



**श्यामा प्रसाद मुखर्जी पोर्ट, कोलकाता**  
**SYAMA PRASAD MOOKERJE PORT, KOLKATA**  
(Erstwhile KOLKATA PORT TRUST)

(AN AUTONOMOUS BODY UNDER THE MINISTRY OF PORTS,  
SHIPPING AND WATERWAYS, GOVERNMENT OF INDIA)

**KOLKATA DOCK SYSTEM**

\*

\*\*

**निविदा के लिए एन.एस. में बैक यार्ड के विकास सहित 7 के पुनर्वास के लिए डिजाइन, इंजीनियरिंग एवं निर्माण कार्य हेतु परियोजना प्रबंधन सलाहकार (पीएमसी) के चयन हेतु आरएफपी। डॉक, केडीएस, एसएमपी, कोलकाता”**

**TENDER FOR RFP for selection of Project Management Consultant (PMC) for the work of “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA”**

**सिविल इंजीनियरिंग विभाग**  
**Civil Engineering Department**  
**श्यामा प्रसाद मुखर्जी पोर्ट, कोलकाता**  
**SYAMA PRASAD MOOKERJEE PORT, KOLKATA**

निविदा संख्या / **TENDER NO.:** SMPK/KDS/CIV /T/2675/34 DT. 31.05.2022

## **Disclaimer**

1. This RFP document is neither an agreement nor an offer by the Syama Prasad Mookerjee Port, Kolkata (SMPK) to the prospective Applicants or any other person. The purpose of this RFP is to provide information to interested parties that may be useful to them in the formulation of their proposal pursuant to this RFP.

2. SMPK does not make any representation or warranty as to the accuracy, reliability or completeness of the information in this RFP document and it is not possible for SMPK to consider particular needs of each party who reads or uses this RFP document. This RFP includes statements which reflect various assumptions and assessments arrived at by SMPK in relation to the consultancy. Such assumptions, assessments and statements do not purport to contain all the information that each Applicant may require. Each prospective applicant should conduct its own investigations and analyses and check the accuracy, reliability and completeness of the information provided in this RFP document and obtains independent advice from appropriate sources.

3. SMPK will not have any liability to any prospective Applicant/Consultancy Company/Firm/Consortium as the case may be or any other person under any laws (including without limitation the law of contract, the principles of equity, restitution or unjust enrichment or otherwise for any loss, expense or damage which may arise from or be incurred or suffered in connection with anything contained in this RFP document, any matter deemed to form part of this RFP document, the award of the Assignment, the information and any other information supplied by or on behalf of SMPK or their employees, any consultants or otherwise arising in any way from the selection process for the Assignment. SMPK will also not be liable in any manner whether resulting from negligence or otherwise however caused arising from reliance of any Applicant upon any statements contained in this RFP.

4. SMPK will not be responsible for any delay in receiving the proposals. The issue of this RFP does not imply that SMPK is bound to select an Applicant or to appoint the Selected Applicant, as the case may be, for the consultancy and SMPK reserves the right to accept/reject any or all of proposals submitted in response to this RFP document at any stage without assigning any reasons whatsoever. SMPK also reserves the right to withhold or withdraw the process at any stage with intimation to all who submitted the RFP Application.

5. The information given is not an exhaustive account of statutory requirements and should not be regarded as a complete or authoritative statement of law. SMPK accepts no responsibility for the accuracy or otherwise for any interpretation or opinion on the law expressed herein.

6. SMPK reserves the right to change/ modify/ amend any or all provisions of this RFP document. Such revisions to the RFP/ amended RFP will be made available on the website.

## **TABLE OF CONTENTS**

(1) Letter of Invitation.....	5
1.1 Introduction.....	5
1.2 Objective .....	5
1.3 Submission.....	5
1.4 Selection Process.....	6
1.5 Contents of this RFP .....	6
1.6 Amendments.....	6
1.7 SMPK reserves the right to accept or reject any or all Proposals without assigning any reason and no correspondence shall be entertained in this regard. .....	6
Critical Data Sheet.....	7
(2) Instructions to Applicants (ITA) .....	9
2.1 Introduction.....	9
2.2 Amendment of RFP documents.....	11
2.3 Clarification and/ or interpretation of reports.....	11
2.4 Ownership of document and copyright.....	11
2.5 Bid Security .....	12
2.6 Applicants.....	12
2.7 Preparation of Proposal .....	13
2.8 Submission, receipt and opening of Proposals .....	16
2.9 Eligible Assignments and Minimum Eligibility Criteria .....	17
2.10 Proposal Opening and Evaluation Process.....	18
2.11 Negotiation .....	19
2.12 Award of contract .....	19
2.13 Confidentiality.....	20
2.14 Fraud and corrupt practices.....	20
2.15 Miscellaneous.....	21
2.16 Data Sheet.....	21
2.17 Instructions for Online Bid/Proposal Online Submission .....	26
(3) Technical Proposal and Standard Forms .....	29
FORM 3A: Technical Proposal Submission Form/ Declaration.....	30
Form 3B: General Information of Applicant.....	33
FORM 3C: Format for Technical Capacity - (Eligible Assignments) .....	34
Form 3D: Statutory Auditors/ Chartered Accountant certificate for Eligible Assignment .....	35
FORM 3E: Financial Capacity .....	36
FORM 3F: Format of Power of Attorney for Authorised Representative.....	37
FORM 3G: Deleted .....	38

FORM 3H: Team Composition and Task Assignments	39
FORM 3I: Curriculum Vitae (CV) for Proposed Staff (with one page of summary of experience)	40
Form 3J: Format of Pre-Proposal Queries	41
FORM 3K: INTEGRITY PACT	43
FORM 3L: Statement of Legal Capacity	44
(4) Financial Proposal - Standard Forms	45
FORM 4A: Financial Proposal Submission Form	46
FORM 4B: Summary of Costs	47
(5) Terms of Reference (ToR)	48
(6) Standard Forms of Contract	64
I. Form of Contract	65
II. General Conditions of Contract	67
III. Special Conditions of Contract	104
Annexure A- Price Bid	127

## (1) Letter of Invitation

### 1.1 Introduction

(1) Syama Prasad Mookerjee Port formerly known as Kolkata Port Trust is the oldest Major Port in the country. The city of Kolkata has a synergistic linkage with the Port. In course of time, the power to rule this vast country passed from East India Company to the British Crown. The affairs of the Port were brought under the administrative control of the Government with the appointment of a Port Commission in 1870. After independence, the Port was declared as a Major Port in 1975 after Major Port Trust Act, 1963 came into force.

(2) SMPK/ Ministry of Ports, Shipping and Waterways (MoPSW) intends to appoint a consultant for conducting a work of “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA”

(3) For the above, Syama Prasad Mookerjee Port, Kolkata (hereinafter referred as “SMPK” or “Client”) invites online proposals from the various consultant to undertake this Assignment:

Project Management Consultant for the work “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA” as per the terms and conditions stipulated in this RFP.

(4) The Consultants shall perform accordance with the Terms of Reference specified at Section 5 (Terms of Reference (ToR)).

### 1.2 Objective

The present work is intended to engage PMC to perform the following objectives,

a) The objective of this consultancy is to efficiently manage the EPC Contract awarded to the successful bidder for the main work, such that each and every activity envisaged for the project is completed in stipulated time kept for successful completion of the project, within budgeted cost frame and in full compliance with the guidelines and applicable Employer's acts, rules and regulations. The objective is also to ensure compliance to achieve project monitoring indicators and milestones as agreed-upon within the stipulated time frame. Report to the Client on technical and financial aspects including progress and supervision of work during execution period.

b) The PMC will be required to provide a team of qualified experts covering required fields for a specific period, including full-time and need based/ part time resource deployment, as specified in ToR.

### 1.3 Submission

- The Proposal in the prescribed format, shall be submitted online at <https://kopt.enivida.in> as per the RFP document. No proposal will be accepted in hard copy, fax, e-mail or any other such means. The Applicant must be registered with e-tender website <https://kopt.enivida.in>. also, the intending bidders should submit the tender cost of **Rs.1770/- (Rupees one thousand seven hundred and seventy only) including @18% GST** to SMPK through DD/Banker's Cheque in favour of Syama Prasad Mookerjee Port, Kolkata on any scheduled/Nationalised Bank payable at Kolkata otherwise their offer will be summarily rejected.

**Or**

Payable through RTGS / NEFT/ Bank Transfer etc., to be transferred on  
A/C: Syama Prasad Mookerjee Port, Kolkata  
A/c No: 067502000000491  
IFSC: IOBA0000675  
Bank Name: Indian Overseas Bank  
Branch Name: STRAND ROAD Branch

- **Bid Security/ (Earnest Money): -**

A bid Security of **Rs. 3,93,850/- (Rupees Three Lakhs Ninety- Three Thousand Eight Hundred and Fifty Only)** to be paid through NEFT from a Nationalised Bank/Scheduled Bank in favour of SMPK for the sum as specified in the RFP shall be required to be submitted by each Applicant ("Bid Security/Earnest Money"). Proposal received without the specified Bid Security will be summarily rejected

- **Railtel Tender Processing Fee (Non-refundable) Mode of Payment:** - E-payment Only through Debit/Credit Card or Net Banking.

TPF- **0.1%** of estimate cost (Minimum 750/- Maximum 7500/-+GST Registration Charges Rs.2000/- +Applicable GST Per Year).

#### **1.4 Selection Process**

The Consultant will be selected on the Price based System (**Least Cost Selection**) as per procedures described in this RFP.

#### **1.5 Contents of this RFP**

The RFP includes the following documents:

SECTION 1: Letter of Invitation

SECTION 2: Instructions to Applicants

SECTION 3: Technical Proposal - Standard Forms

SECTION 4: Financial Proposal - Standard forms

SECTION 5: Terms of Reference

SECTION 6: I – Standard Form of Contract

II – General Conditions of Contract

III – Special Conditions of Contract

Appendices: Other relevant information, forms and formats.

#### **1.6 Amendments**

All amendments / corrigenda will only be published on the e-tender website <https://kopt.enivida.in> and on the SMPK website- <https://smporkolkata.shipping.gov.in> .

**1.7** SMPK reserves the right to accept or reject any or all Proposals without assigning any reason and no correspondence shall be entertained in this regard.

## **Critical Data Sheet**

The Proposal complete in all respects, should be submitted online as per sequence mentioned below. In case the same is not being in order, SMPK shall not be responsible for missing any document while evaluating the proposals. Proposal should be submitted in two covers.

### **(1) Cover-I: Technical Proposal**

#### **(a) RFP processing Fee & Bid Security**

(i) Scanned copy of the proof for the submission of RFP Processing Fee as per clause 2.1.19 of this RFP

(ii) Scanned copy of the proof for the submission of Bid Security as per clause 2.5 of this RFP

(iii) Scanned copy of the proof for the submission of Tender Cost as per relevant clause of this RFP

#### **(b) Enclosure-I- Scanned copy of the following documents: -**

(i) Signed Technical Submission form/ Declaration as per **Form 3A** provided in Section-3.

(ii) Provide the General Information of Applicant as per **Form 3B**

(iii) Format of Technical Capacity (Eligible Assignments) duly filled and signed by Authorized Signatory of the Applicants as per **Form 3C** provided in Section-3

(iv) Documentary evidence in support of Eligible Assignments as per Clause 2.9 of this ITA.

(A) Completion Certificate issued by the Client for the Assignment and Work Order.

(v) Deleted .

(vi) Format of Financial Capacity duly filled and signed by Authorized Signatory of the Applicants as per **Form 3E** along with the certificate of Statutory Auditors/Chartered Accountant.

(vii) Format of Power of Attorney for Authorized Signatory duly filled and signed as **per Form 3F**.

(viii) Deleted-

(ix) Format of Team Composition and Task Assigned duly signed by the Authorized Signatory of Applicants as per **Form 3H**

(x) Format of Curriculum Vitae (CV) for the proposed Key Personnel as **Form 3I** duly signed by the respective Key Personnel and Authorized signatory of the Applicant

(xi) **Form 3L** –Deleted .

(xii) **Form 3K**-. Deleted .

#### **(c) Enclosure-II: Scanned copies of the following document: -**

(i) RFP document with all addendums and Corrigendum issued till date duly signed by the Applicant (Digital Signature on the front and last page of the RFP and Corrigendum will suffice the purpose)

(ii) Copy of GST Registration (self-certified copy)

(iii) Copy of PAN card of the Applicant (self-certified copy)

(iv) Copy of valid NSIC Certificate or MSME Certificate under **MSME** has to be submitted along with the bid.

(v) All the documents submitted shall be signed and stamped by the Applicant it may be noted that the Technical Proposal shall not contain any reference to the Financial Proposal.

Vi) Self declaration of the bidder that the Bidding Firm has Not been debarred / de-listed by any Govt / Quasi Govt. / Public Sector undertaking in India **(to be mentioned in the letter head of the Firm).**

vii) Self-declaration regarding the proprietor/partner(s)/authorized signatory of the bidding firm (in the case of proprietorship firm /partnership firm /limited company, as the case may be) is/are not associated with any other firm bidding for the same work **(to be mentioned in the letter head of the Firm).**

## 2) Cover-II

Financial Proposal shall be submitted online only as per the format provided in the Tender website, as mentioned above.

### (3) Important Dates: -

S L. NO.	Activity	Timeline
1 .	Date of issue of RFP / publishing date (T)	31.05.2022
2 .	Period of Download of E-Tender	06.06.2022 to 12.07.2022 (up to 14:00 hrs.)
3 .	Last date of submission of e-tender	12.07.2022 (up to 15:00 hrs.)
4 .	Pre – Bid Meeting Date & Time(On line) Link will be shared through Corrigendum .	<b>20.06.2022 at 11:30 Hrs.</b>
5 .	Opening of the Technical Proposal	13.07.2022 (after 15:00 hrs.)
6 .	Last date of submission of EMD & Tender Document fee at Syama Prasad Mookerjee Port, Kolkata	15.07.2022 (up to 12:00 hrs.)
7 .	Opening of the Financial Proposal	To be intimated to Technically Qualified Applicants.



## (2) Instructions to Applicants (ITA)

### 2.1 Introduction

2.1.1 Applicants are advised that the selection of Consultant shall be on the basis of an evaluation by Client through the selection process specified in this RFP (the “Selection Process”). Applicants shall be deemed to have understood and agreed that no explanation or justification for any aspect of the Selection Process will be given and that Client’s decisions are without any right of appeal whatsoever.

2.1.2 The Applicants are invited to submit Technical and Financial Proposals (collectively called as “the Proposal”), as specified in this RFP / Data Sheet, for the services required for the Project Management Consultant for the work of **“DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA”**, hereinafter referred to as the “Assignment”. The Proposal will form the basis for contract signing with the Consultancy. The Consultancy shall submit the Deliverables in accordance with the Terms of Reference of this RFP (the “ToR”).

2.1.3 The Applicants shall submit the Proposal in the form and manner specified in this RFP. The Proposal shall be submitted as per the forms given in relevant sections herewith. Upon selection, the Consultancy shall be required to enter into a contract with the Client in the form specified in this RFP (the “Contract”).

2.1.4 Applicants should familiarize themselves with local conditions and take them into consideration in preparing their Proposals.

2.1.5 The Client will provide, at no cost to the Consultant, available inputs, if any required to carry out the services.

2.1.6 Applicants shall bear all costs associated with the preparation and submission of their proposals, and their participation in the Selection Process, including but not limited to postage, delivery charges, expenses associated with any demonstrations or presentations, attending all the meetings which may be required by Client or any other costs incurred in connection with or relating to its Proposal. The Client is not bound to accept any Proposal and reserves the right to annul the Selection Process at any time prior to Contract award, without thereby incurring any liability to the Applicants.

2.1.7 Client requires that the Consultancy provide professional, objective, and impartial advice and at all times hold Client’s interests’ paramount, avoid conflicts with other assignments or its own interests, and act without any consideration for future work. The Consultant shall not accept or engage in any assignment that may place it in a position of not being able to carry out the Assignment in the best interests of Client.

2.1.8 It is the Client’s policy to require that the Applicants observe the highest standard of ethics during the Selection Process and execution of such contracts. In pursuance of this policy, the Client:

(1) Defines, for the purposes of this provision, the terms set forth below:

(a) **“Corrupt practice”** means the offering, giving, receiving, or soliciting anything of value to influence the action of officials in the Selection Process or in contract execution; and

(b) **“Fraudulent practice”** means a misrepresentation of facts in order to influence the selection process or the execution of a contract in a way which is detrimental to the Client and includes collusive

practices among consultants (prior to or after submission of proposals) designed to establish prices at artificial, non-competitive levels and to deprive the Client of the benefits of free and open competition.

(2) SMPK will **reject** the Proposal for award if it determines that the Applicant has engaged in corrupt or fraudulent activities in competing for the contract in question.

(3) SMPK will declare an Applicant ineligible, either indefinitely or for a stated period of time, to be awarded a contract if it at any time determines that the Applicant has engaged in corrupt or fraudulent practices in competing for and in executing the contract.

2.1.9 In the event any entity has been barred by the Central Government, any State Government, a statutory authority or a public sector undertaking, as the case may be, from participating in any project or bid, and the bar subsists as on the date of the Proposal Due Date, it would not be eligible to submit a Proposal.

2.1.10 Deleted

2.1.11 Deleted

2.1.12 Details related to timelines and submission of deliverables is given in the **Terms of Reference** (ToR- Section 5)

2.1.13 The Proposal shall be valid for a period of not less than 180 (one hundred and eighty) days from the Proposal Due Date.

2.1.14 **Brief Description of the Selection Process:** The Client has adopted a **two-stage process** (referred to as the "**Selection Process**") for the evaluation of the Proposals. The proposals shall comprise of two parts namely - the Technical Proposal and Financial Proposal. In the first stage, the evaluation of Technical Proposals will be carried out. Based on this technical evaluation as mentioned in this RFP, a list of Technically Qualified Applicants shall be prepared. In the second stage, the Financial Proposals of Technically Qualified Applicants will be evaluated. The Applicant quoting the **lowest fee** (L1- the "**Successful Applicant**") may be invited for discussion as per RFP Terms.

2.1.15 **Number of Proposals:**

Applicant(s) may submit proposal as sole Applicant. However, no Applicant can submit more than one Proposal for the Consultancy.

2.1.16 Deleted

2.1.17 **Right to reject any or all Proposals:**

(1) Notwithstanding anything contained in this RFP, the Client reserves the right to accept or reject any Proposal and to annul the Selection Process and reject all Proposals, at any time without any liability or any obligation for such acceptance, rejection or annulment, and without assigning any reasons thereof.

(2) Without prejudice to the generality of above, the Client reserves the right to reject any Proposal if:

(a) at any time, a material misrepresentation is made or discovered, or

(b) the Applicant does not provide, within the time specified by the Client, the supplemental information sought by the Client for evaluation of the Proposal.

(3) Such misrepresentation / improper response by the Applicant may lead to the disqualification of the Applicant. If such disqualification / rejection occurs after the Proposals have been opened and the Successful Applicant gets disqualified / rejected, then the Client reserves the right to appropriate /forfeit the Bid security of the Successful Applicant, consider the next best Applicant and take any

other measure as may be deemed fit in the sole discretion of the Client, including annulment of the Selection Process.

#### 2.1.18 Acknowledgement by Applicant

- (1) It shall be deemed that by submitting the Proposal, the Applicant has:
- (a) made a complete and careful examination of the RFP;
  - (b) received all relevant information requested from the Client;
  - (c) accepted the risk of inadequacy, error or mistake in the information provided in the RFP or furnished by or on behalf of the Client;
  - (d) satisfied itself about all matters, things and information, including matters herein above, necessary and required for submitting an informed Application and performance of all of its obligations there under;
  - (e) acknowledged that it does not have a Conflict of Interest; and
  - (f) agreed to be bound by the undertaking provided by it under and in term hereof.

(2) The Client and / or its advisors / consultants shall not be liable for any omission, mistake or error on the part of the Applicant in respect of any of the above or on account of any matter or thing arising out of or concerning or relating to RFP or the Selection Process, including any error or mistake therein or in any information or data given by the Client and/ or its consultant.

#### 2.1.19 RFP Processing Fee:

The intending bidders should submit the tender cost of **Rs.1770/- (Rupees one thousand seven hundred and seventy only) including @18% GST** to SMPK through DD/Banker's Cheque in favour of Syama Prasad Mookerjee Port, Kolkata on any scheduled/Nationalised Bank payable at Kolkata otherwise their offer will be summarily rejected.

**Or**

Payable through RTGS / NEFT / Bank Transfer etc., to be transferred on

A/C: Syama Prasad Mookerjee Port, Kolkata

A/c No: 067502000000491

IFSC: IOBA0000675

Bank Name: Indian Overseas Bank

Branch Name: STRAND ROAD Branch

**Railtel Tender Processing Fee (Non-refundable) Mode of Payment:** - E-payment Only through Debit/Credit Card or Net Banking.

TPF- **0.1%** of estimate cost (Minimum 750/- Maximum 7500/-+GST Registration Charges Rs.2000/-+Applicable GST Per Year).

#### 2.1.20 Pre-Proposal/ Pre – Bid Meeting

(1) A pre-proposal meeting shall be held as per date mentioned in the Data Sheet. A Virtual pre-proposal meeting URL link will be intimated through the website vide Corrigendum.

(2) During the course of pre-proposal meeting, the Applicant will be free to seek clarifications and make suggestions for consideration by the Client. The Client will endeavour to provide clarifications

and such further information as it may in its sole discretion, consider appropriate for facilitating a fair, transparent and competitive selection process.

(3) The Applicants any put forth their pre-proposal queries in the format prescribed in **Form 3J** in section 3.

## 2.2 Amendment of RFP documents

### 2.2.1 Deleted

2.2.2 At any time before the submission of Proposals, the Client may, for any reason, modify the RFP document by issuing an amendment. All amendment / corrigenda will be posted on the website mentioned in the Data Sheet.

### 2.2.3 Deleted

### 2.3 Deleted

### 2.4 Deleted

## 2.5 Bid Security/ (Earnest Money):-

2.5.1 A bid Security of **Rs. 3,93,850/- (Rupees Three Lakhs Ninety Three Thousand Eight Hundred and Fifty Only)** to be paid through NEFT from a Nationalised Bank/Scheduled Bank in favour of SMPK for the sum as specified in the RFP shall be required to be submitted by each Applicant ("Bid Security/Earnest Money"). Proposal received without the specified Bid Security will be summarily rejected.

2.5.2 Client will not be liable to pay any interest on Bid Security. Bid Security of unsuccessful Applicants shall be returned, without interest, within one month after signing of the contract with the successful Applicant or when the Selection process is cancelled by Client. The successful Applicant's Bid Security shall be returned, without any interest upon Applicant signing the Contract and furnishing the Performance Security in accordance with the provision of the RFP and Contract.

2.5.3 Client will be entitled to appropriate/forfeit the Bid Security as mutually agreed loss and damage payable to client in regard to the RFP without prejudice to Client's any other right or remedy under the following conditions-

(1) If an Applicant engages in a corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice as envisaged under this RFP (including the Standard Form of Contract)

(2) If any Applicant withdraws its Proposal during the period of its validity as specified in this RFP or if the Bid Validity Period is extended by the Applicant,

(3) In the case of the Successful Applicant, if the Successful Applicants fail to sign the Contract or provide the Performance Security within the specified time limit, or

(4) If the Applicant commits any breach of terms of this RFP or is found to have made a false representation to Client.

### 2.5.4 Performance Security: - As per Clause No. 2.12.2

## 2.6 Applicants

2.6.1 For Micro & Small Enterprises (MSEs) registered with NSIC & or MSME: -

a) Micro & Small Enterprises (MSEs) registered with NSIC (under single

point registration scheme) or **MSME** are exempted from depositing Cost of Tender Document.

b) If Micro & Small Enterprises (MSEs) registered with **NSIC or MSME** intends to participate in the tender, for the items they are not registered with NSIC, then they will have to deposit cost of Tender Document, as per NIT. **Otherwise their offer will not be considered.**

c) Copy of valid NSIC Certificate for MSEs has to be submitted along with bid.

d) Tenderers submitted without requisite Earnest Money are liable to be rejected excepting in case of Micro & Small Enterprises (MSEs) registered with NSIC (under single point registration scheme) or MSME for items for which the tender is invited

2.6.2 An Applicant may be a Natural person, partnership firm, LLP, private entity or government-owned entity and should submit the proposal in accordance with the terms of this RFP. Applicant can apply only on sole basis and should be registered in India; **JV/Consortium is not allowed.**

### 2.6.3 Conflict of Interest

(1) Client requires that successful Applicant (Consultant) provides professional, objective and impartial advice and at all times holds Client's interest paramount, strictly avoids conflicts with other assignment(s)/ job(s) or his own corporate interest and act without any consideration for future work.

(2) Without limitation on the generality of the foregoing, Applicants and their affiliates shall be considered to have a conflict of interest, unless stated otherwise and shall not be recruited, under any of the circumstances set forth below: -

(a) **Conflicting activities:** - A firm that has been engaged by the client to provide Goods, Works, or Non-Consulting services for a project, or any of its affiliates, shall be disqualified from providing Consulting service resulting directly related to Goods, Works or Non-consulting services. Conversely, a firm hired to provide consultancy services for the preparation or implementation of a Project, or any of its affiliates, shall be disqualified from subsequently providing Goods, or Works or Non-consulting services resulting from or directly related to the consulting services for such preparation or implementation.

(b) **Conflicting Assignment/Job:** - A consultant (including its Personnel and Sub-Consultant(s) or any of its affiliates shall not be hired for any assignment/job that, by its nature, may be in conflict with another assignment/Job of the Consultant to be executed for the same or another Client, for example a consultant hired to prepare engineering design for an infrastructure project shall not be engaged to prepare an independent environmental assessment for the same project and a Consultant assisting a Client in the privatization of public assets shall not purchase nor advise purchasers of such assets.

(c) **Conflicting Relationship:** - A Consultant (including its Personnel and Sub-Consultant) that has a close business or family relationship with a member of the Client's Staff who is directly or indirectly involved in any part of (i) the preparation of the Terms of Reference of the assignment/job, (ii) the selection process for such assignment/job or (iii) supervision of the Contract, may not be awarded a Contract, unless the conflict stemming from this relationship has been resolved in a manner acceptable to the Client throughout the selection process and execution of the contract.

(3) Consultants have an obligation to disclose any situation of actual or potential conflict that impacts their capacity to serve the best interest of their Client or that may reasonably be perceived as having this effect. Any such disclosure shall be made as per the standard forms of Technical provided herewith. If the consultant fails to disclose said situations and if Client comes to know about such situation at any time, it may lead to the disqualification of the consultant during the proposal evaluation process or termination of its contract during the execution of assignment.

- 2.6.4 Self declaration of the bidder that the Bidding Firm has Not been debarred / de-listed by any Govt / Quasi Govt. / Public Sector undertaking in India **(to be mentioned in the letter head of the Firm).**
- 2.6.5. Self-declaration regarding the proprietor/partner(s)/authorized signatory of the bidding firm (in the case of proprietorship firm /partnership firm /limited company, as the case may be) is/are not associated with any other firm bidding for the same work **(to be mentioned in the letter head of the Firm).**

2.6.6 Deleted

## **2.7 Preparation of Proposal**

2.7.1 Applicants are requested to submit their Proposal in English language and strictly in the formats provided in this RFP. The Client will evaluate only those Proposals that are received in the specified forms and complete in all respects. All the documentary evidence and other submissions should only be in English Language.

2.7.2 In preparing their Proposal, Consultants are expected to thoroughly examine the RFP document. Material deficiencies in providing the information requested may result in rejection of a Proposal.

2.7.3 Technical Proposal: While preparing the Technical Proposal, Consultants must give particular attention to the following:

(1) Minimum Eligibility Criteria with regard to Technical and Financial Capacity of the Applicant- Clause 2.9.2 and 2.9.3

(2) Deleted

(3) Documentary evidence and other information as provided in clause 2.9.4 of this RFP (Instruction to Applicants)

### **(4) The Key Personnel**

(i) The Key proposed personnel must be permanent full-time employees of the firm or hired on contract by the firm.

(ii) The composition of the proposed Team and Task Assignment to Key Personnel shall be clearly stated.

(iii) No Key Personnel shall be proposed for any position if the CV of the Key Personnel does not meet the requirements of the ToR.

(iv) The Key Personnel shall remain available for the period as indicated in the RFP.

(v) No alternative proposal for any Key Personnel shall be made and only one CV for each position shall be furnished.

(vi) Each CV needs to have been recently signed by the Key Personnel and/or countersigned by the authorized official of the Firm. At the time of submission of Proposal, the scanned copies of the signature of Key Personnel will be allowed but at the time of signing of Contract, the original signature will be required. However, in both the cases, original counter signature of Authorized Signatory shall be required in original.

(vii) A CV shall be summarily rejected if the educational qualification and experience of the Key Personnel proposed does not match with the requirement of the RFP document.

(viii) The client reserves the right to interview Key Personnel proposed by the Applicant to assess the suitability of the Key Personnel with respect to the requirement set forth in this RFP during the process of evaluation of Proposal.

(ix) The Key Personnel proposed should possess good working knowledge of English language.

#### **(5) Requirement of Personnel:**

They PMC professionals must have relevant experience complying to the requirement of TOR, familiarity with the local conditions and prevalent local laws and must exhibit expertise of International – standards in supervision of large infrastructure projects. Staff nominated by the selected PMC must be confirmed as available for the project to do the scheduled work. The CVs of the proposed professionals must be submitted along with signed declaration by the proposed professional confirming their availability for the project. CVs submitted without such declaration shall not be considered for evaluation.

The PMC team must comprise of highly qualified and experienced Key and Non-Key experts best suited for the assignment. PMC must provide CVs of both key Experts and Non-Key Experts in their Technical Proposal. Some key experts shall be employed intermittently, at interval which would be proposed by SMPK

A team of Total **7 Personnel** (4 Key Personnel + 3 Non- Key Personnel), as mentioned in the TOR of this RFP.

#### **2.7.4 Deleted**

2.7.5 Cover page of the Proposal shall be signed by the Authorized Representative of the Applicant. All the alterations, omissions, additions, or any other amendments made to the Proposal shall be initiated by the person(s) signing the Proposal. The Proposals must be properly signed by the Authorized Representative (the “Authorized Representative”) as detailed below:

(1) by the proprietor in case of a proprietary firm

(2) by a partner, in case of a partnership firm and/or a limited liability partnership; or

(3) by a duly authorized person holding the Power of Attorney, in case of a Limited Company or a corporation; or

(4) Power of Attorney, for the Authorized Representative, to be executed as per Applicable Laws and as per format provided in the RFP.

2.7.6 Applicants should note the Proposal Due Date, as specified in Data Sheet, for submission of Proposals. No supplementary material will be entertained by the Client, and that evaluation will be carried out only on the basis of Documents received by the closing time of Proposal Due Date as specified in Data Sheet. Applicants will ordinarily not be asked to provide additional material information or documents subsequent to the date of submission, and unsolicited material if submitted will be summarily rejected. For the avoidance of doubt, the Client reserves the right to seek clarifications in case the proposal is non-responsive on any aspects.

#### **2.7.7 Deleted**

#### **2.7.8 Deleted.**

#### **2.7.9 Deleted.**

2.7.10 The Technical Proposal should provide the information as per various Standard Forms provided in Section-3 of this ITA. The standard forms shall be duly filled, stamped and signed by the

Authorized Signatory of the Applicant with all the supporting documents as mentioned therein in various Standard Technical Forms and provided in this ITA.

(1) For Eligible Assignments, the outline should indicate, inter alia, the profiles and names of the staff provided, duration of the assignment, contract amount, and firm's involvement along-with documentary evidence as detailed out in TOR of this RFP.

(2) **Each page of the CV must be signed in original** by the Authorized Representative together with original or electronic signature of the Key Personnel. However, at the time of contract signing, original signatures of both Authorized Representative and Key Personnel shall be required.

2.7.11 Entire RFP documents along with any Addendum, Corrigendum issued shall be stamped and signed by the Authorized signatory of the Applicant and submitted the same in the Technical Proposal.

2.7.12 **Financial Proposal:** While preparing the Financial Proposal, Applicants are expected to take into account the various requirements and conditions stipulated in this RFP document. The Financial Proposal should be inclusive of all costs including but not limited to all applicable taxes associated with the Assignment. While submitting the Financial Proposal, the Applicant shall ensure the following:

(1) All the costs associated with the Assignment shall be included in the Financial Proposal. These shall normally cover remuneration for all Key Personnel, transportation, equipment, printing of documents, secondary and primary data collection, coordination and tie up with the stakeholders, attending all the meetings/discussions of Working Groups etc. The total amount indicated in the Financial Proposal shall be without any condition attached or subject to any assumption and shall be final and binding. In case any assumption or condition is indicated in the Financial Proposal, it shall be considered non-responsive and liable to be rejected.

(2) The Financial Proposal shall take into account all the expenses and tax liabilities and cost of insurance specified in the draft contract, levies and other impositions applicable under the prevailing law on the Applicants, sub-consultants and their staff. For the avoidance of doubt, it is clarified that all taxes, excluding GST, shall be deemed to be included in the cost shown in the Financial Proposal. The Applicant shall be paid only applicable tax over and above the Consultancy fee on submission of documents. Further, all payments shall be subjected to deduction of taxes at source as per Applicable Laws.

2.7.13 The Financial Proposal should be submitted online only as per the format provided on the tender website. The copy of standard Financial Proposal submission forms prescribed in this RFP for reference only

2.7.14 The Financial Proposal shall be in lumpsum which is payable as per deliverables and Methodology of Payment prescribed in the Terms of Reference of this RFP. Applicants shall provide the price of their services in Indian Rupees.

2.7.15 Applicants must do their due diligence about the tax implications and Client will not be liable for any incident.

2.7.16 The Proposals must remain valid for a period of **180 days** from the Proposal Due Date as specified in the Data Sheet. During this period, the Consultant is expected to keep available the Key Personnel proposed for the Assignment. The Client will make its best effort to complete Contract signing within this period. If the Client wishes to extend the validity period of the Proposals, it may ask the Applicants to extend the validity of their Proposals for a stated period. Consultants, who do not agree, have the right not to extend the validity of their Proposals.

## **2.8 Submission, Receipt and Opening of Proposals**

### **2.8.1. Submission of Proposals**



The Technical Proposal and Financial Proposal, complete in all respects, should be submitted online as per sequence mentioned below. **Proposal should be submitted in two covers.**

(1) **Cover-I: Technical Proposal**

(a) **RFP Processing Fee(Cost of Tender Document ) & Bid Security(EMD):**

(b) **Enclosure-I- Scanned copy of the documents** as stated earlier.

(c) **Enclosure-II: Scanned copies of the documents as stated earlier .**

It may be noted that the Technical Proposal shall not contain any reference to the Financial Proposal.

(2) **Cover-II: Financial Proposal**

**2.9 Eligible Assignments and Minimum Eligibility Criteria**

2.9.1 For the purposes of determining conditions of eligibility and for evaluating the Proposals under this RFP, advisory / consultancy assignments for the following categories shall be deemed as Eligible Assignments (the "Eligible Assignments"):

(1) The intending bidder must have successfully completed **PMC Activities/TPQI for Infrastructure project works related to Construction of Jetty / berth / wharves or Construction of water retaining structure like dam, anicut structure, RCC bridge, Highways** during the last 7 (seven) years ending last day of month previous to one in which applications are invited Industrial Cities

**2.9.2 Technical Capacity**

(1) The Applicants should have successfully completed at least **One (1)** Eligible Assignments in the past 7 years prior to Proposal Due Date with a contract value not less than **Rs. 57.24 Cr.**

OR

(2) **Two (2)** Eligible Assignments in the past 7 years prior to Proposal Due Date each with a contract value not less than **Rs.35.77 Cr.**

OR

(3) **Three (3)** Eligible Assignment in the past 7 years prior to Proposal Due Date each with a contract value not less than **Rs. 28.62 Cr.**

**Note:** - Work experience as a **sub-contractor shall not be considered** as the requisite qualification.

**2.9.3 Financial Capacity: -**

The Average Annual Financial Turnover of the bidding firm during the **last three years**, ending on **31-03-2021**, should be at least **Rs.21.50 Cr. The same should be audited as per relevant norms wherever required along with UDIN of the Auditor.**

**2.9.4 Documentary evidence to substantiate/support Eligible Assignments**

(1) Completion Certificate issued by the Client for the Assignment and Work Order.

(2) Deleted

(3) Statutory Auditors Certificate/ Chartered Accountant to substantiate the Financial Capacity of the Applicant as per Clause 2.9.3 FORM-3E

## **2.10 Proposal Opening and Evaluation Process**

### **2.10.1 Proposal Opening**

Proposal opening shall be carried out in **two stages**.

(1) First, Technical Proposal of all the Proposals received shall be opened online on the date and time mentioned in RFP document.

(2) Financial Proposal of those Applicants whose Technical Proposal has been determined to be responsive and on evaluation, fulfils the Technical Capacity as stipulated in this RFP document, shall be opened on a subsequent date, which will be notified to such Applicants.

(3) In the event of the specified date for the submission of Bids being declared a holiday for SMPK, the Proposals will be opened at the appointed time and location on the next working day.

### **2.10.2 Technical proposal Evaluation**

(1) Prior to evaluation of Proposals, the Client will determine whether each Proposal is responsive to the requirements of the RFP at the time of evaluation (Test of Responsiveness).

A Proposal shall be considered responsive only if:

(a) It is received by the Proposal Due Date and time including any extension thereof, given in the Data Sheet.

(b) It is accompanied by the proof of payment of RFP processing fee.

(c) It is accompanied by the Bid Security & Cost of Tender .

(2) At the time of Technical Opening, Technical Proposal will be evaluated on the basis of Test of Responsiveness, as per clause 2.10.2 (1).

(3) Only responsive Proposals shall be further taken up for evaluation. The Client shall evaluate the technical Proposals on the basis of the Qualification & Experience of Key Personnel and Minimum Eligibility Criteria specified in the RFP document. In the first stage of evaluation, a proposal shall be rejected if it is found deficient or found not meeting the Technical Capacity.

(4) To assist in the examination, evaluation, and comparison of the Proposals, and qualification of the Applicants, the Client may, at its discretion, ask any Applicant for a clarification of its Proposal, giving a reasonable time for response. The Client, however, is not bound to accept the clarification submitted by the Proposal if found irrelevant. Client's request for clarification and the response shall be in writing or email.

(5) Technical Proposals will be evaluated first as per Clause 2.7.3 (5) wherein the qualification and Experience of the Key Personnel to be met by the Applicants and thereafter the proposal shall be evaluated on the basis of meeting the Minimum eligibility criteria mentioned in 2.9. The Proposals which are meeting the criteria of Key Personnel and Minimum Eligibility Criteria as mentioned in clause 2.7.3 (5) and 2.9 respectively will be declared as passed.

(6) SMPK shall inform the Applicants, whose Technical Proposals fulfil the criteria stipulated in the RFP document, about the opening of Financial Proposal.

(7) Financial Proposals will be opened online as per e-tender website <https://kopt.enivida.in> .

### **2.10.3 Financial Proposal Evaluation**

(1) Applicant quoting the **Lowest Financial Proposal** will be declared as the Successful Applicants (L-1 Applicant)

(2) In event the proposal price of two or more Applicants is found to be the same (Tie-Applicants), SMPK may,

(a) Invite fresh Financial Proposal only from Tie Applicants, however the Financial Proposal quoted by the Tie Applicants in their fresh Financial Proposal should not be higher than the Financial Proposal already quoted by the Applicant.

OR

(b) Take any such measure as may deem fit in its sole discretion including annulment of the RFP process.

2.10.4 The Successful Applicant shall be the Applicant quoting the Lowest Financial proposal. The Applicant quoting the second Lowest Financial Proposal shall be kept as reserve and may be invited at the discretion of the Client for discussion in case the L-1 Applicants withdraws or fails to comply with the requirement mentioned in the RFP.

## **2.11 Clarification**

2.11.1 The Successful Applicant may, if necessary, be invited for further clarifications if required. The discussion shall Generally, not be for reducing the price of proposal but will be for re-confirming the obligations of the consultant under this RFP. Issues such as deployment of Key Personnel, scope of work, methodology and quality of work plan shall be discussed during negotiations. In case the Successful Applicant fails to reconfirm its commitment, the Client reserves the right to designate the next ranked Applicant as the Successful Applicant and invite for discussion.

2.11.2 The Client will not normally consider **substitutions** except in cases of incapacity of Key Personnel for reasons of health. Similarly, after award of contract the Client expects all the proposed Key Personnel to be available during implementation of the Contract. The Client will not consider substitutions during contract implementation except under exceptional circumstances up to a maximum of 1 (one) Key Personnel and that too by only equally or better qualified and experienced personnel.

## **2.12 Award of contract**

2.12.1 After selection, a Letter of Award (the "LOA") will be issued, in duplicate, by the Client to the Successful Applicant and the Successful Applicant shall, within 3 (three) days of the receipt of the LOA, sign and return the duplicate copy of the LOA in acknowledgement thereof. In the event the duplicate copy of the LOA duly signed by the Successful Applicant is not received by the stipulated date, the Client may, unless it consents to extension of time for submission thereof, appropriate the Bid Security of such Applicant as mutually agreed genuine pre-estimated loss and damage suffered by the Client on account of failure of the Successful Applicant to acknowledge the LOA, and the next ranked Applicant (L-2) may be considered.

### **2.12.2 Performance Security/Guarantee:**

The Successful Contractor should submit a Performance Guarantee in the form of B.G. for **3 % of contract value** in SMPK's proforma from a Nationalised Bank within 21 days from the date of receipt of LOI/Work Order, failing which the contract would be rescind without any further notice. For the Successful Applicant, the Performance Security will be retained by Client until the completion of the Assignment by the Consultant and be released **90 (Ninety) Days** after the completion of the Assignment as per the terms of the Contract.

The P.G shall be accepted with effect from the date of W.O/LOI. The SMPK bank account details to which amount is to be transferred (accepted only online payable through RTGS / NEFT / Bank Transfer etc) is mentioned below:

A/C: Syama Prasad Mookerjee Port, Kolkata A/c No: 067502000000491

IFSC: IOBA0000675

Bank Name: Indian Overseas Bank Branch Name: STRAND ROAD Branch, Kolkata

The contractor shall be required to deposit an amount equal to 3% of the tendered value of the contract as Performance Guarantee. Performance Guarantee is to be furnished within 21 (twenty-one) days after notification of the award and it should remain valid for a period of 90 (ninety) days beyond the date of completion of all contractual obligations of the contractor. The performance security will be forfeited and credited to the procuring entity's account in the event of a breach of contract by the contractor.

**Refund of performance Security/ Guarantee:**

The performance guarantees to be refunded to the contractor without interest, after he duly performs and completes all obligations under the contract .

**2.12.3 Execution of Contract:** After acknowledgement of the LOA and furnishing of Performance Security as aforesaid by the Successful Applicant, the Successful Applicant shall execute the Agreement within 7 (Seven) days from the date of issue of LOA. The Successful Applicant shall not be entitled to seek any deviation in the Agreement.

**2.12.4 Commencement of Assignment:** The Successful Applicant / Consultant is expected to commence the Assignment on the date of Commencement of Service as prescribed in the General Conditions of Contract. If the Successful Applicant fails to either sign the Agreement or commence the Assignment as specified herein, the Client may invite the second ranked

Applicant for contract signing. In such an event, the Bid Security / Performance Security, as the case may be, of the Successful Applicant shall be liable to be appropriated by the Client.

**2.13 Confidentiality**

Information relating to evaluation of proposals and recommendations concerning awards of contract shall not be disclosed to the consultants who submitted the proposals or to other persons not officially concerned with the process, until the winning firm has been notified that it has been awarded the contract.

**2.14 Fraud and Corrupt practices**

**2.14.1** The Applicants and their respective officers, employees, agents and advisers shall observe the highest standard of ethics during the Selection Process. Notwithstanding anything to the contrary contained in this RFP, the Client will reject a Proposal without being liable in any manner whatsoever to the Applicant, if it determines that the Applicant has, directly or indirectly or through an agent, engaged in corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice (collectively the "Prohibited Practices") in the Selection Process.

In such an event, the Client will, without prejudice to its any other rights or remedies, forfeit and appropriate the Bid Security, as mutually agreed genuine pre-estimated compensation and damages payable to the Client for, inter alia, time, cost and effort of the Client, in regard to the RFP, including consideration and evaluation of such Applicant's Proposal.

2.14.2 Without prejudice to the rights of the Client under this Clause, hereinabove and the rights and remedies which the Client may have under the LOA or the Agreement, if an Applicant or Consultant, as the case may be, is found by the Client to have directly or indirectly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice during the Selection Process, or after the issue of the LOA or the execution of the Agreement, such Applicant or Consultant shall not be eligible to participate in any tender or RFQ cum RFP issued by the Client during a period of **2 (two) years** from the date such Applicant or Consultant, as the case may be, is found by the Client to have directly or through an agent, engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice, as the case may be.

2.14.3 For the purposes of this Clause, the following terms shall have the meaning hereinafter respectively assigned to them:

(1) **“Corrupt practice”** means (i) the offering, giving, receiving, or soliciting, directly or indirectly, of anything of value to influence the action of any person connected with the Selection Process (for avoidance of doubt, offering of employment to or employing or engaging in any manner whatsoever, directly or indirectly, any official of the Client who is or has been associated in any manner, directly or indirectly with the Selection Process or the LOA or has dealt with matters concerning the Agreement or arising there from, before or after the execution thereof, at any time prior to the expiry of one year from the date such official resigns or retires from or otherwise ceases to be in the service of the Client, shall be deemed to constitute influencing the actions of a person connected with the Selection Process; or (ii) save as provided herein, engaging in any manner whatsoever, whether during the Selection Process or after the issue of the LOA or after the execution of the Agreement, as the case may be, any person in respect of any matter relating to the Project or the LOA or the Agreement, who at any time has been or is a legal, financial or technical consultant/ adviser of the Client in relation to any matter concerning the Project;

(2) **“fraudulent practice”** means a misrepresentation or omission of facts or disclosure of incomplete facts, in order to influence the Selection Process;

(3) **“coercive practice”** means impairing or harming or threatening to impair or harm, directly or indirectly, any persons or property to influence any person’s participation or action in the Selection Process;

(4) **“undesirable practice”** means (i) establishing contact with any person connected with or employed or engaged by the Client with the objective of canvassing, lobbying or in any manner influencing or attempting to influence the Selection Process; or (ii) having a Conflict of Interest; and

(5) **“restrictive practice”** means forming a cartel or arriving at any understanding or arrangement among Applicants with the objective of restricting or manipulating a full and fair competition in the Selection Process.

## 2.15 Miscellaneous

2.15.1 The Selection Process shall be governed by, and construed in accordance with, the laws of India and the Courts at New Delhi shall have exclusive jurisdiction over all disputes arising under, pursuant to and/or in connection with the Selection Process.

2.15.2 The Client, in its sole discretion and without incurring any obligation or liability, reserves the right, at any time, to:

(1) suspend and/or cancel the Selection Process and/or amend and/or supplement the Selection Process or modify the dates or other terms and conditions relating thereto;

(2) consult with any Applicant in order to receive clarification or further information;

(3) retain any information and/or evidence submitted to the Client by, on behalf of and/or in relation to any Applicant; and/or

(4) independently verify, disqualify, reject and/or accept any and all submissions or other information and/or evidence submitted by or on behalf of any Applicant.

2.15.3 It shall be deemed that by submitting the Proposal, the Applicant agrees and releases the Client, its employees, agents and advisers, irrevocably, unconditionally, fully and finally from any and all liability for claims, losses, damages, costs, expenses or liabilities in any way related to or arising from the exercise of any rights and/or performance of any obligations hereunder, pursuant hereto and/or in connection herewith and waives any and all rights and/ or claims it may have in this respect, whether actual or contingent, whether present or future.

2.15.4 All documents and other information provided by Client or submitted by an Applicant to Client shall remain or become the property of Client. Applicants and the Consultant, as the case may be, are to treat all information as strictly confidential. Client will not return any Proposal or any information related thereto. All information collected, analysed, processed or in whatever manner provided by the Consultant to Client in relation to the consultancy shall be the property of Client.

2.15.5 The Client reserves the right to make inquiries with any of the clients listed by the Applicants in their previous experience record.

## **2.16 Data Sheet**

2.16.1 The name of Client is: “Syama Prasad Mookerjee Port, Kolkata”

2.16.2 **The address of the Client is:**

Office of the Chief Engineer,

Syama Prasad Mookerjee Port, Kolkata,

2<sup>nd</sup> floor, Head office Building,

15, Strand Road, Kolkata-700001.

Email: [santanumitra@kolkataporttrust.gov.in](mailto:santanumitra@kolkataporttrust.gov.in)

[sk.halder@kolkataporttrust.gov.in](mailto:sk.halder@kolkataporttrust.gov.in)

2.16.3 **Objective and description of the assignment:**

The present work is intended to engage PMC to perform the following objectives,

(1) The objective of this consultancy is to efficiently manage the EPC Contract awarded to the successful bidder for the main work, such that each and every activity envisaged for the project is completed in stipulated time kept for successful completion of the project, within budgeted cost frame and in full compliance with the SMPK guidelines and applicable Employer’s acts, rules and regulations. The objective is also to ensure compliance to achieve project monitoring indicators and milestones as agreed-upon within the stipulated time frame. Report to the Client on technical and financial aspects including progress and supervision of work during execution period.

(2) The PMC will be required to provide a team of qualified experts covering required fields for a specific period, including full-time and need based/ part time resource deployment, as specified in ToR.

(3) The following are the principal tasks envisaged under the PMC services required for the project:

i) To Check and certify the detailed design & drawings of all structural components for the berth and stack yard, submitted by the contractor by a team of experienced engineers with D&Q background within stipulated time frame (for the said item of work) as provided in the main contract on the basis of which approval will be given by the SMPK Authority for construction & further activity to the contractor.

ii) Checking the methodology and bar chart for the whole project work with respect to the total time-line of the project to enable the client to give consent to the contractor to go ahead with the work. Checking of sub-items of work and schemes submitted by the contractor for proper effective implementation of the work and provide suggestion client on above matters. Quick Checking of construction drawings for part work submitted by contractor to facilitate project work during the tenancy of the project work.

iii) Comprehensive Project technical support including day to day supervision for ensuring progress, quality and safety parameters as outlined in the scope of EPC Contract, coordination and management with all stakeholders including Contractors and Clients.

iv) Contract management and Administration Services,

v) Preparing Project Reports and reviewing / updating project activities,

vi) Ensuring Compliance to Quality and Safety parameters for the Project,

a) To provide services to SMP, KOLKATA for monitoring complete quality on the work by carrying out inspection, laboratory testing, quality audit, verification of site records and any other means required in this connection. Inspection of construction equipments including calibration deployed by the contracting agency in order to assess their suitability for the work at site.

b) To deploy required experienced Technical Personnel on the site for PMC & QA to ensure that quality on the work to be maintained as per provision of relevant Contract specification and relevant BIS specifications/IRC and other International standard specifications of work, as detailed in the tender of the main work

c) To provide laboratory facilities for sampling and testing, field-testing facilities and survey equipments etc. during the course of execution as mentioned in the bid document. To carryout NDT and other relevant tests as and when required.

d) To provide services to sort out any Technical problem arisen during the course of execution of the project and to give proper & suitable suggestions to overcome that.

e) Reporting, documentation, quality certification etc.

f) The Selected PMC's representative shall verify and sign all the important registers and site records such as Cement Register, Steel Register, Cube Testing Register, Cylinder Testing Register, Beam Testing Register for flexural strength of CC Pavement, NDT register, Level Books, Record of all sampling, testing & survey works etc. pertaining to works maintained by the main contractor and client

representative.

- g)** In case of any disputes pertaining to work during execution between the SMP, KOLKATA and Contracting Agency, PMC's representative shall participate at site in joint measurements etc. for verification.

- h)** The selected PMC has to perform the work of Design Drawing verification, Third-Party Inspection and Quality Assurance of the work/project to ensure the quality control and quality assurance of the entire work.

This may be detailed as:

- i)** Ensure quality services acceptable to industry standards, codes of practice and job specifications.

Materials compliance verification and inspection.

**ii)**

- iii)** To ensure that materials duly approved by the competent authority/EIC are being used in the work.

Quality and acceptability of Materials and workmanship.

**iv)**

Inspection of the Work at appropriate times.

**v)**

- vi)** Verifications of work in progress with respect to adherence to plans, specifications/drawings and time line.

- vii)** Laboratory testing of construction materials and test samples. Associate with work tests being carried out by Contractor and undertake additional tests as necessary to assess the quality of material and finished products.

- viii)** To ensure that all laboratory tests as laid down in the specifications are carried out at appropriate time and materials failing to conform to the required specifications are promptly rejected and removed from site.

- ix)** Selected PMC should always be present and witness tests on materials, which are required to be carried out at the construction site in a field laboratory, set up by the contractor under the control of the Engineer or his representative of the SMP, KOLKATA, if any. Selected PMC should also test the materials at site in presence of representative of SMP, KOLKATA and Contractor in their own-set up field laboratory, if there be any need of such during the course of execution of the work.

- x)** For detail checking of Pile construction & related work section 8, clause no.8.3.3 of Site condition and specifications of the main Tender document of work to be checked and ensured.

- xi)** Supervision and checking of Pile casting, Pile load test, precast and cast in-Situ concreting work for various structural members like beam, slab, pile muff etc, checking of reinforcement detail as per drawing for RCC work before casting, Granular sub base work for yard, compaction of sand layer, laying of Geo-synthetic stratum, checking of



strength of Paver blocks etc. Selected PMC may also have to provide Technical personnel at RMC plants if the need arises for checking of quality of RMC concrete during casting of pile as well as structural members of berth & stack yard.

Bollards, Fenders and other marine fixtures are to be checked as per Indian/International Standards at manufacturer's works (factory) in presence of Govt approved accredited quality surveyors during testing before delivering and fixing at site.

**XII)** Supervision and ensure of quality of material & workmanship of all works defined in the main project work.

**XIII)** Attending the project review meetings with client & contractor of the main project which may be held at SMP, KOLKATA head office/Operational Office as well as at site also.

**XIV)** NDT tests if required including:

Rebound Hammer Test:

Ultrasonic Pulse Velocity Test:

Concrete Core Extraction:

Rebar Location & Cover-meter:

Half-cell potential Test / Concrete Resistivity Test:

Or any other tests as required to ascertain and checking the quality of work.

**i)** The PMC should also take care of quality control (QC) and quality assurance (QA) of assessments that have been completed. QC is undertaken by checking the final assessment and ensuring compliance with the required criteria. QA is undertaken by checking that the way the final assessment was conducted was itself authentic and correct.

The PMC should also:

**I)** ensure that there is a uniform and consistent approach to and application of the assessment process;

**II)** ensure that all assessors are assessing and applying competence guidelines to the same standard;

**III)** provide support, advice and guidance to assessors;

**IV)** ensure that all assessments and records are accurate and complete;

**V)** resolve problems with interpretation of performance criteria, range statements or knowledge;

Make recommendations as required for appropriate improvements to the

VI) contractor's competence programme.

VII) All materials, components, items shall be identified with proper numbering, marking labels, tags etc. It shall be ensured that the identification is maintained either on the item or its record traceable throughout storage, fabrication, storage and installation stages.

j) Project Management Consultancy shall be responsible for maintaining test result, reports, test certificates, which shall indicate the item details (such as batch no., lot no., date of receipt) and also the inspection status, i.e. "Under inspection", "Inspected", "Found OK" and "Inspected-Rejected". The documents shall act as product identification and traceability records.

QA Program includes elements such as:

I) Document control

Tender and contract control (clauses relevant to PMC & QA at site)

II)

III Calibration/verification of measuring and testing equipment

)

IV) Calibration/verification of all plants and equipments at site deployed for work by the contractor.

Preventive action, Corrective action

V)

Quality audits.

VI)

**Detailed Description of the Project are furnished in the main tender document.**

**2.16.4 Tentative schedule for Selection Process is as follows:**

S L. NO.	Activity	Timeline
1	Date of issue of RFP / publishing date (T)	31.05.2022
2	Period of Download of E-Tender	06.06.2022 to 12.07.2022 (up to 14:00 hrs.)
3	Last date of submission of e-tender	12.07.2022 (up to 15:00 hrs.)
4	Pre – Bid Meeting Date & Time(On line ) Link will be shared through Corrigendum.	20.06.2022 at 11:30 Hrs.
5	Opening of the Technical Proposal	13.07.2022 (after 15:00 hrs.)

6	<b>Last date of submission of EMD &amp; Tender Document fee at Syama Prasad Mookerjee Port, Kolkata</b>	15.07.2022 (up to 12:00 hrs.)
7	<b>Opening of the Financial Proposal</b>	To be intimated to Technically Qualified Applicants.

#### 2.16.5

i) **The RFP Processing Fee** (Cost of Tender Document )for this RFP should submit the tender cost of **Rs.1770/- (Rupees one thousand seven hundred and seventy only) including @18% GST** to SMPK through DD/Banker's Cheque in favour of Syama Prasad Mookerjee Port, Kolkata on any scheduled/Nationalised Bank payable at Kolkata otherwise their offer will be summarily rejected.

**Or**

Payable through RTGS / NEFT / Bank Transfer etc., to be transferred on

A/C: Syama Prasad Mookerjee Port, Kolkata

A/c No: 067502000000491

IFSC: IOBA0000675

Bank Name: Indian Overseas Bank

Branch Name: STRAND ROAD Branch

**ii) Railtel Tender Processing Fee (Non-refundable) Mode of Payment:** - E-payment Only through Debit/Credit Card or Net Banking.

TPF- **0.1%** of estimate cost (Minimum 750/- Maximum 7500/-+GST Registration Charges Rs.2000/-+Applicable GST Per Year).

**iii) Bid Security/ (Earnest Money): -**

A bid Security of **Rs. 3,93,850/- (Rupees Three Lakhs Ninety- Three Thousand Eight Hundred and Fifty Only)** to be paid through NEFT from a Nationalised Bank/Scheduled Bank in favour of SMPK for the sum as specified in the RFP shall be required to be submitted by each Applicant ("Bid Security/Earnest Money"). Proposal received without the specified Bid Security will be summarily rejected.

**iv) Performance Security**

**The Successful Tenderer should submit a Performance Security/Guarantee** in the form of **Bank Guarantee (B.G.)** for 3 % of contract value in SMPK's proforma from a Nationalised Bank within 21 days from the date of receipt of LOI/Work Order, failing which the contract would be rescind without any further notice. The B.G. will remain valid upto three months after the end of the PMC contract.

2.16.6 The proposal of the Applicant should be valid for **180 days** from the Proposal Due Date – Bid Validity Period.

2.16.7 **Duration** of assignment shall be for a period of **21(Twenty one ) Months** from the date of commencement of service as prescribed in General Conditions of Contract.

2.16.8 Procedure for submission of the proposals as detailed out in Clause 2.8.1

2.16.9 No Proposal shall be accepted after the closing time of Proposals.

2.16.10 The Technical Proposal will be opened by the Evaluation Committee of SMPK on the dates mentioned in the Data Sheet.

2.16.11 The official website for accessing the information related to this RFP are,

Bidders are requested to use internet Browsers Firefox version below 50 / Internet Explorer version 8 or above, and Java 8 Update 151 or 161.

Further, bidders are requested to go through the following information and instructions available on the Enivida Portal <https://kopt.enivida.in> before responding to this e-tender:

- \* Bidders Manual Kit
- \* Help for Contractors
- \* FAQ

**2.17 Instructions for Online Bid/Proposal Submission through Tender site:** - As mentioned in this RFP.

#### 2.17.1 Registration

**Railtel Tender Processing Fee (Non-refundable) Mode of Payment:** - E-payment Only through Debit/Credit Card or Net Banking.

TPF- **0.1%** of estimate cost (Minimum 750/- Maximum 7500/-+GST Registration Charges Rs.2000/-+Applicable GST Per Year).

**2.17.2 Searching for Bidding Documents:** - In the website of SMPK and in Enivida Portal (<https://kopt.enivida.in>)

#### 2.17.3 Preparation of Bids

(1) Bidder should take into account any addendum and corrigendum published on the bid document before submitting their bids only on e-procurement portal <https://kopt.enivida.in>.

(2) Please go through the bid advertisement and the bid document carefully to understand the documents required to be submitted as part of the bid. Please note the number of covers in which the bid documents have to be submitted, the number of documents – including the names and content of each of the document that need to be submitted. Any deviations from these may lead to rejection of the bid.

(3) Bidder, in advance, should get ready the bid documents to be submitted as indicated in the bid document / schedule and generally, they can be in PDF /JPEG formats. Bid Original documents may be scanned with 100 dpi with Colored option which helps in reducing size of the scanned document.

(4) To avoid the time and effort required in uploading the same set of standard documents which are required to be submitted as a part of every bid, a provision of uploading such standard documents (e.g. PAN card copy, annual reports, auditor certificates etc.) has been provided to the bidders. Bidders can use “My Documents” available to them to upload such documents.

(5) These documents may be directly submitted from the “My Documents” area while submitting a bid and need not be uploaded again and again. This will lead to a reduction in the time required for bid submission process.

#### 2.17.4 Submission of Bids

(1) Bidder should log into the website well in advance for the submission of the bid so that it gets uploaded well in time i.e. on or before the bid submission time. Bidder will be responsible for any delay due to other issues.

(2) The bidder has to digitally sign and upload the required bid documents one by one as indicated in the bidding document.

(3) Bidder has to select the payment option as “Online mode or Bank Guarantee” as to pay the EMD/ Bid Security as applicable and enter details of the instrument as per the terms of Tender/RFP.

(4) In case of Bank Guarantee, scanned copy of BG should be uploaded along with bid. The original Bank Guarantee shall be submitted to office of the concerned official as per schedule mentioned in the bid document. Non-submission of original Bank Guarantee within the specified period shall lead to summary rejection of bid. The details of the BG, physically submitted should match with the details available in the scanned copy and the data entered during bid submission time. Otherwise bid will be rejected.

(5) Bidders are requested to note that they should necessarily submit their financial bids in the format provided and no other format is acceptable. If the price bid has been given as a standard BOQ format with the bid document, then the same is to be downloaded and to be filled by all the bidders. Bidders are required to download the BOQ file, open it and complete (unprotected) cells with their respective financial quotes and other details (such as name of the bidder). No other cells should be changed. Once the details have been completed, the bidder should save it and submit it online, without changing the filename. If the BOQ file is found to be modified by the bidder, the bid will be rejected.

(6) The server time (which is displayed on the bidder’s dashboard) will be considered as the standard time for referencing the deadlines for submission of the bids by the bidders, opening of bids etc. The bidders should follow this time during bid submission.

(7) All the documents being submitted by the bidders would be encrypted using PKI encryption techniques to ensure the secrecy of the data. The data entered cannot be viewed by unauthorized persons until the time of bid opening. Data storage encryption of sensitive fields is done. Any bid document that is uploaded to the server is subjected to symmetric encryption using a system generated symmetric key. Further this key is subjected to asymmetric encryption using buyers/bid opener public keys. Overall, the uploaded bid documents become readable only after the bid opening by the authorized bid openers.

(8) The uploaded bid documents become readable only after the bid opening by the authorized bid openers.

(9) Upon the successful and timely submission of bid click “Complete” (i.e. after Clicking “Submit” in the portal), the portal will give a successful Bid submission acknowledgement & a bid summary will be displayed with the unique id and date & time of submission of the bid with all other relevant details.

(10) The bid summary has to be printed and kept as an acknowledgement of bid submission.

#### **2.17.5 Removal and/or Replacement of Personnel**

(a) Except as the Employer may otherwise agree, no changes shall be made in the Key Personnel. If, for any reason beyond the reasonable control of the Consultants, it becomes necessary to replace any of the Personnel, the Consultants shall forthwith provide as a replacement a person of equivalent or

better qualifications. The upper limit of substitution on account of various reasons including on health ground should normally not exceed 25% of the total key personnel as given in Appendix A.

(b) If the Employer (i) finds that any of the Personnel has committed serious misconduct or has been charged with having committed a criminal action, or (ii) has reasonable cause to be dissatisfied with the performance of any of the Personnel, then the Consultants shall, at the

Employer's written request specifying the grounds therefore, forthwith provide as a replacement a person with qualifications and experience acceptable to the Employer.

(c) Any of the Personnel provided as a replacement under Clauses (a) and (b) above, the rate of remuneration applicable to such person as well as any reimbursable expenditures (including expenditures due to the number of eligible

dependents) the Consultants may wish to claim as a result of such replacement, shall be subject to the prior written approval by the Employer. Except as the Employer may otherwise agree, (i) the Consultants shall bear all additional travel

and other costs arising out of or incidental to any removal and/or replacement, and (ii) the remuneration to be paid for any of the Personnel provided as are placement shall not exceed the remuneration which would have been payable to

the Personnel replaced. Further for Key Personnel replaced for the second time, the remuneration payable shall not exceed 90% of the remuneration which would have been payable to the originally proposed Key Personnel. Also, if the total replacement of Key Personnel exceeds 25%, the remuneration payable for Key Personnel shall not exceed 90% of the remuneration which would have been payable to the originally proposed Key Personnel.

#### **2.17.6. Liquidated damages:**

##### **a. Liquidated Damages for error/ variation:**

In case any error or variation is detected in the reports submitted by the Consultant and such error or variation is the result of negligence or lack of due diligence on the part of the Consultant, the consequential damages thereof shall be quantified by the Authority in a reasonable manner and recovered from the Consultant by way of deemed liquidated damages, subject to a maximum of 50%

(fifty percent) of the Agreement Value.

##### **b. Liquidated Damages for delay:**

In case of delay in completion of Services, liquidated damages not exceeding an amount equal to 0.1% (zero point one percent) of the Agreement Value per day, subject to a maximum of 10% (ten percent) of the Agreement Value will be imposed and shall be recovered by appropriation from the Performance Security or otherwise. However, in case of delay due to reasons beyond the control of the Consultant, suitable extension of time shall be granted without levying Liquidated Damages (LD).

#### **2.17.7 Payment for PMC services (Fees in Indian Rupees):**

Payment would be at a reasonable periodicity as to be decided by SMPK.

#### **2.17.8 Assistance to Bidders**

For any Query,

##### **Contact Persons (Syama Prasad Mookerjee Port, Kolkata):**

**1. S. Mitra, Dy. Chief Engineer, Mob. No. 98362 98680**

**2. S. K. Halder, Superintending Engineer (Contract), Mob. No. 96747 20075**

**3. S. Das, Engineer, Mob. No. 9830621827**

Phone no.: 03371012486, 03371012398

E-mail IDs: - [santanumitra@kolkataporttrust.gov.in](mailto:santanumitra@kolkataporttrust.gov.in)

& [sk.halder@kolkataporttrust.gov.in](mailto:sk.halder@kolkataporttrust.gov.in)

**Contact Persons (Envida Portal):**

Phone No.: - 7278929467/8448288981

E-Mail IDs: - enividahelpdesk@gmail.com & [ewizardkumar@gmail.com](mailto:ewizardkumar@gmail.com)

**(3) Technical Proposal and Standard Forms**

Form 3A: Technical Proposal Submission Form/Declaration

Form 3B: General Information of Applicant

Form 3C: Format of Technical Capacity (Eligible Assignments)

Form 3D: Statutory Auditors/ Chartered Accountant certificate for Eligible Assignment

Form 3E: Format of Financial Capacity

Form 3F: Format for Power of Attorney for Authorized representative

Form 3G: Deleted

Form 3H: Team Composition and task Assignments

Form 3I: Curriculum Vitae (CV) for proposed Key & Non- Key Personnel (with one page of summary of experience)

Form 3J: Pre-Proposal Queries Format

Form 3K: Integrity Pact

Form 3L: Legal Capacity

\*\*\*\*\*

**FORM 3A: Technical Proposal Submission Form/ Declaration**

[Location, Date]

To:

The Chief Engineer,  
Civil Engineering Department,  
Syama Prasad Mookerjee Port, Kolkata,  
2<sup>nd</sup> floor, Head office Building,  
15, Strand Road, Kolkata-700001.

**Subject:** RFP for Selection of Project Management Consultant (PMC) for the work of “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA.

Dear Sir,

With reference to your RFP document dated ....., we, having examined all relevant documents and understood their contents, hereby submit our Proposal for selection. The Proposal is unconditional and unqualified.

We are submitting our Proposal as [sole applicant] [insert full name and address Consultant].

We understand you are not bound to accept any Proposal you receive.

If negotiations are held during the period of validity of the Proposal, i.e., before [date], we undertake to negotiate on the basis of the proposed staff. Our Proposal is binding upon us, subject only to the modifications resulting from negotiations in accordance with the RFP.

Further:

(1) We acknowledge that SMPK will be relying on the information provided in the Proposal and the documents accompanying the Proposal for selection of the Consultant, and we certify that all information provided in the Proposal and in the supporting documents is true and correct, nothing has been omitted which renders such information misleading; and all documents accompanying such Proposal are true copies of their respective originals.

(2) This statement is made for the express purpose of appointment as the Consultant for the aforesaid Assignment.

(3) We shall make available to SMPK/Client any additional information it may deem necessary or require for supplementing or authenticating the Proposal.

(4) We acknowledge the right of SMPK/Client to reject our application without assigning any reason or otherwise and hereby waive our right to challenge the same on any account whatsoever.



(5) We certify that in the last 3 years, we have neither failed to perform on any contract, as evidenced by imposition of a penalty by an arbitral or judicial authority or a judicial pronouncement or arbitration award against the Applicant, nor been expelled from any project or contract by any public authority nor have had any contract terminated by any public authority for breach on our part.

(6) We declare that:

(a) We have examined and have no reservations to the RFP, including any Addendum/corrigendum issued by the Client;

(b) We do not have any conflict of interest in accordance with the terms of RFP.

I We have not directly or indirectly or through an agent engaged or indulged in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice, as defined in the RFP document, in respect of any tender or request for proposal issued by or any agreement entered into with Client or any other public sector enterprise or any government, Central or State;

and

(c) We hereby certify that we have taken steps to ensure that no person acting for us or on our behalf will engage in any corrupt practice, fraudulent practice, coercive practice, undesirable practice or restrictive practice.

(7) We understand that you may cancel the selection process at any time and that you are neither bound to accept any Proposal that you may receive nor to select the Consultant, without incurring any liability to the Applicants.

(8) Deleted

(9) We certify that in regard to matters other than security and integrity of the country, we or any of our affiliates have not been convicted by a court of law or indicted or adverse orders passed by a regulatory authority which would cast a doubt on our ability to undertake the Consultancy for the Assignment or which relates to a grave offence that outrages the moral sense of the community.

(10) We further certify that in regard to matters relating to security and integrity of the country, we have not been charge-sheeted by any agency of the Government or convicted by a court of law for any offence committed by us or by any of our affiliates. We further certify that we have not been barred by the central government, any state government, a statutory body or any public sector undertaking, as the case may be, from participating in any project or bid, and that any such bar, if any, does not subsist as on the date of this RFP.

(11) We further certify that no investigation by a regulatory authority is pending either against us or against or against our CEO or any of our Directors / Managers

(12) We hereby irrevocably waive any right or remedy which we may have at any stage at law or howsoever otherwise arising to challenge or question any decision taken by Client in connection with the selection of Consultant or in connection with the selection process itself in respect of the above-mentioned Assignment.

(13) We agree and understand that the proposal is subject to the provisions of the RFP document. In no case, shall we have any claim or right of whatsoever nature if the consultancy for the Assignment is not awarded to us or our proposal is not opened or rejected.

(14) We agree to keep this offer valid for **one hundred eighty (180) days** from the Proposal Due Date specified in the RFP.

(15) A Power of Attorney in favour of the authorized signatory to sign and submit this Proposal and documents is attached herewith.

(16) Deleted.

(17) Bid Security and RFP processing fee as provided in the RFP has been paid by us and we are enclosing the proof of the such payment.

(18) In the event of our being selected as the Consultant, we agree to enter into a Contract in accordance with the contract prescribed in the RFP. We agree not to seek any changes in the aforesaid form and agree to abide by the same.

(19) We have studied the RFP and all other documents carefully. We understand that except to the extent as expressly set forth in the Contract, we shall have no claim, right or title arising out of any documents or information provided to us by Client or in respect of any matter arising out of or concerning or relating to the selection process including the award of consultancy.

(20) The Technical and Financial Proposal is being submitted. This Technical Proposal read with the Financial Proposal shall constitute the application which shall be binding on us.

(21) We agree and undertake to abide by all the terms and conditions of the RFP Document.

We remain

Yours sincerely,

Authorized Signature [In full and initials]:

Name and Title of Signatory:

Name of Firm: Address:  
Applicant/Member in Charge)

(Name and stamp of the

### **Form 3B: General Information of Applicant**

#### **Details of Applicant**

##### **(1) Applicant**

(a) Name:

(b) Country of incorporation:

I Address of the corporate headquarters and its branch office(s), if any, in India:

##### **(2) Brief Description of the Company including details of its main lines of Business**

##### **(3) Details of individual(s) who will serve as the point of contact/ communication for SMPK:**

(a) Name:

(b) Designation:

I Company:

(d) Address:

I Telephone Number:

(f) E-Mail Address:

##### **(4) Particulars of the Authorized Signatory of the Bidder:**

(a) Name:

(b) Designation:

I Company:

(d) Address:

I Phone Number:

(f) Email Address:

### FORM 3C: Format for Technical Capacity – (Eligible Assignments)

#### Experience

[Using the format below, provide information on each assignment for which your firm, and each associate for this assignment, was legally contracted either individually as a corporate entity or as a Lead Member/Member in Charge of the major companies for carrying out consulting services similar to the ones requested under this assignment. In case of the contract jointly executed by the Applicant (as a part of consortium, the Applicants should further support his claim for the share of work done for that particular conduct by producing a certificate from Client or Statutory Auditors Certificate or self-certificate]

- Use Assignments with copy of proof of experience as required for meeting the minimum Eligibility criteria prescribed.
- Exhibit only those Assignments undertaken in the last seven (7) years preceding the Proposal Due Date.
- Assignment without the proof of experience as detailed out in 2.9.4 will not be considered.

Assignment Name:	Approx. value of the Contract (in INR in Crore)
Country: Location within country:	Duration of assignment (months):
Name of Client:	Total No. of staff-months of the assignment:
Address:	Approx. value of the services provided by your firm under the contract (in INR in Crore)
Start Date (Month/Year): Completion Date (Month/Year):	No: of professional staff months provided by associated Consultants:
Name of Lead Member: Name of Associated Consultants, If any	Name of senior professional staff of your firm involved and functions performed (indicate most significant profiles such as Project Director / Coordinator, Team Leader):
Narrative Description of Assignment:	
Description of actual services provided by your staff within the assignment:	

Firm's Name:

Authorized Signature:

Note:

For the purpose of evaluation of applicants INR 70 (INR Seventy only) per USD shall be considered as the applicable currency conversion rate. In case of any other currency the same shall first be converted to USD as on the date 60 (Sixty) days prior to the proposal due date and the amount so derived in USD shall be converted into INR at the aforesaid rate. The conversion rate of such currency shall be the daily representative exchange rates published by the IMF for the relevant date. Please, limit the description of each project in two A4 size sheet of paper. Descriptions exceeding two A4 size sheet of paper shall not be considered for evaluation.

**Form 3D: DELETED**

### FORM 3E: Financial Capacity

- Use the below format to exhibit Turnover figure for the past three (3) financial years only

Sl. No.	Financial Year	Annual Turnover (INR in Cr.)
1.	2018-2019	
2.	2019-2020	
3.	2020-2021	
Average Annual Turnover $[(1) + (2) + (3)]/3$		

**Note: -**

The certificate of Average Annual Turnover is to be provided by the Applicant(s) from its respective Statutory Auditor. **The same should be audited as per relevant norms wherever required along with UDIN of the Auditor.**

**Certificate from the Statutory Auditor/ Chartered Accountant**

This is to certify that ----- (Name of the Firm) (Registered Address) has received the payments/ earned revenue shown above against the respective years.

Name of the Authorized Signatory

Designation:

Name of the Firm: -----

(Signature of the Statutory Auditor Seal of the Firm)

**Note: -**

This form shall be submitted on the letter head of the Chartered Accountant/statutory auditor.

### FORM 3F: Format of Power of Attorney for Authorised Representative

#### (On a Non-Judicial Stamp Paper of appropriate value)

Know all men by these presents, We, .....(name of organization and address of the registered office) do hereby constitute, nominate, appoint and authorize Mr. / Ms. ....son / daughter / wife and presently residing at ... who is presently employed with / retained by us and holding the position of....., ..... as our true and lawful attorney (hereinafter referred to as the "Authorized Representative"), with power to sub- delegate to any person, to do in our name and on our behalf, all such acts, deeds and things as are necessary or required in connection with or incidental to submission of our Proposal for and selection for the {Assignment name}, being undertaken by **Syama Prasad Mookerjee Port, Kolkata** (the "Client") including but not limited to signing and submission of all applications, proposals and other documents and writings, participating in pre-proposal and other conferences and providing information / responses to the Client, representing us in all matters before the Client, signing and execution of all contracts and undertakings consequent to acceptance of our proposal and generally dealing with the Client in all matters in connection with or relating to or arising out of our Proposal for the said Assignment and / or upon award thereof to us till the entering into of the Contract with the Client.

And, we do hereby agree to ratify and confirm all acts, deeds and things lawfully done or caused to be done by our said Authorized Representative pursuant to and in exercise of the powers conferred by this Power of Attorney and that all acts, deeds and things done by our said Authorized Representative in exercise of the powers hereby conferred shall and shall always be deemed to have been done by us.

IN WITNESS WHEREOF WE, .... THE ABOVE-NAMED PRINCIPAL HAVE EXECUTED THIS POWER OF ATTORNEY ON THIS ... DAY OF....., 20\*\*

For ...

(Signature, name, designation and address)

Witnesses:

1.

2.

Accepted

(Signature, name, designation and address of the Attorney)

#### **Notes: -**

1. The mode of execution of the Power of Attorney should be in accordance with the procedure, if any, laid down by the applicable law and the charter documents of the executant(s) and when it is so required the same should be under common seal affixed in accordance with the required procedure.

2. Wherever required, the Applicant should submit for verification the extract of the charter documents and other documents such as a resolution / power of attorney in favour of the person executing this Power of Attorney for the delegation of power hereunder on behalf of the Applicant.

3. For a Power of Attorney executed and issued overseas, the document will also have to be legalized by the Indian Embassy and notarized in the jurisdiction where the Power of Attorney is being issued. However, the Power of Attorney provided by Applicants from countries that have signed The Hague Legislation Convention, 1961 are not required to be legalized by the Indian Embassy if it carries a conforming Apostille certificate.

**FORM 3G: Deleted**



**FORM 3H: Team Composition and Task Assignments**

<b>Key Personnel</b>				
<b>Name of Staff</b>	<b>Firm</b>	<b>Area of Expertise</b>	<b>Position Assigned</b>	<b>Task Assigned</b>

<b>Non-Key Personnel</b>				
<b>Name of Staff</b>	<b>Firm</b>	<b>Area of Expertise</b>	<b>Position Assigned</b>	<b>Task Assigned</b>

**FORM 3I: Curriculum Vitae (CV) for Proposed Staff (with one page of summary of experience)**

Limit each CV to 5 pages single-sided.

1	Proposed Position (Also specify whether staff is for Core Team)	Only one candidate shall be nominated for each position			
2	Name of Firm	Insert name of firm proposing			
3	Name of Staff	[First] [Middle] [Surname]			
4	Date of Birth	[Day, Month, Year]	Nationality		
5	Education	Indicate college/university and other specialized education of staff member, giving names of institutions, qualifications obtained, and date.			
6	Membership of Professional Organizations				
7	Training & Publications:	[Indicate significant training since education degrees (under 5) were obtained]			
8	Countries of Work Experience	List countries where staff has worked in the last ten years			
9	Languages	Language	Proficiency (good/ fair/ poor)		
			Speaking	Reading	Writing
		English			
		Language 2			

1 0.	Employment Record [Starting with present position, list in reverse order every employment held by staff member since graduation, giving for each employment (see format here below): dates of employment, name of employing organization, positions held.]:	Name of Organization	Position Held	Duration
				To Present
1 1.	Detailed Tasks Assigned			
1 2.	Work Undertaken that Best Illustrates the Required Professional Experience	<p>[Among the assignments in which the Staff has been involved, indicate the Handle the Tasks Assigned following information for those assignments that best illustrates staff's professional experience as per the requirements of this RFP</p> <p>Name of assignment or project:</p> <p>Year:</p> <p>Location: Client:</p> <p>Relevant project features: [size in INR, details of eligible projects and services provided]</p> <p>Positions held:</p> <p>Activities performed:</p>		

### 13. Certification:

I, the undersigned, certify that to the best of my knowledge and belief, this CV correctly describes me, my qualifications, and my experience. I understand that any wilful misstatement described herein may lead to my disqualification or dismissal, if engaged.

Date:

[Signature of staff member]

Day/Month/Year

Full name of staff: Date:

[Signature of authorized representative of the firm]

Day/Month/Year Full name of authorized representative:

Signature of the proposed staff:

Form 3J: Format of Pre-Proposal Queries

Sl. No.	Clause No/Page No	Brief details of Existing Clause	Query/(ies)	Suggestions/Remarks by SMPK

**FORM 3K: INTEGRITY PACT**

**\*AS PER GCC**

**FORM 3L: Statement of Legal Capacity**

(To be forwarded on the letterhead of the Bidder)

Ref. Date:

The Chief Engineer,  
Civil Engineering Department,  
Syama Prasad Mookerjee Port, Kolkata,  
2<sup>nd</sup> floor, Head office Building,  
15, Strand Road, Kolkata-700001.

Dear Sir,

We hereby confirm that we satisfy the terms and conditions laid out in the RFP document.

We have agreed that ..... (insert individual's name) will act as our representative and has been duly authorized to submit the RFP document. Further, the authorized signatory is vested with requisite powers to furnish such letter and authenticate the same.

Thanking you,

Yours faithfully,

(Signature, name and designation of the authorised signatory)

For and on behalf of.....

#### **(4) Financial Proposal – Standard Forms**

#### FORM 4A: Financial Proposal Submission Form

[Location, Date]

To:

The Chief Engineer,  
Civil Engineering Department,  
Syama Prasad Mookerjee Port, Kolkata,  
2<sup>nd</sup> floor, Head office Building,  
15, Strand Road, Kolkata-700001.

**Subject:** RFP for Selection of Project Management Consultant (PMC) for the work of “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA.

Dear Sir,

We, the undersigned, offer to provide the services for [name of assignment] in accordance with your Request for Proposal dated [date] and our Proposal. Our attached Financial Proposal (inclusive of GST) is for the sum of [amount(s) in words and figures].

Our Financial Proposal shall be binding upon us subject to the modifications resulting from arithmetic correction, if any, up to expiration of the validity period of the Proposal, i.e. [date].



We undertake that, in competing for (and, if the award is made to us, in executing) the above contract, we will strictly observe the laws against fraud and corruption in force in India namely —Prevention of Corruption Act 1988.

We understand you are not bound to accept any Proposal you receive.

We remain,

Yours sincerely,

Authorized Signature [In full and initials]:

Name and Title of Signatory:

Name of Firm and Address:

**FORM 4B: Summary of Costs**

**Deleted**

## (5) Terms of Reference (ToR)

The PMC shall be responsible for effectively leading and taking initiatives to execute the projects and for advising, assisting and acting on behalf of SMPK when so authorized, for effective management of the Project. All reference made herein with respect to SMPK, various consultants as appointed, EPC Contractor are hereby collectively referred as Stakeholders in this TOR and the same should be read in relevant context as applicable to and involving concerned stakeholder for purpose of coordination and reporting to undertaken by PMC. Such mechanism and mode of implementation along with Contractual Framework for executing this TOR and formal reporting structure involving all stakeholders

The quality of PMC for Construction management and supervision at site should be of the standard expected under the Project Agreement with the SMPK.

	<b>Overall the scope of the PMC services shall be as indicated herein but not limited thereto</b>
	<b>Project Preparation Stage</b>
(i)	Acquaint with all the work done, reports / documents prepared for this project i.e. Review existing reports / documents for this project prior to appointment of PMC.
(ii)	Review and comment on baseline surveys and reports in respect of planned berth construction & stack yard and accordingly give final recommendations / change to be incorporated in surveys and reports.
(iii)	Set procedures systems, standards, criteria and reporting systems for the Contractor and 'Design Consultants engaged by the Contractor' / Review design and provide guidance to 'Design consultants engaged by the Contractor'.
(iv)	Assist SMPK Officers in monitoring site-readiness for the Projects.

(v)	Carry out / assist SMPK Officers for other activities required for preparation and start of the project.
-----	--

	<b>Task 1: Team Mobilization and Project Start-Up</b>
	Resident Engineer cum Team Leader of PMC will introduce team members with the concerned officials of SMPK and will hold meetings to discuss the following:
(i)	Rules and responsibilities of all parties in the project setup and lay out the rules and guidelines for implementation of the project.
(ii)	Reporting system and point of contact.
(iii)	Setting up of its project office at Site.
(iv)	Issuing of Project Reports, Contract Documents and other background information related to the Project.

	<b>Task 2: Review of available Contract Documents</b>
(i)	Before the start of the work / contract package (whichever is applicable), PMC will undertake study of Detailed Project Report / feasibility report including all contract document of EPC contract between client and contractor and other available documents with particulars relevance to design, specifications, methodology and time frame for executing the work and project schedule.
(ii)	Study of Contract Agreement between Employer and the Contractors:  The understanding of these contract provisions is very important in the overall success of the project. It is very important to have this Agreement absolutely clear and specific in all aspects, and adequately robust to cope up with the requirements for the successful completion of the Project. The provisions of the achievements of the milestones, the procedure for dispute resolution, if arises are absolutely vital for the success of the Project.
	<b>Task 3: Review of Design, drawing and model study reports</b>
	PMC shall be responsible for detail design checking and corresponding detail considering applicable local rules and regulations and SMPK rules and regulations, Indian Bureau of Standards, publications and International standards wherever applicable shall be followed in the order of appearance here above.
(i)	When a set of standards is followed for design, the review shall normally follow that set of standards. Design review shall have to cater to site requirements, construction amenability and least life cycle cost aspects.
(ii)	Responsible or review and proof checking of designs and drawings submitted by the EPC contractor for approval to facilitate Client to give approval within time frame specified in EPC contract. To recommend the final design and drawings for approval of the Engineer – In – Charge of SMPK.

(iii) )	Assist SMPK officials including other concerned stakeholders on actions required on review done / suggestions for design and construction aspects.
------------	--

	<b>Project Monitoring and Control</b>
	PMC shall be responsible for monitoring entire project development and progress related to execution thereby assisting all Stakeholders in efficient project management and rendering advice in taking necessary actions for timely and quality completion of the project.
(i)	Review and comment on the project schedule prepared by the executing agency and assist all stakeholders to provide necessary approvals.
(ii)	Monitor project development at project site against agreed scheduling and co-ordinate for finalizing the remedial measure/mitigation plan in case of delay in the project at any point of time.
(iii) )	Monitor project development goals for site execution against stipulated goals in project indicator framework.
(iv) )	Update / revise project scheduling, developmental goals, physical and financial achievements of Contractor in co-ordination with all stakeholders.
(v)	Report fortnightly project status and quarterly project status to all stakeholders.

	<b>Detailed Tasks</b>
(i)	Review Contractor's detailed works program along with concerned stakeholders and suggest modifications in consultation with client where deemed necessary.
(ii)	Review the suitability of Contractor's superintending and key personnel and suggest modifications where required, in consultation with Engineer – In- Charge.
(iii) )	Ensure that all the works carried out under this program fully comply with engineering designs, technical specifications, drawings, established codes & sound engineering practices and contract documents and compliance to the environmental management plan.
(iv) )	Assist client's engineer in interpretation of the drawings and Technical Specifications etc. as and when required.
(v)	Review the Construction methodology proposed by the contractor for execution of works in order to ensure that the same is satisfactory in respect of technical requirements, project implementation schedule, environmental aspects, construction period and operational occupational safety of the works, property, personnel and third parties.
(vi) )	The consultant will assist concerned stakeholders to inspect the work on completion before taking over by the Employer and indicate any rectification required and outstanding work to be carried out by the contractor prior to issuance of certificate of completion by Employer, and will indicate any defects to be rectified

	during 'defect liability period of the Contractor with EPC Contractor'
(vi i)	Recommendations regarding methods and procedures for the evaluation and the system for monitoring of works after completion.
	<b>Project Co-ordination</b>
	<p>PMC shall be responsible for effective co-ordination with all stakeholders i.e. SMPK officials, including various design consultants (if any), Independent Engineers and other consultants as may be appointed for project from time to time as per requirement of Employer.</p> <p>PMC shall manage and interface all design co-ordination meetings with contractor, consultants (if any) and assist all stakeholders in maintaining the progress for all deliverables for efficient project execution and render advice to stakeholders in taking necessary actions for timely and quality completion of the project</p>
	<b>Detailed Tasks</b>
(i)	Assist in forward planning and monitoring progress of contractor / Independent Engineers
(ii)	Advice and assist concerned stakeholders in avoidance of disputes / claims. Advise and assist concerned Stakeholders in defending Employer's stand.
(iii )	Examine all reports submitted by contractor and advise on required actions to the client.
(iv )	Review and finalize all design data, Geo- technical investigation data & details required to implement Environment Management Plan.
(v)	Review and finalize specification of material and workmanship as per main EPC contract document.
(vi )	Assist the client in administration of contracts of the Project
(vi i)	Assist in scheduling and facilitating requested meetings of all above as and when required between client and the contractor
	<b>Project Execution</b>
(i)	Assist in monitoring / execution of all civil works including maintenance during contract period of civil works. PMC would be responsible for day to day monitoring at site and measurements.
(ii)	Ensure adequacy, stability and safety of all personnel and construction works being executed by the contractor during the construction, operation and maintenance up to the end of the 'defect liability period of the Contract with EPC Contractor'.
(iii )	Regular Site visits by Key personnel to monitor progress in implementation, physical progress, environmental mitigation, contractor's performance and adequacy of the contractor's supervision to maintain quality assurance as per specifications and time limit of the project.

	<b>Detailed Tasks (including temporary and permanent works, fabrication / shop drawings for Piling work, structural steel works &amp; RCC work as applicable):</b>
(i)	Assist in planning of all civil works including those required for compliance to the environment management plan
(ii)	Assist in monitoring and tracking statutory approvals and clearances.
(iii)	Assist concerned stakeholders to deal with performance deviation by contractors and suggest suitable remedial measure.
(iv)	Advise and assist concerned stakeholders in defending Employer's stand
(v)	Advise and assist in minimizing disputes / claims.
(vi)	Advise and assist concerned stakeholders in coordination and in effective monitoring.
(vii)	Assist / advice on encumbrance removal / utility shifting during construction period by effective coordination with other concerned departments of SMPK.
(viii)	Assist / advice regarding timely handing over the site by contractor in stages and the advance actions required to be taken for the handing over of the site and to achieve the milestones for completion of the construction work within the time frame.
(ix)	Carry out proper monitoring of progress of the works through computer aided project management techniques using latest available software on project monitoring and assist client engineers to conversant with handling of those software for effective monitoring of the project.
(x)	Check contractors setting out of works prior to execution, for conformance with the good for construction drawings and file daily, weekly and monthly report with verify lines and levels to ensure works are being executed as per the approved drawings / layouts, alignments and levels.
(xi)	Checking contractor's proposed detail designs / drawings for works (including temporary and permanent works, Piling work, fabrication / shop drawings for structural steel works, RCC work Bar bending schedule etc as applicable to enable the client for giving timely approval to the contractor for construction work.
(xii)	Inspect at regular intervals the contractor's plan and facilities, including the workers' accommodation at site, to ensure conformity with the construction contract and all government / state regulations.
(xiii)	Inspect the contractor's safety measures, including labour welfare and immediately notify both the Employer and the contractor of any infringement or violation.
(xiv)	Maintain records, working / as-built drawings, and test data, details of variations, correspondence and diaries / register in the formats approved / specified by the Client.
(xv)	Ensure that the quality of materials used, meet the specifications of contract agreement.

(xv i)	Maintain records of all plant, labour and materials used in the construction of the works.
(xv ii)	Ensure that the quality of workmanship and the temporary arrangements / structures made for carrying out the works meet the requirement of specifications and safety standards
(xv iii)	Verify physically 100% the measurements taken by the contractor and subsequently report to the client for payment and maintain measurement records in standard format.
(xi x)	Assist concerned stakeholders in scrutiny of invoices raised and settlement of all claims amicably.
(xx )	Issue interim quantity certificates for processing contractors' invoice. Certify completion of part or all of the works for payment.
(xx i)	Analyze claims submitted by the contractor and prepare recommendations for the approval of "Engineer in Charge" in terms of both technical and financial issues, for the claims for response to the contractor.

	<b>Quality Assurance and Quality Control</b>
(i)	PMC shall be responsible for Quality Assurance & Technical Auditing (QA/TA) of the construction works. Develop forms and procedures in order to ensure implementation of a proper Quality Assurance System on all activities and aspects of the Project.
(ii)	Assist the concerned stakeholders on matters connected with quality assurance / control aspect of works in order to ensure the quality of work and its conformity with standards & specification prescribed in the contract.
	<b>Detailed Tasks:</b>
(i)	To ensure high quality in construction works to be executed.
(ii)	Review and approve the quality assurance / control system & procedures being followed by contractor.
(iii )	Check & approve sources of materials and agree with the contractor materials ordering schedule.
(iv )	Review suitability of source and quality of construction materials on the basis of inspections, test results / manufacturer's certificates etc.
(v)	To assist client in approval of the field-testing laboratories set up by the contractor in respect of its facilities, adequacy, arrangements, equipment and laboratory staff etc.
(vi )	Witness all the Quality Control tests being conducted by the staff of the Contractor in the contractor's laboratory or to be tested in NABL accredited field-testing laboratory or in the Manufacturer's establishment in presence of 3 <sup>rd</sup> party as approved by the clients maintain BIS /International standard.
(vi)	Assist client during inspection of the construction equipment and other related

i)	machinery in order to assess their suitability for the works. The consultant will check the calibrations of the necessary equipment and also carry out periodical inspection of the equipment to be conducted.
(vi ii)	During course of inspection if any item of the work is found substandard or unacceptable, the consultant would immediately inform the contractor for the rectification required (in writing), giving full justification thereof with necessary supporting data and inform the client about the same.
	<b>Task 1: Preparation of Quality Assurance Plan</b>
(i)	The consultant shall prepare a Quality Assurance Plan (QAP) and take approval of the authority which will detail, consultant's plan to conduct the various activities and measures / procedures to keep a check on the quality and timeline of the project.
(ii)	The Quality Assurance Plan and Quality Control Procedures will be continually checked by the Consultant's supervisory staff to oversee that the work is executed and completed according to specification as laid out in EPC Tender following applicable relevant Indian code of practice including international codes (wherever necessary) and good practices.
(iii )	<p>The main considerations that should weigh with preparation of an overall Quality Assurance Plan are:</p> <p>(a) Clearly defining the objectives.</p> <p>(b) Enumerating the activities involved.</p> <p>I Incorporating the requirements of quality in each activity and providing for a full – proof safeguard.</p> <p>(d) Laying down the surveillance plan, checks for each apprehended lapse and omission,</p> <p>I Establishment of corrective action and continuous improvement process.</p> <p>(f) The Consultants shall also develop forms and procedures for proper implementation of Quality Assurance Plan. They shall inter alia include the following:</p> <p>(I) Procedure for storing of materials to be used in permanent works. Organization of materials from stackyards during laying and finished works.</p> <p>(II) Type, frequency and procedure of tests for different kinds of materials used for construction and permanent structural installations including electrical and marine equipment.</p> <p>(III) Inspection and test plans including requirement for witnessing.</p> <p>(IV) Requirements for record keeping</p> <p>(V) Norms and procedures for control of process related to dismantling of old berth and existing yard, pile casting, laying of concrete structures, Trench for service utilities, fixing of Marine fixtures like bollard, bullring, fenders etc and other works for yard development and installation of other permanent work covering all disciplines involved in enabling Construction of berth and stack yard.</p>



	<p>(VI) Acceptability criteria for works and workmanship.</p> <p>(VII) Formats for recording and compilation of test data.</p> <p>(VIII) Reporting system for test results and for actions to be taken in respect of quality</p>
	<b>Task 2: Review of Field-Testing laboratories</b>
	<p>The laboratory and all facilities thereby will be supplied through the Main EPC Contracts by the Contractor. The list of equipment being provided by the contractor will be made available to the Team Leader by the Employer. The Team Leader with the assistance of Sr. Quality Assurance Engineer will check the field laboratory set up by Contractor against this list and report any discrepancies or additional equipment necessary,</p>
	<b>Task 3: Quality and Technical Audit</b>
(i)	<p>All Test and Controls before, during and after execution of the works will be preliminary defined beforehand and agreed leading to an organized systematic Quality Control.</p>
(ii)	<p>The Consultant will review the laboratory setup of the Contractor including the calibration of all equipments. A comprehensive testing program and standardization of forms for testing purpose will be setup and to be approved by the EIC or his authorized representative. Typical standard sheets will be produced for all the test required. They shall, inter alia, include the following:</p> <ul style="list-style-type: none"> <li>(a) The type of test to be performed</li> <li>(b) Demands of specifications in relation to materials or final product,</li> <li>(c) The person responsible for testing.</li> <li>(d) The periodicity and frequency of the test (Volume of works, daily, weekly, before execution etc.</li> <li>(e) The standard and limits to be observed.</li> <li>(f) The tests conform to which standard i.e. relevant BIS or International code.</li> </ul>
(iii)	<p>The consultant shall ensure that contractor maintain systematic documentation of all testing as per the forms that will be developed by the consultant.</p>
(iv)	<p>The consultant's team will audit the quality reports maintained by the Contractor and will also witness the testing of material. Where necessary, testing in other NABL/Govt approved laboratories will be arranged by the Contractor and monitored and witnessed by the Consultant.</p>
(v)	<p>The Source of materials will also be reviewed and test reports of quarry material will be audited to assess their engineering properties. For all pre-fabricated and ready-mix items, certificated form manufacturers will be audited to verify that the items meet the project requirement and specifications.</p>
(vi)	<p>The Consultant will develop procedures to audit various items of construction and ensure that all concerned persons understand and implement these procedures with special emphasis on proper testing before any element is covered up. If during</p>

	inspections the Consultant finds improper materials have been used or if tests fails to meet the requirement of the specification, the consultant will notify the concerned stakeholders and the client immediately.
(vi i)	The Consultant will regularly inspect all the work site to ensure, on the basis of first hand observation that works are being executed according to plans and specification and to provide on the job training to local supervision personnel. If any deficiencies in quality are observed during site visits, remedial measures will be initiated on the spot with an intimation to client representative.
(vi ii)	Supervisory personnel will be educated in proper technique to inspect / test for the particular problem and to prevent repetition.
	<b>Post Construction / Consultancy</b>
(i)	Take up performance report of completed project work.
(ii)	Assist in making final payment of contractors and consultants.
(iii )	Assist in obtaining early discharge certificates from contractor.
(iv )	Assist in ensuring maintenance compliance of project works and payment
	<b>Other activities related to the Project</b>
(i)	Efficient documentation both on hard copy and soft copy.
(ii)	Assist in handling RTI applications and assessment of RTI compliance related to site work if any arises during the project tenure.
(iii )	Assist in handling audit observations including preparation of detailed of reply on Audit Para, factual note.
(iv )	Presenting project status during meetings as well as to prepare power point presentation on the same from time to time.
(v)	To assist in monitoring and evaluation including updating the indicators of result framework of the project.
(vi )	Assist in arranging and conducting fortnightly progress review / coordination meetings and to prepare its minutes of meetings.
	<b>Carry out final Inspection</b>
	<p>After completion of the project, the consultant will make an inspection of the entire project or parts of the project with representatives of Concerned Stakeholders and client. All defects, imperfections, and faults will be notified to the client and in turn client will instruct the Contractor for rectification of the defects. Upon completion of all rectification a Final Inspection Report will be prepared with the Client or his representative and the Contractor.</p> <p>Following final inspection of the project and the correction of all identified deficiencies on the project, the consultant shall recommend to Employer to issue the Project Completion Certificate.</p>

	<b>Services to be provided during 'Defects Liability Period of the Contract with EPC Contractor</b>
	During this period the Consultant will make at least one visit in three months at completed project site to verify the behavior of the structure and note defects. If necessary, the Consultant will notify the Employer. In assessing any possible defect that may appear, care will be taken to differentiate between a "construction defect" which is the Contractor's responsibility to rectify and "normal wear and tear" which is a maintenance item
	Following each inspection, a report detailing the observed defects will be prepared and discussed with the Employer and the Contractor involved. A solution to the problems will be determined in consultation with Employer and the Contractor.
	At the end Defect Liability Period the Consultant will make a final inspection with Employer and the representative of the contractor and certify to Engineer in Charge that all is in order and that the Contractor may be released from further obligation as per provision for contract.
	<b>Reporting Requirements and their timelines</b>
	The Consultant will prepare and submit the following reports in hard and soft copy to Engineer in Charge, in the format prepared by the Consultant and as approved by Engineer-In-Charge:

**REPORTS: -**

<b>S L. No.</b>	<b>Particular of the Report</b>	<b>No. of Copies (Both Hard &amp; Soft)</b>	<b>Content of the Report</b>	<b>Time of submission</b>
1	Inception Report	3	PMC will submit an Inception Report within a fortnight after getting the work order containing a description on approach and methodology along with detailed work plan and resource deployment plan for effective and successful implementation of the project.	Within 15 days from commencement of services
2	Quality Assurance Plan	3	PMC shall prepare a quality assurance plan for achieving quality in construction based on	Within 30 days from commencement of services

			BIS/International standards (wherever required) and best practices being followed. It shall be submitted within one month of the mobilization	
3	Standard Operating procedure for evaluation	3	Recommendations regarding methods and procedures for evaluation and the system for monitoring different stages of project work upto completion	Within one month after completion of consultancy assignment
4	Quality Certificate	3	Certificate regarding Quality of work executed for each activity of work and covering all types of works.	Within one month after each stages of completion of work.
5	Final Completion Report with CD	3	The PMC will prepare a comprehensive final completion report including Equipment's, installed, Utilities and Services (Structural, Electrical, Civil & Marine) before the end of consultancy services.	Within one month of the completion of project work by EPC contractor

**The consultant shall also prepare and submit the following reports (hard & soft copy).**

S I. No.	Description	Number	Copies	Content of the Report
1	Construction monitoring manual	1	3	Construction Monitoring Manual shall include detailed project procedures for efficient and time-bound implementation of the project and for progress monitoring and quality control. This manual shall be submitted within two months of the commencement of the consultancy services.
2	Engineering Reports	As required	3	Engineering Report shall include the progress on detailed design and drawings highlight any issues which may lead to design changes and needs prior

				client approval or any incorporation due to site requirement.
3	Maintenance Manual	1	3	Maintenance Manual shall be submitted two months prior to the completion of project work prepared in line with Civil Works Contract
<b><i>Any other report as desired by the Employer</i></b>				

	<b>Fortnightly Progress Reports</b>
	The PMC shall prepare & submit a brief progress report summarizing the work accomplished by the supervision team for the proceeding fortnight. The report shall outline any problems encountered (administrative, technical or financial) and give details / recommendation on how these problems have been / may be overcome. Brief work progress summaries will be included for ongoing berth and stack yard work, outlining problems encountered and solution / recommended solutions. The report shall also record the status of payment to the contractors, certificates of all claims for cost or time extensions within that period and of action required from government and other agencies to permit unhindered work progress and implementation.
	<b>Quarterly Progress Reports</b>
	The PMC shall prepare a comprehensive report summarizing all activities under the supervision contract at the end of each quarter and also at the other times when considered warranted by either the PMC or the Concerned Stakeholders because of delay of the construction works or because of the occurrence of technical or contractual difficulties. Such reports shall include but not be limited to, (i) Details of major milestones achieved (ii) the progress of the contract (iii) all contract variations and change orders (iv) the status of Contractor's claims, if any; etc. and will include brief descriptions of the technical and contractual problems being encountered, physical and financial progress in approved formats, financial status of the contract as a whole consisting of the cost incurred cost forecast as well as financial plan and other relevant information on the ongoing contract.
	<b>Final Completion Reports</b>
	The PMS shall prepare a comprehensive final completion report of the contract, after entire work reaches a stage of substantial completion during the period of the consultancy services. These reports must be submitted within one month after the completion of the work by the contractor and before taking over of all the works by the Employer. The report shall incorporate summary of the method of construction,

	the construction supervision performed, as built construction drawings, problems encountered & solutions undertaken thereon and recommendations for future projects of similar nature to be undertaken by the Employer. The Authority's Engineer will summarize and consolidate in a single report the key information to prepare the Final Completion Report on completion of the Project work under EPC contract.
	<b>Data, services, and facilities to be provided by the employer</b>
	The following and any other such data, available with the SMPK shall be provided to the PMC: Project details, specifications, designs, schedule, Main PMC contract document and any other relevant document supportive to Project implementation available with SMPK.
	<b>Staffing</b>
	<p>They PMC professionals must have relevant experience complying to the requirement of TOR, familiarity with the local conditions and prevalent local laws and must exhibit expertise of BIS and International – standards in supervision of large infrastructure projects. Personnel nominated by the selected PMC must be confirmed as available for the project to do the scheduled work. The CVs of the proposed professionals must be submitted along with signed declaration by the proposed professional confirming their availability for the project. CVs submitted without such declaration shall not be considered for evaluation.</p> <p>The PMC team must comprise of highly qualified and experienced Key and Non-Key experts best suited for the assignment. PMC must provide CVs of both key Experts and Non-Key Experts in their Technical Proposal. Some key experts shall be employed intermittently, at interval which would be proposed by SMPK as per project requirement.</p>

**Qualification & Experience of Key Personnel: -**

<b>S I. No.</b>	<b>Position</b>	<b>Educational Qualification</b>	<b>Experience, Roles &amp; Responsibility</b>	<b>No. of Personnel</b>
1	<b>Project Manager</b>	<p>Should be a Graduate in Civil Engineering with Post-Graduate in Construction Management or MBA</p> <p>Minimum 25 years of overall experience including 05 five years of experience in Port, Harbour, IWT related</p>	<p>1. Experience in managing similar large infrastructure project with proper planning and Quality Assurance and supervision of field engineers.</p> <p>2. Ability to handle multiple projects simultaneously, should</p>	01

		<p>construction works / project management.</p> <p>Age Limit: Should not be more than 55 years of age as on the date of submission of tender.</p>	<p>have handled as Resident Engineer or in a similar capacity for at least three projects of similar works/magnitude.</p> <p>3. Alternatively, should have the experience as Team Leader with 8 years' experience of Project monitoring and supervision of at least two infrastructure projects preferably in Port sector of which one project should be of similar works/magnitude.</p> <p>4. Responsible for the project implementation activities of the respective Contractors.</p> <p>5. Shall ensure execution of works on site as per specifications / standards, and interact with SMPK and the respective Contractor.</p> <p>6. Shall guide, supervise, coordinate and monitor the work of other experts in his team as well as those of the respective Contractor.</p> <p>7. Should have a proven record of project management &amp; supervision in projects of similar nature and magnitude</p>	
2	<b>Quality Cum</b>	Should be a Graduate in	Responsible for	01

.	<b>Material Expert</b>	<p>Civil Engineering. Post-Graduation in Construction Management/Port&amp; Harbour Engineering.</p> <p>Minimum 15 years of experience in Construction/project Monitoring works related to Port / Harbor / IWT structures, including at least 5 years of experience in formulation and implementation of Quality Assurance plan for project works in Harbor / Port / Marine foundations / major infrastructure works and experience in Mobilization, installation and calibration of Lab equipment is essential.</p> <p>Should be conversant with internationally acceptable modern standards for Quality Assurance in Harbor / Marine / Port / IWT / major infrastructure projects and all safety aspect of the project.</p> <p>Age Limit: Should not be more than 50 years of age as on the date of submission of tender.</p>	<p>supervising all the tests to be done in different stages of construction and for total Quality Assurance Plan of the project. He will also monitor the safety aspect related to the project to be complied by the EPC contractor.</p>	
3.	<b>Design Expert</b>	<p>Should be a Graduate in Civil Engineering. Post Graduate in Structural/Construction Engineering.</p> <p>Should have minimum 15 years of design experience including 5 years of experience in Port/Harbour / IWT/major marine structure related designs.</p> <p>Age Limit: Should not be more than 50 years of age as on the date of submission of</p>	<p>1. Should have handled similar assignment as Design Engineer/ manager or in a similar capacity for at least three projects of similar works/magnitude.</p> <p>2. Alternatively, he should have 8 years' experience of design in at least three infrastructure projects preferably in Port</p>	01



		tender.	<p>sector of which one project should be of similar works/magnitude.</p> <p>3. Responsible for the checking of detailed design &amp; drawing of the project submitted by the contractor and inform to the client regarding acceptance of the design &amp; drawings for their approval within the time frame stipulated for Engineering part of the main contract. He also has to review the design whenever required as per site condition during the project period. He shall undertake project site visits as and when required and if desired by the client at any point of time.</p>	
4	<p><b>Assistant Manager</b> (Contract &amp; Project Monitoring Expert)</p>	<p>Should be a graduate in Civil Engineering from a reputed University or institution.</p> <p>Minimum 15 years of experience in Contract &amp; Project Monitoring of various consultancy / works contracts.</p> <p>Age Limit: Should not be more than 50 years of age as on the date of submission of tender.</p>	<p>He will be responsible for Manage contract, including review of invoices from EPC contractor engaged by SMPK and match against relevant TOR / Contracts also monitoring of the work through latest modern project monitoring software.</p> <p>2. Review compliance and adherence to project agreements, contractual obligation in the main EPC</p>	01

			contract by the contractor for effective and timely completion of the project.	
<b>B. Non-Key Expert (will not be considered for the purpose of evaluation)</b>				
<b>S l. No.</b>	<b>Position</b>	<b>Educational Qualification</b>	<b>Experience, Roles &amp; Responsibility</b>	<b>No. of Personnel</b>
1	<b>Site Inspector</b>	<p>Should be a Diploma or above, in Civil Engineering.</p> <p>Minimum 7 years in project management and construction supervision of infra-structure Projects. Preference shall be given with experience in Port/Harbour/ IWT works projects.</p> <p>Age Limit: Should not be more than 40 years of age as on the date of submission of tender.</p>	<p>1. Responsible for the project implementation activities of the respective Contractors in close coordination with client Engineers.</p> <p>2. Ensure supervision and execution of works on site as per specifications and standards, and continuously interact with the SMPK and the respective Contractor.</p> <p>3. Assist Resident Engineer in supervision, coordination and monitoring the work of the EPC Contractor.</p> <p>4. Prepare various types of MIS reports</p> <p>5. Any other works as assigned by SMPK from time to time related to project work.</p> <p>6. Should be responsible for checking of layout and levels at project site through modern techniques of survey using total stations, GPS etc. Verify 7 checking of the layout, levels at</p>	03

			different stages of construction and suggest rectification if any deviation. He also has to assist Client Engineers' during measurement taking of works at various stage.	
--	--	--	---	--

**Criteria, sub-criteria and point system for the evaluation of the Full Technical Proposals:**

S I. No.	Item	Points
(i)	Specific experience of the Consultant (as a firm) relevant to the Assignment	10
	<b>Total points for criteria (i)</b>	<b>10</b>
(i)	Adequacy and quality of the proposed methodology, and work plan in responding to the Terms of Reference (TORs):	
(a)	Technical approach and methodology	20
(b)	Work Plan	15
(c)	Organization and staffing	10
	<b>Total Points for criteria (ii)</b>	<b>45</b>
	<i>[Notes to Consultant: The Client will assess whether the proposed methodology is clear, responds to TORs, work plan is realistic and implementable; overall team composition is balanced and has an appropriate skill mix; and the work plan has right input of Experts]</i>	
(i)	Key Expert's qualifications and competence for the Assignment:	
ii)	<i>[Note to Consultant: Each position number corresponds to the same for the Key Experts to be prepared by the Consultant]</i>	
(a)	Position K-1: Project Manager	15
(b)	Position K-2: Quality Cum Material Expert	10
(c)	Position K-3: Design Expert	10

c)		
( d)	Position K-4: Assistant Manager (Contract & Project monitoring Expert)	10
	<b>Total points for criterion (iii)</b>	<b>45</b>
	The number of points to be assigned to each of the above position shall be determined considering the following two sub criteria and relevant percent weights:	
( 1)	General qualification (general education, training and experience: <b>20%</b>	
( 2)	Adequacy for the Assignment (relevant education, training, experience in the sector / similar assignments): <b>80%</b>	
	Total Weightage	<b>100%</b>
	<b>Total Points for the above criteria (i + ii + iii)</b>	<b>100</b>
	<b>The minimum technical score required to pass is: 75</b>	

## (6) Standard Forms of Contract

### CONTRACT FOR CONSULTANCY SERVICES

Between

[Name of Client]

And

[Name of Consultants]/Lead Member

Dated:

## I. Form of Contract

### Contract to undertake [name of assignment]

This CONTRACT (hereinafter called the “Contract”) is made on the [Date in words] day of the month of \*month+ \*year in “yyyy” format, by and between

Syama Prasad Mookerjee Port, Kolkata, having its Registered Office at 2<sup>nd</sup> floor, Head office Building, 15, Strand Road, Kolkata-700001, India, hereinafter referred to as the “**Client**” which expression unless repugnant to context or meaning thereof shall include its successors, affiliates and assigns) of the First Part.

**and**

\*Name of Consultants and registered address (hereinafter called the “**Consultant(s)**”) which expression unless repugnant to context or meaning thereof shall include its successors, affiliates and assigns) of the Second Part.

### WHEREAS

(a) The Client vide Request of Proposal for the Appointment of Project Management Consultant (PMC) for the work of “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA. (hereinafter called the “**Consultancy**”) has requested the Consultants to provide certain consulting services as defined in the General Conditions attached to this Contract (hereinafter called the “**Services**”);

(b) The consultant submitted its proposal for the aforesaid work, whereby the consultant represented to the Client that it had the required professional skill, personnel and technical resources, have agreed to provide the services on the terms and conditions set forth in this Contract.'

(c) The Client, on acceptance of the aforesaid proposals of the Consultant, awarded the Consultancy to the Consultant vide its Letter of Award dated ----- (the "LOA") and

(d) In pursuance of the LOA, the parties hereto hereby agree as follows: -

NOW THEREFORE the parties hereto hereby agree as follows:

**(1) The following documents attached hereto shall be deemed to form an integral part of this Contract:**

(a) The General Conditions of Contract (hereinafter called "GCC");

(b) The Special Conditions of Contract (hereinafter called "SCC");

(c) The following Appendices:

(i) **Appendix A:** Terms of reference containing, inter-alia, the Description of the Services and reporting requirements, (reproduce **section-5 (ToR)**).

(ii) **Appendix B:** Key Personnel, Task assignment, qualification requirements of key Personnel (reproduce as per **Form 3H** submitted by the Applicant).

(iii) **Appendix C:** Cost Estimate (reproduce **Form 4B** submitted by Applicant)

(iv) **Appendix D:** "Conformed Document" which incorporates all the changes, modifications and results of the contract discussion, if required

(v) **Appendix E:** Copy of Letter of Award (attached signed copy of Letter issued by Client)

(vi) **Appendix F:** Copy of letter of Award/ acceptance by Consultant (Attached signed and accepted copy of Letter of Award by Consultant)

(vii) **Appendix G:** Copy of Bank Guarantee for Performance Security – **As per GCC**

(viii) **Appendix H:** Clarifications, if any

(ix) **Appendix I:** Hours of work for Consultant's Personnel, if required

(x) **Appendix J:** Correspondence, if any undertaken

(xi) **Appendix K:** Signed and stamped copy of RFP and all corrigendum issued.

**(2) The mutual rights and obligations of the Client and the Consultants shall be as set forth in the Contract; in particular:**

(a) The Consultants shall carry out the Services in accordance with the provisions of the Contract;  
and

(b) Client will make payments to the Consultants in accordance with the provisions of the Contract.

**(3) Priority of documents:** The Parties expressly agree that in the event of any conflict, inconsistency or contradiction between any clauses forming part of the documents constituting the Contract, and more particularly mentioned in Clause 1 (of this contract) hereinabove, the documents shall be interpreted in the following order of precedence:

(a) The provisions of this Contract shall override all provisions of other documents of the Contract.

(b) the provisions of the SCC shall be subject to the Contract, but shall override all provisions of other documents comprising the Contract;

(c) the provisions of the GCC shall be subject to the Contract SCC, but shall take precedence over all other documents comprising the Contract; and

(d) the Appendices shall subject to each of the Contract, SCC and the GCC

(e) Any decision of the Client in relation to the priority of documents shall be final and binding upon the Consultant

**IN WITNESS WHERE OF**, the Parties hereto have caused this Contract to be signed in their respective names as of the day and year first above written.

**FOR AND ON BEHALF OF Client**

[Signature] [Name] [Designation]

**FOR AND ON BEHALF OF CONSULTANT**

[Signature] [Name] [Designation]

**Witness:**

1. [Signature, name and address]
2. [Signature, name and address]

## II. General Conditions of Contract



**KOLKATA PORT TRUST**

**KOLKATA DOCK SYSTEM**

**CIVIL ENGINEERING DEPARTMENT**

**15, STRAND ROAD, KOLKATA -700001**

### **GENERAL CONDITIONS OF CONTRACT**

**FORMS AND AGREEMENTS**

**SANCTIONED BY TRUSTEES UNDER  
RESOLUTION NO. 92**



**OF  
THE 6<sup>TH</sup> MEETING HELD ON 27<sup>TH</sup> MAY,  
1993.**

**(Copy of Booklet Published on May, 1993)**

<b>TABLE OF CONTENTS</b>
--------------------------

A.	INDEX TO GENERAL CONDITIONS OF CONTRACT
B.	FORM OF TENDER
C.	FORM OF AGREEMENT
D.	FORM GC1, GC 2, GC3
E.	PERFORMANCE BOND
F.	INTEGRITY PACT

# GENERAL CONDITIONS OF CONTRACT

## INDEX

### CLAU SE

1. DEFINITIONS.
2. DUTIES 7 POWERS OF ENGINEER & ENGINEERS' REPRESENTATIVE.
3. THE TENDER/OFFER AND ITS PRE-REQUISITES.
4. THE CONTRACT & GENERAL OBLIGATION OF CONTRACTOR.
- 5 COMMENCEMENT, EXECUTION AND COMPLETION OF WORK.
6. TERMS OF PAYMENT.
7. VARIATION AND ITS VALUATION.
8. DELAY/EXTENSION OF COMPLETION TIME/LIQUIDATED DAMAGE/TERMINATION OF CONTRACT.
9. MAINTENANCE AND REFUND OF SECURITY DEPOSIT.
10. INTERPRETATION OF CONTRACT DOCUMENTS, DISPUTES & ARBITRATION.

## 1. DEFINITIONS

1.0. In the contract, as hereinafter defined, the following words and expressions shall have the meaning hereinafter assigned to them, except where the context otherwise requires.

1.1. "**Employer**" or "Board" or "Trustees" means the Board of Trustees for the Port of Kolkata, a body corporate under Section 3 of the Major Port Trust Act, 1963, including their successors, representatives and assigns.

1.2. "**Chairman**" means the Chairman of the Board and includes the person appointed to act in his place under Sections 14 and 14A of the Major Port Trusts Act, 1963.

1.3. "**Contractor**" means the person or persons; Firm or Company whose tender /offer has been accepted by the Trustees and includes the Contractor's representative's heirs, successor and assigns, if any permitted by the Board / Chairman.

1.4. "**Engineer**" means the Board's official who has invited the tender on its behalf and includes the Chief Engineer, the Chief Mechanical Engineer, the Senior Executive Engineer the Chief Hydraulic Engineer, the Deputy Chief Engineer, the Deputy Chief Mechanical Engineer, the Senior Resident Engineer, The Manager (Infrastructure & Civic Facilities), the Manager (Plant & Equipment) the Deputy Manager ( Infrastructure & Civic Facilities) and the Deputy Manager (Plant & Equipment), or other official as may be appointed from time to time by the employer, with written notification to the Contractor, to act as Engineer for the purpose of the contract, in place of the "Engineer" so designated.

1.5. "**Engineer's Representative**" means any subordinate Engineer or Assistant to the Engineer or any other official appointed from time to time by the Engineer to perform the duties set forth in Clauses 2.4 to 2.6 hereof.

1.6. "**Work**" means the Work to be executed in accordance with the Contract and includes authorized "Extra Works" and "Excess Works" and Temporary Works.

1.7. "**Temporary Works**" means all temporary works of every kind required in or about the execution, completion or maintenance of the works and includes (without thereby limiting the foregoing definitions) all temporary erections, scaffolding, ladders, timbering, soaking vats, site offices, cement and other godowns, platforms and bins for stacking building materials, gantries, temporary tracks and roads, temporary culverts and mixing platforms.

1.8. "**Extra Works**" means those works required by the Engineer for completion of the Contract which were not specifically and separately included in the schedule of items of works (i.e., Bills of Quantities) of the tender. "Excess Works" means the required quantities of work in excess of the provision made against any item of the Bill of Quantities.

1.9. "**Specifications**" means the relevant and appropriate Bureau of Indian Standards Specifications (latest revisions) for materials and workmanship unless stated otherwise in the Tender.

1.10. **"Drawings"** means the drawings referred to in the Tender and specification and any modification of such drawings approved in writing by the Engineer and such other drawings as may from time to time be furnished or approved in writing by the Engineer.

1.11. **"Contract"** means and includes the General and Special Conditions of Contract, Specifications, Drawings, priced Bill of Quantities, the Tender/ Offer, the letter of acceptance of the Tender/Offer, the Contract Agreement if separately entered into and the Schedule of Rates and Price, if any, adopted by the Trustees at their discretion.

1.12. **"Constructional Plant"** means all appliances or things of whatsoever nature required in or about the execution, completion or maintenance of the works or temporary works and includes (without thereby limiting the foregoing definition) all machinery and tools but does not include materials or other things intended to form or forming part of the permanent work.

1.13. **"Site"** means the land and other places, on, under, in or through which the works are to be executed or carried out and any other lands or places provided by the Trustees for the purpose of the Contract.

1.14. **"Contract Price"** means the sum named in the letter of acceptance of the Tender/ Offer of the Contractor, subject to such additions thereto and deduction there from as may be made by the Engineer under the provisions here-in-after contained.

1.15. **"Month"** means English Calendar Month.

1.16. **"Excepted risks"** are riot in so far as it is uninsurable, war, invasion, act of foreign enemies, hostilities (whether war be declared or not) Civil War, rebellion, revolution, insurrection or military or usurped power or use or occupation by the Trustees of any portion of the works in respect of which a certificate of completion has been issued (all of which are herein collectively referred to as the excepted risks).

1.17. Word importing the **singular** only, also includes the **plural** and vice-versa where the context so required.

1.18. The **headings and marginal notes** in these General Conditions of Contract shall not be deemed to be part thereof or be taken into consideration in the interpretation or construction thereof or of the contract.

1.19. Unless otherwise stipulated the word "Cost" shall be deemed to include overhead costs of the contractor, whether on or off the site.

## **2. DUTIES & POWERS OF ENGINEER & ENGINEER'S REPRESENTATIVE**

2.1. The Contractor shall execute, complete and maintain the works in terms of the contract to the entire satisfaction of the Engineer and shall comply with the Engineer's direction on any matter whatsoever.

2.2. The Contractor shall take instructions from the Engineer and subject to limitation of Clause 2.5 herein, from the Engineer's Representative.

2.3. The Engineer shall have full power and authority  
 (a) to supply to the contractor from time to time during the progress of the works such further drawings and instructions as shall be necessary for the purpose of proper and adequate execution and maintenance of the works and the contractor shall carry out and be bound by the same.

(b) to alter or modify the specification of any material and workmanship and to inspect the work at any time.

(c) to order for any variation, alternation and modification of the work and for extra works.

(d) to issue certificates as per contract.

(e) to settle the claims & disputes of the Contractor and Trustees, as the first referee.

(f) to grant extension of completion time.

2.4. The Engineer's representative shall:

(a) watch and supervise the works.

(b) test and examine any material to be used or workmanship employed in connection with the work.

(c) have power to disapprove any material and workmanship not in accordance with the contract and the contractor shall comply with his direction in this regard.

(d) take measurements of work done by the contractor for the purpose of payment or otherwise.

(e) order demolition of defectively done work for its reconstruction all by the Contractor at his own expense.

(f) have powers to issue alteration order not implying modification design and extension of completion time of the work and

(g) have such other powers and authorities vested in the Engineer, which have been delegated to him in writing by the Engineer under intimation to the Contractor.

2.5. Provided always that the Engineer's Representative shall have no power:

(a) to order any work involving delay or any extra payment by the Trustees,

(b) to make variation of or in the works and

(c) to relieve the Contractor of any of his duties or obligations under the Contract.

2.6. Provided also as follows:

60.

(a) Failure of Engineer's Representative to disapprove any work or materials shall not prejudice the power of the Engineer thereafter to disapprove such work or materials and to order the pulling down, removal, breaking-up thereof and re- construction at the contractor's cost and the contractor shall have no claim to compensation for the loss sustained by him.

(b) If the contractor shall be dissatisfied by reason of any decision of the Engineer's Representative, he shall be entitled to refer the matter to the Engineer who shall there upon confirm, reverse or vary such decision.

(c) Any written instructions or written approval given by the Engineer's Representative to the contractor, within the terms of delegation of power and authority vested in Engineer to his Representative in writing shall bind the contractor and the Trustees as though it had been given by the Engineer, who may from time to time make such delegation. Contractor and the Trustees as though it had been given by the Engineer, who may from time to time, make such delegation.

### **3. THE TENDER / OFFER AND ITS PRE-REQUISITES**

3.1. The Contractor shall, before making out and submitting his tender / offer be deemed to have inspected and examined the site, fully consider all factors, risks and contingencies, which will have direct and in direct impact on his expenses and profit from the work and shall be specifically deemed to have taken the following aspects into consideration:

(a) The form and nature of the site and its surroundings including their sub-surface, hydrological, tidal and climate conditions, the means of access to the site and all other local conditions including the likely charges and costs for temporary way-leave, if any, required for the work.

(b) The drawings, specifications, the nature and extent of work to be executed and the quality, quantity and availability of the required materials and labour for the work and the need to execute the work to the entire satisfaction of the Engineer, and also by complying with the General and Special Conditions of Contract.

(c) The accommodation required for the workmen and site office, mobilization  
/ demobilization and storage of all plant, equipment and  
Construction materials.

(d) The sources and means of procurement of water for drinking, washing and execution of work, and source and availability of electrical power, all of Contractor's cost.

(e) Payment of taxes and duties and compliance of all applicable statutes, ordinances and law together with the rules made there under, the rules, regulations and bye-laws of public bodies or any local or other authority by the Contractor, keeping the Trustees indemnified against penalties and liabilities of every kind arising from the Contractor's failure in such compliance.

(f) Payment of all kinds of stamp-duty for exacting the agreement or for any legal instrument including Bank Guarantees and Indemnity Bonds.

3.2. The Contractor's tender shall be in ink on the Tender Forms supplied by the Trustees, unless stipulated otherwise in the Notice-Inviting the Tender and shall be faultless in figures and free from erasing. Corrections, if any, shall only be made by scoring out and initialing of the revised figure.

3.3. If required by the Engineer or the Trustees, the Contractors in their tender or subsequently, shall disclose the names of their owners/partners/Share Holders at the required points of time. The failure in this regard shall be treated as a breach and a contract, if entered into, shall be liable to be cancelled.

3.4. Unless otherwise stipulated in the Notice Inviting the Tender/Offer, every tender must be submitted with Earnest Money of the amount calculated as per the following scale.

Estimated Value	Amount of Earnest Money	
	For works contract.	For contract of supplying materials of equipment only
Up to Rs.1,00,000/-	5% of the estimated value of work	1% of the estimated value of work.
Over Rs. 1,00,000/-	2% of the estimated value of work subject to a maximum of Rs.20,000/- and minimum of Rs. 5,000/-	1/2% of the estimated value of work subject to a maximum of Rs. 10,000/- and minimum of Rs. 1,000/-

(b) Earnest Money shall be deposited with Trustees' treasurer in cash or by Banker's Cheque of any Kolkata Branch of a Nationalized Bank of India drawn in favour of Kolkata Port Trust or in the form of an "Kolkata Port Trust" and payable at Kolkata / Haldia Holding as the case may be and the receipt granted there for be kept attached to the Tender / offer in the Sealed Cover.

(c) Earnest Money of un-accepted tender shall be refunded without any interest through A/c. Payee Cheque drawn on a Nationalized Bank of Kolkata / Haldia.

(d) The enlisted (registered) Contractors of the Trustees, who have deposited fixed Security with the Trustees FA & CAO / Manager (Finance) according to his Class of Registration, shall be exempt from depositing the Earnest Money, as per the following scale:

Class of Registration	Amount of Fixed Security	Financial limit of each tender
A	Rs. 10,000/-	Any tender priced up to Rs. 2,00,000/-
B	Rs. 5,000/-	Any tender priced up to Rs.1,00,000/-
C	Rs. 2,500/-	Any tender priced up to Rs.50,000/-



- (e) (i) Tender submitted without requisite Earnest Money may be liable to rejection.

(ii) If before expiry of the validity period of his Tender / offer, the tender amends his quoted rates or tender/ offer making them unacceptable to the Trustees and / or withdraws his tender / offer, the Earnest Money deposited shall be liable to forfeiture of the option of the Trustees.

(f) The Earnest Money of accepted Tender / offer shall be retained by the Trustees as part of the Security Deposit, for which a separate Treasury Receipt shall be issued to the Contractor after cancellation of the previous Receipt of Earnest Money.

(g) Balance security for works contract shall be recovered by deduction from all progressive Bill (including final Bill, if necessary) @ 10% of the gross value of work in each such bill, so that the total recovery may not exceed the quantum computed as per the under noted percentages of the total value of work actually done up to the stage of completion.

Value of Work	% of Security Deposit for works contract	% of Security Deposit for Contract of supplying materials and equipments only
For works up to Rs. 10,00,000/-	10% (Ten percent )	1% ( One percent )
For works costing more than Rs.10,00,000/- and up to Rs.20,00,000/-	10% on first Rs. 10,00,000/- + 7½ % on the balance	1% on first Rs.10,00,000/- + 1/2% on the balance
For works costing more than Rs.20,00,000/-	10% on first Rs. 10,00,000/- + 7½ % on next Rs.10,00,000/- + 5% on the balance	1% on first Rs.10,00,000/- + 1/2% on next Rs.10,00,000/- + 1/4% on the balance

(h) Balance Security for Contract of supplying materials and equipment computed in terms of the percentages given above, shall have to be deposited with the trustees' Treasurer in advance and within 30 days from the date of placement of supply order, either in cash or by A/c. Payee Draft of a Nationalized Bank of India drawn in favour of Kolkata Port Trust and payable at Kolkata / Haldia, as the case may be.

(i) No interest shall be paid by the trustees to the Tenderer / Contractor on the amount of Earnest Money / Security Deposit held by the Trustees, at any stage.

3.5.

(i) The Security Deposit shall be refunded to the Contractor in terms of Clause

9.3 hereinafter and subject to deduction, if any, under the provision of Sub- Clause 3.5(ii) herein below. If, however, the contract provides for any maintenance period, 50% of the Security Deposit may be refunded against any of the Treasury Receipt for that amount on expiry of half of the

maintenance period and the balance deposit on the said maintenance period and after the Engineer has certified the final completion of work in form G.C.2 and the Contractor has submitted his "No Claim" Certificate in form G.C.3.

(ii) The Security Deposit/Earnest Money may be liable to forfeiture at the option of the Trustees, if the Contractor fails to carry out the work or to perform/observe any of the conditions of the contract. The Trustees shall also be at liberty to deduct any of their dues from the Security Deposit, fixed Security, Earnest Money or from any sum due or to become due to the Contractor under any other contract.

3.6. If stipulated in the contract as a Special Condition, the Contractor shall have to submit to the Engineer a performance Bond in the form of an irrevocable guarantee from Kolkata / Haldia Branch, as the case may be, of any Nationalized Bank of India in the proforma annexed hereto and for the sum and period as mentioned in the letter of acceptance of the Tender/Offer, within 15 days from the date of such letter, failing which the contract shall be liable to be terminated and the Earnest Money are liable to forfeiture; all at discretion of the Engineer. The cost of obtaining this or any other Bank Guarantee and/or the revalidation thereof, wherever required, has to be borne by the Contractor and it shall be his sole responsibility to arrange for timely revalidation of such bank guarantee, failing which and for non-fulfillment of any contractual obligation by the Contractor, the Engineer and/or the Trustees shall be at liberty to raise claim against the Guarantee and/or enforce the same unilaterally.

3.7. Every Tenderer / bidder shall submit in respect of a tender value of more than Rs. 5 crores, along with their tender comprising Special Conditions of Contract, General Conditions of Contract, BOQ, Earnest Money, etc., a document called **Integrity Pact Agreement** duly signed by their authorized representative. The proforma of the Integrity Pact Agreement shall as specified in the G.C.C. In case of tender value more than Rs. 5 crores, the Integrity Pact Agreement is an essential part and parcel of the bid document to be submitted by each tenderer, without which the tender shall not be considered.

#### **4. THE CONTRACT & GENERAL OBLIGATIONS OF CONTRACTOR**

##### **4.1.**

- (a) The contract documents shall be drawn-up in English language.
- (b) The contract shall be governed by all relevant Indian Acts as applicable only within the jurisdiction of the High Court at Kolkata, India, including the following Act:
  - 1. The Indian Contract Act, 1872.
  - 2. The Major Port Trust, Act, 1963.
  - 3. The Workmen's Compensation Act, 1923.
  - 4. The Minimum Wages Act, 1948.
  - 5. The Contract Labour (Regulation & Abolition) Act, 1970.
  - 6. The Dock Workers' Act, 1948.
  - 7. The Indian Arbitration Act (1940) (in the case of a definite arbitration Agreement only).

4.2. After acceptance of his Tender / Offer and when called upon to do so by the Engineer or his representative, the Contractor shall, at his own expense, enter

into and execute a Contract Agreement to be prepared by him in the form annexed hereto. Until such Contract Agreement is executed the other documents referred to in the definition of the term "Contract" here-in- before shall collectively be the Contract.

4.3. Several documents forming the contract are to be taken as mutually explanatory of one another. Should there be any discrepancy, ambiguity, omission or error in the various contract documents, the Engineer shall have the power to correct the same and his decision shall be final and binding on the parties to the Contract.

4.4. Two copies of the Drawing referred to in the General and Special Conditions of Contract and in the Bill of Quantities, shall be furnished by the Engineer to the Contractors free of cost for his use on the work, but these shall remain the property of the Trustees and hence, the Contractor shall return them to the Engineer or his Representative on completion of the work. if not torn or mutilated on being regularly used at site.

4.5. The Contractor shall prove and make at his own expense any working or progress drawings required by him or necessary for the proper execution of the works and shall, when required, furnish copies of the same free of cost to the Engineer for his information and/ or approval, without meaning thereby the shifting of Contractor's responsibility on the engineer in any way whatsoever.

4.6. The Contractor shall not directly or indirectly transfer, assign or sublet the Contract or any part thereof without the written permission of the engineer. Even if such permission be granted, the Contractor shall remain responsible (a) for the acts, defaults and neglect of any sub-contractor, his agents servants or workmen as fully as if these were the acts, defaults or neglects of the Contractor himself or his agents, servants or workmen, and (b) for his full and entire responsibility of the contract and for active superintendence of the works by him despite being sublet, provided always that the provision of labourers on a "piece rate" basis shall not be deemed to be subletting under this clause.

4.7. Unless otherwise specified, the Contractor shall be deemed to have included in his Tender / Offer all his cost for supplying and providing all constructional plant, temporary work, materials both for temporary and permanent works, labour including supervision thereof transporting to and from the site and in and about the work, including loading, unloading, fencing, watching, lighting, payment of fees, taxes and duties to the appropriate authorities and other things of every kind required for the construction, erection, completion and maintenance of the work.

4.8. The Contractor shall be solely responsible for the adequacy, stability and safety of all site operations and methods of construction, even if any prior approval thereto has been taken from the Engineer or his Representative. The Contractor shall not be responsible for the correctness of the design or specification of the Temporary and Permanent works formulated by the Engineer; but the contractor shall be fully responsible for the correct implementation thereof as also for any design and specification prepared / proposed / used by the Contractor.

4.9. Whenever required by the Engineer or his Representative, the Contractor shall submit to him the details of his (a) programme for execution of the work, (b)

proposed procedure and methods of work, (c) proposed deployment of plant, equipment labour, materials and temporary works. The submission to and/ or any approval by the Engineer or his Representative to any such programme or particulars, shall not relieve the Contractor of any of his obligations under the contract. If for any reason the contractor be unable to adhere to his earlier programme, he shall submit his revised programme for completion of work within the stipulated time whenever asked to do so.

4.10. Necessary and adequate supervision shall be provided by the Contractor during execution of the works and as long thereafter as the Engineer or his Representative shall consider necessary during the maintenance period. The Contractor or his competent and authorised agent or representative shall be constantly at site and instructions given to him by the Engineer or his Representative in writing shall be binding upon the Contractor subject to limitation in clause 2.5 hereof. The Contractor shall inform the Engineer or his Representative in writing about such representative / agent of his at site.

4.11. The Contractor shall employ in execution of the Contract only qualified, careful and experienced persons and the Engineer shall be at liberty to direct the Contractor to stop deployment of any of his staff, workmen or official at site and the Contractor shall within 48 hours comply with such instruction without any demur, whenever the Engineer shall feel that the deployment of the person concerned will not be conducive to the proper and timely completion of the work.

4.12. The Contractor shall be responsible for the true and proper setting-out of the works in relation to reference points/lines/levels given by the Engineer in writing. The checking of any setting-out or of any alignment or level by the Engineer or his Representative shall not in any way relieve the contractor of his responsibility for the correctness thereof and he shall fully provide, protect and preserve all stakes, templates, bench marks, sight rails, pegs, level marks, profile marks and other things used in setting-out the works.

4.13. From the commencement of the works till issue of the completion certificate in Form G.C.1, vide Clause 5.12 hereof, the contractor shall take full responsibility for the care thereof. Save for the excepted risks, any damage, loss or injury to the work or any part thereof shall be made good by the Contractor at his own cost as per instruction and to the satisfaction of the Engineer, failing which the Engineer or his Representative may cause the same to be made good by any other agency and the expenses incurred and certified by the Engineer, shall be recoverable from the Contractor in whatever manner the Engineer shall deem proper. This Clause will not apply to that part of the work, which might have been taken over by the Trustees on partial completion of the work and in such case the Contractor's obligation will be limited to repairs and replacement for manufacturing or construction defects during the Maintenance period (Guarantee Period) as per the directions of the Engineer as also for defects/ damages if any caused to the work by the Contractor during such repairs and replacement in the maintenance period.

4.14. The Contractor shall at his own cost protect, support and take all precautions in regard to the personnel or structure or services or properties belonging to the Trustees or not, which may be interfered with or affected or disturbed or endangered and shall indemnify and keep indemnified the Trustees

against claim for injury, loss or damage caused by the Contractor in connection with the execution and maintenance of the work to the aforesaid properties, structures and services and/ or to any person including the Contractor's workmen. Cost of Insurance Cover, if any, taken by the Contractor shall not be reimbursed by the Trustees, unless otherwise stipulated in the Contract.

4.15. The Contractor shall immediately inform the Engineer's Representative if any fossil, coins, articles of value or antiquity and structures and other remains or things of geological or archaeological importance be discovered at site which shall remain the property of the Trustees and protect them from being damaged by his workmen and arrange for disposal of them at the Trustees expense as per the instruction of the Engineer's Representative.

4.16. The Contractor shall be deemed to have indemnified the Trustees against all claims, demands, actions and proceedings and all costs arising there from on account of:

- (a) Infringement of any patent right, design, trade-mark, or name or other protected right, in connection with the works or temporary work.
- (b) Payment of all royalties, rent, toll charges, local taxes, other payments or compensation, if any, for getting all materials and equipment required for the work.
- (c) Unauthorized obstruction or nuisance caused by the Contractor in respect of Public or Private road, railway tracks, footpaths, crane tracks, waterways, quays and other properties belonging to the Trustees or any other person.
- (d) Damage / injury caused to any highway and bridge on account of the movement of Contractor's plants and materials in connection with the work
- (e) Pollution of waterway and damage caused to river, lock, sea-wall or other structure related to waterway, in transporting contractor's plants and materials.
- (f) The Contractor's default in affording all reasonable facilities and accommodation as per the direction of the Engineer or his Representative to the workmen of the Trustees and other agencies employed by or with the permission and / or knowledge of the Trustees on or near the site of work.

4.17. Debris and materials, if obtained by demolishing any properly, building or structure in terms of the Contract shall remain the property of the Trustees.

4.18. The Contractor's quoted rates shall be deemed to have been inclusive of the following:

- (a) Keeping the site free of unnecessary obstruction and removal from site of constructional plant wreckage, rubbish, surplus earth or temporary works no longer required.
- (b) Cleaning and removal from site the entire surplus materials of every kind to leave the site clean and tidy after completion of the work, without which payment against final bill may be liable to be withheld.
- (c) Precautionary measures to secure efficient protection of Docks, the River Hooghly and other waterways against pollution of whatever nature during execution and maintenance of the works, and to prevent rubbish, refuse and

other materials from being thrown into the water by the Contractor's men or those of his agency.

(d) Making arrangements for deployment of all labourers and workers, local or otherwise including payment for their wages, transport, accommodation, medical and all other statutory benefits and entry permits, wherever necessary.

(e) Making arrangements in or around the site, as per the requirements of Kolkata Municipal Corporation or other local authority or the Engineer or his Representative, for preventing (i) spread of any infectious disease like smallpox, cholera, plague or malaria by taking effective actions for destruction of rats, mice, vermin, mosquitoes etc. and by maintaining healthy and sanitary condition, (ii) illegal storage and distribution of Drugs, Narcotics, Alcoholic liquor, Arms and Ammunitions, (iii) unlawful, riotous or disorderly conduct of the Contractor's or his Sub-Contractor's workmen,

(iv) deployment of workmen of age less than 16 years.

4.19. Every direction or notice to be given to the Contractor shall be deemed to have been duly served on or received by the Contractor, if the same is posted or sent by hand to the address given in the tender or to the Contractor's Site Office or in case of Trustee's enlisted Contractor to the address as appearing in the trustee's Register or to the Registered Office of the Contractor. The time mentioned in these conditions for doing any act after direction or notice shall be reckoned from the time of such posting or dispatch.

4.20. The Contractor and his sub-contractor or their agents and men and any firm supplying plant, materials, and equipment shall not publish or caused to be published any photographs or description of the works without the prior authority of the Engineer in writing.

4.21. The Contractor shall, at the Trustees' cost to be decided by the Engineer, render all reasonable facilities and Co-operation as per direction of the Engineer or his representative to any other Contractor engaged by the Trustees and their workmen, to the Trustees' own staff and to the men of other Public Body on or near the site of work and in default, the contractor shall be liable to the trustees for any delay or expense incurred by reason of such default.

4.22. The work has to be carried out by the Contractor causing the minimum of hindrance for any maritime traffic or surface traffic.

4.23. All constructional plants, temporary works and materials when brought to the site by the contractor, shall be deemed to be the property of the Trustees who will have a lien on the same until the satisfactory completion of the work and shall only be removed from the site in part or in full with the written permission of the Engineer or his Representative.

## **5. COMMENCEMENT, EXECUTION AND COMPLETION OF WORK**

5.1. The contractor shall commence the work within 7 days of the receipt of Engineer's letter informing acceptance of the Contractor's tender / offer by the Trustees or within such preliminary time as mentioned by the contractor in the

Form of Tender or the time accepted by the Trustees. The contractor shall then proceed with the work with due expedition and without delay, except as may be expressly sanctioned or ordered by the Engineer or his Representatives, time being deemed the essence of the contract on the part of the Contractor.

5.2. The Contractor shall provide and maintain a suitable office at or near the site, to which the Engineer's Representative may send communications and instructions for use of the Contractor.

5.3. Unless specified otherwise in the contract or prior permission of the Engineer has been taken, the contractor shall not execute the work beyond the working hours observed by the Engineer's Representative and on Sundays and Holidays observed in the trustees system, except in so far as it becomes essential on account of tidal work or for safety of the work. If the progress of the work lags behind schedule or the work has been endangered by any act or neglect on the part of the contractor, then the Engineer or his Representative shall order and the contractor at his own expense shall work by day and by night and on Sundays and Public Holidays. Any failure of the Engineer or his Representative to pass such an order shall not relieve the contractor from any of his obligations. The Engineer's decision in this regard shall be final, binding and conclusive.

5.4. Unless stipulated otherwise in the contract, all materials required for the work shall be procured and supplied by the contractor with the approval of the Engineer or his Representative and subject to subsequent testing as may be required by the Engineer or his Representative. The engineer shall exercise his sole discretion to accept any such materials.

5.5. Unless stipulated otherwise, in the contract, all materials, workmanship method of measurement shall be in accordance with the relevant Codes (Latest Revision) of the Bureau of Indian Standards and the written instructions of the Engineer or his Representative. Where no specific reference is available in the contract, the materials and workmanship shall be of the best of their respective kinds to the satisfaction of the Engineer.

5.6. Samples shall be prepared and submitted for approval of the Engineer or his Representative, whenever required to do so, all at the contractor's cost.

5.7. Unless stipulated otherwise in the contract, the cost of any test required by the Engineer or his representative in respect of materials and workmanship deployed on the work shall be borne by the contractor.

5.8. Regarding the supply of any materials by the Trustees to the contractor in accordance with the contract, the following conditions shall apply:

(a) The contractor shall, at his own expense, arrange for transporting the materials from the Trustees' Stores, watching, storing and keeping them in his safe custody, furnishing of statement of consumption thereof in the manner required by the Engineer or his representative, return of surplus and empty container to the Trustees' Stores as per the direction of the Engineer or his Representative.

(b) Being the custodian of the Trustees' materials, the contractor shall remain solely responsible for any such materials issued to him and for any loss or damage thereof for any reason other than "Excepted Risks", the contractor



shall compensate the Trustees' in the manner decided by the Engineer and shall at no stage remove or cause to be removed any such material from the site without his permission.

(c) The Trustees' materials will generally be supplied in stages and in accordance with the rate of progress of work, but, except for grant of suitable extension of completion time of work as decided by the Engineer, the contractor shall not be entitled to any other compensation, monetary or otherwise, for any delay in the supply of Trustees' materials to him. The Contractor shall, however communicate his requirement of such materials to the Engineer from time to time.

(d) Unless stipulated otherwise in the contract, the value of the Trustees' materials issued to the contractor shall be recovered from the Contractor's bills and / any of his other dues. Progressively according to the consumption thereof on the work and / or in the manner decided by the Engineer or his Representative and at the rate / stipulated in the contract. These rates shall only be considered by the contractor in the preparation of his tender / offer and these will form the basis of escalation / variation, if in future the contractor is required to procure and provide any such material on the written order of the Engineer consequent on the Trustees' failure to affect timely supply thereof.

(e) If the Engineer decides that due to the contractor's negligence, and of the Trustees' materials issued to the contractor has been – (i) lost or damaged,

(ii) consumed in excess of requirement, and (iii) wasted by the contractor in excess of normal wastage, then the value thereof shall be recovered from the contractor's bills or from any of his other dues, after adding 19.25% extra over the higher one of the following:

1. The issue rate of the materials at the Trustees' Stores, and
2. The market price of the material on the date of issue as would be determined by the Engineer.

5.9. The Engineer or his Representative shall have the power to inspect any material and work at any time and to order at any time – (i) for removal from the site of any material which in his opinion is not in accordance with the contract or the instruction of the Engineer or his Representative, (ii) for the substitution of the proper and suitable materials, or (iii) the removal and proper re-execution of any work, which in respect of material and workmanship is not in accordance with the contract or the instructions of the Engineer. The contractor shall comply with such order at his own expense- and within the time specified in the order. If the contractor falls to comply, the Engineer shall be at liberty to dispose of such materials and re-do any work in the manner convenient to the Trustees by engaging any outside agency at the risk and expense of the contractor and after giving him a written prior notice of 7 days.

5.10. No work shall be covered up and put out of view by the contractor without approval of the Engineer or his Representative and whenever required by him the contractor shall uncover any part or parts of the work or make openings in or through the same as may be directed by the Engineer or his Representative from time to time and shall reinstate or make good those part of works thus affected to the satisfaction of the Engineer, all at the cost of the contractor. The Trustees shall reimburse such cost as determined by the Engineer, if the initial covering up was with prior written order of the Engineer or his Representative.

5.11. On a written order of the Engineer or his Representative the contractor shall delay or suspend the progress of the work till such time the written order to resume the execution is received by him. During such suspension the contractor shall protect and secure the work to the satisfaction of the Engineer or his Representative. All extra expenses in giving effect to such order shall be considered by the Trustees, unless such suspension is

Otherwise provide for in the contract, or

1. Necessary by reason of some default on the part of the Contractor, or
2. Necessary by reason of climatic conditions on the site, or
3. Necessary for proper execution of the works or for the safety of the works or any part thereof. The Engineer shall settle and determine such extra payment and / or Extension of completion time to be allowed to the contractor, as shall, in the opinion of the Engineer, be fair and reasonable.

If at any time before or after commencement of the work the Trustees do not require the whole of the work tendered for, the Engineer shall notify the same to the contractor in writing and the contractor shall stop further works in compliance of the same. The Contractor shall not be entitled to any claim for compensation for underived profit or for such premature stoppage of work or on account of curtailment of the originally intended work by reason of alteration made by the Engineer in the original specifications, drawings, designs and instruction.

5.12. When the whole of the work has been completed to the satisfaction of the Engineer and has passed any final test prescribed in the contract, the contractor shall, within 21 days of submission of his application to the Engineer be entitled to receive from him a certificate for completion of work in Form G.C.1 annexed hereto. If any part of the total work having been completed to the satisfaction of the Engineer, be takeover and / or used by the Trustees the Contractor shall on application be entitled to partial completion certificate in the Form of G.C.1 indicating the portion of the work covered by it, so that the Contractor's liability during maintenance period of the contract, if any, shall commence from the date mentioned in such certificate so far as the completed portion of the work is concerned.

## **6. TERMS OF PAYMENT:**

6.1. No Sum shall be considered as earned by or due to the Contractor in respect of the work till final and satisfactory completion thereof and until a certificate of final completion in Form G.C.2 has been given by the Engineer. On account payments, if any, made prior to issue of the certificate in Form G.C.2, shall all be treated as mere advances, which shall stand recoverable in full or in part, if the Engineer so decides in the context of Contractor's unfulfilled contract condition, if any.

6.2. All payments shall be made to the Contractor on the basis of measurement of actual work done, as recorded in the Trustees' measurement books and at accepted tendered or at agreed rates, as the case may be except as otherwise provided in the contract and when the Engineer decided any other rate for change in the scope of work or omission, if any, on the part of the Contractor.

6.3. For work of sanctioned tender value more than Rs. 50,000/- or having an initially stipulated completion period of 4 months or more, on account payments may be made at the discretion of the Engineer or his Representative at intervals deemed suitable and justified by him. Provided always that, subject to execution of work of substantial value in the context of the contract price, the interval of such on account payments shall be decided by the Engineer or his Representative, which shall ordinarily not be less than 1 month in between two payments for on account bill and / or advance.

6.4. Measurement for works done shall be progressively taken by the Engineer's Representative and entered in the Trustees' Measurement Book, at intervals deemed suitable and proper by him and / or the Engineer. The Contractor or his duly accredited Representative or Agent shall remain present at the time of such measurement and assist the Engineer's Representative in every manner required by him. After the measurements taken have been entered in the Measurement Book, the Contractor or his Agent shall sign the Measurement Book at the end of such Measurements over the Contractor's Rubber Stamp as a token of acceptance of all such measurements, recorded above and prior to such signature. If the Contractor or his Agent fails to participate even after 3 days written notice from the Engineer's Representative the measurement shall be taken ex-parte by the Engineer's representative and those shall be accepted by the Contractor.

6.5. Based on the quantum of work and the value thereof computed in the Measurement Book, the Contractor shall type out his bill in the proforma approved by the Engineer and submit the same to the Engineer's Representative in quadruplicate, duly signed by him or his accredited Agent over his Rubber Stamp. The Engineer or his Representative may, in his absolute discretion, allow advance payment against such bill to the extent of an amount not exceeding 75% of the "net payable" sum of the said bill, subject to adjustment thereof against the bill at the time of checking and auditing the bill at the Trustees end. The measurement Book will not be handed over to the Contractor; but he will obtain the abstracts of quantities, amount and recoveries to type out the bill.

6.6. At the discretion of the Engineer or his Representative and only in respect of accepted offers/ where estimated amount put to tender would be Rs. 2,00,000/- or more, advance payment may be made to the extent of 75% of the value of any material purchased and brought to the site by the Contractor. Provided always that:

i.

The materials shall, in the opinion of the Engineer or his Representative, be of imperishable nature.

ii. The value of such materials shall be assessed by the Engineer or his Representative, at their own discretion.

iii. A formal agreement has been drawn up with the contractor, under which the Trustees secure a lien on the contractor's materials.

iv. The materials are safe-guarded by the contractor against losses, shortage and misuse due to the contractor postponing the execution of the work or otherwise.

v. In the event of shortage of such materials within the Trustees' protected areas in the Docks, the contractor shall submit an indemnity Bond in the proforma and manner acceptable to Trustee' whereby the contractor shall indemnify the Trustees' against all financial loss/ damage, on account of loss/ damage to such materials for whatever reasons.

vi. In the event of storage of such materials outside the Trustees' protected areas the Contractor shall submit to the Engineer an irrevocable Bank Guarantee favoring the Trustees and for the same sum as is being advance, in the proforma and manner acceptable to the Trustees. The Guarantee shall be of a Kolkata / Haldia Branch of any Nationalized Bank or a Scheduled Commercial bank, as the case may be, acceptable to the Trustees and shall remain valid till the anticipated period of consumption of such materials in the work. The Bank Guarantee must bear an undertaking by the issuing Bank guaranteeing automatic payment of the guaranteed sum to the Trustees by the Bank on the date of expiry of the validity of the Guarantee, unless with the prior written approval of the Engineer on behalf of the Trustees, the Bank has extended the validity of the Guarantee.

vii. The amount of advance shall be recoverable from the contractor's bills or any other dues, progressively with the consumption of the materials on the basis of quantity consumed. Consequent on full recovery of the advance the Indemnity Bond / Bank Guarantee, vide sub-clause (v) & (vi) above, shall be returned to the Contractor duly discharged by the Engineer on behalf of the Trustees.

6.7. No Certificate of the Engineer or his Representative shall protect the Contractor against or prevent the Trustees from obtaining repayment from the Contractor, in case the Engineer or his Representative should over certify for payment or the Trustees should over- pay the Contractor on any account.

6.8. No claim for interest shall be admissible to the Contractor at any stage and in respect of any money or balance or Bank Guarantee, which may be due to the Contractor from the Trustees, owing to dispute or otherwise or for any delay on the part of the Trustees in making interim or final payment or otherwise.

## **7. VARIATION AND ITS VALUATION:**

7.1. The Quantities set out in the Bill of Quantities of the tender shall be treated as estimated quantities of the work and shall never be deemed as actual or correct quantities of the works to be executed by the contractor in fulfillment of his obligation under the contract.

7.2. The Engineer shall have the power to order the Contractor in writing to make any variation of the Quantity, quantity or form of the works or any part thereof that may, in his opinion, be necessary and the Contractor upon receipt of such an order shall act as follows:

- a) Increase or decrease the quantity of any work included in the contract.
- b) Omit any work included in the contract.
- c) Change the Character or quality or kind of any work included in the contract.
- d) Change the levels, lines, position and dimensions of any part of the work, and
- e) Execute extra and additional work of any kind necessary for completion of the works.

7.3. No such variation shall in any way vitiate or invalidate the contract or be treated as revocation of the contract, but the value (if any) of all such variations evaluated in accordance with the Engineer's sole decision shall be taken into account and the contract price shall be varied accordingly.

7.4. Provided always that written order of the Engineer shall not be required for increase or decrease in the quantity of any work up to 15% where such increase or decrease is not the result of any variation order given under this clause but is the result of the quantities exceeding or being less than those stated in the bill of quantities. Provided also that verbal order of variation from the Engineer shall be complied with by the Contractor and the Engineer's subsequent written confirmation of such verbal order shall be deemed to be an order in writing within the meaning of this clause.

7.5. a) The Contractor shall not be entitled to any claim of extra or additional work unless they have been carried out under the written orders of the Engineer.

b) The Engineer shall solely determine the amount (if any) to be added to or deducted from the sum named in the tender in respect of any extra work done or work omitted by his order.

c) All extra, additional or substituted work done or work omitted by order of the Engineer shall be valued on the basis of the rates and prices set out in the contract, if in the opinion of the Engineer, the same shall be applicable. If the contract does not contain any rates or prices directly applicable to the extra additional or substituted work, then the Engineer may decide the suitable rates on the basis of Schedule of Rates (including surcharge in force at the time of acceptance of tender), if any, adopted by the Trustees with due regard to the accepted contractual percentage, if any thereon. In all other cases the Engineer shall solely determine suitable rates in the manner deemed by him as fair and reasonable, and his decision shall be final, binding and conclusive.

d) If the nature or amount of any omission or addition relative to the nature or amount of the whole of the contract work or to any part thereof shall be such that, in the opinion of the Engineer, the rate of prices contained in the contract for any item of the works or the rate as evaluated under sub-clauses

(b) and (c) of this clause, is by reason of such omission or addition rendered unreasonable or in-applicable the Engineer shall fix such other rate or price as he deems proper and the Engineer's decision shall be final, binding and conclusive.

## **8. DELAY / EXTENSION OF COMPLETION TIME / LIQUIDATED DAMAGE /TERMINATION OF CONTRACT**

8.1. Should the quantum of extra or additional work of any kind or delayed availability of the Trustees' materials to be supplied as per contract or exceptionally adverse climatic conditions and natural phenomenon or strikes, lock-outs, civil commotions or other special circumstances of any kind beyond the control of the Contractor cause delay in completing the work, the contractor shall apply to the Engineer in writing for suitable extension of completion time within 7 days from the date of occurrence of the reason and the Engineer shall thereupon consider the stated reasons in the manner deemed necessary and shall either reject the application or determine and allow in writing the extension period as he would deem proper for completion of the work, with or without the imposition of "Liquidated Damaged" Clause (No. 8.3 hereof) on the Contractor and his decision shall be binding on the contractor. If an extension of completion time is granted by the Engineer, the clause No. 8.3 of the Liquidated damage shall apply from its date of expiry, if the work be not completed within the extended time, unless stated otherwise in the decision communication by the Engineer, as aforesaid.

8.2. a) If the Contractor fails to complete the work within the stipulated dates or such extension thereof as communicated by the Engineer in writing, the contractor shall pay as compensation (Liquidated Damage) to the Trustees and not as a penalty, ½ % (half percent) of the total value of work (contract price) as mentioned in the latter of acceptance of the tender/offer, for every week or part thereof the work remains unfinished. Provided always that the amount of such compensation shall not exceed 10% the said value of work.

b) Without prejudice to any of their legal rights, the Trustees shall have the power to recover the said amount of compensation / damage in Sub- Clause (a) of this clause, from any money due or likely to become due to the contractor. The payment or deduction of such compensation / damage shall not relieve the Contractor from his obligation to complete the work or from any of his other obligations / liabilities under the contract and in case of the Contractor's failure and at the absolute discretion of the Engineer, the work may be ordered to be completed by some other agency at the risk and expense of the Contractor, after a minimum three days notice in writing has been given to the contractor by the Engineer or his Representative.

8.3. Without being liable for any compensation to the Contractor, the Trustees may, in their absolute discretion, terminate the contract due to occurrence of any of the following reasons and decision of the Trustees in this respect, as communicated by the Engineer shall be final and conclusive:

(i) The Contractor has abandoned the contract.

(ii) In the opinion of the Engineer, either the performance of the Contractor is not satisfactory or the work is not getting completed within the agreed period on account of Contractor's lapses.

(iii) The Contractor has failed to commence the work or has without any lawful excuse under these conditions, has kept the work suspended despite receiving the Engineer's or his Representative's written notice to proceed with the work.

(iv) The Contractor has failed to remove materials from site after receiving from the Engineer or his Representative the written notice stating that the said materials or work are rejected by him.

(v) The Contractor is not executing the work in accordance with the contract or is persistently or flagrantly neglecting to carry out his obligations under the contract.

(vi) Any bribe, commission, gift or advantage is given, promised or offered by or on behalf of the contractor to any officer, servant or representative of the Trustees or to any person on his or their behalf in relation to the obtaining or to the execution of the contract.

(vii) The Contractor is adjudged insolvent or enters into composition with his creditors or being a company goes into liquidation either compulsorily or voluntarily.

8.3.1 Upon receipt of the letter of termination of work, which may be issued by the Engineer on behalf of the Trustees, the Contractor shall hand over all the Trustees' tools, plant and materials issued to him at the place to be ascertained from the Engineer, within 7 days of receipt of such letter.

8.3.2 In all such cases of Termination of work, the Trustees shall have the power to complete the Work through any other agency of the Contractor's risk and expense and the Contractor shall be debited any sum or sums that may be expended in completing the work beyond the amount that would have been due to the contractor, had he duly completed the whole of the work in accordance with the contract.

8.3.3 Upon termination of contract, the contractor shall be entitled to receive payment of only 90 % of the value of the work actually done or materials actually supplied by him and subject to recoveries as per contracts, provided the work done and materials conform to specifications at the time of taking over by the Trustees. The payment for work shall be based on measurements of actual work done and priced at approved contract rates or other rates, as decided by the Engineer. The payment for materials supplied shall be at the rates as decided by the Engineer, which shall in no case be more than market rates prevailing at the time of taking over by the Trustees. The Engineer's decision in all such case shall be final, binding and conclusive.

8.3.4 The Trustees shall have the power to retain all moneys due to the Contractor until the work is completed by other agency and the Contractor's Liabilities to the Trustees and known in all respect.

## **9. MAINTENANCE AND REFUND OF SECURITY DEPOSIT**

9.1. On completion of execution of the work the contractor shall maintain the same for a period, as may be specified in the form of a Special Condition of the Contract, from the date mentioned in the initial Completion Certificate in the Form G.C.1. Any defect / fault, which may appear in the work during aforesaid maintenance period, arising, in the sole opinion of the Engineer or his Representative, from materials or workmanship not in accordance with the contract or the instruction of the Engineer or his Representative, shall, upon the written notice of the Engineer or his Representative, be amended and made good by the Contractor at his own cost within seven days of the date of such notice, to the satisfaction of the Engineer or his Representative, failing which the Engineer or his Representative shall have the defects amended and made good through other agency at the Contractor's risk and cost and all expenses, consequent thereon or incidental thereto, shall be recoverable from the Contractor in manner deemed suitable by the Engineer.

9.2. The Contract shall not be considered completed and the work shall not be treated as finally accepted by the Trustees, until a final Completion Certificate in Form G.C. 2 annexed hereto shall have been signed and issued by the Engineer to the contractor after all obligations under the Contract including that in the maintenance period, if any, have been fulfilled by the Contractor. Previous entry on the works or taking possession, working or using thereof by the trustees shall not relieve the Contractor of his obligations under the contract for full and final completion of the work.

9.3. On completion of the contract in the manner aforesaid, the Contractor may apply for the refund of his Security Deposit by submitting to the Engineer (i) The Treasury Receipts granted for the amount of Security held by the Trustees, and

(ii) his "No further claim" Certificate in Form G.C.3 annexed hereto (in original), whereupon the Engineer shall issue Certificate in Form G.C.2 and within two months of the Engineer's recommendation, the Trustees shall refund the balance due against the Security Deposit to the Contractor, after making deduction therefrom in respect of any sum due to the Trustees from the Contractor.

## **10. INTERPRETATION OF CONTRACT DOCUMENTS , DISPUTES & ARBITRATION**

10.1. In all disputes, matters, claims, demands or questions arising out of or connected with the interpretation of the Contract including the meaning of Specifications and Instructions or as to the quality of workmanship or as to the materials used in the work or the execution of the work whether during the progress of the work or after the completion and whether before or after the determination, abandonment or breach of the contract the decision of the Engineer shall be final and binding on all parties to the contract and shall forthwith be given effect to by the Contractor.



10.2. If, the Contractor be dissatisfied with any such decision of the Engineer, he shall within 15 days after receiving notice of such decision require that the matter shall be referred to Chairman, who shall thereupon consider and give a decision.

10.3. If, however, the contractor be still dissatisfied with the decision of the Chairman, he shall, within 15 days after receiving notice of such decision required that within 60 days from his written notice, the Chairman shall refer the matter to an Arbitrator of the panel of Arbitrators to be maintained by the Trustees for the purpose and any such reference shall be deemed to be a submission to arbitration within the meaning of Indian Arbitration Act, 1940 or any statutory modification thereof.

10.3.1 If the Arbitrator so appointed is unable or unwilling to act or resigns his appointment or vacates his office due to any reason whatsoever, another person from panel shall be appointed as Sole Arbitrator and he shall proceed from the stage at which it was left by his predecessor.

10.3.2 The Arbitrator shall be deemed to have entered on reference on the date he issues notice to both the parties fixing the date of first hearing.

10.3.3 The time limit within which the Arbitrator shall submit his award shall normally be 4 months as provided in Indian Arbitration Act, 1940 or any amendment thereof. The Arbitrator may, if found necessary, enlarge the time for making and publishing the award, with the consent of the parties.

10.3.4 The Venue of the arbitration shall be Kolkata or as may be fixed by the Arbitrator in his sole discretion. Upon every or any such reference to cost of any incidental to the reference and award respectively shall be in discretion of the Arbitrator who may determine, the amount thereof or by whom and to whom and in what manner the same shall be borne and paid.

10.3.5 The Award of the Arbitrator shall be final and binding on all parties subject to the provisions of the Indian Arbitration Act, 1940 or any amendment thereof. The Arbitrator shall give a separate award in respect of each item of disputes and respective claim referred to him by each party and give reason for the award.

10.3.6 The Arbitrator shall consider the claims of all the parties to the contract within only the parameters of scope and conditions of the contract in question.

10.3.7 Save as otherwise provided in the contract the provisions of the Arbitration Act, 1940 and rules made there under, for the time being in force, shall apply to the arbitration proceedings under this Clause.

10.4. The Contractor shall not suspend or delay the work and proceed with the work with due diligence in accordance with Engineer's decisions. The Engineer also shall not withhold any payment, which, according to him, is due or payable

to the Contractor, on the ground that certain disputes have cropped up and are likely to be referred to arbitration.

10.5. Provided always as follows:

(a) Nothing of the provisions in paragraphs 8.3 to 8.3.7 hereinabove would apply in the case of contracts, where tendered amount appearing in the letter of acceptance of the tender / offer is less than Rs. 40,00,000/-.

(b) The Contractor shall have to raise disputes or differences of any kind whatsoever in relation to the execution of the work to the Engineer within 30 days from the date of occurrence of the cause of dispute and before the preparation of the final bill, giving detailed justifications, in the context of contract conditions.

(c) Contractor's dispute, if any, arising only during the maintenance period stipulated in the contract, must be submitted to the Engineer, with detailed justifications in the context of contract Conditions, before the final completion of the work. No dispute or difference on any matter whatsoever, pertaining to the contract can be raised by the contractor after the completion of the work.

(d) Contractor's claim / dispute raised beyond the time limits prescribed in sub-clauses 8.5 (b) and 8.5 (c) hereinabove, shall not be entertained by the Engineer and / or by any Arbitrator, subsequently.

(e) The Chairman / Trustees shall have the right to alter the panel of Arbitrators on their sole discretion, by adding the names of new Arbitrators and / or by deleting the names of existing Arbitrators, without any reference to the Contractor.

## THE BOARD OF TRUSTEES FOR THE PORT OF KOLKATA

### FORM OF TENDER

**CONTRACT NO.**.....

To,

.....I/We

.....

..... of

.....

.....

having examined the site of works, inspected the Drawings and read the Specifications, General and Special Conditions of Contract and Conditions of Tender, hereby tender and undertake to execute and complete all the works required to be performed in accordance with the Specification, Bill of Quantities, General & Special Conditions of Contract and Drawings prepared by or on behalf of the Trustees and at the rates and prices set out in the annexed Bill of Quantities with ..... month/week from the date of the order to commence the work and in the event of our Tender being accepted in full or in part, I/We also undertake to enter into a Contract Agreement in the Form hereto annexed with such alterations or additions thereto which may be necessary to give effect the acceptance of the Tender and incorporating such Specification, Bill of Quantities, Drawings and Special & General Conditions of Contract and I / We hereby agree that until such Contract Agreement is executed the said Specifications, Bill of Quantities, Conditions of Contract and the Tender, together with the acceptance thereof in writing by or on behalf of the Trustees shall be the Contract.

**THE TOTAL AMOUNT OF TENDER Rs (Not To be filled up)**(Repeat in words) **(Not to be filled up)**

\*\*\*\*\*

\*\*\*\*\*

\*  
—

\*\*\*\*\* ..

.....

.....

\*I/We require ..... days/months preliminary time to arrange and procure the materials required by the work from date of acceptance of the Tender before I/We could commence the Work.

(\* This should be scored out in the case of labour contracts)

I/We have deposited with the Trustees' Financial Advisor & Chief Accounts Officer / Manager (Finance), Haldia Dock Complex vide Receipt No

..... of..... as Earnest Money.

I/We agree that period for which the Tender shall remain open for acceptance shall not be less than four months.

Signature of the Tenderer

Witness:

(Seal of the Tenderer)

Signature .....

Name of the Tenderer

.....

Name .....

(In Block Letters)(In

Block Letters)

Address .....

Dated

.....

.....

Address

..... Occupation

.....

.....

# THE BOARD OF TRUSTEES FOR THE PORT OF

## KOLKATA FORM OF AGREEMENT

THIS AGREEMENT made this ..... day  
of ..... 200..... between the Board of Trustees for the Port of Kolkata,

a body corporate constituted by the Major Port Trusts Act, 1963 (hereinafter called "Trustees" which expression shall unless excluded by or repugnant to the context be deemed to include their successors in office) of the one part  
and

.....

.....(hereinafter called " the Contractor ", which expression shall unless excluded by or repugnant to the context be deemed to include its heirs, executors, administrators, representatives and assignees or successors in office) of the other part.

WHEREAS the Trustees are desirous that certain works should be executed / constructed ,viz.

.....

.....and have accepted a Tender / Offer by the Contractor for the execution and maintenance of such work NOW  
THIS AGREEMENT WITNESSETH as follows :

1. In this Agreement words and expressions shall have the same meanings as  
are respectively assigned to them in General Conditions of Contract hereinafter referred  
to.

2. The following documents shall be deemed to form and be read and  
construed as part of this Agreement, viz.

- (a) The said Tender / Offer & the acceptance of the Tender / Offer
- (b) The General Conditions of Contract
- (c) The Special Conditions of Contract
- (d) The Conditions of Tender
- (e) The Technical Specifications
- (f) The Schedule of Rates
- (g) The Terms of Payment
- (h) All correspondence by which, the contract is added, amended,  
varied or modified in any way by mutual consent.

3. In consideration of the payments to be made by the Trustees to the  
Contractor as hereinafter mentioned , the Contractor hereby covenant with the Trustees  
to execute and maintain the work in conformity in all respects with the provisions of the  
contract.

4. The Trustees hereby covenants to pay to the Contractor, in consideration

of such execution  
manner prescribed

and maintenance of the Work, the Contract Prices at the times and in the  
by the Contract.

IN WITNESS whereof of the parties hereto have caused their respective Common Seals to be hereunto affixed (or have hereunto set their respective hands and seals) the day and year first above written.

The \_\_\_\_\_ Seal

of.....

...

.....

.....

Was hereunto affixed in the presence of:

Name.....

Address .....

.....

.....

.....

Or

## SIGNED, SEALED AND DELIVERED

by \_\_\_\_\_ the \_\_\_\_\_ said

.....

.

*In the presence of:*

Name.....

Address: .....

.....

....

*The Common Seal of the Trustees was hereunto affixed in the presence of:*

Name.....

Address: .....



Contractor .....

Address .....

.....Date of Completion

.....

Dear Sir/s,

This is to certify that the following works viz.

Name of the Work .....

.....Estimate Number E.E.O

.....dt

C.E.O.....dt.....

Work Order Number .....

Allocation.....

Contract Number .....

Which was carried out by you is in the opinion of the undersigned completing in every respect on the ----- Day of-----  
-----20.....in

accordance with clause 62 of the General Conditions of Contract and under the provisions of the Contract for a period of --.  
Days / weeks / months /

years.

From the.....day of ..... 20 .....

To the .....day of ..... 20 .....

Signature ( ..... )

(Engineer / Engineer's Representative)

Name.....

Designation.....

Office Seal

c.c. to The Deputy Chief Engineer ( )The  
Deputy Manager ( )

Financial Adviser & Chief Accounts Officer/Manager (Finance), Haldia Dock  
Complex.

# KOLKATA PORT TRUST

FORM G.C.2

The Financial Adviser & Chief Accounts Officer. The Manager (finance), Haldia

Dock Complex.

## CERTIFICATE OF FINAL COMPLETION

This is to certify that the following works viz.

Name of Work .....

Estimate No. E.E.O. No. .... dt .....

C.E.O. No .....dt .....

Work Order No.....dt .....

Contract No. ....

Resoln. No & Meeting No.....

Allocation .....

Which was carried out by Shri..... / Messrs is now complete in

every respect in accordance with the terms of the Contract and that all the obligations under Contract have been fulfilled by the Contractor.

Signature ( ..... )

(Engineer / Engineer's Representative)

Name.....

Designation.....

Office Seal

# KOLKATA PORT TRUST

## FORM G.C.3

(‘No Claim’ Certificate From Contractor)

The Engineer Kolkata Port Trust Kolkata /  
Haldia

(Attn: .....)

(Address, the Trustees’ Official, mentioned in the work Order and under whom the Contract  
was executed)

Dear Sir,

I / We do hereby declare that I / We have received full and final payment from Kolkata Port Trust for the execution of the following work, viz.

Name of Work .....

Work Order No ..... dt .....

Contract No ..... dt.....

Agreement No .....dt.....

and I / We have no further claim against Kolkata Port Trust in respect of the abovementioned job.

Yours faithfully,

(Signature of Contractor)

Date .....

Name of Contractor .....

Address .....

.....

(Official Seal of the Contractor)

Draft Proforma of Bank Guarantee (Performance Bond) in lieu of cash Security Deposit, to be issued by the Kolkata/Haldia Branch, as the case may be, of any nationalized Bank of India on Non-Judicial Stamp Paper worth Rs.50/- or as decided by the Engineer / Legal Adviser of the Trustees.

To

The Board of Trustees for the Port of Kolkata.

BANK GUARANTEE

NO.....DATE.....

Name of issuing Bank

..... Name of  
Branch.....

..... Address.....

..

In consideration of the Board of Trustees of the Port Kolkata, a body corporate - duly constituted under the Major port Trust Act, 1963 ( Act 38 of 1963), having agreed to exempt Shri / Messrs .....  
..... a proprietary / Partnership / Limited / Registered  
Company, having its Registered Office at .....

.....

(hereinafter referred to as "The Contractor") from cash payment of Security Deposit / Payment of Security Deposit through deduction from the Contractors' bills under the terms and conditions of a contract made between the Trustees and the Contractor for

..... (write the name of the work as per Work Order) in terms of  
the Work order No .....

..... ated .....(hereinafter

referred to as "the said contract"), for the due fulfillment by the contractor of all the terms and conditions contained in the said contract, on submission of a bank Guarantee for Rs

..... (Rupees .....

..... )  
we,.....Branch,

Kolkata...../ Haldia, do on the advise of the contractor,

hereby undertake to indemnify and keep indemnified the Trustees to the extent of the said sum of Rs ..... (Rupees  
.....

.....)

We.....Branch,Kolkata

...../Haldia, further agree that if a written demand is made by the Trustees through any of its officials for honoring the Bank Guarantee constituted by these presents, We,..... Branch, Kolkata .....

...../Haldia shall have no right to decline to cash the same for any reason whatsoever and shall cash the same and pay the sum so demanded to the Trustees within a



week from the date of such demand by an A/c. Payee Banker's Cheque drawn in favour of "Kolkata Port Trust", without any demur. Even if there be any dispute between the contractor and the Trustees, this would be no ground for us,.....

.....(Name of Bank), ..... .

..... Branch, Kolkata...../Haldia to decline to honour the

Bank Guarantee in the manner aforesaid. The very fact that We, ..... .

.....Branch,Kolkata...../Haldia, decline

or fail or neglect to honour the Bank Guaranteed in the manner aforesaid shall constitute sufficient reason for the Trustees to enforce the Bank Guarantee unconditionally without any reference, whatsoever, to the contractor.

2. We,.....Br

anch,Kolkata ...../Haldia, further agree that a mere demand

by the Trustees at any time and in the manner aforesaid, is sufficient for us,

..... Branch, Kolkata ..... / Haldia, to pay the amount covered by this Bank Guarantee in full and in the manner aforesaid and within the time aforesaid without reference to the contractor and no protest by the contractor, made either directly or indirectly or through Court, can be valid ground for us, .....

...Branch,Kolkata...../Haldia, to decline or fail or neglect

to make payment to the Trustees in, the manner and within the time aforesaid.

3. We, ..... Branch, Kolkata

..... / Haldia, further agree that the Bank Guaranteed herein contained shall remain in full force and effect, during the period that is taken for the due performance of the said contract by the contractor and that is shall continue to be enforceable till all the dues of the Trustees under and/or by virtue of the terms and conditions of the said contract have been fully paid and its claim satisfied and/or discharged in full and/or till the Trustees certify that the terms and conditions of the said contract have been fully and properly observed/fulfilled by the contractor and accordingly, the Trustees have discharged the Bank Guarantee, subject however, that this guarantee shall remain valid up to and inclusive of

.....day of .....19.....and subject all so that the provision that the Trustees shall have no right to demand payment against this guarantee after the expiry of 6(six) calendar months from the expiry of the aforesaid validity period up to ..... Or any extension thereof made by us, .....Branch, Kolkata / Haldia, in

further extending the said validity period of this Bank Guarantee on Non-Judicial Stamp Paper of appropriate value, as required / determined by the Trustees, only on a written request by the Trustees to the contractor for such extension of validity of this Bank Guarantee.

4. We, ..... .

Branch, Kolkata...../Haldia, further agree that, without our

consent and without affecting in any manner our obligations hereunder, the Trustees shall have the fullest liberty to vary from time to time any of the terms and conditions of the said contract or to extend the time for full performance of the said contract including fulfilling all obligations under the said contract by the contractor or to postpone for any time or from time to time any of the powers exercisable by the Trustees against the contractor and to forebear or enforce any of terms and conditions relating to the said contract and We, .....Branch, Kolkata

...../Haldia, shall not be relieved from our liability by reason of

any such variation or extension being granted to the contractor or for any fore- bearance, act or commission on the part of the Trustees or any indulgence by the Trustees to the contractor or by any such matter or thing of whatsoever nature, which under the law relating to sureties would, but for this provision, have effect of so relieving.....us,

Branch,

Kolkata ..... /Haldia.

5. We ..... Branch, Kolkata

...../Haldia, lastly undertake not to revoke this Bank Guarantee during its currency except with the previous consent of the Trustees in writing.

SIGNATURE.....

NAME.....

DESIGNATION.....

(Duly constituted attorney for and on behalf of)BANK.....

BRANCH.....

Kolkata..... / HALDIA.

(OFFICIAL SEAL OF THE BANK)

## **Integrity Pact**

Between

Syama Prasad Mookerjee Port, Kolkata (SMPK) hereinafter referred to as "The Principal/ Employer".

And

..... hereinafter referred to as "The Bidder/Contractor"

### Preamble

The Principal intends to award, under laid down organizational procedures, contract/s for

..... The Principal values full compliances with all relevant laws of the land, rules, regulations, economic use of resources and of fairness/transparency in its relations with its Bidder(s) and/or Contractor(s).

In order to achieve these goals, an Independent External Monitor (IEM) appointed by the principal, will monitor the tender process and the execution of the contract for compliance with the principles mentioned above.

NOW, THEREFORE,

To avoid all forms of corruption by following a system that is fair, transparent and free from any influence/prejudiced dealings prior to, during and subsequent to the currency of the contract to be entered into with a view to:-

Enabling the PRINCIPAL/EMPLOYER to get the contractual work executed and/or to obtain/dispose the desired said stores/ equipment at a competitive price in conformity with the defined specifications/ scope of work by avoiding the high cost and the distortionary impact of corruption on such work /procurement/ disposal and Enabling BIDDERS/ CONTRACTORS to abstain from bribing or indulging in any corrupt practice in order to secure the contract by providing assurance to them that their competitors will also abstain from bribing and other corrupt practices and the PRINCIPAL/EMPLOYER will commit to prevent corruption, in any form, by its officials by following transparent procedures.

## **Section 1 – Commitments of the Principal/ Employer.**

(1) The Principal commits itself to take measures necessary to prevent corruption and to observe the following principles:

1. No employee of the Principal, personally or through family members, will in connection with the tender for, or the execution of a contract, demand, take a promise for or accept, for self or third person, any material or immaterial benefit which the person is not legally entitled to.
2. The Principal will, during the tender process treat all Bidder(s) with equity and reason. The Principal will, in particular, before and during the tender process, provide to all Bidder(s) the same information and will not provide to any Bidder(s) confidential/ additional information through which the Bidder(s) could obtain an advantage in relation to the tender process or the contract execution.
3. The Principal will exclude from the process all known prejudiced persons.

(2). If the Principal obtains information on the conduct of any of its employees which is a criminal offence under the Indian Penal Code (IPC)/Prevention of Corruption (PC) Act, or if there be a substantive suspicion in this regard, the Principal will inform the Chief Vigilance Officer and in addition can initiate disciplinary actions.

## **Section-2 –Commitments of the Bidder(s) / Contractor(s)**

(1) The Bidder(s)/Contractor(s) commit himself to take all measures necessary to prevent corruption. He commits himself to observe the following principles during his participation in the tender process and during the contract execution.

a. The Bidder(s) /Contractor(s) will not directly or through any other person or firm, offer, promise or give to any of the Principal's employees involved in the tender process or the execution of the contract or to any third person any material or other benefit which he/she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the tender process or during the execution of the contract.

b. The Bidder(s)/Contractor(s) will not enter with other Bidders into any undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, subsidiary contract, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process.

c. The Bidder(s)/Contractor(s) will not commit any offence under the relevant IPC/PC Act; further the Bidder(s)/Contractor(s) will not use improperly, for purposes of competition or personal gain, or pass on to others, any information or document provided by the Principal as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.

d. The Bidder(s)/Contractor(s) of foreign origin shall disclose the name and address of the Agents/representatives in India, if any. Similarly the Bidder(s)/Contractor(s) of Indian Nationality shall furnish the name and address of the foreign principles, if any. Further details as mentioned in the

“Guidelines on Indian Agents of Foreign Suppliers” shall be disclosed by the Bidder(s)/Contractor(s). Further, as mentioned in the Guidelines, all the payments made to the Indian agent/representative have to be in Indian Rupees only. Copy of the “Guidelines on Indian Agents of Foreign Suppliers” is annexed and marked as Annex-A.

e. The Bidder(s)/Contractor(s) will when presenting his bid, disclose any and all payments he has made, is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract.

(2). The Bidder(s)/Contractor(s) will not instigate third persons to commit offences outlined above or be an accessory to such offences.

### Section-3-Disqualification from tender process and exclusion from future contracts

If the Bidder(s)/Contractor(s) before award or during execution has committed a transgression through a violation of Section 2 above, or in any other form such as to put his reliability or credibility in question, the Principal is entitled to disqualify the Bidder(s)/Contractor(s) from the tender process or take action as considered appropriate.

### Section 4-Compensation for damages

(1) If the Principal has disqualified the Bidder(s) from the tender process prior to the award according to Section 3, the Principal is entitled to demand and recover the damages equivalent to Earnest Money Deposit/Bid Security.

(2) If the Principal has terminated the contract according to Section 3 or if the Principal is entitled to terminate the contract according to Section 3, the Principal shall be entitled to demand and recover from the Contractor liquidated damages of the contract value or the amount equivalent to Performance Bank Guarantee.

### Section 5-Previous transgression

(1) The Bidder declares that no previous transgressions occurred in the last 3 years from the date of signing the Integrity pact with any other Company in any country conforming to the anticorruption approach or with any other Public Sector Undertaking / Enterprise in India, Major Ports/ Govt. Departments of India that could justify his exclusion from the tender process.

(2) If the Bidder makes incorrect statement on this subject, he can be disqualified from the tender process or action can be taken as considered appropriate.

### Section 6- Equal treatment of all Bidders/Contractors/Sub-Contractors

- (1) The Bidder(s)/Contractor(s) undertake(s) to demand from all subcontractors a commitment in conformity with this Integrity Pact, and to submit it to the Principal before contract signing.
- (2) The Principal, will enter into agreements with identical conditions as this one with all Bidders, Contractors and Sub-contractors.
- (3) The Principal will disqualify from the tender process all bidders who do not sign this Pact or violate its provisions.

## Section 7- Other Legal actions against violating Bidder(s)/ Contractor(s)/ Sub Contractor(s)

The actions stipulated in this Integrity pact are without prejudice to any other legal action that may follow in accordance with provisions of the extant law in force relating to any civil or criminal proceedings. .

## Section 8 – Role of Independent External Monitor(IEM):

(a) The task of the Monitors shall be to review independently and objectively, whether and to what extent the parties comply with the obligations under this pact.

(b) The Monitors shall not be subject to instructions by the representatives of the parties and shall perform their functions neutrally and independently.

(c) Both the parties accept that the Monitors have the right to access all the documents relating to the contract.

(d) As soon as the Monitor notices, or has reason to believe, a violation of this pact, he will so inform the authority designated by the Principal and the Chief Vigilance Officer of KolkataPort Trust.

(e) The BIDDER/ CONTRACTOR(s) accepts that the Monitor has the right to access without restriction to all contract documentation of the PRINCIPAL including that provided by the BIDDER/ CONTRACTOR. The BIDDER/ CONTRACTOR will also grant the Monitor, upon his request and demonstration of a valid interest, unrestricted and unconditional access to his contract documentation, if any. The same is applicable to sub-contractors. The Monitor shall be under contractual obligation to treat the information and documents of the Bidder/Contractor/ Sub-contractor(s) with confidentiality.

(f) The Principal/ Employer will provide to the Monitor sufficient information about all meetings among the parties related to the contract provided such meetings could have an impact on the contractual relations between the Principal and the Contractor. The parties offer to the Monitor, the option to participate in such meetings.

(g) The Monitor will submit a written report to the designated Authority of Principal/ Employer/ Chief Vigilance Officer of Syama Prasad Mookerjee Port, Kolkata within 8 to 10 weeks from the date of reference or intimation to him by the Principal/ Employer/ Bidder/ Contractor and should the occasion arise, submit proposals for correcting problematic situation. BIDDER/ CONTRACTOR can approach the Independent External Monitor (s) appointed for the purposes of this Pact.

(h) As soon as the Monitor notices, or believes to notice, a violation of this agreement, he will so inform the Management of the Principal and request the Management to discontinue or to take corrective action, or to take other relevant action. The Monitor can in this regard submit non-binding recommendations. Beyond this, the Monitor has no right to demand from the parties that they act in a specific manner, refrain from action or tolerate action.

(i) If the Monitor has reported to the Principal substantiated suspicion of an offence under the relevant

IPC/PCA, and the Principal/ Employer has not, within reasonable time, taken visible action to proceed

against such offence or reported to the Chief Vigilance Officer, the Monitor may also transmit this

information directly to the Central Vigilance Commissioner, Government of India.

(j) The word 'Monitor' would include both singular and plural.

#### 8.a) The Name and Correspondence Particulars of Independent External Monitors:

a) Shri Subhashish Sarkar, Flat No. 406, Block-III, Kirti Apartments,  
Mayur Vihar Phase-I Extension, Delhi-110 091,

Mob No. 98117 07230,

E-mail : subhashishsarkar53@yahoo(dot)com

b) Ms. Bulbul Sen, IRS (Retd.), B-104 Nayantara Apts.  
Block 8B, Sec - 7 Dwarka

New Delhi-110075

E-mail ID – bsensarkar@gmail(dot)com

### Section 9 – Facilitation of Investigation:

In case of any allegation of violation of any provisions of this Pact or payment of commission, the PRINCIPAL/EMPLOYER or its agencies shall be entitled to examine all the documents including the Books of Accounts of the BIDDER/CONTRACTORS and the BIDDER/CONTRACTOR shall provide necessary information and documents in English and shall extend all possible help for the purpose of such examination.

### Section 10 – Pact Duration:

The pact begins with when both parties have legally signed it and will extend upto 2 years or the complete execution of the contract including warranty period whichever is later. In case bidder/contractor is unsuccessful this Integrity Pact shall expire after 6 months from the date of signing of the contract.

If any claim is made/lodged during this time, the same shall be binding and continue to be valid despite the lapse of this pact as specified above, unless it is discharged/determined by Chairman, SMPK.[]



### Section 11 – Other Provisions:

- (1) This agreement is subject to Indian Law. Place of performance and jurisdiction is the Registered Office of the Principal in Kolkata.
- (2) Changes and supplements as well as termination notices need to be made in writing in English.
- (3) If the Contractor is a partnership or a consortium, this agreement must be signed by all partners or consortium members.
- (4) Should one or several provisions of this agreement turn out to be invalid, the reminder of this agreement remains valid. In this case, the parties will strive to come to an agreement to their original intentions.

---

(For & on behalf of the Principal)

(Office Seal)

Place:

Date:

---

(For & on behalf of Bidder/Contractor).

(Office Seal)

Witness 1:

(Name & Address) .....

Witness 2:

(Name & Address) .....

### III. Special Conditions of Contract

#### 1. **GENERAL:**

These provisions though given in a separate section are part of the tender documents which must be read as a whole, the various sections being complementary to one another and are to be taken as mutually explanatory. These provisions shall be read in conjunction with the other parts of the tender documents viz. General Conditions of Contract, Notice Inviting E-Tenders, and Instructions to Bidder, Particular Specifications, Drawings, Bill of Quantities and other documents forming part of the Contract. In case of any discrepancy or ambiguity in the documents, the order of precedence of the documents as stated below will apply. In particular, these provisions will over ride those in the General Conditions provided there is discrepancy between them.

#### 2. **CORRELATION AND ORDER OF PRECEDENCE OF TENDER DOCUMENTS:**

If the stipulations in the various tender documents be found to be at variance in any respect, one will override others (but only to the extent these are at variance) in the order of precedence as given in the list below, i.e. any particular item in the list will take precedence over all those placed lower down in the list.

- (a) Order letter.
- (b) Bill of Quantities.
- (c) Drawings.
- (d) Particular Specifications of work.
- (e) Special Conditions of Contract.
- (f) General Conditions of Contract.

In case of any dispute, question or difference either during the execution of the work or any other time as to any matter or thing connected with or arising out of this Contract, the decision of the Chief Engineer, Syama Prasad Mookerjee Port, Kolkata, thereon shall be final and binding upon all parties.

The execution of work shall conform minutely to the approved & assigned drawings & specification & any other details drawings which shall be provided /duly approved by the Engineer during the progress of the work as to such other drawings those have formed part of the contract documents.

#### 3. **Scope of PMC Services to be performed by the Successful PMC: As mentioned in Section- 5 (ToR)**

#### 4. **Time Period estimated for the consultancy service: Deployment period of 21 Months**

#### 5. **Terminology:**

##### a) **Quality:**

Quality is defined as "The totality of characteristics of an entity that bears on its ability to satisfy the stated and implied need". Quality Control is defined as the procedure adopted and controls exercised to ensure that the materials proposed to be used in production, process adopted for production and workmanships of production conform to the prescribed standards and laid down acceptance criteria. The quality control is exercised by construction agency that ensures that the defined objective is achieved through appropriate tests, checks and inspections by suitable qualified personnel and by following correct processes, methodologies to produce the right outcome. Furthermore, the objective evidences of all tests,

checks and inspections carried out from time to time are documented in prescribed formats for reference and record.

**Quality Assurance of a work** is defined as a process which exercises various checks at different stages of a work right from its inception till its acceptance, to put it in service to ensure that the work has been properly designed and constructed as per approved designs, drawings and specifications.

**Confirmatory Testing** is defined as the sampling and testing which is carried out independent of quality control sampling and testing to confirm that the executing agency results which have been reported are correct and representative, with statistical parameters of the material being produced/ processed.

**Acceptance** is defined as those operations, inspections, sampling and accepting the tests that are conducted to determine whether the product or service will be accepted for use and payment. Acceptance is determined using a statistically based acceptance plan in construction with assurance that the executing agency has fulfilled the quality control obligations. Acceptance is the responsibility of the SMP, KOLKATA.

**Documents to be referred:**

- a) Tender / relevant Contract specification and relevant BIS specifications/IRC / Other International Standard recommendations for improvement of Dock infrastructure for in and around Docks of KDS, available with SMP, KOLKATA
- b) Quality Assurance and Quality Control procedures, formats to be developed by the construction agency.
- c) Upto date Contract Specifications.
- d) Any other document as deemed fit by Selected PMC/SMP, KOLKATA

**Quality Objectives**

“This QA/QC services specify the ‘Quality management’ processes needed for the construction activities conducted by the construction Contractor engaged by SMP, KOLKATA for specific work/project.”

“To achieve ‘On time Completion of work/project as per Construction Schedule using ‘Best Practices’ according to Tender / relevant Contract specification and relevant BIS specifications/IRC /MORTH (5<sup>th</sup> Revision or any upgradation as deemed fit)/Specific CRRRI recommendations for improvement of road infrastructure for in and around Docks of KDS, available with SMP, KOLKATA”

“To achieve the above Project Objective the Project Manager will expect SMP, KOLKATA’s and Contractor’s project team members for its full cooperation and support for work target.”

**6. Responsibilities for accuracy of PMC Services:**

- a) The Selected PMC shall be responsible for accuracy of service provided by them. The advice and/or opinion, if any, provided shall be with documentary proof of standards/laws/codes etc. However, decision for execution of work will be of the SMP, KOLKATA and no claim of any kind of PMC will be entertained in this regard.

b) Selected PMC shall be responsible for providing advice and/or opinion regarding Quality Assurance Plan prepared by Executing Agency of the two works including methodology which should be adopted, Specifications, Standards and quality measure parameter etc. If there is conflict of provisions in this regard, decision of SMP, KOLKATA shall be final & binding on both the parties.

**7. The Services provided by the Selected PMC shall be inclusive of following:**

- (a) Remuneration to the personnel
- (b) Offices' hire charges
- (c) Travelling expenses of the personnel
- (d) Lodging and Boarding expenses of the personnel
- (e) Periodical reporting/documentation
- (f) Communication
- (g) Any contingency expenditure in connection to perform the assignment.
- (h) Setting up of On-site testing laboratories, testing charges of on-site tests of works in field and testing of works on off-site tests as per requirement and as approved by CE.
- (i) All statutory taxes including local and state/central government taxes shall be borne by the Selected PMC exceeding Service tax which shall be governed as per stipulation made under prevailing Act/rules.

Office accommodations for technical personnel of PMC working at project site have to be arranged by them, however a suitable area will be provided by SMPK for temporary office arrangement. No charges will be taken by SMPK, for providing the land for temporary office accommodation.

**8.0 ADDITIONAL CONDITIONS OF CONTRACT**

**8.1 Commencement, completion, suspension and termination of contract.**

**8.1.1 Commencement of services:**

The Selected PMC shall begin carrying out the services from the date of commencement as stipulated in the work order issued to them.

**8.1.2 Suspension:**

The SMP, KOLKATA may by written notice of suspension to the Selected PMC suspend all payments to the Selected PMC hereunder if the Selected PMC fail to perform any of their obligations under this contract, including carrying out the services, provided that such notice of suspension (i) shall specify the nature of failure and (ii) shall request the Selected PMC for remedy of such failure within a period not exceeding 15 days after receipt of such notice of suspension.

**8.1.3 Completion of the Project:**

Time limit for completion of the PMC project work as stipulated in the work tender is **21 (twenty-one) months**. However, the Selected PMC has to continue his services till actual completion of the project work by the contracting agency for which necessary extension of time may be given without imposition of LD, if it is found that the reason for extension is not due to the fault of Selected PMC.

#### **8.1.4 Expiration of contract:**

Unless terminated earlier pursuant of contract conditions hereof, this contract shall expire when services have been completed and all payments have been made at the end of such time period after the effective date or the extended period, if required.

#### **8.1.5 Liability on Quality:**

The Selected PMC is responsible to ensure complete quality of work executed. If quality of any part of work is proved inferior anyhow during execution or after completion of project, it shall be treated as the Selected PMC's failure in their obligations and accordingly action shall be taken as per clause 8.1.3 & 8.9 mentioned above. Moreover, all the payments due to the Selected PMC and their deposits kept with SMP, KOLKATA pertaining to various works at different work sites of SMP, KOLKATA assigned to the Selected PMC, along with EMD kept at SMP, KOLKATA shall be forfeited; and the Selected PMC shall be barred for a specific period to participate in any PMC tender of SMPK.

### **8.2 Obligations of the Selected PMC.**

#### **8.2.1 Standards of performance:**

The Selected PMC shall perform the services and carry out their obligations with reasonable due diligence, efficiency and economy, in accordance with generally accepted professional techniques and practices, and shall observe sound management practices, and use appropriate advanced technology and latest equipments, testing machineries and methods. The Selected PMC shall always act, in respect of any matter relating to this contract or to the services, as faithful advisers to the SMP, KOLKATA, and shall at all times support and safeguard the SMP, KOLKATA legitimate interests in any dealings.

#### **8.2.2 Law governing services:**

The Selected PMC shall perform the services in accordance with the applicable law and shall take all practicable steps to ensure that the personnel of the Selected PMC also comply the applicable law.

#### **8.2.3 Deleted**

#### **8.2.4 Confidentiality:**

The Selected PMC and/or their personnel shall not disclose any confidential information relating to the project/work, the services, the contracts or the SMP, KOLKATA's business or operations without the prior written consent of the SMP, KOLKATA.

#### **8.2.5 Reporting Obligations:**

The Selected PMC shall submit to the EIC or his authorized representative/SMP, KOLKATA the reports and documents specified in Terms of Reference, in the form, in the numbers and within the time periods as specified.

#### **8.2.6 Material furnished by the SMP, KOLKATA:**

The material made available to the Selected PMC by the SMP, KOLKATA shall be the property of the SMP, KOLKATA and shall be marked accordingly. Upon termination or expiration of this agreement, Selected PMC shall furnish forthwith to the SMP, KOLKATA, an inventory of such materials and shall dispose of such materials in accordance with the instructions of the EIC or his authorized representative/SMP, KOLKATA

#### 8.2.7 **Approval of personnel:**

The Selected PMC personnel to be deployed for this work shall be got approved from EIC or his authorized representative/SMP, KOLKATA.

#### 8.2.8 **Deleted**

#### 8.2.9 **Insurance to be taken out by the Selected PMC:**

The Selected PMC shall take out and maintain at their own cost, insurance against the risks and for the coverage as mentioned below, for the period of consultancy.

- (a) Third Party motor vehicle liability in respect of motor vehicle used by the Selected PMC or his personnel.
- (b) Workers compensation insurance in respect of personnel of the Selected PMC.
- (c) Insurance against loss or damages to the Selected PMC 's property used in performance of services and any documents prepared by the Selected PMC.

8.2.10 To provide all necessary formats for quality control acceptable as per Indian Standard /International Standard & contract specification procedure for respective works to be provided in advance to the Engineer-in-charge or his authorised representative.

8.2.11 The Selected PMC shall make no correspondence directly with the contracting agency of the project/work or they shall not give any instructions/suggestions directly to the Contracting Agency. They shall convey such issues to the authorized representative of EIC or his authorized representative/SMP, KOLKATA only.

#### 8.2.12 **Deleted.**

8.2.13 If any personnel employed on work by the Selected PMC **misbehaves** with EIC or his authorized representative/SMP, KOLKATA or Contractor's representative, he shall be removed from the site with a written order by the EIC and shall be prevented to engage anywhere at any work in SMP, KOLKATA by such order.

### 8.3 **Obligations of the SMP, KOLKATA**

#### 8.3.1 **Assistance:**

The SMP, KOLKATA shall provide the Selected PMC and their personnel with work permits/ free Dock permit and such other documents as shall be necessary to enable the Selected PMC 's personnel to perform the services at site without any hindrances.

#### 8.3.2 **Access to land:**

The SMP, KOLKATA warrants that the Selected PMC shall have free of charge, unimpeded access to all land in his premises in respect of which access is required for performance of the services.

### 8.3.3 Data, services and facilities:

The SMP, KOLKATA shall provide to the Selected PMC free of charge the following:

- (a) Copy of detailed engineering design, drawings of the works, which will be checked and verified by PMC within stipulated time of main contract and submit to the EIC or his representatives, so that SMPK can give approval of design and drawings for execution of the project work.
- (b) Two sets of final approved design & drawings of the project will be given to the PMC team to perform their work smoothly.
- (c) Copy of contract documents containing conditions of contract, contract specifications, BOQ and drawings etc. of the works for which PMC are to be performed.

### 8.3.4 Payment:

In consideration of the services performed by the Selected PMC under this contract, the SMP, KOLKATA shall make payments and in such manner as follows:

#### 8.3.4.1 Payment for PMC services:

Payment to the Selected PMC shall be done at his accepted tender rates and as per following terms.

- (a) On account payment to the Selected PMC shall be arranged as and when required at the discretion of the EIC or his authorised representative.
- (b) The terms of payment shall be in accordance with Clause-6 of the General Conditions of Contract.
- (c) The Selected BIDDER/PMC's fee as per scope of work will be paid as per quoted rates. The fee quoted shall be payable from the date from which the agreement comes in force.
- (d) The Selected PMC's fee is inclusive of all prevailing taxes, except GST. GST tax will be paid/reimbursement/deducted after paying as per the existing GST rules at the time of payment.
- (e) Subject to the availability and feasibility of system, SMP, KOLKATA may make payment directly to the Selected PMC's designated bank account. For this purpose, the Selected PMC will have to indicate (i) name of bank (ii) branch name (iv) branch code and (v) designated account number in the "Abstract Form Of Tender". In case payment is made directly through bank, the Selected PMC may be required to submit a pre-receipt as per instruction of SMP, KOLKATA.

#### 8.3.4.2 Considering the above, the PMC's fees shall be paid as under:

- a) **90%** of PMC fees shall be paid on the basis of payment of each bill to the contracting agency of the project work.
- b) **Remaining 10%** shall be paid within 30 days after acceptance of the final completion report by the SMP, KOLKATA as submitted by the Selected PMC mentioned in this RFP.

8.3.4.3 SMP, KOLKATA will deduct Income Tax from the payment to Selected PMC as per rules. The Tax Deduction Certificate for such deductions shall be issued by department to Selected PMC. The same will not be deducted if Selected PMC agency produces a certificate of exemption of the same.

#### 8.3.4 Fairness and Good Faith:

The parties undertake to act in good faith with respect to each other's rights under this contract and to adopt all reasonable measures to ensure the realization of the objectives of this Contract.

#### 8.3.5 Compliance of Suggestions:

Before preparing RA/Final bill of contracting agency the concerned SE shall comply satisfactorily to the queries, suggestions, notes etc. issued by the PMC agency. The concerned SE shall submit a copy of such compliance report to EIC.

#### 8.4 Security Deposit:

For the successful Bidder, the Security Deposit will be recovered from the contractors each and every On-Account Bill [including the final bill, if necessary] at the percentage of each such bills as set forth in **Clause. 3.4, 3.5 & 3.6 of the General Conditions of Contract.**

##### 8.4.1 Bonds for Performance Guarantees:

On issue of the work order, the Selected PMC may provide "Performance Guarantee" within 21 days of issue of work order equivalent to 3 % of the contract amount of PMC services in the standard Performa. This shall be applicable to the project/work assigned to the Selected PMC and valid upto three months after the end of the PMC contract.

##### 8.4.2 The performance security shall be in one of the following forms:

Bank Guarantee may be considered in lieu of Cash Security Deposit. In that case, the Selected PMC shall have to submit to the Engineer a performance Bond in the form of an irrevocable guarantee from any Nationalized Bank at Kolkata.

Such bank guarantee shall remain valid for **90 days** after expiration of the contract as mentioned above in this tender document.

##### 8.4.3 Responsibility for accuracy of PMC services provided:

The Selected PMC shall be responsible for accuracy of services provided by them for the project. They shall indemnify the **EIC/SMP, KOLKATA** through the Performance Security Deposit to be deducted as per this agreement against any action arising out of such inaccuracies in the work which might surface at any time at a later date of implementation of the project or final inspection report submitted by Selected PMC whichever is later.

##### 8.4.4 Release/ Forfeiture of Performance Security Deposit:

Performance Security deposit shall be released after 6 months of actual completion of the work or final inspection report submitted by Selected PMC or pre -audit of final bill of the Contractor, whichever is later. However, before refund of performance security deposit, it will be ensured that extension of time, if any, for agreement of Selected PMC is decided by the competent authority and final bill of Selected PMC has already been paid.

#### 8.5 Indemnity:

The Selected PMC shall indemnify the SMP, KOLKATA and its officers or employees, against any claim or liability of any kind, which includes but not limited to injury to person or property or rights of any person arising out of or in consequence of the performance of this Agreement.

#### 8.6 Force Majeure:



#### 8.6.1 Definition:

For the purpose of this contract, "Force majeure" means an event which is beyond the reasonable control of a party, and which makes a party's performance of its obligations here under impossible or so impractical as reasonably to be considered impossible in the circumstances, and includes, but is not limited, to acts of God, war (declared or undeclared), riots, civil disorder, are

- a) Within the power of the party invoking force majeure to prevent, confiscation or any other action by Government agencies.
- b) Force majeure shall not include (i) any event which is caused by the negligence or intentional action of a party employees, nor (ii) any event which a diligent party could reasonably have been expected to both (A) take in to account at the time of the conclusion of this contract and (B) avoid or over come in the carrying out of its obligations hereunder.
- c) Force majeure shall not include insufficiency of funds or failure to make any payment required hereunder.

#### 8.6.2 No breach of contract:

The failure of a party to fulfil any of its obligations here under shall not be considered to be a breach of or default under, this contract in so far as such inability from an event of force majeure, provided that the party affected by such an event has taken all reasonable precautions, due care and reasonable alternative measures, all with the objective of carrying out the terms and conditions of this contract

#### 8.6.3 Measures to be taken:

- a) A party affected by an event of Force Majeure shall take all reasonable measures to remove such party's inability to fulfil its obligations hereunder with minimum of delay.
- b) A party affected by an event of Force Majeure shall notify the other party of such event as soon as possible and in any event not later than fourteen (14) days following the occurrence of such event providing evidence of the nature and cause of such event and shall similarly give notice of the restoration of normal conditions as soon possible.
- c) The parties shall take all reasonable measures to minimize the consequences of any event of Force Majeure.

#### 8.7 Consultation:

Not later than thirty (30) days after the Selected PMC or SMP, KOLKATA, as the result of force majeure, have become unable to perform their contractual obligation under this contract, the parties shall consult with each other with a view for agreeing on appropriate measures to be taken in the circumstances.

#### 8.8 Extension of Time:

- a) Any period during which a party shall, pursuant to this contract complete any action or task shall be extended for a period equal to the time during which such party was unable to perform such action as a result of Force Majeure or for reasons not attributable to such Party.

b) Also, extension of time will be given to Selected PMC, if the execution of the work continues beyond the stipulated date(s) of completion. However, no extra payment on this account shall be payable to the Selected PMC.

#### **8.9 Termination of Contract:**

The SMP, KOLKATA may by not less than thirty (30) days written notice of termination to the Selected PMC (except in the event listed in paragraph (f) below, for which there shall be a written notice of not less than forty-five (45) days, such notice to be given after the occurrence of the events specified in the paragraph (a) through (f) of this condition no. 8.9 to terminate this contract.

a) If the Selected PMC fail to remedy in the performance of their obligations hereunder, as specified in a notice of suspension pursuant to Clause No.8.1.2 herein above, within thirty (30) day of receipt of such notice of suspension or within such further period as the SMP, KOLKATA may have subsequently approved in writing;

b) If the Selected PMC become insolvent or bankrupt or enter into any agreements with their creditors for relief of debt or take advantage of any law for the benefit of debtors or go into liquidation or receivership whether compulsory or voluntary;

c) If the Selected PMC fail to comply with any final decision reached as a result of arbitration proceedings;

d) If the Selected PMC submit to SMP, KOLKATA a statement which has a material effect on the right, obligations or interests of the SMP, KOLKATA and which the Selected PMC know to be false;

e) If as the result of force-majeure the Selected PMC are unable to perform a material portion of the services for a period of not less than thirty (30) days or

f) If the SMP, KOLKATA in its sole discretion and for any reason whatsoever, decides to terminate this contract.

#### **8.10 Cessation of Rights and Obligations:**

Upon termination of this Contract pursuant to Clause No. 8.9 hereof, or upon expiration of this Contract Clause no.8.1.4 hereof, all rights and obligations of the Parties hereunder shall cease, except:

- a) Such rights and obligations as may have accrued on the date of termination or expiration;
- b) The obligation of confidentiality set forth in Contract Clause no. 8.2.4 hereof;
- c) Any right which a Party may have under the Applicable Law.

**8.11 Cessation of Services:**

Upon termination of this Contract by notice pursuant to Contract Clause No. 8.9 hereof, the Selected PMC shall, immediately upon dispatch or receipt of such notice, take all necessary steps to bring the services to a close in a prompt and orderly manner and shall make every reasonable effort to keep expenditures for this purpose to a minimum. With respect to documents prepared by the Selected PMC and equipment and materials furnished by the SMP, KOLKATA, the Selected PMC shall proceed as provided, respectively, by Contract Clause No. 8.2.6 hereof.

**8.12 Payment upon Termination:**

Upon termination of this Contract pursuant, the SMP, KOLKATA shall make the following payments to the Selected PMC (after offsetting against these payments any amount that may be due from the Selected PMC to the SMP, KOLKATA):

- i) Remuneration pursuant to Clause no. 8.3.4 hereof for Services satisfactorily performed prior to the effective date of termination.
- ii) Reimbursable expenditures pursuant to Contract Clause no 8.3.4 hereof for expenditures actually incurred prior to the effective date of termination.

**8.13 Forfeiture of Performance Security Deposit upon termination of contract:**

In case, the agreement of Selected PMC is terminated due to the default of the Selected PMC, his Performance Security Deposit (deducted up to that stage) shall be forfeited which shall be absolutely at the disposal of the SMP, KOLKATA.

**8.14 Foreclosure:**

a) **SMP, KOLKATA** may, by not less than thirty (30) days of written notice of foreclosure (the expiry of the notice period whereof being the date of termination) to the Selected PMC, without assigning any reason whatsoever at any stage of the contract, terminate the contract.

b) Upon termination of this contract, the Selected PMC shall take necessary steps to bring the work to a close in a prompt orderly manner and shall handover all the documents/ reports prepared by the Selected PMC up to and including the date of termination to the SMP, KOLKATA.

c) The Selected PMC shall be duly paid for the works carried out and services rendered till the date of termination.

**8.15 Sub-contract:**

The Selected PMC shall not be permitted to assign the work to any sub-PMC unless otherwise approved.

**8.16 Miscellaneous:****8.16.1 Modification:**

Modification of the terms and conditions of this contract, including any modification of the scope of the services, may only be made by written agreement between the parties, however each party shall give due consideration to any proposals for modification made by the other party.

8.16.2 All monetary references and payments herein shall be in Indian Rupee Currency.

#### **9. LOCATION:**

The work shall have to be executed at **Netaji Subhash Dock, Kolkata.**

#### **10. ACCESS TO THE SITE:**

(a) By Road: From **CGR Road**.

(b) By Circular Rail: **Kidhirpur Railway Station**

#### **11. WORK SITE:**

**The work site is located** Within **Netaji Subhash Dock** Area of Syama Prasad Mookerjee Port, Kolkata. Tenderer must visit the work site and its surrounding before submission of the tender, so that due consideration is given to the local conditions at site. The intending tenderer should contact **Superintending Engineer (Netaji Subhash Dock) 51, C.G.R. Road, Kolkata 700043, Kolkata 700043** to make the site inspection along with his representative.

#### **12. INSPECTION OF SITE:**

The Bidder shall inspect the site of work and thoroughly familiarise himself with the nature of work, site conditions, and access to the site and location before submission of the tender. He should contact the **Superintending Engineer (Netaji Subhash Dock) at his office at 51, C.G.R. Road, Kolkata 700043 for Civil Work** for collecting information about the site before submission of the tender. No excuse will be entertained afterwards on the above ground. In case any part of the site cannot be handed over to the successful Bidder in time, no compensation for loss of labour or any other cause nor any claim will be entertained by the Trustees. Suitable extension of time shall, however, be granted to the successful Bidder on that ground if applied for.

#### **13. SITE CONDITIONS & METHOD OF WORK:**

The work shall have to be executed at Within Dock Area of Netaji Subhash Dock under the jurisdiction of **NSD (Netaji Subhash Dock) Division** as detailed in the Scope of Work & B.O.Q.

The contractor shall take adequate measures so as to execute the work with due regard to the above. The cost of which shall have to be included in the quoted rates.

Further, if so required by the Engineer in the interests of normal working of the Port, if it is found necessary to shift / suspend some construction activity for some duration, this shall be done in compliance with the instructions of the Engineer and as per relevant clause of the G.C.C. The bidder shall consider all

the above points while quoting as no separate claim for idle charges towards labour, material will be considered for payment.

Proper care should be taken to provide adequate protection to the existing structures and cables (telephone, computer, etc) all such installations against any damage at the Contractor's risk and expense. Any damage / defect to existing structures arising due to the faulty execution of the work shall have to be rectified forthwith as directed to the satisfaction of the Engineer, without charging extra.

#### **14. TIME OF COMPLETION:**

The work is urgent in nature and must be commenced immediately on receipt of the work order and to be completed in all respects within **21 (Twenty One) Months** including preliminary time from the date of placement of work order.

#### **15. SUFFICIENCY OF TENDER:**

i) The tender drawings and all data / information as furnished herein or inspected and / or collected by the PMC for the purpose of the work should be properly assessed, interpolated or utilised in his offer at his own responsibility and SMPK does not guarantee sufficiency or adequacy of the data / information so supplied to him or collected or understood by the PMC.

ii) The PMC shall be deemed to have satisfied himself before tendering as to the correctness and sufficiency of his tender for the works and of the rates stated in the priced Bill of Quantities and the rates shall cover all his obligations under the contract and all matters and things necessary for the proper construction, completion, commissioning and maintenance of the work.

iii) In case rate of particular item is printed erroneously in B.O.Q., the rate stated in the schedule of rates will prevail over the rate misprinted in B.O.Q.

#### **16. ACCESSIBILITY FOR CHECKING AND SUPERVISION:**

The successful PMC is to provide necessary arrangement for free access to the SMPK officer's and personnel for supervision and checking of the subject work at his own cost.

#### **17. SPECIFICATIONS/ CODES AND STANDARDS:**

All works under this contract will be executed according to the Trustees' Specification for works. Whenever the details are not specifically covered in the specifications, relevant provisions in the latest revision and/ or replacements of the Indian Standard Specifications (IS) or any other International Code of Practice/ CPWD specifications will be followed. The PMC shall have to procure copies of such codes/ standards for ready reference of his own personnel as well as the Engineer or his representative at site at his own cost and without any additional reimbursement.

**18. TEMPORARY WORKS:**

The successful PMC shall allow for providing labour and materials for the construction and removal of all temporary works, e.g. site office, site store, scaffolding, fencing lighting; watching, tube well and pipe lines etc. required for constructional purpose as well as for drinking water purpose of contractor's men, water supply, vats, platform, etc. as may be necessary for the successful execution, completion and maintenance of works without any extra cost to the Trustees and the rates should be quoted accordingly. No rent shall, however, be charged to PMC for construction/erection of such temporary sheds and structures.

**19. CONTRACT PRICE:**

The “**Contract Price**” for this contract means the sum named in the tender subject to such additions thereto, deductions there from or reductions due to supply of any materials by the Trustees’ as provided for in the Contract.

**20. SETTING OUT OF WORK AND INITIAL MEASUREMENTS:**

The Engineer shall provide the initial reference and Bench Mark for the setting out of work. It will be the successful PMC's responsibility to set out the work accurately and get them checked by the Engineer. The successful PMC shall provide at his own expense all necessary instruments, staff and labour for the checking of the survey.

The successful PMC shall be responsible for the true setting out of the work and for the correctness of all dimensions, levels, lines, positions and alignment. Any error in any part of the works shall be rectified by the successful PMC at his own cost. The successful PMC would set up inspection facilities at Site at his own cost.

**21. PARTICULARS OF EXISTING WORKS:**

Such information as maybe given in the specification as to the existing features and works other than those now under construction as part of “Syama Prasad Mookerjee Port, Kolkata” given without warranty of accuracy and neither the Trustees nor the Engineer will be liable for any discrepancies therein.

**22. SAFETY MEASURES:**

The successful PMC shall adhere to safe construction practice, guard against hazardous and unsafe working conditions and follow all safety precautions for prevention of injury or accidents and safeguarding life and property. The successful PMC shall comply with relevant provisions of Dock Workers (Safety, Health and Welfare) Act – 1986 and Dock Workers (Safety, Health and Welfare) Regulation – 1990 and Safety Officer of the Trustees or Safety Inspectors shall be afforded all facilities for inspection of the works, tools, plant, machineries, equipments etc. wherever so required. The successful PMC shall further comply with any instruction issued by the Engineer, Trustees’ Safety Officer, Safety Inspector in regards to safety which may relate to temporary, enabling or permanent works, working of tools, plants, machineries, equipments, means of access or any other aspect.

The successful PMC shall provide all necessary first aid measures, rescue and life-saving equipment to be available in proper condition.

The successful PMC shall provide PPE's (Personal Protective Equipments) such as, helmet, safety shoe etc. to all workers and shall also provide job specific PPE's e.g. safety belts for working at heights; protective face and eye shield, goggles, hand gloves for welding / gas cutting works; protective foot wear and gloves for hot works; facemasks, gloves and overalls for painting works, mixing and handling materials etc. as directed by the Engineer-In-Charge.

All safety rules shall be strictly followed while working on live electrical systems or installations as stipulated in the relevant safety codes.

Use of hoisting machines and tackles including their attachments, construction tools, machineries and equipments shall comply to the relevant safety codes.

Before allowing workers in sewers, manholes, any duct or covered channel etc, the manhole covers shall have to be kept open and ventilated at least one hour in advance and necessary safety torches / lamps should be inserted first before allowing entry to the worker. Suitable hand gloves and other safety gear will be provided to the worker during handling / removing of slushes / sludge etc. without any extra cost. The successful PMC shall adopt all the above safety measures at his own cost.

The successful PMC shall also ensure that –

- (i) No damage is caused to plants and vegetations unless the same is required for execution of the project proper.
- (ii) The work shall not pollute any source of water / land / air surrounding the work site so as to affect adversely the quality or appearance thereof or cause injury or death to animal and plant life.
- (iii) His office & labour hutment etc. shall be maintained in a clean and hygienic condition throughout the period of their use and different effluents of the labour hutment shall have to be disposed off suitably.

### **23. HOLIDAY OR SUNDAY WORK:**

Subject to provisions in local Acts and any statutes of the State, the successful PMC shall arrange for working on Holidays and Sundays whenever so desired by the Engineer to expedite progress and complete the works in time.

The successful PMC shall not be entitled to any additional payment for taking up works on Holidays and Sundays. The successful PMC should be prepared to resort to round-the-clock working by following shift timings for labour.

### **24. POWER SUPPLY:**

If available and if required, suitable power supply may be arranged by the Trustees at the nearest existing supply point of the site of work on receipt of request letter from the successful PMC to that effect. All necessary arrangements for the distribution at site will have to be made by the successful PMC at his own cost as approved by the Trustees' Engineer or his representative.

Charges for consumption of power shall be periodically recovered from the successful PMC's Bill at the rates of SMPK as prevalent amended from time to time including installation and hire charges for meters. The Trustees do not guarantee uninterrupted power supply from the above sources and successful PMC shall not be compensated for any delay in providing / irregularity of power supply. The successful PMC shall have to arrange for the supply of power at his own cost during such periods.

**25. WATER SUPPLY:**

The successful PMC will arrange for supply of water both for drinking and for construction purposes. However, on written request from the successful PMC, water for drinking purposes may be made available free of cost from the exiting water line of the Trustees at a point near the site of work. The successful PMC will have to arrange for laying pipelines, as necessary, as per approval of the Engineer or his representative, for storing and distributing the same to the work point at his own cost.

i) Under no circumstances, the successful PMC would be allowed to use such drinking water for constructional works.

ii) In any case Dock water will not be allowed to be used for any work including curing.

**26. THE SITE AND WORKING AREA CLEAR:**

The successful PMC shall at all times keep the site and working areas free from all surplus materials, rubbish and offensive matter all of which shall be disposed off in a manner to be approved by the Engineer's Representative.

**27. PROTECTION OF EXISTING SERVICES:**

The successful PMC must pay full attention to the fact that the existing service facilities for users are not distributed at any time due to storing of materials and rubbish and take every precaution to keep the entrance passage clear if the same are being used by the laborers.

The successful PMC shall be held liable for all damage and interference to the existing service, caused by him in execution of works. Should any damage be done to the existing services, in general, the successful PMC shall make good the same and any further work considered necessary by the Engineer's representative without any delay otherwise the cost of such repairing shall be recovered for his running bill for which Engineer's decision shall be final and binding.

**28. CLEANING DURING EXECUTION AND AFTER COMPLETION:**

On completion of the works the successful PMC shall reinstate and make good at his own expense any property or land which might have been disturbed and/or damaged by his works. He should also clean the site as required during execution and fully clear the site after completion of all the works.

The successful PMC shall forward any usable materials found during the course of construction at the work site or its vicinity to SMP, Kolkata's stores/yards, dispose off the debris beyond the port area all at his own expenses by his own transport and labour and clean out all part of the work and leave everything clean and tidy to the entire satisfaction of the Engineer, failing which suitable deduction will be made from final bill as per discretion of the Engineer/Engineer's representative.

**29. METHOD OF MEASUREMENT:**

Unless otherwise specified in the Particular Specifications and Bill of Quantities, the work shall be measured according to the current P.W.D.'s (Building, S&P & Road) Schedule of Rates (2014), Govt. of West Bengal and analysed rate. For details of measurement not covered by the above S.P.-27 1987 of B.I.S. shall be referred to.



**30. ON ACCOUNT PAYMENT:**

On account payment to the Contractor shall be arranged as and when required at the discretion of the Engineer on the basis of measurements of completed works at the quoted rates in the Bill of Quantities. The terms of payment shall be in accordance with Clause-6 of the General Conditions of Contract. The Bills should be submitted by the contractor in quadruplicate to the Office of the respective **Superintending Engineer (Netaji Subhash Dock)** with necessary documents in original. Subject to the availability and feasibility of system, SMPK may make payment directly to the contractor's designated bank account. For this purpose, the contractor will have to indicate (i) name of bank (ii) branch name (iii) branch code and (iv) designated account number in the "Abstract Form of Tender". In case payment is made directly through bank, the contractor may be required to submit a pre-receipt as per instruction of SMPK.

**31. LABOUR, TOOLS & PLANTS:**

The successful PMC shall supply all necessary labour, tools and plants required for satisfactory execution of the work.

**32. ESCALATION / VARIATION ON PRICES:**

No Escalation / Variation on the prices on any account will be considered for adjustment / payment.

**33. CONTRACT LABOUR LAWS:**

The successful PMC shall be required to comply with the Minimum wages Acts 1948, Employees Liability Act, 1938, Industrial Disputes Act, 1947, and The Contract Labour (Regulation and Abolition) Act, 1970, or statutory amendments and the modifications thereof, any other laws relating thereto and the rules made there under from time to time. **Payment to the labourers to be made as per the minimum wage rates fixed by Chief Labour Commissioner (Central) and as per M.W.A. Govt. of W.B. whichever is higher and revision from time to time.**

It will be the duty of the successful PMC to abide by the provisions of the Act. Ordinances, Rules, Regulations, Byelaws and Procedures as are lawfully necessary in the execution of the works. The successful PMC will be fully responsible for any delay/damage etc. and keep the Engineer indemnified against all penalties and liabilities of any kind for noncompliance or infringement of such Acts, Ordinances, Rules, Regulations By-laws and Procedures. **The successful PMC shall comply to the Employees' Bonus rules & to pay Bonus once a year to his workmen accordingly, for which no extra payment shall be made to the successful PMC.**

The successful PMC shall indemnify the SMPK against payment to be made under or for the observance of the laws aforesaid without prejudice to his right to claim indemnity from his sub-contractor.

The aforesaid regulations shall be deemed to be a part of this contract and any breach thereof shall be deemed to be a Breach of Contract. It will be obligatory on the part of successful PMC to obtain necessary Labour Licence from the Competent Authority for deploying requisite Nos. of labours in the work and submit to the Engineer-In-Charge prior to commencement of the work.

The successful PMC shall also be required to comply regarding 'Workmen Compensation Act, 1923 as amended by Amendment Act No.65 of 1976'

In addition to the above, the Personal Injuries (Compensation Insurance) Act, 1963 and any modifications thereof and rules made there under from time to time. The successful PMC shall take into

account all the above said financial liabilities in his quoted rates and nothing extra, whatsoever, shall be payable to him on this account.

The successful PMC shall indicate maximum number of workmen to be engaged on any day for execution of the work in the appropriate place in the ABSTRACT FORM OF TENDER & he shall have to obtain a regular /permanent license as per sec12(1) of the Contract Labour Act.

Further, whenever a contract work has commenced or completed, the contractor has to intimate the same to the Assistant Labour Commissioner (Central) /labour Enforcement Officer (Central) in Form IV-A within 15 days of such commencement or completion.

The successful PMC has to arrange for displaying the name of the Regional Labour Commissioner (Central), Asst. Labour Commissioner (Central) & Labour Enforcement Officer (Central) at his worksite(s). The successful PMC shall inform the Principal Employer the date, time & venue of disbursement to be made by him to his workers.

The successful PMC shall also be required to put up a notice at the site of work mentioning the date, time & venue of disbursement to be made by him to his workers and he or his authorized representative shall have to be present during period of disbursement.

#### **34. COMPLIANCE WITH E.P.F & M. P. ACT & ESI Act 1948:**

The successful PMC will have to comply with provision of EPF & MP Act 1952 and also for Employees State Insurance Act 1948 (along with amendments, if any), issued from time to time as applicable.

If asked for by the Employer, the successful PMC will be required to submit photocopy of all payment challans and produce the original for verification to the representative of the principal employer, i.e. **Superintending Engineer (Netaji Subhash Dock).**

#### **35. INDEMNIFICATION:**

The successful PMC shall be deemed to indemnify and keep indemnified the Trustees from and against all actions, claims, demands and liabilities whatsoever under and in respect of the breach of any of the provisions of any law, rules or regulations having the force of law, including but not limited to –

- a) The Minimum Wages Act, 1948.
- b) The Dock Workers (Regulation of Employment) Act, 1948
- c) The Building and Other Construction Workers (Regulation of Employment & Conditions of Service) Act, 1996
- d) The Dock Workers' Safety, Health & Welfare Act, 1986
- e) The Payment of Wages Act, 1936.
- f) The Workmen's Compensation Act, 1923.
- g) The Employees Provident Fund Act, 1952.
- h) The Contract Labour (Regulation and Abolition) Act, 1970; Rules 1971.
- i) The Equal Remuneration Act, 1976.
- j) The Employees State Insurance Act, 1948 & Employees State Insurance (Amendment) Act ,1989

- k) Child Labour (Prohibition and Regulation) Act, 1986.
- l) The Maternity Benefits Act 1961
- m) Interstate Migrant Workmen (Regulation of Employment & Conditions Of Service) Act, 1979.
- n) Motor Vehicle Act, latest revision.
- o) The payment of Bonus Act, 1965.

### **36. TAXES & DUTIES:**

**The prices quoted shall be including all statutory levies excluding GST, which shall be paid extra.**

Supplier/service provider to confirm that the GST amount charged in invoice is declared in its returns and payment of taxes is also made.

- The Supplier/ Service Provider agrees to comply with all applicable GST laws, including GST acts, rules, regulations, procedures, circulars & instructions thereunder applicable in India from time to time and to ensure that such compliance is done within the time prescribed under such laws. Supplier/Service Provider should ensure accurate transaction details, as required by GST laws, are timely uploaded in GSTN. In case there is any mismatch between the details so uploaded in GSTN by Supplier/ Service Provider and details available with Syama Prasad Mookerjee Port, Kolkata, then payments to Supplier/Service Provider to the extent of GST relating to the invoices/s under mismatch may be retained from due payments till such time Syama Prasad Mookerjee Port, Kolkata is not sure that accurate tax amount is finally reflected in the GSTN to SMPK's Account and is finally available to Syama Prasad Mookerjee Port, Kolkata in terms of GST laws and that the credit of GST so taken by Syama Prasad Mookerjee Port, Kolkata is not required to be reversed at a later date along with applicable interest.
- Syama Prasad Mookerjee Port, Kolkata has the right to recover monetary loss including interest and penalty suffered by it due to any non-compliance of tax laws by the supplier/service provider. Any loss of input tax credit to Syama Prasad Mookerjee Port, Kolkata for the fault of supplier shall be recovered by Syama Prasad Mookerjee Port, Kolkata by way of adjustment in the consideration payable.
- Supplementary invoices/Debit note/credit note for price revisions to enable Syama Prasad Mookerjee Port, Kolkata to claim tax benefit on the same shall be issued by bidder for a particular year before September of the succeeding Financial Year.

The purchase order/ work order shall be void, if at any point of time bidder is found to be a black listed dealer as per GSTN rating system and further no payment shall be entertained.

### **37. SETTLEMENT OF DISPUTES:**

If a dispute of any kind whatsoever arises between the Employer and the successful PMC in connection with or arising out of the contract or the execution of the works, the same shall be dealt as per relevant provisions of the General Conditions of Contract.

### **38. CONTRACTOR TO EXECUTE CONTRACT AGREEMENT:**

The successful PMC after acceptance of his tender shall be required to enter into and execute a Contract Agreement to be prepared in the form annexed to the General Conditions of Contract together with such modifications as may be necessary within one month from the date of placement of the order. The successful PMC shall have to submit copies in sextuplets of all

documents; correspondence, connected papers etc. as detailed in the above form of Contract Agreement together with the instrument of Contract Agreement prepared on Non-Judicial stamped paper of requisite denomination having five more copies made on plain paper all at his own cost. The successful PMC shall have to submit three sets of such Contract Agreement duly executed, sealed, signed and witnessed for execution by the Trustees. The other three sets shall be completed in all respects but not signed. If the successful PMC or tenderers are a partnership concern, they will have to get Agreement signed by all the partners or by the partner who is authorized to sign for and on behalf of the other partners.

The successful PMC shall also comply with the requirements of Security Deposit for the due fulfilment of the contract. The blank proforma of tender documents shall be supplied in sextuplets to the successful PMC free of charge for preparing the documents of the aforesaid Contract Agreement.

The successful PMC shall have to copy out and prepare the documents of the Contract Agreement neatly and correctly. The necessary amendments, corrections etc. (if any) have to be done at his own cost. The successful PMC shall be required to keep close co-ordination and liaison with the Marine Department while executing the works. The **Superintending Engineer** in charge of the construction will direct the representatives of the successful PMC to maintain liaison with different sections of the other departments and the successful PMC must keep the concerned **Superintending Engineer** of the Civil Engineering Department informed and/or posted with the programme contemplated with other departments. The **Superintending Engineer** of the Civil Engineering Department shall be nodal authority in all these co-ordinations and / or liaison and all programmes must be vetted by him. In cases of exigencies, the successful PMC or his representatives may establish direct liaison/co-ordination but in all such case the **Superintending Engineer** should be informed promptly.

#### **39. EMPLOYMENT OF LOCAL RESOURCES:**

The successful PMC shall pay special attention to engage the maximum possible number of local Engineer and other technical personnel.

#### **40. KOLKATA PORT TRUST:**

The expression “**KOLKATA PORT TRUST**” appearing anywhere in the tender documents, shall be construed to read as “**SYAMA PRASAD MOOKERJEE PORT, KOLKATA**”.

#### **41. CLARIFICATION OF BIDS:**

To assist in the examination and comparison of Tenders, the Employer may, at his discretion, ask any Tenderer for clarification of his Tender, including breakup/analysis of unit rates. The request for clarification and the response shall be in writing, but no change in the price or substance of the intending PMC shall be sought, offered, or permitted except as required to conform the correction of arithmetic errors discovered by the Employer in the evaluation of the Tenders.

No intending PMC shall contact the Employer on any matter relating to his Tender from the time of the Tender opening to the time the contract is awarded. If the intending PMC wishes to bring additional information to the notice of the Employer, he should do so in writing.

Any effort by the intending PMC to influence the Employer's Tender evaluation, Tender comparison or contract award decisions, may result in the rejection of his Tender.

**42. DELETED**

**43. DELETED**

**44. DISPARITY IN QUOTED RATE/AMOUNT:**

If there is any disparity between the quoted rate in percentage and the Tender Amount, the rate quoted in percentage shall prevail as the rate quoted by the successful PMC and the Tender Amount shall be derived by adding/subtracting (as the case may be) this percentage with/from the Estimated Value put to tender. Similarly, in case of disparity between the rate quoted in figures and in words, the rate quoted in words shall prevail.

**45. DOCK PERMIT:**

For works inside the Docks, Dock permit required for men, materials, vehicles and equipments etc. are to be procured by the successful PMC **at free of cost** as per recommendation of the executing departments/divisions indicating the specific number of free permits to be issued. But for creation of individual IDs in permit system a charge as applicable, will be levied per person (one time) even for companies/ Individuals who have been granted permission to obtain free permits by SMP, Kolkata. In case the work has to be carried out in an operational zone, the successful PMC should keep in mind that the work is to be executed without hampering the operational activities and should complete the work within the stipulated time specified in the tender.

**46. WORKING PERIOD:**

Normally the work will be carried out between **8 A.M. to 5 P.M.** on the Trustees' working days only. However, the intending PMC should note that he might be required to carry out the job on Sundays, holidays and after normal working hours and at night in addition to the normal working hours to expedite the progress of the work if permitted by **Competent Authority**. The intending PMC should include in his rates the cost, if any, involved on those accounts.

**47. BANK GUARANTEE IN LIEU OF CASH SECURITY DEPOSIT:**

Security deposit shall be recovered from the on A/C. Bill as per **Clause – 3.4 and 3.5 of General Conditions of Contract**. However, Bank Guarantee may be considered in lieu of Cash Security Deposit. In that case, the successful PMC shall have to submit to the Engineer a performance Bond in the form of an irrevocable guarantee from any Nationalized Bank at Kolkata in the proforma as given in the G.C.C. In this context **Clause 3.6 of G.C.C.** may be referred to.

**48. MEASURES AGAINST POLLUTION:**

The successful PMC shall have to take proper measures against environmental pollution during execution of work as directed by the Engineer.

The successful PMC shall, abide by all the regulations and rules of Syama Prasad Mookerjee Port, Kolkata and those that may be issued from time to time without any extra cost to the SMP, Kolkata.

**49. PORT AREA OBLIGATIONS:**

The Dock area is a custom bounded area and as such the successful PMC shall comply with all Regulations of the Port and Custom authorities and those that may be imposed from time to time in respect of the transit of all of successful PMC's plants, vehicles, materials, and staff in the area.

Whenever regulations so require, permits shall have to be obtained for such transit of successful PMC's plants, vehicles, staff and workmen. The successful PMC shall instruct his staff and Workmen to comply with all requirements in this "Restricted Area".

The successful PMC shall suitably fence the area that may be allotted to him inside the “Bonded Area” of the port for stores and other requirements to the full satisfaction of the Port and Security Agencies.

The successful PMC shall, abide by all the regulations and rules of Syama Prasad Mookerjee Port, Kolkata and those that may be issued from time to time without any extra cost to the SMP, Kolkata.

## 50. ERRORS IN THE BILL OF QUANTITIES:

In case rate of particular item is printed erroneously in B.O.Q., the rate stated in the Schedule of rates will prevail over the rate misprinted in B.O.Q.

[illegible]

**Annexure –A**

SYAMA PRASAD MOOKERJEE PORT, KOLKATA

सिविल इंजीनियरिंग विभाग

CIVIL ENGINEERING DEPARTMENT

15, स्टैंड रोड, कोलकाता -700001

15, Strand Road, Kolkata - 700001

NIT No.: **SMPK/KDS/CIV/T/2675/34 DT. 31.05.2022**

NOTE: Last Date of Download of tender documents : 12.07.2022 (up to 14.00 hours)

Tender is due for submission by 3:00 P.M. On 12.07.2022

\*\*\*\*\*

**PRICE BID (PART-II)**

\*\*\*\*\*

**Annexure-A (Contd.)**

**E-TENDER FOR RFP for selection of Project Management Consultant (PMC) for the work of “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA”**

NIT NO: SMPK/KDS/CIV/T/2675/34 Dt. 31.05.202

**PART –II/PRICE BID**

**TENDER PARTICULARS**

<b>ESTIMATED COST</b>		<b>NA</b>
<b>EARNEST MONEY</b>		<b>Rs. 3,93,850/-</b> (Rupees Three Lakhs Ninety- Three Thousand Eight Hundred and Fifty Only)
<b>TIME OF COMPLETION</b>		<b>21 Months</b>
<b>PERIOD OF DOWNLOAD OF E-TENDER (Both Days Inclusive)</b>		<b>06.06.2022 to 12.07.2022</b> (UPTO 14:00 HRS.)
<b>DATE AND TIME FOR PRE-BID MEETING (On line) Link will be shared through Corrigendum.</b>		20.06.2022 at 11.30 Hours
<b>LAST DATE OF SUBMISSION OF E-TENDER AND OPENING OF THE TENDER</b>		<b>Submission on 12.07.2022 Up to 15:00 hrs. Opening after 3-00 P.M on 13.07.2022.</b>



# SYAMA PRASAD MOOKERJEE PORT, KOLKATA

## सिविल इंजीनियरिंग विभाग

### CIVIL ENGINEERING DEPARTMENT

#### PREAMBLE TO THE BILL OF QUANTITIES

#### E-TENDER FOR RFP for selection of Project Management Consultant (PMC) for the work of "DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA"

**TENDER NO : SMPK/KDS/CIV/T/2675/34 Dt. 31.05.2022**

The Bill of Quantities must be read with the General Conditions of Contract, the Special Conditions of Contract and the Particular Specifications of Work and the Bidder is deemed to have examined the above documents and to have thoroughly familiarise himself with the total scope of work and its mode of execution.

1.2 The quantities given in the Bill of Quantities are approximate only and are given to provide a common basis for tendering. Payment will be made according to the quantities of each item of work actually carried out at the accepted rates as per Order Letter. The measurements of each item of work shall be measured jointly by the Engineer or his Representative.

1.3 General direction and description of work or materials given elsewhere in the contract documents are not necessarily repeated in the description of items in the Bill of Quantities.

1.4 The prices and rates entered by the Contractor in the Bill of Quantities shall be deemed to cover the complete and finished work, inter-alia, all costs and expenses which may be required for successful completion of the works together with all risks, liabilities, contingencies, insurance, octroi, royalties, taxes and obligations imposed or implied by the Contractor.

1.5 Where separate items such mobilisation, demobilisation, temporary works etc., have not been provided in the Bill of Quantities for works required under the Contract, then the cost of such works shall be deemed to have been included in the prices and rates of other items.

1.6 Without affecting the generality of the foregoing provisions, the prices and rates entered in the Bill of Quantities by the Contractor shall include inter-alia, all costs and expenses involved in or arising out the followings:-

1.7 The provision, storage, transport, handling, use distribution and maintenance of all materials, plants, equipment machineries and tools including all costs, charges dues demurrages or other outlays involved in the transportation.

1.8 The provision and maintenance of all his staff and labours and their payments, accommodation, transport, taxes and other requirements.

1.9 Setting out including the location and preservation of survey markers, measurement and supervision.

2.0 The provision, storage, transport, use handling, distribution and maintenance of consumable stores, fuel, water and electricity.

2.1 All First Aid, Welfare and safety requirements.

2.2 Damage caused to the works, plants, materials and consumables stores caused by weather.

2.3 Licence, fees and other charges for compliance of Government Acts and Rules that are in force and applicable.

2.4 The Contractor should be held responsible for the safe custody of materials, machineries etc. at site procured by him or issued to him by the Trustees.

2.5 This being an **ITEM RATE TENDER**, the Bidder shall quote his rates accordingly **on line** based on his own analysis .

The Tender Price thus established would be taken for comparative evaluation of E-Tenderer.

2.6 The Contractor shall at all times keep the site and working areas free from all surplus materials, rubbish , other excavated/offensive matter etc. all of which shall be disposed off in a manner to be approved by the Engineer's Representative.

2.7 On completion of the works the contractor shall reinstate and make good at his own expense any property or land which might have been disturbed and/or damaged by his works. He should also clean the site as required during execution and fully clear the site after completion of all the works.

The contractor shall forward any usable materials found during the course of construction at the work site or its vicinity to SMPK stores/yards, dispose off the debris beyond the port area all at his own expenses by his own transport and labour and clean out all part of the work and leave everything clean and tidy to the entire satisfaction of the Engineer, failing which suitable deduction will be made from final bill as per discretion of the Engineer/Engineer's representative.

XXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXX

**Bill of Quantity**N.I.T. No. **SMPK/KDS/CIV/T/2675/34 Dt. 31.05.2022**

Proposed Key Personnel are to be deployed on full time basis at the disposal of SMPK authority.

Sl. No.	Position	No. of post	Rate/month (in Rs.)	Amount for 21 months (in Rs.)
<b>(1) KEY-PERSONNEL</b>				
1	Project Manager	01		
	Quality Cum Material Expert	01		
	Design Expert	01		
	Assistant Manager (Contract & Project Monitoring Expert)	01		
<b>(2) NON-KEY-PERSONNEL</b>				
	Site Inspector	3		
<b>TOTAL AMOUNT (In Rs.)</b>				

**NOTE: - Amount Not to be Quoted here.**

\*The price offer is inclusive of all taxes, incidentals, overheads, travelling expenses, printing and binding of reports, expenditure related to presentation to be made during the execution of the Consultancy Service, sundries and all other items involving expenditure for execution of this assignment covering scope of work as stipulated in "Terms of Reference" of this RFP and excluding prevalent GST. This offer is valid for a period of **180 days** from the due date of submission of the proposal document.

**Signature of Power of Attorney Holder(s).....****Name: .....****NOTE: THE JOB CERTIFICATION WILL BE DONE BY THE IN-CHARGE OF PMC ON MONTHLY BASIS.**



**SYAMA PRASAD MOOKERJEE PORT, KOLKATA**

**(Erstwhile KOLKATA PORT TRUST)**

**(AN AUTONOMOUS BODY UNDER THE MINISTRY OF PORTS, SHIPPING AND WATERWAYS, GOVERNMENT OF INDIA)**

**KOLKATA DOCK SYSTEM**

**एन.एस. में बैक यार्ड के विकास सहित 7 एनएसडी पुराने बर्थ के पुनर्वास के लिए  
डिजाइन, इंजीनियरिंग और निर्माण। डॉक, केडीएस, एसएमपी, कोलकाता**

**“DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD  
BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK,  
KDS, SMP, KOLKATA”**

**Tender Document for EPC Contract**

**NIT NO.SMPK/KDS/CIV/T/2622/60 Dt.29.10.2021**

**Civil Engineering Department  
SYAMA PRASAD MOOKERJEE PORT, KOLKATA**

**FAX: +91-033-2230-0413, Phone: +91-033-2230-0413**

**Visit at [www.smpportkolkata.shipping.gov.in](http://www.smpportkolkata.shipping.gov.in) & <https://kopt.enivida.in>**

**Email: [ce@kolkataporttrust.gov.in](mailto:ce@kolkataporttrust.gov.in) & [sk.halder@kolkataporttrust.gov.in](mailto:sk.halder@kolkataporttrust.gov.in)**

Civil Engineering Department  
SYAMA PRASAD MOOKERJEE PORT, KOLKATA

INDEX

SL. No.	DESCRIPTION	Page Nos.	
		From	To
Part A- General Information			
1.	Bid Description	4	4
2.	NIT	5	6
3.	Procedure for Bid Submission	7	17
4.	Memorandum (General Description)	18	19
Part B-Commercial Bid			
5.	SECTION-1: Instruction to Bidders	21	31
6.	SECTION-2: Forms of Bid, Qualification Information And Letter of Acceptance	32	41
7.	SECTION-3: General conditions of Contract	42	79
8.	SECTION-4: Special Conditions of Contract	80	101
9.	SECTION-5: Schedule of Payment	102	104
10.	SECTION-6: Forms of Securities and Other Formats	105	136
Part C-Technical Bid			
11.	SECTION-7: Time Schedule	138	139
12.	SECTION-8: Site Conditions and Specifications	140	180
13.	SECTION-9: Drawings	181	185
14.	SECTION-10: Important Project Parameters/ Project related information	186	202
15.	SECTION-11: Soil Investigation Report	208	586
Part D- Price Bid			
16.	SECTION-12: Price Bid	203	207

## **PART A- GENERAL INFORMATION**

1. Bid Description

**NAME OF WORK: - “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK, KDS, SMP, KOLKATA”.**

TENDER DOCUMENT AVAILABLE	FROM : TO :	02.11.2021, from 14:00 Hrs 09.12-2021, upto 13:00 Hrs
TIME AND DATE OF PRE-BID CONFERENCE(Online)	DATE :	16-11-2021
	TIME :	At 15:00 Hrs
LAST DATE AND TIME FOR RECEIPT OF BIDS	DATE :	09.12.2021
	TIME :	upto15:00 Hrs
TIME AND DATE OF OPENING OF BIDS	DATE :	10.12.2021
	TIME :	At 15:00 Hrs
PLACE OF OPENING OF BIDS :	Chief Engineer’s Office, Kolkata Dock System, SMP,Kolkata.  Head Office, 2 <sup>nd</sup> FLOOR ,15 - Strand Road, Kolkata 700001	

**2.NOTICE INVITING TENDERS (NIT)**

ORGANISATION	SYAMA PRASAD MOOKERJEE PORT, KOLKATA
DEPARTMENT	Civil Engineering Department
NIT NUMBER	SMPK/KDS/CIV/T/2622/60 Dt.29.10.2021
NAME OF WORK	DESIGN, ENGINEERING & CONSTRUCTION FORREHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK, KDS, SMP, KOLKATA.(EPC contract)
PERIOD OF COMPLETION	18 (Eighteen) Months
FORM OF CONTRACT	EPC(TURNKEY)
BIDDING TYPE	Open Tender
TYPE OF TENDER	EPC Mode- Lump-sum turnkey
TENDER DOCUMENT FEE	Rs.10,000/-+Rs. 1,800/-(GST@18%) =Rs.11,800/- (Eleven Thousand Eight Hundred only)
RAILTEL TENDER PROCESSING FEE (NON-REFUNDABLE) MODE OF PAYMENT: - E-PAYMENT ONLY THROUGH DEBIT/CREDIT CARD OR NET BANKING.	Tender Processing Fee- Rs 7500/-+GST . Registration Charges Rs2000/- + applicable GST .
TENDER DOCUMENT FEE PAYABLE TO	NEFT/RTGS to the Bank Account as detailed below:  A/C: Syama Prasad Mookerjee Port, Kolkata A/c No: 067502000000491 IFSC: IOBA0000675 Bank Name: Indian Overseas Bank Branch Name: STRAND ROAD Branch
MODE OF PAYMENT	DD / NEFT/RTGS Payable to: Syama Prasad Mookerjee Port, Kolkata
SOLVENCY	Rs.30.60 Cr. All Bidders shall submit Bank Solvency certificate from a nationalized / scheduled bank in India for a minimum amount as mentioned in Section - III: Bid Data Sheet. The Bank Solvency certificate submitted by the Bidder shall not be older than one (1) year from the Bid Submission Last Date. In case Bidder does not adhere to this criterion, his bids shall be considered non-responsive and shall not be considered for further evaluation process.
EMD/BID SECURITY	Exempted as per Ministry of Finance Circular No. F9/4/2020-PPD, Dt.: 12-11-2020 upto 31.12.2021.
BID DOCUMENT DOWNLOADING START DATE & TIME	02.11.2021 from 14.00hrs.
PRE-BID MEETING	<u>16.11.2021 at 15.00 hrs.</u> in virtual mode (online). Link for Pre- Bid meeting : Link of Zoom Meeting  <a href="https://zoom.us/j/92454810250?pwd=UFERysvNFhEZmZCajVvRHZJTUxwdz09">https://zoom.us/j/92454810250?pwd=UFERysvNFhEZmZCajVvRHZJTUxwdz09</a>  Meeting ID : 92454810250 Pass Code: 741813
BID-DOCUMENT DOWNLOADING END DATE & TIME	09.12.2021 upto 13.00 hrs.



LAST DATE AND TIME FOR RECEIPT OF BIDS	09.12.2021 upto 15.00 hrs.
BID VALIDITY	180 days from the date of opening of tender.
TECHNICAL BID OPENING DATE & TIME	10.12.2021 after 15.00 hrs
OFFICER INVITING BIDS	Chief Engineer,KDS, SMP, Kolkata
BID OPENING AUTHORITY	Superintending Engineer-(Contract)
ADDRESS	C/o Chief Engineer's Office, Kolkata Dock System, SMP, Kolkata. Head Office, 2 <sup>nd</sup> FLOOR ,15 - Strand Road, Kolkata 700 001
CONTACT DETAILS	<ul style="list-style-type: none"> <li>• Designation- Chief Engineer: Mobile No.: +91 98362 98695 Email ID: ce@kolkataporttrust.gov.in</li> <li>• Designation-Dy. Chief Engineer – I: Mobile +91 98362 98651 Email ID: <a href="mailto:ab.pal@kolkataporttrust.gov.in">ab.pal@kolkataporttrust.gov.in</a></li> <li>• Designation-Dy. Chief Engineer – II: Mobile +91 98362 98680 Email ID: santanumitra@kolkataporttrust.gov.in</li> <li>• Designation -SE (Contract): Mobile No: +91 96747 20075 Email ID: sk.halder@kolkataporttrust.gov.in</li> </ul>

### **3. Procedure for Bid Submission**

**Annexure-A**

**Important Instructions for e-Tender**

Bidders are requested to use internet Browsers Firefox version below 50 / Internet Explorer version 8 or above, and Java 8Update 151 or 161.

Further, bidders are requested to go through the following information and instructions available on the Enivida Portal

**<https://kopt.enivida.in/>** before responding to this e-tender:

- Bidders Manual Kit
- Help for Contractors
- FAQ

**Contact Persons (Syama Prasad Mookerjee Port, Kolkata):**

1. S.K. Halder, Superintending Engineer  
(Contract)  
2. R. Mondal, Engineer(c) M.N.-9674720070

Phone no. **03371012486 ,03371012398**

e-mail ID: - [sk.halder@kolkataporttrust.gov.in](mailto:sk.halder@kolkataporttrust.gov.in) & [cecontract@kolkataporttrust.gov.in](mailto:cecontract@kolkataporttrust.gov.in)

Contact persons (Enivida Portal):  
**Phone No.7278929467/8448288981**  
**Mail id: - [enividahelpdesk@gmail.com](mailto:enividahelpdesk@gmail.com)/ewizardkumar@gmail.com**

1	All entries in the tender should be entered in online Technical & Commercial Formats without any ambiguity.
2	E-tender cannot be accessed after the due date and time mentioned in NIT.
3	KoPT reserves the right to cancel or reject or accept or withdraw or extend the tender in full or part as the case may be without assigning any reason thereof.
4	Any order resulting from this tender shall be governed by the terms and conditions mentioned therein.
5	No deviation to the technical and commercial terms & conditions are allowed.
6	The bidders must upload all the documents required as per terms of tender. Any other document uploaded which is not required as per the terms of the tender shall not be considered.
7	The bid will be evaluated based on the filled-in technical & commercial formats.
8	Bidder has fully read and understood the entire Tender Document, GCC, Corrigendum and Addenda, if any downloaded from under the instant e-tender and no other source, and will comply to the said document, GCC, Corrigendum and Addenda. <b>A declaration in this regard is to be made by the bidder.</b>
9	(A) Tender will be opened electronically on specified date and time as mentioned in the NIT. Bidder’s can witness electronic opening of Bid. (B) Necessary addendum/corrigendum (if any) of the tender would only be hoisted in the e-Enivida Portal
10	(A) Part- I i.e. Techno-commercial Bid will be opened electronically on specified date and time as mentioned in the NIT. Bidders can witness electronic opening of Bid. (B) Part- II i.e Price Bid will be opened electronically of only those bidder (s) whose offer will be Techno-Commercially qualified and accepted by SMPK. Such Bidder (s) will be intimated the date of opening of price Bid (Part II) in due course through valid email confirmed by them. Necessary Addendum/ Corrigendum (If Any) of the tender would only be hoisted in the Enivida Potal.

- a. Bids shall be submitted online on Enivida Portal <https://kopt.enivida.in>
- b. The bidders should scan and upload copies of Document in support of Registration as contractor. The bidders shall manually sign on all the documents, uploaded by him, owning responsibility for their correctness/authenticity.
- c. (1) The bidders should pay the Tender Document Fee (non-refundable) which shall be accepted only through RTGS/NEFT/Electronic Bank Transfer. The SMPK bank account details to which amount is to be transferred on is given below:

A/C: Syama Prasad Mookerjee Port, Kolkata  
 A/c No: 067502000000491  
 IFSC: IOBA0000675  
 Bank Name: Indian Overseas Bank  
 Branch Name: STRAND ROAD Branch

(2) The Ministry of Finance Guide lines issue vide OM no. F.9/4/2020-PPD, dt.12.11.2020 regarding Bid Security/Earnest Money Deposit/Performance Guarantee/Security Deposit instructions will be applicable for all the tenders till 31.12.2021.

(3) The bidders those who are claiming EMD Exemption as per Ministry of Finance Guidelines No.F.9/4/2020-PPD dt 12-11-2020, are advised to submit "Bid Security Declaration" towards EMD and same should be submitted along with technical bid failing which the bid shall be summarily rejected.

(4) The bidders shall upload the copy of the online transaction details with UTR No. along with the Technical bid documents failing which the bid shall be summarily rejected. SMPK shall not be liable/responsible for any connectivity/internet problem either with user side /NIC/Bank. It is in the own interest of the bidders, bidders may get it verified from Bank that there requisite money has been received by SMPK for the said NIT.

(5) In case of the NSIC/MSME certificate submitted bidders, the eligibility for exemption of Transaction fee and EMD amount subject to fulfilling of tender conditions.

d. The SMPK will not hold any risk and responsibility non-visibility of the scanned and uploaded documents.

e. The Documents that are uploaded online on the Enivida Portal <https://kopt.enivida.in/> will only be considered for Bid Evaluation.

### 3. General Terms and Conditions

**Tender fee:** All the participating bidders shall pay a tender document fee (non-refundable) in on-Line transaction for Rs.10,000/-+Rs. 1,800/-(GST@18%) = Rs.11,800/- (Eleven Thousand Eight Hundred only) (accepted only online payable through DD / RTGS/NEFT/Electronic Bank Transfer ) to be transferred on:

A/C: Syama Prasad Mookerjee Port, Kolkata  
 A/c No: 067502000000491  
 IFSC: IOBA0000675  
 Bank Name Indian Overseas Bank  
 Branch Name: STRAND ROAD Branch

- a. E.M.D. is exempted now as per Ministry of Finance **Circular No.F.9/4/2020-PPD, dt.12.11.2020, which is valid upto 31.12.2021.**
- b. Only e-tender will be accepted & any other method for accepting the tender will not be entertained.
- c. "The bidder shall authenticate the bid with his digital signature certificate for submitting the bid electronically the Enivida Portal <https://kopt.enivida.in/> platform and the bids not authenticated by digital signature certificate of the bidder will not be accepted on the e-procurement platform."
- d. The successful bidder found defaulting in submission of hard copies of uploaded certificates /documents, within the stipulated time i.e. before concluding the agreement or if any variation is noticed between the uploaded documents and the hard copies submitted by the successful bidder, the successful bidder will be suspended from participating in tenders on the Enivida Portal platform for a period of three years.

4. Even though the Tenderers meet the qualifying criteria, they are liable to be disqualified /debarred / suspended/blacklisted if they have
  - furnished false / fabricated particulars forms, statements and annexure, submitted in proof of the qualification in the requirements and/or
  - Not turned up for entering into agreement, when called upon.
  - Record of poor progress such as abandoning the work, not properly completing the contract, inordinate delays in completion, litigation history or financial failures etc. and/or
  - Participated in the previous bidding for the same work and had quoted unreasonably high lump-sum price and
5. Even while execution of the work, if found that the work was awarded to the Contractor based on false / fake certificates of experience, litigation, action pending or any other reason whatsoever attracts disqualification at the discretion of the competent authority and work will be terminated immediately. If the offered price quoted by a tenderer is found to be either abnormally high or with in the permissible ceiling limits prescribed but under collusion or due to unethical practices adopted at the time of bidding process, such bids shall be rejected.
6. A tenderer / Bidder submitting a Tender or Bid which the tender accepting authority consider successive and or indicative of insufficient knowledge of current prices or definite attempt of profiteering will render himself liable to be debarred permanently from tendering or for such period as the tender accepting authority may decide. The tenderer overall price should be based on the controlled prices for the materials, if any, fixed by the SMPK or the reasonable prices permissible for the tenderer to charge a private purchaser under the provisions of clause-6 of the hoarding and profiteering prevention ordinance of 1943 as amended from time to time and on similar principle in regard to labour supervision on the construction.
- 7. One Tender per Tenderer:**  
Each Tenderer shall submit only one Tender for the work. A Tenderer who submits more than one Tender will cause dis-qualification for all the tenders submitted by them.
- 8. Last date/time for Submission of the Tenders.**
  - a. Tenders must be submitted not later than the date and time specified in NIT. In the event of the specified date / time for the submission of bids declared as holiday, the bids will be received on the next working day.
  - b. The Chief Engineer,KDS, SMPK, may extend the dates for issue and receipt of Tenders by issuing an amendment at the sole discretion of SMPK.

**9. Modification to the Tender.**

No Tender can be modified after the last date/time of submission of Tenders.

**TENDER OPENING AND EVALUATION:**

**10. Tender opening:**

- a) The tenderers or their authorised representatives can be present at the time of opening of the tenders. Either the tenderer himself or one of his representatives with proper authorization only will be allowed at the time of tender opening. If any of the tenderer is not present at the time of opening of tenders, the tender opening authority will, on opening the tender of the absentee tenderer, reads out and record the deficiencies if any, which shall be binding on the tenderer.
- b) The technical bid containing qualification requirements will be evaluated by the tender opening authority and the minutes are recorded which will be signed by the tender opening authority .

**11. Clarification on the Technical Bid:**

- a) The tender opening authority may call upon any Tenderer/Bidder for clarification on the statements, documentary proof relating to the technical bid. The request for clarification and response there to shall be in writing and it shall be only on the qualification information furnished by the Tenderer. The clarification called for from the tenderers / Bidders shall be furnished within the stipulated time, which shall not be more than a week.

- b) The Tenderer/Bidder are bound to furnish clarifications called for by SMPK Authority within the stipulated time otherwise disqualification and rejection of his tender in the event of failure to do so.

## **12. Price Bid Opening:**

- a) Only the Price Bids of qualified Tenderers whose technical Bids are found satisfying the eligibility criteria shall be opened in the presence of the qualified Tenderers / Bidders who ever is interested or their authorized representatives present on the date and time fixed for opening of Price bid.
- b) The Price Bid of the Unqualified Tenderers will not be opened.
- c) Tenders shall be scrutinized in accordance with the conditions stipulated in the Tender document. In case of any discrepancy of non-adherence to the Conditions, the decision taken by the Tender Accepting Authority on tenders shall be final and the same shall be binding on Tenderer/ Bidder.

## **13. Evaluation and Comparison of Price Bids**

The tender committee will evaluate and compare the price-bids of all the qualified Tenderers.

## **14. Process to be Confidential.**

- a) Information relating to the examination, clarification, evaluation and comparison of Tenders and recommendations for the award of a contract shall not be disclosed to Tenderers or any-other persons not officially concerned with such process until the award to the successful Tenderer has been announced by the tender accepting authority. Any effort by a Tenderer to influence the processing of Tenders or award decisions may result in the rejection of his Tender.
- b) No Tenderer/Bidder shall contact the Superintending Engineer/Executive Engineer or any individual or authority concerned with finalization of tenders on any matter relating to tender from the time of the Tender opening upto the time the Contract is awarded.
- c) Before recommending/accepting the tender, the tender recommending/accepting authority shall verify the correctness of certificates submitted to meet the eligibility criteria both commercial & technical. The authenticated agreements of previous works executed by the lowest tenderer may be called for.
- d) Tenders will be finalized by the tender committee of SMP, Kolkata according to the powers vested with them.

**SYAMA PRASAD MOOKERJEE PORT, KOLKATA**  
**Civil Engineering Department**  
**NOTICE INVITING TENDERS**

The Chief Engineer, **SYAMA PRASAD MOOKERJEE PORT, KOLKATA, Civil Engineering Department** invites tender for “**DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK, KDS, SMP, KOLKATA**” [EPC] (two bid system) based on tenderer’s own survey, detailed sub soil investigations, detailed design, as per scheme indicated and the minimum requirements conforming to those indicated in bid documents; having sound experience of similar kind of construction work given below from the eligible firms

Name of work	Works to be Carried out	EMD	Time Allowed For Completion
<b>DESIGN, ENGINEERING &amp; CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK; KDS; SMP, KOLKATA</b>	<b>ENGINEERING, PROCUREMENT &amp; CONSTRUCTION of OLD BERTH NO.7,NSD ON TURN-KEY BASIS.</b>  (as per Scope of Work)	Exempted as per Ministry of Finance Circular No. F9/4/2020-PPD, dt.: 12-11-2020 which is upto 31.12.2021.  (Bid security Declaration Should be Submitted in Form D-2)	<b>18 Months</b>

- Lump-sum price tenders are invited for the work “**DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK; KDS; SMP, KOLKATA**”.
- Tender fee:** All the participating bidders shall pay a tender fee (non-refundable) in on-Line transaction for **Rs.10,000/-+Rs. 1,800/-(GST@18%) =Rs.11,800/- (Eleven Thousand Eight Hundred only)** (accepted only online payable through DD / RTGS / NEFT / Bank Transfer etc.,) to be transferred on  
A/C: Syama Prasad Mookerjee Port, Kolkata  
A/c No: 067502000000491  
IFSC: IOBA0000675  
Bank Name Indian Overseas Bank  
Branch Name: STRAND ROAD Branch
- The time allowed for completion of the work will be 18 MONTHS.
- Earnest money is presently exempted as per Ministry of Finance Circular No. F9/4/2020-PPD, Dt.: 12-11-2020 upto 31.12.2021.
- The contractor whose tender is accepted will be required to furnish Security Deposit for due fulfillment of this contract consisting of a percentage deduction from the R/A bills to be made on account to the contractor. The Earnest Money will be treated as part of the security deposit of work.
- The acceptance of tender will rest with the BoT, **SYAMA PRASAD MOOKERJEE PORT, KOLKATA**, which does not bind itself to accept lowest tender and reserves the authority to reject any or all the tenders received without assigning any reason. All tenders in which any of the prescribed condition is not fulfilled will be rejected.
- Tenders which do not fulfill all or any of the above conditions and or incomplete in any respect are liable to be summarily rejected and tenders containing uncalled for remarks or any additional conditions are also liable to be summarily rejected.
- Canvassing in connection with tenders is strictly prohibited and the tenders submitted by the contractors, who resort to canvassing will be liable to rejection.
  - The amount shall be quoted in figures and words and shall be accurately filled in.
  - In case of any discrepancy between words and figures, price in words shall be reckoned.
- GST will be paid by SMP,Kolkata as per actual.

10. The tenderer will have to give a certificate that he is not related to any officer of Syama Prasad Mookerjee Port, Kolkata or any Officer in the rank of under Secretary or above in the Ministry of Ports, Shipping and Waterways (MoPSW), Government of India. The tenderer should give a declaration in this regard
11. No Engineer of Gazetted Rank or other Gazetted Officer employed in Engineering or administrative duties in an Engineering Department of Government of India is allowed to work as a Contractor for a period of 2 years of his retirement from Government of India. This contract is liable to be cancelled if either the Contractor or any of his employee is found at any time to be such a person who had not obtained the permission of the Government of India as aforesaid before submission of the tender or engagement in the Contractor's service as the case maybe.
12. Site for the execution of the work will be made available as soon as the work is awarded. In case it is not possible for the department to make available the entire site at a time on the award of the work, the Contractor will have to arrange their working programme suitably. No claim what so ever for handing over the site in stages will be entertained, and the decision of the Chief Engineer is final and cannot be questioned.
13. The Contractor shall produce a license in the prescribed form from Asst. Labour Commissioner (Central), within 15 days from the date of work order and on his failure to do so the contract is liable to be terminated and the Earnest Money Deposit or Security Deposit whichever is to his credit shall be forfeited and the Contract shall have no claim what so ever on this account.
14. The Tender submitted by the tenderer should be valid for a minimum period of 180 days from the date of opening of tender and the tenderer cannot amend, alter or revoke his tender in any way during this period.
15. The successful tenderer shall execute an agreement with Board of Trustees of **SYAMA PRASAD MOOKERJEE PORT, KOLKATA** on a Non-judicial stamp paper worth of Rs.100/- in the prescribed form.
16. The tenderers should acquaint themselves with the work and working conditions of the site and locality and no claim will be entertained on this issue and the decision of Chief Engineer is final and cannot be questioned.
17. a) According to GST Act every dealer is liable to be registered whose aggregate turn over exceeds Rs.20.00 lakhs for supply of Goods/ service/ executing any works contractor. Accordingly, GSTIN is to be provided for participation to tender and to award the contract.  
  
(b) The applicable ATDS as per the contract GST/CGST Act, will be deducted as and when notified by the Government.
18. The tenderer should visit the site/ read the specifications and study the working drawing and special conditions etc., carefully before submitting the tender.
19. P.F. contribution to the contract labour, in case the Contractor engages more than 20 workers, shall be payable by the Contractor. He shall produce documentary proof of registration with P.F. Authorities along with P.F. Code number. Also documentary proof of payment of P.F. contribution to the Contract Labour Regularly shall be produced with every interim certificate failing which no payment will be released to the Contractor. The Port Trust will not entertain any claim whatsoever in this respect.
20. Payment to the contract labour if any involved in the works entrusted are to be paid by the Contractor in the presence of the site officer of SMP, Kolkata as per prevailing M.W.Act. Further, the Contractor has to submit documentary evidence in support of the payments made to the labour engaged in the work along with subsequent running account bill, failing which the bill will not be passed.
21. In respect of P.F. Contribution recovered from the labour and remitted to the P.F. Commissioner, documentary evidence in support of the same is to be submitted by the Contractor along with subsequent running account bill, failing which the bill will not be passed.
22. The Contractor to whom the work is awarded shall invariably produce the PAN Number obtained from the Income Tax Authorities, along with proof.
23. The contractor shall submit required document as per the Check list enclosed along with tenders. The tenders received without enclosing required documents as per the checklist duly signed will be liable for rejection.
24. The contractors / Firms while quoting tender shall note that, post tender negotiations may be held with the L-1 bidder, if necessary.



25. In the event that two or more Bidders quote the same amount (The "Tie Bids"), the authority shall identify the selected Bidder by further dropping in close sealed cover, which shall be conducted, with prior notice, and opened in presence of the Tie Bidders who choose to attend.
26. Tenderer shall submit the experience/completion certificates of works along with their tender.
27. In case the documents submitted by the bidder found to be not genuine, the management reserves the right to not to allow to participate in future tenders of SMPK.
28. The rate to be quoted should be exclusive of GST component and payment will be made against "Tax Invoice" as prescribed under the GST Act/Rules.
29. Income Tax as applicable will be deducted from all running bills..
30. The successful bidder is required to remit GST as per the "Tax Invoice" and file the details in GSTRI on or before 10<sup>th</sup> of the subsequent month to enable SMPK to claim in put tax credit otherwise the said tax invoice will be kept pending for payment.

INSTRUCTIONS TO BIDDERS FOR ONLINE e-BID SUBMISSION THROUGH

e-TENDERING and e-PROCUREMENT:

The SYAMA PRASAD MOOKERJEE PORT, KOLKATA(SMPK) has migrated from manual tendering toe-procurement and e-tendering system using the software of NIC for this purpose.

PROCEDURE FOR SUBMISSION OF TENDER

The bidders are required to submit soft copies of their bid electronically on the Railtel Portal using valid Digital Signature Certificates. Below mentioned instructions are meant to guide the bidders for registration on the Railtel enivida Portal, prepare their bids in accordance with the requirements and submit their bids online on the Railtel Portal. For more information, bidders may visit the Railtel Portal <https://kopt.enivida.in>

1. REGISTRATION PROCESS ON ONLINE PORTAL

- a. Bidders to enroll on the e-Procurement module of the portal <https://kopt.enivida.in> by clicking on the link “Bidder Enrolment” as per portal norms.
- b. The bidders to choose a unique username and assign a password for their accounts. Bidders are advised to register their valid email address and mobile numbers as part of the registration process. These would be used for any communication from the Railtel enivida Portal.
- c. Bidders must provide the details of PAN number, registration details etc. as applicable and submit the related documents. The user id will be activated only after submission of complete details. The activation process will take minimum 24 working hours. After completion of registration payment, you can also send your acknowledgement copy on our help desk mail id [enividahelpdesk@gmail.com](mailto:enividahelpdesk@gmail.com) for activation of your account.

d.	<table><tr><td>Railtel Registration Charges: <b>Mode of Payment:</b> E-payment Only through Debit/ Credit Card or Net Banking.</td><td>Registration Charges: Rs.2000/- + applicable GST</td></tr></table>	Railtel Registration Charges: <b>Mode of Payment:</b> E-payment Only through Debit/ Credit Card or Net Banking.	Registration Charges: Rs.2000/- + applicable GST
Railtel Registration Charges: <b>Mode of Payment:</b> E-payment Only through Debit/ Credit Card or Net Banking.	Registration Charges: Rs.2000/- + applicable GST		

- e. Bidders to register upon enrolment their valid Digital Signature Certificate (DSC: Class III Certificates with signing key and encryption usage) issued by any Certifying Authority recognized by CCA India with their profile.
- f. A bidder should register only one valid DSC. Please note that the bidders are responsible to ensure that they do not lend their DSCs to others, which may lead to misuse. Foreign bidders are advised to refer “DSC details for Foreign Bidders” for Digital Signature requirements on the portal.
- g. Bidder then logs in to the site through the secured login by entering their user ID/password and the password of the DSC / e-Token.

2. Tender Document Search

- a. Various built-in options are available in the Railtel enivida Portal to facilitate bidders to search active tenders by several parameters. These parameters include Tender ID, organization, location, date, value, etc.
- b. There is also an option of advanced search for tenders, wherein the bidders may combine a number of search parameters such as organization name, a form of contract, location, date, other keywords, etc. to search for a tender published on the Online Portal.
- c. Once the bidders have selected the tenders they are interested in, they may download the required documents/tender schedules. These tenders can be moved to the respective ‘Interested Tenders’ folder. This would enable the Online Portal to intimate the bidders through SMS / e-mail in case there is any corrigendum issued to the tender document.
- d. The bidder should make a note of the unique Tender ID assigned to each tender, in case they want to obtain any clarification/help from the Helpdesk.

3. Bid Preparation

- a. Bidder should also take into account of corrigendum published on the tender document and attach them with original tender document during submitting their bids.
- b. Please go through the tender advertisement and the tender document carefully to understand the documents required to be submitted as part of the bid.

- c. Please note the number of covers in which the bid documents have to be submitted, the number of documents - including the names and content of each of the document that needs to be submitted. Any deviations from these may lead to rejection of the bid.
- d. Bidder, in advance, should get ready the bid documents to be submitted as indicated in the tender document/schedule and generally, they can be in PDF/XLS/PNG, etc. formats. Documents in PDF format with maximum Five (5) Mb file can be uploaded.

4. Bid Submission

- a. Bidder to log into the site well in advance for bid submission so that he/she uploads the bid in time i.e., on or before the bid submission time. Bidder will be responsible for any delay due to other issues.
- b. The bidder to digitally sign and upload the required bid documents one by one as indicated in the tender document.
- c. Bidders must pay required payments (Form fee, EMD, Tender Processing Fee etc.) as mentioned before submitting the bid.
- d. Bidder to select the payment option mode as specified in the Schedule (EMD/FORM FEE Section) to pay the form fee/ EMD wherever applicable and enter details of the instrument.
- e.

Railtel Tender Processing Fee: (Non-refundable) <b>Mode of Payment:</b> E-payment Only through Debit/ Credit Card or Net Banking.	TPF- 0.1% of estimate cost (Rs7500/-) + GST Registration Charges ₹2000/- +applicable GST.
---	--

- f. A standard BOQ format has been provided with the tender document to be filled by all the bidders. Bidders to note that they should necessarily submit their financial bids in the prescribed format and no other format is acceptable.
- g. The server time (which is displayed on the bidders’ dashboard) will be considered as the standard time for referencing the deadlines for submission of the bids by the bidders, the opening of bids, etc. The bidders should follow this time during bid submission.
- h. All the documents being submitted by the bidders would be encrypted using PKI encryption techniques to ensure the secrecy of the data, which cannot be viewed by unauthorized persons until the time of bid opening.
- i. The uploaded tender documents become readable only after the tender opening by the authorized bid openers.
- j. Upon the successful and timely submission of bids, the portal will give a successful bid submission message & a bid summary will be displayed with the bid no. and the date & time of submission of the bid with all other relevant details.
- k. Kindly have all relevant documents in a single PDF file.
- l. The off-line tender shall not be accepted and no request in this regard will be entertained whatsoever.

5. Amendment of bid document

At any time prior to the deadline for submission of proposals, SMPK reserve the right to add/ modify/ delete any portion of this document by the issuance of a Corrigendum, which would be published on the website and will also be made available to the all the Bidder who have been downloaded the tender document. The Corrigendum shall be binding on all bidders and will form part of the bid documents.

6. Instruction to Bidders

- a. Process for Bid submission through Railtel enivida portal is explained in Bidder Manual. Bidders are requested to download Bidder Manual from the home page of website (<https://kopt.enivida.in>). Steps are as follows:

(Home page           ⇒ Downloads           ⇒ Bidder Manuals).

- b. The tenders will be received online through portal <https://kopt.enivida.in>. In the Technical Bids, the bidders are required to upload all the documents in .pdf format.
- c. Possession of Valid Class III **Digital Signature Certificate (DSC)** in the form of smart card/ e-Token in the company’s name is a prerequisite for registration and participating in the bid submission activities through

<https://kopt.enivida.in>. Digital Signature Certificates can be obtained from the authorized certifying agencies, details of which are available on the web site <https://kopt.enivida.in> under the link 'DSC help'.

Tenderers are advised to follow the instructions provided in the 'User Guide and FAQ' for the e-Submission of the bids online through the Railtel Portal for e-Procurement at <https://kopt.enivida.in>

- d. The bidder has to **"Request the tender"** to portal before the **"Date for Request tender document"**, to participate in bid submission.
7. All entries in the tender should be entered in online Technical & Commercial Formats without any ambiguity.
8. Any order resulting from this e-tender shall be governed by the terms and conditions mentioned therein.
9. No deviation to the technical and commercial terms & conditions will be allowed.
10. The tender inviting authority has the right to cancel this e-tender or extend the due date of submission of the bids.
11. The confidentiality of the bids is maintained since these used Socket Layer **128 bit** encryption technology is used. Data storage encryption of sensitive fields is done.
12. The bidder should logout of the tendering system using the normal log out option available at the top right-hand corner and not by selecting the (X) option in the browser.
13. Bidder can re-submit the bid as many times as possible within the Bid-Submission end date and time.
14. Bidder can withdraw the bid submitted online within the bid submission end date and time, and the withdrawn bid can't be resubmitted.
15. For any clarifications on in the <https://kopt.enivida.in>, please contact **SYAMA PRASAD MOOKERJEE PORT, KOLKATA**.

#### CONTACT DETAILS

**Land Line Number: +91-033-2230-0413**

#### **Mobile Number**

1. Chief Engineer : +91 98362 98695
2. Dy. Chief Engineer – I: +91 98362 98651
3. Dy. Chief Engineer –II: +91 98362 98680
4. SE (Contract): +91 96747 20075

4. MEMORANDUM (GENERAL DESCRIPTION)

...

**LUMP-SUM PRICE -TENDER FOR WORKS**

I/ We hereby tender for execution for Board of Trustees of the **SYAMA PRASAD MOOKERJEE PORT** of the works specified in the tender memorandum within the time specified in such memorandum at the rates specified there in and in accordance in all respects with the specifications design and instructions in writing referred to the conditions of contract and with such materials as are provided in all other respects in accordance with such conditions so far as applicable.

MEMORANDUM (GENERAL DESCRIPTION)

a)	Name of work	:	“DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK, KDS, SMP, KOLKATA”
b)	Earnest Money	:	EXEMPTED now upto 31.12.2021 as per Ministry of Finance Circular No. F9/4/2020-PPD, Dt.: 12-11-2020.
c)	Security Deposit	:	
	i) Retention Money(S.D)	:	As per provision in GCC as per GCC Clause 3.4 (f), (g), (h) & (i).
	ii) Performance Guarantee	:	3 % of the Contract amount to be paid within 21 days of issuance of work order as per Ministry of Finance Circular No. F9/4/2020-PPD, Dt.: 12-11-2020. VALID UPTO 31.12.2021
e)	Percentage to be deducted from bills towards Retention Money	:	As per provision in GCC
f)	Time allowed for the work from date of written order to commence.	:	18 (Eighteen) Months
g)	Period of commencement	:	15 (Fifteen) days from the date of issue of Work Order/LOI.
h)	Defect Liability Period: /Period of maintenance	:	10 (Ten) years from the date of completion.

Should this tender be accepted, I/We here by agree to abide by and fulfill all the terms and provisions of the conditions contained in the pamphlet named "GENERAL AND SPECIAL CONDITIONS OF CONTRACT" which have been read by me, read and explained to me so far as applicable, or in default thereof to forfeit and pay to the Board of Trustees or its successors in office the sums of money mentioned in the said conditions:

Give particulars and Nos. strike out  
(a) If no cash security deposit is to be taken

EMD/BID SECURITY amount Exempted, as  
per Ministry of Finance circular no.  
F.9/4/2020-PPD, dt.12.11.2020

Strike out(b) if any Cash Security Deposit  
is taken

Receipt attached as Earnest Money  
(A) the

Signature of bidder before submission Dated the

day of

2021

of tender.

Signature of witness

Witness:

Address:

Occupation:

.

**PART B- COMMERCIAL BID**

## **SECTION -1**

### **INSTRUCTIONS TO BIDDERS**



**GENERAL:****1 Scope of Bid**

The Chief Engineer SMPK invites bids on EPC mode for the construction of “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S.DOCK, KDS, SMP, KOLKATA” detailed in the table given in NIT. The bidders may submit bids for the works detailed in the table given in NIT.

The successful bidder will be expected to complete the works by the intended completion date specified in the Contract data.

**2 Eligible Bidders**

- 2.1 The Invitation for Bid is open to all eligible bidders meeting the eligibility criteria as defined in clause no.3.
- 2.2 All bidders shall provide in Section 2, Forms of Bid and Qualification Information, a statement that the Bidder is not associated, nor has been associated in the past, directly or indirectly, with the Consultant or any other entity that has prepared the design report, specifications, and other documents for the SMPK for this tender. A firm that has been engaged by the Employer to provide consulting services for the preparation of tender / supervision of the works/PMC and any of its affiliates shall not be eligible to bid.
- 2.3 Government-owned enterprises may only participate if they are legally and financially autonomous, operate under commercial law and are not a dependent agency of the Employer subject to fulfilment of Minimum Qualifying Criteria.
- 2.4 Bidders shall not be under a declaration of ineligibility for corrupt and fraudulent practices issued by the employer in accordance with clause 34.

**3. Eligibility Criteria**

- 3.1
  - 3.1.1 Experience on similar works executed successfully during the last seven years and details like monetary value, client’s satisfaction & proof of satisfactory completion certificate from client.
  - 3.1.2 Documentary evidence of adequate financial standing and proof from client for satisfactory completion of works.
  - 3.1.3 Solvency certificate from Bankers for Rs.30.60 Cr.
  - 3.1.4 Equipment requirement/schedule.
  - 3.1.5 Managerial/Manpower requirement.
  - 3.1.6 Project Planning and Quality Control procedure to be adopted. Information regarding projects in hand, current litigation, orders regarding exclusion, expulsion or black listing, if any.
  - 3.1.7 Trained Technical & Certified workmen proposed to be employed at the work site of the project. The Contractor must undertake to employ of certified technical worker to the extent of 20% of total strength. Valid certificates by a recognized University, technical Board or Ministry, Government of India would only be taken cognizance of.
- 3.2 Design satisfying the project requirement as certified by PMC, all bidders shall include the following information and documents with their bids in Section 2.
  - 3.2.1 Copies of original documents defining the constitution or legal status, place of registration, and principal place of business;
  - 3.2.2 written power of attorney of the signatory of the Bid to commit the Bidder;
  - 3.2.3 Total monetary value of each construction work performed during last seven years;
  - 3.2.4 Experience in works of a similar nature and size for each of the last seven years and details of works underway or contractually committed; and
  - 3.2.5 Employers who may be contacted for further information on those contracts;
  - 3.2.6 Major items of construction equipment proposed to carry out the Contract;
  - 3.2.7 Qualifications and experience of key site management and technical personnel proposed for the Contract;

- 3.2.8 Reports on the financial standing of the Bidder, such as profit and loss statements and auditor's reports for the past seven years;
- 3.2.9 Evidence of adequacy of working capital for this contract (access to line(s) of credit and availability of other financial resources)  
Authority to seek references from the Bidder's bankers;
- 3.2.10 Information regarding any litigation, current or during the last seven years, in which the Bidder is involved, the parties concerned, and disputed amount;
- 3.2.11 Proposals for subcontracting components of the Works amounting to more than 10 percent of the Bid Price (for each, the qualifications and experience of the identified sub-contractor in the relevant field should be annexed); and
- 3.2.12 The proposed methodology and program of construction, backed with equipment planning and deployment, duly supported with broad calculations and quality control procedures proposed to be adopted, justifying their capability of execution and completion of the work as per technical specifications within the stipulated period of completion as per milestones.  
Designs to be submitted for approval of PMC/Client.
- 3.3 To qualify for the contract, bidders are advised to note the minimum qualification criteria specified below.

**(i) Details of average annual turnover shall not be less than Rs.22.94 Crores during the last 3(three) years ending 31st March of the previous financial year duly certified by the Chartered Accountant verified with UDIN.**

**(ii) Proof of experience in similar nature of works i.e., experience of having successfully completed works as defined in the Tender Document during last 7 years ending last day of month previous to the one in which applications are invited should be**

**a. 3 (three) completed works of each costing not less than the amount equal to Rs. 30.59 Crores.**

**(or)**

**b. 2(two) completed works of each costing not less than Rs. 38.24 Crores.**

**(or)**

**c. 1(one) completed work of each costing not less than Rs.61.18 Crores.**

**Similar Works: Infrastructure works related to Construction of Jetty / berth / wharves or Construction of heavy industrial building or Construction of water retaining structure like dam, anicut structure or Construction of RCC bridges. All these works must be carried out involving RCC & pile/sheet pile works.**

- 3.4 Sub-contractors' experience and resources shall not be taken into account in determining the bidder's compliance with the qualifying criteria.
- 3.5 Even though the bidders meet the above qualifying criteria, they are subject to be disqualified if they have:
  - Made misleading or false representations in the forms, statements and attachments submitted in proof of the qualification requirements; and/or
  - Record of poor performance such as abandoning the works, not properly completing the contract, inordinate delays in completion, litigation history, or financial failures etc.
  -

#### **4. One Bid Per Bidder**

Each bidder shall submit only one bid . A bidder who submits more than one Bid to be disqualified.

#### **Joint Venture:**

Joint venture partners would be limited to three (including the lead partner) with at least 26% equity holding for each member. One of the partners, who is responsible for performing key function in the contract management or is executing major component of the proposed contract, shall be nominated as being in charge during the bidding period and in the event of a successful bid, during contract execution. The partner in charge shall be authorised to incur liabilities and receive instructions for and on behalf of any and all partners of the joint venture, this authorization shall be evidenced by submitting registered power of attorney signed by legally authorized signatories of all the partners.

All partners of the joint venture shall be liable, jointly and severally during the bidding process and

for the execution of the contract in accordance with contract terms and a statement to this effect shall be included in the authorization as above. The bid shall be signed so as to legally bind all partners, jointly and severally.

The joint venture must satisfy collectively the eligibility criteria as described in this section. For this purpose, the following information of each member of the joint venture may be added together to meet the collective eligibility criteria:

Joint ventures must comply with the following requirements:

- a. Average Annual Turnover
- b. Particular Construction Experience
- c. Capacity of key Personnel
- d. Ability to own/lease relevant equipment
- e. Financial capacity

Each JV partner including the lead partner shall meet not less than 26% of the following criteria:

- i) Average Annual Turnover
- ii) Particular Construction Experience
- iii) Financial capacity

All the partners together shall satisfy 100% of the criteria.

A copy of the joint venture agreement (JVA) specific to this project, if entered into by the partners shall be submitted with the Bid. Alternatively, a letter of intent to execute a JVA in the event of successful bid shall be signed by all partners and submitted with the bid. In any case, it is mandatory that a JV agreement is entered into before award of the work.

Pursuant to the foregoing, the JVA shall include among other things, the joint-venture's objectives, the proposed management structure, the contribution of each partner to joint-venture operation, the commitment of the partners to joint and several liability for due performance, recourse / sanctions with in the joint venture in the event of default or withdrawal of any partner and arrangements for providing the required indemnities.

#### **4.1 JOINT VENTURES / CONSORTIUM AND OTHER FORMS OF ASSOCIATION**

In case the tender is submitted in joint venture/consortium, the Bidder shall submit the following confirmation along with their offer submitted with this tender.

- 4.1.1 All joint venture agreements / consortium agreements, technical collaboration agreement shall ensure that all parties of the joint venture/consortium are individually and jointly responsible for the tender conditions and such agreements are legally valid.
- 4.1.2 Joint venture/consortium should be in the nature of legally acceptable agreements and such agreements should be notarized.
- 4.1.3 Such joint venture/consortium agreement should contain explicitly the scope and responsibilities of all the partners in the joint venture/consortium in terms of financial and technical commitments/contribution. The JV/consortium should be equally, severally and jointly responsible.
- 4.1.4 One of the members of the consortium shall be authorized as being in-charge (lead member), and this authorization shall be evidenced by a power of attorney duly signed by the authorized signatories of the consortium Members as per the format enclosed in the tender document as per Format provided in Section -6 of this tender document.
- 4.1.5 The validity of the joint venture/consortium agreement entered upon on the award of Letter of Acceptance (LOA) by SYAMA PRASAD MOOKERJEE PORT, KOLKATA should continue for the entire period of contract as specified in the tender. All such agreements shall be irrevocable for the above periods.
- 4.1.6 Firms with at least 26% equity holding each shall be allowed to jointly meet the eligibility criteria.
- 4.1.7 Where the bidder is a consortium the average annual financial turnover of the individual members forming the consortium shall be submitted.
- 4.1.8 The entity processing the tender must be a member of the consortium submitting the tender.

- 4.1.9 It is clarified that an unsuccessful bidder or JV/Consortium shall not be permitted to join a successful JV/Consortium whose bid is accepted at a later date.
- 4.1.10 In case of a Consortium, the combined Technical and Financial Capability of those members who have and shall have share of at least 26% (twenty-six per cent) each, should satisfy the above conditions of eligibility, provided that each such member shall, for the entire period of the contract, hold share not less than 26%.
- 4.2 FURTHER CONDITIONS FOR JV/CONSORTIUM:**
- 4.2.1 Intending tenderer(s), as Consortium, is eligible to participate in the tender. The term “Tenderer” used in this document would apply to either a Single Entity or a group of entities, i.e. a Consortium. Further, the Tenderer may be a natural person, private entity, government owned entity or any combination of them with a formal intent to enter into an agreement or under an existing agreement to form a Consortium. A Consortium shall be eligible for consideration subject to the conditions set out in this tender document.
- 4.2.2 The Tenderer shall not have a conflict of interest that affects the Tendering Process. Any Tenderer found to have a Conflict of Interest shall be disqualified. A Tenderer shall be deemed to have a Conflict of Interest affecting the Tendering Process, if:
- 4.2.3 The Tenderer, its Member or Associate (or any constituent thereof) and any other Tenderer, its Member or any Associate thereof (or any constituent thereof) have common controlling shareholders or other ownership interest; provided that this disqualification shall not apply in cases where the direct or indirect shareholding of a Tenderer, its Member or an Associate thereof (or any shareholder thereof having a shareholding of more than 5 per cent of the paid up and subscribed share capital of such Tenderer, its Member or Associate, as the case may be) in the other Tenderer, its Member or Associate is less than 5 per cent of the subscribed and paid up equity share capital thereof; provided further that this disqualification shall not apply to any ownership by a bank, insurance company, pension fund or a public financial institution referred to in section 4A of the Companies Act 1956, or any of its subsequent amendment. For the purposes of this Clause, indirect shareholding held through one or more intermediate persons shall be computed as follows:
- 4.2.4 Where any intermediary is controlled by a person through management control or otherwise, the entire shareholding held by such controlled intermediary in any other person (the “Subject Person”) shall be taken into account for computing the shareholding of such controlling person in the Subject Person; and
- 4.2.5 Subject always to sub-clause iii(Financial Bid) above, where a person does not exercise control over an intermediary, which has shareholding in the Subject Person, the computation of indirect shareholding of such person in the Subject Person shall be undertaken on a proportionate basis ; provided, however, that no such shareholding shall be reckoned under this sub-clause.
- 4.2.6 If the shareholding of such person in the intermediary is less than 26% of the subscribed and paid up equity shareholding of such intermediary;
- OR
- 4.2.7 A constituent of such Tenderer is also a constituent of another Tenderer;
- OR
- 4.2.8 Such Tenderer, or any Associate thereof receives or has received any direct or indirect subsidy, grant, concessional loan or subordinated debt from any other Tenderer, or any Associate thereof or has provided any such subsidy, grant, concessional loan or subordinated debt to any other Tenderer, its Member or any Associate thereof;
- OR
- 4.2.9 Such Tenderer has the same legal representative for purposes of this Tender as any other Tenderer;
- OR
- 4.2.10 Such Tenderer, or any Associate thereof has a relationship with another Tenderer, or any Associate thereof, directly or through common third party/parties, that puts either or both of them in a position to have access to each others’ information about, or to influence the Tender of either or each other.
- 4.2.11 A Tenderer shall be liable for disqualification if any legal, financial or technical adviser of SYAMA PRASAD MOOKERJEE PORT, KOLKATA in relation to the Tender is engaged by the Tenderer, its Member or any Associate thereof, as the case may be, in any manner for matters related to or incidental to the Tender. For the avoidance of doubt, this disqualification shall not apply where such adviser was engaged by the Tenderer, its Member or Associate in the past but its assignment expired or was terminated 6 (six) months prior to the date of issue of this Tender. Nor will this disqualification apply where such adviser is engaged after a period of 3 (three) years from the date of commercial operation of the contract.

**Explanation:** In case a Tenderer is a Consortium, then the term Tenderer, as used above, shall include each Member of such Consortium.

Note: Notwithstanding anything to the contrary contained in this tender document, in the event of any member of any Consortium suffering from a Conflict of Interest, the offer of such consortium shall be treated as disqualified. However, in the event of similar situation arising / detected after placement of LOI, the same shall have to be addressed and resolved by the Consortium, failing which the contract, if entered into, shall be terminated.

In this regard, it must be borne in mind that suppression of such Conflict of Interest, if detected later, shall not absolve the Consortium of its responsibility and appropriate action shall be initiated in terms of the provision of the tender.

The Tenderer(s) shall have valid documents as listed in various clauses of this tender document and submit the same in the manner as stipulated.

**5. Cost of Bidding**

The bidder shall bear all costs associated with the preparation and submission of his Bid, and the Employer will in no case be responsible and liable for those costs.

**6. Site Visit**

The Bidder, at their own responsibility and risk is encouraged to visit and examine the Site of works and its surroundings and obtain all information that may be necessary for preparing the Bid and entering into a contract for execution of the Work. The costs of visiting the site shall be at the Bidders' own expense.

**BIDDING DOCUMENTS**

**7. Content of Bidding Documents**

As per Index of Tender Document.

The bidder is expected to examine carefully all instructions, conditions of contract, contract data, forms, terms, technical specifications, forms, drawings, annexures in the bid document. Failure to comply with the requirements of the bid document shall be at the bidder's own risk. Pursuant to clause 26 of Section-1 hereof, bids which are not substantially responsive to the requirements of the bid documents shall be rejected.

**8. Clarification of Bidding Documents**

A prospective bidder requiring any clarification of the bidding documents may notify the employer in writing or by electronic form at least one day advance before pre-bid meeting date.

**Pre-bid meeting**

The bidder or his official representative is invited to attend a pre-bid meeting in virtual mode (online), which will take place at The Chief Engineer's Office SMPK at 15.00 hours on 16.11.2021. The purpose of the meeting will be to clarify issues and to answer questions on any matter that may be raised at that stage. The bidder is requested to submit any queries in writing to reach the Employer at least one day before the pre-bid meeting.

All the participating bidders will be notified regarding the information of the minutes of the meeting, including the text of the questions raised (without identifying the source of enquiry) and the responses given will be uploaded in the e-procurement portal. Any modification of the bidding documents as listed above may become necessary as a result of the pre-bid meeting shall be made by the Employer exclusively through the issue of an Addendum pursuant to Clause- 9 of this section and not through the minutes of the pre-bid meeting.

Non-attendance at the pre-bid meeting will not be a cause for disqualification of a bidder.

- a. It is proposed to hold a Pre-bid meeting in order to clarify and discuss issues with respect to the Project, or any other related issues. The meeting shall be held on 16.11.2021 in the office of Chief Engineer, 2ND Floor, Head Office Building, Kolkata Port Trust, at Kolkata and would start at 15.00 hours on virtual mode through below mentioned link

Topic of Meeting- Pre Bid Meeting for EPC of 7 NSD Berth of KDS  
Link of Zoom Meeting  
<https://zoom.us/j/92454810250?pwd=UFERysvNFhEZmZCajVvRHZJTUxwdz09>

Meeting ID: 924 5481 0250  
Passcode: 741813

- b. Pre-bid meeting will be held in the presence of the tenderers/their representatives who may be present. Any claim or query on any issue, at a later date will not be entertained.

- c. Tenderers are advised to forward their queries for pre-bid to e-mail: [sk.halder@kolkataporttrust.gov.in](mailto:sk.halder@kolkataporttrust.gov.in) & [r.mondal@kolkataporttrust.gov.in](mailto:r.mondal@kolkataporttrust.gov.in) if any at least one day before 16.11.2021 and attend in virtual mode(online) the Pre-bid meeting.
- d. All the queries raised in the pre-bid meeting along with clarifications will be uploaded in the website.
- e. All enquires shall be addressed to the following address in writing by letter or facsimile transmission.
- f. No interpretation, revision, or other communication from the Port Trust regarding this solicitation is valid unless in writing and is signed by the Chief Engineer, SYAMA PRASAD MOOKERJEE PORT, KOLKATA 700 001, West Bengal (India) written copies of the Port Trust responses, including a description of the enquiry but without identifying its source will be sent to all the Tenderers.
- g. During the Pre-Bid meeting, the queries received in advance would be clarified first, followed by those raised during the meeting. The SYAMA PRASAD MOOKERJEE PORT, KOLKATA's response would be uploaded in the website.
- h. The Tenderer(s) has to make a complete & careful examination and independent evaluation of the tender notice, scope of work, technical specifications, site, local conditions, physical qualities of ground, sub-soil conditions and all information provided by the SYAMA PRASAD MOOKERJEE PORT, KOLKATA in the tender and has to determine to his satisfaction the accuracy, nature and extent of difficulties, risks that are likely to be faced by him during the course of execution/performance of its obligations as per contract. Any clarifications ambiguities and inconsistencies in the tender shall be raised by the tenderer along with other tenderers in the pre-bid meeting only but not after opening of the bids. No claim on this account will be entertained.

#### **9. Amendment of Bidding Documents**

Before the deadline for submission of bids, the Employer may modify the bidding documents by using addendum. Any addendum thus issued shall be part of the bidding documents and shall be communicated through SMPK website to all the purchasers of the bidding documents. Prospective bidders shall acknowledge receipt of each addendum.

To give prospective bidders reasonable time in which to take an addendum into account in preparing their bids, the Employer shall extend as necessary the deadline for submission of bids, in accordance with Clause-19 of this section.

#### **10. Language of The Bid**

All documents relating to the bid shall be in English language.

#### **11. Documents Comprising the Bid**

##### **Documents Comprising the Bid**

The bid submitted by the bidder shall comprise of necessary details as mentioned in:

##### **I. PART – A-General Information**

##### **II. PART B- Commercial Bid**

##### **III. PART C- Technical Bid**

##### **IV. PART D- Price Bid**

The tender should submit the tender documents in two parts:

1<sup>st</sup> part comprises of I, II & III.

2<sup>nd</sup> part is for “Price Bid” that is ‘IV’ above only.

**12. Bid Prices**

The contract shall be for the whole works, at the lump-sum price submitted by the Bidder. The bidder shall fill in lump-sum price for Works described in the Bidding Documents.

The Bidder shall fill in lump-sum price (both in figures and words) for whole work described in the Bidding Documents.

The bidder also filled the amount for individual items attached with bidding document and arrive at the total cost to justify the lump-sum amount they quoted for the work.

Except GST all duties, taxes, and other levies payable by the contractor under the contract, or for any other cost shall be included in the financial Bid Price submitted by the Bidder.

**13. Currencies of Bid and Payment**

The unit rates and the prices shall be quoted by the bidder entirely in Indian Rupees.

**14. Bid Validity**

Bids shall remain valid for a period not less than 180 days from the date of opening of the bid document, bid valid for a shorter period shall be rejected by the Employer as non-responsive. In exceptional circumstances, prior to expiry of the original time limit, the Employer may request the bidders to extend the period of validity for a specified additional period. The bidders' responses shall be made in writing or by e-mail. A bidder may refuse the request without forfeiting his bid security. A bidder agreeing to the request will not be permitted to modify his bid.

**15. Bid Security (Earnest Money Deposit: EMD)**

Earnest money Deposit (EMD): Exempted, as per Ministry of Finance Circular No.F.9/4/2020-PPD, Dt.12.11.2020 valid upto 31.12.2021. Bid Security declaration is to be submitted as per proforma.

**16. Alternative Proposals by Bidders**

Conditional offer or Alternative offers will not be considered in the process of tender evaluation.

**17. Format and Signing of Bids**

The Bid shall be submitted as per instructions to Bidders for online e-bid submission through e-tendering and e-procurement.

**SUBMISSION OF BIDS****18. Sealing and Marking of Bids**

The bidder shall also upload the scanned copies of the documents mentioned in Technical Bid & Financial bid as per clause-11 of this section.

The Tender complete in all respect should be uploaded upto 15.00 hours on 09.12.2021 and will be open after 15:00 hours on 10.12.2021. In case of opening date is a holiday, the tender will be opened on the next working date in presence of such of the tenderers who may wish to be present.

**19. Deadline for Submission of Bids**

Bids must be received by the Employer at the Envida Portal not later than at 15:00 hrs of 09.12.2021.

In the event of the specified date for the submission of bids being declared a holiday by the Employer, the Bids will be received upto the appointed time on the next working day.

The Employer may extend the deadline for submission of bids by issuing an amendment in accordance with Clause 9 of this section in which case all rights and obligations of the Employer and the bidders previously subject to the original deadline will then be subject to the new dead line.

**20. Late Bids**

Any Bid uploaded after the deadline will not be accepted.

**21. Modification and withdrawal of Bids**

Bidders may modify or withdraw their bids before the deadline prescribed in Clause-19 of this section. No bid may be modified after the deadline for submission of Bids.

Withdrawal or modification of a Bid between the deadline for submission of bids and the expiration of the original period of bid validity or as extended may result in suspension of business with SMPK for a period 3 (Three) years apart from blacklisting the firm.

**BID OPENING AND EVALUATION****22. Bid Opening**

On the due date and appointed time as specified in clause 19 of this section, the Employer will first open Technical bids of all bids received in presence of the Bidders or their representatives who choose to attend. In the event of the specified date for Bid opening being declared a holiday by the Employer, the bids will be opened at the appointed time and location on the next working day.

If all Bidders have submitted unconditional Bids together with requisite Bid security, then all Bidders will be accessed by the SMPK. If any Bid contains any deviation from the Bids documents and/or if the same does not contain Bid security in the manner prescribed in the Bid documents, then that Bid will be rejected and the Bidder informed accordingly. All valid Financial Bids whose technical bids have been determined to be substantially responsive in accordance with Clause 25 of this section, shall be opened on the specified date from declaring the results of the Technical Bid, in

presence of the bidders or their representatives who choose to attend. The Bidder's name, the Bid prices, the total amount of each bid, any discounts and such other details as the Employer may consider appropriate, will be announced by the Employer at the opening. Any bid price, discount, which is not read out and recorded at Bid opening, will not be taken into account for Bid evaluation.

**23. Process to be Confidential**

Information relating to the examination, clarification, evaluation and comparison of the bids and recommendations for the award of a contract shall not be disclosed to Bidders or any other persons not officially concerned with such process until the award to the successful bidder has been announced.

**24. Clarification of Bids**

To assist in the examination and comparison of Bids, the Employer may, at his discretion, ask any Bidder for clarification of his Bid. The request for clarification and the response shall be in writing, but no change in the price or substance of the Bid shall be sought, offered, or permitted except as required to conform the correction of arithmetic errors discovered by the Employer in the process of evaluation of the Bids in accordance with Clause 25 of this section. No Bidder shall contact the Employer on any matter relating to his bid from the time of the bid opening upto the time, the contract is awarded. If the Bidder wishes to bring additional information to the notice of the Employer, he should do so in writing, but that is not binding on SMPT to accept.

Any effort by the Bidder to influence the Employer's bid evaluation, bid comparison or contract award decisions may result in rejection of his bid.

**25. Examination of Bids and Determination of Responsiveness**

Prior to detailed evaluation of Bids, the Employer will determine whether (a) each Bid meets the eligibility criteria defined in Clause -3 of this section (b) bid document has been properly signed by an authorised signatory (accredited representative) holding Power of Attorney in his favour. The Power of Attorney shall inter alia include a provision to bind the Bidder to settlement of disputes clause; (c) is accompanied by the required Bid security and (d) is responsive to the requirements of the Bidding documents.

A substantially responsive Technical and Financial Bid is one, which conforms to all the terms, conditions and specification of the Bidding documents, without material deviation or reservation. A material deviation or reservation is one (a) which affects in any substantial way the scope, quality or performance of the Works; (b) which limits in any substantial way, the Employer's rights or the Bidder's obligations under the Contract; or (c) whose rectification would affect unfairly the competitive position of other bidders presenting responsive Bids.

If a Technical Bid is not substantially responsive, it will be rejected by the Employer, and may not subsequently be made responsive by correction or withdrawal of the non-conforming deviation or reservation.

The Financial bid of those bidders whose Technical bid has been determined to be non-responsive shall not be opened.

**26. Correction of Errors**

Bids determined to be responsive will be checked by the Employer for any arithmetic errors. Errors will be corrected by the Employer as follows:

Where there is a discrepancy between the lump-sum price in figures and in words, the lump-sum price in words will govern; and the amount stated in the Bid will be adjusted by the Employer in accordance with the above procedure for the correction of errors and shall be considered as binding upon the bidder. If the Bidder does not accept the corrected amount the Bid will be rejected, and the Bidder will be suspended from business with SMPK for a period 3 (Three) years apart from blacklisting of the firm.

**27. If the Bidder that submitted the lowest evaluated bid does not accept the correction of errors, its bid shall be rejected.**

**28. Evaluation and Comparison of Financial Bids**

The Employer will evaluate and compare only the Bids determined to be responsive in accordance with Clause-25 of this section for the responsive technically qualified bidders. In evaluating the Bids, the Employer will determine for each Bid, the evaluated Bid Price by adjusting the Bid Price by making any correction for errors pursuant to Clause-26 of this section.

If the Bid of the successful Bidder is seriously unbalanced in relation to the Engineer-in-charge (Nodal Officer) or his nominee's estimate of the cost of work to be performed under the contract, the Employer may require the Bidder to produce detailed price analyses for any or all items of the Bill of Quantities, to demonstrate the internal consistency of those prices with the implementation/construction methods and schedule proposed.

**AWARD OF CONTRACT**

**29. Award Criteria**

The Employer will award the Contract to the Bidder whose Bid has been determined to be responsive to the Bidding documents and who has offered the lowest Bid Price, provided that such Bidder has been determined to be (a) eligible in accordance with the provisions of Clause- 2 of this section, and (b) qualified in accordance with the provisions of Clause 3 of this section.



**30. Employer's Right to accept any Bid and to reject any or all.**

Not with standing to clause 29 of this section, the Employer reserve the right to accept or reject any bid and to cancel the bidding process and reject all bids, at any time prior to the award of contract, without assigning any reason and there by incurring any liability to the affected bidder or bidders of the grounds for Employer's action.

**31. Notification of Award and Signing of Agreement.**

The Bidder whose Bid has been accepted will be notified of the award by the Employer prior to expiration of the Bid-validity period by email/Fax and also confirmed by registered letter. This letter (here in after and in the Conditions of Contract called the "letter of Acceptance") will state the sum that the Employer will pay the Contractor in consideration of the execution, completion and maintenance of the Works by the Contractor as prescribed by the Contract (here in after and in the Contract called the "Contract Price"). The notification of award will constitute the formation of the Contract subject only to the furnishing of a performance security in accordance with the provisions of Bidding Documents. The Agreement will incorporate all correspondence between the Employer and the successful Bidder within 21 days of receipt of LOI/Work Order, the successful Bidder will furnish the performance security and sign the Agreement with the Employer.

It will be signed by the Employer and sent to the successful Bidder within 28 days following the notification of award along with the Letter of Acceptance. Upon furnishing of Performance Security by the successful Bidder , the Employer will promptly notify the other Bidders that their Bids are unsuccessful.

**32. Performance Security**

Security Deposit shall consist of two parts; i) Performance Guarantee to be submitted at award of work and ii) Security Deposit to be recovered from Running Bills.

Performance Guarantee:

- a. The Contractor should submit a Performance Guarantee in the form of B.G. for 3 % of contract value in SMPK's proforma from a Scheduled/ Nationalised Bank within 21 days from the date of receipt of LOI/Work Order, failing which the contract would be rescind without any further notice. The P.G. should be obtained for the full period covering defect liability period of 10 (Ten)years.

The P.G shall be accepted with effect from the date of W.O/LOI. The SMPK bank account details to which amount is to be transferred (accepted only online payable through DD / RTGS / NEFT / Bank Transfer etc) is mentioned below:

A/C: Syama Prasad Mookerjee Port, Kolkata A/c No: 067502000000491

IFSC: IOBA0000675

Bank Name: Indian Overseas Bank Branch Name: STRAND ROAD Branch, Kolkata

**NOTE:** The Ministry of Finance Guidelines regarding Bid Security / Earnest Money Deposit / Performance Guarantee / Security Deposit instructions issued vide no. F/9/4/2020-PPD, dt.12-11-2020 will be applicable for all the tenders till 31-12-2021.

The contractor shall be required to deposit an amount equal to 3% of the tendered value of the contract as Performance Guarantee. Performance Guarantee is to be furnished within 21 (twenty-one) days after notification of the award and it should remain valid for a period of 60 (sixty) days beyond the date of completion of all contractual obligations of the contractor, including Defect Liability Period (DLP). The performance security will be forfeited and credited to the procuring entity's account in the event of a breach of contract by the contractor.

**Refund of performance Guarantee:**

The performance guarantees to be refunded to the contractor without interest, after he duly performs and completes all obligations under the contract but not later than 365 days of completion of the Defect Liability Period (DLP).

**The Security deposit (SD):**

(i)The SD amount will be deducted from running on account bills as per clause no.3.4 & 3.5 of GCC and Earnest money if any will also converted into Security Deposit.

(ii)The Security Deposit shall be refunded to the Contractor in terms of Clause 28(iii) hereinafter and subject to deduction, if any, under the provision of Sub-clause 28 (iv) herein below. Id, however, the Contract provides for any maintenance period. 50% of the Security Deposit may be refunded against any of the treasury Receipt for that amount on expiry of half of the maintenance period and the balance deposit on the expiry of the said maintenance period and after the Engineer

has certified the final completion of work in Form G.C.2 and the Contractor has submitted his "No Claim" Certificate in Form G.C.3.

iii) The Security Deposit/Earnest Money may be liable to forfeiture at the option of the Trustees, if the Contractor fails to carry out the work or to perform/observe any of the conditions of the Contract. The Trustees shall also be at liberty to deduct any of their dues from the Security Deposit, fixed Security, Earnest Money or from any sum due or to become due to the Contractor under any other contract

(iv) The Contractor shall not be considered completed the work and the work shall not be treated as finally accepted by the Trustees, until a Final Completion Certificate in Form G.C.2 annexed hereto shall have been signed and issued by the Engineer of the contractor after all obligations under the Contract including that in the maintenance period, if any, have been fulfilled by the Contractor. Previous entry on the works or taking possession, working on using thereof by the Trustees shall not relieve the Contractor of his obligations under the contract for full and final completion of the work.

(v) On completion of the contract in the manner aforesaid, the Contractor may apply for the refund of his Security Deposit by submitting to the Engineer (i) The Treasury Receipts granted for the amount of Security held by the Trustees, and (ii) his "No further claim" Certificate in Form G.C.3 annexed hereto (in original), where upon the Engineer shall issue Certificate in Form G.C.2 and within two months of the Engineer's recommendation, the Trustees shall refund the balance due against the Security Deposit to the Contractor, after making deduction therefrom in respect of any sum due to the Trustees from the Contractor.

### **33. Advance Payments**

**No advance payment will be made for the subject work.**

### **34. Corrupt or Fraudulent Practices**

The Employer requires that Bidders/Suppliers/Contractors under this contract, observe the highest standard of ethics during the procurement and execution of this contract. In pursuance of this policy, the Employer:

It defines, for the purpose of these provisions, the terms set forth below as follows:

(i) **"corrupt practice"** means the offering, giving, receiving or soliciting of anything of value to influence the action of a public official in the procurement process or in contract execution;

and

(ii) **"fraudulent practice"** means a mis-representation off acts in order to influence a procurement process or the execution of a contract to the detriment of the Employer, and includes collusive practice among Bidders (prior to or after bid submission) designed to establish bid prices at artificial non-competitive levels and to deprive the Employer of the benefits of free and open competition.

**NOTES-** SMPK will reject a proposal for award of work if he determines that the Bidder recommended for award has engaged in corrupt or fraudulent practices in competing for the contract in question.

will declare a Bidder ineligible, either indefinitely or for a stated period of time, to be awarded a contract/contracts if found any time determines that the Bidder has engaged in corrupt or fraudulent practices in competing for, or in executing, the contract.

Furthermore, Bidders shall be aware of the provision stated in clause 50 of the Special Conditions of Contract.

## **SECTION-2**

**FORMS OF BID, QUALIFICATION INFORMATION**

**AND**

**LETTER OF ACCEPTANCE**

**TABLE OF FORMS**

- 1 FORM OF BID
- 2 PRE-QUALIFICATIONS OF BIDDERS
- 3 PRE-QUALIFICATION OF BIDDERS
- 4 LETTER OF ACCEPTANCE
- 5 NOTICE TO PROCEED WITH THE WORK
- 6 AGREEMENT FORM

**SPECIMEN FOR FORM OF BID**  
**(To be executed on bidder’s letter head)**

*[The Tenderer shall fill in this Form in accordance with the instructions indicated No alterations to its format shall be permitted and no substitutions shall be accepted The Form shall be submitted in both the Techno- Commercial and Price Covers separately.]*

Date  
Title Name  
Tender No

[The Tenderer shall fill in this Form in accordance with the instructions indicated No alterations to its format shall be permitted and no substitutions shall be accepted The Form shall be submitted in both the Techno- Commercial and Price Covers separately.]

To

SYAMA PRASAD MOOKERJEE PORT, KOLKATA

We, the undersigned, declare that:

- a. We have examined and have no reservations to the Tendering Documents, including Addendum and Clarifications issued after Pre-bid meeting along with Minutes;
- b. We offer to execute the work in conformity with the Tendering Documents and in accordance with the Delivery Schedules specified in then Schedule of Requirements;
- c. The total price of our Tender for the entire work is Rs. ----- (Rupees        )  
**{Not to be Quoted here}**
- d. Our tender shall be valid for the period of time specified in **[ITB]**, from the date fixed for the Tender submission deadline in accordance with **[ITB]**, and it shall remain binding upon us and may be accepted at any time before the expiration of that period or any extended period in accordance with **[ITB]**;
- e. If our tender is accepted, we commit to obtain a performance guarantee in accordance with **[ITB]** for the due performance of the Contract, as specified in specimen form for the purpose;
- f. We, including any subcontractors or Contractors for any part of the contract, [insert the nationality of the Tenderer, including that of all parties that comprise the Tenderer, if the Tenderer is a JV and the nationality each sub-contractor and Contractor];
- g. We have no conflict of interest in accordance with **[ITB]**;
- h. Our firm, its affiliates or subsidiaries—including any sub-contractors or Contractors for any part of the contract—has not been declared ineligible by the Port, under laws of India or official regulations, in accordance with **[ITB]**;
- i. We understand that this Tender, together with your written acceptance thereof included in your notification of award, shall constitute a binding contract between us, until a formal contract Agreement is prepared and executed in accordance with **[ITB]** and as per specimen form the purpose;
- j. We understand that you are not bound to accept the lowest evaluated Tender or any other Tender that you may receive.
- k. We also make a specific clause of [ITB, NIT] under which the Contract is governed.
- l. In case of Out Station Firms, having a branch in India for liaison purposes, please mention the Name of the Contact person and Tel. No., Fax No., and mail- Id and also the Complete Postal Address of the Firm.
- m. We understand that the Communication made with the Firm at, by the Port shall be deemed to have been done with us.

**Signed:** [insert signature of person whose name and capacity are shown]  
In the capacity of [insert legal capacity of person signing the Form of Tender]

Name: [insert complete name of person signing the Form of Tender]

Duly authorized to sign the Tender for and on behalf of: [insert complete name of Tenderer]

Dated on            day of        ,            [insert date of signing]

PRE-QUALIFICATION OF BIDDERS

The information to be filled in by the Bidder in the following pages will be used for purposes of Pre-Qualification as provided for in the Instructions to Tenderers.

1. Only for Individual Bidders

Constitution or legal status of Bidder (Attach copy)

- Place of registration:
- Principal place of business
- (Power of Attorney of signatory of Bid (Attach)

2. Turnover of the Firm/JV

Year	Turnover
<i>[INSERT THE YEARS AS PER PQC, i.e. LAST THREE FINANCIAL YEARS ENDING 31<sup>ST</sup> MARCH OF THE PRVIOUS YEAR]</i>	

Attachments:

Financial reports for the last three years: balance sheets, profit and loss statements, auditors' reports (in case of companies/ corporation) etc. List them below and attach copies.

The same should be audited as per relevant norms wherever required along with UDIN of the Auditor.

3. Infrastructure works related to Construction of Jetty / berth / wharves or construction of heavy industrial building or construction of water retaining structure like dam, anicut structure or Construction of RCC bridges. All these works must be carried out involving RCC & pile/sheet pile works .

Particulars	Year	No. of works	Value
Total value of completed similar work as defined in the tender document during last 7 years			

4 Attachments: Supporting documents, viz., Successful completion certificates from clients, other documentations to substantiate the similarity of work as per definition of “Similar Work”. Employers reserves the right to verify the information;

5.Information on Bid Capacity (works for which bids have been submitted and works which are yet to be completed) as on the date of this bid.

(A) Existing commitments and on-going works:

Description of work	Place & state	Contract No. & Date	Name and Address of Port	Value of Contract (Rs. Million)	Stipulated period of completion	Value of remaining to be completed	Anticipated date of completion
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)

(B) Works for which bids already submitted:

Description of work	Place & State	Name and Address of Port	Stipulated period of completion	Date when decision is expected	Remarks if any
(1)	(2)	(3)	(4)	(5)	(6)

\*Attach certificate(s) from the Engineer-in-charge (Nodal Officer) or his nominee(s)-in-Charge.

6. The following Contractor's Equipment are essential for carrying out the works. The Bidder should list all the information requested below:

Item of equipment	Requirement No. Capacity	Owned/leased/to be procured	Nos. /Capacity	Age /Condition	Remarks (From whom to be purchased)
(1)	(2)	(3)	(4)	(5)	(6)

7. Qualifications and experience of key personnel proposed for administration and execution of the Contract. Attach biographical data. Refer also to Sub Clause 4.3 (e) of instructions to Bidders and Sub Clause 9.1 of the Conditions of Contract.

Position	Name	Qualification	Years of experience (general)	Years of experience in the proposed position
Project Manager				
Discipline Specialist etc.				

8. Proposed sub-contracts and firms involved

Sections of the works	Value of sub-contract	Sub-contractor (name and address)	Experience in similar work

9. Information on litigation history in which the Bidder is involved.

Other party (ies)	Port	Cause of dispute	Amount	Remarks involved showing present status.

Additional Information Bidder may like to submit duly authorized to sign this Authorization on behalf of [insert complete name of Tenderer]  
Dated on day of, [insert date of signing]



LETTER OF ACCEPTANCE

(On letter head paper of the Port)

\_\_\_\_\_(date)

To: \_\_\_\_\_  
(name and address of the Contractor)

Dear Sirs,

Sub: Tender No.

Title of the Tender:

Ref: Your bid dated **And** [list of correspondence with the bidder]

This is to notify you that your Bid dated \_\_\_\_\_for execution of the  
\_\_\_\_\_(name of the contract and identification number, as given in  
the Instructions to bidders) for the Contract Price of Rupees \_\_\_\_\_  
(amount in words and figures as corrected and modified in accordance with the Tender Document is hereby  
accepted by the Employer/ Board.)

You are hereby requested to furnish Performance Guarantee, in the form detailed in Tender Document for  
anamount of Rs. \_\_\_\_\_Within 21 days of the receipt of this letter of  
acceptance.

Detailed Letter of Acceptance will follow.

Please acknowledge receipt.

Yours faithfully,

CHIEF ENGINEER,KDS

SYAMA PRASAD MOOKERJEE PORT, KOLKATA

ISSUE OF NOTICE TO PROCEED WITH THE WORKS

(letter head of the Port)

.....dated

*[Only for those tenders requiring separate commencement letter especially when site handing over is required as per tender conditions]*

To  
(name and address of the Contractors)

Dear Sirs,

Sub: Tender No.

Title of the Tender:

Ref: Letter of Acceptance No. dated:

Pursuant to your furnishing the requisite Performance Guarantee and Bid security as stipulated in **Tender Document** and signing of the contract for execution of the said work, you are hereby instructed to proceed with the execution of the works in accordance with the contract documents. It is hereby notified that the **site is being handed over to you w.e.f.[date].....for execution of work in accordance with the contact documents.**

Yours faithfully

(Signature, name and title of  
signatory authorised to sign on  
behalf of Employer/Board)

**SPECIMEN CONTRACT AGREEMENT**  
(To be executed on Rs.100/- non-judicial Stamp Paper)

[The successful Tenderer shall fill in this form in accordance with the instructions indicated]

THIS CONTRACT AGREEMENT is made

The no.....day of.....month.....year

BETWEEN

- (1)

The Trustees of Port of **SYAMA PRASAD MOOKERJEE PORT, KOLKATA**, an Autonomous Body of the Ministry of SHIIPING of the Government of INDIA, incorporated under the Major Port Trust Act,1963 as Amended there after, under the Laws of India and having its principal place of business at **SYAMA PRASAD MOOKERJEE PORT, KOLKATA, 700 001** (herein after called “The Port”),
- and
- (2)

.....(name of Contractor) [incorporated under] the laws of  
.....(country of Contractor) and having its principal place of business at  
.....(address of Contractor) (herein after called “the Contractor”).

WHEREAS

The Employer/Board invited Tenders against tender no.....for execution of..... **[TENDER TITLE AND BRIEF DESCRIPTION]** viz., and has accepted a Tender by the Contractor in accordance with the supply/ delivery schedules, in the sum of Contract Price.....(in words and figures, expressed in the Contract currency(ies)) (herein after called “the Contract Price”).

NOW THIS AGREEMENT WITNESSETH AS FOLLOWS:

1.

In this Agreement words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract referred to.
2.

The following documents shall constitute the Contract between the Employer/Board and the Contractor and each shall be read and construed as an integral part of the Contract:
- (a)

This Contract Agreement;
- (b)

Special Conditions of Contract;
- (c)

General Conditions of Contract;
- (d)

Technical Requirements (including Schedule of Requirements and Technical Specifications, drawings);
- (e)

Notice Inviting Tender;
- (f)

Replies issued to the Pre-bid queries, addendum if any issued **[numbers and dates]**;
- (g)

The Contractor’s Bid and original Price and Delivery Schedules;
- (h)

The Employer/Board’s Notification of Award;
- (i)

**[Correspondence the Employer/ Board had exchanged with the bidder till and after award of contract [specific letters and dates]**;
- (j)

**And [Add here any other document(s)]**

AND WHEREAS

3. EMPLOYER/ BOARD accepted the Bid of CONTRACTOR for the provision and the execution of WORK at the CONTRACT PRICE as indicated in CONTRACT upon the terms and subject to the conditions of Contract. Now this CONTRACT AGREEMENT witnesseth and it is hereby agreed and declared as follows:

4. In consideration of the payment to be made to CONTRACTOR for WORK to be executed by him. CONTRACTOR hereby Covenants with EMPLOYER/ BOARD that CONTRACTOR shall and will duly provide, execute and complete Work and things in CONTRACT, mentioned or described or which are to be implied there from or may be reasonably necessary for completion of Work and at the times and in the manner and subject to the terms and conditions or stipulations mentioned in CONTRACT.

5. In consideration of the due provision, execution and completion of WORK by the CONTRACTOR in accordance with the terms of the CONTRACT, the EMPLOYER/BOARD does hereby agree with CONTRACTOR that EMPLOYER/ BOARD will pay to Contractor the respective amounts for the work actually done by him and approved by EMPLOYER/ BOARD as per Payment Terms accepted in CONTRACT and payable to CONTRACTOR under provision of Contract at such time and at such manner as provided for in the CONTRACT.

AND

6. In consideration of the due provision, execution and completion of WORK, CONTRACTOR does hereby agree to pay such sums as may be due to EMPLOYER/ BOARD for the services rendered by EMPLOYER/ BOARD to Contractor as set forth in CONTRACT and such other sums as may become payable to EMPLOYER/ BOARD towards loss, damage to the EMPLOYER/ BOARD's equipment, materials etc. and such payments to be made at such time and in such manner as is provided in the CONTRACT.

IN WITNESS whereof the parties hereto have caused this Agreement to be executed in accordance with the laws of ..... *[insert the name of the Contract governing law country]* on the day, month and year indicated above.

For and on behalf of the Employer/Board

Signed ..... *[insert signature]*  
in the capacity of ..... *[insert title or other appropriate designation]*  
in the presence of ..... *[insert identification of official witness]*

For and on behalf of the Contractor

Signed ..... *[insert signature of authorized representative(s) of the Contractor]*  
In the capacity of ..... *[insert title or other appropriate designation]*  
In the presence of ..... *[insert identification of official witness]*

CONTRACTOR

CHIEF ENGINEER,KDS

## **SECTION-3**

### **GENERAL CONDITIONS OF CONTRACT**

# General Conditions of Contract Forms and Agreements

---

Sanctioned by the Trustees under Resolution No. 92 of the 6<sup>th</sup>  
Meeting held on 27<sup>th</sup> May, 1993

---

---

Including Addendum Sanctioned by the Trustees Meeting held on  
July, 2014

---

KOLKATA PORT TRUST  
KOLKATA DOCK SYSTEM  
&  
HALDIA DOCK COMPLEX  
JULY, 2014

GENERAL CONDITIONS OF CONTRACT

	CLAUSE		PAGES
1.	AMENDMENT TO GENERAL CONDITIONS OF CONTRACT	...	GC 1
2.	DEFINITION	...	GC 2 – GC 3
3.	DUTIES & POWERS OF ENGINEER & ENGINEER’S REPRESENTATIVE	...	GC 3 – GC 5
4.	THE TENDER/OFFER AND ITS PRE-REQUISITES	...	GC 5 – GC 9
5.	THE CONTRACT & GENERAL OBLIGATIONS OF CONTRACTOR	...	GC 9 – GC 14
6.	COMMENCEMENT, EXECUTION AND COMPLETION OF WORK	...	GC 14 – GC 17
7.	TERMS OF PAYMENT	...	GC 18 – GC 20
8.	VARIATION AND ITS VALUATION	...	GC 20 – GC 22
9.	DELAY/EXTENSION OF COMPLETION TIME/LIQUIDATED DAMAGE/TERMINATION OF CONTRACT	...	GC 22 – GC 24
10.	MAINTENANCE AND REFUND OF SECURITY DEPOSIT	...	GC 24 – GC 25
11.	INTERPRETATION OF CONTRACT DOCUMENTS, DISPUTES & ARBITRATION	...	GC 25 – GC 27
12.	FORMS GC-1, GC-2 , GC-3		
13.	FORM OF AGREEMENT		
14.	PROFORMA FOR B.G. FOR CONTRACT PERFORMANCE		
15.	INTEGRITY PACT DOCUMENT: PROFORMA		
16.	DRAFT Memorandum of Understanding between SMP, Kolkata. & Transparency International India		

GC - 1  
AMENDMENT  
TO

GENERAL CONDITIONS OF CONTRACT

❖ CI-3.4 THE TENDER /OFFER & ITS PRE-REQUISITES

Table under sub-clause (a)

PREVIOUS			AS AMENDED		
Estimated Value of Work	Amount of Earnest Money		Estimated Value of Work	Amount of Earnest Money	
	For Works Contract	For Contract of Supplying Materials or Equipment only		For Works Contract	For Contract of Supplying Materials or Equipment only
Up to Rs. 1,00,000=00	5% of the estimated value of work	1% of the estimated value of work	Up to Rs. 10 Crore	2% of the estimated value of work	1% of the estimated value of work
Over Rs. 1,00,000.00	2% of the estimated value of work subject to a maximum of Rs. 20,000/- and minimum of Rs. 5,000/-.	½% of the estimated value of work subject to a maximum of Rs. 10,000/- and minimum of Rs. 1,000/-.	Over Rs. 10 Crore	2% on first Rs. 10 Crore + 1% on the balance	½% of the estimated value of work subject to a maximum of Rs. 10,000/- and minimum of Rs. 1,000/-.

[ AMENDMENT SANCTIONED BY THE BOARD OF TRUSTEES VIDE RESOLUTION NO 210 OF THE TRUSTEES’ MEETING HELD ON 26.02.2013]

Table under sub-clause (d)

PREVIOUS			AS AMENDED		
Class of Registration	Amount Of Fixed Security	Financial Limit Of Each Tender	Class of Registration	Amount Of Fixed Security	Financial Limit Of Each Tender
A	Rs 10,000/-	Any tender priced upto Rs 2,00,000/-	A	Rs 50,000/-	Any tender priced up to Rs 10,00,000/-
B	Rs 5,000/-	Any tender priced upto Rs 1,00,000/-	B	Rs 25,000/-	Any tender priced upto Rs 5,00,000/-
C	Rs 2,500/-	Any tender priced upto Rs 50,000/-	C	Rs 15,000/-	Any tender priced upto Rs 3,00,000/-

[ AMENDMENT SANCTIONED BY THE BOARD OF TRUSTEES VIDE RESOLUTION NO 82 OF THE TRUSTEES’ MEETING HELD ON 12.10.2012]



GC - 2

1. DEFINITIONS

- 1.0 In the contract, as here in after defined, the following words and expressions shall have the meaning herein assigned to them, except where the context otherwise required.
- 1.1 “Employer” or “Board” or “Trustees” means of the Board of Trustees for the Port of Calcutta, a body corporate under Section 3 of the Major Port Trusts Act, 1963, including their successors, representatives and assigns. Employer
- 1.2 “Chairman” means the Chairman of the Board and includes the person appointed to act in his place under Sections 14 and 14A of the Major Port Trusts Act, 1963 Chairman
- 1.3 “Contractor” means the person or persons, Firm or Company whose tender/offer has been accepted by the Trustees and includes the Contractor’s representatives, heirs, successor and assigns, if any, permitted by the Board/Chairman. Contractor
- 1.4 “Engineer” means the Board’s official who has invited the tender on its behalf and includes the Manager (Infrastructure & Civic Facilities) or other official as may be appointed from time to time by the Employer, with written notification to the Contractor, to act as Engineer for the purpose of the Contract, in place of the “Engineer” so designated. Engineer
- 1.5 “Engineer’s Representative” means any subordinate or Assistant to the Engineer or any other official appointed from time to time by the Engineer to perform the duties set forth in Clauses 2.4 to 2.6 hereof. Engineer’s Representative
- 1.6 “Work” means the work to be executed in accordance with the Contract and includes authorised “Extra Works” and ‘Excess Works” and “Temporary Works”. Works
- 1.7 “Temporary Works” means all temporary works of every kind required in or about the execution, completion or maintenance of the works and includes (without thereby limiting the foregoing definitions) all temporary erections, scaffolding, ladders, timbering, soaking vats, site offices, cement and other godowns, platforms and bins for stacking building materials, gantries, temporary tracks and roads, temporary culverts and mixing platforms. Temporary works
- 1.8 “Extra Works” means those works required by the Engineer for completion of the Contract which were not specifically and separately included in the schedule of items of the works i.e. (Bill of Quantities) of the tender. “Excess Works” means the required quantities of work in excess of the provision made against any item of the bill of Quantities. Extra works and Excess works
- 1.9 “Specifications” means the relevant and appropriate Bureau of Indian Standard’s specifications / International Standard’s Specifications (latest revisions) for materials and workmanship unless stated otherwise in the Tender.

1.10	<b>“Drawings” means the drawings referred to in the Tender and specification and any modification of such drawings approved in writing by the Engineer and such other drawings as may from time to time be furnished or approved in writing by the Engineer.</b>	<b>Drawings</b>
1.11	<b>“Contract” means and includes the General and Special Conditions of Contract, Specifications, Drawings, priced Bill of Quantities, the Tender / Offer, the letter of acceptance of the Tender/Offer, the Contract Agreement, if separately entered into and the Schedule of Rates and Price, if any, adopted by the Trustees at their discretion.</b>	<b>Contract</b>
1.12	<b>“Constructional Plant” means all appliances or things of whatsoever nature required or about the execution, completion or maintenance of the works or temporary works and includes (without thereby limiting the foregoing definition) all machinery and tools but does not include materials or other things intended to form or forming part of the permanent works.</b>	<b>Constructional Plant</b>
1.13	<b>“Site” means the land, waterways and other places, on, under, in or through which the works are to be executed by the Trustees for the purpose of the Contract.</b>	<b>Site</b>
1.14	<b>“Contract Price” means the sum named in the letter of acceptance of the Tender/Offer of the Contractor, subject to such additions thereto and deductions therefrom as may be made by the Engineer under the provisions here in after contained.</b>	<b>Contract Price</b>
1.15	<b>“Month” means English Calendar Month.</b>	<b>Month</b>
1.16	<b>“Excepted Risks” are riot in so far as it is uninsurable, war, invasion, act of foreign enemies, hostilities) whether war be declared or not), Civil War, rebellion, revolution, insurrection or military or usurped power or use or occupation by the Trustees of any portion of the works in respect of which a certificate of completion has been issued (all of which are herein collectively referred to as the excepted risks).</b>	<b>Excepted Risks</b>
1.17	<b>Word importing the singular only, also includes the plural and vice-versa where the context so requires.</b>	<b>Singular/ Plural</b>
1.18	<b>The heading and marginal notes in these General Conditions of Contract shall not be deemed to be part thereof or be taken into consideration in the interpretation or construction thereof or of the contract.</b>	<b>Headings/ Marginal Notes.</b>
1.19	<b>Unless otherwise stipulated the work “Cost” shall be deemed to include overhead costs of the Contractor, whether on or off the site.</b>	<b>Cost</b>
2.0	<b>DUTIES &amp; POWERS OF ENGINEER &amp; ENGINEER’S REPRESENTATIVE.</b>	
2.1	<b>The Contractor shall execute, compete and maintain the works in terms of the contract to the entire satisfaction of the Engineer and Shall comply with the Engineer’s direction on any matter whatsoever.</b>	<b>Engineer’s Authority</b>

GC - 4

2.2	The Contractor shall take instructions from the Engineer and subject to limitation of Clause 2.5 hereof, from the Engineer’s Representative.	Authority of Engineer’s Representative
2.3	<p><i>The Engineer shall have full power and authority:</i></p> <p>(a) to supply to the contractor from time to time during the progress of the works such further drawings and instructions as shall be necessary for the purpose of proper and adequate execution and maintenance of the works and the contractor shall carry out and be bound by the same.</p> <p>(b) to alter or modify the specification of any material and workmanship and to inspect the work at any time.</p> <p>(c) to order for any variation, alteration and modification of the work and for extra works.</p> <p>(d) to issue certificates as per contract.</p> <p>(e) to settle the claims &amp; disputes of the Contractor and Trustees, as the first referee.</p> <p>(f) To grant extension of completion time.</p>	Engineer’s Power
2.4	<p><i>The Engineer’s Representative shall:</i></p> <p>(i) watch and supervise the works.</p> <p>(ii) test and examine any material to be used or workmanship employed in connection with the work.</p> <p>(iii) have power to disapprove any material and workmanship not in accordance with the contract and the contractor shall comply with his direction in this regard.</p> <p>(iv) take measurements of work done by the contractor for the purpose of payment or otherwise.</p> <p>(v) order demolition of defectively done work for its reconstruction all by the Contractor at his own expense.</p> <p>(vi) have powers to issue alteration order not implying modification of design and extension of completion time of the work and</p> <p>(vii) have such other powers and authorities vested in the Engineer, which have been delegated to him in writing by the Engineer under intimation to the Contractor.</p>	Power of Engineer’s Representative.

GC - 5

2.5

*Provided always that the Engineer's Representative shall have no power:*

(a)

to order any work involving delay or any extra payment by the Trustees,

(b)

to make variation of or in the works; and

(c)

to relieve the Contractor of any of his duties or obligations under the Contract.

Limitation of Engineer's Representative's Power

2.6

Provided also as follows:

(a)

Failure of Engineer's Representative to disapprove any work or materials shall not prejudice the power of the Engineer thereafter to disapprove such work or materials and to order the pulling down, removal, breaking-up thereof and re-constructing at the contractor's cost and the contractor shall have no claim to compensation for the loss if any sustained by him.

(b)

If the contractor shall be dissatisfied by reason of any decision of the Engineer's Representative, he shall be entitled to refer the matter to the Engineer who shall thereupon confirm, reverse or vary such decision.

(c)

Any written instructions or written approval given by the Engineer's Representative to the contractor, within the terms of delegation of power and authority vested in the Engineer to his Representative in writing, shall bind the contractor and the Trustees as though it had been given by the Engineer, who may from time to time make such delegation.

Engineer's Overriding Power

3.0 THE TENDER/OFFER AND ITS PRE-REQUISITES

3.1

The Contractor shall, before making out and submitting his tender/offer, be deemed to have inspected and examined the site, fully considered all factors, risks and contingencies, which will have direct and indirect impact on his expenses and profit from the work and shall be specifically deemed to have taken the following aspects into consideration:

(a)

The form and nature of the site and its surroundings including their sub-surface, hydrological, tidal and climatic conditions, the means of access to the site and all other local conditions, including the likely charges and costs for temporary way-leave, if any, required for the work.

(b)

The drawings, specifications, the nature and extent of work to be executed and the quality, quantity and availability of the required materials and labour for the work and the need to execute the

The tender must encompass all relevant aspects/ issues.

Site & Local condition.

Drawing/ Specification/ Nature &

GC - 6

- (c) The accommodation required for the workmen and site office, mobilisation/demobilisation and storage of all plant, equipment and Construction materials.

Accommodation for Contractor's men/materials.
- (d) The sources and means of procurement of water for drinking, washing and execution of work, and source and availability of electrical power, all at Contractor's cost.

Water for drinking etc. /Electrical power.
- (e) Payment of taxes and duties and compliance of all applicable statutes, ordinances and law together with the rules made thereunder, the rules, regulations and bye-laws of public bodies or any local or other authority by the Contractor, keeping the Trustees indemnified against penalties and liabilities of every kind arising from the Contractor's failure in such compliance.

Payment of Taxes/duties and observance of all statutes.
- (f) Payment of all kinds of stamp-duty for executing the agreement or for any legal instrument including Bank Guarantees and Indemnity Bonds.

Payment of Stamp Duty by the Contractor.

- 3.2

The Contractor's tender shall be in ink on the Tender Forms supplied by the Trustees, unless stipulated otherwise in the Notice Inviting the Tender and shall be faultless in figures and free from erasing. Corrections, if any, shall only be made by scoring out and initialling of the revised figure.
- 3.3

If required by the Engineer or the Trustees, the Contractors in their tender or subsequently, shall disclose the names of their owners/partners/share holders at the required points of time. The failure in this regard shall be treated as a breach and a contract, if entered into, shall be liable to be cancelled.
- 3.4

(a) Unless otherwise stipulated in the Notice Inviting Tender / Offer, every tender must be submitted with Earnest Money of the amount calculated as per the following scale.

- Disclosure of Owner's name.
- Earnest Money and Security Deposit.

Estimated Value of Work	Amount of Earnest Money	
	For Works Contract	For Contract of Supplying Materials or Equipment only
Up to Rs. 1,00,000=00	5% of the estimated value of work	1% of the estimated value of work
Over Rs. 1,00,000=00	2% of the estimated value of work subject to a maximum of Rs. 20,000/- and minimum of Rs. 5,000/-.	½% of the estimated value of work subject to a maximum of Rs. 10,000/- and minimum of Rs. 1,000/-.

- (b) Earnest Money shall be deposited with the Trustees’ treasurer in cash or by Banker’s Cheque of any Calcutta Branch of a Nationalised Bank of India drawn in favour of Calcutta Port Trust or in the form of any “Account Payee” Draft of any Nationalised Bank of India drawn in favour of “Calcutta Port Trust” and payable at Calcutta/Haldia, as the case may be, and the receipt granted therefor be kept attached to the Tender/Offer in the Sealed Cover.

Method of Paying E.M.
- (c) Earnest Money of unaccepted tender shall be refunded without any interest through A/c. Payee Cheque drawn on a Nationalised Bank of Calcutta / Haldia.

Refund of E.M.
- (d) The enlisted (registered) Contractors of the Trustees who have deposited fixed Security with the Trustees’ FA & CAO / Manager (Finance) according to his Class of Registration, shall be exempt from depositing the Earnest Money, as per the following scale:

Exemption from E.M. to Regd. Firms

Class of Registration	Amount of Fixed Security	Financial Limit of Each Tender
A	Rs. 25,000/-	Any tender priced up to Rs.5,00,000/-
B	Rs. 10,000/-	Any tender priced up to Rs.2,00,000/-
C	Rs. 5,000/-	Any tender priced up to Rs.1,00,000/-

- (e) (i) Tender submitted without requisite Earnest Money may be liable to rejection.

Tender without EM liable to rejection.
- (ii) If before expiry of the validity period of his Tender/Offer, the tenderer amends his quoted rates or tender/offer making them unacceptable to the Trustees and/or withdraws his tender/offer, the Earnest Money deposited shall be liable to forfeiture at the option of the Trustees.

Forfeiture of E.M. before Acceptance of offer.
- (f) The Earnest Money of accepted tender/offer shall be retained by the Trustees as part of the Security Deposit, for which a separate Treasury Receipt shall be issued to the Contractor after cancellation of the previous Receipt of Earnest Money.

E.M. to be converted to part S.D.
- (g) Balance security for works contract shall be recovered by deduction from all progressive Bill (including final Bill, if necessary) @ 10% of the gross value of work in each such bill, so that the total recovery may not exceed the quantum computed as per the under noted percentages of the total value of work actually done up to the stage of completion.

Mode of recovery of balance S.D.

Value of Work	% of Security Deposit for works contract.	% of Security Deposit For contract of supply-ing materials & equipment only.	Scale of S.D. recovery.
For works up to Rs.10,00,000/-.	10% (Ten percent)	1% (One percent)	
For works costing more than Rs.10,00,000/- and up to Rs.20,00,000/-	10% on first Rs.10,00,000/- + 7½% on the balance.	1% on first Rs.10,00,000/- + ½% on the balance.	
For works costing more than Rs.20,00,000/-	10% on first Rs.10,00,000/- + 7 ½% on the next Rs.10,00,000/- + 5% on the balance.	1% on first Rs.10,00,000/- + ½% on the next Rs.10,00,000/- + ¼% on the balance.	

(h) Balance Security for Contract of supplying materials and equipment computed in terms of the percentages given above, shall have to be deposited with the Trustees’ Treasurer in advance and within 30 days from the date of placement of supply order, either in cash or by A/c. Payee Draft of a Nationalized Bank of India drawn in favour of Calcutta Port Trust and payable at Calcutta/Haldia, as the case may be.

(i) No interest shall be paid by the Trustees to the Tenderer/Contractor on the amount of Earnest Money/Security Deposit held by the Trustees, at any stage.

S.D. for supply contracts to be deposited in advance.

No interest payable on E.M. /S.D

3.5 (i) The Security Deposit shall be refunded to the Contractor in terms of Clause 9.3 hereinafter and subject to deduction, if any, under the provision of Sub-clause 3.5 (ii) herein below. However, the Contract provides for any maintenance period. 50% of the Security Deposit may be refunded against any of the treasury Receipt for that amount on expiry of half of the maintenance period and the balance deposit on the expiry of the said maintenance period and after the Engineer has certified the final completion of work in Form G.C.2 and the Contractor has submitted his “No Claim” Certificate in Form G.C.3.

(ii) The Security Deposit/Earnest Money may be liable to forfeiture at the option of the Trustees, if the Contractor fails to carry out the work or to perform/observe any of the conditions of the Contract. The Trustees shall also be at liberty to deduct any of their dues from the Security Deposit,

Mode of refund of S.D.

Forfeiture of S.D.

fixed Security, Earnest Money or from any sum due or to become due to the Contractor under any other contract.

- 3.6 If stipulated in the contract as a Special Condition, the contractor shall have to submit to the Engineer a performance Bond in the form of an irrevocable guarantee from Calcutta/Haldia Branch, as the case may be, of any Nationalised Bank of India in the proforma annexed hereto and for the sum and period as mentioned in the letter of acceptance of the Tender/Offer, within 15 days from the date of such letter, failing which the Contract shall be liable to be terminated and the earnest money shall be liable to forfeiture; all at the discretion of the Engineer. The cost of obtaining this or any other Bank Guarantee and/or the revalidation thereof, wherever required, has to be borne by the Contractor and it shall be his sole responsibility to arrange for timely revalidation of such Bank Guarantee, failing which and for non-fulfilment of any contractual obligation by the Contractor, the Engineer and/or the Trustees shall be at liberty to raise claim against the Guarantee and/or enforce the same unilaterally.
- Bank Guarantee in lieu of Cash S.D. in certain cases
- 3.7 “Every Tenderer/ Bidder shall submit, in respect of a tender value of more than Rs 5 Crore, along with their tender comprising Special Conditions of Contract, General Conditions of Contract, BOQ, Earnest Money, etc. a document called Integrity Pact Agreement duly signed by their authorized representative. The Proforma of the Integrity Pact Agreement shall be as specified in the GCC. In case of tender value more than Rs 5 Crore, the Integrity Pact Agreement is an essential part and parcel of bid document to be submitted by each tenderer, without which the tender shall not be considered.”
- 4.0 THE CONTRACT & GENERAL OBLIGATIONS OF CONTRACTOR
- 4.1 (a) The contract documents shall be drawn-up in English language.
- English language to be used
- (b) The contract shall be governed by all relevant Indian Acts. As applicable only within the jurisdiction of the High Court at Calcutta, India, including the following Acts:
- Applicability of laws on the contract
1. The Contract Act (India), 1872.
  2. The Major Port Trusts Act, 1963.
  3. The Workmen’s Compensation Act, 1923.
  4. The Minimum Wages Act, 1948.
  5. The Contract Labour (Regulation & Abolition) Act, 1970.
  6. The Dock Workers’ Act, 1948.
  7. The Arbitration and Conciliation Act (1996) (in the case of a definite Arbitration Agreement only).
- 4.2 After acceptance of his Tender/Offer and when called on to do so by the engineer or his representative, the contractor shall, at his own expense, enter into and execute a Contract Agreement to be prepared by him in the form annexed hereto. Until such Contract Agreement is executed, the other documents referred to in the definition of the term ‘Contract’ herein-before, shall collectively be the Contract.
- Contractor to Execute Contract Agreement.
- 4.3 Several documents forming the contract are to be taken as mutually explanatory of one another. Should there be any discrepancy, ambiguity, omission or error in the various contract documents, the Engineer shall have the power to correct the same and his decision shall be final and binding on the parties to the Contract.
- Interpretation of contract documents –Engineers’ Power



- 4.4 Two copies of the Drawings referred to in the general and special Conditions of Contract and in the Bill of Quantities, shall be furnished by the Engineer to the Contractors free of cost for his use on the work, but these shall remain the property of the Trustees and hence, the Contractor shall return them to the Engineer or his Representative on completion of the work, if not torn or mutilated on being regularly used at site. All Drawings are Trustees' property.
- 4.5 The Contractor shall prove and make at his own expense any working or progress drawings required by him or necessary for the proper execution of the works and shall, when required, furnish copies of the same free of cost to the Engineer for his information and/or approval, without meaning thereby the shifting of Contractor's responsibility on the Engineer in any way whatsoever. Contractor to prepare working / progress drawings
- 4.6 The Contractor shall not directly or indirectly transfer, assign or sublet the Contract or any part thereof without the written permission of the Engineer. Even if such permission be granted, the Contractor shall remain responsible (a) for the acts, defaults and neglect of any sub-contractor, his agents, servants or workmen as fully as if these were the acts, defaults or neglects of the Contractor himself or his agents, servants or workmen and (b) for his full and entire responsibility of the contract and for active superintendence of the works by him despite being sublet, provided always that the provision of labourers on a "piece rate" basis shall not be deemed to be sub-letting under this clause. Contractor cannot sub-let the work
- 4.7 Unless otherwise specified, the Contractor shall be deemed to have included in his Tender/Offer all his cost for supplying and providing all constructional plant, temporary work. Materials both for temporary and permanent works, labour including supervision thereof, transporting to and from the site and in and about the work, including loading, unloading, fencing, watching, lighting, payment of fees, taxes and duties to the appropriate authorities and other things of every kind required for the construction, erection, completion and maintenance of the work. Contractors' price is inclusive of all costs
- 4.8 The Contractor shall be solely responsible for the adequacy, stability and safety of all site operations and methods of construction, even if any prior approval thereto has been taken from the Engineer or his Representative. The Contractor shall not be responsible for the correctness of the design or specification of the Temporary and Permanent works formulated by the Engineer; but the Contractor shall be fully responsible for the correct implementation thereof, as also for any design and specification prepared/proposed/used by the Contractor. Contractor is responsible for all construction process, except for correctness of design and specification formulated by the Engineer
- 4.9 Whenever required by the Engineer or his representative, the Contractor shall submit to him the details of his (a) programme for execution of the work, (b) proposed procedure and methods of work, (c) proposed deployment of plant, equipment, labour, materials and temporary works. The submission to and/or any approval by the Engineer or his Representative to any such programme or particulars shall not relieve the Contractor of any of his obligations under the contract. Contractor to submit his programme of work

If for any reason the contractor be unable to adhere to his earlier programme, he shall submit his revised programme for completion of work within the stipulated time whenever asked to do so.

- |      |   |            |    |  |
|------|---|------------|----|--|
| 4.10 | Necessary and adequate supervision shall be provided by the Contractor during execution of the works and as long thereafter as the Engineer or his representative shall consider necessary during the maintenance period. The Contractor or his competent and authorised agent or representative shall be constantly at site and instructions given to him by the Engineer or his representative in writing shall be binding upon the Contractor subject to limitation in Clause 2.5 hereof. The Contractor shall inform the Engineer or his representative in writing about such representative/agent of him at site.  | Contractor | to | supervise the works  |
| 4.11 | The Contractor shall employ in execution of the Contract only qualified careful and experienced persons and the Engineer shall be at liberty to direct the Contractor to stop deployment of any of his staff, workmen or official at site and the Contractor shall within 48 hours comply with such instruction without any demur whenever the Engineer shall feel that the deployment of the person concerned will not be conducive to the proper and timely completion of the work.   | Contractor | to | deploy qualified men and Engineer's power to remove Contractor's men |
| 4.12 | The Contractor shall be responsible for the true and proper setting out of the works in relation to reference points/lines/levels given by the Engineer in writing. The checking of any setting-out or of any alignment or level by the Engineer or his Representative shall not in any way relieve the contractor of his responsibility for the correctness thereof and he shall fully provide protect and preserve all stakes, templates, bench marks, sight rails, pegs, level marks, profile marks and other things used in setting out the works.  | Contractor | is | responsible for line, level, setting out etc.                        |
| 4.13 | From the commencement of the works till issue of the completion certificate in Form G.C.1, vide Clause 5.12 hereof, the contractor shall take full responsibility for the care thereof. Save for the excepted risks, any damage, loss or injury to the work or any part thereof shall be made good by the Contractor at his own cost as per instruction and to the satisfaction of the engineer, failing which the Engineer or his Representative may cause the same to be made good by any other agency and the expenses incurred and certified by the Engineer shall deem proper. This Clause will not apply to that part of the work, which might have been taken over by the Trustees on partial completion of the work and in such case the Contractor's obligation will be limited to repairs and replacement for manufacturing or construction defects during the Maintenance period (Guarantee Period) as per the directions of the Engineer as also for defects/damages if any caused to the work by the Contractor during such repairs and replacement in the maintenance period. | Contractor | is | responsible to protect the work                                      |

## GC – 12

- 4.14** The Contractor shall at his own cost protect support and take all precautions in regard to the personnel or structure or services or properties belonging to the Trustees or not which may be interfered with or affected or disturbed or endangered and shall indemnify and keep indemnified the Trustees against claim for injury, loss or damage caused by the Contractor in connection with the execution and maintenance of the work to the aforesaid properties, structures and services and/or to any person including the Contractor's workmen. Cost of Insurance Cover, if any, taken by the Contractor shall not be reimbursed by the Trustees, unless otherwise stipulated in the Contract.
- Contractor is responsible for all damages to other structures / persons caused by him in executing the work.
- 4.15** The Contractor shall immediately inform the Engineer's Representatives if any fossil, coins, articles of value or antiquity and structures and other remains or things of geological or archaeological importance be discovered at site which shall remain the property of the Trustees and protect them from being damaged by his workmen and arrange for disposal of them at the Trustees' expense as per the instruction of the Engineer's Representative.
- Fossils, Treasure trawls, etc. are Trustees' property
- 4.16** The Contractor shall be deemed to have indemnified and shall indemnify the Trustees against all claims, demands, actions and proceedings and all costs arising therefrom on account of:
- Contractor to Indemnify the Trustees against all claims for loss, damage, etc.
- (a) Infringement of any patent right, design, trademark or name or other protected right in connection with the works or temporary work.
  - (b) Payment of all royalties, rent, toll charges, local taxes, other payments or compensation, if any, for getting all materials and equipment required for the work.
  - (c) Unauthorised obstruction or nuisance caused by the contractor in respect of Public or Private or Private road, railway tracks, footpaths, crane tracks, waterways, quays and other properties belonging to the Trustees or any other person.
  - (d) Damage/injury caused to any highway and bridge on account of the movement of Contractor's plants and materials in connection with the work.
  - (e) Pollution of waterway and damage caused to river, lock, sea-wall or other structure related to waterway, in transporting contractor's plants and materials.
  - (f) The Contractor's default in affording all reasonable facilities and accommodation as per the direction of the Engineer or his Representative to the workmen of the Trustees and other agencies employed by or with the permission and/or knowledge of the Trustees on or near the site of work.
- 4.17** Debris and materials, if obtained by demolishing any property, building or structure in terms of the Contract shall remain the property of the Trustees.
- Dismantled materials Trustees' property

## GC – 13

- |      |   |  |
|------|---|--|
| 4.18 | <p>The Contractor's quoted rates shall be deemed to have been inclusive of the following:</p> <ul style="list-style-type: none"> <li>(a) Keeping the site free of unnecessary obstruction and removal from site of constructional plant wreckage, rubbish, surplus earth or temporary works no longer required.</li> <li>(b) Cleaning and removal from site all the surplus materials of every kind to leave the site clean and tidy after completion of the work, without which payment against final bill may be liable to be withheld.</li> <li>(c) Precautionary measures to secure efficient protection of Docks, the River Hooghly and other waterways against pollution of whatever nature during execution and maintenance of the works and to prevent rubbish, refuse and other materials from being thrown into the water by the Contractor's men or those of his agency.</li> <li>(d) Making arrangements for deployment of all labourer and workers, local or otherwise including payment for their wages, transport, accommodation, medical and all other statutory benefits and entry permits, wherever necessary.</li> <li>(e) Making arrangements in or around the site, as per the requirements of local authority or the Engineer or his Representative for preventing (i) spread of any infectious disease like smallpox, cholera, plague or malaria by taking effective actions for destruction of rats, mice, vermin, mosquitoes, etc. and by maintaining healthy and sanitary condition, (ii) illegal storage and distribution of Drugs, Narcotics, Alcoholic liquor, Arms and Ammunitions, (iii) unlawful, riotous or disorderly conduct of the Contractor's or his Sub-Contractor's workmen, (iv) deployment of workmen of age less than 16 years.</li> </ul> | <p>Contractor's quoted rates/price must be all inclusive</p>       |
| 4.19 | <p>Every direction or notice to be given to the Contractor shall be deemed to have been duly served on or received by the Contractor, if the same is posted or sent by hand to the address given in the tender or to the Contractor's Site Office or to the Registered Office of the Contractor. The time mentioned in these conditions for doing any act after direction or notice shall be reckoned from the time of such posting or despatch.</p>  | <p>Notice to Contractor.</p>                                       |
| 4.20 | <p>The Contractor and his Sub-contractor or their agents and men and any firm supplying plant, materials and equipment shall not publish or caused to be published any photographs or description of the works without the prior authority of the Engineer in writing.</p>  | <p>Contractor not to publish photograph or particulars of work</p> |

## GC – 14

- 4.21 The Contractor shall at the Trustees' cost to be decided by the Engineer render all reasonable facilities and Co-operation as per direction of the Engineer or his representative to any other Contractor engaged by the Trustees and their workmen to the Trustees' own staff and to the men of other Public Body on or near the site of work and in default the Contractor shall be liable to the Trustees for any delay or expense incurred by reason of such default. Contractor to provide facilities to outsiders
- 4.22 The work has to be carried out by the Contractor causing the minimum of hindrance for any maritime traffic or surface traffic. Work to cause minimum possible hindrance to traffic movement
- 4.23 All constructional plants, temporary works and materials when brought to the site by the Contractor shall be deemed to be the property of the Trustees who will have lien on the same until the satisfactory completion of the work and shall only be removed from the site in part or in full with the written permission of the Engineer or his Representative. Trustees' lien on Contractor's Plant & Equipment.
- 5.0 COMMENCEMENT, EXECUTION AND COMPLETION OF WORK.
- 5.1 The Contractor shall commence the work within 7 days of the receipt of Engineer's letter informing acceptance of the Contractor's tender/offer by the Trustees or within such preliminary time as mentioned by the Contractor in the Form of Tender or the time accepted by the Trustees. The Contractor shall then proceed with the work with due expedition and without delay, except as may be expressly sanctioned or ordered by the Engineer or his Representatives, time being deemed the essence of the contract on the part of the contractor. Preliminary time to commence work an maintenance of steady rate of progress
- 5.2 The Contractor shall provide and maintain a suitable office at or near the site to which the Engineer's Representative may send communications and instructions for use of the Contractor. Contractor's site office
- 5.3 Unless specified otherwise in the contract or prior permission of the Engineer has been taken, the contractor shall not execute the work beyond the working hours observed by the Engineer's Representative and on Sundays and Holidays observed in the Trustees' system, except in so far as it becomes essential on account of tidal work or for safety of the work. If the progress of the work lags behind schedule or the work has been endangered by any act or neglect on the part of the contractor, then the Engineer or his Representative shall order and the contractor at his own expense shall work by day and by night and on Sundays and Public Holidays. Any failure of the Engineer or his Representative to pass such an order shall not relieve the contractor from any of his obligations. The Engineer's decision in this regard shall be final binding and conclusive. Contractor to observe Trustees' working hours

## GC – 15

- |     |  |  |
|-----|--|--|
| 5.4 | Unless stipulated otherwise in the contract all materials required for the work shall be procured and supplied by the contractor with the approval of the Engineer or his Representative and subject to subsequent testing as may be required by the Engineer or his Representative. The Engineer shall exercise his sole discretion to accept any such materials.   | Contractor to supply all materials as per requirement of the Engineer or his representative                      |
| 5.5 | Unless stipulated otherwise in the contract all materials, workmanship and method of measurement shall be in accordance with the relevant Codes (Latest Revision) of the Bureau of Indian Standards and the written instructions of the Engineer or his Representative. Where no specific reference is available in the contract, the material and workmanship shall be of the best of their respective kinds to the satisfaction of the Engineer.                                       | Materials & Works  |
| 5.6 | Samples shall be prepared and submitted for approval of the Engineer or his representative, whenever required to do so, all at the Contractor's cost.  | Contractor to submit samples for approval  |
| 5.7 | Unless stipulated otherwise in the contract, the cost of any test required by the Engineer or his representative in respect of materials and workmanship deployed on the work, shall be borne by the Contractor.   | Contractor to arrange all testing at his own cost.   |
| 5.8 | Regarding the supply of any materials by the Trustees to the contractor in accordance with the contract, the following conditions shall apply :  |  |
|     | (a) The Contractor shall, at his own expense, arrange for transporting the materials from the Trustees' Stores, watching, storing and keeping them in his safe custody, furnishing of statement of consumption thereof in the manner required by the Engineer or his representative, return of surplus and empty container to the Trustees' Stores as per the direction of the Engineer or his Representative.   | The Contractor shall account for and look after the Trustees' materials  |
|     | (b) Being the custodian of the Trustees' materials, the contractor shall remain solely responsible for any such materials issued to him and for any loss or damage thereof for any reason other than "Excepted Risks", the Contractor shall compensate the Trustees' in the manner decided by the Engineer and shall at no stage remove or cause to be removed any such material from the site without his permission in writing.  | Contractor to compensate for loss and damage to Trustees' materials  |
|     | (c) The Trustees' materials will generally be supplied in stages and in accordance with the rate of progress of work but except for grant of suitable extension of completion time of work as decided by the Engineer. The Contractor shall not be entitled to any other compensation, monetary or otherwise, for any delay in the supply of Trustees' materials to him. The Contractor shall, however, communicate his requirement of such materials to the Engineer from time to time. | Delay in supply of Trustees' materials will only entitle the Contractor for extension of completion time of work |

(d) Unless stipulated otherwise in the contract, the value of the Trustees' materials issued to the contractor shall be recovered from the contractor's bills and/or any of his other dues, progressively according to the consumption thereof on the work and/or in the manner decided by the Engineer or his representative and at the rate/s stipulated in the contract. These rates shall only be considered by the contractor in the preparation of his tender/offer and these will form the basis of escalation/variation, if in future the contractor is required to procure and provide any such material on the written order of the Engineer consequent on the Trustees' failure to effect timely supply thereof.

Recovery from Contractor for Trustees' materials under normal circumstances

(e) If the Engineer decides that due to the contractor's negligence, any of the Trustees' materials issued to the contractor has been – (i) lost or damaged, (ii) consumed in excess of requirement and (iii) wasted by the contractor in excess of normal wastage, then the value thereof shall be recovered from the contractor's bills or from any of his other dues, after adding 19 ¼% extra over the higher one of the followings -

Recovery from Contractor for Trustees' materials under other circumstances.

(1) The issue rate of the materials at the Trustees' Stores and

(2) The market price of the material on the date of issue as would be determined by the Engineer.

5.9 The Engineer or his Representative shall have the power to inspect any material and work at any time and to order at any time – (i) for removal from the site of any material which in his opinion is not in accordance with the contract or the instruction of the engineer or his representative, (ii) for the substitution of the proper and suitable materials, or (iii) the removal and proper re-execution of any work which in respect of material and workmanship is not in accordance with the contract or the instructions of the Engineer. The Contractor shall comply with such order at his own expense and within the time specified in the order. If the contractor fails to comply, the Engineer shall be at liberty to dispose any such materials and re-do any work in the manner convenient to the Trustees by engaging any outside agency at the risk and expense of the contractor and after giving him a written prior notice of 7 days.

Contractor to replace materials/work not acceptable to the Engineer or his Representative

5.10 No work shall be covered up and put out of view by the contractor without approval of the Engineer or his Representative and whenever required by him, the contractor shall uncover any part or parts of the work or make openings in or through the same as may be directed by the Engineer or his representative from time to time and shall reinstate or make good those part of works thus affected to the satisfaction of the Engineer, all at the cost of the contractor.

Contractor to seek approval of Engineer or his Representative before covering up any portion of work

The Trustees shall reimburse such cost as determined by the Engineer, if the initial covering up was with prior written order of the Engineer or his Representative.

**5.11** On a written order of the Engineer or his Representative, the contractor shall delay or suspend the progress of the work till such time the written order to resume the execution is received by him. During such suspension the contractor shall protect and secure the work to the satisfaction of the Engineer or his Representative. All extra expenses in giving effect to such order shall be considered by the Trustees, unless such suspension is –

Contractor to suspend work on Order from Engineer or his Representative

- (a) otherwise provided for in the contract, or
- (b) necessary by reason of some default on the part of the contractor, or
- (c) necessary by reason of climatic conditions on the site, or
- (d) necessary for proper execution of the works or for the safety of the works or any part thereof.

The Engineer shall settle and determine such extra payment and/or Extension of completion time to be allowed to the contractor, as shall, in the opinion of the Engineer be fair and reasonable, and the same shall be final and binding on the Contractor.

**5.11.** If at any time before or after commencement of the work the Trustees do not require the whole of the work tendered for the Engineer shall notify the same to the contractor in writing and the contractor shall stop further works in compliance of the same. The Contractor shall not be entitled to any claim for compensation for underived profit or for such premature stoppage of work or on account of curtailment of the originally intended work by reason of alteration made by the Engineer in the original specifications, drawings, designs and instructions.

**5.12** When the whole of the work has been completed to the satisfaction of the Engineer and has passed any final test prescribed in the contract, the contractor shall, within 21 days of submission of his application to the Engineer, be entitled to receive from him a certificate for completion of work in Form G.C.1, annexed hereto. If any part of the total work having been completed to the satisfaction of the Engineer, be taken over and/or used by the Trustees, the Contractor shall on application be entitled to partial completion certificate in the Form G.C.1 indicating the portion of the work covered by it, so that the Contractor's liability during maintenance period of the contract, if any, shall commence from the date mentioned in such certificate so far as the completed portion of the work is concerned.

Completion Certificate G.C.1.



**6.0 TERMS OF PAYMENT:**

- 6.1** No sum shall be considered as earned by or due to the Contractor in respect of the work till final and satisfactory completion thereof and until a certificate of final completion in Form G.C.2 has been given by the Engineer.
- All interim payments are till issue of Certificate in Form G.C.2
- On account payments, if any, made prior to issue of the certificate in Form G.C.2, shall all be treated as mere advance, which shall stand recoverable in full or in part, if the Engineer so decides in the context of Contractor's unfulfilled contract condition, if any.
- 6.2** All payments shall be made to the Contractor only on the basis of measurements of actual work done, as recorded in the Trustees' measurement books and at accepted tendered or at agreed rates, as the case may be, except as otherwise provided in the contract and when the Engineer decides any other rate for change in the scope of work or omission, if any, on the part of the Contractor.
- Payment on the basis of measurements at agreed rates.
- 6.3** For work of sanctioned tender value more than Rs.50,000/- or having an initially stipulated completion period of 4 months or more, on account payments may be made at the discretion of the Engineer or his Representative at intervals deemed suitable and justified by him. Provided always that subject to execution of work of substantial value in the context of the contract price, the interval of such on-account payments shall be decided by the Engineer or his Representative, which shall ordinarily not be less than 1 month in between two payments for on account bill and/or advance.
- Limitation for on account payment
- 6.4** Measurement for works done shall be progressively taken by the Engineer's Representative and entered in the Trustees' Measurement Book, at intervals deemed suitable and proper by him and/or the Engineer. The Contractor or his duly accredited Representative or Agent shall remain present at the time of such measurement and assist the engineer's Representative in every manner required by him. After the measurements taken have been entered in the Measurement Book, the Contractor or his Agent shall sign the Measurement Book at the end of such Measurements over the Contractor's Rubber Stamp as a token of acceptance of all such measurements, recorded above and prior to such signature. If the Contractor or his Agent fails to participate even after 3 days written notice from the Engineer's Representative, the measurement shall be taken ex-parte by the Engineer's Representative and those shall be accepted by the Contractor.
- Recording of measurements

## GC – 19

- 6.5** Based on the quantum of work and the value thereof computed in the Measurement Book, the Contractor shall type out his bill in the proforma approved by the Engineer and submit the same to the Engineer's Representative in quadruplicate, duly signed by him or his accredited Agent over his Rubber Stamp. The Engineer or his Representative may in his absolute discretion, allow advance payment against such bill to the extent of an amount not exceeding 75% of the "net payable" sum of the said bill, subject to adjustment thereof against the bill at the time of checking and auditing the bill at the Trustees' end. The measurement Book will not be handed over to the Contractor; but he will obtain the abstracts of quantities, amounts and recoveries to type out the bill. Contractor to prepare and submit his bills
- 6.6** At the discretion of the Engineer or his Representative and only in respect of accepted offers/where estimated amount put to tender would be Rs.2,00,000/- or more, advance payment may be made to the extent of 75% of the value of any material purchased and brought to the site by the Contractor. Provided always that –
- (i) the materials shall, in the opinion of the Engineer or his Representative be of imperishable nature, Advance payment against Non-perishable materials
  - (ii) the value of such materials shall be assessed by the engineer or his Representative at their own discretion,
  - (iii) a formal agreement has been drawn up with the contractor, under which the Trustees secure a lien on the contractor's materials,
  - (iv) the materials are safe-guarded by the contractor against losses, shortage and misuse due to the contractor postponing the execution of the work or otherwise,
  - (v) in the event of storage of such materials within the Trustees' protected areas in the Docks, the contractor shall submit an Indemnity Bond in the proforma and manner acceptable to Trustees' whereby the contractor shall indemnify the Trustees against all financial loss/damage, on account of loss/damage to such materials for whatever reasons,

GC – 20

- (ii) in the event of storage of such materials outside the Trustees’ protected areas the Contractor shall submit to the Engineer an irrevocable Bank Guarantee favouring the Trustees and for the same sum as is being advance, in the proforma and manner acceptable to the Trustees. The Guarantee shall be of a Calcutta/Haldia Branch of any Nationalised Bank or a Schedule Commercial Bank, as the case may be, acceptable to the Trustees and shall remain valid till the anticipated period of consumption of such materials in the work. The Bank Guarantee must bear an undertaking by the issuing Bank guaranteeing automatic payment of the guaranteed sum to the Trustees by the Bank on the date of expiry of the validity of the Guarantee, unless with the prior written approval of the Engineer on behalf of the Trustees, the Bank has extended the validity of the Guarantee.
- (iii) The amount of advance shall be recoverable from the contractor's bills or any other dues, progressively with the consumption of the materials on the basis of quantity consumed. Consequent on full recovery of the advance the Indemnity Bond/Bank Guarantee, vide Sub-clause (v) & (vi) above, shall be returned to the Contractor duly discharged by the Engineer on behalf of the Trustees.

6.7	No certificate of the Engineer or his representative shall protect the Contractor against or prevent the Trustees from obtaining repayment from the Contractor, in case the Engineer or his representative should over-certify for payment or the Trustees should over-pay the Contractor on any account.	Recovery for wrong and over payment
6.8	No claim for interest shall be admissible or payable to the Contractor at any stage and in respect of any money or balance or Bank Guarantee, which may be due to the Contractor from the Trustees, owing to dispute or otherwise or for any delay on the part of the Trustees in making interim or final payment or otherwise.	Interest not admissible to Contractor
7.0	VARIATION AND ITS VALUATION:	
7.1	The Quantities set out in the Bill of Quantities of the tender shall be treated as estimated quantities of the work and shall never be deemed as actual or correct quantities of the works to be executed by the contractor in fulfilment of his obligation under the contract.	Quantities in Bill of Quantities of Tender
7.2	The Engineer shall have the power to order the Contractor in writing to make any variation of the quantity, quality or form of the works or any part thereof that may, in his opinion, be necessary and the Contractor upon receipt of such an order shall act as follows:	Engineer’s power to vary the works

- 7.2 (a) Increase or decrease the quantity of any work included in the contract.
- (b) Omit any work included in the contract.
- (c) Change the Character or quality or kind of any work included in the contract.
- (d) Change the levels, lines, position and dimensions of any part of the work, and
- (e) Execute extra and additional work of any kind necessary for completion of the works
- 7.3 No such variation shall in any way vitiate or invalidate the contract or be treated as revocation of the contract, but the value (if any) of all such variations evaluated in accordance with the Engineer's sole decision shall be taken into account and the contract price shall be varied accordingly. Variation by engineer do not vitiate the contract
- 7.4 Provided always that written order of the Engineer shall not be required for increase or decrease in the quantity of any work upto 15% where such increase or decrease is not the result of any variation order given under this clause but is the result of the quantities exceeding or being less than those stated in the bill of quantities. Provided also that verbal order of variation from the Engineer shall be complied with by the Contractor and the Engineer" subsequent written confirmation of such verbal order shall be deemed to be an order in writing within the meaning of this clause. Where written order for variation is not needed
- 7.5 (a) The Contractor shall not be entitled to any claim of extra or additional work unless they have been carried out under the written orders of the Engineer. Payment for extra or additional, or omitted work or substituted work, Engineer's powers
- (b) The Engineer shall solely determine the amount (if any) to be added to or deducted from the sum named in the tender in respect of any extra work done or work omitted by his order.
- (c) All extra, additional or substituted work done or work omitted by order of the Engineer shall be valued on the basis of the rates and prices set out in the contract, if in the opinion of the Engineer, the same shall be applicable. If the contract does not contain any rates or prices directly applicable to the extra, additional or substituted work, then the Engineer may decide the suitable rates on the basis of Schedule of Rates (including surcharge in force at the time of acceptance of tender), if any, adopted by the Trustees with due regard to the accepted contractual percentage, if any thereon. In all other cases the Engineer shall solely determine suitable rates in the manner deemed by him as fair and reasonable, and his decision shall be final, binding and conclusive.

## GC – 22

- (d) If the nature or amount of any omission or addition relative to the nature or amount of the whole of the contract work or to any part thereof shall be such that, in the opinion of the Engineer, the rate of prices contained in the contract for any item of the works or the rate as evaluated under sub-clauses (b) and (c) of this clause, is by reason of such omission or addition rendered unreasonable or in-applicable, the Engineer shall fix such other rate or price as he deems proper and the Engineer's decision shall be final, binding and conclusive.

**8.0 DELAY / EXTENSION OF COMPLETION TIME / LIQUIDATED DAMAGE / TERMINATION OF CONTRACT**

- 8.1** Should the quantum of extra or additional work of any kind or delayed availability of the Trustees' materials to be supplied as per contract or exceptionally adverse climatic conditions and natural phenomenon or strikes, lock-outs, civil commotion or other special circumstances of any kind beyond the control of the Contractor, cause delay in completing the work, the contractor shall apply to the Engineer in writing for suitable extension of completion time within 7 days from the date of occurrence of the reason and the Engineer shall thereupon consider the stated reasons in the manner deemed necessary and shall either reject the application or determine and allow in writing the extension period as he would deem proper for completion of the work with or without the imposition of "Liquidated Damage" Clause (No.8.3 hereof) on the Contractor and his decision shall be final and binding on the Contractor. If an extension of completion time is granted by the Engineer without imposition of liquidated damage, from the Clause No.8.3 of the Liquidated damage shall apply from its date of expiry, if the work be not completed within the extended time, unless stated otherwise in the decision communicated by the Engineer, as aforesaid. Extension of completion time
- 8.2** a) If the Contractor fails to complete the work within the stipulated dates or such extension thereof as communicated by the Engineer in writing, the Contractor shall pay as compensation (Liquidated Damage) to the Trustees and not as a penalty, ½% (half percent) of the total value of work (contract piece) as mentioned in the letter of acceptance of the tender/offer, for every week or part thereof the work remains unfinished. Provided always that the amount of such compensation shall not exceed 10% of the said value of work. The amount of Liquidated damages shall be determined by the Engineer, which shall be final and binding. 'Liquidated Damage' and other compensation due to Trustees

(b) Without prejudice to any of their legal rights, the Trustees shall have the power to recover the said amount of compensation/damage in Sub-clause (a) of this clause, from any money due or likely to become due to the Contractor. The payment or deduction of such compensation/damage shall not relieve the Contractor from his obligation to complete the work or from any of his other obligations/liabilities under the contract and in case of the Contractor's failure and at the absolute discretion of the Engineer, the work may be ordered to be completed by some other agency at the risk and expense of the Contractor, after a minimum three days notice in writing has been given to the Contractor by the Engineer or his Representative.

**8.3** Without being liable for any compensation to the Contractor, the Trustees may, in their absolute discretion, terminate the contract and enter upon the site and works and expel the Contractor there from after giving him a minimum 3 days' notice in writing, due to occurrence of any of the following reasons and decision of the Trustees in this respect, as communicated by the Engineer shall be final and conclusive :

**Default of the Contractors remedies & powers/Termination of Contract.**

- (i) The Contractor has abandoned the contract.
- (ii) In the opinion of the Engineer, either the progress of work is not satisfactory or the work is not likely to be completed within the agreed period on account of Contractor's lapses.
- (iii) The Contractor has failed to commence the works or has without any lawful excuse under these conditions has kept the work suspended for at least 15 days despite receiving the Engineer's or his Representative's written notice to proceed with the work.
- (iv) The Contractor has failed to remove materials from site or to dismantle or demolish and replace work for 7 days after receiving from the Engineer or his representative the written notice stating that the said materials or work were condemned and rejected by him under these conditions.
- (v) The Contractor is not executing the works in accordance with the contract or is persistently or flagrantly neglecting to carry out his obligations under the contract.
- (vi) Any bribe, commission, gift or advantage is given, promised or offered by or on behalf of the contractor to any officer, servant or representative of the Trustees or to any person on his or their behalf in relation to the obtaining or to the execution of the contract.
- (vii) The Contractor is adjusted insolvent or enters into composition with his creditors or being a company goes into liquidation either compulsory or voluntary.

- 8.3.1** Upon receipt of the letter of termination of work, which may be issued by the Engineer on behalf of the Trustees, the Contractor shall hand over all the Trustees' tools, plant and materials issued to him at the place to be ascertained from the Engineer, within 7 days of receipt of such letter.
- 8.3.2** In all such cases of Termination of work, the Trustees shall have the power to complete the work through any other agency at the Contractor's risk and expense and the Contractor shall be debited any sum or sums that may be expended in completing the work beyond the amount that would have been due to the Contractor, had he duly completed the work of the work in accordance with the contract.
- 8.3.3** Upon termination of contract, the Contractor shall be entitled to receipt payment of only 90% of the value of work actually done or materials actually supplied by him and subject to recoveries as per contract, provided the work done and materials conform to specifications at the time of taking over by the Trustees. The payment for work shall be based on measurements of actual work done and priced at approved contract rates or other rates, as decided by the Engineer. The payment for materials supplied shall be at the rates as decided by the Engineer, which shall in no case be more than market rates prevailing at the time of taking over by the Trustees. The Engineer's decision in all such case shall be final, binding and conclusive.
- 8.3.4** The Trustees shall have the power to retain all moneys due to the Contractor until the work is completed by other agency and the Contractor's liabilities to the Trustees are known in all respect.

**9.0 MAINTENANCE AND REFUND OF SECURITY DEPOSIT**

- 9.1** On completion of execution of the work the Contractor shall maintain the same for a period, as may be specified in the form of a Special Condition of the Contract, from the date mentioned in the Initial Completion Certificate in Form G.C.1. Any defect/fault, which may appear in the work during aforesaid maintenance period, arising, in the sole opinion of the Engineer or his representative, from materials or workmanship not in accordance with the contract or the instruction of the Engineer or his representative, shall, upon the written notice of the Engineer or his representative, be amended and made good by the Contractor at his own cost within seven days of the date of such notice, to the satisfaction of the Engineer or his representative, failing which the Engineer or his representative shall have the defects amended and made good through other agency at the Contractor's risk and cost and all expenses, consequent thereon or incidental thereto, shall be recoverable from the Contractor in any manner deemed suitable by the Engineer.
- Contractor's obligation for maintenance of work.

- 9.2 The Contractor shall not be considered completed and the work shall not be treated as finally accepted by the Trustees, until a Final Completion Certificate in Form G.C.2 annexed hereto shall have been signed and issued by the Engineer to the contractor after all obligations under the Contract including that in the maintenance period, if any, have been fulfilled by the Contractor. Previous entry on the works or taking possession, working or using thereof by the Trustees shall not relieve the Contractor of his obligations under the contract for full and final completion of the work. Certificate of final completion
- 9.3 On completion of the contract in the manner aforesaid, the Contractor may apply for the refund of his Security Deposit by submitting to the Engineer (I) The Treasury Receipts granted for the amount of Security held by the Trustees, and (ii) his “No further claim” Certificate in Form G.C.3 annexed hereto (in original), where upon the Engineer shall issue Certificate in Form G.C.2 and within two months of the Engineer’s recommendation, the Trustees shall refund the balance due against the Security Deposit to the Contractor, after making deduction therefrom in respect of any sum due to the Trustees from the Contractor. Refund of Security Deposit
- 10.0 INTERPRETATION OF CONTRACT DOCUMENTS, DISPUTES AND ARBITRATION
- 10.1 In all disputes, matters, claims, demands or questions arising out of or connected with the interpretation of the Contract including the meaning of Specifications, drawings, designs and instructions or as to the quality of workmanship or as to the materials used in the work or the execution of the work whether during the progress of the works or after the completion and whether before or after the determination, abandonment or breach of the contract the decision of the Engineer shall be final and binding on all parties to the contract and shall forthwith be given effect to by the Contractor. Engineer’s decision
- 10.2 If the Contractor be dissatisfied with any such decision of the Engineer, he shall within 15 days after receiving notice of such decision require that the matter shall be referred to Chairman, who shall thereupon consider and give a decision. Chairman’s award.
- 10.3 If, however, the Contractor be still dissatisfied with the decision of the Chairman, he shall within 15 days after receiving notice of such decision require that within 60 days from his written notice, the Chairman shall refer the matter to an Arbitrator of the panel of Arbitrators to be maintained by the Trustees for the purpose and any such reference shall be deemed to be a submission to arbitration within the meaning of Indian Arbitration Act, 1940 or any statutory modification thereof. Arbitration.
- 10.3.1. If the Arbitrator so appointed is unable or unwilling to act or resigns his appointment or vacates his office due to any reason whatsoever, another person from panel shall be appointed as Sole Arbitrator and he shall proceed from the stage at which his predecessor left it.



- 10.3.2** The Arbitrator shall be deemed to have entered on reference on the date he issues notice to both the parties fixing the date of first hearing.
- 10.3.3** The time limit within which the Arbitrator shall submit his award shall normally be 4 months as provided in Indian Arbitration Act, 1940 or any amendment thereof. The Arbitrator may, if found necessary, enlarge the time for making and publishing the award, with the consent of the parties.
- 10.3.4** The venue of the arbitration shall be either Calcutta or Haldia as may be fixed by the Arbitrator in his sole discretion. Upon every or any such reference the cost of any incidental to the reference and award respectively shall be in the discretion of the Arbitrator who may determine, the amount thereof or by whom and to whom and in what manner the same shall be borne and paid.
- 10.3.5** The Award of the Arbitrator shall be final and binding on all parties subject to the provisions of the Indian Arbitration Act 1940 or any amendment thereof. The Arbitrator shall give a separate award in respect of each item of disputes and respective claim referred to him by each party and give reason for the award.
- 10.3.6** The Arbitrator shall consider the claims of all the parties to the contract – within only the parameters of scope and conditions of the contract in question.
- 10.3.7** Save as otherwise provided in the contract the provisions of the Arbitration Act, 1940 and rules made thereunder, for the time being in force, shall apply to the arbitration proceedings under this Clause.
- 10.4** The Contractor shall not suspend or delay the work and proceed with the work with due diligence in accordance with Engineer's decision. The Engineer also shall not withhold any payment, which, according to him, is due or payable to the Contractor, on the ground that certain disputes have cropped up and are likely to be referred to arbitration.
- 10.5** Provided always as follows:
- [a] Nothing of the provisions in paragraphs 10.3 to 10.3.7 hereinabove would apply in the cases of contracts, where tendered amount appearing in the letter of acceptance of the tender / offer is less than Rs.40,00,000/-.
- [b] The Contractor shall have to raise disputes or differences of any kind whatsoever in relation to the execution of the work to the Engineer within 30 days from the date of occurrence of the cause of dispute and before the preparation of the final bill, giving detailed justifications, in the context of contract conditions.

- [c] Contractor's dispute if any arising only during the maintenance period, if any, stipulated in the contract, must be submitted to the Engineer, with detailed justification in the context of contract conditions, before the issuance of final completion certificate in Form G.C.-2 *ibid*.**  
**No dispute or difference on any matters whatsoever, the Contractor can raise pertaining to the Contract after submission of certificate in form G.C.3 by him.**
- [d] Contractor's claim / dispute raised beyond the time limits prescribed in sub-clauses 10.5[b] and 10.5 [c] hereinabove, shall not be entertained by the Engineer and / or by any Arbitrator subsequently.**
- [e] The Chairman / Trustees shall have the right to alter the panel of Arbitrators, vide Clause 10.3 hereinabove, on their sole discretion, by adding the names of new Arbitrators and / or by deleting the names of existing Arbitrators, without making any reference to the Contractor.**

(TO BE SUBMITTED WITH COVER- I OFFER)  
THE BOARD OF TRUSTEES FOR SMP, KOLKATA  
FORM OF TENDER (UNPRICED)

To  
The Chief Engineer  
Kolkata Dock System  
SMP,KOLKATA.

I/We \_\_\_\_\_

having examined the site of work, inspected the Drawings and read the specifications, General & Special Conditions of Contract and Conditions of the Tender, hereby tender and undertake to execute and complete all the works required to be performed in accordance with the Specification, Bill of Quantities, General & Special Conditions of Contract and Drawings prepared by or on behalf of the Trustees and at the rates & prices set out in the annexed Bill of Quantities within \_\_\_\_\_ months / weeks from the date of order to commence the work and in the event of our tender being accepted in full or in part. I / We also undertake to enter into a Contract Agreement in the form hereto annexed with such alterations or additions thereto which may be necessary to give effect to the acceptance of the Tender and incorporating such Specification, Bill of Quantities, Drawing and Special & General Conditions of Contract and I / We hereby agree that until such Contract Agreement is executed the said Specification, Bill of Quantities, Conditions of Contract and the Tender, together with the acceptance thereof in writing by or on behalf of the Trustees shall be the Contract.

THE TOTAL AMOUNT OF TENDER Rs. **NOT TO BE QUOTED IN COVER I OFFER**  
(Repeat in words) **NOT TO BE QUOTED IN COVER I OFFER**

I / We require \_\_\_\_\_ days / months preliminary time to arrange and procure the materials required by the work from the date of acceptance of tender before I We could commence the work.  
I / We have deposited with the Trustees’ FA&CAO, vide Receipt No. \_\_\_\_\_ of \_\_\_\_\_ as Earnest Money.  
I / We agree that the period for which the tender shall remain open for acceptance shall not be less than four months.

Dated:

(Signature of Bidder with Seal) \_\_\_\_\_

**WITNESS:**

Signature:

Name of the Bidder:

Name:

Address:

(In Block Letters)

Address:

Occupation:

SYAMA PRASAD MOOKERJEE PORT, KOLKATA  
KOLKATA DOCK SYSTEM  
FORM G.C.1

Contractor \_\_\_\_\_

Address -----  
-----

Date of completion: -

Dear sir(s),

This is to certify that the following work viz: -

Name of work: - .....  
.....  
.....

Estimate No. E.E.0.....Dt.....  
C.E.O.....Dt.....

Work Order No.....  
Allocation.....  
Contract No. ....

which was carried out by you is in the opinion of the undersigned complete in every respect on the \_\_\_\_\_ day of \_\_\_\_\_2021 in accordance with terms of the Contract and you are required to maintain the work as per Clause 62 of the General Conditions of Contract and under provisions of the Contract for a period of \_\_\_\_\_weeks / months / years

from the \_\_\_\_\_day of \_\_\_\_\_  
\_\_\_\_\_2021 to \_\_\_\_\_day of \_\_\_\_\_2021.

Yours faithfully,

Signature.....  
(ENGINEER/ENGINEER’S REPRESENTATIVE)  
Name.....  
Designation.....  
OFFICE SEAL

SYAMA PRASAD MOOKERJEE PORT, KOLKATA  
KOLKATA DOCK SYSTEM

FORM G.C.2.

Certificate of Final Completion.

The Financial Adviser & Chief Accounts  
Officer/The Manager (Finance), Haldia Dock  
Complex.

This is to certify that the following work viz: -

Name of work: .....

Estimate No. E.E.O.....dt.....  
C.E.O.....dt.....

Work Order No.....

Contract No. ....

Resolution & Meeting No. ....

Allocation: .....

which was carried out by Shri/Messrs..... is now complete in every respect in  
accordance with the terms of the Contract and that all obligations under the Contract have been fulfilled by  
the Contractor.

Signature.....  
(ENGINEER/ENGINEER’S REPRESENTATIVE)  
NAME.....  
DESIGNATION.....  
OFFICE SEAL

SYAMA PRASAD MOOKERJEE PORT, KOLKATA  
KOLKATA DOCK SYSTEM

FORM G.C.3

(NO CLAIM CERTIFICATE)

The  
CHIEF ENGINEER  
KOLKATA DOCK  
SYSTEM  
SMP,KOLKATA  
(Atten:.....  
.....

Dear Sir,

I / We do hereby declare that I / we have  
executed the following work viz: -

Name of work: - \_\_\_\_\_  
\_\_\_\_\_

Work Order No: - \_\_\_\_\_

Contract No. \_\_\_\_\_

Agreement No.....Dt.....

and I / we have no further claim against the SMP,KOLKATA in respect of the said work.

Yours faithfully,

(Signature of tenderer)  
Dated \_\_\_\_\_

Name of Contractor.....

Address:.....

(OFFICIAL SEAL OF THE CONTRACTOR)

## SYAMA PRASAD MOOKERJEE PORT, KOLKATA

PROFORMA OF FORM OF AGREEMENT

THIS AGREEMENT made \_\_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_ between the "Board Of Trustees for SYAMA PRASAD MOOKERJEE PORT,KOLKATA , a statutory body constituted under Major Port Trust Act ,1963 under the rules there under and statutory modification thereto having Registered Office at 15, Strand Road , KOLKATA -700001 (hereinafter called "EMPLOYER" which expression unless excluded by or repugnant to the context be deemed to include his successor/s in office) on the one part and \_\_\_\_\_ (hereinafter called the "CONTRACTOR" which expression shall unless excluded by or repugnant to the context he deemed to include his heirs, executors, administrators, representative, successor in officer and permitted assigns) of the other part.

WHEREAS The TRUSTEES are desirous that certain works should be executed viz \_\_\_\_\_ and have accepted a Tender/Offer by the contractor for the execution, completion and maintenance of such works.

NOW THIS CONTRACT AGREEMENT WITNESSETH as follows: -

1. In this agreement words expressions shall have the same meanings as are respectively assigned to them in General Conditions Of Contract, hereinafter referred to.
2. The following documents shall be deemed to form and be read and construed as part of this Agreement, viz: -
  - i. The said Tender/Offer & the acceptance of Tender/ Offer.
  - ii. The Drawings.
  - iii. The General Conditions Of Contract.
  - iv. Special Conditions Of Contract (If any).
  - v. The Conditions Of Tender.
  - vi. The Specifications.
  - vii. The Bill Of Quantities.
  - viii. All correspondences by which the contract is added, amended, varied or modified in any way by mutual consent.
3. In consideration of the payments to be made by the Trustees to the Contractor as hereinafter mentioned the contractor hereby covenant with the Trustees to execute, complete and maintain the work in conformity in all respects with the provisions of Contract.
4. The Trustees hereby covenants to pay to the contractor in consideration of such execution, completion and maintenance of the works the Contract Prices at the times and in the manner prescribed by the contractor.

IN WITNESS whereof the parties hereto have caused their respective Common Seals to be hereunto as fixed (or have set their respective hands and seals) the day and year first above written. have executed these presents on the day and year first above written.

The Seal of \_\_\_\_\_

Was hereunto affixed in the presence of: -

Name: - \_\_\_\_\_

Address: - \_\_\_\_\_

OR

SIGNED SEALED AND DELIVERED

By the said \_\_\_\_\_

In the presence of: -

Name: - \_\_\_\_\_

Address: - \_\_\_\_\_

The Common Seal of the Trustees was hereunto affixed in the presence of: -

Name: - \_\_\_\_\_

Address: - \_\_\_\_\_



**Proforma Of Irrevocable Bank Guarantee (PERFORMANCE BOND) in lieu of cash Security Deposit, to be issued by the Kolkata/ Haldia Branch, as the case may be, of any nationalised Bank of India on Non-Judicial Stamp Paper worth Rs 50/- or as decided by the Engineer/ Legal Adviser of the Trustees.**

Ref. \_\_\_\_\_ Bank Guarantee No. \_\_\_\_\_  
Date \_\_\_\_\_

To  
The Board of Trustees  
SYAMA PRASAD MOOKERJEE PORT,KOLKATA  
15, Strand Road  
Kolkata – 700 001

Dear Sirs,

In consideration of the Board of Trustees ,SYAMA PRASAD MOOKERJEE PORT, Kolkata, - (hereinafter referred to as the “ EMPLOYER” which expression shall unless repugnant to the context or meaning thereof include its successors administrators and assigns) having awarded to \_\_\_\_\_, with registered office at \_\_\_\_\_ (hereinafter referred to as the “CONTRACTOR “ which expression shall unless repugnant to the context or meaning thereof, include its successors, administrators, executors and assigns) a CONTRACT by issue of EMPLOYER’S work order dated\_\_\_\_\_the same having been unequivocally accepted by the Contractor resulting in a ‘CONTRACT’ bearing Letter Of Award No \_\_\_\_\_ dated \_\_\_\_\_ Valued at Rs \_\_\_\_\_ for “ \_\_\_\_\_” and the contractor having agreed to prove a Contract performance Guarantee for the faithful performance of the entire Contract equivalent to Rs. \_\_\_\_\_ (Rupees \_\_\_\_\_ only) to the EMPLOYER.

We, the \_\_\_\_\_ Bank, \_\_\_\_\_, Kolkata/ Haldia having its Head Office at \_\_\_\_\_ (hereinafter referred to as the “Bank”, which expression shall unless repugnant to the context or meaning thereof, include its successors, administrators, executors and assigns) do hereby guarantee and undertake to pay the Employer on demand any and all monies payable by the Contractor to the extent of Rs. -( \_\_\_\_\_ only) as aforesaid at any time upto \_\_\_\_\_ without any demur, reservation, contest, recourse or protest an/or without any reference to the CONTRACTOR, Any such demand made by Employer on the Bank shall be conclusive and binding notwithstanding any difference between EMPLOYEER and CONTRACTOR or any dispute pending before any Court, tribunal, Arbitrator or any other Authority. The Bank undertakes not to revoke this guarantee during its currency without previous consent of employer and further agrees that the guarantee herein contained shall continue to be enforceable till the Employer discharges his guarantee.

EMPLOYER shall have the fullest liberty without affecting in any way the liability of the Bank under this guarantee from time to time to extend the time for performance of the CONTRACT by CONTRACTOR. Employer shall have the fullest liberty, without affecting this guarantee, to postpone from time to time the exercise of any powers vested in them or any right which they might have against Contractor, and to exercise the same at any time in any manner, and other to enforce or to forebear to enforce any covenants, contained or implied, in the CONTRACT between EMPLOYER and CONTRACTOR or any other course of remedy or security available to EMPLOYER . The Bank shall not be released of its obligations under these presents by any exercise by EMPLOYER of its liberty with reference to the matters aforesaid or any of them or by reason or any other acts of omission or commission on the part of employer or any other indulgence shown by EMPLOYER or by any other matter or thing whatsoever which under Law would, but for this provision, have the effect of reliving the bank.

The Bank also agreed that EMPLOYER at its option shall be entitled to enforce this Guarantee against the Bank as principal debtor, in the first instance without proceeding against CONTRACTOR and notwithstanding any security or other guarantee that EMPLOYER may have in relation to the CONTRACTOR’S liabilities.

Notwithstanding anything contained herein above our liability under this guarantee is restricted to Rs \_\_\_\_\_ (rupees \_\_\_\_\_ only) and it shall remain in force up to and including \_\_\_\_\_ and shall be extended from time to time for such period, on whose behalf this guarantee has been given.

Dated, this \_\_\_\_\_ day of \_\_\_\_\_, 2021 \_\_\_\_\_ at \_\_\_\_\_

WITNESSES

_____	_____
(Signature)	(Signature)
_____	_____
(Name)	(Name)
_____	_____
(Official address)	(Designation with Bank Stamp)
	+ Attorney as per power of Attorney No.

## **SECTION- 4**

### **SPECIAL CONDITIONS OF CONTRACT**

**A. GENERAL:**

- 1. Definitions**
- 2. Interpretation**
- 3. Language and Law**
- 4. Nodal Office or his Nominee**
- 5. Delegation**
- 6. Communications**
- 7. Joint Venture**
- 8. Sub-Contracting**
- 9. Personnel–Contract Representative**
- 10. Employer’s and Contractor’s Risks**
- 11. Employer’s Risks**
- 12. Contractor’s Risks**
- 13. Insurance**
- 14. Site investigation reports**
- 15. Queries about the Contract data**
- 16. Contractor to construct the works**
- 17. The works to be completed by the intended completion date**
- 18. Approval by the Engineer-in-charge (Nodal Officer) or his nominee**
- 19. Safety**
- 20. Discoveries**
- 21. Possession of site**
- 22. Access to site**
- 23. Instructions**
- 24. Disputes**
- 25. Settlement of Disputes**

**B. TIME CONTROL:**

- 26. Program**
- 27. Extension of the intended completion date**
- 28. The Early warning provisions**
- 29. Delay ordered by the Engineer in  
charge (Nodal Officer) or his  
nominee**
- 30. Management meetings**
- 31. Early warning**

**C. QUALITY CONTROL:**

- 32. Identify defects**
- 33. Tests**
- 34. Correction of defects**
- 35. Uncorrected defects**

**D. COST CONTROL:**

- 36. Schedule of Payments**
- 37. Payment certificates**
- 38. Payments**
- 39. Tax**
- 40. Currencies**
- 41. Retention**
- 42. Liquidate damages**
- 43. Advance payment**
- 44. Performance Securities**
- 45. Cost of repairs**

**E. FINISHING THE CONTRACT:**

- 46. Completion**
- 47. Taking over**
- 48. Final Account**
- 49. Operating and Maintenance Manuals**
- 50. Termination**
- 51. Payment upon termination**
- 52. Property**
- 53. Release from performance**

**F. EXTRA CONDITIONS OF CONTRACT:**

- 54. Labour**
- 55. Compliance with labour Regulations**

**G. SPECIAL INSTRUCTION TO BIDDER**

- 56. Dock Permit**

## A. General

**1. Definitions:** GAD – General Arrangement Drawing, ITB - Instructions to Bidders, PMC - Project Management Consultants, SMPK –SYAMA PRASAD MOOKERJEE PORT,KOLKATA; KOPT means KOLKATA PORT TRUST;BOT means “Board of Trustees”; EIC means Engineer –In-Charge ;  
GCC means General Conditions of Contract

Terms which are defined in the Contract Data are not also defined in the Conditions of Contract but keep their defined meanings. Capital initials are used to identify defined terms.

**Events** are those defined in the Bidding Document

The **Completion Date** is the date of completion of the Works as certified by the Engineer-in-charge (Nodal Officer) or his nominee in accordance with the Bidding Document

The **Contract** is the contract between the Employer and the Contractor to execute, complete and maintain the Works. It consists of the documents listed in Clause2 below.

The **Contract Data** defines the documents and other information which comprise the Contract.

The **Contractor** is a person or corporate body whose Bid to carry out the works has been accepted by the Employer.

The **Contractor's Bid** is the completed Bidding documents submitted by the Contractor to the Employer.

The **Contract Price** is the price stated in the letter of acceptance and thereafter as adjusted in accordance with the provisions of the Contract.

Days are calendar days, months are calendar months.

A **Defect** is any part of the Works not completed in accordance with the Contract.

The **Defects Liability Period** is the period mentioned in the Contract Data and calculated from the date of Completion of the work.

The **Employer** is the party who will employ the Contractor to carry out the Works.

The **Engineer-in-charge** (Nodal Officer) or his nominee is the person named in the Contract Data (or any other competent person appointed and notified to the contractor to act in place of the Engineer- in-charge or his nominee who is responsible for supervising the work, administering the Contract, certifying payments due to the Contractor, issuing and valuing Variations to the Contract, awarding extensions of time and valuing the other Events.

**Equipment** is the Contractor's machinery and vehicles brought temporarily to the Site to execute the Works.

The **Initial Contract Price** is the Contract Price listed in the Employer's Letter of Acceptance.

The **Intended Completion Date** is the date on which it is intended that the Contractor shall complete the works. The Intended Completion Date is specified in the Contract Data. The Intended Completion Date may be revised only by the Engineer-in-charge (Nodal Officer) or his nominee by issuing an extension of time.

**Material** are all supplies, including consumables, used by the contractor for execution of the Works.

**Plant** is an integral part of the Works which is required for the work and brought at site of work by the contractor.

The **Site** is the area defined in the Contract Data.

**Site Investigation Reports** are those, which are included in the Bidding documents and are factual interpretative reports about the surface and sub-surface conditions at the site.

**Specification** means the Specification of the Works included in the Contract and any modification or addition made are to be approved by the Engineer-in-charge (Nodal Officer) or his nominee.

The **Start Date** is given in the Contract Data. It is the date when the Contractor shall commence execution of the works. It does not necessarily coincide with any of the Site Possession Date.

A **Subcontractor** is a person or corporate body who has a Contract with the Contractor to carry out a part of the work in the Contract which includes work on the Site.

**Temporary Works** are works designed, constructed, installed and removed by the Contractor to facilitate the main work which are needed for construction or installation and subsequently removed by the contractor after completion of the main work.

A **Variation** is an instruction given by the Engineer-in-charge (Nodal Officer) or his nominee which varies the Works.

The **Works** are what the Contract requires from the Contractor to construct, install as defined in the Contract Data.

The **Trained Work Person** are those employed / proposed to be employed by the Contractor at the Project Site, who have participated and are in possession of a valid Competency Certificate through a programme run under the auspices of a University, State Technical Board, Ministry of Government of India.

## 2. Interpretation

In interpreting these Conditions of Contract, singular also means plural, male also means female or neuter and the other way around. Headings have no significance. Words have their normal meaning under the language of the Contract unless specifically defined. The Engineer-in-charge (Nodal Officer) or his nominee will provide Instructions clarifying queries about the Conditions of Contract.

The documents forming the Contract shall be interpreted in the following order of priority:

- (1) Agreement
- (2) Letter of Acceptance and notice to proceed with works Contractor's Bid
- (3) Contract Data
- (4) Conditions of Contract including Special Conditions of Contract
- (5) Specifications
- (6) Drawings
- (7) Bill of quantities
- (8) Any other documents listed in the Contract Data as forming part of the Contract.

## 3. Language and Law

The language of the Contract and the law governing the Contract are stated in the Contract Data.

#### **4. Engineer-in-charge (Nodal Officer) or his nominee's Decisions**

Except where otherwise specifically stated, the Engineer-in-charge (Nodal Officer) or his nominee will decide contractual matters between the Employer and the Contractor in the role representing the Employer.

#### **5. Delegation**

The Engineer-in-charge (Nodal Officer) or his nominee may delegate any of the duties and responsibilities to other nominated people after notifying the Contractor and may cancel any delegation after notifying the Contractor.

#### **6. Communications**

Communications between parties which are referred to in the conditions are effective only when in writing. A notice shall be effective only when it is delivered (in terms of Indian Contract Act 1872).

#### **7. Joint Venture**

Refer ITB

#### **8. Sub-contracting**

The Contractor may sub-contract with the approval of the Engineer-in-charge (Nodal Officer) or his nominee but may not assign the Contract without the approval of the Employer in writing. Subcontracting does not alter the Contractor's obligations.

#### **Other Contractors**

The Contractor shall co-operate and share the Site with other contractors, public authorities, utilities, and the Employer between the dates given in the Schedule of other contractors. The Contractor shall as referred to in the Contract Data, also provide facilities and services for the works described in the Schedule. The employer may modify the schedule of other contractors and shall notify the contractor of any such modification.

#### **9. Personnel**

The Contractor shall employ the key personnel named in the Schedule of Key Personnel as referred to in the Contract Data to carry out the functions stated in the Schedule or other personnel approved by the Engineer-in-charge (Nodal Officer) or his nominee. The Engineer-in-charge (Nodal Officer) or his nominee will approve any proposed replacement of Key personnel only if their qualifications, abilities, and relevant experience are substantially equal to or better than those of the personnel listed in the Schedule.

If the Engineer-in-charge (Nodal Officer) or his nominee asks the Contractor to remove a person who is a member of the Contractor's staff of his work force stating the reasons, the Contractor shall ensure that the person leaves the Site within seven days and he should not have any further connections with the work in the Contract.

#### **10. Employer's and Contractor's Risks**

The Employer carries the risks which this Contract states are Employer's risks and the Contractor carries the risks which this Contract states are Contractor's risks.



## 11. Employer's Risks

The Employers risks are,

In so far as they directly affect the execution of the Works in the country where the Permanent Works are to be executed:

- (1) War and hostilities (whether war be declared or not), invasion, act of foreign enemies;
- (2) Rebellion, revolution, insurrection, or military or usurped power, or civil war;
- (3) Ionizing radiations, or contamination by radio activity from any nuclear fuel, or from any nuclear waste, from the combustion of nuclear fuel, radio active toxic explosive or other hazardous properties of any explosive nuclear assembly or nuclear component thereof;
- (4) Pressure waves caused by aircraft or other aerial devices travelling at sonic or supersonic speeds; and
- (5) Riot, commotion or disorder, unless solely restricted to the employees of the Contractor or of his Sub contractors and arising from the conduct of the Works;
- (6) Floods, tornadoes, earthquakes and land slides
- (7) Loss or damage due to the use or occupation by the Employer of any Section or part of the Permanent Works, except as may be provided for in the Contract;
- (8) Loss or damage to the extent that it is due to the design of the Works, other than any part of the design provided by the Contractor or for which the Contractor is responsible; and
- (9) Any operation of the forces of nature (in so far as it occurs on the Site) during progress of work.
- (10) could not have reasonably foreseen, or
- (11) could reasonably have foreseen, but against which he could not reasonably have taken at least one of the following measures:
  - ® Prevent loss or damage to physical property from occurring by taking appropriate measures,
  - or
  - ® Insure against.

## 12. Contractor's Risks

All risks of loss of or damage to physical property and of personal injury and death which arise during and in consequence of the performance of the Contract are the responsibility of the Contractor.

## 13. Insurance

The Contractor shall provide in the joint names of the Employer and the Contractor, insurance cover from the Start Date to the end of the Defects Liability Period, in the amounts and

Deductibles stated in the Contract Data for the following events which are due to the Contractors' risks.

- a. Loss of or damage to the Works, Plant and Materials
  - b. Loss of or damage to Equipment;
  - c. Loss of or damage of property (except for Plant, Materials and Equipment supplied by the contractor for work) in connection with the Contract;
- and
- d. Personal injury or death.

Policies and certificates for insurance shall be submitted by the Contractor to the Engineer-in-charge (Nodal

Officer) or his nominee for the Engineer-in-charge (Nodal Officer) for his approval before the Start Date. All such insurances shall provide for compensation to be payable required to compensate the loss or damage incurred.

If the Contractor does not provide any of the policies and certificates required, the Employer may effect the insurance which the Contractor should have provided and recover the premiums the Employer has paid from payments otherwise due to the Contractor or, if no payment is due, the payment of the premiums shall be a debt due.

Alterations to the terms of an insurance shall not be made without the approval of the Engineer-in-charge (Nodal Officer) or his nominee.

Both parties shall comply with all conditions of the insurance policies.

#### **14. Site Investigation Reports**

The contractor, in preparing the bid, shall visit the site, rely on the site condition &, on the Site information referred to in the Contract Data, supplemented by any information available to the Bidder regarding site.

#### **15. Queries about the Contract Data.**

The Engineer-in-charge (Nodal Officer) or his nominee will clarify queries on the Contract Data.

#### **16. Contractor to Construct the Works.**

The Contractor shall construct and install the Works in accordance with the detailed technical data, Specifications and Drawings provided in Contract Data based on which Engineering to be made and after approval of the Design & Drawings by the client/PMC, construction of the project to be executed.

#### **17. The Works to Be Completed by the Intended Completion Date.**

The Contractor shall commence execution of the Works on the Start Date and shall carry out the Works in accordance with the program submitted by the Contractor as updated with the approval of the Engineer-in-charge (Nodal Officer) or his nominee, and complete them by the Intended Completion Date. The Contractor shall be responsible for detail Engineering and construction.

Approval of Client/PMC shall not alter the Contractor's responsibility for the design of the project.

#### **18. Approval by the Engineer-in-charge (Nodal Officer) or his nominee.**

The Contractor shall also submit Specifications and Drawings showing the proposed Temporary Works to facilitate main work to the Engineer-in-charge (Nodal Officer) or his nominee, who will approve them if they comply with the Specifications and Drawings.

The Contractor shall be responsible for design of all aforesaid temporary works.

The Engineer-in-charge (Nodal Officer) or his nominee's approval shall not alter the Contractor's responsibility for design of the Temporary Works.

All Drawings prepared by the Contractor for the execution of the temporary or permanent Works, are subject to prior approval by the Engineer-in-charge (Nodal Officer) or his nominee before their use.

#### **19. Safety.**

The Contractor shall be responsible for the safety of all activities on the Site.

#### **20. Discoveries.**

Anything of historical or other interest or of significant value unexpectedly discovered on the Site is the property of the Employer. The Contractor is to notify the Engineer-in-charge (Nodal Officer) or his nominee of such discoveries and carryout the Engineer-in-charge (Nodal Officer) or his nominee's instructions for dealing with them.

## 21. Possession of the Site.

The Employer shall give possession of all parts of the Site to the Contractor, free from encumbrances. If possession of a part is not given by the date stated in the Contract Data the Employer is deemed to have delayed the start of the relevant activities and necessary extension of time in this regard will be given.

## 22. Access to the Site

The Contractor shall allow the Engineer-in-charge (Nodal Officer) or his nominee and any person authorized by the Engineer-in-charge (Nodal Officer) or his nominee access and PMC team to the Site to any place where work in connection with this Contract is being carried out or is intended to be carried out and to any place where materials or plant are being manufactured, fabricated and/or assembled for the subject works.

## 23. Instructions the Contractor shall carry out all instructions of the Engineer-in-charge (Nodal Officer) or his nominee which comply with the applicable laws where the Site is located.

## 24. Disputes

Any dispute during contract period will be governed by Clause no.10 of GCC.

## 25. Settlement of Disputes

In the event of disputes between the contractor and the Board of Trustees in a contract, the same will be dealt as under except where otherwise provided in contract, all questions and disputes relating to the meaning of the specifications, designs, drawings and instructions where in before mentioned and as to the quality of workmanship or materials used on the work or as to any other questions of claim, right, matter or thing whatsoever, in anyway, arising out of, relating to the contract, designs, drawings specifications or otherwise concerning the works or the execution or failure to execute the same, whether arising during the progress of the work or after the completion or abandonment thereof, shall be referred to arbitral tribunal with Sole Arbitrator as follows:

**The selection and appointment of the arbitrator shall be made by SMPK from a panel of Arbitrator.**

Settlement of Disputes is also governed by Clause no.10 of GCC

## B. TIME CONTROL

### 26. Program

Within the time stated in the Contract Data the Contractor shall submit to the Engineer-in-charge (Nodal Officer) or his nominee for approval a Program showing the general methods, arrangements, order, and timing for all the activities in the works along with monthly cash-flow forecast.

An update of the Program shall be a program showing the actual progress achieved on each activity and the effect of the progress achieved on the timing of the remaining work including any changes to the sequence of the activities.

The Contractor shall submit to the Engineer-in-charge (Nodal Officer) or his nominee, for approval an updated Program at intervals no longer than the period stated in the Contract Data. If the Contractor does not submit an updated Program within this period, the Engineer-in-charge (Nodal Officer) or his nominee may withhold the amount stated in the Contract Data from the next payment certificate and continue to withhold this amount until the next payment after the date on which the overdue Program has been submitted.

The Engineer-in-charge (Nodal Officer) or his nominee's approval of the Program shall not alter the Contractor's obligations. The Contractor may revise the Program and submit it to the Engineer-in-charge (Nodal Officer) or his nominee again at any time to expedite the progress of work in the project. A revised Program is to show the effect of Variations for the benefit and progress of the project.

**27. Extension of the Completion**

If the Contractor shall desire an extension of time for completion of the work on the grounds of his having been unavoidably hindered during execution or on any other grounds, he shall apply in writing to the Competent Authority within 30 days of the date of hindrance on account of which he desires such extension as aforesaid and the Competent Authority shall if in his opinion, the ground of extension of time prayed for is reasonable, therefore, he may grant extension of time on same contract terms, as the cause in his opinion is correct and extension is required for smooth completion of the project without any extra benefits on that ground.

**28.** The Early warning provisions shall be as per Clause 31.

**29. Delays Ordered by the Engineer-in-charge (Nodal Officer) or his nominee**

The Engineer-in-charge (Nodal Officer) or his nominee may instruct the Contractor to delay the start or progress of any activity within the Works at any time.

**30. Management Meetings**

Either the Engineer-in-charge (Nodal Officer) or his nominee or the Contractor may require the other to attend a management meeting with PMC. The business of a management meeting shall be to review the plans of work, plans for remaining work and to deal with matters raised in accordance with the early warning procedure.

The Engineer-in-charge (Nodal Officer) or his nominee shall record the business of management meetings and is to provide copies of his record to those attending the meeting. The responsibility of the parties for actions to be taken is to be decided by the Engineer-in-charge (Nodal Officer) or his nominee either at the management meeting or after the management meeting and stated and communicated in writing to all who attended the meeting.

**31. Early Warning**

The Contractor is to warn the Engineer-in-charge (Nodal Officer) or his nominee at the earliest opportunity of specific likely future events or circumstances that may adversely affect the quality of the work or delay the execution (progress) of works. The Engineer-in-charge (Nodal Officer) or his nominee may require from the Contractor to provide in detail the reasons for such unexpected events.

The Contractor shall cooperate with the Engineer-in-charge (Nodal Officer) or his nominee in making and considering proposals for how to deal with such an event or expected circumstance can be avoided and take a judicious decision jointly involving PMC team to carry out the work smoothly to maintain the progress and any resulting instruction of the Engineer-in-charge (Nodal Officer) or his nominee will be communicated to the contractor.

**C. QUALITY CONTROL****32. Identify Defects**

The Engineer in charge (Nodal Officer) or his nominee or PMC team shall check the Contractor's work and notify the Contractor of any Defects that are found. Such checking shall not affect the Contractor's responsibilities for timely completion of the work. The Engineer-in-charge (Nodal Officer) or his nominee or PMC may instruct the Contractor to search for a Defect and to uncover and test any work that they consider may have a Defect.

**33. Tests**

If the Engineer-in-charge (Nodal Officer) or his nominee or PMC instructs the Contractor to carry out a test to check whether any work the Contractor shall comply with that instruction and arrange for that test to satisfy them to ensure quality of work.

**34. Correction of Defects**

The Engineer-in-charge (Nodal Officer) or his nominee or PMC shall give notice to the Contractor of any Defects before the end of the Defects Liability Period, which begins at Completion and is defined in the Contract Data. The Defects Liability Period shall be extended for as long as Defects remain to be corrected.

Every time notice of a Defect is given the Contractor shall correct the notified Defect within the length of time specified by the Engineer-in-charge (Nodal Officer) or his nominee's notice.

**35. Uncorrected Defects.**

If the Contractor has not corrected a Defect within the time specified in the Engineer-in-charge (Nodal Officer) or his nominee's notice the Engineer-in-charge (Nodal Officer) or his nominee will assess the cost of having the Defect corrected, and the Contractor will pay this amount failing which same will be recovered from their due.

**D. COST CONTROL**

**36. Schedule of payment**

The schedule of payment shall contain items for the construction, supply, installation, testing and commissioning of work to be done by the Contractor.

The Contractor will be paid on percentage basis as mentioned in the break up of lump sum rate to be submitted item wise (to be accepted by SMPK Authority during tender finalization stage) as Schedule of payment for each completed item of the work after certified by the PMC and subsequent acceptance of Engineer in charge or his representative.

**37. Payment Certificates.**

The Contractor shall submit to the Engineer-in-charge (Nodal Officer) or his nominee monthly statements of the estimated value of the work completed less the cumulative amount certified previously.

The PMC shall check the Contractors' monthly statement (measurement of works) within 7 days and forward it to the Engineer in Charge or his nominee on the basis of which contractor will raise the bill and Directly submitted to the Engineer in Charge or his nominee who will certify the amount to be paid to the Contractor considering all factors as per terms and conditions of the tender and forward the same to Finance wing of SMPK for payment.

The final value of work executed and forwarded for payment (amount) in each bill shall be determined by the Engineer-in-charge (Nodal Officer) or his nominee. PMC has no roll on this.

The Engineer-in-charge (Nodal Officer) or his nominee may exclude any item certified in a previous certificate or reduce the proportion of any item previously certified in the light of later information gathered by him in later date..

**38. Payments**

Joint measurements along with authorized representative of SMPK shall be taken continuously by the contractor and need not to be connected with billing stage. System of 4 copies of measurements, one each for Contractor, Employer and Engineer-in-charge (Nodal Officer) or his nominee and PMC. Bills (GST Invoice) shall be prepared and submitted by the Contractor after signing to the Engineer-in-charge (Nodal Officer) or his nominee.

75% of bill amount may be paid within 14 days of submission of the bill. Balance amount of the verified bill may be paid within 28 days of the submission of the bill.

Contractor shall submit final Bill within 60 days of issue of defects liability certificate. Client's Engineer-in-charge (Nodal Officer) or his nominee shall check the bill within 60 days after its receipt and return the bill to Contractor for corrections, if any. 50% of undisputed amount shall be paid to the Contractor at the stage of returning the bill.

The contractor should re-submit the bill, with corrections within 30 days of its return by the Engineer-in-charge (Nodal Officer) or his nominee. There-submitted bill shall be checked and paid within 60 days of its receipt.

As it is a **Lumpsum** contract there is no scope of payment of any extra-excess works unless otherwise instructed and communicated in writing by the Engineer in charge during validity of the contract.

So no payment for any extra-excess work will be entertained in this contract in general Unless otherwise specifically instructed by the Engineer-In-Charge and communicated through written instruction.

### 39. Tax

The rates quoted by the Contractor shall be deemed to be inclusive of all taxes and duties except GST that the Contractor will have to pay for the performance of this Contract. The Employer will perform such duties in regard to the deduction of such taxes at sources as per applicable law. GST will be given by SMPK as per prevailing rate.

### 40. Currencies

All payments shall be made in Indian Rupees.

### 41. Retention

The Employer shall retain SD from each payment, due to the Contractor the proportion stated in the Contract Data and GCC until Completion of the whole work.

Retention Money shall be deducted as per relevant clause 3.4 & 3.5 of GCC. Retention SD money shall be refunded after completion of maintenance period as per clause 9.3 of GCC

Performance Guarantee of 10% will be retained upto completion of Defect Liability Period and thereafter refunded.

### 42. Liquidated Damages

In case of delay in completion of the contract, liquidated damages (L.D) will be levied at the rate of half percent (1/2 %) of the contract value per week of delay or part thereof subject to a maximum of 10 percent of the contract price and it will be governed by clause 8.2(a) & (b) of GCC.

- The owner, if satisfied, that the works can be completed by the contractor within a reasonable time after the specified time for completion, may allow further extension of time at its discretion with or without the levy of L.D. In the event of extension granted being with L.D., the owner will be entitled without prejudice to any other right or remedy available in that behalf, to recover from the contractor's bill as agreed damages equivalent to half percent (1/2 %) of the contract value of the works for each week or part of the week subject to the ceiling.
- The owner, if not satisfied that the works can be completed by the contractor and in the event of failure on the part of the contractor or to complete work within further extension of time allowed as aforesaid, shall be entitled, without prejudice to any other right, or remedy available in that behalf, to rescind the contract.
- The owner, if not satisfied with the progress of the contract and in the event of failure of the contractor to recoup the delays in the mutually agreed time frame, shall be entitled to terminate the contract.
- In the event of such termination of the contract as described in clauses 8.3 of GCC or both, the owner shall be entitled to recover L.D. upto ten percent (10%) of the contract value and forfeit the security deposit made by the contractor besides getting the work completed by other means at the risk and cost of the contractor.
- The ceiling of LD shall be ten percent (10 %) of the project cost in turnkey contracts.

### 43. Advance payment

There is no provision of Advance Payment in the subject contract.

**44. Performance Securities:** For detail of Security Deposit(SD)Refer Clause No. -3.4.(f),(g)(h)(i)& 3.5 & 3.6 of GCC

**45. Cost of Repairs**

Loss or damage to the Works or Materials to be incorporated in the Works between the Start Date and the end of the Defects Correction period shall be remedied by the Contractor at the Contractor's cost if the loss or damage arises from the Contractor's acts or omissions.

**E. FINISHING THE CONTRACT.**

**46. Completion**

After completion of the work, the contractor will intimate through a written notice to the Engineer-in-charge (Nodal Officer) or his nominee/Employer to this effect. The Engineer-in-charge (Nodal Officer) or his nominee/Employer &PMC upon receipt of this notice shall conduct a complete joint survey of the work within 7 days and prepare a defects list jointly. The defects pointed out by the Engineer-in-charge (Nodal Officer) or his nominee/Employer would be rectified by the contractor within 14 days and there after acceptance report be signed jointly by the contractor and the Employer. This joint acceptance report shall be treated as 'Completion Certificate'.

**47. Taking Over**

The Employer shall take over the Site and the Works within seven days of the Engineer-in-charge (Nodal Officer) or his nominee issuing a certificate of Completion.

**48. Final Account**

The Contractor shall supply to the Engineer in charge (Nodal Officer) or his nominee a detailed account of the total amount that the Contractor considers payable under the Contract before the end of the Defects Liability Period. The Engineer-in-charge (Nodal Officer) or his nominee shall issue a Defects Liability Certificate and certify any final payment that is due to the Contractor within 60 days of receiving the Contractor's account if it is correct and complete. If it is not, the Engineer-in-charge (Nodal Officer) or his nominee shall issue within 15 days a schedule that states the scope of the corrections or additions that are necessary for the correction and certify payment of 50% of the undisputed amount to the contractor. If the Final Account is still unsatisfactory after it has been re-submitted by the contractor the Engineer-in-charge (Nodal Officer) or his nominee shall decide on the amount payable to the Contractor and issue a payment certificate, within 60 days of receiving the Contractor's revised account.

**49. Operating and Maintenance Manuals**

"As built" Drawings in both hard and soft format are required to be submitted by the and shall supply them by the dates stated in the Contract Data before handing over of site by the contractor to the client.



If the Contractor does not supply the Drawings and/or manuals by the dates stated in the Contract Data, or they do not receive the Engineer-in-charge (Nodal Officer) or his nominee's approval, the Engineer-in-charge (Nodal Officer) or his nominee shall withhold the amount stated in the Contract Data from payments due to the Contractor.

## **50. Termination**

The Employer or the Contractor may terminate the Contract if the other party causes a fundamental breach of the Contract.

Fundamental breaches of Contract include, but shall not be limited to the following:

- (a) The Contractor stops work for 28 days when no stoppage of work is shown on the current Program and the stoppage has not been authorised by the Engineer-in-charge (Nodal Officer) or his nominee: The Engineer-in-charge (Nodal Officer) or his nominee instructs the Contractor to delay the progress of the Works and the instruction is not withdrawn within 28 days.
- (b) The Employer or the Contractor becomes bankrupt or goes into liquidation .
- (c) A payment certified by the Engineer-in-charge (Nodal Officer) or his nominee is not paid by the Employer to the Contractor within 60 days from the date of the Engineer-in-charge (Nodal Officer) or his nominee's certification.
- (d) The Engineer-in-charge (Nodal Officer) or his nominee gives notice to correct a particular ,which is a fundamental breach of Contract and the Contractor fails to correct it within a reasonable period of time determined by the Engineer-in-charge (Nodal Officer) or his nominee.
- (e) The Contractor does not maintain a security and safe working procedure, which is required for safety the work at site.
- (f) If the Contractor, in the judgment of the Employer has engaged in corrupt or fraudulent practices in competing for or in the executing the Contract.
- (g) If the contractor has contravened clauses mentioned in Bidding Document.
- (h) Clauses 8.3 of GCC will be also applicable

When either party to the Contract gives notice of a breach of contract to the Engineer-in-charge (Nodal Officer) or his nominee for a cause other than those listed above, the Engineer-in-charge (Nodal Officer) or his nominee shall decide whether the breach is fundamental or not.

Notwithstanding the above, the Employer may terminate the Contract for convenience subject to payment of compensation to the contractor including loss of profit on uncompleted works. Loss of profit shall be calculated on the same basis as adopted for calculation of extra/additional items.

If the Contract is terminated the Contractor shall stop work immediately, make the Site safe and secure and leave the Site as soon as reasonably possible.

**51. Payment upon Termination.**

If the Contract is terminated because of a fundamental breach of Contract by the Contractor, the Engineer-in-charge (Nodal Officer) or his nominee shall issue a certificate for the value of the work done less payments received upto the date of the issue of the certificate, less other recoveries due in terms of the contract, less taxes due to be deducted at source as per applicable law and less the percentage to apply to the work not completed as indicated in the Contract Data. Additional Liquidated Damages shall not apply. If the total amount due to the Employer exceeds any payment due to the Contractor, the difference shall be a debt payable to the Employer.

If the Contract is terminated at the Employer's convenience or because of a fundamental breach of Contract by the Employer, the Engineer-in-charge (Nodal Officer) or his nominee shall issue a certificate for the value of the work done, the reasonable cost of removal of Equipment repatriation of the Contractor's personnel employed solely on the Works, and the Contractor's costs of protecting and securing the Works and loss of profit on uncompleted works less payments received upto the date of the certificate, less other recoveries due in terms of the contract and less taxes due to be deducted at source as per applicable law.

**52. Property**

All materials on the Site, Plant, Equipment, Temporary Works and Works for which payment has been made to the contractor by the Employer, are deemed to be the property of the Employer, if the Contract is terminated because of a Contractor's default.

**53. Release from Performance.**

If the Contract is frustrated by the outbreak of war or by other event entirely outside the control of either the Employer or the Contractor, the Engineer-in-charge (Nodal Officer) or his nominee shall certify that the Contract has been frustrated. The Contractor shall leave the Site and stop work as quickly as possible after receiving this certificate and shall be paid for all work carried out before receiving it and for any work carried out afterwards to which commitment was made.

**F. EXTRA CONDITIONS OF CONTRACT****54. LABOUR**

The Contractor shall, unless otherwise provided in the Contract, make his own arrangements for the engagement of all staff and labour, local or other, and for their payment, housing, feeding and transport & other incidental costs.

The Contractor shall, if required by the Engineer-in-charge (Nodal Officer) or his nominee, submit to the Engineer-in-charge (Nodal Officer) or his nominee a list in detail, in such form and at such intervals as the Engineer-in-charge (Nodal Officer) or his nominee may prescribe, showing the staff and the numbers of the several classes of labour from time to time employed by the Contractor on the Site and such other information as the Engineer-in-charge (Nodal Officer) or his nominee may require.

**55. COMPLIANCE WITH LABOUR REGULATIONS:**

During continuance of the contract, the Contractor and his sub-contractors shall abide by at all times all existing labour enactment and rules made there under, regulations, notifications and by laws of the State or Central Government or local authority and any other labour law (including rules) regulations, by laws that may be passed or notification that may be issued under any labour law in future either by the State or Central Government or the local authority. Salient features of some of the major labour laws that are applicable to construction industry are given below. The Contractor shall keep the Employer indemnified in case any action is taken against the Employer by the Appropriate Authority on account of contravention of any of the provisions of any Act or rules made there under, regulations or notifications including amendments. If the Employer is caused to pay or reimburse such amounts as may be necessary to cause or observe, or for non-observance of the provisions stipulated in the notifications/by

laws/Acts/Rules/regulations including amendments, if any, on the part of the Contractor the Engineer-in-charge (Nodal Officer) or his nominee/Employer shall have the right to deduct any money due to the Contractor including his amount of performance security. The Employer/Engineer-in-charge (Nodal Officer) or his nominee shall also have right to recover from the Contractor any sum required or estimated to be required for making good the loss or damage suffered by the Employer.

The employees of the Contractor and the Sub-Contractor in no case shall be treated as the employees of the Employer at any point of time.

#### **SALIENT FEATURES OF SOME MAJOR LAWS APPLICABLE TO ESTABLISHMENTS ENGAGED IN BUILDING AND OTHER CONSTRUCTION WORK.**

- (a) Workmen Compensation Act 1923: - The Act provides for compensation in case of injury by accident arising out of and during the course of employment.
- (b) Payment of Gratuity Act 1972: Gratuity is payable to an employee under the Act on satisfaction of certain conditions on separation if an employee has completed 5 years service or more on death at the rate of 15 days wages for every completed year of service. The Act is applicable to all establishments employing 10 or more employees.
- (c) Employees P.F and Miscellaneous Provision Act 1952: The Act Provides for monthly contributions by the employer to workers at nominated rate. The benefits payable under the Act are: (i) Pension to family pension on retirement or death, as the case may be. (ii) Deposit linked insurance on the death in harness of the worker, (iii) payment of P.F accumulation on retirement/death etc.
- (d) Maternity Benefit Act 1951: - The Act provides for leave and some other benefits to workmen/employees in case of confinement or miscarriage etc.
- (e) Contract Labour (Regulation & Abolition) Act 1970: - The Act provides for certain welfare measures to be provided by the Contractor to contract labour and in case the Contractor fails to provide, the same are required to be provided, by the Principal Employer by Law. The Principal Employer is required to take Certificate of Registration and the Contractor is required to take license from the designated Officer. The Act is applicable to the establishments or Contractor of Principal Employer if they employ 20 or more contract labours.
- (f) Minimum Wages Act 1948: The Employer is supposed to pay not less than the Minimum Wages fixed by appropriate Government as per provisions of the Act if the employment is a scheduled employment Construction of Buildings, Roads, Runways are scheduled employment.
- (g) Payment of Wages Act 1936: - It lays down as to by what date the wages are to be paid when it will be paid and what deductions can be made from the wages of the workers.
- (h) Equal Remuneration Act 1979: - The Act provides for payment of equal wages for work of equal nature to Male and Female workers and for not making discrimination against Female employees in the matters of transfers, training and promotions etc.
- (i) Payment of Bonus Act 1965: The Act is applicable to all establishments employing 20 or more employees. The Act provides for payments of annual bonus subject to a minimum of 8.33% of wages and maximum of 20% of wages to employees drawing Rs.3500/- per month or less. The bonus to be paid to employees getting Rs. 2500/- per month or above upto Rs. 3500/- per month shall be worked out by taking wages as Rs. 2500/- per month only. The Act does not apply to certain establishments. Then newly set-up establishments are exempted for five years in certain circumstances. Some of the State Governments have reduced the employment size from 20 to 10 for the purpose of applicability of this Act.
- (j) Industrial Disputes Act 1947: - The Act lays down the machinery and procedure for resolution of Industrial disputes, in what situations a strike or lock out becomes illegal and what are the requirements for laying off or re-trenching the employees or closing down the establishment.

- (k) Industrial Employment's (Standing Orders) Act 1946: - It is applicable to all establishments employing 100 or more workmen (employment size reduced by some of the States and Central Government to 50). Provides for laying down rules governing the conditions of employment by the Employer on matters provided in the Act and get same certified by the designated Authority.
- (l) Trade Unions Act 1926: - The Act lays down the procedure for registration of trade union of workmen and employers. The Trade Union registered under the Act have been given certain immunities from civil and criminal liabilities.
- (m) Child Labour (Prohibition & Regulation) Act 1986: - The Act prohibits employment of children below 14 years of age in certain occupations and processes and provides for regulation of employment of Children in all other occupations and processes. Employment of Child Labor is prohibited in Building and Construction Industry.
- (n) Inter-State Migrant workmen's (Regulation of Employment & Conditions of Service) Act 1979: -  
The Act is applicable to an establishment which employs 5 or more inter-state migrant workmen through an intermediary (who has recruited workmen in one state for employment in the establishment situated in another state). The Inter-State migrant workmen, in establishment to which this Act becomes applicable, are required to be provided certain facilities such as housing, medical aid, travelling expenses from home upon the establishment and back, etc.
- (o) The Building and Other Construction workers (Regulation of Employment and Conditions of Service) Act 1996 and the Cess Act of 1996: - All the establishments who carry on any building or other construction work and employs 10 or more workers are covered under this Act. All such establishments are required to pay cess at the rate not exceeding 2% of the cost of construction as may be modified by the Government. The Employer of the establishment is required to provide safety measures at the Building or Construction work and other welfare measures, such as Canteens, First-Aid facilities. Ambulance, Housing accommodations for workers near the work place etc. The Employer to whom the Act applies has to obtain a registration certificate from the Registering Officer appointed by the Government.
- (p) Factories Act 1948: - The Act lays down the procedure for approval at plans before setting up a factory, health and safety provisions, welfare provisions, working hours, annual earned leave and rendering information regarding accidents or dangerous occurrences to designated authorities. It is applicable to premises employing 10 persons or more with aid of power or 20 more persons without the aid of power engaged in manufacturing process.

## **G. SPECIAL INSTRUCTIONS TO BIDDERS**

### **(a) CLAIMS AND DISPUTES:**

Any claims or disputes arising out of the contract should be promptly submitted in writing to the Engineer-in-Charge within one month from the date of cause of action so that the points at issue could be immediately verified at site by the field officers, facts ascertained and a prompt decision can be given. Claims raised beyond this time limit will not be entertained. The tenderers shall carefully note this stipulation.

### **(b) THE SITE OF WORK:**

The work site is located at Inside N.S. Dock of SMP, Kolkata. Tenderer must visit the work site and its surrounding before submission of e-tender, so that due consideration is given to the local conditions at site. The intending tenderer should contact Superintending Engineer, (NSD) 51, C.G.R. Road, Kolkata 700043 (Ph: 9836298690) to make the site inspection along with his representative.

### **© CLAUSE REGARDING SECURITY DEPOSIT**

The S.D. will be recovered from the monthly bills at the rate mentioned in GCC until the balance is recovered. The amount of security deposit will be refunded to the Contractor after deducting dues if any to the Port, on expiry of the maintenance period of 10 (Five) years for whole work.

### **(d) SUB-LETTING:**

Engaging of labour on a piece work basis shall not be deemed to be sub-letting.

### **(e) INSURANCE OF WORKS ETC:**

The contractor shall insure in the joint names of the Board and the contractor against all risks of what ever nature viz., all losses or damages from what ever cause arising (other than the except risks) for which he is responsible under the terms of the contract and in such manner that the Board and contractor are covered during the period of execution of the works for any loss or damage, occasioned by the contractor in the course of any operation carried out by him for the purpose of complying with his obligations. The said insurance shall cover the following:

- a) The works and the temporary works to the full value of such works executed from time to time.
- b) The materials, constructional plant and other things brought on to the site by the contractor to the full value of such materials, constructional plant and other things, such insurances shall be effected with an insurer and in terms approved by the Board (which approval shall not be unreasonably withheld) and the contractor shall whenever required produce to the Engineer-in-charge or his representative the policy or policies of insurance and the receipt for payment of current premiums provided always that without limiting his obligations and responsibilities as aforesaid nothing in this clause contained shall render the contractor liable to insure against the necessity for the repair or reconstruction of any work constructed with materials or workmanship not in accordance with the requirements of the contract.  
If the insurance policies do not take care of any of the risks identified or part of the work involved, the contractor shall indemnify the Board suitably against such risks and works.

### **(e) DAMAGE TO PERSONS AND PROPERTY:**

The contractor shall (except if and so far as the specification provides otherwise) indemnify and keep indemnified the Board against all losses and claims for injuries or damages to any person in the employment of the Board or any property of the Board whatever (other than surface other damage to land or crops being in the site suffered by tenants or occupiers) which may arise out of or in consequence of the construction and maintenance of work and against all claims, demands,

proceedings, damages, costs, charges and expenses what so ever in respect of or in relation there to. Provided always that nothing here in contained shall be deemed to render the contractor liable for or in respect of or to indemnify the Board against compensation or damages for or with respect to:

- The permanent use or occupation of land by the works or any part there of or (save as here in after provided) surface or other damage as a foresaid.
- The right of the Board to construct the works or any part thereof on/over/under/in or through any land.
- Interference whether temporary or permanent with any right of a airway or water or other easement or quasieasement which is an un-avoidable result of the construction of works in accordance with the contract.
- Injuries or damage to persons or property resulting from any act of neglect done or committed during the execution of the contract of the client or his agents, staff or other contractors (employed by the contractor) or for in respect of any claims, demands, proceedings, damages, costs, charges and expenses in respect there of in relating there to.
- Provided further that for the purpose of this clause the expression “the site shall be deemed to be limited to the area defined in the specification or shown on the drawings or damaged as an inevitable consequence of the carrying out of the works.

**(f) Third party insurance:**

i) Before commencing the execution of the work, the contractor (but without limiting his obligations and responsibilities) shall insure against any damage, loss or injury which may occur to any property (including that of the Board) or to any person (including any employee of the Board) by or arising out of the execution of the works or temporary works in the carrying out of the contract.

ii) Such insurance shall be effected with an Insurer and in terms approved by the Engineer in Charge save and except any accident injury resulting from any act or default of the board his agents or staff and for at least the amount stated in the Tender and Contractor shall, when ever required, produce to the Engineer-in-charge or his representative the policy or policies of insurance and the receipts for payment of the current premiums. The minimum amount of third-party insurance shall be Rs 50 lacs for each occurrence.

**(g) 1)** The Board shall not be liable for in respect of any damages or compensation payable at Law in respect or in consequence of any accident or injury to any workmen or other persons in the employment of the Contractor. The Contractor shall indemnify and keep indemnified the Board against all such damages and compensation (save and except as aforesaid and expenses whatsoever in respies of in relation there to.

2) The Contractor shall insure against such liability with an insurer approved by the Engineer-in-Charge (which approval shall not unreasonably withhold) and shall continue such insurance during the total tenure of the work and for any persons who are employed by him on the works and shall when required produce to the Engineer-in-Charge or his representative such policy of insurance and the receipt for payment of the current premium.

**(h)** If the Contractor shall fail to effect and keep in force the insurance referred to above as mentioned here of any other insurances which he may be required to effect under the terms of the contract then and in any such case the Board may effect and keep in force any such insurance pay such premium or premiums as may be necessary for that purpose and from time to time deduct the amount so paid by the Board as aforesaid from any amount due or which may become due to the Contractor or recover the same as a debt due from the Contractor.

**(i)** The Contractor shall not take away any of the plant and machinery until completion of the work without the written permission of the Engineer-in-Charge.

(j) Not with standing with anything contained in the contract.

- i. The Contractor shall be under no liability whatsoever whether by way of indemnity or other wise for or in respect of destruction of or damage to the works or temporary works or to property whether of the Board or third parties or for in respect of injury of loss of life which is the consequence whether direct or indirect effect of war , hostilities (whether war be declared or not) invasion act of foreign enemies, rebellion, revolution, insurrection of military or usurped power civil war (otherwise than among the Contractor's own employees or riot, commotion or disorder (herein after comprehensively referred to as "the said special risks").
- ii. If the works or temporary works or any materials (whether for the former or the later) on or near shall sustain destruction or damage by reason of any of the said special risks, the Contractor shall nevertheless be entitled to payment for any permanent work already certified.
- iii. Destruction, damage, injury or loss of life caused by the explosion or impact wherever and whenever occurring of any mine, bomb, shell, grenade or other projectile, missile, ammunition or explosive of war shall be deemed to be consequence of the said special risks.
- iv. The Board shall repay to the Contractor any increased cost incidental to the execution for the works (other than such as may be attributable to the  
of reconstructing work condemned by the Engineer-in-Charge due to faulty specification and improper workmanship prior to the occurrence of any special risk which is however attributable to or consequent on or the result of or in any way whatsoever connected with the said special risks) (subject however to the provision in the clause here in after contained in regard to outbreak of war). But the Contractor shall as soon as any such increase of cost shall come to his knowledge forthwith notify the Engineer-in-Charge thereof in writing.
- v. If during the execution of the contract there shall be an outbreak of war (whether war is declared or not) in any part of the work which whether financially or otherwise materially affects the execution of the works the Contractor shall unless and until the contract is terminated, under the provisions contained in this Clause use his best endeavors to complete the execution of the works provided always that the Board shall be entitled at anytime after such outbreak of war to terminate this contract by giving notice in writing to the Contractor and such notice being given this contract shall (save as to the right of the parties under this clause and to the operation of arbitration clause) terminate but without prejudice to the rights of either parties respires of any incident break thereof.

- vi) If the Contract shall be terminated under the provisions of the last proceeding sub-clause, The Contractor shall with all reasonable dispatch remove from the site all constructional plants.
- vii) Removal of plant on termination
- viii) If the contract shall be terminated as a foresaid the Contractor shall be paid by the Board (in so far as such amounts or items shall not have already been covered by payments on account made to the Contractor) for all work prior to the date of termination at the rates and prices provided in the contract and in addition:
 

The amounts payable in respect of any preliminary items so far as the work or service comprised there in has been carried out or performed and proper portion as certified by the Engineer-in-Charge of any such items of the work or service comprised in which has been partially carried out or performed.

The cost of materials of good reasonably ordered for the works or temporary works which shall have been delivered to the Contractor or of which the Contractor is legally liable to accept delivery (such materials or goods becoming the property of the Board upon such payment being made by him).

A sum to be certified by the Engineer-in-Charge being the amounts of any expenditure reasonably incurred by the Contractor in the expectation of completing the whole works in so far as such expenditure shall not have been covered by the payments in this sub clause before mentioned.

The reasonable cost of repatriation of all the Contractor's staff and workmen employed on or in connection with the works at the time of such termination. Provided always that against any payments due from the Board under above mentioned clause, the Board shall be entitled to be credited with any outstanding balance due from the Contractor for any such previously paid by the Board to the Contractor in respect of the execution of the works.

**(k)** The tenderers shall return all the drawings issued along with the tender schedules to the Engineer in charge.

**56. Dock Permit:**

For works inside the Docks, Dock permit required for men , materials, vehicles and equipments etc. are to be procured by the successful tenderer **at free of cost** as per recommendation of the executing departments/divisions indicating the specific number of free permits to be issued. But for creation of individual IDs in permit system a charge as applicable, will be levied per person (one time) even for companies/ Individuals who have been granted permission to obtain free permits by KoPT. In case the work has to be carried out in an operational zone, the tenderer should keep in mind that the work is to be executed without hampering the operational activities and should complete the work within the stipulated time specified in the tender.

**57. An establishment by the contractor shall have to be maintained within Port area limit for Total Defect Liability Period for taking up issues related to maintenance of the work .**



**SECTION-5**

**SCHEDULE OF PAYMENT**

SCHEDULE OF PAYMENT

RELEASE OF PAYMENTS:

The lump-sum bid amount for the work as described in as per contract data shall be paid as per details included in Schedule for Interim Payments for each component of the work described therein individually on pro-rata basis for each individual component.

Schedule for Interim Payments  
(Schedule given as under will be followed for the work-billing schedule for interim payment)

Sl. No.	Description	Percentage on Contact Value	
		Individual	Total
1.	Basic Engineering, Surveying, Preparation of working drawings and detailed designs		3%
2.	Dismantling of Existing Structure		1%
3.	Completion of Piling and Sheet Piling Works		50%
	a. Supply, fabrication and erection of liner	20%	
	b. Driving of Piles	5%	
	c. Providing Reinforcement in Piles	13%	
	d. Placing Concrete in Piles	10%	
	e. Supply and driving of Z-section Sheet Pile	2%	
4.	Completion of RCC/PCC works		21%
	i) Providing Beams	7%	
	ii) Providing Slabs	7%	
	iii) Providing Pile Muffs	7%	
5.	Completion of Installation of Fender		1%
6.	Completion of Installation of Bollards		1%
7.	Completion of Construction of Stack Yard		10%
	i) Dismantling and Excavation upto founding level	1%	
	ii) Provision of Granular Layer	0.5%	
	iii) Sand Filling	1%	
	iv) Mattress laying	2%	
	v) Back Filling	2.5%	
	vi) PCC	1%	
	vii) Paver Block Topping	2%	
8.	Other Miscellaneous Working like fixing of Crane Rail & various tests etc.		2%
9.	Site Clearance		1%
10.	Handing over the Work		10%
	TOTAL		100 %

Note:

- This break-up is a tentative amount of major activities to be carried out during the execution of the project, however for the payment purpose same should be accepted for the successful bidder by the Engineer-In-Charge of the contract.
- a. Part work done on any of the above items shall be paid for on pro-rata basis at the time of submitting each interim bill for the bill submitted by the contractor and verified by PMC & Representative of Engineer-in-Charge.
- b. Release of payments are subject to completion of the certification by SMPK.
- c. Completion of item means its execution in all respects and certified by the PMC/Engineer-In-Charge e.g.: - Structural Steel Members Fabrication and Erection, RCC Deck Slab, etc., as per Technical specifications / Standards.

**SCHEDULE OF ITEM FOR EXTRA WORK/DEVIATIONS**

**In general as it is a Lump-sum contract ,there will be no excess-extra items.**

- i. The payment for extra items (Not covered in scope of work) will be made if specially instructed by the Engineer-In-Charge and communicated through written communication as per clause No. 7 of the GCC.
- ii. The contractor shall submit the BOQ and rates for any item of extra work / deviation, duly furnishing the supporting details for examination by Engineer-in-charge. The EIC may ask the contractor to furnish the existing supporting details in case of rates on the higher side.

## **SECTION-6**

### **FORMS OF SECURITIES AND OTHER FORMATS**

**FORMS OF SECURITIES AND OTHER FORMATS**

- (I) Schedule-T
- (II) Schedule- O
- (III) Proforma of Performance Certificate/Credential of works
- (IV) Documents to be uploaded (Annexure D)
- (V) Annexure D-1
- (VI) Form of BID Security Declaration (Annexure D-2)
- (VII) Proforma of Bank Guarantee (Performance Bond)
- (VIII) Format in case of Joint Venture/ Consortium Agreement
- (IX) Format for Power of Attorney for Lead Member of Consortium
- (X) Format of Joint Bidding Agreement.
- (XI) Integrity Pact
- (XII) Guidelines for Indian Agents of Foreign Suppliers (Annexure A)
- (XIII) Stage Payment (to be executed on Rs.100/- Non-Judicial Stamp Paper)
- (XIV) Specimen Letter of Authority from Bank for all BGs (to be executed on Bank's letter head)
- (XV) Specimen Letter of Authority for Submission of Bid (to be executed on Rs.100/- Non-Judicial Stamp Paper)
- (XVI) Exceptions and Deviations
- (XVII) Form of Tender
- (XVIII) Pre-Bid Query Format
- (XIX) Check List

**FORMS OF SECURITIES AND OTHER FORMATS**

Acceptable forms of securities are annexed. Bidders should not complete the Performance Security Form at this time. Only the successful Bidder will be required to provide Performance Securities in accordance with one of the forms, or in a similar form acceptable to the Employer.

**CONTRACTOR**

**CHIEF ENGINEER,KDS**

SYAMA PRASAD MOOKERJEE PORT, KOLKATA

CONCURRENT COMMITMENT(S) OF THE BIDDER (i.e. Works in The Hand of The Bidder at The Time of Submission of Tender Offer)

(To be submitted with Part-I of Offer)

Bidders must fill in the under noted columns.

Sl. No.	Full particulars of works to be executed concurrently by the bidder. (i) Name of work. (ii) Client. (iii) W.O. No. & Date.	Sanctioned Tender Value. (in Rs.)	Completion time as stated in tender.	Name and address to whom reference can be made.
1	(i)			
	(ii)			
	(iii)			
2	(i)			
	(ii)			
	(iii)			
3	(i)			
	(ii)			
	(iii)			
4	(i)			
	(ii)			
	(iii)			

(To be submitted with Part-I of Offer)

**SCHEDULE 'O' SHEET – 1**

The Bidders are also requested to furnish the following particulars: -

A) In case of Limited Company -

- 1) Name of Company :
- 2) Address of its present registered office. :
- 3) Date of its incorporation :
- 4) Full name and address of each of its Directors – any special particulars as to Directors if desire to be stated. :
- 5) Name, address and other necessary particulars of Managing Agents, if any appointed by the Company. :
- 6) Copies of Memorandum, Articles of Association (with the latest amendments, if any). :
- 7) Copies of audited balance sheets of the Company for the last **three years**. :

B) In case of a firm -

- 1) Name and address of the firm. :
- 2) When business started :
- 3) If registered a certified copy of certificate of registration. :
- 4) A certified copy of the Deed of Partnership :
- 5) Full name and address of each of the partners and the interest of each partner in the partnership – any special particulars as to partners if desired to be stated. :
- 6) Whether the firm pays income tax over Rs.10, 000/- per year :



(To be submitted with Part-I of Offer)

**SCHEDULE 'O' SHEET – 2.**

C) In case of an Individual:

- 1) Full name and address of the Bidder any :  
special particulars of the Bidder if  
desired to be stated.
- 2) Name of the father of the Bidder. :
- 3) Whether the Bidder carries on business :  
in his own name or any other name.
- 4) When business was started and by :  
whom.
- 5) Whether any other person is interested :  
in the business directly or indirectly, if  
so, name and address etc. of such  
persons and the nature of such interest.
- 6) Whether the Bidder pays Income Tax :  
over Rs.10, 000/- per year.

Dated:

---

(Full signature of Bidder)

**(Proforma of Performance certificate/credential of works)**  
[To be issued on issuing authority’s letterhead duly signed with office seal]

1.	Name of the Certifying Authority:	
2.	Name of the work:	
3.	Name of the Contractor:	
4.	Schedule date of commencement and completion of the work as per Work Order:	
5.	Date of actual commencement of work & date of actual completion:	
6.	i) If there is time overrun, whether delay is due to the contractor (Yes/No.):  ii) If yes, what is the extent of delay attributable to the contractor:	
7.	Sanctioned Tender value & Actual value executed:	
8.	Quality of work (Excellent/satisfactory/poor):	
9.	Remarks (If any):	

**DOCUMENTS TO BE UPLOADED ALONG WITH PART –I****Scanned copy of the following documents to be uploaded: -**

- i) GST registration certificate.
- ii) Valid Trade Licence (Valid for current period & also for type of work).
- iii) Valid Professional Tax Clearance Certificate / Up to date tax payment challan. If this is not applicable, the bidder must submit a declaration in this regard.
- iv) Proof of possessing valid Employees' Provident Fund (EPF) Account. EPF Registration Certificate.
- v) Proof of being registered with Employees' State Insurance Corporation (ESIC), ESI Registration Certificate
- vi) Details of the firm as per Schedule-O (in Part-I) of the tender document duly filled up.
- vii) Credentials in the form of copies of Letters of Award of Works along with corresponding Completion Certificates from owners to justify that the intending bidder satisfies the earlier mentioned pre-qualification criteria.
- viii) Balance sheet and Profit and Loss account / Trading account for the last 3 (three) financial years **(i.e. 2018-2019 , 2019-2020 and 2020-21). The same should be audited as per relevant norms wherever required along with UDIN of the Auditor.**
- ix) Bank Draft/ Pay Order etc. regarding EMD & Cost of Tender documents / valid NSIC certificate/ MSME certificate.
- x) PAN Card.
- xi) A list of technically qualified and skilled persons would be engaged to supervise and execute the work (to be mentioned in the letter head of the Firm).
- xii) Self-declaration of the bidder that the Bidding Firm has Not been debarred / de-listed by any Govt / Quasi Govt. / Public Sector undertaking in India (to be mentioned in the letter head of the Firm).
- xiii) Self-declaration regarding the proprietor/partner(s)/authorized signatory of the bidding firm (in the case of proprietorship firm /partnership firm /limited company, as the case may be) is/are not associated with any other firm bidding for the same work (to be mentioned in the letter head of the Firm).
- xiv) A list of works which are in hand at the time of submitting the offer as per the enclosed proforma titled 'Concurrent Commitments of The Bidder' vide 'Annexure-C' (Schedule –T) in Part-I of the tender document.
- xv) Undertaking of the tenderer to be submitted as per enclosed Pro-forma (Annexure –D-1) in lieu of submission of signed copies of the full Tender document, G.C.C, addenda & corrigendum in the letter head of the Firm.
- xvi) Last page of "Bill of Quantities" & the "Form of Tender" duly filled up (without price quoted) shall be duly signed and stamped by the Bidder.
- xvii) **Bid security declaration in the prescribed format as per Annexure- D2**
- Xviii) Integrity Pact

**N. B.-1** The bidder will have to produce the original documents or any additional documents, if asked for, to satisfy the Authorities.

**N.B.-2** Even though the bidders meet the above qualifying criteria, they are subject to be disqualified if they have made misleading or false representations in the forms, statements and attachments submitted in proof of the qualification requirements and their **EMD/SD will be forfeited for such action.**

**NIT NO.: SMPK/KDS/CIV/T/2622/60 DT. 29.10.2021**

Ref. No.....

Dated:

The Chief Engineer,  
Syama Prasad Mookerjee Port, Kolkata,  
Civil Engineering Department,  
15, Strand Road,  
Kolkata – 700 001

Dear Sir,

We, ----- (Name of Tenderer) have fully read and understood the entire Tender Document, GCC, Corrigendum and Addenda, if any, downloaded from under the instant e-tender and no other source, and will comply to the said document, GCC, Corrigendum and Addenda.

We are submitting this undertaking in lieu of submission of signed copy of the full tender documents GCC, Corrigendum and Addenda.

Yours faithfully,

Signature of Tenderer.....

Name

Designation:

Date:

Seal of the tenderer.....

**Form of Bid Security Declaration**

**ANNEXURE –D-2**

NIT NO.: SMPK/KDS/CIV/T/2622/60 DT. 29.10..2021

Ref. No...

Dated:

The Chief Engineer,  
Syama Prasad Mookerjee Port, Kolkata,  
Civil Engineering Department,  
15, Strand Road,  
Kolkata – 700 001

We, ----- (Name of the bidder) understand that, according to your conditions, bids must be supported by a Bid-Security Declaration.

We accept that we will automatically be suspended **for three years** from being eligible for bidding in any contract with the entity that invited Bids for the period of **180 days** starting from the **date of opening tender** if we are in breach of our obligation(s) under the bid conditions, i.e. if we withdraw or modify our Bids during the period of validity.

Yours faithfully,

Signature of Tenderer:

Name:

Designation:

Date:

NIT NO.: SMPK/KDS/CIV/T/2622/60 DT. 29.10.2021

## **PROFORMA OF BANK GUARANTEE**

### **(PERFORMANCE BOND)**

(In lieu of Cash Security Deposit) To be issued by the Kolkata Branch, as the case may be of any Nationalized Bank/Scheduled bank of India on Non-judicial Stamp Paper worth Rs 100/- or as decided by the Authority.

**To**

**Syama Prasad Mookerjee Port, Kolkata,  
15, Strand Road,  
Kolkata – 700 001**

BANK GUARANTEE NO.....DATE.....

Name of Issuing Bank.....

Name of Branch.....

Address.....

In consideration of the Syama Prasad Mookerjee Port, Kolkata (**SMPK**) a Special Purpose Vehicle (SPV) with share of Syama Prasad Mookerjee Port, Kolkata (**SMPK**) and Govt. Of West Bengal having agreed to exempt.....a Proprietary / Partnership /Limited / Registered Company, having its Registered office at .....(hereinafter referred to as the "Contractor") from cash payment of Security Deposit / Payment of Security Deposit through deduction from the Contractors' bills under the terms and conditions of a contract made between the Trustees and the Contractor for.....(write the name of the work as per LOA) in terms of the Letter of Intent No dated.....(herein after referred to as the 'Contract'), for the due fulfilment by the contractor of all the terms and conditions contained in the said contract, on submission of a Bank Guarantee for (Rs.....), we.....Bank.....Branch.....do, on the advice of the contractor hereby undertake to indemnify and keep indemnified the Trustees to the extent of the said sum of Rs.....(Rupees.....). We,.....

..... Bank ..... Branch, further agree that if a written demand is made by the SMPK through any of its officials for honouring the Bank Guarantee constituted by these presents, We,..... Bank..... Branch, shall have no right to decline to cash the same for any reason whatsoever and shall cash the same and pay the sum so demanded to the Trustees within a week from the date of such demand by an A/c Payee Banker's Cheque drawn in favour of "Syama Prasad Mookerjee Port, Kolkata" without any demur. Even if there be any dispute between the contractor and the Syama Prasad Mookerjee Port, Kolkata, this would be no ground for us..... (Name of Bank). ..... Branch, to decline to honour the Bank

Guarantee in the manner aforesaid. The very fact that We..... Bank  
 ..... Branch, decline or fail or neglect to honour  
 the Bank Guarantee in the manner aforesaid shall constitute sufficient reason for the SMPK to enforce the  
 Bank Guarantee unconditionally without any reference, whatsoever, to the contractor.

2. We..... Bank. ....Branch, further agree that a mere demand by the Trustees at any  
 time and in the manner aforesaid is sufficient for  
 us.....Bank.....Branch, to pay the amount covered  
 by this Bank Guarantee in full and in the manner aforesaid and within the time aforesaid without  
 reference to the contractor and no protest by the contractor, made either directly or indirectly or  
 through Court, can be valid ground for us.....Bank.....Branch, to  
 decline or fail or neglect to make payment to the SMPK in the manner and within the time  
 aforesaid.

3. We .....Bank.....Branch, further agree that the Bank Guarantee herein  
 contained shall remain in full force and effect, during the period that is taken for the due performance of  
 the said contract by the contractor and that it shall continue to be enforceable till all the dues of the SMPK  
 under and/or by virtue of the terms and conditions of the said contract have been fully paid and its claim  
 satisfied and/ or discharged in full and/or till the SMPK certify that the terms and conditions of the said  
 contract have been fully and properly observed/fulfilled by the contractor and accordingly, the Trustees  
 have discharged the Bank Guarantee, subject however, that this guarantee shall remain valid upto and  
 inclusive of days of.....20 and subject also to the provision that the SMPK shall have no  
 right to demand payment against this guarantee after the expiry of 6 (six) calendar months from the expiry  
 of the aforesaid validity period up to.....or any extension thereof made by  
 us.....Bank.....Branch, in further extending the said validity period of this Bank  
 Guarantee on Non-Judicial Stamp paper of appropriate value, as required/determined by the Trustees,  
 only on a written request by the SMPK to the contractor for such extension of validity of this Bank  
 Guarantee.

4. We.....Bank. ....Branch, further agree that, without  
 our consent and without affecting in any manner our obligations hereunder, the SMPK shall have  
 the fullest liberty to vary from time to time any of the terms and conditions of the said contract to  
 extend the time for full performance of the said contract including fulfilling all obligations under  
 the said contract or to extend the time for full performance of the said contract including fulfilling  
 all obligations under the said contract by the contractor or to postpone for any time or from time  
 to time any of the powers exercisable by the SMPK against the contractor and to forebear or  
 enforce any of terms and conditions relating to the said contract and we.....  
 Bank..... Branch shall not be relieved from our liability by reason of any such variation or  
 extension being granted to the contractor or for any fore-bearance, act or commission on the part  
 of the SMPK or any indulgence by the SMPK to the contractor or by any such matter of thing of  
 whatsoever nature, which under the law relating to sureties would, but for this provision have  
 effect of so relieving us .....Bank... ..... Branch.

5. We, .... Bank. .... Branch, lastly undertake not to revoke this Bank Guarantee during its currency except with the previous consent of the Trustees in writing.

SIGNATURE.....

NAME.....

DESIGNATION.....

(Duly constituted attorney for and on behalf of)

BANK.....

BRANCH ..... (OFFICIAL SEAL OF THE BANK)



**NIT NO.: SMPK/KDS/CIV/T/2622/60 DT. 29.10.2021**

**FORMAT IN CASE OF JOINT VENTURE/CONSORTIUM AGREEMENT**

(To be submitted on stamp paper)

This Joint venture/consortium agreement is made at \_\_\_\_\_ on \_\_\_\_\_ day of \_\_\_\_\_ 20... between M/s. \_\_\_\_\_ (please indicate the status viz. Proprietor, firm, Company) represented through its proprietor /partner or Director (hereinafter referred to as "First Party") and M/s. \_\_\_\_\_ (Please indicate the status viz. Proprietor, Firm, Company ) represented through its proprietor /partner or Director ( hereinafter referred to as "Second Party") WHEREAS the First party is engaged in the business of \_\_\_\_\_

AND WHEREAS THE Second Party is engaged in the business of \_\_\_\_\_

AND WHEREAS both the parties are desirous of entering into a joint venture /consortium for carrying on the work of Syama Prasad Mookerjee Port, Kolkata in connection with work of \_\_\_\_\_ (please mention the work of the tender).

AND WHEREAS the First Party and Second Party have agreed to form joint venture/consortium for execution of subject works.

NOW THIS DEED WITNESSED AS UNDER:

a. That under this Joint Venture/consortium Agreement the work will be done jointly by the first party and second party in the name and style of M/s. \_\_\_\_\_.

b. It is further agreed by the Joint Venture/consortium Partner that \_\_\_\_\_ of M/s. \_\_\_\_\_ has been nominated as Lead Partner for the execution of the works.

c. That all the parties shall be liable jointly, equally and severally for the satisfactory execution of the contract in all respect in accordance with terms and conditions of the contract and the lead partner shall be authorised to incur liabilities and receive instruction for and on behalf of any and all the partners and parties of the Joint Venture/consortium and the entire execution of the contract including payment shall be done exclusively with the lead partner.

d. THE PROPOSED PARTICIPATION SCOPE OF ACTIVITIES TO BE PERFORMED AND RESPONSIBILITIES OF EACH:

The proposed administrative arrangement, participation, scope of activities to be performed and responsibilities for the execution of the work of the each party shall be as under:

First Party:

Second Party:

e. The turnover and experience of each party is as under:

First Party:

Second Party:

f. Subject to Clause-4, the parties shall depute their experienced staff as required for the works and plants, equipment, machinery etc. as requires for execution of works, will be deployed by each Joint Venture/consortium partners for execution of the contract.

g. In the event of default by any partner in the execution of the part of the contract, the Lead Partner will have the authority to assign the work to any other party acceptable to the Syama Prasad Mookerjee Port, Kolkata to ensure the satisfactory execution of that part of the contract.

h. The Registered Office of the Joint Venture/Lead Partner of the consortium shall be at \_\_\_\_\_

i. The Joint Venture/consortium shall regularly maintain in the ordinary course of business a true and correct account of all its incoming and outgoing and also of its assets and liabilities in proper books or account which shall ordinarily be kept at place of business and after Completion of above mentioned work all account shall be taken.

j. Opening and operation of Bank Account:

The Joint Venture/consortium shall open and maintain bank account(s) at \_\_\_\_\_ The Lead Partner as mentioned in Clause (2) above shall have the power to receive the payments on behalf of the Joint Venture/consortium and to give discharge on behalf of the Joint Venture/consortium.

IN WITNESS WHEREOF the Parties hereto have signed hereunder at \_\_\_\_\_ on this \_\_\_\_\_ day of \_\_\_\_\_

Party of First Part

Party of Second Part

Witness:

1)

2)

**POWER OF ATTORNEY****Format For Power Of Attorney For Lead Member Of Consortium**(To be executed before Notary Public on a Non-Judicial Stamp Paper of at least Rs 10)

Dated: .....

TO WHOMSOEVER IT MAY CONCERN Mr.....(Name of the Person(s)),

domiciled at .....

(Address), acting as.....(Designation and name of the company), and whose signature is attested below, is hereby appointed as the Lead member and authorised on behalf of--

-----

-(Name of the applicant) to provide information and respond to enquiries etc. as may be required by the Employer for the project of (Project title).....and is hereby further authorised to sign and file relevant documents in respect of the above.

(Attested signature of Mr.....) For.....

(Name &amp; designation of the member of joint venture/Consortium)

- Individual power of attorney for signing the joint venture/Consortium shall be submitted in the above format separately by each applicant.

**POWER OF ATTORNEY****Format For Power Of Attorney For Lead Member Of Consortium**(To be executed before Notary Public on a Non-Judicial Stamp Paper of at least Rs 10)POWER OF ATTORNEY

Whereas, **Syama Prasad Mookerjee Port, Kolkata (SMPK)** ("the Authority") has invited tenders from interested parties for "....." (Tender No).

Whereas, ....., ....., ..... And ..... (collectively the "Consortium") being members of the Consortium are interested in bidding for the Tender in accordance with the terms and conditions of the Tender Document and other connected documents in respect of the said tender, and

Whereas, it is necessary under the Tender Document for the members of the Consortium to designate one of them as the Lead Member with all necessary power and authority to do for and on behalf of the Consortium, all acts, deeds and things as may be necessary in connection with the Consortium's bid for the Tender and its execution.

**NOW THEREFORE KNOW ALL MEN BY THESE PRESENTS**

We, M/s. .... having our registered office at .....,  
 M/s. .... having our registered office at ....., M/s. ....  
 having our registered office at ....., and M/s. .... having our registered office  
 at ....., [the respective names and addresses of the registered office] (hereinafter  
 collectively referred to as the "Principals") do hereby designate, nominate, constitute,  
 appoint and authorize M/s.

..... having its registered office at ....., being one of the members of the Consortium, as the Lead Member and true and lawful attorney of the Consortium (hereinafter referred to as the "Attorney"). We hereby irrevocably authorize the Attorney to conduct all business for and on behalf of the Consortium and any one of us during the bidding process and, in the event the Consortium is awarded the Contract, during the execution of the contract, and in this regard, to do on our behalf and on behalf of the Consortium, all or any of such acts, deeds or things as are necessary or required or incidental to the pre-qualification of the Consortium and submission of its bid(s) for the tender, including but not limited to signing and submission of all applications, bids and other documents and writings, participate in Pre Bid and other conferences/meetings, respond to queries, submit information/ documents, sign and execute contracts and undertakings consequent to acceptance of bid(s) of the Consortium and generally to represent the Consortium in all its dealings with the Authority, and/or any other Government

Agency or any person, in all matters in connection with or relating to or arising out of the Consortium's bid(s) for the tender and/or upon award thereof till the Agreement is entered into with the Authority.

AND hereby agree to ratify and confirm and do hereby ratify and confirm all acts, deeds and things lawfully done or caused to be done by our said Attorney pursuant to and in exercise of the powers conferred by this Power of Attorney and that all acts, deeds and things done by our said Attorney in exercise of the powers hereby conferred shall and shall always be deemed to have been done by us / Consortium.

IN WITNESS HEREOF WE HAVE EXECUTED THIS POWER OF ATTORNEY ON THIS .....

DAY OF ..... 2021

For .....

.....

(Name & Title)

For .....

.....

(Name & Title)

For .....

.....

(Name & Title)

**Witnesses:**

1.

2.

.....

(To be executed by all the members of the Consortium)

## Format of Joint Bidding Agreement

*(To be executed on Non-Judicial Stamp Paper of not less than Rs 100/-)*

THIS JOINT BIDDING AGREEMENT is entered into on this the..... day of..... 20...

### **AMONGST**

1. { ..... Limited, a company incorporated under the Companies Act, 1956} and having its registered office at ..... (hereinafter referred to as the **"First Part"** which expression shall, unless repugnant to the context include its successors and permitted assigns)

### **AND**

2. { ..... Limited, a company incorporated under the Companies Act, 1956} and having its registered office at ..... (hereinafter referred to as the **"Second Part"** which expression shall, unless repugnant to the context include its successors and permitted assigns)

### **AND**

3. { ..... Limited, a company incorporated under the Companies Act, 1956 and having its registered office at ..... (hereinafter referred to as the **"Third Part"** which expression shall, unless repugnant to the context include its successors and permitted assigns)}

### **AND**

4. { ..... Limited, a company incorporated under the Companies Act, 1956 and having its registered office at ..... (hereinafter referred to as the **"Fourth Part"** which expression shall, unless repugnant to the context include its successors and permitted assigns)}

The above-mentioned parties of the FIRST, SECOND, {THIRD and FOURTH} PART are collectively referred to as the **"Parties"** and each is individually referred to as a **"Party"**

### **WHEREAS,**

- A. [Syama Prasad Mookerjee Port, Kolkata (SMPK), a Special Purpose Vehicle (SPV) with share of Syama Prasad Mookerjee Port, Kolkata (SMPK) and Govt. Of West Bengal is in the ratio of **74:26** (hereinafter to be called the Authority) and having Principal Office at 15, Strand Road, Kolkata-700001 (hereinafter referred to as the **"Syama Prasad Mookerjee Port, Kolkata (SMPK)"** which expression shall, unless repugnant to the context or meaning thereof, include

its administrators, successors and assigns) has invited offers by its Request through NIT No. .... dated .....(the “**TENDER DOCUMENT**”) for selection of successful tenderer for the contract as proposed in the said tender document.

- B. The Parties are interested in jointly bidding for the Project as members of a Consortium and in accordance with the terms and conditions of the tender document and other documents in respect of the work, and
- C. It is a necessary condition under the tender document that the members of the Consortium shall enter into a Joint Bidding Agreement and furnish a copy thereof with the Offer.

***NOW IT IS HEREBY AGREED as follows:***

### **1. Definitions and Interpretations**

In this Agreement, the capitalised terms shall, unless the context otherwise requires, have the meaning ascribed thereto under the tender document.

### **2. Consortium**

- 21. The Parties do hereby irrevocably constitute a consortium (the “**Consortium**”) for the purposes of jointly participating in the Tendering Process for the Work.
- 22. The Parties hereby undertake to participate in the Tendering Process only through this Consortium and not individually and/ or through any other consortium constituted for this work, either directly or indirectly or through any of their Associates.

### **3. Covenants**

The Parties hereby undertake that in the event the Consortium is declared the successful tenderer and awarded the contract, it shall incorporate a special purpose vehicle (the “**SPV**”) under the Indian Companies Act 1956 for entering into an Agreement with the SMPK and for performing all its obligations as the successful tenderer in terms of the Agreement for the Project.

### **4. Role of the Parties**

The Parties hereby undertake to perform the roles and responsibilities as described below:

- a) Party of the First Part shall be the Lead member of the Consortium and shall have the power of attorney from all Parties for conducting all business for and on behalf of the Consortium during the tendering process and till all the obligations of the SPV shall become effective;
- (a) Party of the Second Part shall be {the Technical Member of the Consortium}
- (b) {Party of the Third Part shall be the Financial Member of the Consortium; and}

(c) {Party of the Fourth Part shall be the Operation and Maintenance Member/  
Other Member of the Consortium.}

*[Note: Status of the members in (b), (c) and (d) are only illustrative. More / less parties may form the Consortium and changes may be made accordingly to the JBA]*

## **5. Joint and Several Liability**

The Parties do hereby undertake to be jointly and severally responsible for all obligations and liabilities relating to the work and in accordance with the terms of the tender document till completion of the contract.

## **6. Shareholding in the SPV**

6.1. The Parties agree that the proportion of shareholding among the Parties in the SPV shall be as follows:

First Party:

Second Party:

{Third Party:}

{Fourth Party:}

6.2. The Parties undertake that a minimum of 26% (twenty-six per cent) of the subscribed and paid up equity share capital of the SPV shall, at all times till completion of two years from the date of commencement of the contract, be held by the Parties of the First, {Second and Third} Part whose experience and net-worth have been reckoned for the purposes of pre- qualification in terms of the tender document.

6.3. The Parties undertake that they shall collectively hold at least 51% (fifty-one per cent) of the subscribed and paid up equity share capital of the SPV at all times till completion of two years from the date of commencement of the contract.

6.4. The Parties undertake that they shall comply with all the requirements as stipulated in the tender document vide N.I.T. No. ....dated .....

## **7. Representation of the Parties**

Each Party represents to the other Parties as of the date of this Agreement that:

- a) Such Party is duly organized, validly existing and in good standing under the laws of its incorporation and has all requisite power to enter into this Agreement with KoPT;
- b) The execution, delivery and performance by such Party of this Agreement has been authorised by all necessary and appropriate corporate or governmental action and a copy of the extract of the charter documents and board resolution/ power of attorney in favour of



the person executing this Agreement for the delegation of power and KoPT to execute this Agreement on behalf of the Consortium Member is annexed to this Agreement, and will not, to the best of its knowledge:

- i. Require any consent or approval not already obtained;
  - ii. Violate any Applicable Law presently in effect and having applicability to it;
  - iii. Violate the memorandum and articles of association, by-laws or other applicable organizational documents thereof;
  - iv. Violate any clearance, permit, concession, grant, license or other governmental authorization, approval, judgment, order or decree or any mortgage agreement, indenture or any other instrument to which such Party is a party or by which such Party or any of its properties or assets are bound or that is otherwise applicable to such Party; or
  - v. Create or impose any liens, mortgages, pledges, claims, security interests, charges or Encumbrances or obligations to create a lien, charge, pledge, security interest, encumbrances or mortgage in or on the property of such Party, except for encumbrances that would not, individually or in the aggregate, have a material adverse effect on the financial condition or prospects or business of such Party so as to prevent such Party from fulfilling its obligations under this Agreement;
- c) this Agreement is the legal and binding obligation of such Party, enforceable in accordance with its terms against it; and
- d) there is no litigation pending or, to the best of such Party's knowledge, threatened to which it or any of its Affiliates is a party that presently affects or which would have a material adverse effect on the financial condition or prospects or business of such Party in the fulfilment of its obligations under this Agreement.

## **8. Termination**

This Agreement shall be effective from the date hereof and shall continue in full force and effect until the Financial Close of the contract is achieved under and in accordance with the terms of the tender, in case the contract is awarded to the Consortium. However, in case the Consortium is either not pre-qualified for the work or does not get selected for award of the contract, the Agreement will stand terminated in case the Tenderer is not pre-qualified or upon return of the Earnest Money by the SMPK to the Bidder, as the case may be.

### 9. *Miscellaneous*

9.1. This Joint Bidding Agreement shall be governed by laws of India.

9.2. The Parties acknowledge and accept that this Agreement shall not be amended by the Parties without the prior written consent of the **Syama Prasad Mookerjee Port, Kolkata (SMPK)**,

IN WITNESS WHEREOF THE PARTIES ABOVE NAMED HAVE EXECUTED AND DELIVERED THIS AGREEMENT AS OF THE DATE FIRST ABOVE WRITTEN.

SIGNED, SEALED AND DELIVERED

For and on behalf of

LEAD MEMBER by:

(Signature)

(Name)

(Designation)

(Address)

SIGNED, SEALED AND DELIVERED

For and on behalf of

SECOND PART by

(Signature)

(Name)

(Designation)

(Address)

SIGNED, SEALED AND DELIVERED

For and on behalf of

THIRD PART by:

(Signature)

(Name)

(Designation)

(Address)

SIGNED, SEALED AND DELIVERED

For and on behalf of

FOURTH PART by

(Signature)

(Name)

(Designation)

(Address)

In the presence of:

1.

2.

**Notes:**

1. The mode of the execution of the Joint Bidding Agreement should be in accordance with the procedure, if any, laid down by the Applicable Law and the charter documents of the executants (s) and when it is so required, the same should be under common seal affixed in accordance with the required procedure.
  2. Each Joint Bidding Agreement should attach a copy of the extract of the charter documents and documents such as resolution / power of attorney in favour of the person executing this Agreement for the delegation of power and SMPK to execute this Agreement on behalf of the Consortium Member.
  3. For a Joint Bidding Agreement executed and issued overseas, the document shall be legalized by the Indian Embassy and notarized in the jurisdiction where the Power of Attorney has been executed.
-

# Integrity Pact

Between

**Syama Prasad Mookerjee Port, Kolkata (KoPT)** hereinafter referred to as “**The Principal/ Employer**”.

And

..... herein after referred to as “**The Bidder/Contractor**”

## Preamble

The Principal intends to award, under laid down organizational procedures, contract/s for ..... The Principal values full compliances with all relevant laws of the land, rules, regulations, economic use of resources and of fairness/transparency in its relations with its Bidder(s) and/or Contractor(s).

In order to achieve these goals, an Independent External Monitor (IEM) appointed by the principal, will monitor the tender process and the execution of the contract for compliance with the principles mentioned above.

NOW, THEREFORE,

To avoid all forms of corruption by following a system that is fair, transparent and free from any influence/prejudiced dealings prior to, during and subsequent to the currency of the contract to be entered into with a view to: -

Enabling the PRINCIPAL/EMPLOYER to get the contractual work executed and/or to obtain/dispose the desired said stores/ equipment at a competitive price in conformity with the defined specifications/ scope of work by avoiding the high cost and the distortionary impact of corruption on such work /procurement/ disposal and Enabling BIDDERS/ CONTRACTORS to abstain from bribing or indulging in any corrupt practice in order to secure the contract by providing assurance to them that their competitors will also abstain from bribing and other corrupt practices and the PRINCIPAL/EMPLOYER will commit to prevent corruption, in any form, by its officials by following transparent procedures.

## Section 1 – Commitments of the Principal/ Employer.

- (1) The Principal commits itself to take measures necessary to prevent corruption and to observe the following principles:
  - a. No employee of the Principal, personally or through family members, will in connection with the tender for, or the execution of a contract, demand, take a promise for or accept, for self or third person, any material or immaterial benefit which the person is not legally entitled to.
  - b. The Principal will, during the tender process treat all Bidder(s) with equity and reason. The Principal will, in particular, before and during the tender process, provide to all Bidder(s) the same information and will not provide to any Bidder(s) confidential/ additional information through which the Bidder(s) could obtain an advantage in relation to the tender process or the contract execution.
  - c. The Principal will exclude from the process all known prejudiced persons.
- (2). If the Principal obtains information on the conduct of any of its employees which is a criminal offence under the Indian Penal Code (IPC)/Prevention of Corruption (PC) Act, or if there be a substantive suspicion in this regard, the Principal will inform the Chief Vigilance Officer and in addition can initiate disciplinary actions.

## Section-2 –Commitments of the Bidder(s) / Contractor(s)

- (1) The Bidder(s)/Contractor(s) commit himself to take all measures necessary to prevent corruption. He commits himself to observe the following principles during his participation in the tender process and during the contract execution.
  - a. The Bidder(s) /Contractor(s) will not directly or through any other person or firm, offer, promise or give to any of the Principal’s employees involved in the tender process or the execution of the contract or to any third person any material or other benefit which he/she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the tender process or during the execution of the contract.
  - b. The Bidder(s)/Contractor(s) will not enter with other Bidders into any undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, subsidiary contract, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process.
  - c. The Bidder(s)/Contractor(s) will not commit any offence under the relevant IPC/PC Act; further the Bidder(s)/Contractor(s) will not use improperly, for purposes of competition or personal gain, or pass on to others, any information or document provided by the Principal as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.
  - d. The Bidder(s)/Contractor(s) of foreign origin shall disclose the name and address of the Agents/representatives in India, if any. Similarly, the Bidder(s)/Contractor(s) of Indian Nationality shall furnish the name and address of the foreign principles,

if any. Further details as mentioned in the “Guidelines on Indian Agents of Foreign Suppliers” shall be disclosed by the Bidder(s)/Contractor(s). Further, as mentioned in the Guidelines, all the payments made to the Indian agent/representative have to be in Indian Rupees only. Copy of the “Guidelines on Indian Agents of Foreign Suppliers” is annexed and marked as Annex-A.

- e. The Bidder(s)/Contractor(s) will when presenting his bid, disclose any and all payments he has made, is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract.
- (2). The Bidder(s)/Contractor(s) will not instigate third persons to commit offences outlined above or be an accessory to such offences.

### **Section-3-Disqualification from tender process and exclusion from future contracts**

If the Bidder(s)/Contractor(s) before award or during execution has committed a transgression through a violation of Section 2 above, or in any other form such as to put his reliability or credibility in question, the Principal is entitled to disqualify the Bidder(s)/Contractor(s) from the tender process or take action as considered appropriate.

### **Section 4-Compensation for damages**

- (1) If the Principal has disqualified the Bidder(s) from the tender process prior to the award according to Section 3, the Principal is entitled to demand and recover the damages equivalent to Earnest Money Deposit/Bid Security.
- (2) If the Principal has terminated the contract according to Section 3 or if the Principal is entitled to terminate the contract according to Section 3, the Principal shall be entitled to demand and recover from the Contractor liquidated damages of the contract value or the amount equivalent to Performance Bank Guarantee.

### **Section 5-Previous transgression**

- (1) The Bidder declares that no previous transgressions occurred in the last 3 years from the date of signing the Integrity pact with any other Company in any country conforming to the anti corruption approach or with any other Public Sector Undertaking / Enterprise in India, Major Ports/ Govt. Departments of India that could justify his exclusion from the tender process.
- (2) If the Bidder makes incorrect statement on this subject, he can be disqualified from the tender process or action can be taken as considered appropriate.

### **Section 6- Equal treatment of all Bidders/Contractors/Sub-Contractors**

- (1) The Bidder(s)/Contractor(s) undertake(s) to demand from all subcontractors a commitment in conformity with this Integrity Pact, and to submit it to the Principal before contract signing.
- (2) The Principal, will enter into agreements with identical conditions as this one with all Bidders, Contractors and Sub-contractors.
- (3) The Principal will disqualify from the tender process all bidders who do not sign this Pact or violate its provisions.

### **Section 7- Other Legal actions against violating Bidder(s)/ Contractor(s)/ Sub Contractor(s)**

The actions stipulated in this Integrity pact are without prejudice to any other legal action that may follow in accordance with provisions of the extant law in force relating to any civil or criminal proceedings.

### **Section 8 – Role of Independent External Monitor (IEM):**

- (a) The task of the Monitors shall be to review independently and objectively, whether and to what extent the parties comply with the obligations under this pact.
- (b) The Monitors shall not be subject to instructions by the representatives of the parties and shall perform their functions neutrally and independently.
- (c) Both the parties accept that the Monitors have the right to access all the documents relating to the contract.
- (d) As soon as the Monitor notices, or has reason to believe, a violation of this pact, he will so inform the authority designated by the Principal and the Chief Vigilance Officer of Kolkata Prot Trust.
- (e) The BIDDER/ CONTRACTOR(s) accepts that the Monitor has the right to access without restriction to all contract documentation of the PRINCIPAL including that provided by the BIDDER/ CONTRACTOR. The BIDDER/ CONTRACTOR will also grant the Monitor, upon his request and demonstration of a valid interest, unrestricted and unconditional access to his contract documentation, if any. The same is applicable to sub-contractors. The Monitor shall be under contractual obligation to treat the information and documents of the Bidder/Contractor/ Sub-contractor(s) with confidentiality.

(f) The Principal/ Employer will provide to the Monitor sufficient information about all meetings among the parties related to the contract provided such meetings could have an impact on the contractual relations between the Principal and the Contractor. The parties offer to the Monitor, the option to participate in such meetings.

(g) The Monitor will submit a written report to the designated Authority of Principal/ Employer/ Chief Vigilance Officer of Syama Prasad Mookerjee Port, Kolkata within 8 to 10 weeks from the date of reference or intimation to him by the Principal/ Employer/ Bidder/ Contractor and should the occasion arise, submit proposals for correcting problematic situation. BIDDER/ CONTRACTOR can approach the Independent External Monitor (s) appointed for the purposes of this Pact.

(h) As soon as the Monitor notices, or believes to notice, a violation of this agreement, he will so inform the Management of the Principal and request the Management to discontinue or to take corrective action, or to take other relevant action. The Monitor can in this regard submit non-binding recommendations. Beyond this, the Monitor has no right to demand from the parties that they act in a specific manner, refrain from action or tolerate action.

(i) If the Monitor has reported to the Principal substantiated suspicion of an offence under the relevant IPC/PCA, and the Principal/ Employer has not, within reasonable time, taken visible action to proceed against such offence or reported to the Chief Vigilance Officer, the Monitor may also transmit this information directly to the Central Vigilance Commissioner, Government of India.

(j) The word 'Monitor' would include both singular and plural.

#### **8.The Name and Correspondence Particulars of Independent External Monitors:**

a) Shri Subhashish Sarkar,  
Flat No. 406, Block-III,  
Kirti Apartments,  
Mayur Vihar Phase-I Extension,  
Delhi-110 091,  
Mob No. 98117 07230,  
E-mail ID- subhashishsarkar53@yahoo(dot)com

b) Ms. Bulbul Sen, IRS (Retd.),  
B-104 Nayantara Aptts.  
Block 8B, Sec - 7  
Dwarka  
New Delhi-110075  
E-mail ID- bsensarkar@gmail.com

#### **Section 9 – Facilitation of Investigation:**

In case of any allegation of violation of any provisions of this Pact or payment of commission, the PRINCIPAL/EMPLOYER or its agencies shall be entitled to examine all the documents including the Books of Accounts of the BIDDER/CONTRACTORS and the BIDDER/CONTRACTOR shall provide necessary information and documents **in English** and shall extend all possible help for the purpose of such examination.

#### **Section 10 – Pact Duration:**

The pact beings with when both parties have legally signed it and will extend upto 2 years or the complete execution of the contract including warranty period whichever is later. In case bidder/contractor is unsuccessful this Integrity Pact shall expire after 6 months from the date of signing of the contract.

If any claim is made/lodged during this time, the same shall be binding and continue to be valid despite the lapse of this pact as specified above, unless it is discharged/determined by Chairman, KoPT.

**Section 11 – Other Provisions:**

- (1) This agreement is subject to Indian Law. Place of performance and jurisdiction is the Registered Office of the Principal in Kolkata.
- (2) Changes and supplements as well as termination notices need to be made in writing in English.
- (3) If the Contractor is a partnership or a consortium, this agreement must be signed by all partners or consortium members.
- (4) Should one or several provisions of this agreement turn out to be invalid, the reminder of this agreement remains valid. In this case, the parties will strive to come to an agreement to their original intentions.

\_\_\_\_\_  
(For & on behalf of the Principal)

\_\_\_\_\_  
(For & on behalf of Bidder/Contractor).

(Office Seal)

(Office Seal)

Place: -

Date: -

Witness 1:

(Name & Address) .....  
.....  
.....

Witness 2:

(Name & Address) .....  
.....  
.....

**GUIDELINES FOR INDIAN AGENTS OF FOREIGN SUPPLIERS**

- 1.1 There shall be compulsory registration of Indian agents of Foreign suppliers for all Tenders. An agent who is not registered with KoPT shall apply for registration in the prescribed Application-Form.
  - 1.2 Registered agents will file an authenticated Photostat copy (duly attested by a Notary Public)/Original certificate of the principal confirming the agency agreement and giving the status being enjoyed by the agent and the commission/remuneration/salary/retainer ship being paid by the principal to the agent before the placement of order by KoPT.
  - 1.3 Wherever the Indian representatives have communicated on behalf of their principals and the foreign parties have stated that they are not paying any commission to the Indian agents, and the Indian representative is working on the basis of salary or as retainer, a written declaration to this effect should be submitted by the party (i.e. Principal) before finalizing the order.
- 2.0 DISCLOSURE OF PARTICULARS OF AGENTS/REPRESENTATIVES IN INDIA. IF ANY.**
- 2.1 Tenderers of Foreign nationality shall furnish the following details in their offer:
    - 2.1.1 The name and address of the agents/representatives in India, if any and the extent of authorization and authority given to commit the Principals. In case the agent/representative be a foreign Company, it is to be conformed whether it is real substantial Company and details of the same shall be furnished.
    - 2.1.2 The amount of commission/ remuneration included in the quoted price(s) for such agents/ representatives in India.
    - 2.1.3 Confirmation of the Tenderer that the commission/remuneration if any, payable to his agents/ representatives in India, is to be paid by KoPT in Indian Rupees only.
  - 2.2 **Tenderers of Indian Nationality shall furnish the following details in their offers:**
    - 2.2.1 The name and address of the foreign principals indicating their nationality as well as their status, i.e. whether manufacturer or agents of manufacturer holding the Letter of Authority of the Principal specifically authorizing the agent to make an offer in India in response to tender either directly or through the agents /representatives.
    - 2.2.2 The amount of commission/remuneration included in the price(s) quoted by the Tenderer for himself.
    - 2.2.3 Confirmation of the foreign principals of the Tenderer that the commission/remunerations, if any, reserved for the Tenderer in the quoted price(s), is to be paid by KoPT in India in equivalent Indian Rupees.
  - 2.3 In either case, in the event of contract materializing, the terms of payment will provide for payment of the commission/remuneration, if any payable to the agents/representatives in India in Indian Rupees on expiry of 90 days after the discharge of the obligations under the contract.
  - 2.4 Failure to furnish correct and detailed information as called for in paragraph-2.0 above will render the concerned tender liable for rejection or in the event of a contract materializing, the same liable to termination by KoPT. Besides this there would be a penalty of banning business dealings with KoPT or damage or payment of a named sum.



**THE BOARD OF TRUSTEES FOR SYAMA PRASAD MOOKERJEE PORT, KOLKATA**

**FORM OF TENDER**

To

The Chief Engineer, KDS

Syama Prasad Mookerjee Port, Kolkata.

I/We \_\_\_\_\_ having examined the site of work, inspected the Drawings and read the specifications, General & Special Conditions of Contract and Conditions of the Tender and all other documents hereby tender and undertake to execute and complete all the works required to be performed in accordance with the Specification, Bill of Quantities, General & Special Conditions of Contract and Drawings prepared by or on behalf of the Trustees and at the rates & prices set out in the annexed Bill of **Quantities for 18 (Eighteen) Months** from the date of order to commence the work and in the event of our tender being accepted in full or in part. I / We also undertake to enter into a Contract Agreement in the form hereto annexed with such alterations or additions thereto which may be necessary to give effect to the acceptance of the Tender and incorporating such Specification, Bill of Quantities, Drawing and Special & General Conditions of Contract and I / We hereby agree that until such Contract Agreement is executed the said Specification, Bill of Quantities, Conditions of Contract and the Tender, together with the acceptance thereof in writing by or on behalf of the Trustees shall be the Contract.

THE TOTAL AMOUNT OF TENDER Rs. **Not to be mentioned here**

(Repeat in words) Not to mention here

I / We require \_\_\_\_\_ days / months preliminary time to arrange and procure the materials required by the work from the date of acceptance of tender before I We could commence the work.

I / We have deposited with the Trustees' FA&CAO, SMP, Kolkata vide Receipt No. \_\_\_\_\_ of \_\_\_\_\_ as Earnest Money.

I / We agree that the period for which the tender shall remain open for acceptance shall not be less than 180 days from the opening date of technical bid.

Dated:

(Signature of Bidder with Seal)

Name of the Bidder:

Address:

**Pre-Bid Query Format**

**Tender Notice No.: SMPK/KDS/CIV /T/2622/60**

**Dt. 29.10.2021**

**Name of Work :- E-tendering for “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA”**

Queries raised by **M/s** .....

Sr. No	Reference of Tender Document/Brief clause		Requirement by the bidder Clarification requested	<u>Reply of SMPK</u>
	Ref.	Brief clause of Tender Document		

## **CHECK LIST TO THE TENDER SCHEDULE**

(For documents to be submitted by the tenderers for acceptance of the tender)

- |    |  |                   |
|----|--|-------------------|
| 1. | Bid Security Declaration   | --Submitted/NA    |
| 2. | Cost of tender schedule  | --Submitted /NA   |
| 3. | <p>(a) Proof of experience in executing similar nature of works completed during last 7 years.<br/>(Similar completed works should be,</p> <p>3(three) works each costing not less than Rs <b>30.59 Crores</b><br/>(or)<br/>2(two) works each costing not less than Rs <b>38.24 Crores</b><br/>(or)<br/>1(one) work costing not less than Rs <b>61.18 Crores</b></p> <p>(b) Proof of average annual turnover should be not less than <b>Rs.22.94 Crores</b> during last 3 years duly certified by the Chartered Accountant verified with UDIN.</p> | --Submitted/NA    |
| 4. | <p>Proof of valid solvency i.e., validity within one year<br/>(Amount as mentioned in the Tender Notice)</p> <p>AND</p>  | -- Submitted / NA |
| 5. | All documents as per Annexure -D   |                   |
| 6. | Section 12 of Bidding Document (To be submitted in Part-II)  | -- Submitted / NA |

**NOTE:**

- (1) The Check List should be signed and submitted by the Tenderers along with their Tenders, duly confirming that they submit the above-mentioned documents.
- (2) The tenders received without Check List duly signing & enclosing and required documents as per the Check List will be liable for rejection.

**PART C- TECHNICAL BID**

## **SECTION – 7**

### **TIME SCHEDULE**



## **SECTION – 8**

### **SITE CONDITION AND SPECIFICATIONS**

SYAMA PRASAD MOOKERJEE PORT, KOLKATA  
Civil Engineering Department

....

1.	Scope of Work		
		1.1	<p>Reconstruction of old 7 NSD berth of size 182.2 m x 26.75 m after demolition of old berth structure to be constructed on insitu bored piles, which will rest on pile muff and necessary beam slab combination and Development of stack yard after dismantling old structures behind the 7 NSD berth at an area of 182.2 m x 61.95 m with paver block topping.</p> <p>For design of the berth following data are given:</p>
			<p>1) The berth structure will rest on pile muff with necessary beam-slab combination for operation of MHC of LHM425 &amp; RMQC.</p> <p>2) Maximum Vessel size 172 mtr. X 25 mtr with DWT 18000 ton.</p> <p>3) Scour depth - The berth is housed in impounded dock basin, thus there is no impact of river current and the basin is in tranquil state.</p> <p>4) Level : The top level of 7 NSD berth is at a level +7.32 m KODS while the dredge bed level of dock basin is 5.18 m. KODS. The dock level water varies from +5.33 m KODS to + 5.18 m. Incidentally the KODS level is 2.82 m below MSL.</p> <p>5) Angle of berthing : As per IS 4651, part-III.</p> <p>6) Velocity of approach : As per IS 4651, part-III.</p> <p>7) Geotechnical data : Recent soil investigation report of site is attached.</p> <p>8) Berthing force is to be considered as per IS 4651, part-III.</p> <p>9) Dia. of Pile will be 1200 mm &amp; Cut off length of Pile will be (-)35.00 m, KoDS.</p> <p>10) RCC to be used will not be below M-40 grade.</p> <p>11) PCC to be used will not be below M-20 grade.</p>



			<div>12) The reinforcement to be used high yield deformed bar of grade Fe500D or Equivalent.</div> <div>13) Construction of Service Trench of 1200mm x 1200mm throughout the periphery both of berth and stacking yard duly provided with heavy duty RCC covers framed with MS Angle 150mm x 150mm x 8mm, whenever necessary.</div> <div>14) Supplying and fixing mild steel liners for pile of required size 8 mm thick along with 12mm stiffener plate of 300mm width to be provided at required level or strata as per the site requirement or as directed by the Engineer-in- Charge (EIC).</div> <div>15) Providing 25mm thick Expansion Joints at the Junction of the deck units in superstructure with 25 mm thick bitumen impregnated fibre board in the gaps of expansion joints to full depth including water sealant at top and bottom filling with joint sealing compound at top.</div> <div>16) Providing and fixing marine fixtures such as SCN 1000H type rubber fender of reputed make like Bridge Stone etc, Stag horn CI bollards of 60T capacity ,Anchor Bolts, Mooring rings, moulded rubber ladders, Safety Chains, D-shackles etc.</div> <div>17) Providing crane track including check rail for RMQC track with 60kg rails on cement concrete bed, fixing to position by holding down bolts and positioning of check rail inside, jointing, check bolting with check blocks, washers, cutting of rails, maintaining gauge, levelling etc., including all accessories and foundation etc.</div> <div>18) Necessary foundation of high mast tower at specified position for proper illumination of berth and stack yard</div> <div>19) Erection and drive of Z-section Sheet Pile (A Z18). to separate the berth area and stacking yard .</div> <div>20) Relevant Indian ISI, IRC and International codes to be used for the design of berth .</div> <div>Uniform distributed live load of 5 T/Sqm. to be considered.</div>
		1.2	For design of Stack Yard:

			<p>1) The stack yard is to be designed for five high 20 tonnes /40 tonnes container with live load.</p> <p>2) Rich stacker and container trailer will operate on the yard.</p> <p>3) The ground development of the yard will have to be made with geo-synthetic stratum mattresses with necessary granular layer, PCC with paver block topping.</p> <p>4) The grade of paver block should not be less than M- 50 grade.</p>
			<p>5) The design should be based on Relevant IS code of latest edition &amp; AASTHO.</p> <p>Other International code are to be used where IS code is not available.</p>
2.	<b>Insure For Performance</b>		<p>The Tenderer to insure with an insurance company for the whole work order amount for a period of 10 years from the date of completion of the work to take care of all risks for satisfactory operations on the Berth No 7, NSD, Kolkata.</p> <p>The bidder shall submit a Bank Guarantee for the Premium Amount payable annually for the entire period of 10 years.</p>
3.	<b>Details of Existing Berth No. 7, NSD, Kolkata</b>		<p>Old Berth No 7 had been constructed on 22-inch dia. franky piles founded in alluvial soil, on pile muff with RCC beam slabs combination etc. The age of existing berth is more than 60 years. It is also to be mentioned that due to ageing effect &amp; continuous mechanical operations over it, its structural member had undergone spalling of concrete, development of cracks, corrosion in reinforcement etc. As a result a portion of Jetty collapsed/damaged in Feb-2018. Now the berth has to be dismantled before new construction.</p>
4.	<b>Location</b>		<p>NETAJI SUBHAS DOCK (NSD) AT KOLKATA DOCK SYSTEM (KDS) OF SYAMA PRASAD MOOKERJEE PORT, KOLKATA.</p> <p>(Formerly known as Kolkata Port Trust).</p> <p></p> <p></p>
5.	<b>Design Requirements</b>		<p>The berth &amp; Stack Yard design shall be based on the detailed survey and soil investigation data (already given) and other relevant data already mentioned. The drawings prepared on the basis of these design along with the drawings required shall from part of the tender document.</p> <p>Detail Design Report and Drawings shall be submitted to the PMC and Engineer in Charge, KDS, SMPK for review, comments and approval first. The work shall have to be carried out in accordance with these approved drawings and such other additional drawings prepared or modified as per comments of PMC and Engineer in Charge of KDS, SMP, Kolkata.</p>
		<b>5.1</b>	<p>The bidder to adopt Layout as proposed by the PMC and SMP for the berth &amp; Stack Yard construction.</p>
		<b>5.2</b>	<p>Design Criteria: The work to be executed should be as per relevant Codes of Bureau of Indian Standards, in the absence of which other relevant International standard (ASTM &amp; British Standards) may be followed.</p> <p>The data already mentioned are strictly to be used in designing the berth and stack yard structure.</p>
		<b>5.2.1</b>	

			<p>I. For MHC Standard load of LHM-425 is to be considered.</p> <p>II. <b>Rail Mounted Quay Crane (RMQC)</b>, 40 T lifting capacity under Spreader at 40 m outreach with compliance of FEM and DIN EN standards.</p> <p>III. Uniformly Distributed load of 5 tonnes per Sqm. on the wharf.</p>
		<b>5.2.2</b>	<b>Lateral Load:</b>
			<p>i) <u>Earth Pressures</u>: Due to soil in contact with the structures including the effect of surcharge loading of 5 tonnes per Sqm. Behind the berth. For Computation of earth pressure, the soil parameters should be taken.</p> <p>ii) <u>Berthing Impact</u>: Berthing force is to be considered as per IS 4651, part-III.</p> <p>iii) Vessel Dimensions: Vessels of size DWT 25500 MT, LOA 172 mts. Beam 25 mts. Drought 8.5 mts., Berthing Velocity and Berthing angle as per IS 4651, part-III.</p> <p>iv) Bollard Pull: 60 tonnes on each of the Bollards to act simultaneously on all the bollards of every unit of berth from joint to joint.</p> <p>v) Seismic force as per relevant IS Code.</p> <p>vi) The effect of temperature on Shrinkage forces.</p> <p>vii) Permissible Stresses, partial safety factors for loads as per IS:4651.</p>
		<b>5.2.3</b>	<b>Sub-Structure:</b>
			Limit State Method of Design is to be adopted and Partial Safety Factors of Materials and Loads should be as follows:
			<p>i) <u>Partial Safety Factor for Strength of Concrete</u>: 1.5</p> <p>ii) <u>Allowable Stresses in Steel</u>:</p> <p>a) Under Factored Load Conditions- 250 N/sqmm</p> <p>b) Under Working Load Conditions- 165 N/sqmm.</p> <p>iii) <u>Load Factors</u>:</p> <p>a) DL, LL and Earth Pressure- 1.5</p> <p>b) 15% increase in allowable stress in steel is allowed while designing the dock system for load combination of 1.5 (DL+LL+EP).</p> <p>c) Surface Crack width is limited to 0.004 times to clear cover to the main reinforcement.</p> <p>d) Minimum M40 Grade of Concrete &amp; Fe 500D Grade of Steel reinforcement are to be used.</p> <p>e) Minimum reinforcement in Piles shall be 0.8% of the cross-sectional area of that Pile.</p>
		<b>5.2.4</b>	<b>Super-Structure:</b>
			Limit State Method of Design is to be adopted and Partial Safety Factors of Materials and Loads should be as follows:

			i) <u>Partial Safety Factor for Strength of Concrete:</u> 1.5 ii) <u>Allowable Stresses in Steel:</u> a) Under Factored Load Conditions- 250 N/sqmm. b) Under Working Load Conditions- 165 N/sqmm. iii) <u>Load Factors:</u> a) DL, LL and Earth Pressure- 1.5 b) 15% increase in allowable stress in steel is allowed while designing the dock system for load combination of 1.5 (DL+LL+EP). c) Surface Crack width is limited to 0.004 times to clear cover to the main reinforcement. d) Minimum M40 Grade of Concrete & Fe500D Grade of reinforcement are to be used. e) Expansion Joints in the Structure should be provided as per relevant IS Code.
6.	Design of Structures		
		6.1	General:
			i) The complete structure shall be designed to be safe against collapse and to maintain at all times and acceptable serviceability level. These shall also be designed to be durable to withstand the deteriorating effect of the climate and environment. It is further agreed that any failure or omission of the PMC to review and/or
			comment hereunder shall not be construed or deemed as acceptance of any such agreement or document by the Authority. No review and/ or observation of the PMC and / or its failure to review and/ or convey its observations on any document/ drawing shall relieve the bidder of its obligations and liabilities under this contract agreement in any manner nor shall the Authority be liable for the same in any manner whatsoever. ii) The bidder is encouraged to adopt innovative / latest techniques in design, construction and use of new materials special Green concrete. However, in all such cases bidder shall submit all the relevant details along with guidelines and proprietary literature proposed to be followed to PMC/SMPK Authority for review and comment. It is further agreed that any failure or omission of the PMC to review and/or comment hereunder shall not be construed or deemed as acceptance of any such agreement or document by the Authority. No review and/ or observation of the PMC and / or its failure to review and/ or convey its observations on any document/ drawing shall relieve the bidder of its obligations and liabilities under this contract agreement in any manner nor shall the SMPK Authority be liable for the same in any manner

			whatsoever.
		6.2	<b>Type of Structure:</b>
			<div><div>i)</div><div>The bidder shall submit the designs for the structural system proposed which is in the Tender. Design and layout of the structures shall be suitable for the soil / site condition of the proposed location.</div><div>ii)</div><div>The Sub-structure, Superstructure and Foundation may be of reinforced concrete.</div></div>
		6.3	<b>Analysis and Design of Structures:</b>
			All structures and their individual components shall be designed and developed as per latest relevant Indian Standard Codes depending upon the type of Structure/ individual component proposed to be provided. The minimum cross-sectional dimensions of each component shall be provided so as to satisfy the requirements specified in the relevant IS Codes and the Design shall be taken into account long term durability, serviceability, constructability, construction methodology and environmental factors. The earth retaining structure shall be designed for lateral earth pressure, surcharge and hydrostatic pressures and other horizontal loads.
		6.4	<b>Design Report and Drawings:</b>
			The Tenderer shall furnish detailed designs and drawings for each component of the project such as Layout Plan, Berth Structures, Drainage, Fixtures and other user facilities etc., as per the requirements specified to the PMC/Engineer in Charge for their review and comments, if any in both soft and Hard copy. It is further agreed that any failure or omission of the PMC to review and/or comment hereunder shall not be construed or deemed as acceptance of any such agreement or document by the Authority. No review and/ or observation of the PMC and / or its failure to review and/ or convey its observations on any document/ drawing shall relieve the bidder of its obligations and liabilities under this contract agreement in any manner nor shall the Authority be liable for the same in any manner whatsoever.

<b>7.</b>	<b>Materials</b>		
		<b>7.1</b>	<b>Natural Materials:</b>
			Physical requirement of earth, sand, gravel and aggregates shall confirm to the requirements of the provisions of the relevant Indian Standards.  Natural aggregates when crushed and blended for various uses different size frictions shall be proportioned to form grading conforming to the to the requirements of the relevant Indian Standards as are relevant to the intended use of the materials.
		<b>7.2</b>	<b>Processed Materials:</b>
		<b>7.2.1</b>	<b>Cement Concrete Mixes:</b>
			PCC and RCC shall be design mixes, in accordance with the provisions of latest IS-456. Concrete of M 40 grade or higher shall be used for the project, except for the levelling courses in foundations, where not lesser than M 20 grade to be used. Specific requirements of the mixes (such as Workability, W/c Ratio, use of Admixtures, Grades of Cement & Steel, Minimum & Maximum Cement content, Characteristic Strength of Concrete etc.) have to be as per latest IS Standards.
		<b>7.3</b>	<b>Manufactured Materials:</b>
		<b>7.3.1</b>	<b>Cement:</b>
			Ordinary Portland Cement of grade 33, 43 & 53 conforming to IS-269, IS-8112 and IS-12269 respectively or Portland Slag Cement conforming to IS-455 shall be used subject to the condition that the design cement content should not be less than 450 Kg/Cum and as per requirement of cement from durability considerations as provided. It is explicitly classified that the use of Portland Pozzolana Cement <b>shall not be</b> permissible for any Structural concrete work.
		<b>7.3.2</b>	<b>Steel:</b>
			High Yield Strength Deformed (HYSD) reinforcing bars of Fe 500D grade conforming to IS-1786. Expansion Joints, Anchor Bolts, Fenders, Bollards, Ladder shall meet the relevant provisions of the IS Codes, recommendations of the system providers, manufacturer testing and certification and the designer design assumptions.  The bidder may use other construction materials for which a detailed design produced to be adopted shall be furnished to PMC and SMP, Kolkata for review and comments.
		<b>7.4</b>	<b>Additional Conditions Regarding Supply and Procurement of Cement &amp; Steel:</b>
			SMP, Kolkata will not supply Cement & Steel. The Contractor shall procure steel and cement required for both permanent and temporary works unless specified otherwise and the materials shall comply with relevant IS Codes and given as below. Any wastage of Cement and steel including the consumption for temporary works shall be to the account of the Contractor (s) and the rate entered in the Contract shall cover the above aspects and <b>No Claim</b> will be entertained on these aspects .
		<b>7.4.1</b>	<b>Cement:</b>

			<p>The Contractor (s) shall procure PSC &amp; OPC conforming the relevant IS Codes (latest edition) as required for the work from approved manufacturers of cement having adequate production capacity as approved by the Ministry of Industries, Government of India and holding valid license to use ISI certification mark. Supply of Cement shall be taken in 50 Kg. HDPE Bags or by cement bulker bearing manufacturers name and ISI marking. Probable list of reliable suppliers may be enclosed to the Tender for cement and obtain approval of PMC &amp; SMP, Kolkata. The</p>
--	--	--	--

			responsibility for selection of proper manufacturers forgetting the desired strength of concrete shall however rest entirely with the Contractor .
			<div><div>i)</div><div>Each consignment of the cement to be brought at site shall be approximately 100 tons or as directed by the Engineer-in-Charge along with manufacturer’s test certificate.</div><div>ii)</div><div><div><div>The Contractor (s) shall arrange testing of cement for each batch in accordance with provisions of relevant IS code and only to be tested from Govt. Authorised Laboratories or Reputed Technical Govt. Institute. The contractor should supply the Cement for free for lab-testing. The testing charge shall be borne by the Contractor</div><div>(s) solely. In case the test result indicate that the cement arranged by the contractor does not conform the relevant IS Code, the same shall be rejected and removed from the site by the Contractor (s) at his own cost, within one-week time of written orders from the Engineer-in- Charge to do so and <b>no claim</b> whatsoever will beentertained in this regard.</div></div><div>iii)</div><div>The cement store-room shall be constructed by the contractor separately as per Indian Standard or as directed by Engineer-in-Charge, for which <b>no extra</b> payment can be claimed by the Contractor . The Contractor shall be responsible for the watch and ward and safety of the stored cement. The Contractor Shall facilitate the inspection of the cement store to the Engineer-in-charge &amp; PMC at any time.</div><div>iv)</div><div>Manufacturer test certificate including bills corresponding to each lot shall be supplied with every consignment of cement. Base on the same but subject to test above, the cement shall be allowed to be used in the work in case of emergency. However, if the test results at (ii) above do not meet required strength, such cement shall be rejected and removed from the site. Concrete produced with such cement prior to rejection of cement shall be accepted only if the test results of the concrete are satisfactory. If the concrete test results are not satisfactory such work shall be rejected and the same shall be dismantled and redone by the Contractor at his own cost.</div><div>v)</div><div>The cement brought to the site and remained unused after completion of work shall not be removed from the site without prior written permission of the Engineer-in-Charge.</div><div>vi)</div><div>The actual issue and consumption of cement on work shall be regulated and proper account shall be maintained at site.</div><div>vii)</div><div>Any cement bag found damaged or torn or contains less than specified weight (i.e. 50 Kg/ Bag), shall be rejected. Also, if any consignment found defective, the Contractor have to remove that particular consignment from the site with immediate effect or as directed by the Engineer-in-Charge.</div></div></div>
		7.4.2	Steel:



			The Contractor shall procure Steel (both reinforcement & Structural) and Z section MS sheet pile required for the works both temporary and permanent including for all fixtures conforming to the												
			relevant IS Code from the main producers viz., <b>M/s VSP, M/s SAIL, M/s TISCO etc.</b> as approved by the Ministry of Steel, Govt. of India. The Contractor (s) shall obtain and furnish bills and valid test certificates to the Engineer-in- Charge in respect of all supplies of Steel brought by the Contractor to the site.												
			<div><div><div><div>i)</div><div>Steel Reinforcement Bars: The reinforced steel shall be HYSD Bars of Fe 500 D grade and shall meet the requirements as specified in relevant IS Code (Latest version).</div></div><div><div>ii)</div><div>Structural Steel: The Structural steel viz., MS Plates, Channels, Joists, Flats, Angles etc., shall conform to IS:2062 (latest version). The steel shall be brought to the site in bulk supply of 10 tonnes or as directed by Engineer-in-Charge.</div></div><div><div>iii)</div><div>The Mild steel bars shall conform to Grade- I of IS:432 Part- I or latest revision.</div></div><div><div>iv)</div><div>Z section MS sheet pile(Az18)shall be conform to relevant IS code.</div></div><div><div>v)</div><div>The Steel shall be stored by the Contractor at site such a way as to prevent distortion and corrosion, if not, the Contractor has to replace them at his own cost. Bars of different sizes shall be stored separately to facilitate PMC/Engineer-in- Charge easy access of counting and checking.</div></div><div><div>vi)</div><div>For checking nominal mass, Tensile Strength, Bend test, Re-bend test etc. as per IS Code, Specimen of sufficient size shall be cut from each size of the section at random and frequency not less than that as specified below: -</div></div></div><table><tr><th>Size of Bar</th><th>For Consignment Below 100 Tonnes</th><th>For Consignment Above 100 Tonnes</th></tr><tr><td>Under 10mm Dia.</td><td>One sample for each 25 tonnes or part thereof.</td><td>One sample for 40 tonnes or part thereof.</td></tr><tr><td>10mm to 16mm Dia.</td><td>One sample for each 35 tonnes or part thereof.</td><td>One sample for 45 tonnes or part thereof.</td></tr><tr><td>Above 16mm Dia.</td><td>One sample for each 45 tonnes or part thereof.</td><td>One sample for 50 tonnes or part thereof.</td></tr></table><div><div><div>vii)</div><div>The contractor shall supply free of charge the steel specimen required for testing. The cost of tests shall also to be borne by the Contractor only. Testing of steel shall be done in any Govt. Authorised Laboratories or Reputed Technical Govt. Institute.</div></div><div><div>viii)</div><div>The actual issue and consumption of steel (both reinforcement , structural &amp; sheet pile) on work shall regulated and proper accounts shall have to be maintained by the contractor.</div></div><div><div>ix)</div><div>Steel brought to site and remaining un-used shall be removed from site duly after obtaining written .permission of the Engineer-in-Charge.</div></div></div></div>	Size of Bar	For Consignment Below 100 Tonnes	For Consignment Above 100 Tonnes	Under 10mm Dia.	One sample for each 25 tonnes or part thereof.	One sample for 40 tonnes or part thereof.	10mm to 16mm Dia.	One sample for each 35 tonnes or part thereof.	One sample for 45 tonnes or part thereof.	Above 16mm Dia.	One sample for each 45 tonnes or part thereof.	One sample for 50 tonnes or part thereof.
Size of Bar	For Consignment Below 100 Tonnes	For Consignment Above 100 Tonnes													
Under 10mm Dia.	One sample for each 25 tonnes or part thereof.	One sample for 40 tonnes or part thereof.													
10mm to 16mm Dia.	One sample for each 35 tonnes or part thereof.	One sample for 45 tonnes or part thereof.													
Above 16mm Dia.	One sample for each 45 tonnes or part thereof.	One sample for 50 tonnes or part thereof.													
		7.4.3	Cement and Steel:												

			<p>i) The supply of cement and steel by the Contractor shall include cost of materials, all taxes, all Duties levied by State/ Central Govt. from time to time, transportation, storage etc., all complete.</p> <p>ii) Any damage, loss, thefts etc., of cement &amp; Steel shall be to the account of Contractor and the Contractor shall arrange necessary watch/security etc for safe guard at their own cost.</p>
<b>8.</b>	<b>Technical Specification</b>		
		<b>8.1</b>	<b>Part I: Special Application</b>
		<b>8.1.1</b>	<b>Drawing List:</b>
			<p>(a) Three drawings are attached with the Tender documents:</p> <p>(i) Layout of NSD (ii) Sketch of new berth no.7,NSD and adjacent stack yards (iii) Layout of old 7,NSD berth with position of existing Franky piles.</p> <p>(b) The design &amp; drawings prepared during <b>Engineering</b> of the project and subsequently approved by the Engineer - In- Charge shall also form part of the contract for the purpose of execution of the project and shall be signed by the PMC, Engineer-in-Charge and the Contractor for Identification.</p> <p>Supplementary drawings, which are required for construction work during execution of the project to be submitted by the contractor time to time and subsequently approved by the Engineer-in- Charge after verification by PMC will also form part of the contract.</p>
		<b>8.1.2</b>	<b>Preamble:</b>
			The Technical Specifications contained herein shall be read in conjunction with the other Bid Documents.
		<b>8.1.2.1</b>	<b>General:</b>
			The Technical Specifications covering the materials and the workmanship aspects as well as method of measurements and payments are included in this section. These Specifications cover the items of Civil and Non-Civil works coming under scope of this document. All works shall be carried out in conformity with the same. These Specifications are not intended to cover the minute details. The works shall be executed in accordance with good practices followed for achieving high standards of workmanship, thus ensuring safety and durability of the construction. All codes and standards referred to in these specifications shall be the Latest version there of unless otherwise stated.
		<b>8.1.2.2</b>	<b>Inclusive Documents:</b>

			<p>The provisions of special conditions of contract, those specified elsewhere in the tender document, as well as execution Drawings and Notes, or other specifications issued in writing by the Engineer-in-Charge shall form part of the Technical Specifications of this project.</p> <p>The attention of the Contractor is drawn to those clauses of codes, which require supporting specification either by the Engineer-in-Charge or by ‘Mutual’ Agreement between the “Supplier &amp; Purchaser “. In such cases, it is the responsibility of the Tenderer / Contractor to seek clarification on any uncertainty and obtain prior approval of the Engineer-in- Charge before taking up Supply/Construction. In absence of such prior clarification, the Engineer-in-Charge’s instruction will be final and binding on the Contractor without involving separately any additional payment.</p>
		<b>8.1.2.3</b>	<b>Other Contractors :</b>
			<p>The Contractor shall allow reasonable facilities to other Contractors working in same area during execution of this contract and ensure that no damage to them is caused to any equipment or installations there due to negligence of his own and / or his Sub-contractor’s workmen.</p>

		8.1.2.4	<b>Contractor’s Working Area:</b>
			<p>The land for establishment of office and store will be provided to the Contractor at free of cost by the client.</p> <p>The land for the Batching Plant, Pre-cast Yard, Rebar Yard and other temporary facilities may be given on rent as per standard rate of trustees and as per prevalent guidelines within a distance of about 5 Km from the site of work.</p>
		8.1.2.5	<b>Testing of Materials:</b>
			<p>All Materials to be used in the work shall be subject to inspection and test. The Contactor shall carryout sampling of such materials and making of concrete test cubes as and when instructed by the Engineer-in-Charge/PMC as per the appropriate Indian Standards and as directed by the Engineer-in-Charge. The Contractor shall deliver the samples of materials and concrete test cubes to the approved laboratory in manner as directed by the Engineer- in Charge, who will conduct testing of the materials and concrete cubes.</p> <p>The cost of charges for sampling of materials and concrete cubes, and delivering same to the laboratory including all incidentals in connection with the same as directed by Engineer-in-Charge shall be borne by the Contactor and shall be deemed to be included in his rate.</p> <p>The contractor can establish a laboratory at site for field testing and cube testing with latest/valid calibrations by the Competent Authority of all equipments of testing.</p> <p>However 70% of total testing can be done at field laboratory and rest 30 % will have to be done at NTH or any reputed Govt Technical Institute’s laboratory.</p>
		8.1.2.6	<b>Metric Unit:</b>
			<p>Metric Unit have been used as far as possible, in the Specification and on all Drawings.</p>
		8.1.2.7	<b>Seismic Zone:</b>
			<p>The project lies in Seismic Zone-III as defined in IS- 1893</p>
		8.2	<b>Part II: Material</b>
		8.2.1	<b>General:</b>
		8.2.1.1	<b>Indian Standards:</b>
			<p>All materials shall as far as possible be of Indian Origin and confirm to the latest editions of the Indian Standards. Standards issued elsewhere may be used only if approved by the Engineer-in-Charge for these materials only, for which appropriate Indian Standards do not exist.</p>
		8.2.1.2	<b>Sampling and Testing:</b>

			<p>Materials as decided by the Engineer-in-Charge to be used in the permanent works shall be subjected to inspection and test and samples of such materials shall be submitted to the Engineer-in-Charge for approval before these are brought to the Site.</p> <p>Samples provided to the Engineer-in-Charge or his representative for their retention is to be labelled boxes, suitable for storage. Materials or workmanship not conforming to the quality with approved samples will be rejected by the Engineer-in-Charge or his representatives. Samples required for approval and testing must be supplied in sufficient quantity and time to allow for testing and approval due allowance being made for the fact, that if the first sample fails subsequent samples may be required. Delay to the works arising from the late submission of samples will not be acceptable as a reason for delay in the completion of works.</p>
			<p>Materials shall be tested before leaving the manufacturer's premises wherever possible. Materials shall also be tested on the site and they may be rejected if found not be suitable or not in accordance with the specification notwithstanding the results of tests at the manufacturer's works or elsewhere or of tests certificate or of any approval given earlier by the Engineer-in-Charge.</p>
		<b>8.2.1.3</b>	<b>Storage of Materials:</b>
			<p>Materials to be used in the permanent works shall be stored on Stacks, supports, in bins, under-cover etc., as appropriate to prevent deterioration or damages from any cause whatsoever to the entire satisfaction of the Engineer-in-Charge or his representative and as amplified in the succeeding clauses.</p>
		<b>8.2.1.4</b>	<b>Records and uses of Materials:</b>
			<p>The Contractor (s) shall maintain a detailed record of the materials received at site or in his stores or storage and working areas in the vicinity of the site and shall make such records available to the Engineer-in-Charge and PMC at anytime or at any later date may be reasonably require. Materials shall wherever possible and practicable be used in the order in which they arrived on the site and in the stores or storage and working areas in the vicinity of the site.</p>
		<b>8.2.1.5</b>	<b>Notice for Inspections of Materials:</b>
			<p>Where the Engineer-in-Charge or his representative or PMC shall give notice to the Contractor that materials are to be inspected at the site, the Contractor shall arrange for inspections, tests or examination required, give information to the Engineer-in-Charge or his representative when such materials are ready for inspection, tests or examinations, either during manufacture, fabrication etc., or on completion,</p>
		<b>8.2.1.6</b>	<b>Use of Permanent Materials for temporary Works:</b>
			<p>Materials for the permanent works shall not be used for temporary works unless otherwise approved in writing by the Engineer-in-Charge. Granting of such permission shall not prejudice the right the Engineer-in-Charge (EIC) to reject materials so used which have become unfit for use in the permanent works.</p>

		8.2.2	Cement:
		8.2.2.1	Ordering Weighment:
			<p>The Contractor shall submit to the Engineer-in-Charge (EIC) immediately after the beginning of the contract and estimate of total quantity of cement for both permanent and temporary works required for the contract.</p> <p>The Contactor shall make necessary arrangement for testing of Cement for each consignment along with manufacturer test certificate and furnish the same to the Engineer-in-Charge.</p>
		8.2.2.2	Contractor (s)’s Responsibilities:
			<p>The Contractor shall be responsible for keeping the cement in sound and acceptable condition. Any cement which deteriorates while in the Contractor ’s charge and to be rejected as unsuitable by the Engineer-in-Charge shall be removed from the site and replaced by the Contactor at their own cost.</p>
		8.2.2.3	Storage and use of Cement:
			<p>The cement will be stored in such a manner as to permit easy access for proper inspection and in a suitable weather tight well-ventilated building to protect the cement from dampness.</p>
		8.2.2.4	Rejection of Cement:
			<p>The Engineer-in-Charge may reject any cement, which has</p>
			<p>deteriorated owing to the inadequate protection or other causes, or in any other cases where cement is not up to his satisfaction. The Contractor shall remove all rejected cement from the site with immediate effect or as directed by Engineer-in-Charge.</p>
		8.2.3	Concrete Aggregate:
		8.2.3.1	Standard:
			<p>All aggregate shall comply with the requirements of IS:383.</p>
		8.2.3.2	Quality:
			<p>Concrete aggregate shall be Hard, Strong, Durable, Clean and free form adherent coatings or other deleterious matters and shall be obtained from a Govt. approved source. Aggregates which are not perfectly clean shall be wash thoroughly in clean fresh water to the satisfaction of the Engineer-in-Charge. Coarse Aggregates shall be obtained from hard Granite stone by crushing.</p>
		8.2.3.3	Testing:
			<p>Prior to commencement of work, representative samples of various aggregates from each source of supply shall be submitted to the Engineer-in-Charge for testing and approval. Samples shall be sufficient in quantities to enable the engineer-in-Charge to carry out the full range of tests in accordance with IS:2386 (Part I to VIII).Only aggregates from sources of supply, which pass the requisite tests and are approved by the Engineer-in-Charge, may subsequently be used in the works and all aggregates used in the works shall be at least equal to the approved samples.</p>
		8.2.3.4	Storage at Site:

			Aggregate shall be stored at site on cleaned, well-paved and drained areas which are not liable to flooding. The various sizes and types of aggregate shall be separately stacked.
		<b>8.2.3.5</b>	<b>Rejected Materials:</b>
			Any aggregate brought to the site, which are not approved by the Engineer-in-Charge, shall be immediately removed from the site or as directed by the Engineer-in-Charge, at the Contractor (s)'s own cost.
		<b>8.2.3.6</b>	<b>Fine Aggregates:</b>
			Fine Aggregates shall consist of sand from any Govt. approved source. Fine Aggregate shall be washed in an approved washing plant if ordered to conform to either Grading Zone- I or II or III, as specified in IS:383.
		<b>8.2.4</b>	<b>Water:</b>
			Clean fresh water shall be used for mixing all concrete, grout & mortar. It shall be free from injurious and bunt of soil, acid, alkalis, organic matters or other deleterious matter including Saline water.
		<b>8.2.5</b>	<b>Admixtures for Concrete:</b>
			Admixtures to the concrete shall not be used without the written permission of the Engineer-in-Charge. When permitted, the contractor shall furnish full details from the manufacturers and shall carry out such tests as the Engineer-in-Charge may require before any Admixture to be used in the work.
		<b>8.2.6</b>	<b>Steel Reinforcement:</b>
		<b>8.2.6.1</b>	<b>Standard:</b>
			Mild Steel reinforcing bars for concrete shall be round in cross section and shall comply with requirements of Grade- I IS:432. HYSD bars for concrete reinforcement shall comply with the requirements and tests as per IS:1786.
		<b>8.2.6.2</b>	<b>Ordering:</b>
			The contractor shall submit to the Engineer-in-Charge
			immediately after the beginning of the Contract, estimate of the total quantity of steel required for both Temporary as well as for Permanent works.
		<b>8.2.6.3</b>	<b>Tests:</b>
			The contractor has to arrange for tests on samples of each consignment along with manufacturers tests certificates as per the provisions of Indian Standards and the same shall be submitted to the Engineer-in-Charge. Any Steel fails in test and found unfit to use shall be removed from the site immediately or as directed by the Engineer-in-Charge.
		<b>8.2.6.4</b>	<b>Contractor 's Responsibilities:</b>
			Once a consignment is approved by the Engineer-in-Charge, it shall be stored in a clean and acceptable condition until it is required to be used. Any steel rendered unsuitable during storage shall be replaced by the contractor at his own cost.
		<b>8.2.7</b>	<b>Structural Steel:</b>
			Structural Steel used in work, other than steel in reinforced bars shall conform to IS:226 - "Structural Steel (Standard Quality)" and IS: 2062- "Structural Steel (Fusion Welding Quality)". Sheet pile should be conform to relevant Indian standard.
		<b>8.2.8</b>	<b>Bentonite:</b>

			<p>Sodium based bentonite shall be used in preparation of bentonite-slurry. The bentonite used in the work shall satisfy the following requirements:</p> <ul style="list-style-type: none"> <li>i) The Liquid Limit of Bentonite shall be more than 300% and less than 450%.</li> <li>ii) Sand content of the Bentonite Powder shall not be greater than 7%.</li> <li>iii) The Swelling Index shall be at least two times its dry volume.</li> <li>iv) The PH value of the Bentonite suspension shall be less than 11.50.</li> <li>v) Bentonite solution shall be made by mixing it with fresh water, using pump for circulation. The density of the bentonite solution should be about 1.12.</li> <li>vi) The Marsh-Viscosity when tested by Marsh Cone shall be about 30 seconds.</li> </ul>
		<b>8.2.9</b>	<b>Jointing Materials:</b>
		<b>8.2.9.1</b>	<b>Joint Filler:</b>
			Preformed Joint-filler shall be of approved manufacturer as decided by the Engineer-In-Charge.
		<b>8.2.9.2</b>	<b>Sealing Compound:</b>
			Where joint sealing compound is specified, it shall be of an approved brand. It shall have good adhesive properties free from any corrosive effect and shall not slump in vertical or inclined joint nor shall it bleed into or corrode the materials with which it is in permanent contact and shall have to be used after approval of the same by the Engineer-In-Charge.
		<b>8.3</b>	<b>Workmanship:</b>
		<b>8.3.1</b>	<b>General:</b>
		<b>8.3.1.1</b>	<b>Standard:</b>
			A high standard of workmanship in all item of works will be required. The Contractor shall ensure that only skilled and experienced trade-men are employed during execution of work.
		<b>8.3.1.2</b>	<b>Plant:</b>
			The Contractor shall be responsible for the supply, use and maintenance of all construction plants and equipments and they shall ensure that all those P& E are suitable for the work and are maintained in such manner as to ensure their efficient working and duly calibrated as per standard by an Authorised Approved Agency. The Engineer-in-Charge may direct that any plant which is not efficient and prejudicial to the quality
			of the work to be removed from the site and replaced by a new plant to his satisfaction.
		<b>8.3.1.3</b>	<b>Supervision:</b>
			The Contractor's supervisory staff shall be qualified and experienced in the type of work being carried out through their supervision and capable of ensuring execution of quality work.
		<b>8.3.1.4</b>	<b>Temporary Works:</b>
			Where required, the Contractor shall furnish such details of his temporary works as may be called for by the Engineer-in-Charge and the Contractor shall satisfy the Engineer-in-Charge as to their safety and efficiency. The Engineer-in-Charge may direct any temporary works which he considers unsafe or inefficient and that shall be removed and replaced immediately by the contractor.
		<b>8.3.2</b>	<b>Excavation and Backfilling:</b>
		<b>8.3.2.1</b>	<b>General:</b>



			The whole of the excavation for the foundation works shall be carried out to the Widths, Lengths and Depths and within the Lines and Levels, indicated in the Drawings or as directed by the Engineer-in-Charge/ PMC. Any excavation beyond such limits or instructions shall have to be make good by the contractor at his own expense to the satisfaction of the Engineer-in-Charge/ PMC.
		<b>8.3.2.2.</b>	<b>Method of Excavation:</b>
			The Contractor may carry out these excavations by any method, he considers most suitable, subject to any stipulations contained in the contract and in the specifications but take the permission from Engineer –in –Charge to adopt that method for execution.
		<b>8.3.2.3</b>	<b>Shoring:</b>
			The Contractor (s) shall provide all shoring, timbering or other approved supports at sites of the excavations as may be necessary to prevent ground movement at his own cost. The contractor shall bear all responsibilities connected with such shoring, including de-watering after approval of the Engineer-in-Charge at his own cost.
		<b>8.3.2.4</b>	<b>Bottom of Excavation:</b>
			The bottom of all excavations shall be trimmed and levelled in accordance with the Drawings.
		<b>8.3.2.5</b>	<b>Disposal of Excess Excavations:</b>
			The excavated/dismantled materials not required for filling is to be transported on roads disposed of from the site as directed by the Engineer-in-Charge. The site must at all times be kept free from surplus materials.
		<b>8.3.2.6</b>	<b>Backfill:</b>
			All return fill to the excavated trenches, pits and filling behind the berth shall consist of material selected from excavationsor elsewhere as approved by the Engineer-in-Charge.
		<b>8.3.3</b>	<b>Piles:</b>
		<b>8.3.3.1</b>	<b>Method of Construction:</b>
			The Contractor (s) must furnish to the engineer-in-Charge/PMC, before commencing work, a detailed method of construction intending to adopt for Pilling work together with the programme of construction for his approval and then start the work.
		<b>8.3.3.2</b>	<b>Drilling Fluid:</b>
			Bentonite shall be mixed thoroughly with clean fresh water to make a suspension, which will maintain the stability of the pile excavation for the period, necessary to place concrete and complete construction. The fluid used shall be such as to form a suspension, which remains stable under the saline conditions, likely to be encountered at the site.

			<p>Control tests shall be carried out on the bentonite suspension using suitable apparatus. The frequency of testing the drilling fluid and the method and procedure of sampling shall be as directed by the Engineer-in-Charge/ PMC. The density of freshly mixed bentonite suspension shall be measured daily as a check on the quality of the suspension being formed.</p> <p>The measuring device shall be calibrated to read to within 0.005 g/ml. Tests to determine Density, Viscosity, Shear Strength and PH-Value shall be applied to bentonite supplied to the pile boring.</p>
		<b>8.3.3.3</b>	<b>General Condition:</b>
			Installation of Bored Cast-in-Situ Piles of specified Diameter to the lines and levels, specified herein after and the Drawings, including Pile-liners, boring, in all types of soils, chiselling in rock, concrete etc.
		<b>8.3.3.4</b>	<b>Concrete Quality:</b>
			Cement to be used in pile foundation shall be Portland Slag Cement (PPC) or Ordinary Portland Cement (OPC) confirming to relevant IS Code (latest version) or as directed by the Engineer-in-Charge. The Grade of concrete for all piles shall be M 40, the cement content of piling work shall be minimum 450 kg/Cum and the maximum water-cement ratio shall be 0.40. For obtaining workability of concrete may have to use super-plasticizer as per approval of Engineer-in- Charge, slump shall be between 150mm to 175mm, Maximum size of aggregate shall be 20mm.
		<b>8.3.3.5</b>	<b>Founding Levels of Piles:</b>
			Boring equipment and accessories shall generally conform IS:2911 (Part-I/ Sec.2). Boring may be done by shell and auger, rotary or percussion equipment or grabbing equipment using reversed or direct mud circulation method. The boring tools shall be such that section affects are minimised during boring and extraction of mud. The boring below the bottom of lime of piles shall be carried out by using bentonite slurry which shall be of approved quality. The size of boring tools shall not be less than the diameter of the pile by more than 75mm. The soil obtained during boring including mud shall be disposed as in SPM, Kolkata identified location at a distance of above 10 km .The decision of Engineer-in-Charge shall be final and binding in this regard.
		<b>8.3.3.6</b>	<b>Drilling Mud:</b>
			The level of drilling mud shall always be maintained above the level of high water. Care shall be taken that due boring and removal of the soil, the hole shall remain almost full with the fluid which should preferably be kept in motion the density and composition of the bentonite fluid shall be such as will suit the ground conditions and maintained fine materials from the boring in suspension are shall conform to IS:2911 (Part I/ Sec.2).
		<b>8.3.3.7</b>	<b>Mild Steel Liner:</b>
			Permanent Mild Steel Liners shall be provided as shown in the drawings. Mild steel liner shall be provided for all piles from cut-off level upto the required levels as directed by the Engineer-in-Charge (EIC).

		8.3.3.8	Cleaning of Borehole Bottom:
			The bottom of the hole shall be cleaned carefully before concreting work is taken up. The cleaning of the hole shall be ensured either by the sling with fresh drilling mud injected at the bottom of the hole or by Air lifting process. To lift the soil from founding level before concreting the bottom of the
			bore hole shall be agitated by jetting with drilling mud at higher pressure than that used during boring or by Air pressure, the specific gravity of the mud suspension near the bottom of bore hole shall be regularly monitored. Suitable slurry-sampler shall be used for this purpose. Consistency of the drilling mud suspension shall be maintained throughout the boring as well as during concreting operation in order to keep the hole stabilised as well as to avoid concrete mixing up with the thicker suspension of the mud. Concreting shall not be taken up if the density of bottom slurry is more than 1.2.
		8.3.3.9	Concreting:
			Concreting of pile shaft shall start as soon as possible after the procedure for cleaning the borehole bottom specified herein above have been concreted and approval of Engineer-in-Charge obtained. Concrete shall be placed by means of a tremie pipe, should a borehole be left un- concreted for more than two hours, it shall be cleaned thoroughly as directed by the Engineer-in-Charge before placing concrete. A vermiculite plug should be introduced in the tremie before pouring concrete.  For first pour a plug shall be introduced at the junction of funnel. This plug is then moved and funnel lifted by about 15cm. To allow the concrete to fall and flush out the bottom. During concreting, the concreting levels in the pile shaft shall be checked every 2m intervals in order to note the difference, if any between the theoretical quantity that should have been placed and actual quantity that has gone in. This is to locate the position of overcut during boring and/ or under filling of concrete.

		8.3.3.10	<b>Tremie Concrete:</b>
			<p>The following procedures shall be used in tremie concrete in piles.</p> <ul style="list-style-type: none"><li>i) The concreting of a pile shall be concreted in one continuous operation.</li><li>ii) The hoper and tremie shall be closed system embedded in the placed concrete, through which water cannot pass.</li><li>iii) The hoper shall be large enough to hold a complete batch of concreting minor content of the concrete bucket if any. The diameter of the tremie pipe shall not be less than 200mm.</li><li>iv) The first charge of concrete shall be placed with a sliding plug pushed down the tube a head of it or with a steel plate in adequate charge to prevent mixing of concrete and water. However, the plug shall not be lift in the concrete as a lump.</li><li>v) The tremie pipe shall always penetrate well into the concrete with adequate margin of safety against withdrawal of the pipe.</li><li>vi) All tremie pipes should be scrupulously cleaned after use.</li></ul> <p>Normally concreting of the piles shall be uninterrupted till completion of pile in the exceptional case of interruption on concreting which shall not be more than one hour under any circumstances. The tremie shall not be taken out of the concrete instead it shall be raised and lowered slowly from time to time to prevent the concrete around the tremie from setting. Concreting should be resumed by introducing a little richer concrete with a higher slump for easy displacement of the partly set concrete.</p>

			<p>If the concreting can not be resumed before final setting up of the concrete already placed, the pile so cast may be rejected or accepted with modifications at the sole direction of the Engineer-in-Charge.</p> <p>In case of withdrawal of tremie out of the concrete either accidentally or to remove a Chole in the tremie may be reintroduced in the following manner to prevent the pregation of laitance or scum laying on the top of the concrete already deposited in the bore.</p> <p>The tremie shall be gently lowered on the old concrete with very little penetration initially. A vermiculite plug shall be introduced in the tremie which will push the plug forward and will emerge out of the tremie displacing laitance scum. The tremie will be pushed further in steps making fresh concrete weep away laitance/ scum in its way when tremie is buried by about 60 to 100cm concreting may be resumed.</p>
		8.3.3.11	<b>Cut off Level:</b>
			<p>The top of concrete in a pile shall be brought above the cut off level to permit removal of all laitance and weak concrete before capping and to ensure good concrete at the cut off level for proper embedment into the deck slab.</p> <p>When concrete is placed by tremie method, concrete shall be cast upto the piling platform level to permit overflow of concrete for visual inspection or to a minimum upto 1m above the cut off level. In the circumstances where cut off level is below ground water level the need to maintain a pressure on the onset concrete equal to or greater than water pressure shall be observed and accordingly length of extra concrete above cut off level shall be provided.</p>
		8.3.3.12	<b>Defective Pile:</b>
			<p>In case piles cast are found defective and unacceptable by Engineer-in-Charge, these shall be removed or left in place in case these piles do not affect the performance of the adjacent piles or to permanent works. In such cases additional piles in replacement of defective piles shall be constructed by the contractor at his own cost as directed by Engineer-In-Charge. Any design changes as a result of installation of new piles will be carried out by the contractor at his own cost. Any deviation from the designed location alignment or lead capacity of any pile shall be noted and adequate corrective measures shall be taken by the contractor at his own cost well before the concreting the pile capping if the deviations are beyond the permissible limit.</p>

		8.3.3.13	<b>Tolerances:</b>
			Piles shall be installed as accurately as possible as per the designs and drawings. For the piles a deviation of 0.5% from the vertical line shall not be exceeded however the pile shall not deviate more than 75mm or 1/10 <sup>th</sup> of diameter whichever is more from their designed position at the cut off level. In case of single pile in a pile cap portional tolerance shall not be more than 50mm. In case of piles deviating beyond these limits and to such an extent that the resulting eccentricity can not be taken care of by a redesign of the pile cap or pile ties. The piles shall be replaced by one or more additional piles by the contractor at his own cost along with any additional cost for pile cap being over size. The decision of Engineer-In-Charge shall be final and binding on the contractor. Further the redesign of the pile sub-structure and super-structure associated with the supplemental or additional pile shall be carried out by the contractor at his own cost.
		8.3.3.14	<b>Chipping of Pile Top:</b>
			Manual chipping shall be permitted after 3 days of pilecasting , pneumatic chipping shall not be started before 7 days.
		8.3.3.15	<b>Pile Load Tests:</b>
			<div><div>i)</div><div>The contractor shall conduct 2 nos. of initial pile load tests on test piles on 1200 mm dia. The contractor shall conduct dynamic pile load tests as mentioned below.</div><div>a) 1200 mm dia. piles- 4 nos.</div><div>ii)</div><div>The contractor shall conduct pile integrity tests for 50% of total nos of piles.</div></div>
		8.3.3.16	<b>Adjacent Structures:</b>
			When working near existing structures care shall be taken to avoid any damage to such structures. In case of deep excavations adjacent to piles, proper shoring or other suitable arrangements shall be done to guard against the lateral movement of soil structures or releasing the confirming soil stress.
		8.3.3.17	<b>Reinforcement:</b>
			Main longitudinal reinforcement in the length of the piles as well as links or spirals shall be provided as shown in the drawing. Reinforcing cage shall be handed and installed carefully with suitable PCC cover blocks of grade M 40 at the cost of contractor without damaging its shape of construction of each pile or as directed by Engineer-In-Charge.
		8.3.3.18	<b>Recording of Data:</b>

			<p>During construction of piles the following data shall be recorded along with any other data as directed by Engineer-In-Charge in triplicate on completion of construction of each pile:</p> <div><div>i)</div><div>Data of starting and completion of each pile.</div></div> <div><div>ii)</div><div>Sequence of installation of piles.</div></div> <div><div>iii)</div><div>Dimensions of piles, reinforcement details and marking of each pile.</div></div> <div><div>iv)</div><div>Details of mild steel liner provided along with stiffener.</div></div> <div><div>v)</div><div>Depth bored and founding level along with a borelog indicating nature of sub-soil structure.</div></div> <div><div>vi)</div><div>Time taken for penetration of every 15cm duringlast 1m depth before founding level.</div></div> <div><div>vii)</div><div>Method of cleaning bottom of hole at founding level before concreting.</div></div> <div><div>viii)</div><div>Time taken for concreting.</div></div> <div><div>ix)</div><div>Cut off level / working level / RL of top ofconcrete.</div></div> <div><div>x)</div><div>Actual cement consumption including theoretical consumption, slump of concrete.</div></div> <div><div>xi)</div><div>Any other relevant important observation.</div></div>
--	--	--	---

		<p>The Contractor shall make calculations and carry out all the necessary tests to determine each class of concrete the proportion by weight of cement, Aggregate and water necessary to produce concrete in accordance with the latest relevant IS Code prior to commencement of the works. The contractor shall submit Mixed Design report to the Engineer-In-Charge/PMC for approval of the same from Engineer-In-Charge .</p> <div><div>i)</div><div>The proportion of cement, coarse aggregate, fine aggregate and water so determine.</div></div> <div><div>ii)</div><div>The sieve analysis is of aggregate, which EIC proposes to use in the works.</div></div> <div><div>iii)</div><div>Full details of preliminary tests on each class of concrete and on the ingredients of each class of concrete.</div></div> <div><div>iv)</div><div>All calculations relevant to the design of each class of concrete mix.</div></div> <div><div>v)</div><div>The density of concrete shall not be less than 2.4 tonnes per cum. The proportions adopted shall be subject to the approval of the EIC &amp; they must be determined for each different type of aggregate the contractor proposes to use and whenever contractor proposes to change to a different type of aggregates during the course of work.</div></div> <p>The contractor shall submit Mix Design calculations and carry out all necessary tests to determine for each class of concrete the proportion by weight of cement, Aggregate and water including admixtures (if any) necessary to produce concrete in accordance with relevant standards prior to commencement of the work for approval of EIC/PMC.</p> <p>The concrete to be incorporated in the various items of works shall be of required strength of high durability. The cement used therefore, shall be Ordinary Portland Cement or Portland Slag Cement conforming to IS Code of latest edition. The Min. Quantity cement to be used in each case if stipulated in the respective item specifications are to be maintained during concreting..</p>
--	--	--



			Design Mixed Concrete:

		<p>Approved super-plasticizers in required as per manufacturer's specification shall be used to get the desired workability and strength. The super-plasticizer to be incorporated in the work shall conform to relevant IS Code and shall be of sulphonate naphthalene formaldehyde condensate and shall be compatible with the Portland Slag Cement to be used in the work and shall produce workable concrete without loss of Slump until placed in position thus helping in placing and compaction of the concrete. The super-plasticizer to be used shall be got approved by any Govt. approved laboratory, before incorporation in the work and a test certificate to that effect shall be submitted by the Contractor. The proportion of superplasticizer to be used in concrete shall be determined by the tests as directed by the Engineer-In-Charge.</p> <p>The concrete mix shall be designed for values of target mean strength not lower than those indicated in IS specifications.</p> <p>It is the responsibility of the Contractor to try various mix-proportions to get the required strength and workability specified.</p> <p><u>Note: -</u></p>
--	--	--

			<p>i) Maximum cement content in the mixes shall be subject to the approval of Engineer-In-Charge based on the tests results indicated above. Extra cement if consumed than what is stated above will be to the account of the Contractor. The Contractor is deemed to have ascertained himself of the quantity of extra cement required to achieve the required strength.</p> <p>ii) Even if the required crushing strengths are achieved with lesser quantity of cement, the Minimum quantity specified above shall be used.</p> <p>iii) All coarse aggregates for the concrete works shall be obtained from hard Granite stone.</p>
		<b>8.3.4.3</b>	<b>Declared Proportions:</b>
			When the proportions are submitted to the Engineer-In-Charge, which he considered will produce concrete having the properties requires f, such proportions shall be known as the declared proportions. However, no agreements by the Engineer-In-Charge to such declared proportions, shall relieve the contractor any of his responsibility to use in the works at all times.
		<b>8.3.4.4</b>	<b>No Deviation from Declared Proportions:</b>
			No deviation from declared proportions will be allowed unless and until the EIC shall file his written Authorisation for the adoption of revised proportions for any class of concrete: This provision shall also apply to any revised proportions so Authorised.
		<b>8.3.4.5</b>	<b>Inspection and Testing:</b>
			As the work progresses inspection of cement, aggregate, reinforcing steel and testing of concrete strength will be done by the Engineer-In-Charge/PMC. The Contractor's concrete plant and material stores shall be made accessible to the Engineer-In-Charge/PMC at all times for inspections and taking samples. The contractor shall facilitate in all possible ways the inspection and testing of sampling by the EIC/PMC.
		<b>8.3.4.6</b>	<b>Test Cubes:</b>
			Test cubes shall be made in accordance with <b>IS:516</b> , except that all test cubes unless otherwise ordered by the Engineer-In-Charge shall be compacted by vibration. The contractor shall provide suitable-portable vibration table for compaction of concrete in cubes. Test cubes shall be cured and stored as provided in IS:516, "Methods of tests for strength of concrete". Test tubes used for checking early strength of pre-cast units shall be stored under the same conditions and in contract with the units to which they relate.
		<b>8.3.4.7</b>	<b>Works Tests:</b>
			Not less than six test cubes shall be taken at each section of the work and / or each day's work on each class of concrete. For the purposes of these specifications "Section" of the work shall be as defined by the Engineer-In-Charge.
		<b>8.3.4.8</b>	<b>Concrete Testing:</b>
			All sampling and testing of concrete shall be carried out in accordance with <b>IS:1199</b> , "Method of Sampling and Analysis of Concrete" unless otherwise specifically provided in the specification.
		<b>8.3.4.9</b>	<b>Testing:</b>
			Three out of each batch of six test cubes will be tested by the Engineer-In-Charge for crushing strength and weight at 7 Days and the remaining at 28 days or at such other time as the Engineer may determine.

		8.3.4.10	Cost:
			The cost and charges for sampling and making concrete
			cubes and delivering the same to other places for testing including all incidentals in connection with the same as directed by the Engineer-In-Charge shall be borne by the Contractor.
		8.3.4.11	Measurement of Ingredients:
			The Proportioning of ingredients of concrete shall be performed by an approved weigh-batching machine periodically as determined by the Engineer-In-Charge. Water shall be fed into the mixer from a tank provided with means for adjusting the flow of water suitably measured so as to supply the quantity determined for each class of concrete. Due allowance shall be made for the weight of water carried out by the aggregates, the actual amount added at the mixture being reduced as necessary. For this purpose, the moisture content of coarse and fine aggregates shall be ascertained periodically and at any other times when alterations of the moisture content may be expected due to new deliveries of aggregates, damp weather or any other reason.
		8.3.4.12	Mixing:
			Concrete shall be thoroughly mixed to uniform consistency in approved type pan or drum mixer. The use of continuous mixer will not be allowed. If the contractor should find it expedient to use small type mixer for special or outlying portions of the work rather than to supply from the main batching plant or plants, he may do it subject to the approval of the Engineer-In-Charge, use smaller approved concrete producing units of the weigh-batch type. In such cases the mix shall be adjusted to whole bags of cement and no splitting of bags will be allowed. The times allowed for the mixing shall as per standard and as directed by EIC.
		8.3.4.13	Discharge from Mixer:
			The concrete shall be discharged from the mixer on to a level clean, water type platform or floor or into water type containers. The area surrounding the mixer shall be paved and kept clean.
		8.3.4.14	Transportation of Concrete:
			The concrete shall be transported from the mixer at work place as rapidly as possible and in such a manner that there shall be no separation or loss of its ingredients. In no circumstances shall more than half an hour elapse between the time water is added to the mix and the time when the concrete is placed and compacted in position. No concrete shall be permitted to be used after initial setting taken place. The use of concrete distributing chutes at an angle of more than 45 degrees from the horizontal will not be permitted without the sanction of Engineer-In-Charge. Use of Retarding agents can be permitted with prior approval of EIC at the contractor's cost.
		8.3.4.15	Authorization to Pour:
			Authorization to pour concrete shall be obtained by the contractor from the Engineer-In-Charge at least 1 day in advance for each pouring.

			Where the full height of concrete is not being poured in one continuous operation the surface of each lift shall be finished horizontal and any laitance removed between the period of initial and final set.
		<del>8.3.4.17</del>	
		<b>8.3.4.16</b>	<b>Depositing of Concrete:</b>
			<p>The arrangements of depositing concrete shall be subjected to the approval of EIC. In no case shall the concrete be dropped or thrown from a height of more than 2 metres. Concreting of beams, slabs and similar members shall be carried out in one continuous operation to the full depth of the member and the sequence of placing shall be so arranged as to avoid disturbance of partially set concrete.</p> <p>Freshly laid concrete shall not be wheeled over or otherwise disrupted. When depositing concrete adjacent to a construction joint, special care shall be taken not to disturb the dowels or other reinforcing bars projecting from the existing concrete.</p>
			<b>Compaction of Concrete:</b>
			<p>The contractor shall agitate the placed concrete thoroughly into places by means of sufficient numbers of approved mechanical vibrators of adequate power and having a frequency not less than 6000 impulses per minutes. The vibrator shall allow to sink freely of its own weight until it enters the previous lift. It shall be withdrawn immediately at the same rate and to be used at a new location. Concrete once vibrated shall not be vibrated again, except prior approval of EIC. The contractor shall ensure that the concrete shall thoroughly worked around the reinforcement and against external shutters so that all entrained air got expelled and the concrete surface when exposed is found good and free from air pockets, honey combing or any other defects.</p>
		<b>8.3.4.18</b>	<b>Concreting in Inclement Weather:</b>

			<p>In the event of Rain, Storm or any other severe conditions arising, concreting shall be stopped . Appropriate temporary stop ends, Vee-grooves etc., placed as may be necessary. During wet weather conditions the concrete shall be adequately protected as soon as placed. The contractor shall always be ready with the approved framed sheeting and tarpaulins etc. for the protection of newly placed concrete, each time while concreting. If any damage/ dispute occurs in the concrete due to negligence of the contractor, for the same reasons, the damaged/ disputed concrete has to be replaced by taking corrective measures as directed by the Engineer-In-Charge at contractor’s cost.</p>
		<b>8.3.4.19</b>	<b>Underwater Concreting:</b>
			<p>For underwater concreting all protective measures shall be taken by the contractor to avoid cement from washing out. The concrete may be placed under water through a tremie pipe, provided with suitable hopper. Extra cautions shall be taken by the contractor to avoid segregation and bleeding. The method of placing concrete shall be applied only after having prior approval of Engineer-In-Charge, on the same.</p>
		<b>8.3.4.20</b>	<b>Construction Joints:</b>
			<p>Construction joints shall be given at the position as directed by the Engineer-In-Charge/PMC. The contractor shall wherever practicable, strip shutters as soon as possible after pouring, subject to the approval of the EIC. Any skin or laitance should be removed and the tops of the stones exposed by means of brushing and washing.</p> <p>At horizontal construction joints, removal of laitance and exposure of the tops of stone shall be accomplished wherever practicable, by means of washing and brushing shortly after pouring, care being taken to obviate undue erosion of the mortar. After cleaning, excess water shall be removed immediately to limit absorption by the cement. In case where the concrete has set out but not set hard the removal of laitance and roughening shall be accomplished by wire brushing and washing, great care being taken not to damage the underlying mass.</p> <p>Where, at either vertical or horizontal joints, the concrete has set hard any skin or laitance shall be removed after the surface roughened by hammering with an approved power operated ‘bush’ hammer followed by wire brushing to</p>

			<p>remove all loose particles. When using this procedure, great care shall be taken to avoid breaking of the arise of the joint face and stunning whichever treatments has been given to the exposed surface. Facing matter shall be cleaned off from that surface and further wire brushing if necessary before depositing freak concrete. It shall then be thoroughly washed with clean fresh water and the surplus blown off. The surface while still moist shall be covered evenly with a layer not less than 4mm. thick of 1:1 cement mortar of medium consistency, which must be vigorously stripped into the surface by means of a suitable stiff brush, the depositing of the fresh concrete following on closely.</p> <p>It is of the utmost importance that the fresh concrete shall be forced hard on to the mortar layer and the cast faces. To this end the compacting tools and vibrators, where appropriate measures shall be worked right up to the old faces and into angles and corners formed between them and the shutters and the damping effect on vibration in such positions shall be allowed for.</p>
		<b>8.3.4.21</b>	<b>Curing:</b>
			<p>All concrete shall be protected during hardening from the harmful effects of sunshine, moisture and drying winds. All exposed faces of concrete shall be kept continuously moist for a period of 14 days. Slabs or other pours of large surface area shall be covered with damp hessian immediately after pouring. For 14 days thereafter concrete shall be kept continuously damp by spraying the cover with clean fresh water or by covering it with suitable thickness of sand layer and kept continuously damp or by ponding where practicable.</p>
		<b>8.3.4.22</b>	<b>Screeding:</b>
			<p>All the surfaces of slabs or other members not required to be shuttered are to be screeded in an approved manner and within a tolerance of plus or minus 5mm. of true level and grade. In making such finish care shall be exercised not to work in excess fines to the top. Care is to be taken to ensure that the concrete is properly closed and for this purpose vibrator screed board or plates will normally be required.</p>
		<b>8.3.4.23</b>	<b>Concrete below Specified Crushing Strength:</b>
			<p>Should the test cubes fail to meet the minimum specified crushing strength for each class of concrete, the Engineer-In-Charge may take one of the following decisions.</p> <ul style="list-style-type: none"><li>i) Instruct the contractor to carry out such additional tests and / or works to ensure the soundness of the structure at the contractor expense.</li><li>ii) The Engineer-In-Charge may accept the work with justified reasonableness. Any decision to accept the work shall be entirely at the discretion of the EIC, who will make a reduction in the rate of the appropriate item.</li><li>iii) Reject the work and instruct the section of works to which the failed cubes relate to dismantle and replaced at the contractor 's expense.</li></ul>
		<b>8.3.4.24</b>	<b>Faulty Work:</b>
			<p>Concrete defective from any cause whatsoever, shall, if so directed by the EIC be cut out and the work reconstructed by the contractor 's cost, concrete thus cut out shall not be used again. No reconstruction of repair to default work shall be done without the permission of the Engineer-In-Charge and in such a manner as he shall direct or approve.</p>

		8.3.5	Shuttering:
		8.3.5.1	General:
			All shuttering and supports included under the contract shall be designed by the contractor and relevant drawings together with calculation for strength and deflection shall be submitted to the Engineer-In-Charge/PMC for approval before commencement of work.
		8.3.5.2	Fixing:
			The contractor shall fix all the form work in perfect alignment. The form work shall be securely based so as to able to withstand, without appreciable displacement, deflection of movement of persons, materials and plant. All the joints should be watertight to prevent leakage of cement slurry from the concrete. Wedges and clamps are to be used wherever practicable. Form work after erection to be checked by the EIC/PMC before placement of concrete.
		8.3.5.3	Removing:
			Forms and shutters shall not be disturbed until the concrete has sufficiently hardened. The proper time of removal should be determined by the Engineer-In-Charge/PMC.
		8.3.5.4	Wrought Shuttering:
			Wrought shuttering shall be such as to produce a first-class fair face on the free from board marks or any other disfigurements and shall be used for exposed surface where specified or directed by Engineer-In-Charge/PMC. Wrought shuttering is to be aligned within a tolerance of 3mm.
		8.3.5.5	Special Provision:
			Wherever concreting of the narrow members is required to be carried out within shutters of considerable depth, temporary openings in the sides of the shutters shall, if so directed by the Engineer-In-Charge be provided to facilitate the pouring and consolidation of the concrete. Temporary openings shall be provided as necessary at the bottoms of shutters of columns, walls and deep beams to permit the expulsion of rubbish etc..
		8.3.5.6	Preparation of Concreting:
			Before any concreting is commenced, shutters and centering shall be carefully examined and the space to be occupied by the pour thoroughly, cleaned out. The inside of shutters shall be treated with coating of an approved substance to obviate adhesion and, where necessary to prevent absorption from the concrete, the shutters shall be thoroughly wetted shortly before concreting is commenced.
		8.3.5.7	Contractor’s Responsibility:
			Any damage resulting from premature removal of shutters or from any other course shall be made good by the contractor at his own expense.
		8.3.6	Reinforced Concrete:
		8.3.6.1	General:
			The following clause shall be read in conjunction with the section relating to concrete.
		8.3.6.2	Storage:
			The reinforcing bars shall be stored on the site on timber or concrete supports suitably spaced and sufficient height to keep the steel clear of the ground.
		8.3.6.3	Bar Bending Schedule:



			Bar bending schedules will be prepared by the contractor and shall be submitted to the Engineer-In-Charge/PMC in triplicate, for approval at least two weeks before bars are to be bent. The EIC/PMC will check and return one copy for the contractor's use, with amendments noted, if any. The cost of preparing schedules will be deemed to be included in the rates for reinforcement in the bill of quantities. Any approval given by the EIC shall in no case, relieve the contractor from being responsible for
			the accuracy and correctness of the bar bending schedule.
		<b>8.3.6.4</b>	<b>Reinforcement Cages:</b>
			The reinforcement as specified in the approved drawing shall be pre-fabricated to suitable length of cages and to full cross-sectional areas, as directed by Engineer-In-Charge/PMC. The cages shall be provided with necessary stiffness rings, cross bracings, chairs, etc., to provide rigidity to the cage to the satisfaction of the EIC. Necessary cement concrete roller cover blocks shall be provided to the cage to ensure proper cover to the reinforcement as directed by the EIC/PMC. While lowering the cages in position proper care is to be taken to ensure that the bars in the lower cage are lapped to the corresponding bars in the upper cages and properly welded. The disturbed stirrups if any at the lap portion are to be rectified as directed by the EIC/PMC.
		<b>8.3.6.5</b>	<b>Bending Reinforcement:</b>
			Bends, Cranks etc. of reinforcement shall be carefully formed in exact accordance with the Drawings or Bar- Bending Schedules otherwise all bars shall be truly straight. Bends shall be made cold round former having a diameter of Four times the Diameter of the Bars. Stirrups and Binders shall be bent to the radius of the bars against which they are to be in contact. Bending of bars shall be in accordance with IS: 2502 "Code of practice for bending and fixing of bars for concrete reinforcement". Heating of the bars will not be allowed. Bars, incorrectly bent shall be used only if means of or straightening and re-bending having been approved by the Engineer-In-Charge. No reinforcement bars shall be bent when in position without approval of EIC, whether or not it is partly embedded in the hardened concrete.
		<b>8.3.6.6</b>	<b>Binding Wire:</b>
			All bars shall be bound tightly together where they cross with annealed steel wire of not less than 1.22 mm. dia. (18 gauge). The free ends of the binding wires shall be bent inwards.
		<b>8.3.6.7</b>	<b>Placing and Fixing:</b>

			<p>The number, size and form of all reinforcement shall be in exact position accordance with the drawings. The reinforcement shall be placed, fixed and maintained in the forms within the tolerance of 5 mm. during the placing and compaction of the concrete. Horizontal bars shall be supported or suspended with concrete blocks to prevent them from sagging. Such spacer / cover blocks should be precast from concrete of the same grade as the concrete in which they are to be embedded. Each block shall be cured for 10 Days or more. Wires or Spring Clips, embedded on the centre of the blocks so that it shall not be in contact with shuttering and subsequently cause rust marks on the concrete. Where necessary, Spacer bars, supporting tools and distance pieces shall be supplied and fixed by the contractor to maintain the reinforcement rigidly in the correct position and to the satisfaction of Engineer-In-Charge.</p> <p>Any Ties or Stirrups connecting the bars shall be tight so that bars are properly braced, inside of their curved parts in actual contact with the bars, around which they are intended to be fixed. The cost of binding wires as well as cover blocks shall be deemed to be covered in the reinforcement steel.</p>
		8.3.6.8	<b>Splicing Reinforcement:</b>
			Where Splicing and / or overlapping in reinforcement are required, the bars shall be provided with such splices and/ or overlaps as shown in Drawings or as directed by Engineer-In-Charge.
		8.3.6.9	<b>Butt Welding of Reinforcement:</b>
			Butt welding of reinforcing bars shall only be used where specified or shown in the Drawings unless permission in writing has previously been given by the Engineer-In-Charge. Where Butt welding is carried out, the ends of the bars shall be prepared with single <b>45 Degree V</b> and Backing plates shall be used. The minimum root face will be <b>One Quarter</b> of the Bar dia.
		8.3.6.10	<b>Cover to Reinforcement:</b>
			The Cover to the reinforcement shall be as per relevant IS Code (latest version).
		8.3.6.11	<b>Reinforcement to be Cleaned:</b>
			All steel reinforcement before the concrete is deposited shall be clean, free from dust, loose scales, oils, rust, grease or any other deleterious materials. Particular care shall be taken to avoid contamination of reinforcement with mould oil.
		8.3.6.12	<b>Depositing Concrete:</b>
			No concrete shall be deposited until all concrete and reinforcement have been inspected and approved by the Engineer-In-Charge/PMC. There shall be in attendance on each concreting Gang Minimum one competent Steel Fixer, who shall ensure that the reinforcement and other embedded fittings are kept in position on during placing and compaction of concrete.
		8.3.7	<b>Pre-cast Concrete:</b>
		8.3.7.1	<b>Pre-casting Yard:</b>

			The precast units shall be cast on or their shutters supported from a suitably prepared level Un-Yielding paved areas. No payment will be made for preparation of casting Yards. The contractor may provide some alternative bottom shuttering with planks etc., instead of concrete platform as directed by Engineer-In-Charge, at <b>no extra</b> cost.
		<b>8.3.7.2</b>	<b>Lifting and Stacking:</b>
			Lifting and Stacking of pre-cast units shall be undertaken without causing shock, vibration or un-due stress to off in the units. The pre-cast units shall not be lifted, transported or used in the works until they are sufficiently matured. The crushing test cubes which are to be kept with the pre-cast units will be used to assess the maturity of the Units. The contractor shall satisfy the Engineer-In-Charge of that methods, he proposes for the lifting, transporting and setting pre-cast units, which will not over-stressed or damage the units in anyway. In the event of overstress or damage due to whatever cause, the unit/ units concerned will be liable for rejection and if so rejected shall be immediately broken up and removed from the site or as directed by EIC. The contractor shall replace such rejected units at his own cost.
		<b>8.3.7.3</b>	<b>Marking:</b>
			The contractor shall ensure that all pre-cast units are properly marked-in clean and legible manner with the reference no and the date of casting which information shall be clearly visible where the units are stacked.
		<b>8.3.7.4</b>	<b>Pre-casting Records:</b>
			Full and accurate records are to be maintained of all pre-cast works. Every unit shall have a reference no. Date of casting, Date of removal from bed and position of placing shall be recorded together with Test Cube Results.
		<b>8.3.8</b>	<b>Structural Steel Works:</b>
		<b>8.3.8.1</b>	<b>Fabrication:</b>
			All Fabrication shall be in accordance with IS:800 “Code of Practice for use of Structural Steel in General Building Construction” and <b>IS:1915</b> “Codes of Practice for Steel Bridges”. Extensive use of Templates shall be made. The Templates shall be steel boosts where considered
			necessary by the Engineer-In-Charge. In case actual members are used as templates for drilling similar pieces, it will be at the discretion of the EIC to decide whether such pieces are fit to be incorporated in the finished structure. The contractor shall arrange for corresponding parts of each unit manufactured from the same drawings to be inter-changeable, as far as economic manufacturing conditions permit, and shall advise the EIC of the precise arrangements made in this respect.
		<b>8.3.8.2</b>	<b>Shop Painting:</b>

			<p>The steel work shall be thoroughly cleaned to remove all rust, loose mill scales, drift and others foreign materials. Greasy and oily surfaces shall be cleaned with solvent and dry rags. Unless otherwise specified the contractor shall not flame to clean or pickle the steel work prior to painting.</p> <p>Painting shall generally be done immediately after the cleaning. All steel work shall be given a coat of epoxy paint in the shop. Each coat shall be allowed to dry thoroughly before the subsequent coat is applied.</p> <p>The steel parts to be encased in concrete shall be thoroughly cleaned but shall not be painted or oiled.</p> <p>This clause shall be read in conjunction with the section relating to painting.</p>
		8.3.8.3	<b>Weight for Billing:</b>
			Weights calculated for the purpose of billing shall be on the basis of the approved drawing and bill of material sheets. No deductions shall be made for cuts, holes etc.
		8.3.8.4	<b>Site Painting:</b>
			After erection, the whole of the steel work shall be thoroughly cleaned and all dirt marks, grease and overspills of primer paint removed. Areas, where the shop coat has suffered damage or deterioration, shall be cut back and repainted with primer in the same manner as in the shop. All exposed surfaces of metal bolt heads and connections left unpainted in the shop shall be similarly treated. After this preliminary work of making good has been approved by Engineer-In-Charge, all surfaces shall be thoroughly washed down with fresh water and when dry, two finish coats of epoxy paint shall be applied, at no extra cost to the department and shall be deemed to be included in the contractor's rate.
		8.3.8.5	<b>Welding:</b>
			<p>Metal arc process shall be used for welding in all cases, unless otherwise specified by the Engineer-In-Charge. The welding procedure shall be in accordance with the requirements of IS: 816 "Code of practice for use of Metal arc welding for general construction in Mild steel".</p> <p>Electrodes used for hand welding or for automatic welding machine shall conform to IS: 814 "Covered Electrodes for metal arc welding of mild steel".</p>

		8.3.9	Special Features – Concrete:
		8.3.9.1	Anchor Bolts and Miscellaneous Steel sets in Concrete:
			<p>Wherever required, fixtures, anchor bolts for structural steel, P.V.C. or any other approved pipes for pressure relief, openings for cross drainage pipes and equipment etc., shall be set in the forms before concrete is poured. All anchor bolts shall be provided with suitable nuts and washers,</p> <p>The anchor bolts and miscellaneous steel shall be set in the forms or in the templates especially provided for this purpose.</p>
			<p>The location and projection of anchor bolts and miscellaneous steel shall be checked by the EIC immediately before the concrete is poured and again when the concrete has set sufficiently to permit access. The threaded projecting part of the anchor bolts shall be protected by means of grease wrapped with clean rig.</p> <p>All items, which have been displaced while pouring concrete, shall be removed and replaced at the Contractor 's expense and to the satisfaction of the Engineer-In-Charge/PMC.</p> <p>Steel surfaces that are in contact with concrete shall not be painted.</p>
		8.3.9.2	Ready Mix Concrete (RMC):

			<p>Ready mix concrete may be considered for adoption by the Engineer-In-Charge at the request of the contractor subject to satisfy the strength requirements for relevant items of contract and duly complying with the following conditions.</p> <ul style="list-style-type: none"><li>i) The relevant details of Design Mix Concrete as specified shall be applicable along with the following specific details for Ready Mix Concrete.</li><li>ii) The contractor shall use Ready Mix Concrete (RMC) of grades as specified. RMC shall conform to the requirements as per IS: 4926 and IS: 2000.</li><li>iii) RMC shall be procured by the contractor from any RMC suppliers as approved by the EIC after verification of the plant and various infrastructure facilities including testing and quality control of materials and concrete at the plant lab and their method of transportation and placing of concrete at site etc.</li><li>iv) Specification for materials / water etc., as given in the tender schedule for relevant grades of concrete shall hold good for R.M.C.</li><li>v) Slump of concrete shall be as per IS:456: 2000.</li><li>vi) Initial mix design from R.M.C manufacturer's shall be submitted by the contractor in quadruplicate with complete data adopted for mix design should be taken into account the aspects such as loss of workability and strength during transportation, till placement of concrete for approval of Engineer- mIn-Charge/PMC.</li><li>vii) R.M.C manufactured and supplied shall be in conformity with the initial mix design approved by the EIC. Any change shall be made only with approval of EIC after necessary revisions to the mix design.</li><li>viii) The contractor shall ensure that all facilities are made available by the manufacturer of RMC at the plant for the department officials to inspect the materials incorporated, test carried out for all materials, concrete etc. Necessary communication system for control of quality of RMC shall be ensured at the place of production and at site of work by the Contractor. Copies of all the tests carried out for materials used / concrete shall also be made available to the department.</li><li>ix) The concrete shall be transported in concrete transit mixer and agitators conforming to IS: 5892.</li><li>x) The concrete shall be delivered and placed in foundation, slabs, beams cast with the slabs etc.,</li></ul>
--	--	--	--

			<p>by pumping using BOOMP for locations like piles, pile caps, main cross beams, longitudinal beams, deck slab and wearing course and Marine Civil Works where putting the RMC using BOOMER is not possible / not desirable considering the thrust of flow of concrete .The RMC will be required to be placed on a nearby PCC platform and then conveyed from there manually and placed in these locations. The decisions as to whether the RMC can be placed by pumping or not shall be decided by Engineer-In-Charge, whose decision shall be final and binding. The contractor will not have any extra claim on this account.</p> <p>xi) The pumps and pumping arrangements shall be inspected and approved by EIC before approving the RMC manufacturer.</p> <p>xii) No water / admixtures shall be allowed after initial mixing of concrete at the plant.</p> <p>xiii) Slump test shall be carried out at site by the department/PMC in presence of contractor and representative of RMC manufacturer. The concrete shall be placed in position within the designed initial setting time and at the end of initial setting time. The record indicating the following details duly signed by the competent representative of RMC manufacturer, contractor, EIC/PMC shall be maintained.</p> <p>xiv) Date of delivery.</p> <p>xv) Time of mixing.</p> <p>xvi) Time of delivery at site.</p> <p>xvii) Quantity and grade of RMC.</p> <p>xviii) The contractor shall enter into an agreement with the approved RMC manufacturer to ensure compliance of above aspects. The overall liability to the department, for the RMC supplied shall rest with the contractor only. The department shall not be liable for any problems with the RMC manufacturer.</p> <p>xix) The calibration and weighing equipment accuracy certificate as per IS: 4926 shall be submitted by the contractor to the Engineer-In-Charge for approval.</p>
		<b>8.3.9.3</b>	<b>Expansion Joints:</b>
			<p>The contractor shall provide all labour, supervision, materials, equipment and tools to carry out the work to the entire satisfaction of the Engineer-In-Charge.</p> <p>The expansion joints shall be formed at the locations and levels approved by the EIC.</p> <p>Instruction of the manufacturers of the approved materials shall be followed while preparing expansion joints.</p>

## **SECTION—9**

### **DRAWINGS**

(to be provided by the Owner)



SYAMA PRASAD MOOKERJEE PORT, KOLKATA  
Civil Engineering Department

....

DRAWINGS

**Name of work: “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK OF KDS - SMP, KOLKATA”**

**DRAWINGS LIST:**

The following Drawings shall form part of the Contract for the purpose of Tendering and shall be signed by the Engineer-in-charge and the Contractor for identification. The drawings can be downloaded with Tender documents.


Sl. No.	Description
1.	Existing Drawing of Old 7,NSD Berth
2.	Sketch for Berth No. 7 & Stack Yard
3.	Layout of N.S.Dock

Supplementary Drawings, if any, which the Engineer-in-charge may issue from time to time or approve during the execution of the Contract will also form part of the Contract.


After placement of work order during Engineering stage of the contract, the detail drawings on the basis of detail design prepared by the contractor and submitted to the Engineer-In-Charge and after approval of the same by EIC all those drawings and design report will be the part of the contract.

DRAWINGS


1. EXISTING DRAWING OF OLD 7,NSD BERTH : -

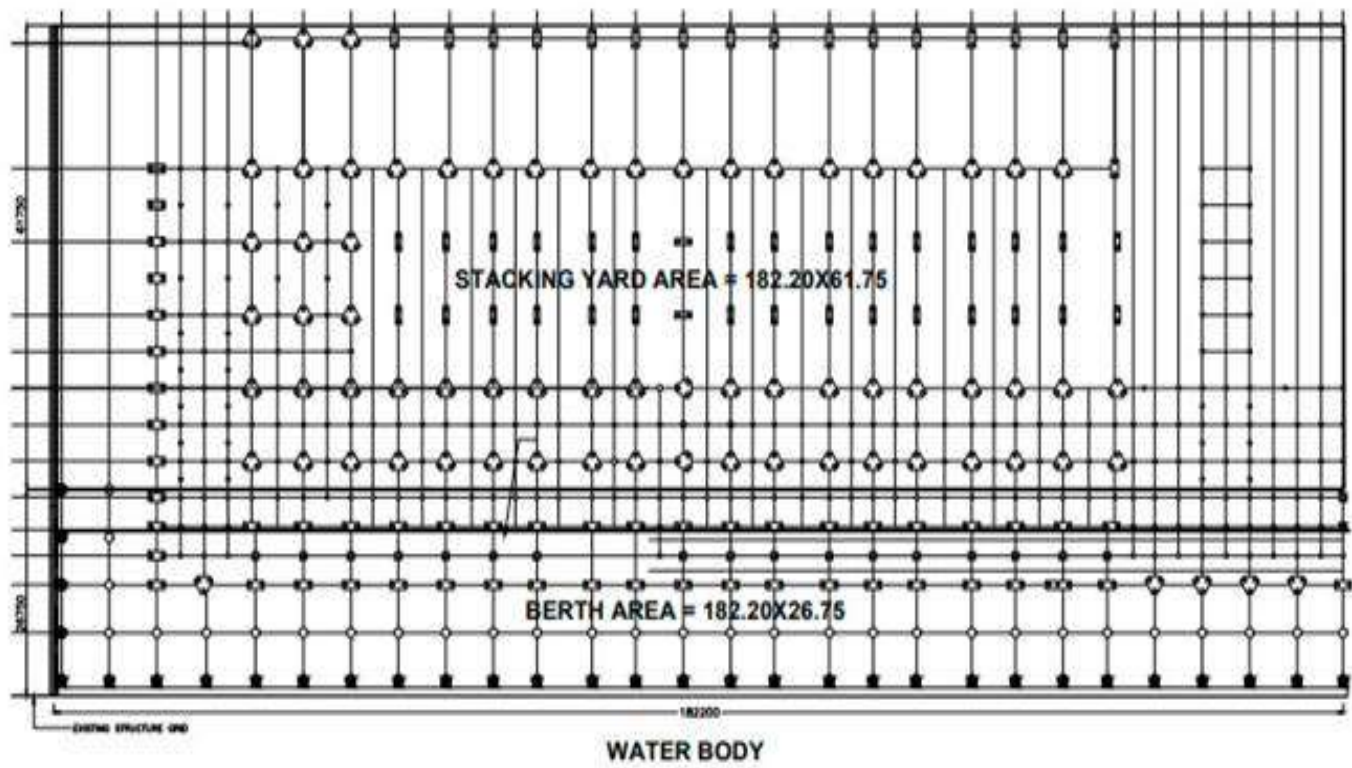

2. SKETCH FOR BERTH NO. 7 & STACK YARD:-

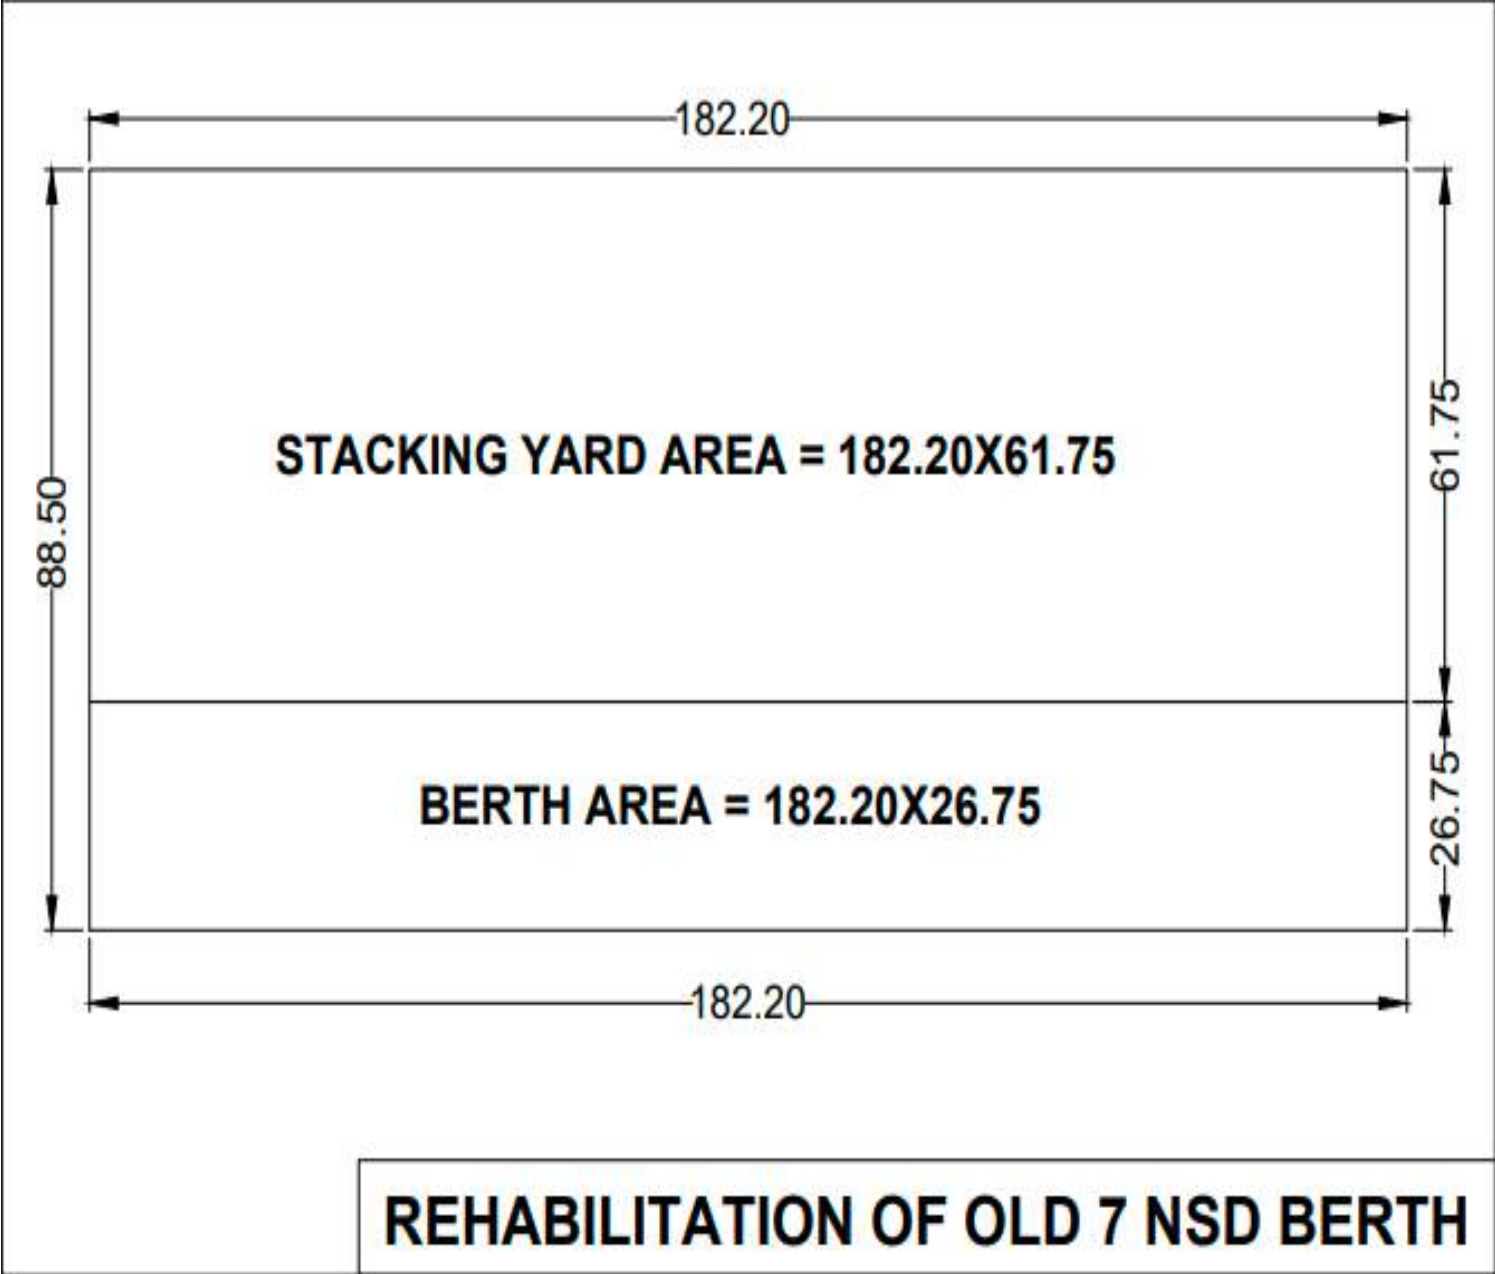

3. LAYOUT OF N.S.DOCK:-

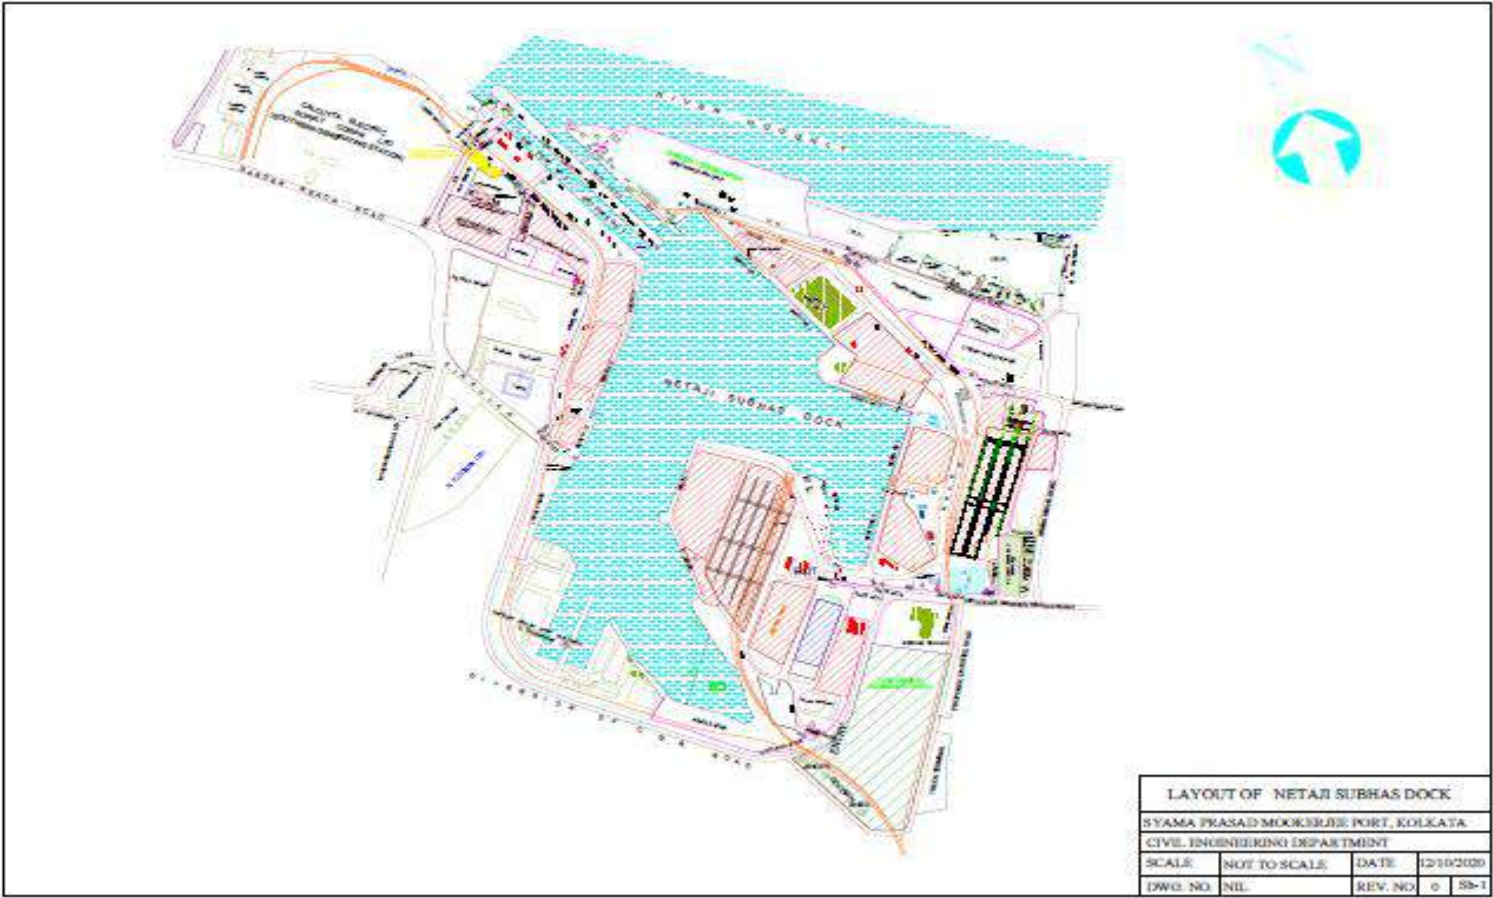

## **SECTION-10**

### **Important Project Parameters/Project Related Information**

**SYAMA PRASAD MOOKERJEE PORT, KOLKATA**  
**Civil Engineering Department**

...

**NAME OF WORK: "DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S. DOCK, KDS, SMP, KOLKATA".**

1. All materials and workmanship shall conform to the appropriate Indian Standard Specifications, code of practice published by the Bureau of Indian Standards (BIS), of latest versions where they have been formulated of the contract special conditions and as per the instructions of the Engineer-in-Charge/ PMC of the work from time to time. Standards issued elsewhere may be used if approved by the Engineer-in-Charge/ PMC for those items of work only for which appropriate Indian Standards do not exist.
2. The contractor has to make his own arrangements regarding temporary stores, work sheds ,labour hutment etc., at his own cost. Land for such work sheds, stores, site office etc., till the work is completed will be given free of rent at a spot approved by the Engineer-in-Charge/ PMC. The temporary sheds shall be constructed with non-inflammable materials like G.I. sheets etc., and shall be removed in reasonable time after the work is completed. In case the Contractor fails to remove the same as aforesaid, the department will remove the same and cost of such removal will be recovered from any amount due to the contractor.
3. If any land is required for labour sheds, Erection of bathing plants etc , the same will be given on rent basis at prevailing rate under the existing rules of the Port Trust at a spot approved by the Engineer-in-charge, subject to availability.
4. A site order book is to be kept by the contractor at the site of work. Any orders and/or instructions issued by the Engineer-in-Charge/ PMC or his authorized representative shall be entered in this book and shall be deemed to have been legally issued. The contractor shall sign each entry in token of having seen the same. This site order-book shall be returned to the Engineer-in-Charge/ PMC in good condition after completion of the work.
5. The contractor is responsible for taking precautionary measures for the safety of the lives of the workmen working under him and the responsibility arising due to any mishap during the execution of work, the payment of any compensation etc., lies entirely on the part of contractor.
6. The workers engaged on water front works such as concrete / masonry works, etc., on the dock side face of the structure should invariably be provided with safety life jackets to ensure safety of lives of the workmen. It is the responsibility of the contractor to have adequate number of safety lifejackets at site and also to ensure that the workmen engaged on water front works invariably wear the safety life jackets. The responsibility arising due to any mishap during the execution of work, the payment of any compensation etc., lies entirely on the part of the contractor . Barricades and vigils, safety lamps, flags, signals etc., for temporary traffic diversions etc., required during execution and progress of the work shall be produced by the contractor at his own cost. Risk and responsibility entirely lies on the part of contractor . No claim in this regard shall be entertained by the department for delay in time schedules consequent on the negligence will be to the contractor's account.
7. The Port working hours are from 8.00 A.M to 1.00 Noon and from 2.00 P.M to 5.30 P.M. on all working days. However the work will be allowed round the clock on working days, Sundays and Holidays ,which will be approved by the Engineer-In-Charge on written request of the contractor. Necessary supervision will be arranged by the SMPK/PMC without any extra cost to the contractor.
8. The notice inviting tenders etc. shall form part of contract.
9. All the rules and regulations governing the SMPK shall be applicable ON THIS WORK..
10. The work shall be carried out without causing any damage to the Port property or hindrance or inconvenience to the operation of the Port, working of the Port machinery. Any damages caused to the Port property either directly or indirectly shall be made good by the contractor at his own cost.

11. All the claims of the Port Trust against the contractor OR any other transaction whatsoever will be recovered from the amounts due to Contractor to this account.
12. The contractor shall employ experienced and qualified Engineers to receive instructions from the Engineer-in-Charge or his authorised representative/ PMC, and to carry out the work in accordance with the specifications. The contractor (s) or his competent authorised agent previously approved in writing by the Engineer-in-Charge/ PMC is to be constantly on the works and shall give his whole time to the superintendence of the same. In case the contractor fails to employ a qualified and experienced civil engineer and Supervisor, an amount of Rs.50,000/- and Rs30,000/- respectively per month will be recovered from the running bills.
13. During excavation for foundations, the Contractor shall dismantle and remove any masonry or concrete or roots or stumps trees stray objects of tough nature if met with, as directed by the Engineer-in-Charge/ PMC at no extra cost to the department.
14. Water and drainage pipe lines electrical, telephone, I.T. and server cables etc., if any, met with during the execution of work are to be suitably lowered or diverted from the site of work by the contractor as directed by the Engineer-in-Charge/ PMC at no extra cost to the department.
15. The contractor is responsible for the safe custody of the materials collected and stacked by him until incorporated in the work, measured and handed over to the department.

16. RETURNS AND DRAWINGS:

All reports, statements, diagrams or drawings etc., which the Contractor is required to submit during the progress of the works to the Engineer-in-Charge/ PMC, or to his representative or to both are unless otherwise directed to be furnished in triplicate, and at the expense of the Contractor.

17. DRAWINGS OF TEMPORARY WORKS:

When the Contractor intends to start erecting any part of the temporary works and stagings required for carrying out the works he shall furnish to the Engineer-in-Charge/ PMC well in advance complete drawings of that part of the temporary works and stagings. The Contractor shall at the same time, if so required by the Engineer-in-Charge, furnish calculation relating to the strength and anticipated deflections in respect of such temporary works. The Contractor shall also furnish to the Engineer-in-Charge/ PMC, drawings showing the method proposed for the erection of the various part of the works. These details are required for a General Review of satisfactory performance.

The furnishing to the Engineer-in-Charge/ PMC of any design for any of the temporary works and staging shall not relieve the Contractor of any liability or obligation under the contract in respect of such temporary works and stagings.

18. CONTRACTOR TO WORK TO OTHER CONTRACTOR(S)'S DRAWINGS:

The Contractor(s) shall where so directed by the Engineer-in- Charge, or his representative be required to work to other contractor's drawings where-so-ever drawings for work not included in this contract are related to particular details of the works.

- a) Handing over site: The tenderer shall note that the entire site may not be handed over to the contractor at a time. This may be handed over in a phase manner and definitely the same should not hamper the progress of work in any way. Contractor should plan accordingly and submit CPM /Progress schedule to Engineer-In-Charge/PMC.
- b) Detailed CPM Schedule: The Contractor shall submit to the Engineer-in-Charge/ PMC, within 15 days from the date of placement of work order, a computer based detailed CPM Schedule on MS Project/Primavira of various activities to be performed in the project to be based on his preliminary time Schedule supplied with the tender and approved by the Engineer-in-Charge/

PMC, showing in an approved form the estimated dates of commencement and completion of various parts of the work including anticipated dates for delivery, erection, etc., of the various sections of the work for the contract. The detailed CPM schedule shall be updated by the Contractor at suitable intervals determined by the Engineer-in-Charge/ PMC, and 3 (Three) copies of same should be deposited to the Engineer-in-Charge/ PMC. The Contractor shall take into account all anticipated delays due to bad weather, cyclones, and heavy rains while working out the CPM Schedule using M.S.Project/ Primavera.

19. PROGRESS REPORTS:

The Contractor shall submit to the Engineer-in-Charge/ PMC on the first day of each week or such longer period as the Engineer-in-Charge/ PMC may from time to time direct, a progress report for the preceding period showing up to date progress and progress during the previous period on all important items of each section or portion of the works in relation to and in consideration of detailed C.P.M. Schedule.

20. RETURNS OF LABOUR:

The Contractor shall if required by the Engineer-in-Charge/ PMC, deliver to the Engineer's representative or at his office a return in detail in such a Form and at such intervals as the Engineer may instruct showing the supervisory staff and the numbers of several classes of labour from time to time employed by the Contractor on the site and such information of constructional plants & equipments as the Engineer-In-Charge or his representative may required.

21. The contractor shall forthwith dispatch at his own cost raise and remove any craft or plant (Floating or otherwise) belonging to him (including also any plant which is held by the contractor under agreement for hire or hire-purchase) which may get damaged and sinks in the course of construction, completion or maintenance of the works or otherwise deal with the same as the Engineer-in-Charge/ PMC may direct and until the same shall be raised and removed by the contractor shall set all such buoys and display at night such lights and do all such things for the safety or navigation as may be required by the BoT. In the event of the contractor not carrying out his obligation imposed upon him by this clause, the Board may remove the same and the contractor shall bear such cost incurred on that by the client..

22. LIFE SAVING AND FIRST AID APPLIANCES:

The Contractor shall at his own expense provide and maintain upon the works to the satisfaction of the Engineer-in-Charge/ PMC sufficient, proper and efficient life saving and first-aid appliances which shall at all times be available for use at site of work.

23. LIGHTS AND SIGNALS:

Any light provided by the contractor shall be so placed or screened as not to interfere with any signal or navigation lights or other markings.

24. PROPERTY IN EXCAVATED MATERIALS:

All materials and objects of any kind obtained from excavations or found on or under the site or under any additional site which the contractor may be allowed to occupy for work shall remain the property of the board and shall not be used in the works or sold or otherwise disposed of without the written permission of the Engineer-in-Charge/ or his representative unless otherwise explicitly provided in the specification. No excavations are to be made upon the site or additional site beyond those shown on the drawings or described in the specification without the prior written permission of the Engineer-in-Charge/ his representative.



25. TEMPORARY OFFICE ETC.:

The Contractor(s) shall submit to the Engineer-in-Charge/ PMC for his approval, drawings and proposals for any temporary work such as office, store, pre-casting yard, batching plant etc., which he intends to construct for execution of the main work and no such work shall be constructed before obtaining the written approval of the Engineer-in-Charge.

26. ENTRY ON PRIVATE OR OTHER PROPERTY:

The Contractor shall not enter upon or commence any work in or upon, across or through any land, building or place being private property until authorized in writing by the Engineer-in-Charge or other Competent Authority to do so.

27. BRIBES AND COMMISSION:

Any bribe, commission, gift or advantage given, promised or offered by or on behalf of the Contractor or his partner, agent or servant or any one, on his or their behalf to any officer, servant, representative or agent of the Engineer-in-Charge/ PMC or to any person on his behalf in relation to the obtaining or to the execution of this or any other contract with the Board shall in addition of this or any criminal liability which he may incur subject the Contract leads to the cancellation of his and all other contracts with the Board and also to the payment of any loss or damage resulting from any such cancellation. The Board shall be entitled to deduct the amounts so payable from any money otherwise due to the Contractor under this or any other contract. Any question or dispute as to the commission of any offence under the present clause shall be settled by the Engineer-in-Charge/ PMC in such a manner and on such evidence of information as he shall think fit and consider sufficient and his decision shall be final , conclusive and binding on the contractor.

28. ADVERTISING:

No advertisement may be placed on any boarding fencing building or scaffolding erected in connection with this contract without the written permission of the Engineer-in-Charge or his representative.

29. CONTRACT SUPERCEDES PREVIOUS DOCUMENTS:

The Contractor shall have no right to any increase Lump Sum rate in the contract nor any other right whatsoever by reason or any representative explanation or statement made or by reason or any information promise or guarantee given or alleged to have been given to him by any person (whether in the comply of the board or not) before the date of the contract is being understood that the contract embedding the whole arrangements between the parties with reference to the contract here by constituted and all previous correspondence, negotiations, representations, explanations statements, promises, or guarantees whether oral or written shall be executed.

30. NOTICE OF OPERATION:

No important operation shall be commenced nor shall work outside the usual working hours be carried out without the consent in writing of the Engineer-in-Charge/ PMC or without full and complete notice also in writing being given to him sufficiently in advance of the time of the operation, so as to enable him to make such arrangements as he may deem necessary for his inspection of PMC and his team.

31. SURVEYS AND LEVELS TO BE AGREED:

Before the works or any part thereof are begun the Contractor or the Contractor 's representative and the Engineer-in-Charge or his representative/PMC shall together

survey and take levels of the site of the works both above and below water level and agree all particulars on which the survey is to be made and on which the measurements of the works are to be based. Such particulars shall be plotted by the Contractor and after agreement the drawings shall be signed by the representative of the Engineer-in-Charge/ PMC and the Contractor or contractor's representative and shall form the basis of the measurements for the certificates of the Engineer-in-Charge/ PMC.

The Contractor (s) shall arrange at his cost all equipments/instruments, materials and workmen to carry out the joint survey. Failing such survey and agreement being prepared and/or signed by the Contractor or contractor's representative, the Surveys of the Contractor is conducted by the Engineer-in-Charge/ PMC, the cost of which shall be born by the contractor and same shall be final and binding on the contractor.

32. NOTICE FOR SETTING OUT OF WORKS:

The Contractor shall give the Engineer-in-Charge/ PMC not less than 24 hours notice in writing of intention to set out or give levels for any parts of the work in order that arrangements may be made for checking. In the absence of such request any delay will be to the contractor's account.

33. JOINT MEASUREMENT OF EXTRAS:

As the same is a Turn-Key contract (Lump sum), usually there will be no excess-extra work. In the event of the contractor having to execute any work as per the written instruction of the Engineer –In-Charge which is not in the scope of this project and in regard to which the contractor may propose to claim extras, he shall immediately notify the Engineer-in-Charge in writing and shall at once make arrangements to take the measurements of the said work with the Engineer-in-Charge/ PMC and the payment will be made on mutually agreed rate based on PWD/CPWD schedule of works..

If these measurements are not taken jointly and booked and agreed at the time of the work is being executed, the Contractor's measurements will not afterwards be recognized by the Engineer-in-Charge/ PMC.

The fact of such joint measurement having been made will in no way commit the Engineer-in-Charge to a recognition of the claim if he considers such claim without foundation. The Engineer-in-Charge/ PMC shall at all times have full access to the Contractor's extra works with the contractor's time book and daily check the time of any extra works with the contractor's time keeper or otherwise be the fact of his agreeing upon any time shall in no way bind the Engineer-in-Charge/ PMC to value the work other than by measurement if he thinks fit so to do.

34. ORDER OF WORKS:

The order in which the works are to be carried out shall be always upon approval of the Engineer-in-Charge or his representatives and shall be such as to suit the detailed method of construction adopted by the Contractor as well as the C.P.M. Schedule. The works shall be carried out in such a manner so as to enable the other contractor to work concurrently.

35. OPERATIONS OF THE EMPLOYER AND OTHERS:

The Ordinary business and works of the Board and others as carried out on and in the vicinity of the site will be continued during the construction, execution and maintenance period of the works and the contract shall be conducted in such a way so as to avoid interference with traffic of any kind by land and by water and with any other works in progress in the vicinity and never disturbing normal operation of Port.

36. SANITARY FACILITY:

The Contractor shall provide and maintain in a clean and sanitary condition adequate latrines and wash places which may be required on the various parts of the site for the use of his employees to the satisfaction of the Engineer-in-Charge/ PMC. Any pollution activities will be permitted at site of work unless otherwise necessary for the execution of the work. The Contractor shall make all arrangements for the disposal of sewage or drainage in accordance with the directions of the Engineer-in-Charge/ PMC.

37. TELEPHONE:

The Contractor (s) shall make his own arrangements with the appropriate authority for the provision of telephone/illumination facilities to the site/site office as contingency of the contract.

38. EXISTING SERVICES:

Drains, pipes, ITcables, overhead wires and similar services encountered in the course of the works shall be guarded from damage by the Contractor at his own cost, so that they may continue in full and uninterrupted use to the satisfaction of the owners thereof, and the Contractor shall not store materials or otherwise occupy, any part of the site in a manner likely to hinder the operation of such services. Should any damage be done by the Contractor to mains, pipes, cables or lines whether above or below ground whether shown or not shown on the drawings the Contractor must make good or bear the cost of making good the same without delay to the satisfaction of the Engineer-in-Charge/ PMC and of the owners.

39. KEEPING SITE CLEAN:

The Contractor shall at all times keep the site free from all surplus excavated materials, rubbish and offensive matter which shall be disposed of in a manner to be approved by the Engineer-in-Charge. Such clearance and disposal of wastes and other materials shall be a contingency of the Contract.

40. INDIAN CONTRACT:

The contract shall be interpreted and have effect in accordance with the law of Indian and no suit or other proceedings relating to this contract shall be filed or taken by the Contractor in any court of law except in KOLKATA.

41. The contractor shall note that the work under this contract is to be executed in the Dock Basin of NSD, which is under operation and ships of various sizes, Dredgers and other Floating Crafts will be moving in the area. The contractor shall take all precautions to prevent any damages to any part of the work under progress of works completed and under maintenance and also the temporary works completed and contractor, floating crafts under his custody, etc., due to drifting of the crafts referred to above. The Board will not take any responsibility for such damages and the contractor has to make good all such damages caused to Port craft, equipment and structures at his cost.

42. The contractor should note that the work site is situated within the restricted /Custom Bonded area. He should obtain necessary passes for himself, his workmen and vehicles and materials from the Commandant, CISF after paying necessary charges and should abide any prohibitory rules and regulations in force and no claim on this account will be entertained.

43. The contractor shall note while dismantling the pipelines etc., utmost care shall be

taken not to damage them and the retrieved materials have to be handed over to place shown by the Engineer-in-Charge/ PMC as per relevant item. All serviceable materials to be forwarded to Trustees Material Management at their designated area as directed by EIC.

44. The tenderers shall note that the construction yard for the work will be given to the minimum requirement subject to not affecting the traffic operations and no claim will be entertained on this account.

45. STORAGE OF AGGREGATES:

The Contractor shall specifically note that the fine and coarse aggregates shall be stored at site neatly in separate bins properly covered by tarpaulins etc., to prevent contamination. The aggregates shall comply to the standards/specifications.

46. HANDLING OF CEMENT FOR THE DAY'S WORK:

The Contractor shall arrange at his own cost for proper storing of cement for the day's work. Necessary water proof covering (tarpaulins etc.,) shall be invariably provided to protect the cement whether rain or no rain.

47. During the currency of the contract, the contractor (s) shall take all necessary care to see that no material such as dismantled materials, debris etc., are thrown into the waterway and great care and meticulous supervision are best owed in this regard.

48. The contracts shall not prefer any claim with regard to in—in rates of any material or labour covered by the subject contract and the direction of the competent authority is final and cannot be subject matter of arbitration.

49. The contractor shall produce documentary proof to the satisfaction of the Chief Engineer in token of having paid the mineral revenue due to the government by the contractor if he has procured the minor minerals directly from the quarries under the relevant acts, rules and regulations of the state/central government or shall obtain and produce such documentary evidence from the person who operates the quarry. The said documentary evidence shall disclose the payment of Mineral Revenue due to the Government for the quantity of the Minor Mineral removed from the said quarries. Till such time, the contractor produces the above documentary evidence, the seignior age fees etc., shall be recovered from the running on account bills and kept in deposits and the same will only be released to the contractor on production of the said documentary evidence. If for any reason the contractor fails to produce such documentary evidence during the period of contract, the contractor shall produce Mineral Revenue clearance certificate, issued by the Competent Authority of the Mines & Geology department to enable refund the pertinent amount. The contractor fails to produce this mineral revenue clearance certificate from the competent authority, the amount so recovered from the running on account bills as mentioned above on the quantities consumed on the work in question, will be remitted to the Mines & Geology department and there after pass the final bill in the contract in question. In terms of G.O. Ms. No. 23 dt. 5.3.1999 issued by W.B. State Irrigation and Command Area Development.

50. The department reserves the right to execute the contract strictly according to the provision of the tender.

51. All concrete works etc., shall be kept wet and properly cured with fresh water as per I.S. Specifications. If curing is not done properly the department will be at liberty to engage labour for curing and the expenditure will be recovered from the Contractor's bills. The decision of the Engineer-in-Charge will be final in this regard.

52. The contractor should submit daily labour report, ground balance of the materials on the day, his day's programme of work in the proforma in the early hours of everyday.
53. The contractor shall programme his work in such a way there is no obstruction to normal functioning of the works/shipment. The materials shall be stacked in such a way that no obstruction is caused to the movement of the traffic in the area.
54. All conversions from Metric Units to British units and vice-verse will be as per I.S. 786.
55. Whenever sizes are referred to in British units in the tender document equivalent or nearest one in metric units will be accepted.
56. Curing of all cement works should be done at the contractor's cost as directed by the Engineer-in-Charge/ PMC.
57. The contractor should see that no obstruction is caused to the normal working of the Port staff working in the locality and should co-operate with other contract agencies working in that area simultaneously without any claim whatsoever.
58. In case, any site wherein the contractor's materials such as debris, gravel, sand, metal, stone etc. are lying is required to be cleared off for giving any markings or taking up any other newworks, the contractor should clear the site within three days from the date of receipt of instructions from the department without any extra cost to the department. In case, they are not cleared within 3 days, they will be removed either by the department or through other agencies and the cost of such removal will be recovered from the contractor's bill.
59. Steel should be stacked in such a way to give easy identification and counting of the various diameters of the bars. The steel yard at site should be kept clean and all the cut pieces etc., should be separately stacked. All the construction materials required for the work should be collected and stacked in such a way not to give any hindrance for the other contract works in that area. The Engineer-in-Charge/ PMC's decision and instructions given from time to time shall be binding and no claim is tenable on this account.
60. All reinforcement and other steel shall be cleared free from oil, grease, loose, mill scales, loose rust or other deleterious matter before incorporating in the work.
61. Great care shall be taken by the contractor to prevent displacement or bending of the members of the steel. Any displacement shall be adjusted and fixed in position before commencement of work at no extra cost to the department.
62. The contractor has to provide necessary helmets as safety-measures for his staff/workers to avoid any untoward incidents at site of work at his own cost.
63. Any vegetation etc. should be cleared by the contractor at no extra cost to the department.
64. All defective works pointed out by Engineer-in-Charge/ PMC shall be rectified free of cost during execution and maintenance.
65. The contractor shall barricade the area where the work is in progress and shall provide necessary caution boards. During nights necessary signal lights shall be provided to

prevent any mishaps. No extra claim will be entertained for all these works.

66. Every effort will be made to handover the site to the contractor as soon as the work order is given. In case the entire site is not handed over to the contractor, he should programme his work in such a way so as not to hamper the progress in anyway.
67. The decision of Engineer-in-Charge is final in case of any technical clarification.
68. The contractor shall submit the test certificates/guarantee cards and other information pertaining to the material used on demand.
69. The offer price quoted by the contractor should be inclusive of all labour and materials etc. unless otherwise specified.
70. The tenderers are expected to see the plans on any working day during office hours and obtain such clarifications and if necessary to inspect the site of work and study the site conditions and make preliminary design before quoting his rate in the tender. No claim whatsoever will be entertained at future date arising out of local working conditions and clarifications given in the department.
71. Security and safety Required:  
The contractor (s) shall comply with all regulations imposed by the customs and Port Security Authorities in respect of the passage of plant, vehicles materials and personnel through customs barriers.
72. Safety Precautions:
  - i. Fire safety precautions:  
The contractor (s) shall make all precautions to prevent out-break of fire and accidents on the site of machinery, men, materials, office, stores and other places connected with the works directly or indirectly. He shall comply with all rules, regulations and orders if any statutory authority and of the Engineer-in-Charge/ PMC at no extra cost of the Board and he should include all the charges in the contract rates.
  - ii. Restricted Areas:  
The contractor shall obtain from the Board details of any restricted areas in and around the site and shall have prominently and clearly, displayed for the information of his staff and work people, notices defining any such restricted area. Such notice shall be provided at his own expenses.
  - iii. The contractor shall give every facility to the authorized safety officers of the board to inspect the works when so ever required and shall observe and abide by and instructions by the Engineer-in-Charge/ PMC in regard to the use of plant, equipment and temporary works in respect of general safety. Compliance with such requirement shall not be used as the basis of claim against the Board.
73. Service lines such as electrical cables, Fibre-Optical, T-cables, water supply lines sewer and drainage pipes, Tele communication cables etc. are embedded in the Port Roads, road side berms hard surfaces areas, pavements etc. The Fiber Optical I.T. cable is very costly cable and if damaged requires replacement for full length.

The contractor therefore, before commencing any excavation shall seek the specific clearance of the route proposed for excavation. Notwithstanding such approval he shall be responsible to takenecessary precautions by way of deploying suitable means and restraint to avoid damage toany of the service lines. In case of any damage caused during excavation or subsequently duringthe progress of thework he should replace/repair the cables/service pipe lines etc. as required at his cost, failing which a

recovery as evaluated by the Engineer-in-Charge/ PMC would be made from the bills.

74. PROGRESS PHOTOGRAPHS , VIDEO FILM and CCTV monitoring:

The contractor shall supply for the Engineer-in-Charge photographs, video of performance of work in both soft and hard form time to time during progress of work.

The contractor shall also supply to the Engineer-in-charge colour, edited progress video film/DVD with sound and narration in English of such portion of the work in progress and completed as the Engineer-in-Charge/ PMC may direct so as to have coherent record of the construction from start to its completion. These will be required every month. The film shall become the property of the board and no copies of the above film shall be supplied to any person or persons without the permission of the Engineer-in-Charge/ PMC. The photos and video film shall cover all important activities of entire work. The contractor also arrange for a CCTV surveillance for working activity of the project and arrange display at four locations for monitoring of the progress of work as directed by the Engineer-In-Charge. The cost of the progress photographs , video film & CCTV installation will be borne by the contractor.

75. Up-keeping of Environment:

The contractor shall take precautionary measures and adhere to the following for up-keeping of the environment at site of work, at no extra cost to the department.

- a) No tree/Plant should be cut or removed without the written permission of the Engineer-in-charge.

Contractor shall make necessary arrangements, to reduce the dust generally by

- i. Regulating the speed of the construction equipment.
- ii. Sprinkling of water wherever required.
- iii. Prevent over loading of trucks and spillage of materials.
- iv. Cover trucks with tarpaulins.

Contractor shall not tamper any hydraulic flow including drainage, rain harvesting pits, catchment drains etc.

76. Water Supply:

The contractor shall make his own arrangements for supply of water of the work and the workmen. The contractor shall arrange for sufficient capacity of water tanks at site of work for curing of concrete.

77. Power Supply:

The contractor shall make his own arrangement for the power required for the work.

However, construction power to the extent possible may be made available to the contractor from the nearest source depending on availability and as per the prevailing rules. In case additional power over and above that is required for use in the construction, the same can be considered subject to satisfaction of EIC about such requirement. The contractor shall submit the details of connecting loads that he intended to use. The contractor shall construct his own LT lines from the place of supply for meeting the construction loads. LT lines shall meet the required standards specified under Indian Electricity Rules 1956 and Indian Electricity Act 1970, and complete the installation shall be approved by the Port Electrical wing of Mechanical department. The contractor(s) shall pay for electrical consumption charges at the rates prevailing in vogue from time to time. Irrespective of contractor electrical power consumption, monthly minimum charges as per prevailing rates will be recovered from contractor's running bills.

78. Life Jackets:

The workers engaged on waterfront should invariably be provided with safety lifejackets by the Contractor at his own cost to ensure safety of life of the workmen. It is the responsibility of the Contractor to have adequate number of safety lifejackets at site and also to ensure that the workmen engaged on waterfront invariably wear the safety life jackets. Also adequate number of life buoys should be kept at site of work as an additional safety measure.

79. Light and Signals:

Floating platform / craft shall display day and night signals as directed by the EIC. The Contractor shall at all times be responsible for ensuring that moorings which may be required in connection with the works do not impede or endanger traffic in channel.

All anchors or other securing devices for moorings are to be placed in accordance with the requirements of the EIC. The Contractor shall ensure that the EIC is provided with an accurate fix of the position of all anchors, securing devices and mooring lines as and when this information is required.

All attendance crafts concerned with the work, shall display navigation lights, when moored to buoys in the Port and shall not obstruct other Port Traffic.

80. Maintenance of Floating Platform/Craft:

All plants and floating platform / craft shall be in good working order to the satisfaction of Engineer-in-Charge/ PMC and shall be maintained in seaworthy condition and shall be certified as such by authorised surveyors. All craft of the Contractor shall have valid license given by SMPK and shall strictly comply with SMPK Regulations.

81. Filling in Holes and Trenches:

The Contractor immediately upon completion of any work under the contract shall at his own expenses fill up all holes or trenches which have been made or dug, and clear away all rubbish occasioned in the execution of the works or temporary works. The Contractor shall bear and pay all costs, charges, damages and expenses which may be incurred or accident which may happen by reason of holes and trenches connected With the work being left unfenced or materials being left unfenced or placed in improper situations.

82. Shoring and Strutting:

Necessary shoring and strutting arrangement shall be made by the contractor to ensure avoiding side collapse of adjacent soil while carrying out the work.

83. Datum–Tidal Working:

All datum will be as per KODS

84. Environmental Considerations:

The Contractor shall refrain from using plant which makes excessive noise, particularly during the hours of darkness, which shall be limited to 45 db (A) at a distance of 100m from the boring and other plants.

85. The floating Craft/Platform shall contain all arrangements for inspection of Bridge Deck Structure etc.

86. The platform shall have sufficient dimensions and strength to carry all the equipment



and manpower and contain sufficient space for movement

87. Sufficient anchorage shall be provided to the platform against waves, currents, wind etc., to stop the lateral movement of the platform.
88. The bed level shall be attained through lead soundings for accuracy.
89. If any forged/fake documents are submitted by the tenderers, their business dealings with SMPK will be banned".
90. The contractor/ Firms while quoting tender shall note that, no post tender negotiation will be held with the L-1 tenderers, except in exceptional cases, whenever it is found necessary.
91. The contractor(s) or his authorised representative shall invariably sign in the hindrance register, which shall be maintained by the concerned division at site of work. The hindrances in execution of work will be recorded in the register, whenever any hindrance takes place, which shall be maintained by the concerned division at site of work and the same shall be reviewed by the Engineer-in-Charge/ PMC from time to time to examine the justified reasons for considering extension of time etc.,
92. The bidder shall give an undertaking that they have not made any payment or illegal gratification to any person/authority connected with the bid process so as to influence the bid process and have not committed any offence under the P.C . Act in connection with the bid.
93. In the event that two or more bidders quote the same amount (the "Tie Bidders"), the authority shall identify the selected bidder by draw of lots, which shall be conducted, with prior notice, in the presence of the Tie-Bidders who choose to attend.
94. In the case the document submitted by the bidder found to be not genuine, the management reserves the right not to allow to participate in future tenders of SMPK.
95. The bidders shall disclose any payments made or proposed to be made to any Intermediaries (Agents etc) in connection with the bid.
96. "The Bidder will have to give a certificate that their firm/ company is not having any relationship (Direct / Indirect) either personal or Commercial with any of the existing trustees of SMPK"
97. Tenderers shall submit the experience/completion certificates along with their tender.

#### **MSME Conditions:**

98. Micro and small enterprises registered with NSIC and ministry of MSME with adequate monitory limits are exempted from payment of tender cost and EMD amount for participating in SMPK. Tenders for the execution of works.
99. All the eligible Bidders, who are registered with NSIC/Ministry of MSME are exempted from payment of EMD amount and tender Document Cost subject to fulfilling of following conditions:
  - i. The Bidder should invariably submit a request letter claiming "EMD and Tender Document Cost exemption".
  - ii. The Bidder has to submit the self-certified copy of the registration certificate issued by NSIC/Ministry of MSME for the works/service relevant to the "Subject Tender" as per Pre- qualification criteria.
  - iii. The above registration certificate should be valid on the date of opening of the technical bid.
  - iv. The Monitory limit of the Registration Certificate shall be more than the "Amount put to Tender". In case the monitory limit of the above Registration Certificate is less than the

estimated cost (put to tender), then the above certificate will be treated as invalid for the subject tender value.

- v. In case the Registration Certificate issued by NSIC/Ministry of MSME is found to be invalid (date expired) or insufficient monetary limit or irrelevant works or services i.e. other than the tendered works/services. Then the above Registration Certificate cannot be considered for exemption of EMD & Tender Document Cost and the Bid received will be treated as “Bid submitted without EMD and Tender Document Cost”, which would attract disqualification under EMD & Tender Document Cost of tender conditions as mentioned above.
- vi. In case the bid is submitted as an Indian arm of a Bidder and the eligibility criteria conditions were met thru foreign company, then the “EMD Exemption & Tender Document Cost cannot be claimed under the MSME status of Indian arm/Subsidiary.
- vii. Copy of “Application for obtaining NSIC/ MSME Registration” of pending renewal of NSIC will not be entertained. Such offers will be treated as Offers received without EMD and Tender Document cost.
- 100. The contractor shall be liable for authenticate verification of work men engaged in the work including obtaining proof of Aadhar Cards etc.,
- 101. The contractor shall engage experienced/skilled workmen at the site.
- 102. The contractor shall fulfill all the legal requirements regarding insurance, PF, ESI etc., to the workmen engaged in the work and shall comply all the QMS/ EMS/OHSAS existing norms of the organization.
- 103. The contractor/authorized representative shall monitor workmen round the clock and shall synchronize with the section in-charge from time to time.
- 104. The contractor shall be liable for any theft / damages occurred to the Port property due to his workmen mismanagement / carelessness / un-lawful activities etc., at site, the necessary recovery will be affected based on the actual assessment whatsoever from running account bills. The Engineer-in-Charge decisions the final in this regard.
- 105. If required, the construction agencies / Firms would provide Crèche at their camp offices/Labour work sites.
- 106. The contractor shall submit the proof of actual payment done (e-payment) to the workmen engaged particulars to the Engineer-in-charge for processing running account bills (payment will be made only for prescribed persons in the work).
- 107. The bidder has to enter in to Pre-contract Integrity Pact Agreement prescribed in the pro-forma enclosed and has to be submitted along with the tender.
- 108. The bidder has to submit declaration (Declaration No.1) towards GST as prescribed in the pro-forma enclosed.
- 109. **GST Conditions:**

**a) GST in respect Supply of Goods & Services or on works contract as applicable in respect of this contract should be payable by the supplier / service provider /contractor and contractor trust will not entertain any claims with effect from 01-07-2017.**

**b) According to GST Act every dealer is liable to be registered whose aggregate turnover exceeds Rs.20 lakhs for supply of goods / services / executing any works contract. Accordingly GSTIN is to be provided for participation in tender and to award the**

**contract.**

**c) The applicable TDS as per the central GST (CGST) Act will be deducted as and when notified by the Government.**

**d) The rate to be quoted should be exclusive of GST component and payment will be made Against "Tax Invoice" as prescribed under the GST Act/Rules.**

**e) The supplier/contractor is required to remit GST as per the "Tax Invoice" and file the details in GSTR on or before 10th of the subsequent month to enable SMPK to claim input tax credit otherwise the said tax invoice will be kept pending for payment.**

(a) The rate quoted shall be exclusive of GST and GST as applicable shall be extra.

(b) The supplier/contractor shall have to provide HSN code/SAC code and the responsibility of applying the correct rate of Tax in GST regime shall be on the supplier/ contractor. The supplier / contractors is not entitled for any other taxes / cesses which are subsumed in GST except for applicable GST mentioned in the Tax Invoice.

(c) The Central excise duty, VAT and TDS on works contracts, Service tax, Octroi, Entry tax etc. which are subsumed in GST are no more applicable in the present GST.

(d) Supplier/Contractor is to submit Tax Invoice (for taxable supplies) as per the governing provisions of GST law and all the particulars which are mandatorily required to be mentioned in Tax invoice etc. shall have to be necessarily mentioned in such Tax Invoice. The amount of GST claimed in the Tax Invoice shall be final and any future claim by the supplier/contractor shall not be entertained by SMPK under any circumstances.

(e) In case of further change in the tax structure till the date of completion of work or in case any error is noticed in the calculation of amount payable / recoverable the same shall be paid by SMPK or else recovered from the bills or security deposits or any other amounts payable to the supplier/ contractor.

(f) In case the value charged / tax charged in the tax invoice is found to be less than the taxable value or tax payable in respect of such supply, the same shall not be entertained by SMPK unless the supplier / contractor who has supplied such goods or services or both, shall issue to the SMPK a debit note / supplementary invoice containing such particulars as may be prescribed.

(g) The supplier of goods/services/composite supplies/works contract or has to mandatorily remit the GST collected from SMPK to the Government. In case of any non-payment of GST by such supplier of goods / services / composite supplies / works contractor which has the adverse effect on the input tax credit availed by SMPK if any, such amount together with interest shall be recovered from the bills / tax invoices / any other amounts payable to the supplier/contractor.

(h) SMPK is liable to deduct TDS if applicable as per the provisions of Section 51 of CGST Act from the date notified by SMPK at the applicable rates.

(i) The components viz. Labour cess, TDS as per Income tax Act 2017, Seigniorage fee etc. viz. taxes/ cesses which are not subsumed in GST shall be applicable as it is and there is no change in such recovery procedure and the same has to be continued.

(j) In terms of clear provisions under Section 171(1) of CGST Act, the supplier/contractor shall have to pass on the benefit in the form of reduction in prices in case there is any reduction in rate of tax on any supply of goods or services or the benefit of input tax credit. Accordingly, the contractor has to submit a Declaration (Declaration No.2) attached here with.

110. Conditions regarding Safety requirements:

- a) The SMPK has Quality Management System (ISO 9001- 2015), Environmental Management system (ISO 14001:2015) and Occupational Health and Safety Management System (OHSAS18001:2007) for their activities. One copy of consolidated policy is enclosed herewith. The contractor shall comply with all the requirements of ISO9001:2015, ISO14001:2015 and OHSAS18001:2007 standard.
- b) The contractor shall while carrying out the above work, abide by safety tasks, rules, regulations and procedures established by SMPK as pre-scribed in the manuals, HIRA format, work instructions, operational control procedures. Copies of the same will be made available to the contractor up – on request for reference.
- c) The contractor shall abide by all Safety Standards and codes attributable to the material and goods to be delivered to site.
- d) The contractor shall participate in safety awareness meetings held at site adhere to the instructions issued and shall also adhere to the safety programmes established by SMPK.
- e) The contractor shall be responsible for health / safety of their personnel including workers during their work at site and correct any deficiencies in the above matters.
- f) The contractor shall plan work activities so that all work will be done in compliance with the rules and regulations and procedure established by SMPK. and to follow safe working practices and keep site clean and neat.
- g) The contractor shall ensure availability of appropriate personal protection equipment such as safety helmets, safety shoes, gloves, life saving equipment nose guard, earplugs, safety harness, goggles to their employees / workers etc., and ensure wearing of PPEs by their employees/workers etc., while carrying out the works.
- h) The contractor shall ensure that all their construction plant and equipment to be employed on the work site is in safe and fully efficient working condition and arrange for carrying out required tests from time to time and submit certificates of such tests carried out according to safety regulations and ensure proper maintenance of the plant and equipment.
- i) The contractor shall investigate and report in writing to Engineer-in-Charge/ PMC about accidents if any taking place at site of work including near misses cases and based on reviews take remedial measures and implement the corrective action to ensure safe working conditions at site of work.
- j) The contractor shall arrange to provide First-Aid facility at site for immediate treatment.
- k) The contractor shall submit daily labour report including supervisors etc., with clearly specifying the names and their age to the SMPK's Engineer or his authorized representative at site. Also record of labour working beyond working hours shall be maintained and submitted to the SMPK Engineer or his authorized representative at site.
- l) The contractor shall submit the risk assessment on HIRA Format prior to the Execution of each activity.

**Traffic/Services Diversion Conditions:**

- 111. Barricades, vigils, safety lamps, flags, signals, caution boards, etc., for temporary traffic diversion etc., as per standards required during execution and progress of the Work without causing any inconvenience to the traffic shall be provided by the contractor at his own cost and all the safety precautions shall be ensured.
- 112. The Contractor shall take up all diversion works at his own cost.

113. The contractor has to plan well in advance at his own cost for the diversion of traffic keeping in view of existing pipelines, electrical lines, cable network, etc., before commencement of work and necessary precautionary measures has to be taken care.
114. The contractor has to plan and arrange to install at his own cost for re-alignment and erection of removed/diverted pipelines, electrical lines, cable network, etc., before completion of work, as per the requirement and as directed by the Engineer-in-Charge/ PMC.
115. The approaches to the Bridge on either end has to be developed and made good by the contractor at his own cost after completion of the Deck Structure, for safety and smooth flow of traffic as required at site and as directed by the Engineer-in-Charge/ PMC.

**Dismantling Conditions:**

116. The rate quoted by the bidders should be taken into account for complete dismantling of the bridge deck structure and removal and razing the above up to the top level of bridge supporting piers and handing over the all useful materials viz., Reinforcement/Structural steel, Steel, pipes, cables, etc., at Port General Stores or as directed by the Engineer-in-Charge/ PMC.
117. All the tenderers are requested to physically inspect the existing sub & super structure including ancillary works of the "Parallel Bridge" in Port area and satisfy themselves about the condition and obtain any clarification if required. No claims will be entertained in this regard.
118. The contractor has to plan well in advance the re-routing of pipelines, electrical lines, cable network, etc., before dismantling of the required work and necessary precautionary measures has to be taken care in the hindrance of the services.
119. The Contractor shall take great care to obtain all the useful materials in good condition from dismantling the structures and transport them to specified stores as directed by the Engineer-in-Charge.
120. The Contractor shall be responsible for the safety of all the useful materials obtained from dismantling until handing over the same to stores as specified or as directed by the Engineer-in-Charge.
121. No work relating dismantling should be undertaken unless and until the contractor /Engineer / Supervisor is present at site and as per the direction of the Engineer-in-Charge/ PMC of the work.
122. The dismantled materials/debris shall be transported and dumped in a place as shown by the Engineer-in-Charge/ PMC as required and as directed by the Engineer-in-Charge/ PMC at his own cost of the bidder.
123. **Dock Permit:** For works inside the Docks, Dock permit required for men , materials, vehicles and equipments etc. are to be procured by the successful tenderer **at free of cost** as per recommendation of the executing departments/divisions indicating the specific number of free permits to be issued. But for creation of individual IDs in permit system a charge as applicable, will be levied per person (one time) even for companies/ Individuals who have been granted permission to obtain free permits by KoPT. In case the work has to be carried out in an operational zone, the tenderer should keep in mind that the work is to be executed without hampering the operational activities and should complete the work within the stipulated time specified in the tender.

**SECTION-12**

**PRICE BID**

## **Syama Prasad Mookerjee Port, Kolkata**

CIVIL ENGINEERING DEPARTMENT

१५, स्ट्रैंडरोड, कोलकाता - ७००००१

15, Strand Road, Kolkata – 700001

NIT No.: SMPK/KDS/CIV /T/2622/60 DT. 29.10..2021

Last Date of **Download** of tender documents

**On 09.12.2021** (up to 12:00 hours)

Tender is due for submission by 15:00 hours

**On 09.12.2021**

**Tender will be opened on 10.12.2021 after 15:00 hours.**

### ***PRICE BID***

\*\*\*\*\*

**“DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD  
BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S.DOCK, KDS, SMP,  
KOLKATA”**

\*\*\*\*\*

**Syama Prasad Mookerjee Port, Kolkata**

**CIVIL ENGINEERING DEPARTMENT**

**PREAMBLE TO THE BILL OF QUANTITIES**

**E-TENDER FOR “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT N.S.DOCK, KDS, SMP, KOLKATA”**

**NIT NO: SMPK/KDS/CIV /T/2622/60 DT. 29.10.2021**

1.1	The Bill of Quantities must be read with the General Conditions of Contract, the Special Conditions of Contract and the Particular Specifications of Work and other documents of Tender and the Bidder is deemed to have examined the above documents and to have thoroughly familiarize himself with the total scope of work and its mode of execution.
1.2	Payment will be made according to the Payment Schedule as mentioned in the Tender Document. The measurements of work shall be measured jointly by the Engineer –In-Charge or his Representative/PMC with the contractor.
1.3	General direction and description of work or materials given elsewhere in the contract documents
1.4	The prices and rates entered by the Contractor in the Bill of Quantities shall be deemed to cover the complete and finished work, inter-alia, all costs and expenses which may be required for successful completion of the works together with all risks, liabilities, contingencies, insurance, octroi, royalties, taxes and obligations imposed or implied by the Contractor.
1.5	Where separate items such mobilization, demobilization, temporary works etc., have not been provided in the Bill of Quantities for works required under the Contract, then the cost of such works shall be deemed to have been included in the prices and rates of other items.
1.6	Without affecting the generality of the foregoing provisions, the prices and rates entered in the Bill of Quantities by the Contractor shall include inter-alia, all costs and expenses involved in or arising out the followings:- <div><div>a) The provision, storage, transport, handling, use distribution and maintenance of all materials, plans, equipment machineries and tools including all costs, charges, dues, demurrages or other outlays involved in the transportation.</div><div>b) The provision and maintenance of all his staff and labours and their payments, accommodation, transport, taxes and other requirements.</div><div>c) Setting out including the location and preservation of survey markers, measurement and supervision.</div><div>d) The provision, storage, transport, use handling, distribution and maintenance of consumable stores, fuel, water and electricity.</div></div>



	<p>e) All First Aid, Welfare and safety requirements.</p> <p>f) Damage caused to the works, plants, materials and consumables stores caused by weather.</p> <p>g) Licence, fees and other charges for compliance of Government Acts and Rules that are in-forced and applicable.</p>
<b>1.7</b>	The Contractor should be held responsible for the safe custody of materials, machineries etc. at site procured by him or issued to him by the Trustees.
<b>1.8</b>	This being a Lump- sum amount tender, the Bidder shall quote his rates on the basis of preliminary Design of Project & also considering other incidental charges during the execution of work based detailed analysis of the Project work on his own analysis.
<b>1.9</b>	No prices in figures or in words should be mentioned anywhere in the Techno - Commercial bid
<b>2.0</b>	Formats: Price Bid main format is related to price bid. The format should be entered online.
<b>2.1</b>	Apart from what is indicated in this NIT no other cost will be payable to the contractor. The bidder should therefore read all the instruction in this NIT carefully, visit the site, make preliminary design of the project and considered other incidental cost to ensure that they have quoted completely and fully. No additional demands would be entertained during the execution of the contract.

Syama Prasad Mookerjee Port, Kolkata  
CIVIL ENGINEERING DEPARTMENT

BILL OF QUANTITIES

E-TENDER “DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION  
OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACKYARD AT  
N.S.DOCK, KDS, SMP, KOLKATA”

SMPK/KDS/CIV /T/2622/60. DT. 29.10.2021

BILL OF QUANTITIES

SL No	Description	Qty	Unit	Rate	Amount (Rs) in figure
1	Rehabilitation and reconstruction of old 7, NSD Berth of size 182.2m x 26.75m after demolition of old berth structure (slab, beam, pile muff and other fitting & fixture) to be construction on in situ boared piles. The berth structure will rest on pile muff with necessary beam-slab combination for operation of MHC of LHM425 & RMQC and development of a container stackyard of size 182.20m x 61.95m with paver block topping after dismantling of old existing yard to withstand load of 5 high 40'/20' container stacking with movement of RST with provision of necessary drainage, RCC cable trench and fire-fighting duct and foundation of high mast electric tower.	1.00	Each		
	TOTAL AMOUNT (In Words)				

NOTE: PRICE NOT TO BE QUOTED HERE

Total Tendered Amount: Rs.

Total tendered amount (in words.....)

[The prices quoted shall be including all statutory levies excluding GST, which shall be paid extra]

Maximum number of workmen likely to be engaged in days work..... numbers

Permanent Income Tax A/C. No... ..

Date: \_\_\_\_\_ (Signature of Tenderer)

[Total amount of tender, completion time and preliminary time as quoted / stated above are to be carried over to Form of Tender attached]

\_\_\_\_\_  
(Signature of Tenderer)

Witness: -

(Name in block letters)

Address:

Occupation


## **SECTION -11**

### **SOIL INVESTIGATION REPORT**

# **SYAMA PRASAD MOOKERJEE PORT KOLKATA**

**CIVIL ENGINEERING DEPARTMENT  
OFFICE OF THE CHIEF ENGINEER  
15 STRAND ROAD, KOLKATA – 700001**

*REPORT  
ON*  
**SOIL INVESTIGATION WORK FOR THE UPGRADATION OF BERTH  
NO.7, NSD, N.S.DOCK**



**CONSTELL CONSULTANTS PVT. LTD.  
KOLKATA**

## TABLE OF CONTENTS

<b>CHAPTER – I</b>	
<i>INTRODUCTION .....</i>	<i>1</i>
 <b>CHAPTER – II</b>	
<i>PROJECT DETAILS.....</i>	<i>2</i>
 <b>CHAPTER – III</b>	
<i>LABORATORY TESTING .....</i>	<i>5</i>
 <b>CHAPTER – IV</b>	
<i>DISCUSSION AND RECOMMENDATION.....</i>	<i>7</i>
 <b>CHAPTER – V</b>	
<i>BORE HOLE LOCATION PLAN. ....</i>	<i>A-1</i>
<i>BORE / DRILL LOGS. ....</i>	<i>B-1 TO B-40</i>
<i>GRAPHICAL REPRESENTATION OF N-VALUE WITH R.L. ....</i>	<i>B-41 TO B-44</i>
<i>LABORATORY TEST RESULTS .....</i>	<i>C-1 TO C-46</i>
<i>PROFILES .....</i>	<i>D-1 TO D-4</i>
<i>GRAIN SIZE DISTRIBUTION CURVES .....</i>	<i>E-1 TO E-78</i>
<i>MOHR'S DIAGRAM / DIRECT SHEAR TEST .....</i>	<i>F-1 TO F-53</i>
<i>e-logp CURVES.....</i>	<i>G-1 TO G-100</i>
<i>MOISTURE CONTENT VS DRY DENSITY PLOT .....</i>	<i>H-1 TO H-20</i>
<i>TYPICAL SAMPLE CALCULATION .....</i>	<i>I-1 TO I-6</i>
<i>PHOTOGRAPH.....</i>	<i>P-1-P-4</i>

---

## C H A P T E R   -   I

### **1.0 INTRODUCTION**

- 1.1 Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock was entrusted to Constell Consultants Pvt. Ltd., 7, Sristidhar Dutta Lane, Kolkata – 700 006 by Syama Prasad Mookerjee Port, Kolkata, Civil Engineering Department, Office of the Chief Engineer, 15 Strand Road, Kolkata – 700001.
- 1.2 The scope of the soil investigation work consisted of sinking ten (10) bore holes each upto a depth of 50.0m below the existing ground / bed level in all kinds of soil formation including collection of undisturbed / disturbed soil samples and conducting Standard Penetration Tests.
- 1.3 The formation at the site is to be reported for various layers present at their respective depths along with their thickness. As ground water table location influences the method of construction of foundation at a site, its depth also needed to be found out. However, it should be noted that the depth of groundwater table observed during the investigation could differ from those encountered during construction and operational life of the constructed facility depending on prevailing meteorological conditions.
- 1.4 During sinking of bore holes soil samples both in disturbed and undisturbed conditions are to be collected for laboratory tests. The disturbed samples would be subjected to tests to obtain soil index properties. The undisturbed soil samples, however, would be used mainly for conducting tests to obtain shear strength parameters as well as compressibility characteristics of the soil representing the strata.
- 1.5 Since the investigation could not cover the regional sub-soil features, due weightage for the variations of sub-surface layers in its horizontal and vertical extent is to be given in selecting design basis.

## CHAPTER - II

### 2.0 PROJECT DETAILS

- 2.1 The site for the investigation work is situated inside N.S. Dock at Berth No.7 in Kolkata.
- 2.2 The field work consisted of sinking ten (10) bore holes – four (4) from the existing bed level below the concrete deck of Berth No.7 and six (6) on the adjacent land each upto a depth of 50.00m below the existing ground / bed level at specified locations. The details of field work like, location (Co-ordinate), bore hole no., RL at bore hole top, termination depth, water level and the dates of commencement and completion are furnished below.

Bore Hole No.	Location (Co-ordinate)		RL. at Bore Hole Top (m)	Termination Depth (m)	Water Level b.g.l (m)	Start Date	End Date
	North	East					
BH-1	22°32'29.50"	88°17'58.75"	+4.4	50.00	** Under Water	27.11.20	30.11.20
BH-2	22°32'28.20"	88°17'58.70"	+4.4	50.00		13.11.20	16.11.20
BH-3	22°32'27.17"	88°17'57.86"	+4.3	50.00		10.12.20	12.12.20
BH-4	22°32'25.75"	88°17'57.89"	+4.3	50.00		23.11.20	26.11.20
BH-5	22°32'24.68"	88°17'57.17"	+7.3	50.00	2.00	03.12.20	05.12.20
BH-6	22°32'29.05"	88°18'0.23"	+7.3	50.00	2.10	30.11.20	02.12.20
BH-7	22°32'27.06"	88°17'59.80"	+7.3	50.00	2.05	13.12.20	15.12.20
BH-8	22°32'25.69"	88°17'58.97"	+7.3	50.00	2.20	07.12.20	09.12.20
BH-10	22°32'28.88"	88°18'1.53"	+7.3	50.00	2.10	17.11.20	20.11.20
BH-11	22°32'27.63"	88°18'1.01"	+7.3	50.00	2.05	21.11.20	23.11.20
<b>Note:</b> b.g.l.= below ground level, ** = max. and min. water level are shown in respective borelogs							

- 2.3 The bore holes of 150 mm diameter were explored with the help of cable operated shell using engine driven mechanical winch as per IS 1892-1979. Shell is used which is a 127mm diameter steel cylinder with a cutting edge at the bottom and is fitted with a hinged one-way flap valve at the bottom. The bore hole is advanced by raising the shell upto a height and allowing it to fall and this is repeated several times till sufficient amount

of soil enters the shell. When the shell gets nearly filled with soil, it is lifted out of the bore hole and emptied. This method of boring is followed upto a suitable depth below the existing ground / bed level.

For further advancement of bore hole mud rotary boring method was adopted. In this method the boring is advanced by a cutter fixed to drill pipes, which are rotated by means of pipe wrenches. Bentonite solution is pushed simultaneously by a mechanical pump. The slurry flowing out of cutter bottom mixes up with the cut soil and flows up to the ground surface, and slurry tank after passing through settling pits and back to the slurry tank. The process is continuous and the same slurry can be used several times. The cutting tool is lowered slowly with the help of a double pulley system fixed on a tripod. This method of boring was followed upto the explored depth of the bore hole.

- 2.4 Seamless flush jointed steel casing of Sx size was used to prevent any caving and water loss from bore holes and those were inserted simultaneously with the advancement of boring operations.
- 2.5 The undisturbed samples were collected from the bore holes at suitable interval wherever possible, with the help of a thin walled sampler, as per the IS: 2132-1986 "Code of practice for thin walled tube sampling of soils". The area ratio of the sampler is of the order of twelve percent and the inside clearance is around two percent. The sample tube about 500mm long and 100mm inner diameter, is coupled with the sampler with a drive head, vent holes and ball check valve to complete the sampling assembly. While sampling below the water table inside the bore hole, the entrapped water has the opportunity to escape through this valve at the top. The sampling assembly is then lowered inside the bore holes by connecting a string of 'AW' size drill rods to it. The assembly is driven to a predetermined depth with the help of jarring link. On completion of sampling operation, the sampler is first rotated (so that the soil would shear off on a horizontal plane at the cutting



shoe edge) and then raised to the surface. The undisturbed sample is waxed at both ends with proper identification mark on the tube sampler.

- 2.6 Standard Penetration Tests were conducted inside the bore holes at 1.5m intervals as per IS 2131-1981 "Method of standard penetration tests for soils". The spoon is advanced by driving with a **Auto-Trip** hammer weighing 63.5 kg falling freely through a height of 75 cm. A record of the number of blows required to penetrate every 15 cm. to a depth of 45cm is kept. The number of blows required for the last 30 cm penetration of the split spoon sampler is recorded as 'N'-value. On completion of the test, the sampler is lifted to the ground, opened and the specimen of the soil sample is stored in double polythene bags with the proper identification mark. The penetration number, 'N' has been shown against the corresponding depths in field bore logs
- 2.7 Representative disturbed samples were collected regularly and wherever the stratum changed. These samples are taken from the cutting edge of undisturbed samples and the split spoon samplers after standard penetration tests. These samples are labelled depth wise and used in the preparation of bore hole log and for general identification and classification purposes. Moreover large quantity of disturbed samples from bailer cuttings (10 nos.) were collected from different depths of BH-5 to BH-8, BH-10 and BH-11 for the determination of maximum dry density and optimum moisture content by light and heavy compactions as specified.
- 2.8 The field investigation work commenced on 13.11.2020 and was completed on 15.12.2020.

## C H A P T E R - I I I

### **3.0 LABORATORY TESTING**

3.1 The following laboratory tests are carried out on undisturbed and disturbed soil samples for identification and classification purposes and to obtain other relevant properties of the sub-surface formation.

- (a) Natural Moisture Content
- (b) Sieve analysis
- (c) Hydrometer analysis
- (d) Liquid Limit and Plastic Limit
- (e) Bulk and Dry Density
- (f) Unconfined Compression Test
  - i) On Undisturbed sample
  - ii) On Remoulded sample
- (g) Triaxial Shear Test (Unconsolidated Un-drained)
- (h) Direct shear test
  - i) On Undisturbed sample
  - ii) On Remoulded sample
- (i) Specific Gravity
- (j) Consolidation Test
- (k) Permeability Test
- (l) Proctor Test (Light and Heavy Compaction)

- 3.2 Chemical analysis of soil samples were also carried out for the determination of different parameters as specified.
- 3.3 All these tests are conducted as per relevant IS Code where such exists and the test results are tabulated in Tables attached herewith.

## C H A P T E R - I V

### 4.0 DISCUSSION AND RECOMMENDATION

4.1 The sub-soil investigation work has been investigated by sinking ten (10) bore holes each upto a depth of 50.0m below the existing ground / bed level at specified locations. The field investigation data and the results of laboratory test conducted on samples collected from the bore holes indicate the presence of different layers beside a filled up layer at the surface of BH-5 to 8, BH-10 & BH-11. The details of layers like layer no., description of layer and the thickness of each layer as encountered in the bore holes are furnished below.

Layer No.	Description	Layer Thickness (m)				
		BH-1	BH-2	BH-3	BH-4	BH-5
—	Fill consisting of silty sand / sand with stone / brick pieces etc.	—	—	—	—	0.70
I	Soft / firm silty clay / silty clay with high silt content / sandy silty clay	5.00	*5.00	—	3.50	*4.80
II	Very soft / soft / firm silty clay / clayey silt with varying percentage of decomposed wood	6.00	6.00	13.00	7.50	9.50
IIIA	Stiff / very stiff silty clay with occasional traces of calcareous nodules	6.50	4.00	5.00	5.00	4.50
IIIB	Stiff / very stiff / hard silty clay (high silt content) / clayey silt / sandy silty clay / medium dense clayey sandy silt	4.50	3.00	4.50	1.50	3.50
IV	Medium dense / dense / very dense silty sand	3.00	7.50	2.50	7.50	5.00
V	Stiff / very stiff to hard silty clay / sandy silty clay with occasional yellow / brown spots	11.50	12.50	12.50	10.80	11.00
VI	Medium dense / dense / very dense silty sand / medium to fine sand	13.50	12.00	12.50	14.20	**11.00
<p>*1.75m±0.25m thick bands of very loose / loose silty fine sand / fine sand are found to be present at the top and within layer-I in BH-2 and BH-5 as shown in sub-soil profile.</p> <p>**1.5m thick band of hard sandy silty clay is found to be present in layer-VI from 44.0m to 45.5m depth in BH-5 as shown in sub-soil profile.</p>						

Layer No.	Description	Layer Thickness (m)				
		BH-6	BH-7	BH-8	BH-10	BH-11
—	Fill consisting of silty sand / sand with stone / brick pieces etc.	2.00	1.50	0.90	1.50	0.80
I	Soft / firm silty clay / silty clay with high silt content / sandy silty clay	*4.50	4.00	*4.60	5.00	6.70
II	Very soft / soft / firm silty clay / clayey silt with varying percentage of decomposed wood	9.00	9.50	9.50	7.50	7.00
IIIA	Stiff / very stiff silty clay with occasional traces of calcareous nodules	4.50	6.00	7.50	5.50	3.50
IIIB	Stiff / very stiff / hard silty clay (high silt content) / clayey silt / sandy silty clay / medium dense clayey sandy silt	4.50	4.50	3.00	2.50	4.50
IV	Medium dense / dense / very dense silty sand	2.50	2.50	2.50	5.00	4.50
V	Stiff / very stiff to hard silty clay / sandy silty clay with occasional yellow / brown spots	12.50	12.50	11.30	18.00	18.00
VI	Medium dense / dense / very dense silty sand / medium to fine sand	**10.50	9.50	10.70	5.00	5.00
<p>*1.5m thick band of loose / medium dense sandy silt / silty sand with traces of clay are found to be present at the top and within layer-I in BH-6 and BH-8 as shown in sub-soil profile.</p> <p>**1.5m thick band of hard sandy silty clay is found to be present in layer-VI from 44.0m to 45.5m depth BH-6 as shown in sub-soil profile.</p>						

**Note:** The description of layers are very much generalized. For detail description refer respective bore hole logs.

4.2 The water level in the bore holes during the period of field work are shown in the respective bore logs. The laboratory test results are tabulated in table nos. C/1-1 to C/12-5. The bore hole location plan is shown in fig. no. A/1. The graphical representation of field and corrected 'N' values with RL are shown in fig. nos. B/1 to B/4. The sub-soil formation as revealed by the bore holes are shown in fig. nos. D/1 to D/4. The grain size distribution curves are shown in fig. nos. E/1 to E/78. The Mohr's diagrams from Tri-axial shear test and normal stress vs shear stress plot from Direct Shear Test are shown in fig. nos. F/1 to F/53. The e-log p curves from consolidation test are shown in fig. nos. G/1 to

G/100. The figures of moisture content vs dry density plot both for light and heavy compaction are shown in fig nos. H/1 to H/20.

4.3 On close scrutiny of field and laboratory test results and based on experience and judgement, necessary soil parameters (bore hole wise) for the purpose of design of foundation are tabulated in the following table.

**BH-1**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
I	Soft to firm sandy silty clay to silty clay	+4.4 (B.L.)	(-)0.6	5.0	4 to 5	1.854	$c=2.9t/m^2$
II	Soft / firm silty clay / clayey silt with varying percentage of decomposed wood	(-)0.6	(-)6.6	6.0	2 to 5	1.584	$c=1.9t/m^2$
IIIA	Stiff / very stiff silty clay	(-)6.6	(-)13.1	6.5	10 to 18	1.945	$c=7.0t/m^2$
IIIB	Hard sandy silty clay with occasional presence of gravels	(-)13.1	(-)17.6	4.5	39 & 47	§2.070	§ $c=19.0t/m^2$
IV	Dense silty sand	(-)17.6	(-)20.6	3.0	§40	2.050	$\phi=36^\circ$
V	Very stiff / hard silty clay with brown spots	(-)20.6	(-)28.1	7.5	19 to 23	1.966	$c=9.7t/m^2$
		(-)28.1	(-)32.1	4.0	32 & 35	§2.030	§ $c=15.0t/m^2$
VI	Dense / very dense silty sand	(-)32.1	(-)45.6 (T.L.)	13.5	§40	2.078	$\phi=37.5^\circ$
B.L= Bed Level, T.L.= Termination Level, § = Suggested Value							

**BH-2**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
I	Very loose / loose silty fine sand followed by soft / firm silty clay	+4.4 (B.L.)	+2.4	2.0	4	1.755	$\phi=26^\circ$
		+2.4	(-)0.6	3.0	4	1.832	$c=2.5t/m^2$
II	Soft / firm silty clay / clayey silt with varying percentage of decomposed wood	(-)0.6	(-)6.6	6.0	2 to 5	1.595	$c=2.1t/m^2$
IIIA	Stiff to very stiff silty clay	(-)6.6	(-)10.6	4.0	10 to 17	1.946	$c=7.0t/m^2$
IIIB	Stiff / very stiff silty clay with high silt content	(-)10.6	(-)13.6	3.0	17	1.963	$c=7.3t/m^2$
IV	Medium dense silty sand	(-)13.6	(-)21.1	7.5	18 to 29	1.965	$\phi=34^\circ$
V	Very stiff to hard silty clay	(-)21.1	(-)25.6	4.5	17 & 23	1.969	$c=10.0t/m^2$
		(-)25.6	(-)33.6	8.0	36 to 52	§2.070	§ $c=19.0t/m^2$
VI	Dense / very dense silty sand	(-)33.6	(-)45.6 (T.L.)	12.0	§40	2.065	$\phi=37^\circ$
B.L= Bed Level, T.L.= Termination Level, § = Suggested Value							

**BH-3**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	( $m$ )			
II	Very soft to soft silty clay with varying percentage of decomposed wood	+4.3 (B.L.)	(-)8.7	13.0	1 to 4	1.626	$c=1.6t/m^2$
IIIA	Stiff silty clay	(-)8.7	(-)13.7	5.0	8 to 16	1.923	$c=6.1t/m^2$
IIIB	Very stiff to hard sandy silty clay	(-)13.7	(-)15.2	1.5	27	\$2.000	$\S c=12.0t/m^2$
		(-)15.2	(-)18.2	3.0	38 & 47	\$2.070	$\S c=19.0t/m^2$
IV	Dense / very dense silty sand	(-)18.2	(-)20.7	2.5	37	2.028	$\phi=35.5^\circ$
V	Very stiff silty clay	(-)20.7	(-)33.2	12.5	24 to 30	2.001	$c=12.2t/m^2$
VI	Dense / very dense silty sand	(-)33.2	(-)36.2	3.0	\$40	2.058	$\phi=37^\circ$
		(-)36.2	(-)37.7	1.5	27	2.028	$\phi=35^\circ$
		(-)37.7	(-)45.7 (T.L.)	8.0	\$40	2.056	$\phi=37^\circ$
B.L= Bed Level, T.L.= Termination Level, \$ = Suggested Value							



**BH-4**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
I	Firm silty clay to silty clay with high silt content	+4.3 (B.L.)	+0.8	3.5	5 & 6	1.852	$c=3.0t/m^2$
II	Soft silty clay / clayey silt with varying percentage of decomposed wood	+0.8	(-)6.7	7.5	2 to 5	1.544	$c=1.9t/m^2$
IIIA	Stiff to very stiff silty clay	(-)6.7	(-)9.7	3.0	9 & 14	1.920	$c=5.6t/m^2$
		(-)9.7	(-)11.7	2.0	20	1.970	$c=9.8t/m^2$
IIIB	Stiff silty clay with high silt content / clayey silt	(-)11.7	(-)13.2	1.5	15	1.949	$c=5.9t/m^2$
IV	Medium dense to dense silty sand	(-)13.2	(-)17.7	4.5	18 to 25	1.940	$\phi=33^\circ$
		(-)17.7	(-)20.7	3.0	32 & 36	2.020	$\phi=36.5^\circ$
V	Very stiff to hard silty clay with occasional brown spots	(-)20.7	(-)22.2	1.5	17	1.958	$c=7.8t/m^2$
		(-)22.2	(-)31.5	9.3	28 to 34	§2.020	§ $c=14.5t/m^2$
VI	Dense / very dense silty sand	(-)31.5	(-)45.7 (T.L.)	14.2	§40	2.064	$\phi=37^\circ$
B.L= Bed Level, T.L.= Termination Level, § = Suggested Value							

**BH-5**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
—	Fill consisting of silty sand with stone / brick pieces etc.	+7.3 (G.L.)	+6.6	0.7	—	§1.800	—
I	Firm silty clay to silty clay with high silt content; loose fine sand observed from 2.5m to 4.0m depth	+6.6	+4.8	1.8	4	1.813	c=2.4t/m <sup>2</sup>
		+4.8	+3.3	1.5	5	1.755	φ=27°
		+3.3	+1.8	1.5	4	1.830	c=2.5t/m <sup>2</sup>
II	Soft to firm silty clay with varying percentage of decomposed wood	+1.8	(-)4.7	6.5	2 to 3	1.649	c=1.9t/m <sup>2</sup>
		(-)4.7	(-)7.7	3.0	6 & 7	1.755	c=3.1t/m <sup>2</sup>
IIIA	Stiff silty clay with occasional presence of calcareous nodules	(-)7.7	(-)12.2	4.5	9 & 10	1.934	c=5.2t/m <sup>2</sup>
IIIB	Very stiff brownish yellow silty clay (high silt content) / clayey silt with sand; medium dense sandy silt observed from 22.5m depth	(-)12.2	(-)15.2	3.0	21 & 25	§1.980	§c=10.0t/m <sup>2</sup>
		(-)15.2	(-)15.7	0.5	19	§1.910	§φ=31°
IV	Medium dense to dense silty sand	(-)15.7	(-)18.2	2.5	23	1.940	φ=33°
		(-)18.2	(-)20.7	2.5	34 & 39	2.030	φ=36.5°
V	Stiff / very stiff to hard silty clay with occasional brown spots	(-)20.7	(-)24.2	3.5	15 & 18	1.958	c=8.0t/m <sup>2</sup>
		(-)24.2	(-)27.2	3.0	24 & 29	2.008	c=11.8t/m <sup>2</sup>
		(-)27.2	(-)31.7	4.5	33 to 36	§2.035	§c=15.5t/m <sup>2</sup>
VI	Medium dense / dense to very dense silty sand	(-)31.7	(-)34.7	3.0	29	2.026	φ=35°
		(-)34.7	(-)40.7	6.0	§40	2.061	φ=37°
		(-)40.7	(-)42.7 (T.L.)	2.0	25 & 33	2.021	φ=35°
G.L.= Ground Level, T.L.= Termination Level, § = Suggested Value							

**BH-6**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
—	Fill consisting of silty sand with stone / brick pieces etc.	+7.3 (G.L.)	+5.3	2.0	—	1.830	—
I	Soft to firm silty clay; loose sandy silt / silty sand with clay as binder observed upto 3.5m depth	+5.3	+3.8	1.5	8	1.760	$\phi=27.5^\circ$
		+3.8	+2.3	1.5	2	1.801	$c=1.4t/m^2$
		+2.3	+0.8	1.5	6	1.851	$c=3.4t/m^2$
II	Soft / firm silty clay with varying percentage of decomposed wood	+0.8	(-)8.2	9.0	2 to 5	1.666	$c=1.8t/m^2$
IIIA	Stiff silty clay with occasional traces of calcareous nodules	(-)8.2	(-)12.7	4.5	9 to 16	1.935	$c=6.4t/m^2$
IIIB	Medium dense sandy silt with clay as binder to hard silty clay with high silt content	(-)12.7	(-)17.2	4.5	20 & 28	$\S 1.980$	$\S \phi=33^\circ$
IV	Dense silty sand	(-)17.2	(-)19.7	2.5	33 & 37	2.028	$\phi=36^\circ$
V	Very stiff to hard silty clay	(-)19.7	(-)26.2	6.5	19 to 23	1.966	$c=9.0t/m^2$
		(-)26.2	(-)29.2	3.0	33 & 35	$\S 2.030$	$\S c=15.0t/m^2$
		(-)29.2	(-)32.2	3.0	23	$\S 1.970$	$\S c=10.0t/m^2$
VI	Dense / very dense silty sand	(-)32.2	(-)42.7 (T.L.)	10.5	$\S 40$	2.059	$\phi=37.5^\circ$
G.L= Ground Level, T.L.= Termination Level, $\S$ = Suggested Value							

**BH-7**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
—	Fill consisting of silty sand with stone / brick pieces etc.	+7.3 (G.L.)	+5.8	1.5	—	1.855	—
I	Soft silty clay	+5.8	+1.8	4.0	2 to 3	1.764	$c=1.7t/m^2$
II	Soft / firm silty clay with varying percentage of decomposed wood	+1.8	(-)7.7	9.5	3 to 5	1.670	$c=2.1t/m^2$
IIIA	Stiff silty clay	(-)7.7	(-)8.7	1.0	9	§1.890	§ $c=4.0t/m^2$
		(-)8.7	(-)13.7	5.0	12 to 17	1.948	$c=7.2t/m^2$
IIIB	Stiff to very stiff silty clay with high silt content	(-)13.7	(-)15.2	1.5	15	§1.950	§ $c=6.5t/m^2$
		(-)15.2	(-)18.2	3.0	25 & 31	§2.010	§ $c=12.5t/m^2$
IV	Medium dense to very dense silty sand	(-)18.2	(-)19.7	1.5	28	2.019	$\phi=35^\circ$
		(-)19.7	(-)20.7	1.0	§40	§2.070	§ $\phi=37^\circ$
V	Very stiff to hard silty clay with occasional brown / yellow spots	(-)20.7	(-)27.2	6.5	17 to 24	1.964	$c=9.0t/m^2$
		(-)27.2	(-)31.7	4.5	35 to 42	§2.050	§ $c=17.0t/m^2$
		(-)31.7	(-)33.2	1.5	24	§1.980	§ $c=11.0t/m^2$
VI	Dense / very dense fine sand	(-)33.2	(-)42.7 (T.L.)	9.5	§40	2.055	$\phi=37^\circ$
G.L= Ground Level, T.L.= Termination Level, § = Suggested Value							

**BH-8**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
—	Fill consisting of silty sand with stone / brick pieces etc.	+7.3 (G.L.)	+6.4	0.9	—	§1.800	—
I	Firm silty clay; medium dense silty fine sand with traces of clay observed from 2.5m to 4.0m depth	+6.4	+4.8	1.6	6	1.851	c=3.1t/m <sup>2</sup>
		+4.8	+3.3	1.5	15	1.834	φ=31°
		+3.3	+1.8	1.5	4	1.825	c=2.4t/m <sup>2</sup>
II	Soft / firm silty clay with varying percentage of decomposed wood	+1.8	(-)7.7	9.5	2 to 5	1.637	c=2.0t/m <sup>2</sup>
IIIA	Stiff silty clay with occasional traces of calcareous nodules	(-)7.7	(-)15.2	7.5	10 to 16	1.935	c=6.0t/m <sup>2</sup>
IIIB	Medium dense sandy clayey silt to sandy silt with traces of clay	(-)15.2	(-)18.2	3.0	24 & 25	§1.980	§φ=33.5°
IV	Medium dense to dense silty sand	(-)18.2	(-)19.7	1.5	19	1.911	φ=32.5°
		(-)19.7	(-)20.7	1.0	§40	§2.070	§φ=37°
V	Very stiff to hard silty clay with yellow spots	(-)20.7	(-)24.2	3.5	19 & 21	1.962	c=9.2t/m <sup>2</sup>
		(-)24.2	(-)28.7	4.5	27 to 31	§2.020	§c=13.0t/m <sup>2</sup>
		(-)28.7	(-)32.0	3.3	38 to 49	§2.070	§c=19.5t/m <sup>2</sup>
VI	Dense / very dense silty sand	(-)32.0	(-)34.7	2.7	31	2.012	φ=36°
		(-)34.7	(-)42.7 (T.L.)	8.0	§40	2.059	φ=37.5°
G.L.= Ground Level, T.L.= Termination Level, § = Suggested Value							

**BH-10**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
—	Fill consisting of silty sand with stone / brick pieces etc.	+7.3 (G.L.)	+5.8	1.5	—	§1.800	—
I	Soft / firm silty clay	+5.8	+3.8	2.0	3	1.801	$c=1.7t/m^2$
		+3.8	+0.8	3.0	5 & 6	1.856	$c=2.8t/m^2$
II	Soft / firm silty clay with varying percentage of decomposed wood	+0.8	(-)4.7	5.5	3 to 4	1.590	$c=1.9t/m^2$
		(-)4.7	(-)6.7	2.0	6	1.448	$c=2.7t/m^2$
IIIA	Stiff silty clay with occasional traces of calcareous nodules	(-)6.7	(-)12.2	5.5	8 to 13	1.930	$c=5.2t/m^2$
IIIB	Very stiff / hard silty clay with high silt content to medium dense clayey sandy silt	(-)12.2	(-)14.2	2.0	31	2.018	$\xi c=14.0t/m^2$
		(-)14.2	(-)14.7	0.5	20	§1.920	$\xi \phi=32^\circ$
IV	Medium dense silty sand	(-)14.7	(-)19.7	5.0	21 to 22	1.929	$\phi=33^\circ$
V	Very stiff to hard silty clay to sandy silty clay	(-)19.7	(-)21.7	2.0	19	1.964	$c=8.4t/m^2$
		(-)21.7	(-)23.2	1.5	27	2.006	$c=11.4t/m^2$
		(-)23.2	(-)37.7	14.5	35 to 45	§2.070	$\xi c=18.0t/m^2$
VI	Dense / very dense silty sand	(-)37.7	(-)42.7 (T.L.)	5.0	§40	2.069	$\phi=37^\circ$
G.L.= Ground Level, T.L.= Termination Level, § = Suggested Value							

**BH-11**

LAYER DETAILS					Corrected N Value	Bulk Density ( $t/m^3$ )	Shear Strength parameter
No.	Description	R.L (m)		Thick- ness			
		From	To	(m)			
—	Fill consisting of sand with stone / brick pieces etc.	+7.3 (G.L.)	+6.5	0.8	—	§1.800	—
I	Soft sandy silty clay; very loose to loose clayey sandy silt to silty fine sand observed from 4.5m depth	+6.5	+2.8	3.7	2 & 4	1.821	$c=1.8t/m^2$
		+2.8	(-)0.2	3.0	2 & 7	1.760	$\phi=26^\circ$
II	Soft / firm silty clay / clayey silt with varying percentage of decomposed wood	(-)0.2	(-)7.2	7.0	3 & 6	1.643	$c=2.3t/m^2$
IIIA	Stiff silty clay with occasional traces of calcareous nodules	(-)7.2	(-)10.7	3.5	8 & 13	1.914	$c=5.3t/m^2$
IIIB	Very stiff silty clay with high silt content to medium dense clayey sandy silt	(-)10.7	(-)12.2	1.5	17	§1.960	$\S c=7.5t/m^2$
		(-)12.2	(-)15.2	3.0	14 & 22	§1.900	$\S \phi=31.5^\circ$
IV	Medium dense / dense silty sand	(-)15.2	(-)19.7	4.5	22 to 30	2.021	$\phi=35^\circ$
V	Stiff to very stiff / hard silty clay to sandy silty clay	(-)19.7	(-)21.2	1.5	13	1.936	$c=6.1t/m^2$
		(-)21.2	(-)25.7	4.5	19 to 21	1.967	$c=9.5t/m^2$
		(-)25.7	(-)33.2	7.5	32 to 44	§2.040	$\S c=16.0t/m^2$
		(-)33.2	(-)37.7	4.5	§50	§2.080	$\S c=22.0t/m^2$
VI	Dense / very dense silty sand	(-)37.7	(-)42.7 (T.L.)	5.0	§40	2.046	$\phi=37^\circ$
G.L.= Ground Level, T.L.= Termination Level, § = Suggested Value							

- 4.4 In view of the sub-soil formation encountered in this area, deep foundation in the form of bored cast-in-situ concrete piles may be provided to carry the load from superstructure. The suggested safe load carrying capacities of **1.2m dia. piles** when placed at R.L.(-)23.0m are furnished in the following table.

Bore Hole Nos.	Dredge Level	Pile Details					Suggested Pile capacity		
		Cut-off level	Founding level	Length of pile	Embedded length of pile	Dia.	Vertical	Uplift	Lateral
	(m)	(m)	(m)	(m)	(m)	(m)	(t)	(t)	(t)
BH-1 to BH-5	(-)5.2	+6.0	(-)23.0	29.0	17.8	1.20	125.0	100.0	8.5
BH-6 to BH-8, BH-10 & BH-11	-	+6.0	(-)23.0	29.0	-	1.20	150.0	120.0	12.0

The above mentioned pile capacities have been calculated on the basis of available and conventional static formula using a factor of safety of 2.5. However it is essential to install the piles with good engineering practice. In reality the actual pile load capacity is dependant on proper installation of pile. The piles may be installed at a centre to centre spacing of  $3.0 \times d$ , where 'd' is the diameter of a pile. Initial load test on piles should be carried out as per BIS 2911 (Part-4) and based on pile load test data final safe design load on a pile should be adopted.

- 4.5 The results of chemical analysis of soil samples are tabulated in Table nos. C/12-1 to C/12-5. Based on the results concrete to be used in foundation construction should be in line with recommendations of IS:456 – 2000.

for **CONSTELL CONSULTANTS PRIVATE LIMITED**


Dated January 18, 2021

  
**S.NANDI**  
B-TECH, ME, MIGS  
SR. GEOTECHNICAL ENGINEER

  
**B. N. BASAK**  
M.E., MIE, MIGS, MIRC, MISEG  
DIRECTOR



## **CHAPTER-V**

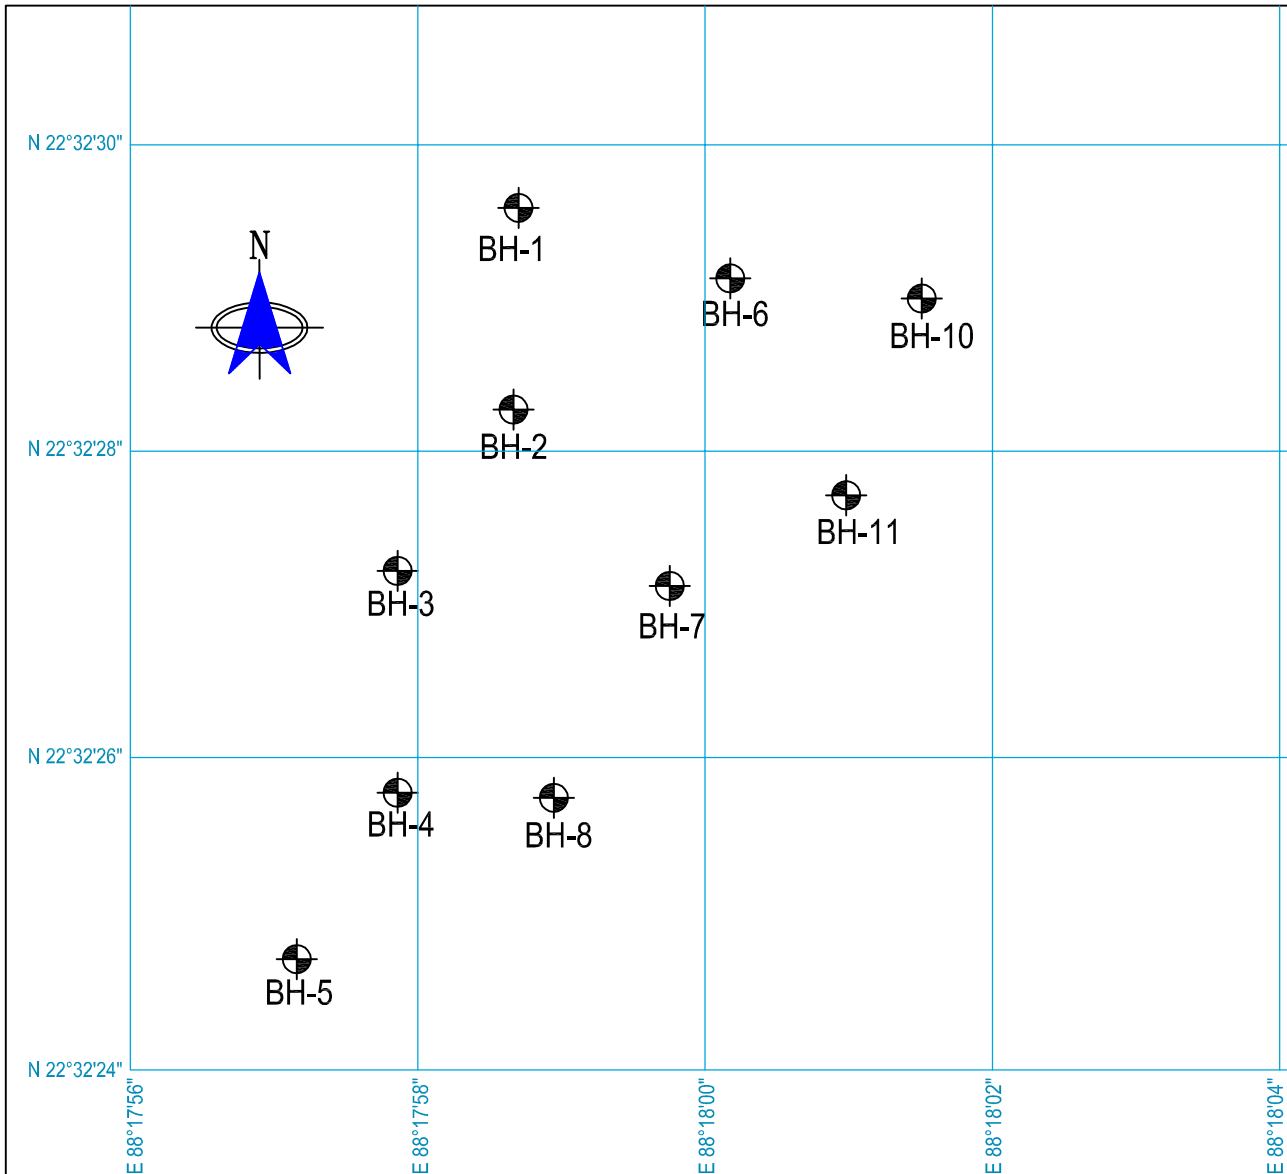

Details of Bore Holes

Sl.	BH No.	Latitude(N)	Longitude(E)	RL
1	BH-1	22°32'29.50"	88°17'58.75"	+4.4
2	BH-2	22°32'28.20"	88°17'58.70"	+4.4
3	BH-3	22°32'27.17"	88°17'57.86"	+4.3
4	BH-4	22°32'25.75"	88°17'57.89"	+4.3
5	BH-5	22°32'24.68"	88°17'57.17"	+7.3
6	BH-6	22°32'29.05"	88°18'0.23"	+7.3
7	BH-7	22°32'27.06"	88°17'59.80"	+7.3
8	BH-8	22°32'25.69"	88°17'58.97"	+7.3
9	BH-10	22°32'28.88"	88°18'1.53"	+7.3
10	BH-11	22°32'27.63"	88°18'1.01"	+7.3

Notes :-

1. All dimensions are in metre, unless otherwise mentioned.
2. Location (co-ordinate) of Bore Holes are supplied by the client.
3. Reduced Level of Bore Holes are based on present berth level whose value is +7.32m above KODS as supplied by the client

Bore Hole Location Plan for the upgradation of Berth No.7, NSD, N.S. Dock

Job No.: CCPL/20101211

Scale : 1: 2000

Figure No.: A/1



## BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-1

Location : N 22°32'29.50", E 88°17'58.75"

Ground Elevation : +4.4m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.85m a.b.l (max.) at 13:00 hrs on 28/11/20  
0.65m a.b.l (min.) at 8:00 hrs on 27/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 27.11.20 To 30.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
27/11	+4.4	0.00													Soft to firm grey sandy silty clay to silty clay
		0.50	1.00	0.50	U	-	-	-	-	-	-	-	-	-	
		1.00	1.45	0.45	P-D	1	2	2	-	4	-	-	-	-	
		2.00	2.50	0.50	U	-	-	-	-	-	-	-	-	-	
		2.50	2.95	0.45	P-D	1	2	3	-	5	-	-	-	-	
		3.50	4.00	0.50	U	-	-	-	-	-	-	-	-	-	
		4.00	4.45	0.45	P-D	1	2	3	-	5	-	-	-	-	
	(-)0.6	5.00	5.50	0.50	U	-	-	-	-	-	-	-	-	-	<div style="text-align: center;">5.00m</div> Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood
		5.50	5.95	0.45	P-D	1	2	3	-	5	-	-	-	-	
		6.50	7.00	0.50	U	-	-	-	-	-	-	-	-	-	
		7.00	7.45	0.45	P-D	0	1	1	-	2	-	-	-	-	
		8.00	8.50	0.50	U	-	-	-	-	-	-	-	-	-	
		8.50	8.95	0.45	P-D	1	2	3	-	5	-	-	-	-	
		9.50	10.00	0.50	U	-	-	-	-	-	-	-	-	-	

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-1

Location : N 22°32'29.50", E 88°17'58.75"

Ground Elevation : +4.4m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.85m a.b.l (max.) at 13:00 hrs on 28/11/20  
0.65m a.b.l (min.) at 8.00 hrs on 27/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 27.11.20 To 30.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
29/11	(-)6.6	10.00	10.45	0.45	P-D	1	2	2	-	4	-	-	-	-	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood
		11.00	11.50	0.50	U	-	-	-	-	-	-	-	-	-	11.00m
		11.50	11.95	0.45	P-D	3	4	6	-	10	-	-	-	-	Stiff / very stiff bluish grey to greyish yellow silty clay
		13.00	13.45	0.45	P-D	5	7	10	-	17	-	-	-	-	
		14.00	14.50	0.50	U	-	-	-	-	-	-	-	-	-	
		14.50	14.95	0.45	P-D	6	7	11	-	18	-	-	-	-	
	(-)13.1	16.00	16.45	0.45	P-D	5	7	7	-	14	-	-	-	-	
		17.00	17.50	0.50	U	-	-	-	-	-	-	-	-	-	
		17.50	17.56	0.06	P-D	80	-	-	-	>100	-	-	-	-	17.50m
		19.00	19.45	0.45	P-D	16	19	20	-	39	-	-	-	-	Hard greyish yellow sandy silty clay with occasional presence of gravels
	(-)17.6	20.50	20.95	0.45	P-D	11	20	27	-	47	-	-	-	-	
		22.00	22.45	0.45	P-D	21	42	53	-	95	-	-	-	-	22.00m
	(-)20.6	23.50	23.95	0.45	P-D	18	37	46	-	83	-	-	-	-	Dense yellowish grey silty sand
		25.00	25.45	0.45	P-D	5	7	13	-	20	-	-	-	-	25.00m
															Very stiff / hard bluish to brownish grey silty clay with brown spots

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211

### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-1

Location : N 22°32'29.50", E 88°17'58.75"

Ground Elevation : +4.4m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.85m a.b.l (max.) at 13:00 hrs on 28/11/20  
0.65m a.b.l (min.) at 8.00 hrs on 27/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 27.11.20 To 30.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
30/11	(-)32.1	26.00	26.50	0.50	U	-	-	-	-	-	-	-	-	-	Very stiff / hard bluish to brownish grey silty clay with brown spots
		26.50	26.95	0.45	P-D	7	9	11	-	20	-	-	-	-	
		28.00	28.45	0.45	P-D	6	8	11	-	19	-	-	-	-	
		29.00	29.50	0.50	U	-	-	-	-	-	-	-	-	-	
		29.50	29.95	0.45	P-D	7	9	12	-	21	-	-	-	-	
		31.00	31.45	0.45	P-D	7	10	13	-	23	-	-	-	-	
		32.50	32.95	0.45	P-D	10	15	17	-	32	-	-	-	-	
		34.00	34.45	0.45	P-D	11	17	18	-	35	-	-	-	-	
		35.50	35.95	0.45	P-D	7	8	13	-	21	-	-	-	-	
		37.00	37.32	0.32	P-D	44	70	30	-	>100	-	-	-	-	Dense / very dense brownish to greyish yellow silty sand; medium dense brownish grey silty clayey sand observed at 38.5m and 48.0m depth
								(2cm)							
		38.50	38.95	0.45	P-D	7	9	12	-	21	-	-	-	-	
		40.00	40.34	0.34	P-D	29	68	32	-	>100	-	-	-	-	
								(4cm)							
		41.50	41.82	0.32	P-D	32	71	25	-	>100	-	-	-	-	
								(2cm)							
		43.00	43.31	0.31	P-D	35	82	20	-	>100	-	-	-	-	
								(1cm)							

**NOTES**

1. Abbreviation Used : **U**-Undisturbed Sample **C**-Core Sample **D**-Disturbed Sample **P**-Standard Penetration Test **V**-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



## BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-1

Location : N 22°32'29.50", E 88°17'58.75"

Ground Elevation : +4.4m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.85m a.b.l (max.) at 13:00 hrs on 28/11/20  
0.65m a.b.l (min.) at 8.00 hrs on 27/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 27.11.20 To 30.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
	(-)45.6	44.50	44.74	0.24	P-D	55	60 (9cm)	-	-	>100	-	-	-	-	Dense / very dense brownish to greyish yellow silty sand; medium dense brownish grey silty clayey sand observed at 38.5m and 48.0m depth
		46.00	46.27	0.27	P-D	60	70 (12cm)	-	-	>100	-	-	-	-	
		48.00	48.45	0.45	P-D	20	26	42	-	68	-	-	-	-	
		50.00	50.36	0.36	P-D	47	52 (6cm)	40	-	>100	-	-	-	-	
		50.00	(Termination Depth)												
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-2

Location : N 22°32'28.20", E 88°17'58.70"

Ground Elevation : +4.4m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.95m a.b.l (max.) at 14:40 hrs on 16/11/20  
0.48m a.b.l (min.) at 7:00 hrs on 14/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-12.50m

Date : From 13.11.20 To 16.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
13/11	+4.4	0.00	0.50	0.50	U	-	-	-	-	-	-	-	-	-	Very loose / loose yellowish grey silty fine sand
		0.50	0.95	0.45	P-D	1	1	1	-	2	-	-	-	-	
	+2.4	2.00	2.45	0.45	P-D	2	2	2	-	4	-	-	-	-	2.00m
		3.00	3.50	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay
	(-)0.6	3.50	3.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		5.00	5.45	0.45	P-D	2	2	3	-	5	-	-	-	-	5.00m
		6.00	6.50	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood; plenty of wood observed at 9.0m depth
		6.50	6.95	0.45	P-D	1	1	2	-	3	-	-	-	-	
	(-)6.6	8.00	8.45	0.45	P-D	1	1	1	-	2	-	-	-	-	
		9.00	9.50	0.50	U	-	-	-	-	-	-	-	-	-	
		9.50	9.95	0.45	P-D	1	2	3	-	5	-	-	-	-	
		11.00	11.45	0.45	P-D	3	5	5	-	10	-	-	-	-	11.00m
		12.00	12.50	0.50	U	-	-	-	-	-	-	-	-	-	Stiff to very stiff bluish grey silty clay
		12.50	12.95	0.45	P-D	4	8	9	-	17	-	-	-	-	

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-2

Location : N 22°32'28.20", E 88°17'58.70"

Ground Elevation : +4.4m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.95m a.b.l (max.) at 14:40 hrs on 16/11/20  
0.48m a.b.l (min.) at 7.00 hrs on 14/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-12.50m

Date : From 13.11.20 To 16.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
14/11	(-)10.6	14.00	14.45	0.45	P-D	5	8	8	-	16	-	-	-	-	Stiff to very stiff bluish grey silty clay
		15.00	15.50	0.50	U	-	-	-	-	-	-	-	-	-	15.00m
		15.50	15.95	0.45	P-D	8	8	9	-	17	-	-	-	-	Stiff / very stiff greyish yellow silty clay with high silt content
		17.00	17.45	0.45	P-D	5	6	11	-	17	-	-	-	-	
	(-)13.6	18.00	18.50	0.50	U	Slipped					-	-	-	-	18.00m
		18.50	18.95	0.45	P-D	12	20	28	-	48	-	-	-	-	Medium dense greyish yellow silty sand; hard yellowish grey silty clay with kankars observed at 21.5m depth
		20.00	20.45	0.45	P-D	10	11	13	-	24	-	-	-	-	
		21.50	21.95	0.45	P-D	8	16	20	-	36	-	-	-	-	
	(-)21.1	23.00	23.45	0.45	P-D	16	26	41	-	67	-	-	-	-	
		24.50	24.95	0.45	P-D	10	12	17	-	29	-	-	-	-	
		25.50	26.00	0.50	U	-	-	-	-	-	-	-	-	-	25.50m
		26.00	26.45	0.45	P-D	5	8	9	-	17	-	-	-	-	Very stiff to hard bluish grey to brownish yellow silty clay
		27.00	27.50	0.50	U	-	-	-	-	-	-	-	-	-	
		27.50	27.95	0.45	P-D	7	15	17	-	32	-	-	-	-	

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211





### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-2

Location : N 22°32'28.20", E 88°17'58.70"

Ground Elevation : +4.4m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.95m a.b.l (max.) at 14:40 hrs on 16/11/20  
0.48m a.b.l (min.) at 7.00 hrs on 14/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-12.50m

Date : From 13.11.20 To 16.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
15/11	(-)33.6	29.00	29.45	0.45	P-D	6	9	14	-	23	-	-	-	-	Very stiff to hard bluish grey to brownish yellow silty clay
		30.00	30.50	0.50	U	-	-	-	-	-	-	-	-	-	
		30.50	30.95	0.45	P-D	13	16	20	-	36	-	-	-	-	
		32.00	32.45	0.45	P-D	12	17	23	-	40	-	-	-	-	
		33.50	33.95	0.45	P-D	16	17	23	-	40	-	-	-	-	
		35.00	35.45	0.45	P-D	17	22	30	-	52	-	-	-	-	
		36.50	36.95	0.45	P-D	11	15	82	-	97	-	-	-	-	
38.00		38.23	0.23	P-D	47	75	-	-	>100	-	-	-	-	38.00m Dense / very dense brownish yellow silty sand	
39.50		39.81	0.31	P-D	34	82	32	-	>100	-	-	-	-		
41.00		41.45	0.45	P-D	28	50	55	-	105	-	-	-	-		
42.50		42.74	0.24	P-D	48	61	-	-	>100	-	-	-	-		
44.00		44.23	0.23	P-D	39	72	-	-	>100	-	-	-	-		
45.50		45.81	0.31	P-D	32	87	25	-	>100	-	-	-	-		
47.00		47.16	0.16	P-D	83	32	-	-	>100	-	-	-	-		

**NOTES**

1. Abbreviation Used : **U**-Undisturbed Sample **C**-Core Sample **D**-Disturbed Sample **P**-Standard Penetration Test **V**-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211

BORE / DRILL LOG															
Project: Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock										Bore Hole No. : BH-2					
Location : N 22°32'28.20" , E 88°17'58.70"										Ground Elevation : +4.4m					
Method of Boring / Drilling : Shell / Rotary										Water Level : 0.95m a.b.l (max.) at 14:40 hrs on 16/11/20 0.48m a.b.l (min.) at 7.00 hrs on 14/11/20					
Boring / Drilling Equipment : Mechanical Winch (W-3)										Dia.of Boring / Drilling: Sx (150mm)					
Casing Lowered : Sx-12.50m										Date : From 13.11.20 To 16.11.20					
Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
	(-)45.6	48.50	48.83	0.33	P-D	24	76	35	-	>100	-	-	-	-	Dense / very dense brownish yellow silty sand
		50.00	50.24	0.24	P-D	57	60	-	-	>100	-	-	-	-	
		50.00	(Termination Depth)												
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-3

Location : N 22°32'27.17", E 88°17'57.86"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.65m a.b.l (max.) at 10:15 hrs on 12/12/20  
0.57m a.b.l (min.) at 12:30 hrs on 12/12/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 10.12.20 To 12.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
10/12	+4.3	0.00													Very soft to soft grey silty clay with varying percentage of decomposed wood
		1.00	1.50	0.50	U	-	-	-	-	-	-	-	-	-	
		1.50	1.95	0.45	P-D	0	0	1	-	1	-	-	-	-	
		2.50	3.00	0.50	U	-	-	-	-	-	-	-	-	-	
		3.00	3.45	0.45	P-D	1	1	2	-	3	-	-	-	-	
		4.00	4.50	0.50	U	-	-	-	-	-	-	-	-	-	
		4.50	4.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		5.50	6.00	0.50	U	-	-	-	-	-	-	-	-	-	
		6.00	6.45	0.45	P-D	0	1	1	-	2	-	-	-	-	
		7.00	7.50	0.50	U	-	-	-	-	-	-	-	-	-	
		7.50	7.95	0.45	P-D	0	1	1	-	2	-	-	-	-	
		8.50	9.00	0.50	U	-	-	-	-	-	-	-	-	-	
		9.00	9.45	0.45	P-D	0	1	1	-	2	-	-	-	-	
		10.00	10.50	0.50	U	-	-	-	-	-	-	-	-	-	

**NOTES**

1. Abbreviation Used : **U**-Undisturbed Sample **C**-Core Sample **D**-Disturbed Sample **P**-Standard Penetration Test **V**-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : R.Kr.Biswas

Driller: M.Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-3

Location : N 22°32'27.17", E 88°17'57.86"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.65m a.b.l (max.) at 10:15 hrs on 12/12/20  
0.57m a.b.l (min.) at 12.30 hrs on 12/12/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 10.12.20 To 12.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
11/12	(-)8.7	10.50	10.95	0.45	P-D	1	1	2	-	3	-	-	-	-	Very soft to soft grey silty clay with varying percentage of decomposed wood
		12.00	12.45	0.45	P-D	2	3	4	-	7	-	-	-	-	
		13.00	13.50	0.50	U	-	-	-	-	-	-	-	-	-	13.00m
		13.50	13.95	0.45	P-D	3	4	4	-	8	-	-	-	-	Stiff bluish grey to brownish yellow silty clay
	(-)13.7	15.00	15.45	0.45	P-D	6	7	9	-	16	-	-	-	-	
		16.00	16.50	0.50	U	-	-	-	-	-	-	-	-	-	
		16.50	16.95	0.45	P-D	4	5	6	-	11	-	-	-	-	
		18.00	18.45	0.45	P-D	10	12	15	-	27	-	-	-	-	18.00m
	(-)18.2	19.50	19.95	0.45	P-D	10	20	27	-	47	-	-	-	-	Very stiff to hard brownish yellow sandy silty clay
		21.00	21.45	0.45	P-D	13	17	21	-	38	-	-	-	-	
		22.50	22.95	0.45	P-D	23	32	40	-	72	-	-	-	-	22.50m
		24.00	24.30	0.30	P-D	40	74	-	-	>100	-	-	-	-	Dense / very dense brownish yellow silty sand
	(-)20.7	25.00	25.50	0.50	U	-	-	-	-	-	-	-	-	-	25.00m
		25.50	25.95	0.45	P-D	8	11	13	-	24	-	-	-	-	Very stiff bluish to brownish grey silty clay

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : R.Kr.Biswas

Driller: M.Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-3

Location : N 22°32'27.17", E 88°17'57.86"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.65m a.b.l (max.) at 10:15 hrs on 12/12/20  
0.57m a.b.l (min.) at 12.30 hrs on 12/12/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 10.12.20 To 12.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
12/12	(-)33.2	27.00	27.45	0.45	P-D	9	12	15	-	27	-	-	-	-	Very stiff bluish to brownish grey silty clay
		28.00	28.50	0.50	U	-	-	-	-	-	-	-	-	-	
		28.50	28.95	0.45	P-D	12	14	16	-	30	-	-	-	-	
		30.00	30.45	0.45	P-D	11	12	14	-	26	-	-	-	-	
		31.50	31.95	0.45	P-D	14	18	20	-	38	-	-	-	-	
		33.00	33.45	0.45	P-D	10	12	16	-	28	-	-	-	-	
		34.50	34.95	0.45	P-D	9	12	15	-	27	-	-	-	-	
		36.00	36.45	0.45	P-D	10	13	17	-	30	-	-	-	-	
		37.50	37.80	0.30	P-D	32	70	-	-	>100	-	-	-	-	Dense / very dense brownish yellow silty sand; hard greyish brown sandy silty clay observed at 43.5m depth
		39.00	39.25	0.25	P-D	58	45	-	-	>100	-	-	-	-	
		40.50	40.95	0.45	P-D	27	32	35	-	67	-	-	-	-	
		42.00	42.27	0.27	P-D	54	67	-	-	>100	-	-	-	-	
		43.50	43.95	0.45	P-D	13	17	45	-	62	-	-	-	-	
		45.00	45.45	0.45	P-D	54	48	59	-	107	-	-	-	-	

**NOTES**

1. Abbreviation Used : **U**-Undisturbed Sample **C**-Core Sample **D**-Disturbed Sample **P**-Standard Penetration Test **V**-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : R.Kr.Biswas

Driller: M.Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-3

Location : N 22°32'27.17" , E 88°17'57.86"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.65m a.b.l (max.) at 10:15 hrs on 12/12/20  
0.57m a.b.l (min.) at 12.30 hrs on 12/12/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.90m

Date : From 10.12.20 To 12.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
		46.50	46.80	0.30	P-D	37	78	-	-	>100	-	-	-	-	Dense / very dense brownish yellow silty sand; hard greyish brown sandy silty clay observed at 43.5m depth
		48.00	48.27	0.27	P-D	43	84	-	-	>100	-	-	-	-	
		50.00	50.25	0.25	P-D	52	58	-	-	>100	-	-	-	-	
		50.00	50.00	Termination											
	(-)45.7														

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : R.Kr.Biswas

Driller: M.Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-4

Location : N 22°32'25.75", E 88°17'57.89"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.93m a.b.l (max.) at 10:00 hrs on 24/11/20  
0.64m a.b.l (min.) at 15:30 hrs on 23/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-14.50m

Date : From 23.11.20 To 26.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
23/11	+4.3	0.00													Firm grey silty clay to silty clay with high silt content
		0.50	1.00	0.50	U	-	-	-	-	-	-	-	-	-	
		1.00	1.45	0.45	P-D	2	3	3	-	6	-	-	-	-	
		2.00	2.50	0.50	U	-	-	-	-	-	-	-	-	-	
		2.50	2.95	0.45	P-D	2	2	3	-	5	-	-	-	-	
	+0.8	3.50	4.00	0.50	U	-	-	-	-	-	-	-	-	-	<div style="text-align: center;">3.50m</div> Soft grey silty clay / clayey silt with varying percentage of decomposed wood; plenty of wood observed at 3.5m depth
		4.00	4.45	0.45	P-D	2	2	3	-	5	-	-	-	-	
		5.00	5.50	0.50	U	-	-	-	-	-	-	-	-	-	
		5.50	5.95	0.45	P-D	1	1	1	-	2	-	-	-	-	
		6.50	7.00	0.50	U	-	-	-	-	-	-	-	-	-	
24/11		7.00	7.45	0.45	P-D	1	1	1	-	2	-	-	-	-	
		8.00	8.50	0.50	U	-	-	-	-	-	-	-	-	-	
		8.50	8.95	0.45	P-D	1	1	2	-	3	-	-	-	-	
		9.50	10.00	0.50	U	-	-	-	-	-	-	-	-	-	

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-4

Location : N 22°32'25.75", E 88°17'57.89"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.93m a.b.l (max.) at 10:00 hrs on 24/11/20  
0.64m a.b.l (min.) at 15:30 hrs on 23/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-14.50m

Date : From 23.11.20 To 26.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
25/11	(-)6.7	10.00	10.45	0.45	P-D	2	2	3	-	5	-	-	-	-	Soft grey silty clay / clayey silt with varying percentage of decomposed wood; plenty of wood observed at 3.5m depth
		11.00	11.50	0.50	U	-	-	-	-	-	-	-	-	-	11.00m
		11.50	11.95	0.45	P-D	3	4	5	-	9	-	-	-	-	Stiff to very stiff bluish grey silty clay
		13.00	13.45	0.45	P-D	3	6	8	-	14	-	-	-	-	
	(-)11.7	14.00	14.50	0.50	U	-	-	-	-	-	-	-	-	-	
		14.50	14.95	0.45	P-D	9	9	11	-	20	-	-	-	-	
		16.00	16.45	0.45	P-D	5	7	8	-	15	-	-	-	-	16.00m
		17.00	17.50	0.50	U	-	-	-	-	-	-	-	-	-	Stiff yellowish grey silty clay with high silt content / clayey silt
	(-)13.2	17.50	17.95	0.45	P-D	5	12	12	-	24	-	-	-	-	17.50m
		19.00	19.45	0.45	P-D	12	18	22	-	40	-	-	-	-	Medium dense to dense yellowish grey silty sand
		20.50	20.95	0.45	P-D	10	18	19	-	37	-	-	-	-	
		22.00	22.45	0.45	P-D	22	34	36	-	70	-	-	-	-	
	(-)20.7	23.50	23.95	0.45	P-D	18	29	34	-	63	-	-	-	-	
		25.00	25.45	0.45	P-D	6	8	9	-	17	-	-	-	-	25.00m
															Very stiff to hard bluish to brownish grey silty clay with occasional brown spots

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-4

Location : N 22°32'25.75", E 88°17'57.89"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.93m a.b.l (max.) at 10:00 hrs on 24/11/20  
0.64m a.b.l (min.) at 15:30 hrs on 23/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-14.50m

Date : From 23.11.20 To 26.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
26/11	(-)31.5	26.00	26.50	0.50	U	-	-	-	-	-	-	-	-	-	Very stiff to hard bluish to brownish grey silty clay with occasional brown spots
		26.50	26.95	0.45	P-D	6	12	17	-	29	-	-	-	-	
		28.00	28.45	0.45	P-D	8	15	17	-	32	-	-	-	-	
		29.50	29.95	0.45	P-D	7	12	16	-	28	-	-	-	-	
		31.00	31.45	0.45	P-D	10	16	18	-	34	-	-	-	-	
		32.50	32.95	0.45	P-D	10	15	19	-	34	-	-	-	-	
		34.00	34.45	0.45	P-D	9	14	18	-	32	-	-	-	-	
		35.50	35.95	0.45	P-D	8	21	84	-	105	-	-	-	-	
		37.00	37.22	0.22	P-D	51	50 (7cm)	-	-	>100	-	-	-	-	35.80m Dense / very dense brownish yellow silty sand
		38.50	38.75	0.25	P-D	29	80 (10cm)	-	-	>100	-	-	-	-	
		40.00	40.28	0.28	P-D	40	100 (13cm)	-	-	>100	-	-	-	-	
		41.50	41.82	0.32	P-D	25	60 (2cm)	30	-	>100	-	-	-	-	
		43.00	43.30	0.30	P-D	32	82	-	-	>100	-	-	-	-	
		44.50	44.80	0.30	P-D	28	92	-	-	>100	-	-	-	-	
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-4

Location : N 22°32'25.75", E 88°17'57.89"

Ground Elevation : +4.3m

Method of Boring / Drilling : Shell / Rotary

Water Level : 0.93m a.b.l (max.) at 10:00 hrs on 24/11/20  
0.64m a.b.l (min.) at 15.30 hrs on 23/11/20

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-14.50m

Date : From 23.11.20 To 26.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
		46.00	46.23	0.23	P-D	35	81 (8cm)	-	-	>100	-	-	-	-	Dense / very dense brownish yellow silty sand
		48.00	48.42	0.42	P-D	18	34 (12cm)	80	-	>100	-	-	-	-	
		50.00	50.16	0.16	P-D	73	32 (1cm)	-	-	>100	-	-	-	-	
	(-)45.7	50.00	(Termination Depth)												

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-5

Location : N 22°32'24.68", E 88°17'57.17"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.00m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 03.12.20 To 05.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
03/12	+7.3	0.00													Fill consisting of grey silty sand with stone / brick pieces etc.
	+6.6	-	0.50	-	D	-	-	-		-					
		1.00	1.50	0.50	U	-	-	-	-	-	-	-	-	-	Firm grey silty clay to silty clay with high silt content; loose yellowish grey fine sand observed from 2.5m to 4.0m depth
		1.50	1.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		2.50	3.00	0.50	U	-	-	-	-	-	-	-	-	-	
		3.00	3.45	0.45	P-D	1	2	2	-	4	-	-	-	-	
		4.00	4.50	0.50	U	-	-	-	-	-	-	-	-	-	
	4.50	4.95	0.45	P-D	1	2	2	-	4	-	-	-	-		
	+1.8	5.50	6.00	0.50	U	-	-	-	-	-	-	-	-	-	_____ 5.50m _____
		6.00	6.45	0.45	P-D	1	1	2	-	3	-	-	-	-	Soft to firm grey silty clay with varying percentage of decomposed wood
		7.00	7.50	0.50	U	-	-	-	-	-	-	-	-	-	
		7.50	7.95	0.45	P-D	0	1	1	-	2	-	-	-	-	
		8.50	9.00	0.50	U	-	-	-	-	-	-	-	-	-	
		9.00	9.45	0.45	P-D	1	1	2	-	3	-	-	-	-	
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-5

Location : N 22°32'24.68", E 88°17'57.17"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.00m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 03.12.20 To 05.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
04/12	(-)7.7	10.00	10.50	0.50	U	-	-	-	-	-	-	-	-	-	Soft to firm grey silty clay with varying percentage of decomposed wood
		10.50	10.95	0.45	P-D	0	1	1	-	2	-	-	-	-	
		12.00	12.45	0.45	P-D	2	3	3	-	6	-	-	-	-	
		13.00	13.50	0.50	U	-	-	-	-	-	-	-	-	-	
		13.50	13.95	0.45	P-D	3	3	4	-	7	-	-	-	-	
		15.00	15.45	0.45	P-D	5	7	10	-	17	-	-	-	-	
		16.00	16.50	0.50	U	-	-	-	-	-	-	-	-	-	
	(-)12.2	16.50	16.95	0.45	P-D	4	4	5	-	9	-	-	-	-	Stiff bluish grey to brownish yellow silty clay with occasional presence of calcareous nodules
		18.00	18.45	0.45	P-D	4	4	6	-	10	-	-	-	-	
		19.50	19.95	0.45	P-D	6	9	12	-	21	-	-	-	-	
		21.00	21.45	0.45	P-D	7	10	15	-	25	-	-	-	-	
		22.50	22.95	0.45	P-D	9	14	16	-	30	-	-	-	-	
		24.00	24.45	0.45	P-D	12	19	22	-	41	-	-	-	-	
		25.50	25.95	0.45	P-D	30	36	38	-	74	-	-	-	-	
NOTES	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test 2. Level at which Artesian Condition experienced and its pressure, if any : 3. Water Loss with depth, if any : 4. Colour of water during drilling :														
	Site Engineer : M. Gain					Driller: M. Barui					Job No.: CCPL/20101211				



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-5

Location : N 22°32'24.68", E 88°17'57.17"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.00m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 03.12.20 To 05.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
05/12	(-)20.7	27.00	27.45	0.45	P-D	26	42	48	-	90	-	-	-	-	Medium dense to dense yellowish grey silty sand
		28.50	28.95	0.45	P-D	5	7	8	-	15	-	-	-	-	28.00m
		29.50	30.00	0.50	U	-	-	-	-	-	-	-	-	-	Stiff / very stiff to hard bluish to yellowish grey silty clay with occasional brown spots
		30.00	30.45	0.45	P-D	6	8	10	-	18	-	-	-	-	
		31.50	31.95	0.45	P-D	8	11	13	-	24	-	-	-	-	
		32.50	33.00	0.50	U	-	-	-	-	-	-	-	-	-	
		33.00	33.45	0.45	P-D	10	12	17	-	29	-	-	-	-	
		34.50	34.95	0.45	P-D	10	15	18	-	33	-	-	-	-	
	(-)31.7	36.00	36.45	0.45	P-D	10	16	20	-	36	-	-	-	-	
		37.50	37.95	0.45	P-D	9	14	19	-	33	-	-	-	-	
		39.00	39.27	0.27	P-D	24	84	-	-	>100	-	-	-	-	39.00m
							(12cm)								
		40.50	40.95	0.45	P-D	20	32	45	-	77	-	-	-	-	Medium dense / dense to very dense brownish to greyish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth
		42.00	42.30	0.30	P-D	45	87	-	-	>100	-	-	-	-	
		43.50	43.85	0.35	P-D	38	67	34	-	>100	-	-	-	-	
							(5cm)								

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-5

Location : N 22°32'24.68", E 88°17'57.17"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.00m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 03.12.20 To 05.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
	(-)42.7	45.00	45.45	0.45	P-D	12	14	72	-	86	-	-	-	-	Medium dense / dense to very dense brownish to greyish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth
		46.50	46.80	0.30	P-D	37	88	-	-	>100	-	-	-	-	
		48.00	48.45	0.45	P-D	25	48	54	-	102	-	-	-	-	
		50.00	50.45	0.45	P-D	32	37	35	-	72	-	-	-	-	
		50.00	(Termination Depth)												
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui								Job No.: CCPL/20101211	



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-6

Location : N 22°32'29.05", E 88°18'0.23"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 30.11.20 To 02.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
30/11	+7.3	0.00													Fill consisting of brownish grey silty sand with stone / brick pieces etc.
		-	0.50	-	D	-	-	-	-	-	-	-	-	-	
		1.50	2.00	0.50	U	-	-	-	-	-	-	-	-	-	
	+5.3	2.00	2.45	0.45	P-D	1	2	4	-	6	-	-	-	-	2.00m
		3.00	3.50	0.50	U	-	-	-	-	-	-	-	-	-	Loose grey sandy silt / silty sand with clay as binder
	+3.8	3.50	3.95	0.45	P-D	1	1	1	-	2	-	-	-	-	3.50m
		4.50	5.00	0.50	U	-	-	-	-	-	-	-	-	-	Soft to firm grey silty clay
		5.00	5.45	0.45	P-D	1	3	3	-	6	-	-	-	-	
	6.00	6.50	0.50	U	-	-	-	-	-	-	-	-	-		
	+0.8	6.50	6.95	0.45	P-D	2	2	2	-	4	-	-	-	-	6.50m
		7.50	8.00	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.5m depth
		8.00	8.45	0.45	P-D	1	2	3	-	5	-	-	-	-	
		9.00	9.50	0.50	U	-	-	-	-	-	-	-	-	-	
01/12		9.50	9.95	0.45	P-D	1	1	1	-	2	-	-	-	-	
NOTES	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test 2. Level at which Artesian Condition experienced and its pressure, if any : 3. Water Loss with depth, if any : 4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-6

Location : N 22°32'29.05", E 88°18'0.23"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 30.11.20 To 02.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
		10.50	11.00	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.5m depth
		11.00	11.45	0.45	P-D	0	1	1	-	2	-	-	-	-	
		12.50	12.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		13.50	14.00	0.50	U	-	-	-	-	-	-	-	-	-	
		14.00	14.45	0.45	P-D	2	3	4	-	7	-	-	-	-	
	(-)8.2	15.50	15.95	0.45	P-D	3	4	5	-	9	-	-	-	-	15.50m
		16.50	17.00	0.50	U	-	-	-	-	-	-	-	-	-	Stiff bluish grey silty clay with occasional traces of calcareous nodules
		17.00	17.45	0.45	P-D	4	6	8	-	14	-	-	-	-	
		18.50	18.95	0.45	P-D	6	8	8	-	16	-	-	-	-	
	(-)12.7	20.00	20.45	0.45	P-D	9	20	30	-	50	-	-	-	-	20.00m
		21.50	21.95	0.45	P-D	14	16	16	-	32	-	-	-	-	Medium dense brownish yellow sandy silt with clay as binder to hard silty clay with high silt content
		23.00	23.45	0.45	P-D	9	18	33	-	51	-	-	-	-	
	(-)17.2	24.50	24.95	0.45	P-D	22	32	36	-	68	-	-	-	-	24.50m
		26.00	26.45	0.45	P-D	20	39	42	-	81	-	-	-	-	Dense yellowish grey silty sand
<b>NOTES</b>	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test 2. Level at which Artesian Condition experienced and its pressure, if any : 3. Water Loss with depth, if any : 4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			





### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-6

Location : N 22°32'29.05", E 88°18'0.23"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 30.11.20 To 02.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
02/12	(-)19.7	27.00	27.50	0.50	U	-	-	-	-	-	-	-	-	-	_____ 27.00m _____
		27.50	27.95	0.45	P-D	5	9	10	-	19	-	-	-	-	Very stiff to hard bluish grey silty clay; yellowish grey silty clay with varying percentage of sand observed from 36.5m depth
		29.00	29.45	0.45	P-D	7	8	11	-	19	-	-	-	-	
		30.00	30.50	0.50	U	-	-	-	-	-	-	-	-	-	
		30.50	30.95	0.45	P-D	6	9	12	-	21	-	-	-	-	
		32.00	32.45	0.45	P-D	9	11	12	-	23	-	-	-	-	
		33.50	33.95	0.45	P-D	8	16	22	-	38	-	-	-	-	
		35.00	35.45	0.45	P-D	7	15	20	-	35	-	-	-	-	
		36.50	36.95	0.45	P-D	7	10	13	-	23	-	-	-	-	
		38.00	38.45	0.45	P-D	22	31	34	-	65	-	-	-	-	
		39.50	39.87	0.37	P-D	16	56	45	-	>100	-	-	-	-	_____ 39.50m _____
	(-)32.2														Dense / very dense brownish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth
		41.00	41.39	0.39	P-D	26	58	42	-	>100	-	-	-	-	
		42.50	42.78	0.28	P-D	45	84	-	-	>100	-	-	-	-	
		44.00	44.45	0.45	P-D	14	16	31	-	47	-	-	-	-	

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-6

Location : N 22°32'29.05", E 88°18'0.23"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 30.11.20 To 02.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
		45.50	45.76	0.26	P-D	22	81 (11cm)	-	-	>100	-	-	-	-	Dense / very dense brownish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth
		47.00	47.28	0.28	P-D	40	73 (13cm)	-	-	>100	-	-	-	-	
		48.50	48.85	0.35	P-D	33	66	34 (5cm)	-	>100	-	-	-	-	
		50.00	50.28	0.28	P-D	36	83 (13cm)	-	-	>100	-	-	-	-	
	(-)42.7	50.00	(Termination Depth)												
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test 2. Level at which Artesian Condition experienced and its pressure, if any : 3. Water Loss with depth, if any : 4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-7

Location : N 22°32'27.06", E 88°17'59.80"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.50m

Date : From 13.12.20 To 15.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
13/12	+7.3	0.00													Fill consisting of grey silty sand with stone / brick pieces etc.
		0.50	-	-	D	-	-	-	-	-	-	-	-	-	
		1.00	1.50	0.50	U	-	-	-	-	-	-	-	-	-	
	+5.8	1.50	1.95	0.45	P-D	1	1	2	-	3	-	-	-	-	1.50m
		2.50	3.00	0.50	U	-	-	-	-	-	-	-	-	-	Soft grey silty clay
		3.00	3.45	0.45	P-D	0	1	1	-	2	-	-	-	-	
		4.00	4.50	0.50	U	-	-	-	-	-	-	-	-	-	
		4.50	4.95	0.45	P-D	1	1	1	-	2	-	-	-	-	
	+1.8	5.50	6.00	0.50	U	-	-	-	-	-	-	-	-	-	5.50m
		6.00	6.45	0.45	P-D	2	2	2	-	4	-	-	-	-	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 5.5m and 13.5m depth
		7.00	7.50	0.50	U	-	-	-	-	-	-	-	-	-	
		7.50	7.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		8.50	9.00	0.50	U	-	-	-	-	-	-	-	-	-	
		9.00	9.45	0.45	P-D	1	1	2	-	3	-	-	-	-	
		NOTES	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test												
2. Level at which Artesian Condition experienced and its pressure, if any :															
3. Water Loss with depth, if any :															
4. Colour of water during drilling :															
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-7

Location : N 22°32'27.06", E 88°17'59.80"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.50m

Date : From 13.12.20 To 15.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
14/12	(-)7.7	10.00	10.50	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 5.5m and 13.5m depth
		10.50	10.95	0.45	P-D	2	2	3	-	5	-	-	-	-	
		12.00	12.45	0.45	P-D	1	2	2	-	4	-	-	-	-	
		13.00	13.50	0.50	U	-	-	-	-	-	-	-	-	-	
		13.50	13.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		15.00	15.45	0.45	P-D	3	4	5	-	9	-	-	-	-	
		16.00	16.50	0.50	U	-	-	-	-	-	-	-	-	-	
		16.50	16.95	0.45	P-D	6	8	9	-	17	-	-	-	-	
		18.00	18.45	0.45	P-D	5	6	9	-	15	-	-	-	-	
		19.50	19.95	0.45	P-D	5	6	6	-	12	-	-	-	-	
	(-)13.7	21.00	21.45	0.45	P-D	4	6	9	-	15	-	-	-	-	
		22.50	22.95	0.45	P-D	7	10	15	-	25	-	-	-	-	
		24.00	24.45	0.45	P-D	9	13	18	-	31	-	-	-	-	
	(-)18.2	25.50	25.95	0.45	P-D	16	21	34	-	55	-	-	-	-	

**NOTES**

1. Abbreviation Used : **U**-Undisturbed Sample **C**-Core Sample **D**-Disturbed Sample **P**-Standard Penetration Test **V**-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-7

Location : N 22°32'27.06", E 88°17'59.80"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.50m

Date : From 13.12.20 To 15.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
	(-)20.7	27.00	27.38	0.38	P-D	31	64	40	-	>100	-	-	-	-	Medium dense to very dense brownish yellow silty sand
		28.00	28.50	0.50	U	-	-	-	-	-	-	-	-	-	28.00m
		28.50	28.95	0.45	P-D	7	8	10	-	18	-	-	-	-	Very stiff to hard grey to bluish grey silty clay with occasional brown / yellow spots
		30.00	30.45	0.45	P-D	6	7	10	-	17	-	-	-	-	
		31.00	31.50	0.50	U	-	-	-	-	-	-	-	-	-	
		31.50	31.95	0.45	P-D	7	10	11	-	21	-	-	-	-	
		33.00	33.45	0.45	P-D	8	12	12	-	24	-	-	-	-	
		34.50	34.95	0.45	P-D	11	16	19	-	35	-	-	-	-	
		36.00	36.45	0.45	P-D	10	16	20	-	36	-	-	-	-	
		37.50	37.95	0.45	P-D	19	19	23	-	42	-	-	-	-	
		39.00	39.45	0.45	P-D	8	11	13	-	24	-	-	-	-	
	(-)33.2	40.50	40.77	0.27	P-D	42	70	-	-	>100	-	-	-	-	40.50m
		42.00	42.22	0.22	P-D	58	50	-	-	>100	-	-	-	-	Dense / very dense brownish yellow medium to fine sand
		43.50	43.86	0.36	P-D	40	61	42	-	>100	-	-	-	-	

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-7

Location : N 22°32'27.06", E 88°17'59.80"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-16.50m

Date : From 13.12.20 To 15.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
15/12		45.00	45.35	0.35	P-D	42	52	40	-	>100	-	-	-	-	Dense / very dense brownish yellow medium to fine sand
		46.50	46.86	0.36	P-D	39	58	42	-	>100	-	-	-	-	
		48.00	48.29	0.29	P-D	47	70	-	-	>100	-	-	-	-	
		50.00	50.27	0.27	P-D	44	67	-	-	>100	-	-	-	-	
		50.00	(Termination Depth)												
<div>NOTES</div> <div>1. Abbreviation Used : <b>U</b>-Undisturbed Sample <b>C</b>-Core Sample <b>D</b>-Disturbed Sample <b>P</b>-Standard Penetration Test <b>V</b>-Vane Shear Test</div> <div>2. Level at which Artesian Condition experienced and its pressure, if any   :</div> <div>3. Water Loss with depth, if any       :</div> <div>4. Colour of water during drilling     :</div>															
Site Engineer :   M. Gain						Driller:   M. Barui						Job No.:   CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-8

Location : N 22°32'25.69", E 88°17'58.97"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.20m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 07.12.20 To 09.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
07/12	+7.3	0.00													Fill consisting of yellowish brown silty sand with stone / brick pieces etc.  0.90m
		0.50	-	-	D	-	-	-	-	-	-	-	-	-	
	+6.4	1.00	1.50	0.50	U	-	-	-	-	-	-	-	-	-	Firm grey silty clay; medium dense grey silty fine sand with traces of clay observed from 2.5m to 4.0m depth
		1.50	1.95	0.45	P-D	1	2	4	-	6	-	-	-	-	
		2.50	3.00	0.50	U	-	-	-	-	-	-	-	-	-	
		3.00	3.45	0.45	P-D	4	5	7	-	12	-	-	-	-	
		4.00	4.50	0.50	U	-	-	-	-	-	-	-	-	-	
		4.50	4.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
	+1.8	5.50	6.00	0.50	U	-	-	-	-	-	-	-	-	-	5.50m
		6.00	6.45	0.45	P-D	1	2	3	-	5	-	-	-	-	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.0m depth
		7.00	7.50	0.50	U	-	-	-	-	-	-	-	-	-	
		7.50	7.95	0.45	P-D	1	1	1	-	2	-	-	-	-	
		8.50	9.00	0.50	U	-	-	-	-	-	-	-	-	-	
			9.00	9.45	0.45	P-D	1	1	2	-	3	-	-	-	-
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : R.Kr.Biswas						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-8

Location : N 22°32'25.69", E 88°17'58.97"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.20m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 07.12.20 To 09.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
08/12	(-)7.7	10.00	10.50	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.0m depth
		10.50	10.95	0.45	P-D	0	1	1	-	2	-	-	-	-	
		12.00	12.45	0.45	P-D	1	2	2	-	4	-	-	-	-	
		13.00	13.50	0.50	U	-	-	-	-	-	-	-	-	-	
		13.50	13.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		15.00	15.45	0.45	P-D	3	4	6	-	10	-	-	-	-	15.00m
		16.00	16.50	0.50	U	-	-	-	-	-	-	-	-	-	Stiff bluish grey to greyish yellow silty clay with occasional traces of calcareous nodules
		16.50	16.95	0.45	P-D	4	5	5	-	10	-	-	-	-	
		18.00	18.45	0.45	P-D	4	5	6	-	11	-	-	-	-	
		19.50	19.95	0.45	P-D	5	7	9	-	16	-	-	-	-	
		21.00	21.45	0.45	P-D	5	7	8	-	15	-	-	-	-	
	(-)15.2	22.50	22.95	0.45	P-D	12	17	25	-	42	-	-	-	-	22.50m
		24.00	24.45	0.45	P-D	17	21	26	-	47	-	-	-	-	Medium dense yellowish grey sandy clayey silt to sandy silt with traces of clay
	(-)18.2	25.50	25.95	0.45	P-D	12	14	16	-	30	-	-	-	-	25.50m
															Medium dense to dense yellowish grey silty sand

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : R.Kr.Biswas

Driller: M. Barui

Job No.: CCPL/20101211





### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-8

Location : N 22°32'25.69", E 88°17'58.97"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.20m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 07.12.20 To 09.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
09/12	(-)20.7	27.00	27.45	0.45	P-D	27	43	55	-	98	-	-	-	-	Medium dense to dense yellowish grey silty sand
		28.00	28.50	0.50	U	-	-	-	-	-	-	-	-	-	28.00m
		28.50	28.95	0.45	P-D	8	9	10	-	19	-	-	-	-	Very stiff to hard bluish grey silty clay with yellow spots
		30.00	30.45	0.45	P-D	8	10	11	-	21	-	-	-	-	
		31.00	31.50	0.50	U	-	-	-	-	-	-	-	-	-	
	(-)32.0	31.50	31.95	0.45	P-D	10	14	17	-	31	-	-	-	-	
		33.00	33.45	0.45	P-D	10	13	14	-	27	-	-	-	-	
		34.50	34.95	0.45	P-D	9	14	16	-	30	-	-	-	-	
		36.00	36.45	0.45	P-D	14	18	23	-	41	-	-	-	-	
		37.50	37.95	0.45	P-D	12	18	20	-	38	-	-	-	-	
		39.00	39.45	0.45	P-D	12	21	28	-	49	-	-	-	-	
		40.50	40.95	0.45	P-D	23	36	48	-	84	-	-	-	-	39.30m
		42.00	42.30	0.30	P-D	38	72	-	-	>100	-	-	-	-	Dense / very dense brownish yellow silty sand
		43.50	43.77	0.27	P-D	52	68	-	-	>100	-	-	-	-	
						(12cm)									
<b>NOTES</b>	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : R.Kr.Biswas						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-8

Location : N 22°32'25.69", E 88°17'58.97"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.20m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.50m

Date : From 07.12.20 To 09.12.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
	(-)42.7	45.00	45.45	0.45	P-D	30	55	52	-	107	-	-	-	-	Dense / very dense brownish yellow silty sand
		46.50	46.87	0.37	P-D	36	58	43	-	>100	-	-	-	-	
		48.00	48.30	0.30	P-D	42	68	-	-	>100	-	-	-	-	
		50.00	50.30	0.30	P-D	54	72	-	-	>100	-	-	-	-	
		50.00	(Termination Depth)												
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any   :														
	3. Water Loss with depth, if any       :														
	4. Colour of water during drilling    :														
Site Engineer :   R.Kr.Biswas						Driller:   M. Barui						Job No.:   CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-10

Location : N 22°32'28.88", E 88°18'1.53"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-12.91m

Date : From 17.11.20 To 20.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
17/11	+7.3	0.00													Fill consisting of grey silty sand with stone / brick pieces etc.
		0.30	-	-	D	-	-	-	-	-	-	-	-	-	
	+5.8	1.50	2.00	0.50	U	-	-	-	-	-	-	-	-	-	1.50m Soft / firm grey silty clay; loose grey silty fine sand observed at 3.0m depth
		2.00	2.45	0.45	P-D	1	1	2	-	3	-	-	-	-	
		3.00	3.50	0.50	U	-	-	-	-	-	-	-	-	-	
		3.50	3.95	0.45	P-D	1	3	3	-	6	-	-	-	-	
		4.50	5.00	0.50	U	-	-	-	-	-	-	-	-	-	
		5.00	5.45	0.45	P-D	2	2	3	-	5	-	-	-	-	
	+0.8	6.00	6.50	0.50	U	-	-	-	-	-	-	-	-	-	6.50m Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed from 12.0m depth
		6.50	6.95	0.45	P-D	1	2	2	-	4	-	-	-	-	
		7.50	8.00	0.50	U	-	-	-	-	-	-	-	-	-	
		8.00	8.45	0.45	P-D	1	2	2	-	4	-	-	-	-	
		9.00	9.50	0.50	U	-	-	-	-	-	-	-	-	-	
		9.50	9.95	0.45	P-D	1	1	2	-	3	-	-	-	-	
18/11		9.50	9.95	0.45	P-D	1	1	2	-	3	-	-	-	-	
NOTES	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-10

Location : N 22°32'28.88", E 88°18'1.53"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-12.91m

Date : From 17.11.20 To 20.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
		10.50	11.00	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed from 12.0m depth
		11.00	11.45	0.45	P-D	1	2	2	-	4	-	-	-	-	
		12.00	12.50	0.50	U	-	-	-	-	-	-	-	-	-	
		12.50	12.95	0.45	P-D	2	3	3	-	6	-	-	-	-	
		13.50	14.00	0.50	U	-	-	-	-	-	-	-	-	-	
	(-)6.7	14.00	14.45	0.45	P-D	2	3	5	-	8	-	-	-	-	14.00m
		15.50	15.95	0.45	P-D	3	4	6	-	10	-	-	-	-	Stiff bluish grey silty clay with occasional traces of calcareous nodules
		16.50	17.00	0.50	U	-	-	-	-	-	-	-	-	-	
		17.00	17.45	0.45	P-D	5	6	10	-	16	-	-	-	-	
		18.50	18.95	0.45	P-D	4	6	7	-	13	-	-	-	-	
	(-)12.2	19.50	20.00	0.50	U	-	-	-	-	-	-	-	-	-	19.50m
		20.00	20.45	0.45	P-D	6	11	20	-	31	-	-	-	-	Very stiff / hard yellowish grey silty clay with high silt content to medium dense yellowish grey clayey sandy silt
		21.50	21.95	0.45	P-D	10	12	19	-	31	-	-	-	-	
	(-)14.7	23.00	23.45	0.45	P-D	12	15	20	-	35	-	-	-	-	22.00m
															Medium dense yellowish grey silty sand

**NOTES**

1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test
2. Level at which Artesian Condition experienced and its pressure, if any :
3. Water Loss with depth, if any :
4. Colour of water during drilling :

Site Engineer : M. Gain

Driller: M. Barui

Job No.: CCPL/20101211



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-10

Location : N 22°32'28.88", E 88°18'1.53"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-12.91m

Date : From 17.11.20 To 20.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
19/11	(-)19.7	24.50	24.95	0.45	P-D	13	16	24	-	40	-	-	-	-	Medium dense yellowish grey silty sand
		26.00	26.45	0.45	P-D	17	18	19	-	37	-	-	-	-	
		27.00	27.50	0.50	U	-	-	-	-	-	-	-	-	-	27.00m
		27.50	27.95	0.45	P-D	7	7	12	-	19	-	-	-	-	Very stiff to hard bluish grey to yellowish brown silty clay to sandy silty clay
		29.00	29.45	0.45	P-D	10	12	15	-	27	-	-	-	-	
		30.00	30.50	0.50	U	-	-	-	-	-	-	-	-	-	
		30.50	30.95	0.45	P-D	12	19	22	-	41	-	-	-	-	
		32.00	32.45	0.45	P-D	11	16	19	-	35	-	-	-	-	
		33.50	33.95	0.45	P-D	12	17	21	-	38	-	-	-	-	
		35.00	35.45	0.45	P-D	10	15	20	-	35	-	-	-	-	
		36.50	36.95	0.45	P-D	13	20	31	-	51	-	-	-	-	
		38.00	38.45	0.45	P-D	16	38	45	-	83	-	-	-	-	
		39.50	39.95	0.45	P-D	8	15	26	-	41	-	-	-	-	
		41.00	41.45	0.45	P-D	11	20	24	-	44	-	-	-	-	
NOTES	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-10

Location : N 22°32'28.88", E 88°18'1.53"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.10m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-12.91m

Date : From 17.11.20 To 20.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
20/11	(-)37.7	42.50	42.95	0.45	P-D	13	19	26	-	45	-	-	-	-	Very stiff to hard bluish grey to yellowish brown silty clay to sandy silty clay  45.00m  Dense / very dense brownish yellow to yellowish grey silty sand
		44.00	44.45	0.45	P-D	13	19	22	-	41	-	-	-	-	
		45.50	45.68	0.18	P-D	70	41 (3cm)	-	-	>100	-	-	-	-	
		47.00	47.28	0.28	P-D	34	82 (13cm)	-	-	>100	-	-	-	-	
		48.50	48.83	0.33	P-D	42	77 (3cm)	32	-	>100	-	-	-	-	
		50.00	50.28	0.28	P-D	33	83 (13cm)	-	-	>100	-	-	-	-	
	(-)42.7	50.00	(Termination Depth)												
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-11

Location : N 22°32'27.63", E 88°18'1.01"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.84m

Date : From 21.11.20 To 23.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
21/11	+7.3	0.00													Fill consisting of grey sand with stone / brick pieces etc.
	+6.5	0.50	-	-	D	-	-	-	-	-	-	-	-	-	
		1.00	1.50	0.50	U	-	-	-	-	-	-	-	-	-	Soft grey sandy silty clay; very loose to loose grey clayey sandy silt to silty fine sand observed from 4.5m depth
		1.50	1.95	0.45	P-D	2	2	2	-	4	-	-	-	-	
		2.50	3.00	0.50	U	-	-	-	-	-	-	-	-	-	
		3.00	3.45	0.45	P-D	1	1	1	-	2	-	-	-	-	
		4.00	4.50	0.50	U	-	-	-	-	-	-	-	-	-	
		4.50	4.95	0.45	P-D	1	1	1	-	2	-	-	-	-	
		5.50	6.00	0.50	U	Slipped			-	-	-	-	-		
	6.00	6.45	0.45	P-D	2	3	3	-	6	-	-	-	-		
	7.00	7.50	0.50	U	-	-	-	-	-	-	-	-	-		
	(-)0.2	7.50	7.95	0.45	P-D	1	1	2	-	3	-	-	-	-	_____ 7.50m _____
		8.50	9.00	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood
		9.00	9.45	0.45	P-D	1	2	3	-	5	-	-	-	-	
NOTES	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-11

Location : N 22°32'27.63", E 88°18'1.01"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.84m

Date : From 21.11.20 To 23.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
		10.00	10.50	0.50	U	-	-	-	-	-	-	-	-	-	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood
		10.50	10.95	0.45	P-D	2	3	3	-	6	-	-	-	-	
		11.50	12.00	0.50	U	-	-	-	-	-	-	-	-	-	
		12.00	12.45	0.45	P-D	1	2	3	-	5	-	-	-	-	
		13.50	13.95	0.45	P-D	2	2	3	-	5	-	-	-	-	
	(-)-7.2	14.50	15.00	0.50	U	-	-	-	-	-	-	-	-	-	14.50m
		15.00	15.45	0.45	P-D	3	4	4	-	8	-	-	-	-	Stiff bluish grey silty clay with occasional traces of calcareous nodules
		16.50	16.95	0.45	P-D	4	5	8	-	13	-	-	-	-	
		17.50	18.00	0.50	U	-	-	-	-	-	-	-	-	-	
	(-)-10.7	18.00	18.45	0.45	P-D	7	8	9	-	17	-	-	-	-	18.00m
		19.50	19.95	0.45	P-D	5	7	10	-	17	-	-	-	-	Very stiff greyish yellow silty clay with high silt content to medium dense clayey sandy silt
		21.00	21.45	0.45	P-D	10	17	19	-	36	-	-	-	-	
	(-)-15.2	22.50	22.95	0.45	P-D	12	20	37	-	57	-	-	-	-	22.50m
		24.00	24.45	0.45	P-D	8	15	24	-	39	-	-	-	-	Medium dense / dense greyish yellow silty sand
<b>NOTES</b>	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test 2. Level at which Artesian Condition experienced and its pressure, if any : 3. Water Loss with depth, if any : 4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			





### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-11

Location : N 22°32'27.63", E 88°18'1.01"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)

Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.84m

Date : From 21.11.20 To 23.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
22/11	(-)19.7	25.50	25.95	0.45	P-D	22	30	31	-	61	-	-	-	-	Medium dense / dense greyish yellow silty sand
		27.00	27.45	0.45	P-D	4	5	8	-	13	-	-	-	-	27.00m
		28.00	28.50	0.50	U	-	-	-	-	-	-	-	-	-	Stiff to very stiff / hard bluish grey to brownish yellow silty clay to sandy silty clay
		28.50	28.95	0.45	P-D	4	8	11	-	19	-	-	-	-	
		30.00	30.45	0.45	P-D	6	9	12	-	21	-	-	-	-	
		31.00	31.50	0.50	U	-	-	-	-	-	-	-	-	-	
		31.50	31.95	0.45	P-D	3	7	13	-	20	-	-	-	-	
		33.00	33.45	0.45	P-D	11	14	18	-	32	-	-	-	-	
		34.50	34.95	0.45	P-D	9	16	17	-	33	-	-	-	-	
		36.00	36.45	0.45	P-D	11	15	18	-	33	-	-	-	-	
		37.50	37.95	0.45	P-D	10	20	20	-	40	-	-	-	-	
		39.00	39.45	0.45	P-D	18	22	22	-	44	-	-	-	-	
		40.50	40.81	0.31	P-D	23	85	30	-	>100 (1cm)	-	-	-	-	
		42.00	42.45	0.45	P-D	29	49	36	-	85	-	-	-	-	
<b>NOTES</b>	1. Abbreviation Used : U-Undisturbed Sample C-Core Sample D-Disturbed Sample P-Standard Penetration Test V-Vane Shear Test														
	2. Level at which Artesian Condition experienced and its pressure, if any :														
	3. Water Loss with depth, if any :														
	4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			



### BORE / DRILL LOG

Project: Soil Investigation work for the upgradation of Berth No.7, NSD,  
N.S.Dock

Bore Hole No. : BH-11

Location : N 22°32'27.63", E 88°18'1.01"

Ground Elevation : +7.3m

Method of Boring / Drilling : Shell / Rotary

Water Level (Static) : 2.05m b.g.l

Boring / Drilling Equipment : Mechanical Winch (W-3)


Dia.of Boring / Drilling: Sx (150mm)

Casing Lowered : Sx-15.84m

Date : From 21.11.20 To 23.11.20

Date (dd / mm)	Elevation (m)	Depth / RUN (m)		Length (m)	Nature of Sampling	SPT : No. of blows					Time Taken (min)	Total length of Core Pieces (m)	Core Recovery (%)	R.Q.D. (%)	Description
		From	To			0-15 cm	15-30 cm	30-45 cm	45-60 cm	N' Value					
23/11	(-)37.7	43.50	43.95	0.45	P-D	27	51	53	-	104	-	-	-	-	Stiff to very stiff / hard bluish grey to brownish yellow silty clay to sandy silty clay  _____ 45.00m _____  Dense / very dense brownish yellow silty sand
		45.00	45.36	0.36	P-D	8	60	40	-	>100	-	-	-	-	
		46.50	46.67	0.17	P-D	15	35	-	-	>100	-	-	-	-	
		48.00	48.45	0.45	P-D	30	52	56	-	108	-	-	-	-	
		50.00	50.27	0.27	P-D	33	80	-	-	>100	-	-	-	-	
	(-)42.7	50.00	(Termination Depth)												
NOTES	1. Abbreviation Used : <b>U</b> -Undisturbed Sample <b>C</b> -Core Sample <b>D</b> -Disturbed Sample <b>P</b> -Standard Penetration Test <b>V</b> -Vane Shear Test 2. Level at which Artesian Condition experienced and its pressure, if any : 3. Water Loss with depth, if any : 4. Colour of water during drilling :														
Site Engineer : M. Gain						Driller: M. Barui						Job No.: CCPL/20101211			

## GRAPHICAL REPRESENTATION OF FIELD N-VALUE WITH R.L.

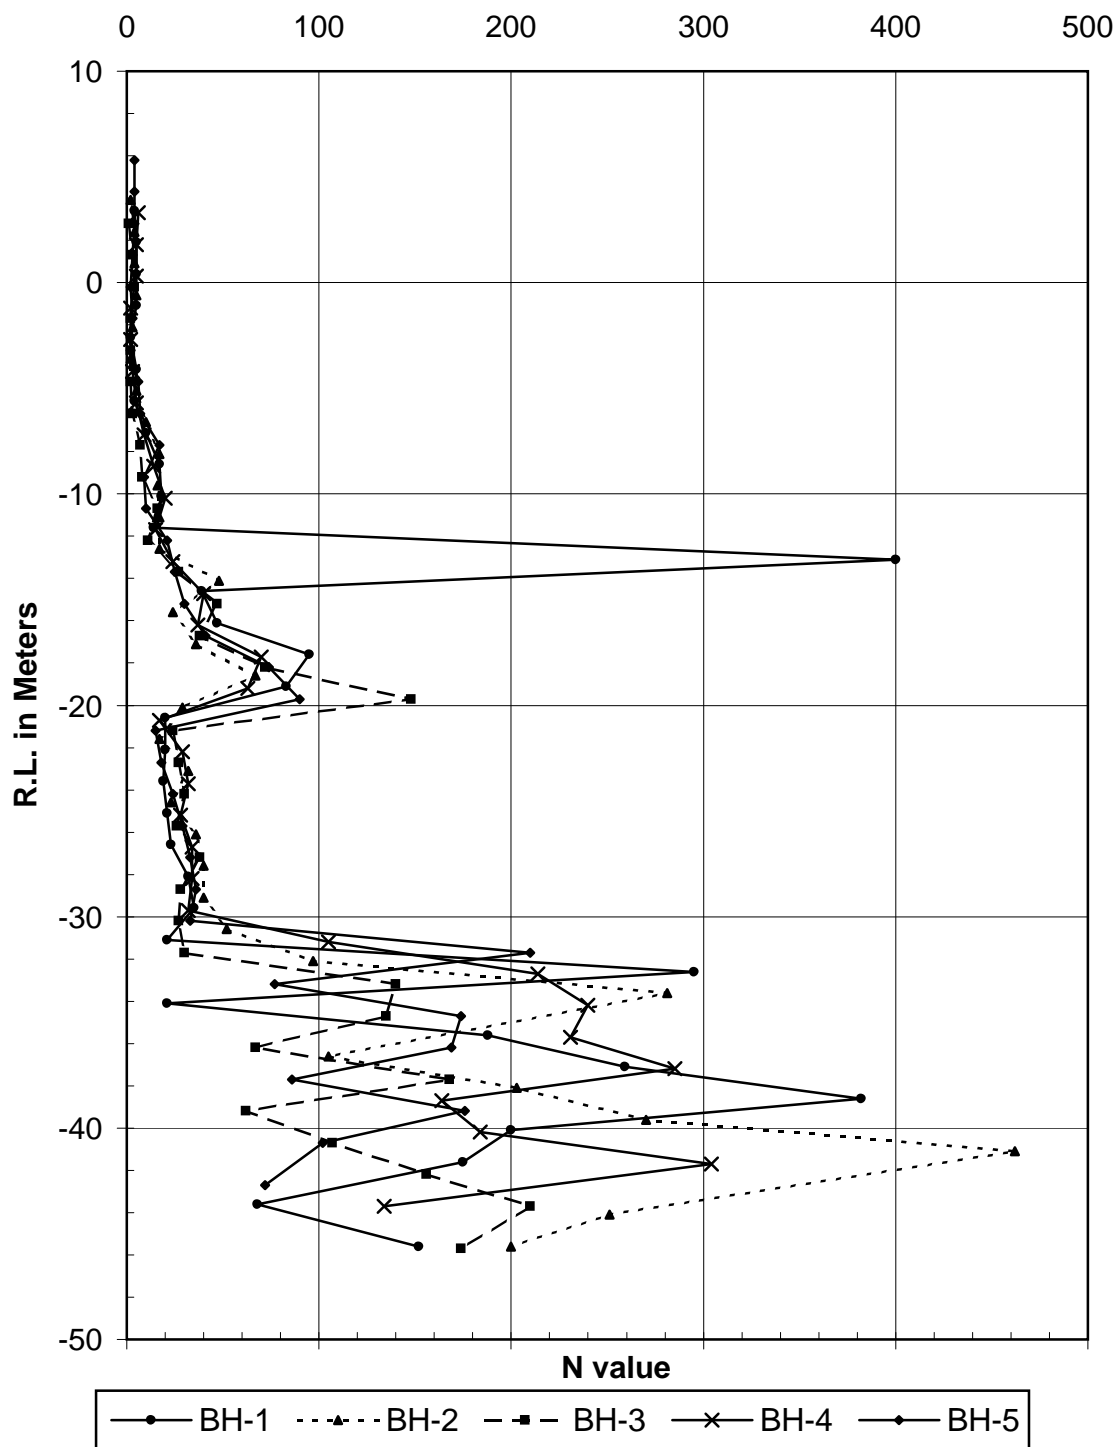


**Project :** Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.:** CCPL/20101211

**Fig No.:** B/1

## GRAPHICAL REPRESENTATION OF FIELD N-VALUE WITH R.L.

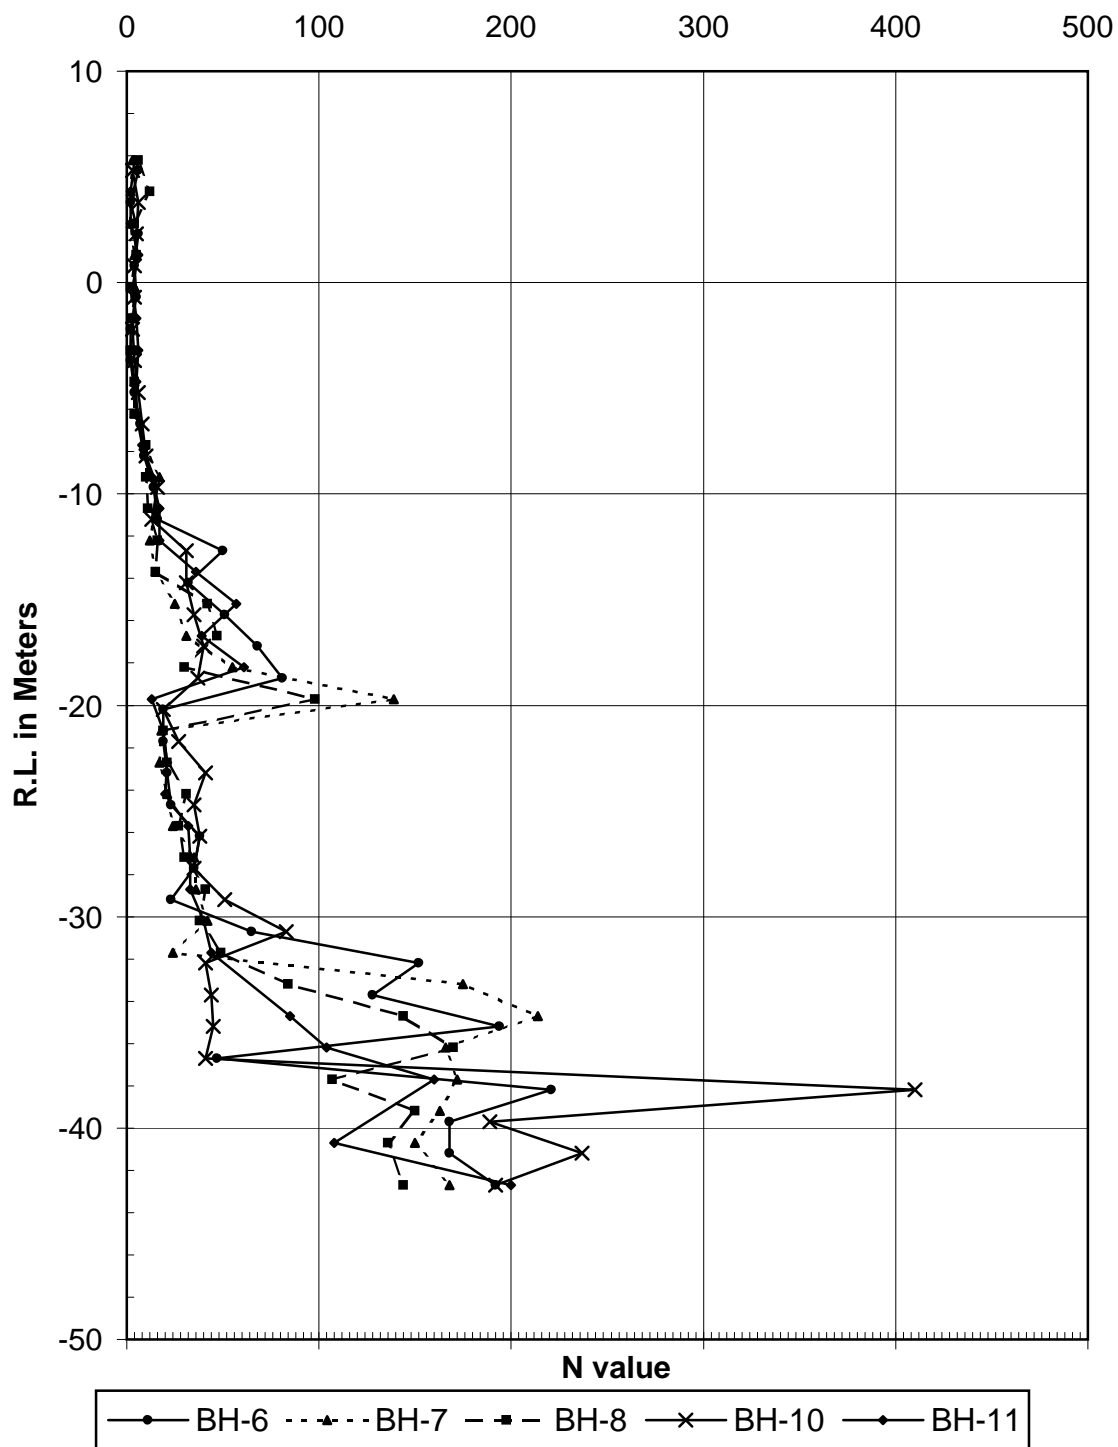


**Project :** Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.:** CCPL/20101211

**Fig No.:** B/2

## GRAPHICAL REPRESENTATION OF CORRECTED N-VALUE WITH R.L.

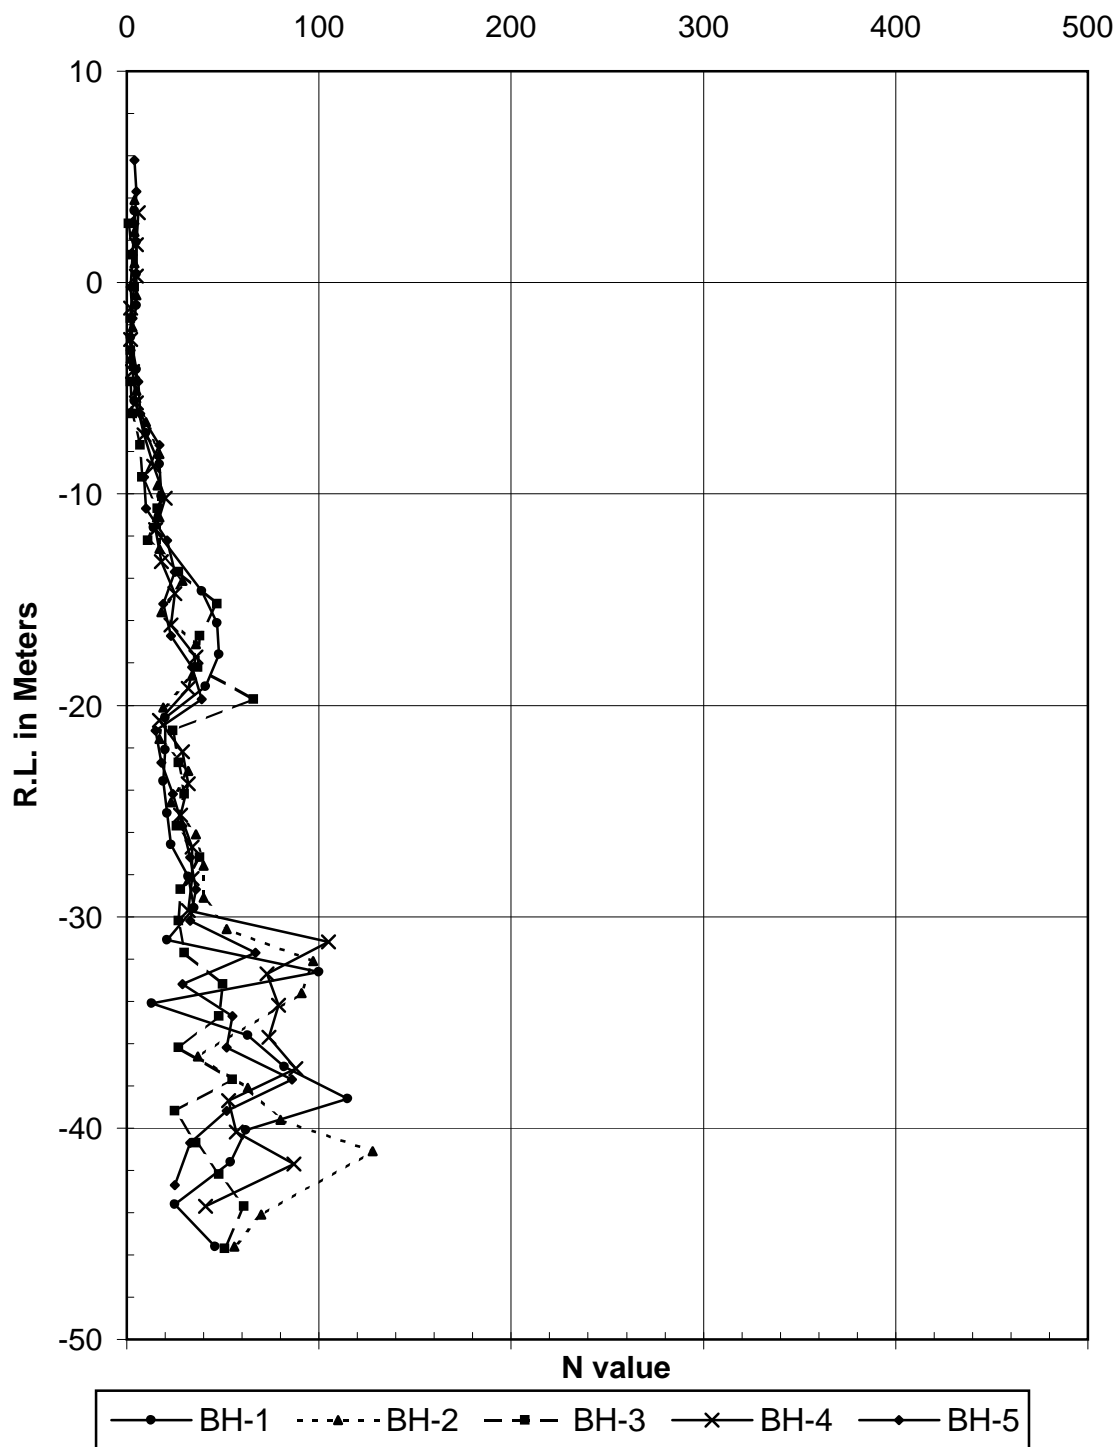


**Project :** Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.:** CCPL/20101211

**Fig No.:** B/3

## GRAPHICAL REPRESENTATION OF CORRECTED N-VALUE WITH R.L.

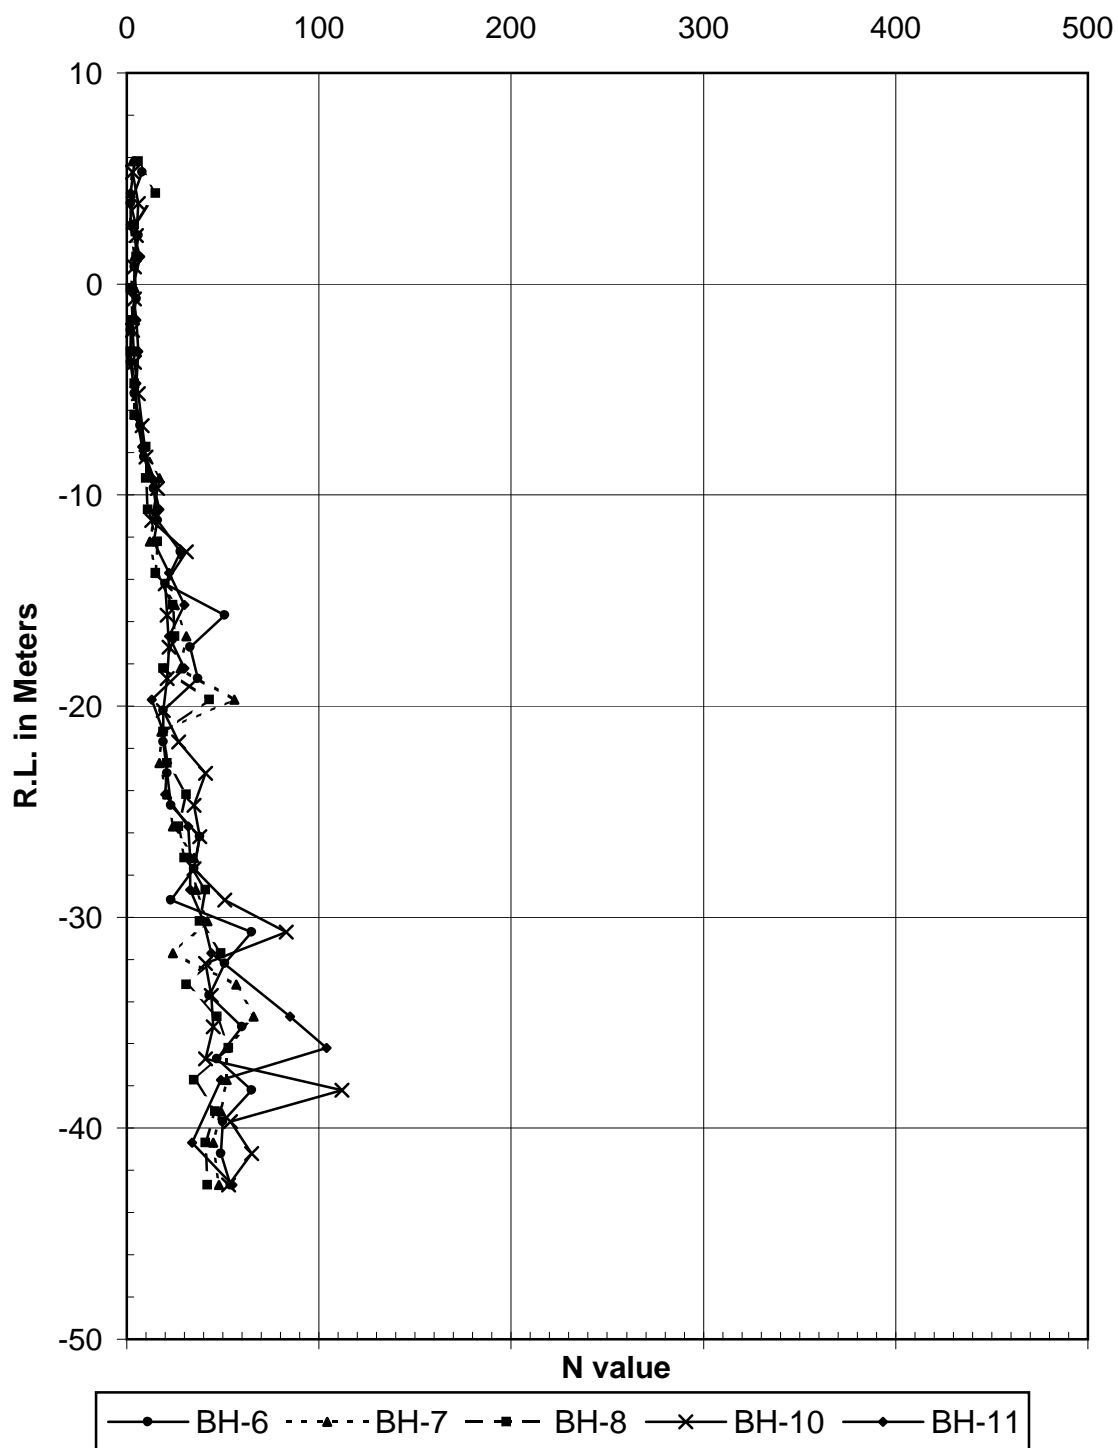

**Project :** Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.:** CCPL/20101211

**Fig No.:** B/4



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-1	0.50	Soft to firm grey sandy silty clay to silty clay	-	-	-	27.6	53.9	18.5	30.2	1.837	1.411	38.4	20.1	18.3	UU UC UC <sub>R</sub>	23 25 19	3.0 - -	2.67	-	-	-	2.96	1.2x10 <sup>-7</sup>
	1.00		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	2.00		-	-	-	23.9	52.5	23.6	28.1	1.874	1.463	40.2	18.4	21.8	UU UC UC <sub>R</sub>	30 32 27	2.0 - -	2.67	0.2666	0.1461	0.8251	3.10	1.3x10 <sup>-7</sup>
	2.50		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	3.50		-	-	-	0.6	76.9	22.5	30.9	1.850	1.413	44.0	23.2	20.8	UU UC UC <sub>R</sub>	27 31 25	4.0 - -	2.67	0.2737	0.1449	0.8892	3.04	1.9x10 <sup>-7</sup>
	4.00	5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	5.00	5.00m Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood	-	-	-	1.6	72.9	25.5	44.9	1.707	1.178	62.9	27.0	35.9	UU UC UC <sub>R</sub>	22 24 18	2.5 - -	2.61	0.3626	0.1637	1.2155	2.94	1.3x10 <sup>-7</sup>
	5.50		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	6.50		-	-	-	6.1	64.2	29.7	83.5	1.445	0.787	99.3 **55.4	43.9 29.3	55.4 26.1	UU UC UC <sub>R</sub>	14 15 8	1.5 - -	2.59	1.1049	0.3359	2.2890	0.54	5.1x10 <sup>-7</sup>
	7.00		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	8.00		-	-	-	0.8	67.4	31.8	49.7	1.603	1.071	59.8	27.9	31.9	UU UC UC <sub>R</sub>	16 17 13	2.5 - -	2.59	0.6916	0.2859	1.4187	0.35	2.7x10 <sup>-7</sup>
	8.50	5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
*Combined percentage of silt & clay																							

Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-1	9.50	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood	-	-	-	1.1	68.8	30.1	53.5	1.579	1.029	70.1	31.3	38.8	UU	17	3.0	2.58	0.7723	0.3079	1.5081	0.36	$1.3 \times 10^{-7}$	
	10.00		4	4	-	-	-	-	-	-	-	-	-	-	UC	20	-	-	-	-	-	-	-	
	11.00		————— 11.00m —————	-	-	0.2	2.8	63.3	33.7	27.0	1.929	1.519	49.4	19.5	29.9	UC <sub>R</sub>	14	-	-	-	-	-	-	-
	11.50	Stiff / very stiff bluish grey to greyish yellow silty clay	10	10	-	3.3	54.7	42.0	-	-	-	68.4	19.9	48.5	UU	51	2.5	2.68	0.3008	0.1705	0.7644	3.43	$1.5 \times 10^{-8}$	
	13.00		17	17	-	-	-	-	-	-	-	-	-	-	UC	54	-	-	-	-	-	-	-	
	14.00		-	-	-	1.3	53.8	44.9	25.4	1.959	1.562	55.9	18.5	37.4	UC <sub>R</sub>	44	-	-	-	-	-	-	-	
	14.50		18	18	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	16.00		14	14	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	17.00		-	-	-	0.7	74.4	24.9	26.0	1.947	1.545	41.5	21.2	20.3	UU	77	2.5	2.69	0.2463	0.1431	0.7219	3.75	$6.3 \times 10^{-9}$	
	17.50	Hard greyish yellow sandy silty clay with occasional presence of gravels	18	18	-	-	-	-	-	-	-	-	-	-	-	UC	82	-	-	-	-	-	-	-
	19.00		14	14	-	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	68	-	-	-	-	-	-	-
	20.50		-	-	-	0.7	74.4	24.9	26.0	1.947	1.545	41.5	21.2	20.3	UU	66	4.0	2.68	0.2566	0.1479	0.7344	3.62	$1.3 \times 10^{-8}$	
	22.00		18	18	-	-	-	-	-	-	-	-	-	-	-	UC	74	-	-	-	-	-	-	-
	23.50	————— 17.50m —————	#400	-	14.6	14.9	56.9	13.6	-	-	-	28.4	16.4	12.0	UC <sub>R</sub>	54	-	-	-	-	-	-	-	-
	19.00	Hard greyish yellow sandy silty clay with occasional presence of gravels	39	39	1.9	15.0	66.4	16.7	-	-	-	34.4	18.9	15.5	-	-	-	-	-	-	-	-	-	-
	20.50		47	47	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	22.00		95	48	-	72.5	*27.5	17.6	\$2.050	1.743	-	-	-	-	DS <sub>R</sub>	10	36.0	-	-	-	-	-	-	
23.50	————— 22.00m —————	83	41	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
# Extrapolated N Values for N>100					*Combined percentage of silt & clay				\$ Remoulded density															
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211			TABLE NO.: C/1-2				







Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-1	25.00	25.00m Very stiff / hard bluish to brownish grey silty clay with brown spots	20	20	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	26.00		-	-	-	0.8	65.2	34.0	25.3	1.962	1.566	49.0	19.5	29.5	UU UC UC <sub>R</sub>	91 96 74	2.5	2.68	0.2279	0.1332	0.7115	-	1.2x10 <sup>-8</sup>	
	26.50		20	20	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	28.00		19	19	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	29.00	-	-	-	1.2	64.9	33.9	24.9	1.970	1.577	53.6	21.3	32.3	UU UC UC <sub>R</sub>	93 98 73	2.0	2.69	0.2374	0.1392	0.7055	-	8.3x10 <sup>-9</sup>		
	29.50	21	21	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	31.00	23	23	0.3	5.7	53.2	40.8	-	-	-	-	48.5	18.3	30.2	-	-	-	-	-	-	-	-	-	
	32.50	32	32	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	34.00	35	35	-	2.2	67.6	30.2	-	-	-	-	43.4	17.6	25.8	-	-	-	-	-	-	-	-	-	
	35.50	21	21	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	37.00	36.50m Dense / very dense brownish to greyish yellow silty sand; medium dense brownish grey silty clayey sand observed at 38.5m and 48.0m depth	#295	100	0.1	76.3	*23.6	17.3	\$2.084	1.777	-	-	-	-	DS <sub>R</sub>	10	38.5	-	-	-	-	-	-	-
	38.50		21	13	-	64.8	21.6	13.6	-	-	-	25.7	15.2	10.5	-	-	-	-	-	-	-	-	-	
	40.00		#188	63	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	41.50		#259	82	-	87.1	*12.9	19.4	\$2.073	1.736	-	-	-	-	DS <sub>R</sub>	0	37.5	-	-	-	-	-	-	
	43.00		#382	115	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	# Extrapolated N Values for N>100					*Combined percentage of silt & clay						\$ Remoulded density												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211			TABLE NO.: C/1-3				

Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity G <sub>s</sub>	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	φ (degrees)		C <sub>c</sub>	$\frac{C_c}{1+e_0}$	Void Ratio, e <sub>0</sub>		
BH-1	44.50	Dense / very dense brownish to greyish yellow silty sand; medium dense brownish grey silty clayey sand observed at 38.5m and 48.0m depth	#200	62	-	78.1	*21.9	18.2	\$2.078	1.758	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	-	
	46.00		#175	54	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	48.00		68	25	-	55.9	30.3	13.8	-	-	-	25.1	15.0	10.1	-	-	-	-	-	-	-	-	-
	50.00		#152	46	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
					*Combined percentage of silt & clay						\$ Remoulded density												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/1-4					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-2	0.00	Very loose / loose yellowish grey silty fine sand	-	-	-	67.7	*32.3		31.9	1.755	1.331	Non-plastic			DS	12	26.0	2.65	-	-	-	0.60	$3.1 \times 10^{-5}$	
	0.50		2	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	2.00		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	3.00	Soft / firm grey silty clay	-	-	-	0.3	64.2	35.5	31.5	1.832	1.393	50.8	19.8	31.0	UU UC UC <sub>R</sub>	23 25 21	2.5 - -	2.67	0.3269	0.1706	0.9165	2.96	$8.9 \times 10^{-8}$	
	3.50		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	5.00		5	5	-	0.7	69.2	30.1	-	-	-	-	51.4	25.2	26.2	-	-	-	-	-	-	-	-	-
	6.00	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood; plenty of wood observed at 9.0m depth	-	-	-	0.1	68.4	31.5	41.5	1.705	1.205	53.0	25.4	27.6	UU UC UC <sub>R</sub>	22 24 20	2.5 - -	2.59	0.4314	0.2007	1.1495	2.94	$2.1 \times 10^{-7}$	
	6.50		3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	8.00		2	2	-	0.1	57.5	42.4	-	-	-	-	67.7	27.2	40.5	-	-	-	-	-	-	-	-	-
	9.00		-	-	-	1.1	69.1	29.8	80.4	1.485	0.823	109.0 **59.8	47.3 27.8	61.7 32.0	UU UC UC <sub>R</sub>	17 19 14	3.0 - -	2.57	1.0496	0.3362	2.1221	0.35	$2.7 \times 10^{-7}$	
	9.50		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	11.00	Stiff to very stiff bluish grey silty clay	10	10	-	4.7	45.8	49.5	-	-	-	65.7	21.8	43.9	-	-	-	-	-	-	-	-	-	-
	12.00		-	-	-	8.0	46.1	45.9	26.4	1.946	1.540	60.0	18.0	42.0	UU UC UC <sub>R</sub>	66 70 61	3.0 - -	2.68	0.2686	0.1543	0.7408	3.62	$1.2 \times 10^{-8}$	
					*Combined percentage of silt & clay							**LL & PL conducted on oven dried sample												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/2-1					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-2	12.50	Stiff to very stiff bluish grey silty clay	17	17	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	14.00		16	16	-	0.2	58.8	41.0	-	-	-	51.0	18.4	32.6	-	-	-	-	-	-	-	-	-
	15.00	15.00m	-	-	-	1.5	75.6	22.9	24.5	1.963	1.577	41.5	19.8	21.7	UU	68	4.5	2.68	0.2495	0.1468	0.6997	3.65	5.3x10 <sup>-8</sup>
	15.50	Stiff / very stiff greyish yellow silty clay with high silt content	17	17	-	-	-	-	-	-	-	-	-	-	UC	73	-	-	-	-	-	-	-
	17.00		17	17	-	8.8	75.8	15.4	-	-	-	33.3	18.3	15.0	-	-	-	2.67	-	-	-	-	-
	18.00m																						
	18.50	Medium dense greyish yellow silty sand; hard yellowish grey silty clay with kankars observed at 21.5m depth	48	29	-	69.1	*30.9	22.3	\$1.980	1.619	-	-	-	-	DS <sub>R</sub>	18	34.0	2.65	-	-	-	0.68	-
	20.00		24	18	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	21.50		36	36	3.7	8.0	73.3	15.0	-	-	-	31.4	18.9	12.5	-	-	-	-	-	-	-	-	-
	23.00		67	34	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	24.50		29	19	1.1	75.8	*23.1	23.1	\$1.950	1.584	-	-	-	-	DS <sub>R</sub>	10	33.5	-	-	-	-	0.94	-
	25.50	25.50m	-	-	-	0.1	51.8	48.1	26.1	1.954	1.550	68.8	20.6	48.2	UU	75	3.5	2.68	0.2839	0.1641	0.7295	3.73	1.8x10 <sup>-9</sup>
	26.00	Very stiff to hard bluish grey to brownish yellow silty clay	17	17	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	27.00		-	-	2.7	5.5	55.9	35.9	24.6	1.983	1.591	55.0	21.6	33.4	UU	109	1.5	2.68	0.2171	0.1289	0.6840	4.09	4.2x10 <sup>-9</sup>
					\$ Remoulded density										UC	115	-						
					*Combined percentage of silt & clay										UC <sub>R</sub>	96	-						
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/2-2					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-2	27.50	Very stiff to hard bluish grey to brownish yellow silty clay	32	32	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	29.00		23	23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	30.00		-	-	-	1.6	56.7	41.7	22.8	2.040	1.661	54.5	19.7	34.8	UU	137	2.0	2.70	0.1935	0.1191	0.6253	4.34	$2.6 \times 10^{-9}$	
	30.50		36	36	-	-	-	-	-	-	-	-	-	-	-	UC	147	-	-	-	-	-		
	32.00		40	40	-	1.2	57.1	41.7	-	-	-	54.9	21.2	33.7	-	-	-	-	-	-	-	-		
	33.50		40	40	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	35.00		52	52	-	5.5	70.5	24.0	-	-	-	40.6	17.3	23.3	-	-	-	2.68	-	-	-	-		-
	36.50		97	97	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		-
	38.00	38.00m	#281	91	1.0	81.2	*17.8	17.2	\$2.080	1.775	-	-	-	DS <sub>R</sub>	0	38.0	-	-	-	-	-	-		
	39.50	Dense / very dense brownish yellow silty sand	#562	170	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	41.00	105	37	2.0	85.2	*12.8	19.5	\$2.031	1.700	-	-	-	DS <sub>R</sub>	0	36.5	-	-	-	-	-	-	-		
	42.50	#203	63	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	44.00	#270	80	0.3	87.7	*12.0	17.6	\$2.078	1.767	-	-	-	DS <sub>R</sub>	0	37.5	-	-	-	-	-	-	-		
	45.50	#462	128	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
# Extrapolated N Values for N>100					*Combined percentage of silt & clay						\$ Remoulded density													
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/2-3					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-2	47.00	Dense / very dense brownish yellow silty sand	#960	253	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	48.50		#251	70	1.5	85.0	*13.5		19.0	\$2.070	1.739	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	
	50.00		#200	56	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
						*Combined percentage of silt & clay							\$ Remoulded density										
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211			TABLE NO.: C/2-4			



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-3	1.00	Very soft to soft grey silty clay with varying percentage of decomposed wood	-	-	-	0.5	53.2	46.3	54.7	1.563	1.010	73.2	29.5	43.7	UU UC UC <sub>R</sub>	13 14 9	1.0 - -	2.62	-	-	-	0.34	4.0x10 <sup>-7</sup>	
	1.50		1	1	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	2.50		-	-	-	1.0	61.2	37.8	48.4	1.634	1.101	59.1	25.5	33.6	UU UC UC <sub>R</sub>	14 15 8	2.0 - -	2.60	0.4496	0.1904	1.3613	0.36	3.0x10 <sup>-7</sup>	
	3.00		3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	4.00		-	-	-	1.8	72.2	26.0	42.0	1.675	1.180	51.8	25.1	26.7	UU UC UC <sub>R</sub>	19 21 14	2.5 - -	2.62	0.3520	0.1585	1.2211	0.39	4.1x10 <sup>-7</sup>	
	4.50		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	5.50		-	-	-	0.7	71.3	28.0	47.5	1.621	1.099	56.9	26.7	30.2	UU UC UC <sub>R</sub>	12 13 9	1.5 - -	2.60	0.5185	0.2191	1.3658	0.35	5.1x10 <sup>-7</sup>	
	6.00		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	7.00		-	-	-	0.3	60.8	38.9	51.0	1.610	1.066	69.9	28.0	41.9	UU UC UC <sub>R</sub>	14 15 10	1.5 - -	2.60	0.6093	0.2499	1.4385	0.35	2.1x10 <sup>-7</sup>	
	7.50		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	8.50		-	-	-	0.4	67.9	31.7	48.5	1.632	1.099	61.8	25.8	36.0	UU UC UC <sub>R</sub>	15 16 10	2.0 - -	2.62	0.5685	0.2385	1.3840	0.35	3.7x10 <sup>-7</sup>	
	9.00		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
					*Combined percentage of silt & clay																			
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																		JOB NO.: CCPL/20101211		TABLE NO.: C/3-1				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-3	10.00	Very soft to soft grey silty clay with varying percentage of decomposed wood	-	-	-	1.0	63.8	35.2	46.0	1.650	1.130	69.0	27.7	41.3	UU UC UC <sub>R</sub>	17 19 13	1.5 - -	2.63	0.5624	0.2417	1.3271	0.35	2.1x10 <sup>-7</sup>	
	10.50		3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	12.00		7	7	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	13.00	13.00m	-	-	-	1.1	53.2	45.7	28.5	1.902	1.480	65.9	22.4	43.5	UU UC UC <sub>R</sub>	39 42 29	2.0 - -	2.69	0.3284	0.1807	0.8174	3.25	8.3x10 <sup>-9</sup>	
	13.50	Stiff bluish grey to brownish yellow silty clay	8	8	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	15.00		16	16	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	16.00		-	-	-	0.2	69.6	30.2	26.1	1.943	1.541	48.4	21.4	27.0	UU UC UC <sub>R</sub>	74 79 52	2.5 - -	2.68	0.2569	0.1477	0.7393	3.72	4.4x10 <sup>-8</sup>	
	16.50	18.00m	11	11	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	18.00		27	27	-	16.1	74.7	9.2	-	-	-	32.7	21.7	11.0	-	-	-	2.67	-	-	-	-	-	
	19.50		47	47	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	21.00	Very stiff to hard brownish yellow sandy silty clay	38	38	-	23.0	61.5	15.5	-	-	-	38.1	20.3	17.8	-	-	-	-	-	-	-	-	-	
	22.50		72	37	0.3	54.3	*45.4	21.4	\$2.028	1.671	-	-	-	DS <sub>R</sub>	16	35.5	-	-	-	-	0.65	-		
	24.00		#148	66	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	25.00	25.00m	-	-	-	0.4	52.4	47.2	24.0	1.980	1.597	69.1	19.5	49.6	UU UC UC <sub>R</sub>	108 115 96	2.0 - -	2.69	0.2211	0.1312	0.6847	4.08	5.5x10 <sup>-9</sup>	
	# Extrapolated N Values for N>100						*Combined percentage of silt & clay				\$ Remoulded density													
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/3-2					





Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-3	25.50	Very stiff bluish to brownish grey silty clay	24	24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	27.00		27	27	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	28.00		-	-	-	3.1	47.3	49.6	23.5	2.021	1.636	69.3	21.7	47.6	UU	122	1.5	2.69	0.2092	0.1273	0.6438	4.21	6.1x10 <sup>-9</sup>
	28.50		30	30	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	129	-	-	-	-	-	-	-
	30.00		26	26	-	0.9	53.6	45.5	-	-	-	60.8	20.1	40.7	-	-	-	-	-	-	-	-	-
	31.50		38	38	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	33.00		28	28	-	1.7	52.4	45.9	-	-	-	65.1	22.8	42.3	-	-	-	-	-	-	-	-	-
	34.50		27	27	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	36.00	30	30	-	15.4	62.1	22.5	-	-	-	41.3	20.5	20.8	-	-	-	-	-	-	-	-	-	
	37.50	37.50m	#140	50	-	81.0	*19.0	18.3	\$2.058	1.740	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	-	-
	39.00	Dense / very dense brownish yellow silty sand; hard greyish brown sandy silty clay observed at 43.5m depth	#135	48	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	40.50		67	27	1.7	77.3	*21.0	20.8	\$2.028	1.679	-	-	-	DS <sub>R</sub>	12	35.0	-	-	-	-	-	-	-
	42.00		#168	55	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	43.50		62	62	-	15.1	58.7	26.2	-	-	-	51.1	20.4	30.7	-	-	-	-	-	-	-	-	-
	45.00		107	36	1.3	72.7	*26.0	18.4	\$2.042	1.725	-	-	-	DS <sub>R</sub>	15	36.0	-	-	-	-	-	-	-
	# Extrapolated N Values for N>100							*Combined percentage of silt & clay				\$ Remoulded density											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211			TABLE NO.: C/3-3				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-3	46.50	Dense / very dense brownish yellow silty sand; hard greyish brown sandy silty clay observed at 43.5m depth	#156	48	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	48.00		#210	61	-	87.3	*12.7	16.4	\$2.070	1.778	-	-	-	DS <sub>R</sub>	0	37.5	-	-	-	-	-		
	50.00		#174	51	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	# Extrapolated N Values for N>100				*Combined percentage of silt & clay				\$ Remoulded density														
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/3-4					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-4	0.50	Firm grey silty clay to silty clay with high silt content	-	-	-	0.7	68.3	31.0	31.5	1.840	1.399	51.5	23.3	28.2	UU UC UC <sub>R</sub>	28 31 24	2.0 - -	2.68	-	-	-	3.06	3.6x10 <sup>-8</sup>
	1.00		6	6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	2.00		-	-	-	0.8	83.9	15.3	29.0	1.863	1.444	37.3	23.5	13.8	UU UC UC <sub>R</sub>	29 30 18	4.0 - -	2.67	0.2499	0.1352	0.8488	3.08	4.7x10 <sup>-6</sup>
	2.50		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	3.50	3.50m	-	-	-	26.4	42.0	31.6	148.7	1.260	0.507	182.5 **67.0	83.8 35.0	98.7 32.0	UU UC UC <sub>R</sub>	20 22 9	2.5 - -	2.56	0.9091	0.1799	4.0530	2.89	6.0x10 <sup>-7</sup>
	4.00	Soft grey silty clay / clayey silt with varying percentage of decomposed wood; plenty of wood observed at 3.5m depth	5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	5.00		-	-	-	1.2	73.5	25.3	43.4	1.660	1.158	54.0	26.7	27.3	UU UC UC <sub>R</sub>	22 23 14	2.0 - -	2.62	0.4144	0.1831	1.2633	2.94	2.9x10 <sup>-7</sup>
	5.50		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	6.50		-	-	-	2.9	58.5	38.6	50.4	1.603	1.066	65.6	27.1	38.5	UU UC UC <sub>R</sub>	15 16 11	1.5 - -	2.60	0.6064	0.2486	1.4394	0.42	2.1x10 <sup>-7</sup>
	7.00		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	8.00		-	-	-	2.0	68.3	29.7	53.1	1.625	1.061	66.0	28.6	37.4	UU UC UC <sub>R</sub>	16 17 10	1.5 - -	2.61	0.6201	0.2522	1.4590	0.41	2.9x10 <sup>-7</sup>
	8.50		3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
					*Combined percentage of silt & clay							**LL & PL conducted on oven dried sample											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/4-1				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity G <sub>s</sub>	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	φ (degrees)		C <sub>c</sub>	$\frac{C_c}{1+e_0}$	Void Ratio, e <sub>0</sub>		
BH-4	9.50	Soft grey silty clay / clayey silt with varying percentage of decomposed wood; plenty of wood observed at 3.5m depth	-	-	-	2.0	61.2	36.8	56.8	1.570	1.001	75.7	34.1	41.6	UU	18	2.0	2.60	0.5917	0.2279	1.5967	0.37	1.8x10 <sup>-7</sup>
	10.00		5	5	-	-	-	-	-	-	-	-	-	-	-	UC	20	-	-	-	-	-	-
	11.00		-	-	-	1.8	73.2	25.0	27.9	1.920	1.501	46.3	23.3	23.0	UC <sub>R</sub>	12	-	-	-	-	-	-	-
	11.00	Stiff to very stiff bluish grey silty clay	-	-	-	1.8	73.2	25.0	27.9	1.920	1.501	46.3	23.3	23.0	UU	52	3.0	2.68	0.3109	0.1741	0.7853	3.44	4.4x10 <sup>-8</sup>
	11.50		9	9	-	2.0	70.0	28.0	-	-	-	48.0	21.0	27.0	UC	56	-	-	-	-	-	-	-
	13.00		14	14	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	45	-	-	-	-	-	-	-
	14.00	-	-	-	0.5	60.9	38.6	25.1	1.970	1.575	58.0	20.1	37.9	UU	95	2.0	2.69	0.2507	0.1468	0.7082	3.95	6.0x10 <sup>-9</sup>	
	14.50	20	20	-	-	-	-	-	-	-	-	-	-	-	UC	98	-	-	-	-	-	-	-
	16.00	15	15	-	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	80	-	-	-	-	-	-	-
	17.00	Stiff yellowish grey silty clay with high silt content / clayey silt	-	-	-	6.3	84.3	9.4	25.4	1.949	1.554	33.5	23.5	10.0	UU	51	4.5	2.67	0.2166	0.1261	0.7179	3.43	1.3x10 <sup>-6</sup>
	17.50		24	18	-	64.6	*35.4	26.9	\$1.900	1.497	-	-	-	-	UC <sub>R</sub>	40	-	-	-	-	-	0.64	-
	19.00		40	25	-	-	-	-	-	-	-	-	-	-	-	DS <sub>R</sub>	15	32.0	-	-	-	-	-
	20.50	37	23	-	71.8	*28.2	22.9	\$1.980	1.611	-	-	-	-	-	DS <sub>R</sub>	10	34.0	2.65	-	-	-	0.67	-
	22.00	70	36	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	23.50	63	32	1.6	81.9	*16.5	20.1	\$2.020	1.682	-	-	-	-	-	DS <sub>R</sub>	0	36.5	-	-	-	-	0.97	-
					*Combined percentage of silt & clay				\$ Remoulded density														
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/4-2				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-4	25.00	25.00m	17	17	-	0.3	50.9	48.8	-	-	-	69.1	22.5	46.6	-	-	-	-	-	-	-	-	
	26.00	Very stiff to hard bluish to brownish grey silty clay with occasional brown spots	-	-	-	3.2	40.3	56.5	26.6	1.958	1.547	70.4	20.9	49.5	UU	72	1.5	2.69	0.2400	0.1380	0.7393	3.70	$2.7 \times 10^{-8}$
	26.50		29	29	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	60	-	-	-	-	-	-	
	28.00		32	32	-	6.6	48.0	45.4	-	-	-	64.0	23.2	40.8	-	-	-	-	-	-	-	-	
	29.50		28	28	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	31.00		34	34	-	6.4	54.8	38.8	-	-	-	57.2	22.9	34.3	-	-	-	-	-	-	-	-	
	32.50		34	34	-	9.0	67.0	24.0	-	-	-	46.0	20.1	25.9	-	-	-	-	-	-	-	-	
	34.00		32	32	-	14.3	64.7	21.0	-	-	-	39.7	19.2	20.5	-	-	-	-	-	-	-	-	
	35.50		105	105	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	37.00	35.80m Dense / very dense brownish yellow silty sand	#214	73	4.1	75.6	*20.3	18.6	\$2.069	1.745	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	-	
	38.50		#240	79	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	40.00		#231	74	-	53.2	*46.8	18.8	\$2.076	1.747	-	-	-	DS <sub>R</sub>	12	37.5	-	-	-	-	-	-	
	41.50		#285	88	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	43.00		#164	53	-	82.0	*18.0	17.7	\$2.059	1.749	-	-	-	DS <sub>R</sub>	0	38.0	-	-	-	-	-	-	-
	# Extrapolated N Values for N>100					*Combined percentage of silt & clay						\$ Remoulded density											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/4-3				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-4	44.50	Dense / very dense brownish yellow silty sand	#184	57	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	46.00		#304	87	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	48.00		#134	41	3.0	56.5	*40.5	18.8	\$2.051	1.726	-	-	-	-	DS <sub>R</sub>	0	36.5	-	-	-	-	-	-
	50.00		#960	243	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	# Extrapolated N Values for N>100			*Combined percentage of silt & clay				\$ Remoulded density															
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/4-4					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-5	1.00	Fill consisting of grey silty sand with stone / brick pieces etc. ————— 0.70m —————	-	-	-	0.7	65.3	34.0	31.5	1.813	1.379	53.9	22.9	31.0	UU	23	2.5	2.68	0.3167	0.1629	0.9439	2.96	$6.0 \times 10^{-8}$	
	1.50	Firm grey silty clay to silty clay with high silt content; loose yellowish grey fine sand observed from 2.5m to 4.0m depth	4	4	-	-	-	-	-	-	-	-	-	-	-	UC	24	-	-	-	-	-	-	
	2.50		-	-	-	93.9	*6.1	28.6	1.755	1.365	-	-	-	-	DS	0	27.0	2.65	-	-	-	0.77	$2.1 \times 10^{-4}$	
	3.00		4	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	4.00	-	-	-	0.7	81.3	18.0	31.1	1.830	1.396	38.8	23.3	15.5	UU	22	4.0	2.67	0.2816	0.1472	0.9128	2.94	$6.9 \times 10^{-7}$		
	4.50	4	4	-	-	-	-	-	-	-	-	-	-	-	-	UC	25	-	-	-	-	-	-	
	5.50	————— 5.50m —————	-	-	-	0.4	60.3	39.3	48.1	1.632	1.102	66.8	28.8	38.0	UU	21	3.0	2.59	0.5069	0.2157	1.3503	2.92	$8.2 \times 10^{-7}$	
	6.00	Soft to firm grey silty clay with varying percentage of decomposed wood	3	3	-	-	-	-	-	-	-	-	-	-	-	UC	23	-	-	-	-	-	-	-
	7.00		-	-	-	1.3	59.4	39.3	59.7	1.540	0.964	79.1	34.6	44.5	UU	14	2.0	2.58	0.7084	0.2648	1.6755	0.36	$1.2 \times 10^{-7}$	
	7.50		2	2	-	-	-	-	-	-	-	-	-	-	-	UC	16	-	-	-	-	-	-	-
	8.50		-	-	-	0.5	72.3	27.2	39.4	1.720	1.234	50.4	25.7	24.7	UU	17	2.5	2.62	0.4564	0.2149	1.1234	0.35	$4.0 \times 10^{-7}$	
																UC <sub>R</sub>	13	-						
	*Combined percentage of silt & clay																							
<b>Abbreviations used :</b> (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/5-1					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-5	9.00	Soft to firm grey silty clay with varying percentage of decomposed wood	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	10.00		-	-	-	0.5	70.7	28.8	40.7	1.702	1.210	50.1	25.5	24.6	UU	15	3.0	2.60	0.4896	0.2278	1.1493	0.35	4.5x10 <sup>-7</sup>
	10.50		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	12.00		6	6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	13.00	Stiff bluish grey to brownish yellow silty clay with occasional presence of calcareous nodules	-	-	-	2.4	67.3	30.3	36.4	1.755	1.287	50.1	26.1	24.0	UU	28	3.0	2.64	0.3945	0.1923	1.0518	3.06	7.1x10 <sup>-8</sup>
	13.50		7	7	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	15.00		17	17	5.4	10.9	44.2	39.5	-	-	-	59.5	20.6	38.9	-	-	-	-	-	-	-	-	-
	16.00		-	-	-	0.6	70.7	28.7	27.3	1.934	1.519	50.2	21.2	29.0	UU	47	2.0	2.68	0.2791	0.1582	0.7640	3.37	4.1x10 <sup>-8</sup>
	16.50	Very stiff brownish yellow silty clay (high silt content) / clayey silt with sand; medium dense sandy silt observed from 22.5m depth to 23.00m	9	9	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	18.00		10	10	-	0.5	70.0	29.5	-	-	-	50.1	21.0	29.1	-	-	-	-	-	-	-	-	-
	19.50		21	21	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	21.00		25	25	0.4	18.7	72.9	8.0	-	-	-	30.7	22.5	8.2	-	-	-	-	-	-	-	-	-
	22.50	Medium dense to dense yellowish grey silty sand	30	19	-	39.1	56.8	4.1	-	-	-	-	-	-	-	-	-	-	-	-	-	0.55	-
	24.00		41	23	-	75.0	*25.0	25.0	\$1.940	1.552	-	-	-	-	DS <sub>R</sub>	10	33.0	-	-	-	-	0.74	-
					*Combined percentage of silt & clay							\$ Remoulded density											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211			TABLE NO.: C/5-2			





Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity G <sub>s</sub>	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	φ (degrees)		C <sub>c</sub>	$\frac{C_c}{1+e_0}$	Void Ratio, e <sub>0</sub>			
BH-5	25.50	Medium dense to dense yellowish grey silty sand	74	34	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	27.00		90	39	6.2	67.8	*26.0	21.0	\$2.030	1.678	-	-	-	DS <sub>R</sub>	12	36.5	2.67	-	-	-	1.39	-		
	28.50	Stiff / very stiff to hard bluish to yellowish grey silty clay with occasional brown spots	15	15	-	1.2	47.7	51.1	-	-	-	70.3	19.9	50.4	-	-	-	-	-	-	-	-	-	
	29.50		-	-	-	2.7	47.8	49.5	26.2	1.958	1.552	65.9	22.0	43.9	UU UC UC <sub>R</sub>	72 80 61	2.0 - -	2.69	0.2634	0.1519	0.7338	3.70	2.7x10 <sup>-8</sup>	
	30.00		18	18	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	31.50		24	24	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	32.50		-	-	1.7	3.0	45.5	49.8	23.8	2.008	1.622	64.2	20.2	44.0	UU UC UC <sub>R</sub>	107 118 94	3.0 - -	2.70	0.2372	0.1425	0.6646	-	5.7x10 <sup>-9</sup>	
	33.00		29	29	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	34.50		33	33	-	1.3	53.8	44.9	-	-	-	64.1	20.7	43.4	-	-	-	-	-	-	-	-	-	-
	36.00		36	36	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	37.50		33	33	-	9.8	65.8	24.4	-	-	-	47.2	20.7	26.5	-	-	-	-	-	-	-	-	-	-
	39.00		39.00m	#210	67	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	40.50		Medium dense / dense to very dense brownish to greyish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth	77	29	0.5	86.6	*12.9	22.6	\$2.026	1.653	-	-	-	DS <sub>R</sub>	0	35.0	-	-	-	-	-	-	-
	42.00			#174	55	-	82.0	*18.0	19.2	\$2.061	1.729	-	-	-	DS <sub>R</sub>	10	37.0	-	-	-	-	-	-	-
	43.50			#169	52	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	# Extrapolated N Values for N>100					*Combined percentage of silt & clay						\$ Remoulded density												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/5-3					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-5	45.00	Medium dense / dense to very dense brownish to greyish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth	86	86	-	19.0	53.2	27.8	-	-	-	42.9	16.0	26.9	-	-	-	-	-	-	-	-	-
	46.50		#176	52	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	48.00		102	33	0.4	86.8	*12.8	22.2	\$2.021	1.654	-	-	-	DS <sub>R</sub>	0	35.0	-	-	-	-	-	-	-
	50.00		72	25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	# Extrapolated N Values for N>100							*Combined percentage of silt & clay					\$ Remoulded density										
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/5-4				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-6	1.50	Fill consisting of brownish grey silty sand with stone / brick pieces etc.	-	-	13.1	43.8	*43.1		23.0	1.830	1.488	-	-	-	-	-	-	-	-	-	-	2.02	-
	2.00	2.00m	6	8	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	3.00	Loose grey sandy silt / silty sand with clay as binder	-	-	-	50.6	40.0	9.4	32.6	1.760	1.327	-	-	-	DS	20	27.5	2.65	-	-	-	0.65	4.3x10 <sup>-5</sup>
	3.50	3.50m	2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	4.50	Soft to firm grey silty clay	-	-	-	1.5	55.3	43.2	35.5	1.801	1.329	61.4	21.8	39.6	UU UC UC <sub>R</sub>	12 14 10	1.5 - -	2.68	0.2968	0.1472	1.0163	0.35	2.1x10 <sup>-8</sup>
	5.00		6	6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	6.00		-	-	-	0.3	76.7	23.0	29.8	1.851	1.426	40.7	20.6	20.1	UU UC UC <sub>R</sub>	30 34 26	2.5 - -	2.66	0.2850	0.1528	0.8653	3.10	4.3x10 <sup>-7</sup>
	6.50	6.50m	4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	7.50	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.5m depth	-	-	-	0.5	64.7	34.8	45.8	1.640	1.125	65.6	26.4	39.2	UU UC UC <sub>R</sub>	21 24 13	2.0 - -	2.60	0.5503	0.2381	1.3115	2.92	2.1x10 <sup>-7</sup>
	8.00		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	9.00		-	-	-	0.5	65.5	34.0	48.1	1.623	1.096	61.5	24.9	36.6	UU UC UC <sub>R</sub>	10 12 7	1.5 - -	2.60	0.4888	0.2060	1.3725	0.35	2.9x10 <sup>-7</sup>
	9.50		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
*Combined percentage of silt & clay																							
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/6-1				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-6	10.50	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.5m depth	-	-	-	0.5	74.2	25.3	40.2	1.735	1.238	52.8	23.3	29.5	UU	15	2.0	2.63	0.4297	0.2022	1.1252	0.35	$3.3 \times 10^{-7}$
	11.00		2	2	-	-	-	-	-	-	-	-	-	-	UC	17	-	-	-	-	-	-	-
	12.50		4	4	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	11	-	-	-	-	-	-	-
	13.50		-	-	-	4.7	52.0	43.3	140.1	1.255	0.523	196.8 **94.9	74.1 35.8	122.7 59.1	UU	17	2.5	2.56	1.8146	0.3705	3.8976	0.40	$5.1 \times 10^{-7}$
	14.00	Stiff bluish grey silty clay with occasional traces of calcareous nodules	7	7	-	-	-	-	-	-	-	-	-	-	UC	20	-	-	-	-	-	-	-
	15.50		9	9	-	5.8	41.8	52.4	-	-	-	74.1	23.1	51.0	UC <sub>R</sub>	10	-	-	-	-	-	-	-
	16.50		-	-	4.2	9.5	45.0	41.3	27.0	1.935	1.524	60.2	19.5	40.7	UU	57	2.5	2.69	0.2929	0.1659	0.7655	3.51	$1.7 \times 10^{-8}$
	17.00		14	14	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	49	-	-	-	-	-	-	-
	18.50	Medium dense brownish yellow sandy silt with clay as binder to hard silty clay with high silt content	16	16	-	0.7	70.6	28.7	-	-	-	46.9	21.2	25.7	-	-	-	-	-	-	-	-	-
	20.00		50	28	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	21.50		32	20	0.1	41.8	53.6	4.5	-	-	-	-	-	-	-	-	-	-	-	-	-	0.66	-
	23.00		51	51	-	13.8	73.4	12.8	-	-	-	32.3	19.8	12.5	-	-	-	-	-	-	-	-	-
	24.50	24.50m	68	33	-	74.8	*25.2	21.2	\$2.028	1.673	-	-	-	-	DS <sub>R</sub>	11	36.0	2.65	-	-	-	0.76	-
	26.00	Dense yellowish grey silty sand	81	37	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
					*Combined percentage of silt & clay							\$ Remoulded density **LL & PL conducted on oven dried sample											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/6-2				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity G <sub>s</sub>	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	φ (degrees)		C <sub>c</sub>	$\frac{C_c}{1+e_0}$	Void Ratio, e <sub>0</sub>			
BH-6	27.00	27.00m	-	-	-	2.4	48.1	49.5	26.7	1.961	1.548	67.0	21.1	45.9	UU	78	1.0	2.68	0.2701	0.1560	0.7315	3.77	6.1x10 <sup>-9</sup>	
	27.50	Very stiff to hard bluish grey silty clay; yellowish grey silty clay with varying percentage of sand observed from 36.5m depth	19	19	-	-	-	-	-	-	-	-	-	-	UC	83	-	-	-	-	-	-	-	
	29.00		19	19	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	67	-	-	-	-	-	-	-	
	30.00		-	-	-	3.5	49.3	47.2	25.5	1.970	1.570	65.1	20.5	44.6	UU	92	1.5	2.69	0.2322	0.1355	0.7137	3.92	4.6x10 <sup>-9</sup>	
	30.50		21	21	-	-	-	-	-	-	-	-	-	-	UC	96	-	-	-	-	-	-	-	
	32.00	23	23	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	33.50	38	38	-	11.2	52.1	36.7	-	-	-	50.8	19.4	31.4	-	-	-	-	-	-	-	-	-	-	-
	35.00	35	35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	36.50	23	23	-	13.9	63.3	22.8	-	-	-	37.4	17.6	19.8	-	-	-	-	-	-	-	-	-	-	-
	38.00	65	65	-	49.4	36.2	14.4	-	-	-	30.7	16.8	13.9	-	-	-	-	-	-	-	-	-	-	-
	39.50	39.50m	#152	51	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	41.00	Dense / very dense brownish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth	#128	43	0.3	85.1	*14.6	17.4	\$2.051	1.747	-	-	-	DS <sub>R</sub>	0	37.0	2.67	-	-	-	-	-	-	-
	42.50		#194	60	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	44.00		47	47	-	30.2	44.3	25.5	-	-	-	37.8	16.7	21.1	-	-	-	-	-	-	-	-	-	-
# Extrapolated N Values for N>100							*Combined percentage of silt & clay				\$ Remoulded density													
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/6-3					





Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity G <sub>s</sub>	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	φ (degrees)		C <sub>c</sub>	$\frac{C_c}{1+e_0}$	Void Ratio, e <sub>0</sub>		
BH-6	45.50	Dense / very dense brownish yellow silty sand; hard bluish grey sandy silty clay observed from 44.0m to 45.5m depth	#221	65	-	87.1	*12.9	17.0	\$2.067	1.767	-	-	-	DS <sub>R</sub>	0	37.5	-	-	-	-	-	-	
	47.00		#168	50	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		
	48.50		#168	49	-	81.8	*18.2	18.1	\$2.060	1.744	-	-	-	DS <sub>R</sub>	0	38.0	-	-	-	-	-	-	
	50.00		#192	54	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	# Extrapolated N Values for N>100			*Combined percentage of silt & clay				\$ Remoulded density															
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/6-4					

Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-7	1.00	Fill consisting of grey silty sand with stone / brick pieces etc.	-	-	26.9	34.4	32.8	5.9	24.0	1.855	1.496	-	-	-	-	-	-	-	-	-	-	2.81	-
	1.50	1.50m Soft grey silty clay	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	2.50		-	-	-	9.5	49.8	40.7	38.9	1.752	1.261	63.1	22.6	40.5	UU UC UC <sub>R</sub>	15 16 10	1.5 - -	2.67	0.4199	0.1984	1.1168	0.42	5.6x10 <sup>-8</sup>
	3.00	5.50m Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 5.5m and 13.5m depth	2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	4.00		-	-	-	0.2	65.0	34.8	35.5	1.776	1.311	56.6	20.9	35.7	UU UC UC <sub>R</sub>	14 17 10	2.0 - -	2.67	0.4022	0.1974	1.0371	0.34	6.3x10 <sup>-8</sup>
	4.50		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	5.50		-	-	-	10.3	53.0	36.7	125.8	1.320	0.585	176.9 **97.6	57.4 63.2	119.5 34.4	UU UC UC <sub>R</sub>	16 19 8	2.5 - -	2.57	1.0763	0.2448	3.3963	0.52	4.0x10 <sup>-7</sup>
	6.00		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	7.00		-	-	-	0.4	69.8	29.8	41.1	1.742	1.235	53.9	25.1	28.8	UU UC UC <sub>R</sub>	22 24 15	1.0 - -	2.58	0.4450	0.2129	1.0898	2.94	2.1x10 <sup>-7</sup>
	7.50		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	8.50		-	-	-	0.7	71.3	28.0	45.0	1.651	1.139	59.8	25.5	34.3	UU UC UC <sub>R</sub>	16 19 12	2.5 - -	2.60	0.4746	0.2079	1.2834	0.36	2.9x10 <sup>-7</sup>
	9.00		3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
					*Combined percentage of silt & clay						**LL & PL conducted on oven dried sample												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/7-1				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-7	10.00	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 5.5m and 13.5m depth	-	-	-	9.6	55.4	35.0	48.3	1.616	1.090	69.5	26.7	42.8	UU	17	2.0	2.62	0.5261	0.2188	1.4044	0.39	$2.6 \times 10^{-7}$
	10.50		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	12.00		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	13.00		-	-	-	7.1	43.2	49.7	129.3	1.315	0.573	199.7 **92.0	94.8 35.7	104.9 56.3	UU UC UC <sub>R</sub>	23 25 14	1.5 -	2.57	1.6736	0.3734	3.4814	2.96	$5.6 \times 10^{-7}$
	13.50		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	15.00	15.00m	9	9	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	16.00	Stiff bluish grey to brownish yellow silty clay	-	-	0.3	9.2	45.7	44.8	26.6	1.948	1.539	64.1	21.0	43.1	UU	69	1.0	2.69	0.2769	0.1584	0.7482	3.66	$1.3 \times 10^{-8}$
	16.50		17	17	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	18.00		15	15	-	0.5	66.3	33.2	-	-	-	51.0	22.0	29.0	-	-	-	-	-	-	-	-	-
	19.50		12	12	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	21.00		21.00m	15	15	-	6.2	77.1	16.7	-	-	-	37.7	21.8	15.9	-	-	-	2.67	-	-	-	-
	22.50	Stiff to very stiff brownish yellow silty clay with high silt content	25	25	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	24.00		31	31	-	4.9	76.1	19.0	-	-	-	42.8	21.9	20.9	-	-	-	-	-	-	-	-	-
					*Combined percentage of silt & clay							**LL & PL conducted on oven dried sample											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/7-2				





Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-7	25.50	25.50m	55	28	-	68.6	*31.4	24.2	\$2.019	1.626	-	-	-	DS <sub>R</sub>	12	35.0	-	-	-	-	0.63	-	
	27.00	Medium dense to very dense brownish yellow silty sand	#139	56	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	28.00	28.00m	-	-	-	3.2	46.7	50.1	25.2	1.956	1.562	64.2	21.4	42.8	UU	74	2.0	2.68	0.2697	0.1572	0.7154	3.72	6.6x10 <sup>-9</sup>
	28.50	Very stiff to hard grey to bluish grey silty clay with occasional brown / yellow spots	18	18	-	-	-	-	-	-	-	-	-	-	UC	80	-	-	-	-	-	-	-
	30.00		17	17	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	60	-	-	-	-	-	-	-
	31.00		-	-	-	3.1	49.1	47.8	24.5	1.971	1.583	65.8	21.9	43.9	UU	94	1.5	2.69	0.2570	0.1513	0.6992	-	5.1x10 <sup>-9</sup>
	31.50		21	21	-	-	-	-	-	-	-	-	-	-	UC	100	-	-	-	-	-	-	-
	33.00	24	24	0.8	1.9	49.6	47.7	-	-	-	58.0	17.8	40.2	-	-	-	-	-	-	-	-	-	-
	34.50	35	35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	36.00	36	36	-	2.6	47.5	49.9	-	-	-	61.8	21.3	40.5	-	-	-	2.70	-	-	-	-	-	-
	37.50	42	42	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	39.00	24	24	-	5.5	74.3	20.2	-	-	-	44.0	21.4	22.6	-	-	-	-	-	-	-	-	-	-
	40.50	40.50m	#175	57	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	42.00	Dense / very dense brownish yellow medium to fine sand	#214	66	-	95.3	*4.7	19.2	\$2.056	1.725	-	-	-	DS <sub>R</sub>	0	36.5	-	-	-	-	-	-	-
	43.50		#166	52	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	# Extrapolated N Values for N>100				*Combined percentage of silt & clay							\$ Remoulded density											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/7-3					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-7	45.00	Dense / very dense brownish yellow medium to fine sand	#172	52	-	95.8	*4.2		17.9	\$2.064	1.751	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	-	
	46.50		#163	49	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	48.00		#150	45	-	96.5	*3.5		17.1	\$2.044	1.746	-	-	-	-	DS <sub>R</sub>	0	37.5	-	-	-	-	-	-
	50.00		#168	48	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	# Extrapolated N Values for N>100							*Combined percentage of silt & clay				\$ Remoulded density												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/7-4					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-8	1.00	Fill consisting of yellowish brown silty sand with stone / brick pieces etc. 0.90m	-	-	-	0.6	73.7	25.7	27.4	1.851	1.453	45.3	20.3	25.0	UU	29	3.0	2.67	0.3326	0.1810	0.8377	3.08	$1.7 \times 10^{-7}$
	1.50	Firm grey silty clay; medium dense grey silty fine sand with traces of clay observed from 2.5m to 4.0m depth	6	6	-	-	-	-	-	-	-	-	-	-	UC	31	-	-	-	-	-	-	-
	2.50		-	-	0.9	52.1	41.0	6.0	29.8	1.834	1.413	-	-	-	DS	15	31.0	2.65	-	-	-	0.76	$3.6 \times 10^{-5}$
	3.00		12	15	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	4.00	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.0m depth	-	-	-	2.1	59.9	38.0	34.8	1.825	1.354	63.4	22.0	41.4	UU	22	1.5	2.68	0.3209	0.1621	0.9795	2.94	$4.3 \times 10^{-8}$
	4.50		4	4	-	-	-	-	-	-	-	-	-	-	UC	24	-	-	-	-	-	-	-
	5.50		-	-	-	1.1	72.7	26.2	45.4	1.644	1.131	61.7	26.0	35.7	UC <sub>R</sub>	16	-	-	-	-	-	-	-
	6.00		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	7.00		-	-	-	0.8	58.0	41.2	50.8	1.605	1.064	70.6	26.6	44.0	UU	13	1.5	2.59	0.6197	0.2547	1.4335	0.36	$5.1 \times 10^{-8}$
	7.50		2	2	-	-	-	-	-	-	-	-	-	-	UC	15	-	-	-	-	-	-	-
	8.50		-	-	-	0.5	69.0	30.5	43.2	1.664	1.162	52.2	24.0	28.2	UC <sub>R</sub>	10	-	-	-	-	-	-	-
															UU	14	2.5	2.60	0.4158	0.1859	1.2375	0.35	$2.9 \times 10^{-7}$
															UC	19	-						
															UC <sub>R</sub>	13	-						

\*Combined percentage of silt & clay

**Abbreviations used :** (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC<sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS<sub>R</sub> = Direct Shear Test on Remoulded sample

Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock

**JOB NO.:**  
CCPL/20101211

**TABLE NO.:**  
C/8-1



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-8	9.00	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed at 13.0m depth	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	10.00		-	-	-	0.9	68.1	31.0	47.0	1.635	1.112	59.8	24.3	35.5	UU UC UC <sub>R</sub>	16 18 13	1.5 -	2.60	0.4617	0.1975	1.3376	0.36	1.6x10 <sup>-7</sup>
	10.50		2	2	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	12.00		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	13.00	15.00m	-	-	-	4.8	63.2	32.0	110.8	1.311	0.622	134.9 **67.5	64.6 37.1	70.3 30.4	UU UC UC <sub>R</sub>	20 24 11	3.0 -	2.56	1.6902	0.4106	3.1163	2.89	4.3x10 <sup>-7</sup>
	13.50		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	15.00		10	10	-	3.5	49.4	47.1	-	-	-	64.9	22.4	42.5	-	-	-	-	-	-	-	-	-
	16.00		-	-	8.9	8.4	40.9	41.8	26.2	1.935	1.533	60.7	20.5	40.2	UU UC UC <sub>R</sub>	56 60 51	2.0 -	2.69	0.2948	0.1680	0.7544	3.50	2.1x10 <sup>-8</sup>
	16.50	22.50m	10	10	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	18.00		11	11	-	0.5	71.4	28.1	-	-	-	49.7	23.0	26.7	-	-	-	-	-	-	-	-	-
	19.50		16	16	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	21.00		15	15	-	2.6	70.9	26.5	-	-	-	51.6	21.9	29.7	-	-	-	-	-	-	-	-	-
	22.50		42	24	0.5	24.1	66.5	8.9	-	-	-	31.7	23.8	7.9	-	-	-	2.66	-	-	-	-	-
	24.00	Medium dense yellowish grey sandy clayey silt to sandy silt with traces of clay	47	25	-	34.6	61.0	4.4	-	-	-	-	-	-	-	-	-	-	-	-	-	0.51	-
					*Combined percentage of silt & clay							**LL & PL conducted on oven dried sample											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/8-2				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-8	25.50	25.50m	30	19	-	64.0	*36.0		25.1	\$1.911	1.528	-	-	-	DS <sub>R</sub>	10	32.5	-	-	-	-	0.66	-	
	27.00	Medium dense to dense yellowish grey silty sand	98	43	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	28.00		28.00m	-	-	-	0.8	56.2	43.0	25.7	1.958	1.558	62.6	21.3	41.3	UU	80	1.5	2.69	0.2797	0.1619	0.7269	3.79	6.1x10 <sup>-9</sup>
	28.50		Very stiff to hard bluish grey silty clay with yellow spots	19	19	-	-	-	-	-	-	-	-	-	-	-	UC	86	-	-	-	-	-	-
	30.00			21	21	-	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	72	-	-	-	-	-	-
	31.00			-	-	-	5.9	50.1	44.0	25.1	1.965	1.571	56.9	20.1	36.8	UU	89	2.5	2.68	0.2662	0.1560	0.7062	-	7.0x10 <sup>-9</sup>
	31.50			31	31	-	-	-	-	-	-	-	-	-	-	-	UC <sub>R</sub>	81	-	-	-	-	-	-
	33.00			27	27	-	1.5	47.3	51.2	-	-	-	63.9	21.3	42.6	-	-	-	-	-	-	-	-	-
	34.50			30	30	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	36.00			41	41	-	1.7	52.5	45.8	-	-	-	61.3	21.1	40.2	-	-	-	-	-	-	-	-	-
	37.50			38	38	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	39.00			49	49	-	9.5	61.8	28.7	-	-	-	45.0	21.5	23.5	-	-	-	-	-	-	-	-	-
	40.50			39.30m	84	31	-	71.3	*28.7	22.5	\$2.012	1.642	-	-	-	DS <sub>R</sub>	11	36.0	-	-	-	-	-	-
	42.00			#144	47	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	43.50			#170	53	-	81.9	*18.1	17.5	\$2.070	1.762	-	-	-	-	DS <sub>R</sub>	0	38.0	-	-	-	-	-	-
	# Extrapolated N Values for N>100					*Combined percentage of silt & clay						\$ Remoulded density												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/8-3					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-8	45.00	Dense / very dense brownish yellow silty sand	107	35	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	46.50		#150	46	3.1	82.8	*14.1	16.4	\$2.059	1.769	-	-	-	DS <sub>R</sub>	0	37.5	-	-	-	-	-	-	
	48.00		#136	41	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	50.00		#144	42	0.9	86.6	*12.5	17.0	\$2.047	1.750	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	-	
# Extrapolated N Values for N>100			*Combined percentage of silt & clay																				
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/8-4					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-10	1.50	Fill consisting of grey silty sand with stone / brick pieces etc.	-	-	0.2	2.0	65.8	32.0	34.1	1.801	1.343	50.3	22.1	28.2	UU	16	2.0	2.68	0.3056	0.1531	0.9955	0.43	$4.0 \times 10^{-8}$	
	2.00	Soft / firm grey silty clay; loose grey silty fine sand observed at 3.0m depth	3	3	-	-	-	-	-	-	-	-	-	-	UC	17	-	-	-	-	-	-	-	
	3.00		-	-	-	58.9	37.4	3.7	32.4	1.770	1.337	-	-	-	DS	10	28.5	2.65	-	-	-	0.64	$4.1 \times 10^{-5}$	
	3.50		6	6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	4.50		-	-	-	1.3	74.9	23.8	29.8	1.867	1.438	43.8	20.2	23.6	UU	26	2.0	2.67	0.3340	0.1799	0.8563	3.02	$5.5 \times 10^{-8}$	
	5.00	5	5	-	-	-	-	-	-	-	-	-	-	-	UC	28	-	-	-	-	-	-	-	
	6.00	-	-	-	2.4	77.6	20.0	32.4	1.844	1.393	43.5	22.7	20.8	UC	20	-	-	-	-	-	-	-	-	
	6.50	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed from 12.0m depth	4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	7.50		-	-	-	1.4	63.6	35.0	51.6	1.570	1.036	73.1	32.9	40.2	UU	24	2.5	2.67	0.3155	0.1646	0.9171	2.98	$1.7 \times 10^{-7}$	
	8.00		4	4	-	-	-	-	-	-	-	-	-	-	-	UC	27	-	-	-	-	-	-	-
	9.00		-	-	-	0.8	59.7	39.5	44.8	1.691	1.168	61.3	27.2	34.1	UC	18	-	2.58	0.5506	0.2492	1.2093	0.35	$1.8 \times 10^{-7}$	
						*Combined percentage of silt & clay																		
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/9-1					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-10	9.50	Soft / firm grey silty clay with varying percentage of decomposed wood; plenty of wood observed from 12.0m depth	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	10.50		-	-	0.1	1.5	58.0	40.4	64.5	1.510	0.918	87.0	36.2	50.8	UU	15	1.5	2.57	0.6438	0.2300	1.7998	0.39	$1.3 \times 10^{-7}$
	11.00		4	4	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	12.00		-	-	-	2.2	65.2	32.6	85.7	1.440	0.775	130.0 **67.8	66.6 37.2	63.4 30.6	UU UC UC <sub>R</sub>	25 27 12	1.5 - -	2.57	0.8891	0.2683	2.3142	3.00	$3.6 \times 10^{-7}$
	12.50		6	6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	13.50		-	-	-	1.2	48.1	50.7	88.5	1.456	0.772	127.1 **77.4	62.3 30.8	64.8 46.6	UU UC UC <sub>R</sub>	24 26 12	2.0 - -	2.57	1.1612	0.3490	2.3272	2.98	$4.9 \times 10^{-7}$
	14.00	14.00m	8	8	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	15.50	Stiff bluish grey silty clay with occasional traces of calcareous nodules	10	10	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	16.50		-	-	0.4	9.1	52.5	38.0	26.2	1.930	1.529	53.1	18.5	34.6	UU UC UC <sub>R</sub>	48 52 40	1.5 - -	2.69	0.3121	0.1774	0.7590	3.39	$2.2 \times 10^{-8}$
	17.00		16	16	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	18.50	19.50m	13	13	-	1.0	74.0	25.0	-	-	-	43.3	21.1	22.2	-	-	-	-	-	-	-	-	-
	19.50		-	-	-	4.0	81.0	15.0	21.5	2.018	1.661	31.8	18.8	13.0	UU UC UC <sub>R</sub>	102 108 72	4.0 - -	2.67	0.1949	0.1212	0.6075	4.02	$4.2 \times 10^{-7}$
	20.00		31	31	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	21.50	Very stiff / hard yellowish grey silty clay with high silt content to medium dense yellowish grey clayey sandy silt	31	20	1.3	40.2	52.0	6.5	-	-	-	-	-	-	-	-	-	-	-	-	-	0.76	-
					*Combined percentage of silt & clay						**LL & PL conducted on oven dried sample												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/9-2				





Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-10	23.00	22.00m Medium dense yellowish grey silty sand	35	21	1.1	69.6	*29.3		24.7	\$1.925	1.544	-	-	-	DS <sub>R</sub>	8	33.0	2.65	-	-	-	0.90	-
	24.50		40	22	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	26.00		37	21	-	73.0	*27.0		24.0	\$1.932	1.558	-	-	-	DS <sub>R</sub>	5	33.5	-	-	-	-	0.76	-
	27.00	27.00m Very stiff to hard bluish grey to yellowish brown silty clay to sandy silty clay	-	-	-	0.4	64.6	35.0	26.4	1.964	1.554	51.2	20.5	30.7	UU UC UC <sub>R</sub>	76 84 63	2.0 - -	2.69	0.2784	0.1608	0.7312	3.74	3.5x10 <sup>-8</sup>
	27.50		19	19	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	29.00		27	27	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	30.00		-	-	-	11.8	64.7	23.5	23.6	2.006	1.623	41.1	19.1	22.0	UU UC UC <sub>R</sub>	102 114 71	3.0 - -	2.68	0.2161	0.1309	0.6513	4.02	6.0x10 <sup>-8</sup>
	30.50		41	41	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	32.00		35	35	-	1.3	58.7	40.0	-	-	-	56.9	18.5	38.4	-	-	-	-	-	-	-	-	-
	33.50		38	38	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	35.00		35	35	-	9.4	67.6	23.0	-	-	-	40.0	18.1	21.9	-	-	-	-	-	-	-	-	-
	36.50		51	51	-	41.7	42.0	16.3	-	-	-	36.2	17.6	18.6	-	-	-	-	-	-	-	-	-
	38.00		83	83	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	39.50		41	41	0.1	19.6	57.0	23.3	-	-	-	-	42.8	17.5	25.3	-	-	-	-	-	-	-	-
					*Combined percentage of silt & clay				\$ Remoulded density														
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/9-3				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-10	41.00	Very stiff to hard bluish grey to yellowish brown silty clay to sandy silty clay	44	44	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	42.50		45	45	-	38.5	42.5	19.0	-	-	-	37.1	19.7	17.4	-	-	-	-	-	-	-	-	-
	44.00		41	41	-	35.5	46.0	18.5	-	-	-	36.6	20.0	16.6	-	-	-	-	-	-	-	-	-
	45.50	45.00m Dense / very dense brownish yellow to yellowish grey silty sand	#410	112	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	47.00	#189	54	-	86.0	*14.0	18.4	\$2.073	1.751	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	-	-	-
	48.50	#237	65	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	50.00	#192	53	0.1	87.8	*12.1	18.0	\$2.064	1.749	-	-	-	DS <sub>R</sub>	0	37.5	-	-	-	-	-	-	-	-
# Extrapolated N Values for N>100							*Combined percentage of silt & clay					\$ Remoulded density											
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/9-4					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)	
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$			
BH-11	1.00	Fill consisting of grey sand with stone / brick pieces etc. — 0.80m —	-	-	0.3	30.5	57.4	11.8	28.3	1.827	1.424	33.9	21.9	12.0	UU	18	3.5	2.67	0.2261	0.1206	0.8750	0.71	6.1x10 <sup>-7</sup>	
	1.50	Soft grey sandy silty clay; very loose to loose grey clayey sandy silt to silty fine sand observed from 4.5m depth	4	4	-	-	-	-	-	-	-	-	-	-	UC	20	-	-	-	-	-	-	-	
	2.50		-	-	1.4	27.5	56.1	15.0	31.2	1.814	1.383	34.6	22.6	12.0	UC <sub>R</sub>	14	-	-	-	-	-	-	7.8x10 <sup>-7</sup>	
	3.00		2	2	-	-	-	-	-	-	-	-	-	-	-	UU	16	3.0	2.66	0.2300	0.1195	0.9239	0.81	
	4.00		-	-	0.5	29.7	55.0	14.8	31.6	1.805	1.372	34.9	23.4	11.5	-	UC	15	-	-	-	-	-	-	2.1x10 <sup>-6</sup>
	4.50		2	2	1.7	45.0	44.2	9.1	-	-	-	-	-	-	-	UC <sub>R</sub>	8	-	-	-	-	-	0.95	-
	6.00	6	7	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	7.00	-	-	-	53.5	42.0	4.5	31.9	1.760	1.334	-	-	-	-	DS	10	26.0	2.65	-	-	-	0.63	5.0x10 <sup>-5</sup>	
	7.50	— 7.50m —	3	3	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	8.50	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood	-	-	-	1.1	75.9	23.0	43.1	1.705	1.191	52.2	26.4	25.8	UU	23	3.0	2.60	0.4129	0.1892	1.1822	2.96	3.1x10 <sup>-7</sup>	
					*Combined percentage of silt & clay																			
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																								
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/10-1					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-11	9.00	Soft / firm grey silty clay / clayey silt with varying percentage of decomposed wood	5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	10.00		-	-	-	1.1	63.0	35.9	60.3	1.526	0.952	74.0	34.7	39.3	UU UC UC <sub>R</sub>	15 18 10	1.5 - -	2.59	0.6042	0.2221	1.7207	0.36	1.6x10 <sup>-7</sup>
	10.50		6	6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	11.50		-	-	-	0.6	74.6	24.8	45.6	1.699	1.167	55.6	30.2	25.4	UU UC UC <sub>R</sub>	22 25 12	2.0 - -	2.58	0.4498	0.2034	1.2110	2.94	4.2x10 <sup>-7</sup>
	12.00		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	13.50		5	5	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	14.50	14.50m	-	-	0.4	3.4	51.2	45.0	29.6	1.897	1.464	68.2	20.5	47.7	UU UC UC <sub>R</sub>	38 42 31	2.0 - -	2.68	0.3032	0.1656	0.8309	3.23	2.1x10 <sup>-8</sup>
	15.00	Stiff bluish grey silty clay with occasional traces of calcareous nodules	8	8	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	16.50		13	13	8.3	7.2	38.8	45.7	-	-	-	65.0	20.0	45.0	-	-	-	-	-	-	-	-	-
	17.50		-	-	-	0.5	67.5	32.0	27.7	1.930	1.511	50.0	20.4	29.6	UU UC UC <sub>R</sub>	56 63 40	3.0 - -	2.68	0.2872	0.1620	0.7732	3.50	2.6x10 <sup>-8</sup>
	18.00		17	17	-	8.0	79.0	13.0	-	-	-	31.8	20.3	11.5	-	-	-	-	-	-	-	-	-
	19.50		17	14	-	29.2	64.2	6.6	-	-	-	28.7	22.3	6.4	-	-	-	-	-	-	-	-	-
	21.00	Very stiff greyish yellow silty clay with high silt content to medium dense clayey sandy silt	36	22	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
*Combined percentage of silt & clay																							
<b>Abbreviations used :</b> (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																JOB NO.: CCPL/20101211		TABLE NO.: C/10-2					



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-11	22.50	22.50m	57	30	0.9	51.2	43.9	4.0	20.8	\$2.011	1.665	-	-	-	DS <sub>R</sub>	15	34.5	-	-	-	-	0.74	-
	24.00	Medium dense / dense greyish yellow silty sand	39	22	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	25.50		61	30	-	67.9	*32.1	-	19.2	\$2.031	1.704	-	-	-	DS <sub>R</sub>	11	35.0	-	-	-	-	0.73	-
	27.00	27.00m	13	13	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	28.00	Stiff to very stiff / hard bluish grey to brownish yellow silty clay to sandy silty clay	-	-	-	1.4	50.0	48.6	26.6	1.936	1.529	68.2	20.7	47.5	UU UC UC <sub>R</sub>	56 61 46	1.5 - -	2.68	0.2619	0.1495	0.7525	3.50	1.7x10 <sup>-8</sup>
	28.50		19	19	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	30.00		21	21	-	2.8	56.1	41.1	-	-	-	57.7	19.4	38.3	-	-	-	-	-	-	-	-	-
	31.00		-	-	-	1.0	59.8	39.2	24.7	1.967	1.577	55.0	19.0	36.0	UU UC UC <sub>R</sub>	91 95 73	2.0 - -	2.69	0.2508	0.1471	0.7054	-	7.1x10 <sup>-9</sup>
	31.50		20	20	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	33.00		32	32	-	1.9	61.1	37.0	-	-	-	53.1	18.4	34.7	-	-	-	-	-	-	-	-	-
	34.50		33	33	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	36.00		33	33	-	2.7	67.3	30.0	-	-	-	45.4	18.3	27.1	-	-	-	-	-	-	-	-	-
	37.50		40	40	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	39.00		44	44	0.3	44.6	38.3	16.8	-	-	-	37.3	18.7	18.6	-	-	-	-	-	-	-	-	-
	40.50	#535	535	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	# Extrapolated N Values for N>100					*Combined percentage of silt & clay							\$ Remoulded density										
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/10-3				



Bore Hole Number	Depth below G.L. in 'm'	Description	Standard Penetration Resistance 'N' Value	Corrected 'N' Value	Grain Size Analysis				Density and Moisture Test			Atterberg Limits			Shear Strength Parameters			Specific Gravity $G_s$	Consolidation Characteristics			Silt Factor	Permeability (cm/sec)
					Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Natural Moisture Content (%)	Bulk Density (gms/cc)	Dry Density (gms/cc)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Type of Test	C (kPa)	$\phi$ (degrees)		$C_c$	$\frac{C_c}{1+e_0}$	Void Ratio, $e_0$		
BH-11	42.00	Stiff to very stiff / hard bluish grey to brownish yellow silty clay to sandy silty clay	85	85	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	43.50		104	104	-	24.0	52.0	24.0	-	-	-	43.5	20.9	22.6	-	-	-	-	-	-	-	-	
	45.00	45.00m	#160	49	1.8	80.9	*17.3		20.6	\$2.060	1.708	-	-	-	DS <sub>R</sub>	0	37.0	-	-	-	-	-	
	46.50	Dense / very dense brownish yellow silty sand	#525	140	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	48.00		108	34	1.2	76.2	*22.6		20.3	\$2.031	1.688	-	-	-	DS <sub>R</sub>	8	36.5	-	-	-	-	-	
	50.00		#200	55	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
# Extrapolated N Values for N>100							*Combined percentage of silt & clay				\$ Remoulded density												
Abbreviations used : (i) UU = Unconsolidated Undrained Triaxial Test (ii) UC = Unconfined Compressive Strength (iii) DS = Direct Shear test (iv) UC <sub>R</sub> = Unconfined Compressive Strength on Remoulded sample (v) DS <sub>R</sub> = Direct Shear Test on Remoulded sample																							
Bore hole data and Laboratory test results for the upgradation of Berth No.7, NSD, N.S.Dock																	JOB NO.: CCPL/20101211		TABLE NO.: C/10-4				



Bore Hole No.	Depth (m)	Description	Standard Proctor Test (Light Compaction)		Modified Proctor Test (Heavy Compaction)	
			Maximum Dry Density (gms/cc)	O.M.C. (%)	Maximum Dry Density (gms/cc)	O.M.C. (%)
BH-5	1.00	Grey silty clay	1.664	19.5	1.850	14.0
BH-5	2.50	Yellowish grey fine sand	1.690	15.5	1.810	12.0
BH-6	3.00	Grey sandy silt / silty sand	1.751	16.0	1.872	12.4
BH-7	2.50	Grey silty clay	1.650	20.0	1.838	14.4
BH-8	1.00	Grey silty clay	1.700	18.4	1.870	13.4
BH-8	2.50	Grey silty fine sand with traces of clay	1.736	15.7	1.845	12.2
BH-10	1.50	Grey silty clay	1.680	19.0	1.860	13.6
BH-10	3.00	Grey silty fine sand with traces of clay	1.740	14.6	1.858	11.0
BH-11	1.00	Grey sandy silty clay	1.726	17.7	1.907	12.4
BH-11	2.50	Grey sandy silty clay	1.720	18.1	1.900	13.0
Laboratory Test Results of Disturbed samples					TABLE NO.: C/11	

Bore Hole No.	Depth (m)	pH	Total Soluble Sulphate (%)	Calcium Carbonate (%)
BH-1	2.00	7.22 (at 22°C)	0.0004	0.80
BH-1	3.50	6.77 (at 22°C)	0.001	0.17
BH-1	5.00	7.01 (at 22°C)	0.036	0.71
BH-1	6.50	6.89 (at 22°C)	0.118	0.18
BH-1	8.00	7.36 (at 22°C)	0.023	0.85
BH-1	9.50	7.10 (at 22°C)	0.058	0.47
BH-1	11.00	7.56 (at 22°C)	0.002	0.91
BH-1	14.00	7.75 (at 22°C)	0.001	1.00
BH-1	17.00	7.40 (at 22°C)	0.001	0.85
BH-1	19.00	7.86 (at 22°C)	0.002	3.60
BH-1	26.00	7.77 (at 22°C)	0.002	2.50
BH-1	29.00	7.83 (at 22°C)	0.002	3.50
BH-2	0.00	6.90 (at 22°C)	0.006	0.21
BH-2	3.00	7.02 (at 22°C)	0.002	0.54
BH-2	6.00	6.86 (at 22°C)	0.018	0.25
BH-2	9.00	7.26 (at 22°C)	0.007	0.83
BH-2	12.00	8.05 (at 22°C)	0.002	8.02
BH-2	15.00	7.08 (at 22°C)	0.002	0.29
BH-2	18.50	7.70 (at 22°C)	0.003	0.89
BH-2	25.50	7.22 (at 22°C)	0.005	0.72
BH-2	27.00	7.98 (at 22°C)	0.006	3.00
BH-2	30.00	7.47 (at 22°C)	0.002	0.58
BH-2	35.00	7.26 (at 22°C)	0.003	0.41
BH-2	41.00	7.28 (at 22°C)	0.003	0.32
<b>Laboratory Test Results of Chemical Analysis of Soil Samples</b>			<b>JOB NO.:</b> CCPL/20101211	<b>TABLE NO.:</b> C/12-1





Bore Hole No.	Depth (m)	pH	Total Soluble Sulphate (%)	Calcium Carbonate (%)
BH-3	2.50	6.48 (at 22°C)	0.092	0.12
BH-3	4.00	7.22 (at 22°C)	0.004	0.70
BH-3	5.50	6.09 (at 22°C)	0.106	0.10
BH-3	7.00	6.65 (at 22°C)	0.034	0.14
BH-3	8.50	6.82 (at 22°C)	0.009	0.20
BH-3	10.00	7.06 (at 22°C)	0.009	0.41
BH-3	13.00	8.06 (at 22°C)	0.003	8.52
BH-3	16.00	7.56 (at 22°C)	0.003	0.90
BH-3	25.00	7.58 (at 22°C)	0.004	0.90
BH-3	28.00	7.87 (at 22°C)	0.005	2.90
BH-3	40.50	7.62 (at 22°C)	0.003	0.85
BH-3	45.00	7.43 (at 22°C)	0.003	0.80
BH-4	0.50	7.21 (at 22°C)	0.003	0.80
BH-4	2.00	7.07 (at 22°C)	0.002	0.45
BH-4	3.50	6.71 (at 22°C)	0.323	0.12
BH-4	5.00	6.82 (at 22°C)	0.034	0.15
BH-4	6.50	6.55 (at 22°C)	0.375	0.13
BH-4	8.00	6.97 (at 22°C)	0.006	0.18
BH-4	9.50	6.18 (at 22°C)	0.501	ND
BH-4	11.00	6.01 (at 22°C)	0.159	ND
BH-4	14.00	7.31 (at 22°C)	0.005	0.67
BH-4	17.00	7.23 (at 22°C)	0.008	0.64
BH-4	20.50	7.29 (at 22°C)	0.009	0.66
BH-4	26.00	7.00 (at 22°C)	0.004	0.61
<b>N.D = Not Detectable</b>				
<b>Laboratory Test Results of Chemical Analysis of Soil Samples</b>			<b>JOB NO.:</b> CCPL/20101211	<b>TABLE NO.:</b> C/12-2

Bore Hole No.	Depth (m)	pH	Total Soluble Sulphate (%)	Calcium Carbonate (%)
BH-5	1.00	7.91 (at 21°C)	0.029	3.08
BH-5	2.50	7.46 (at 21°C)	0.002	0.80
BH-5	4.00	7.29 (at 21°C)	0.002	0.50
BH-5	5.50	7.38 (at 21°C)	0.045	0.55
BH-5	7.00	7.07 (at 21°C)	0.117	0.38
BH-5	8.50	7.02 (at 21°C)	0.014	0.31
BH-5	10.00	6.90 (at 21°C)	0.004	0.17
BH-5	13.00	7.71 (at 21°C)	0.002	0.99
BH-5	16.00	7.73 (at 21°C)	0.001	0.89
BH-5	22.50	7.09 (at 21°C)	0.014	0.51
BH-5	29.50	7.22 (at 21°C)	0.001	0.60
BH-5	32.50	7.56 (at 21°C)	0.004	0.71
BH-6	3.00	7.42 (at 21°C)	0.002	0.99
BH-6	4.50	7.45 (at 21°C)	0.005	0.98
BH-6	6.00	7.37 (at 21°C)	0.001	0.85
BH-6	7.50	7.21 (at 21°C)	0.015	0.77
BH-6	9.00	6.43 (at 21°C)	0.133	0.11
BH-6	10.50	7.08 (at 21°C)	0.015	0.59
BH-6	13.50	6.69 (at 21°C)	0.261	0.13
BH-6	16.50	8.13 (at 21°C)	0.019	8.74
BH-6	21.50	7.74 (at 21°C)	0.004	1.00
BH-6	27.00	8.08 (at 21°C)	0.069	7.82
BH-6	30.00	7.68 (at 21°C)	0.009	0.90
BH-6	38.00	7.44 (at 21°C)	0.002	0.60
<b>Laboratory Test Results of Chemical Analysis of Soil Samples</b>			<b>JOB NO.:</b> CCPL/20101211	<b>TABLE NO.:</b> C/12-3

Bore Hole No.	Depth (m)	pH	Total Soluble Sulphate (%)	Calcium Carbonate (%)
BH-7	1.00	7.04 (at 21°C)	0.078	0.58
BH-7	2.50	7.32 (at 21°C)	0.062	0.72
BH-7	4.00	7.35 (at 21°C)	0.002	0.71
BH-7	5.50	6.25 (at 21°C)	0.171	ND
BH-7	7.00	6.51 (at 21°C)	0.047	0.11
BH-7	8.50	7.07 (at 21°C)	0.004	0.39
BH-7	10.00	7.41 (at 21°C)	0.011	0.49
BH-7	13.00	6.49 (at 21°C)	0.304	0.11
BH-7	16.00	7.93 (at 21°C)	0.004	2.10
BH-7	28.00	7.64 (at 21°C)	0.007	1.10
BH-7	31.00	7.50 (at 21°C)	0.004	1.00
BH-7	42.00	7.45 (at 21°C)	0.005	1.00
BH-8	1.00	7.01 (at 21°C)	0.009	0.48
BH-8	2.50	6.82 (at 21°C)	0.005	0.14
BH-8	4.00	6.81 (at 21°C)	0.021	0.14
BH-8	5.50	6.86 (at 21°C)	0.005	0.15
BH-8	7.00	6.88 (at 21°C)	0.006	0.14
BH-8	8.50	6.82 (at 21°C)	0.005	0.13
BH-8	10.00	6.78 (at 21°C)	0.020	0.11
BH-8	13.00	6.93 (at 21°C)	0.130	0.18
BH-8	16.00	8.04 (at 21°C)	0.004	8.51
BH-8	24.00	8.02 (at 21°C)	0.006	7.92
BH-8	28.00	7.86 (at 21°C)	0.005	3.88
BH-8	31.00	7.45 (at 21°C)	0.005	0.89
<b>N.D = Not Detectable</b>				
<b>Laboratory Test Results of Chemical Analysis of Soil Samples</b>			<b>JOB NO.:</b> CCPL/20101211	<b>TABLE NO.:</b> C/12-4

Bore Hole No.	Depth (m)	pH	Total Soluble Sulphate (%)	Calcium Carbonate (%)
BH-10	3.00	7.00 (at 21°C)	0.009	0.77
BH-10	4.50	7.44 (at 21°C)	0.008	0.85
BH-10	6.00	7.98 (at 21°C)	0.007	3.92
BH-10	7.50	7.88 (at 21°C)	0.018	3.52
BH-10	9.00	7.46 (at 21°C)	0.037	0.92
BH-10	10.50	6.98 (at 21°C)	0.149	0.13
BH-10	12.00	7.26 (at 21°C)	0.025	0.81
BH-10	13.50	6.45 (at 21°C)	0.144	0.11
BH-10	16.50	8.15 (at 21°C)	0.006	8.75
BH-10	19.50	8.09 (at 21°C)	0.008	8.55
BH-10	27.00	8.22 (at 21°C)	0.006	9.21
BH-10	30.00	7.68 (at 21°C)	0.007	1.00
BH-11	1.00	7.55 (at 21°C)	0.013	0.92
BH-11	2.50	7.46 (at 21°C)	0.009	0.49
BH-11	4.00	7.23 (at 21°C)	0.007	0.40
BH-11	7.00	7.20 (at 21°C)	0.007	0.32
BH-11	8.50	6.96 (at 21°C)	0.008	0.16
BH-11	10.00	6.10 (at 21°C)	0.111	ND
BH-11	11.50	6.56 (at 21°C)	0.070	0.11
BH-11	14.50	7.61 (at 21°C)	0.031	0.97
BH-11	17.50	7.63 (at 21°C)	0.011	0.95
BH-11	28.00	7.20 (at 21°C)	0.013	0.39
BH-11	33.00	7.05 (at 21°C)	0.009	0.25
BH-11	39.00	6.96 (at 21°C)	0.013	0.19
<b>N.D = Not Detectable</b>				
<b>Laboratory Test Results of Chemical Analysis of Soil Samples</b>			<b>JOB NO.:</b> CCPL/20101211	<b>TABLE NO.:</b> C/12-5

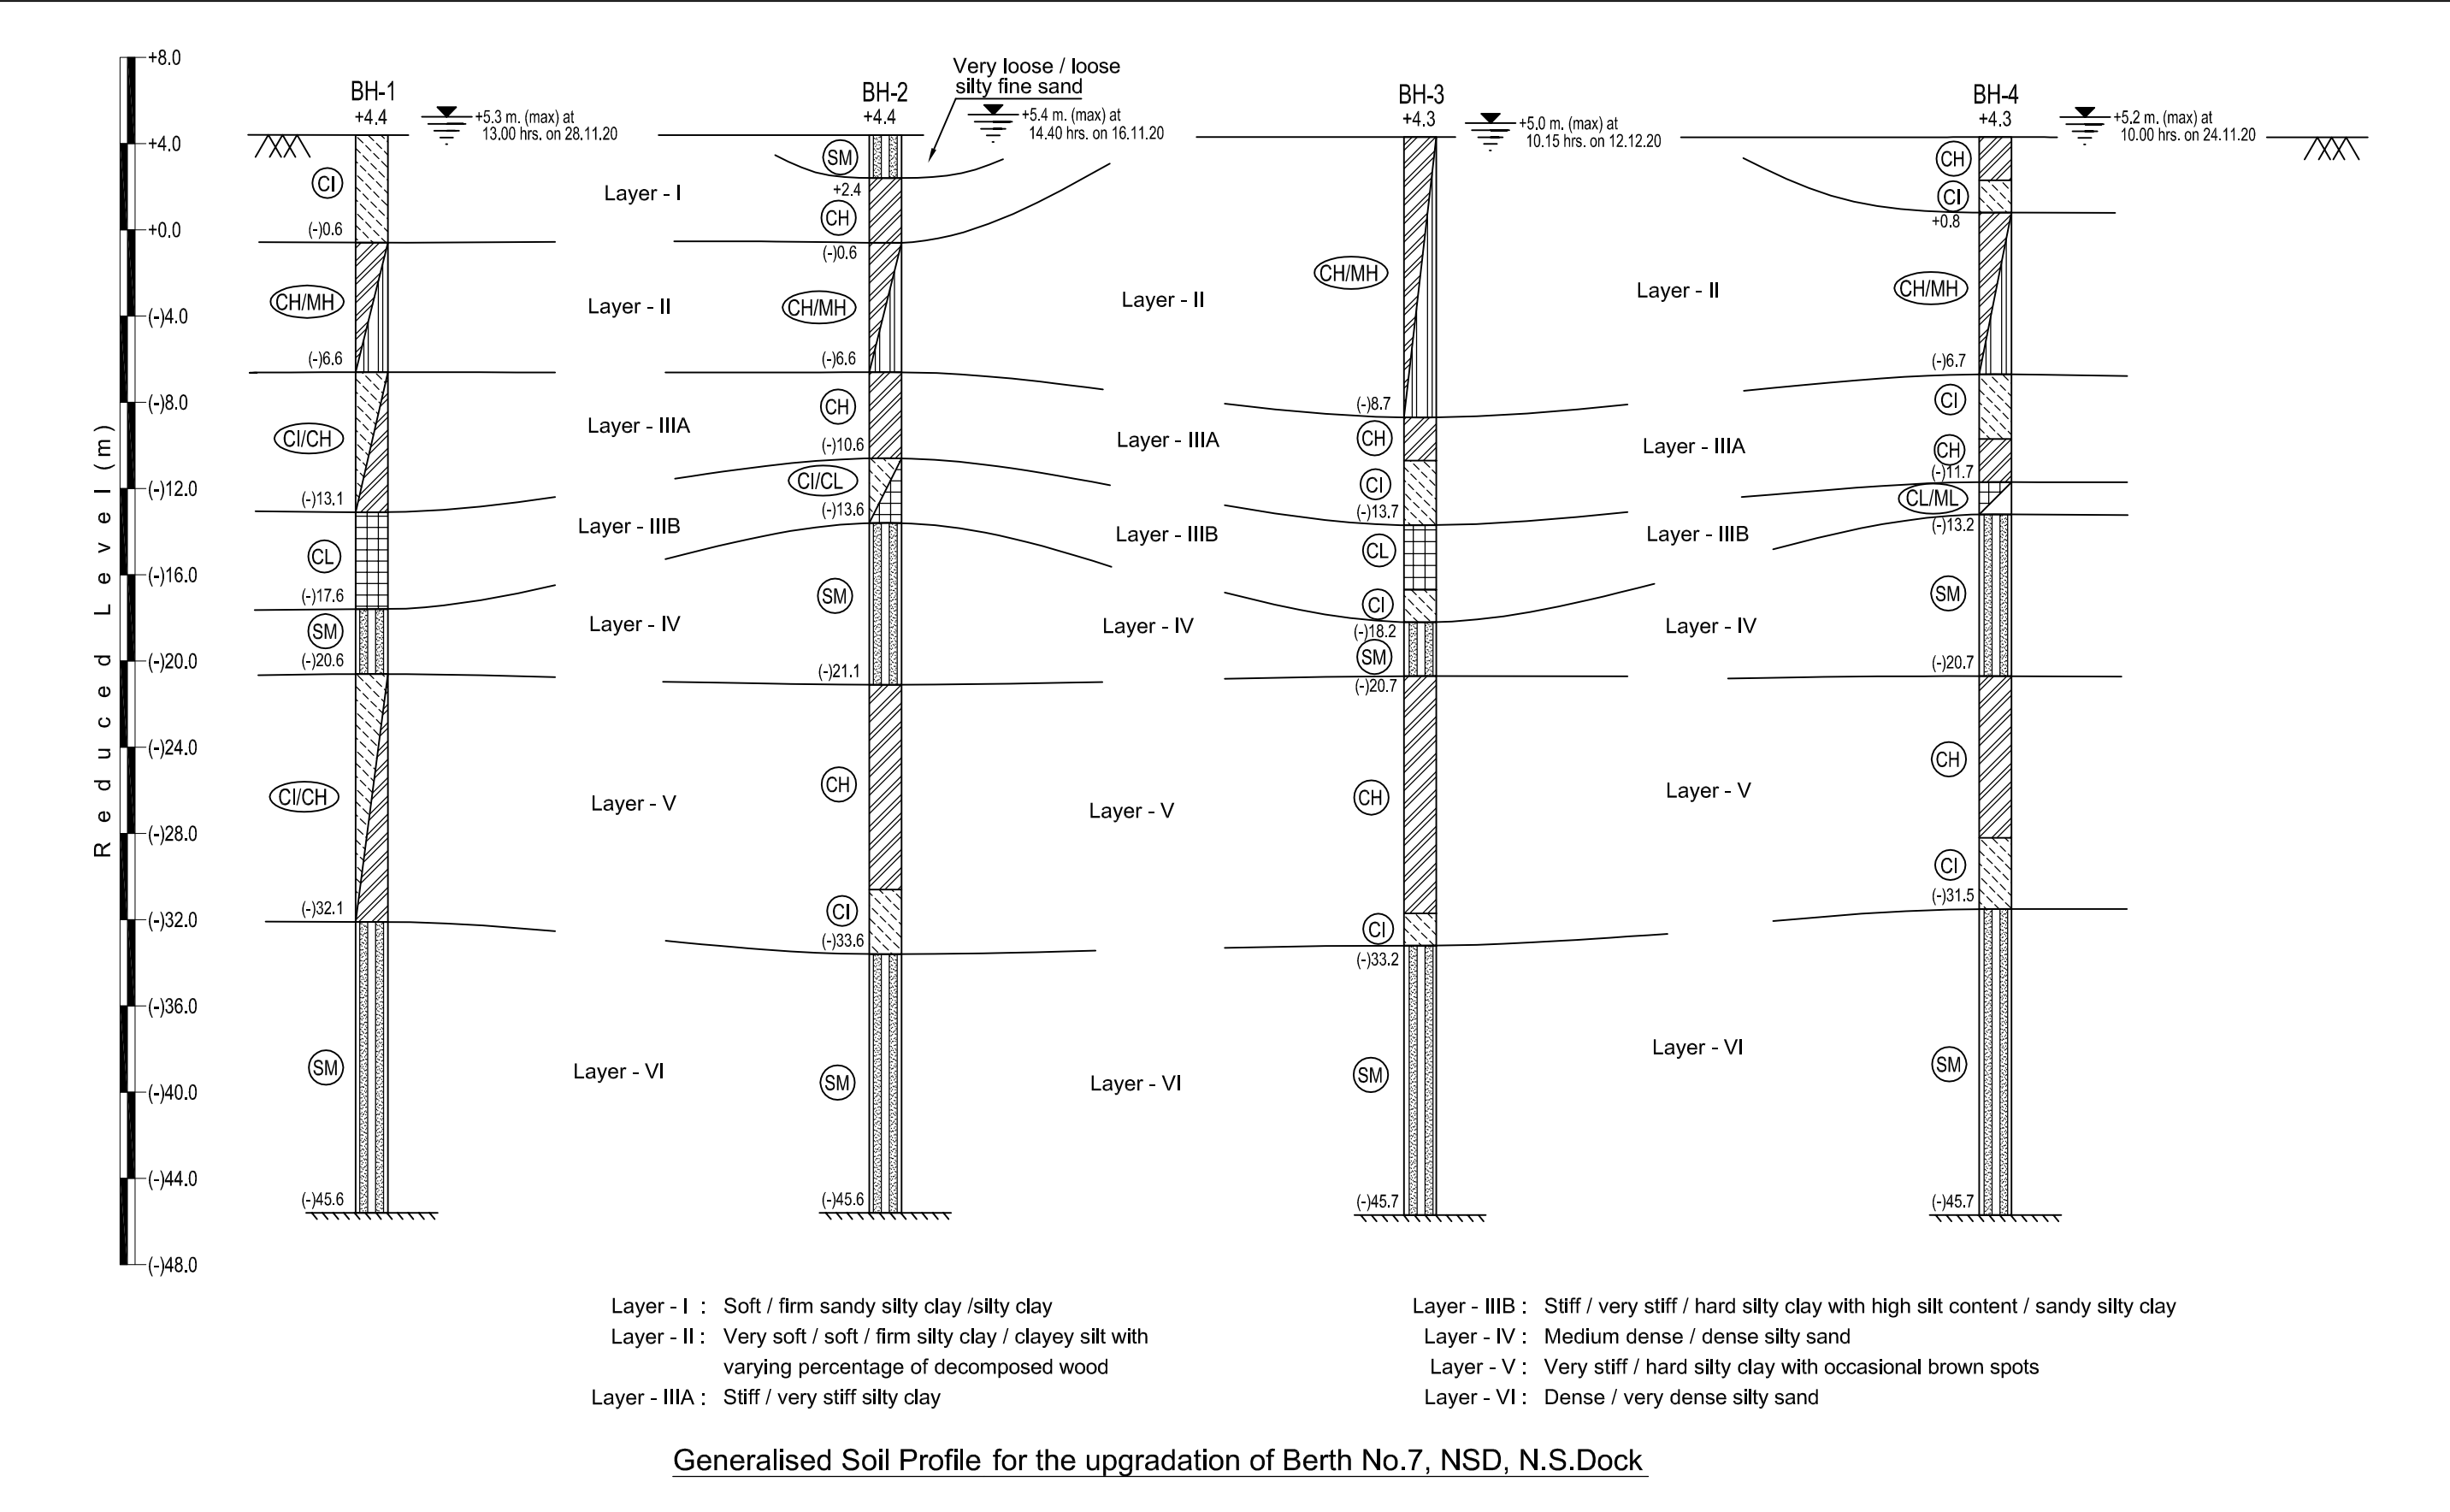

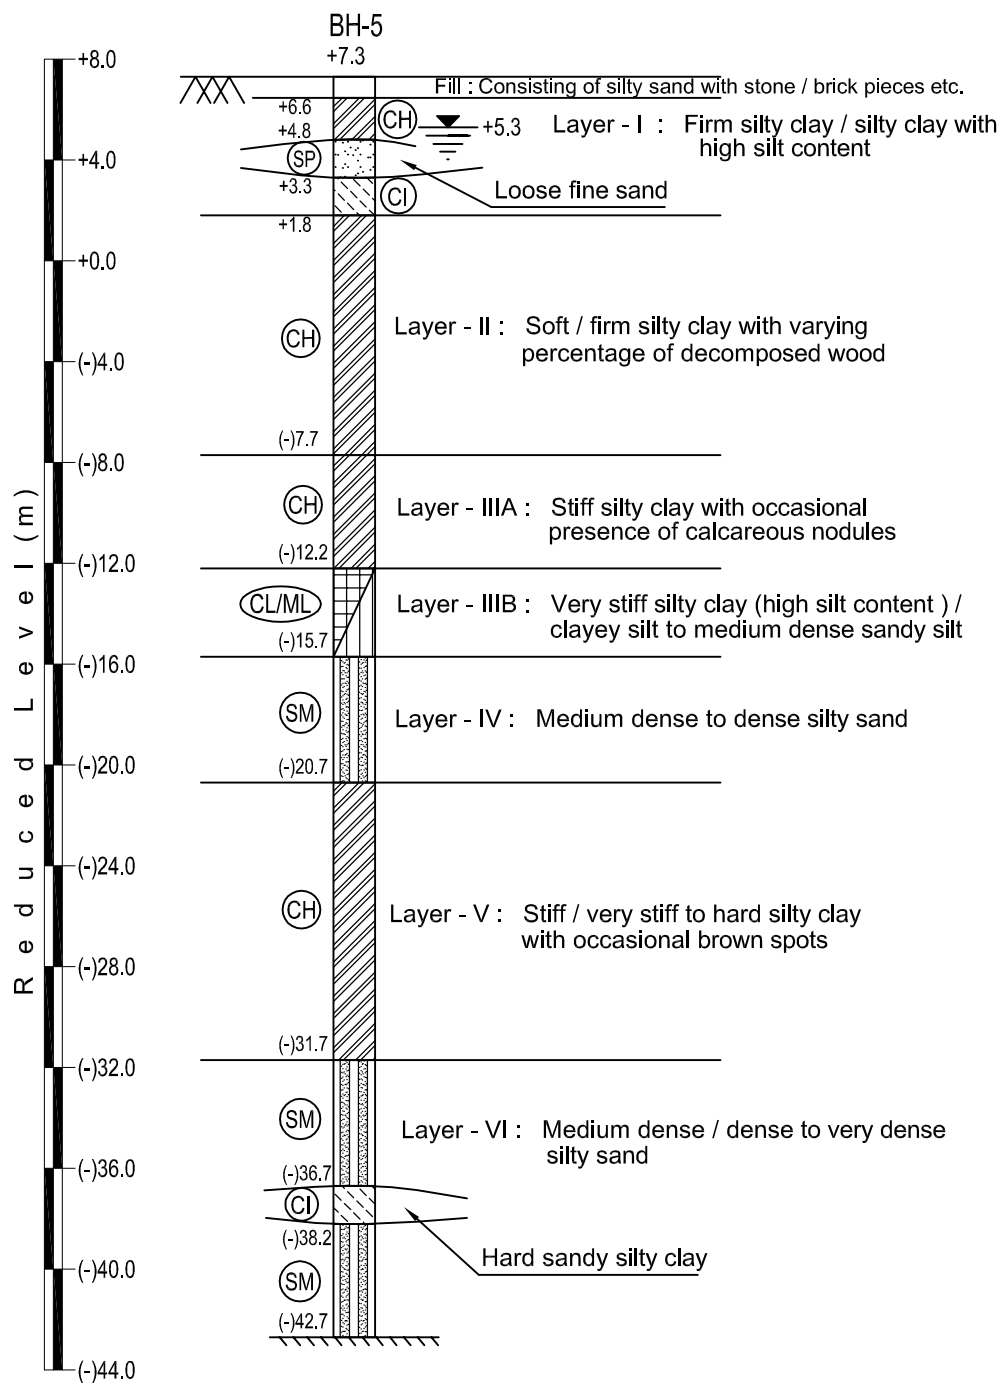


Generalised Soil Profile for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.:  
CCPL/20101211

Scale: 1:300

Figure No.: D/2

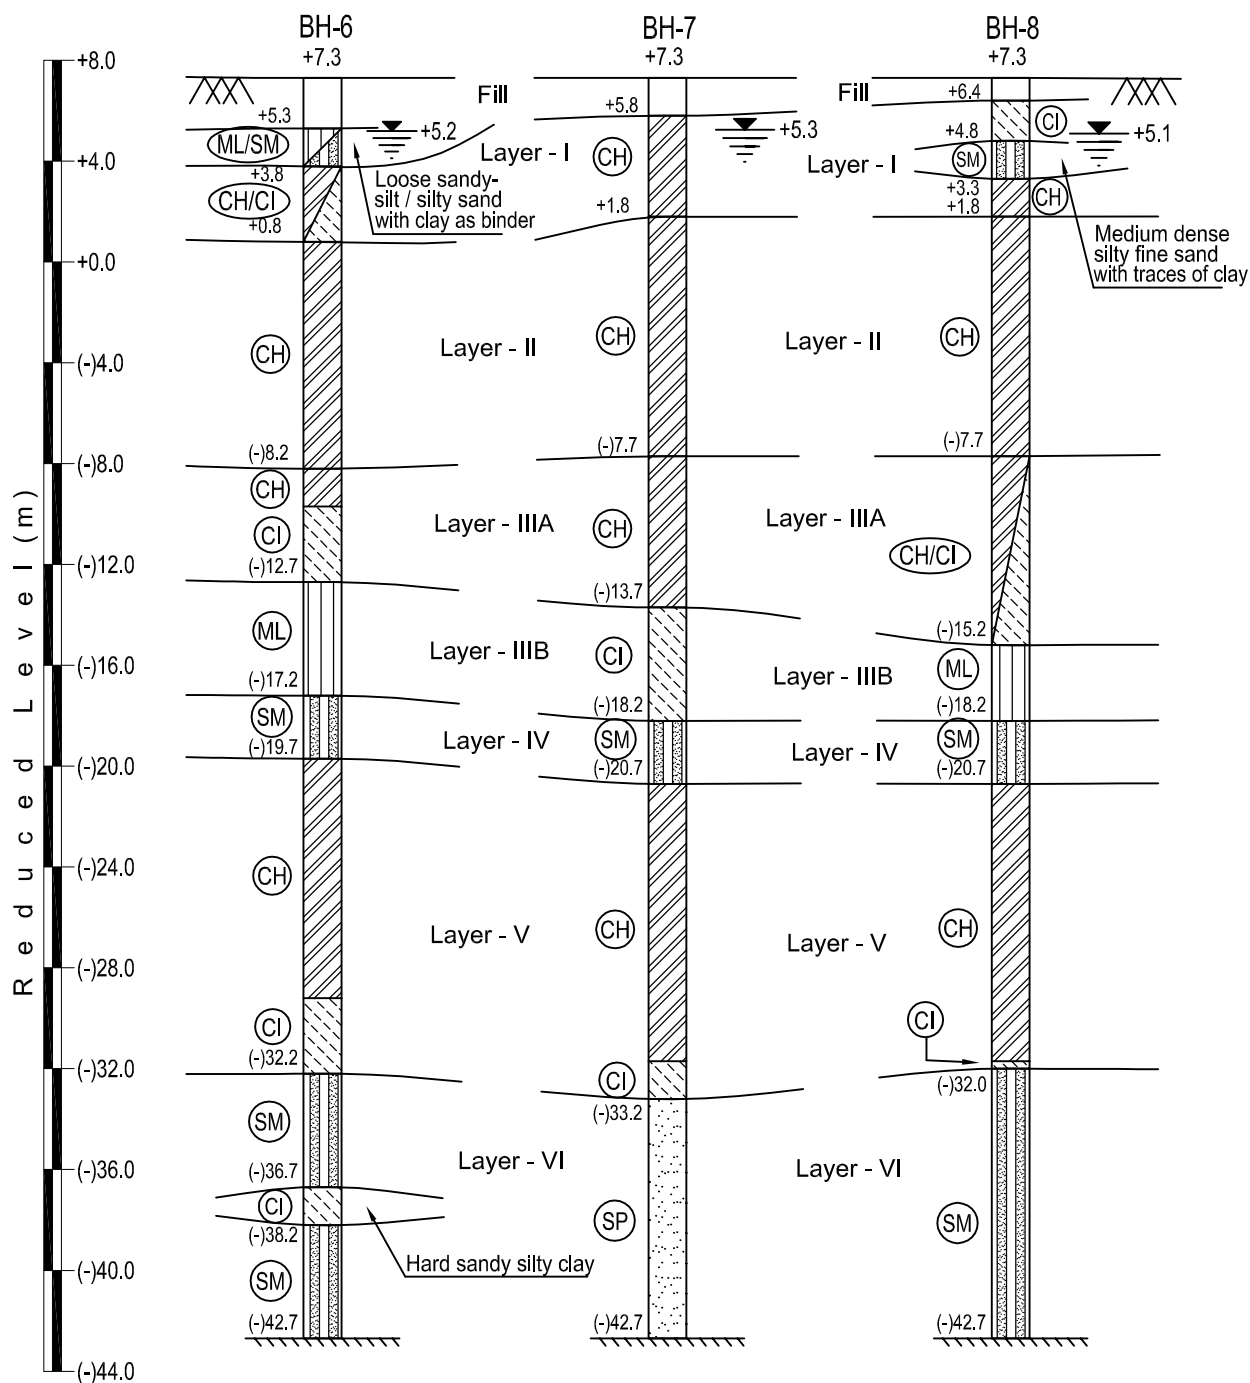


- Fill : Consisting of silty sand with stone / brick pieces etc.
- Layer - I : Soft / firm silty clay
- Layer - II : Soft / firm silty clay with varying percentage of decomposed wood
- Layer - IIIA : Stiff silty clay with occasional traces of calcareous nodules
- Layer - IIIB : Medium dense sandy silt with traces of clay / stiff / very stiff / hard silty clay with high silt content
- Layer - IV : Medium dense / dense / very dense silty sand
- Layer - V : Very stiff to hard silty clay with occasional yellow / brown spots
- Layer - VI : Dense / very dense silty sand / medium to fine sand

**Generalised Soil Profile for the upgradation of Berth No.7, NSD, N.S.Dock**

Job No.:  
CCPL/20101211

Scale: 1:300

Figure No.: D/3

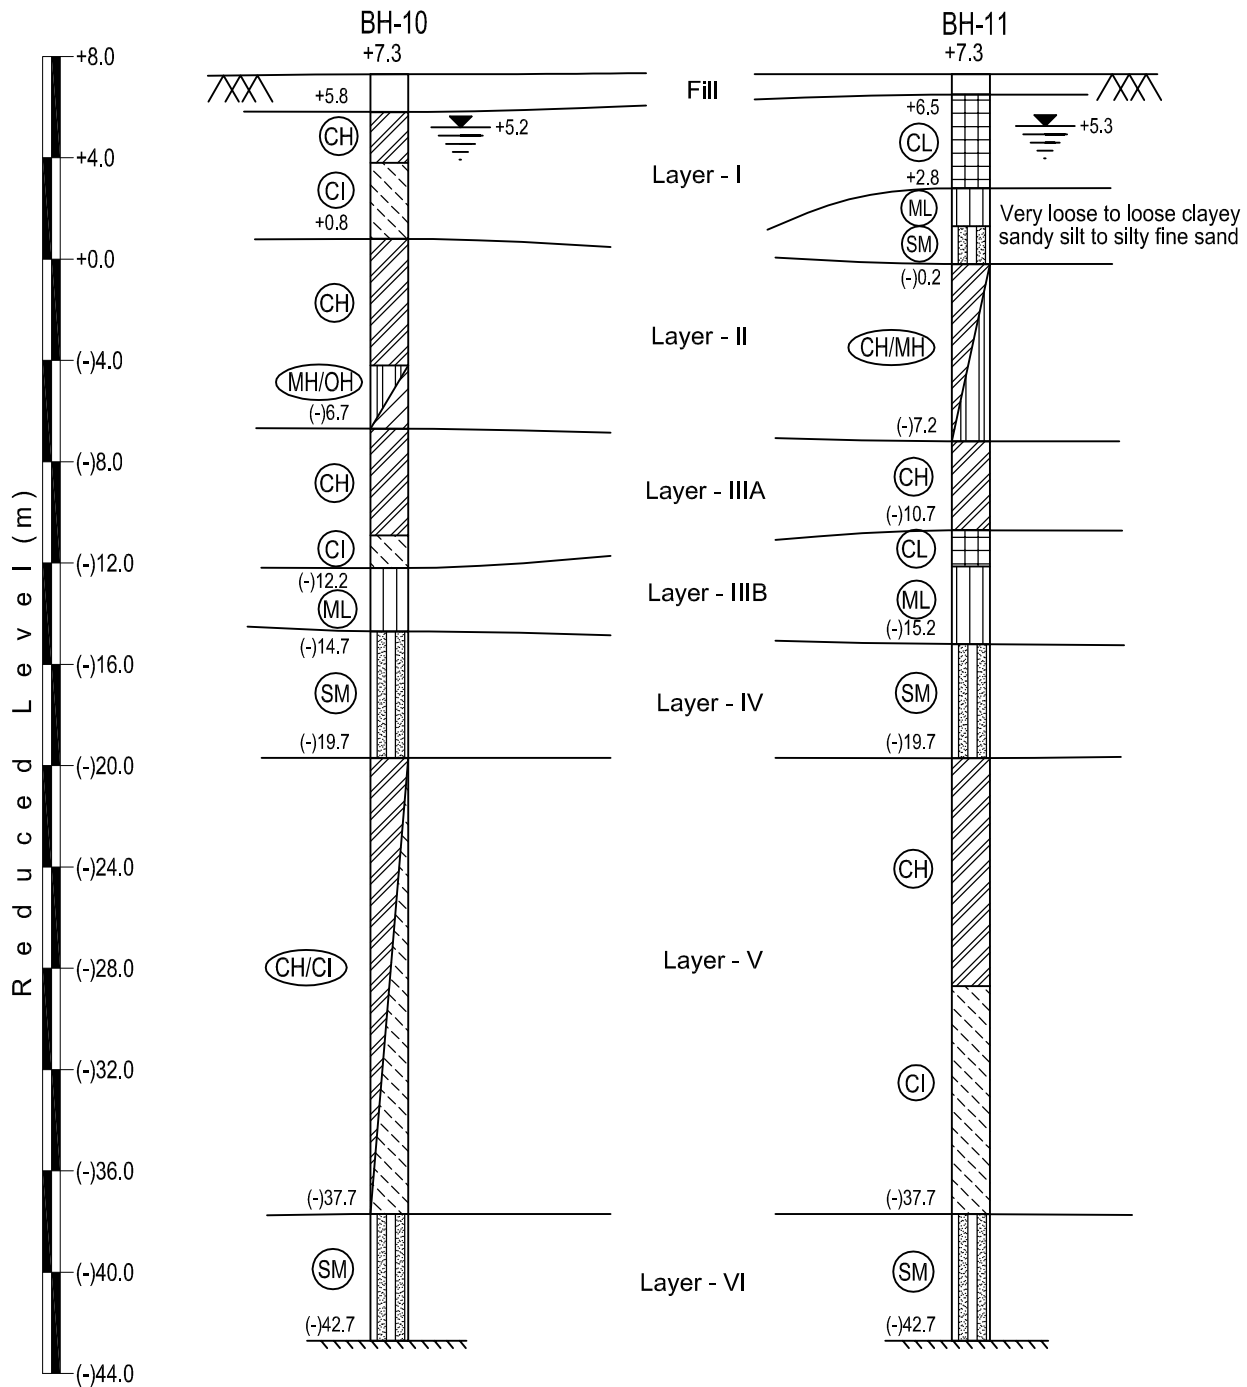

**Fill :** Consisting of silty sand / sand with stone / brick pieces etc.

**Layer - I :** Soft / firm silty clay / sandy silty clay

**Layer - II :** Soft / firm silty clay / clayey silt with varying percentage of decomposed wood

**Layer - IIIA :** Stiff silty clay with occasional traces of calcareous nodules

**Layer - IIIB :** Very stiff / hard silty clay with high silt content to medium dense clayey sandy silt

**Layer - IV :** Medium dense / dense silty sand

**Layer - V :** Stiff / very stiff to hard silty clay to sandy silty clay

**Layer - VI :** Dense / very dense silty sand

### Generalised Soil Profile for the upgradation of Berth No.7, NSD, N.S.Dock




Job No.:  
CCPL/20101211

Scale: 1:300

Figure No.: D/4



### GRAIN SIZE DISTRIBUTION CURVES

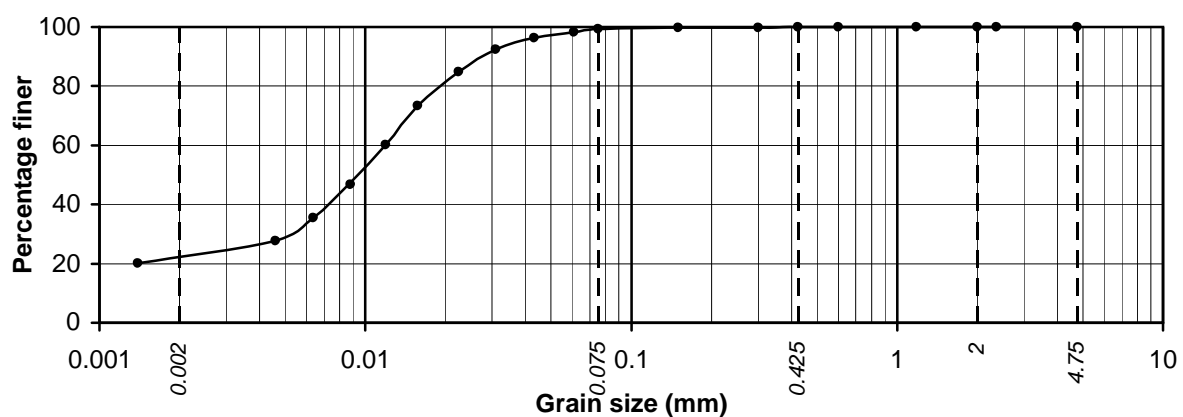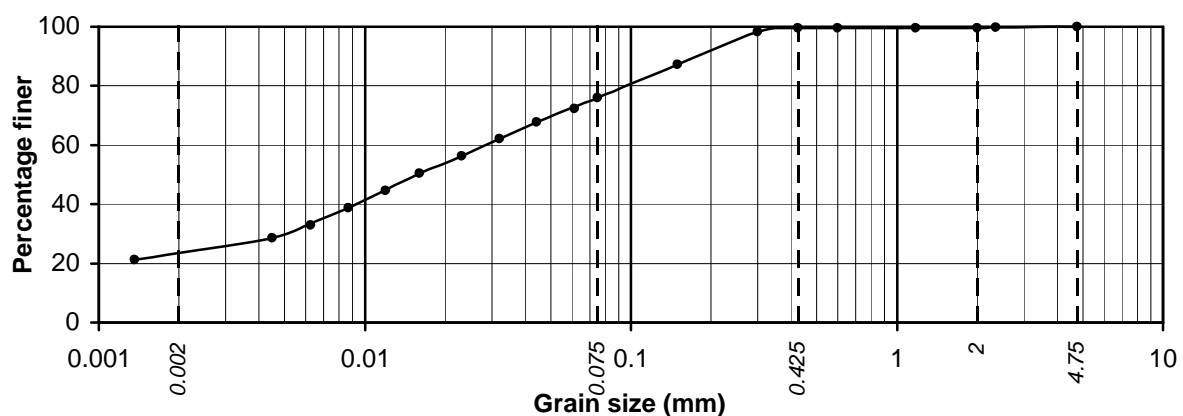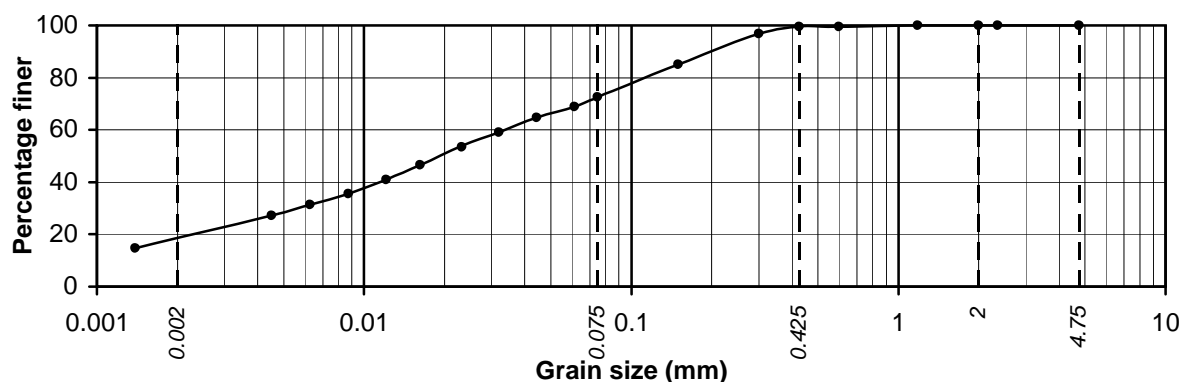


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/1


### GRAIN SIZE DISTRIBUTION CURVES

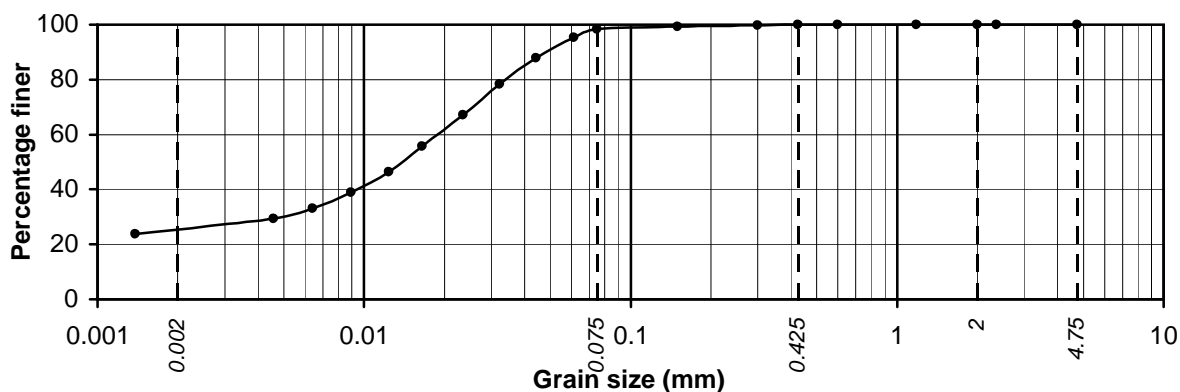

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 5.00m	25.5	72.9	1.5	0.1	0.0	0.0

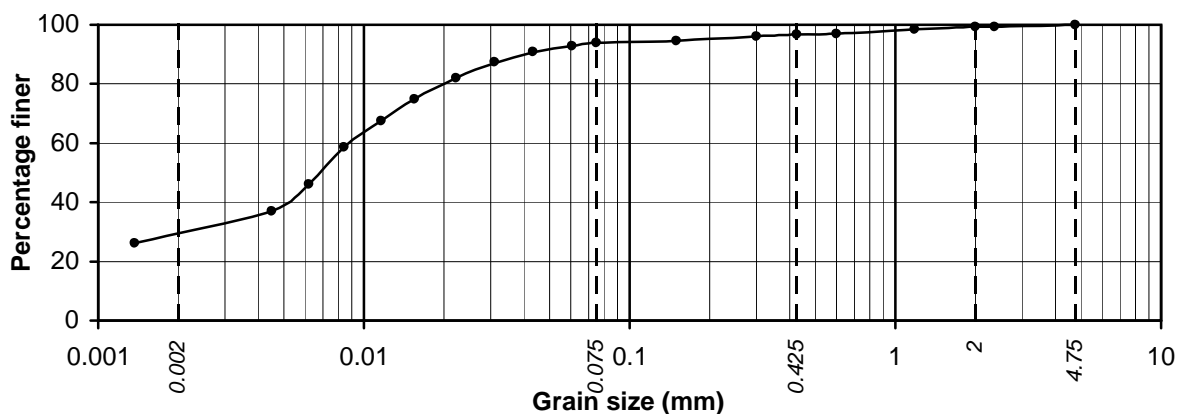

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 6.50m	29.7	64.2	2.8	2.6	0.7	0.0

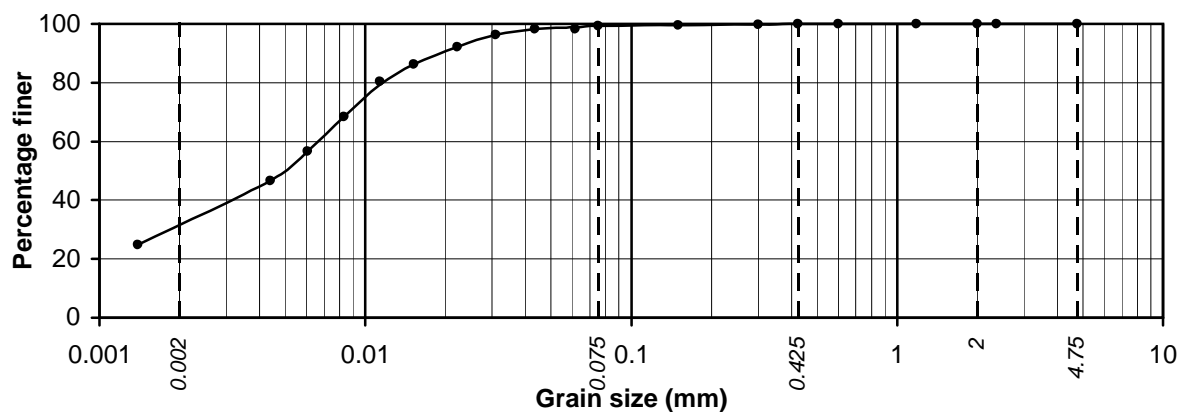


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 8.00m	31.8	67.4	0.7	0.1	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/2


### GRAIN SIZE DISTRIBUTION CURVES

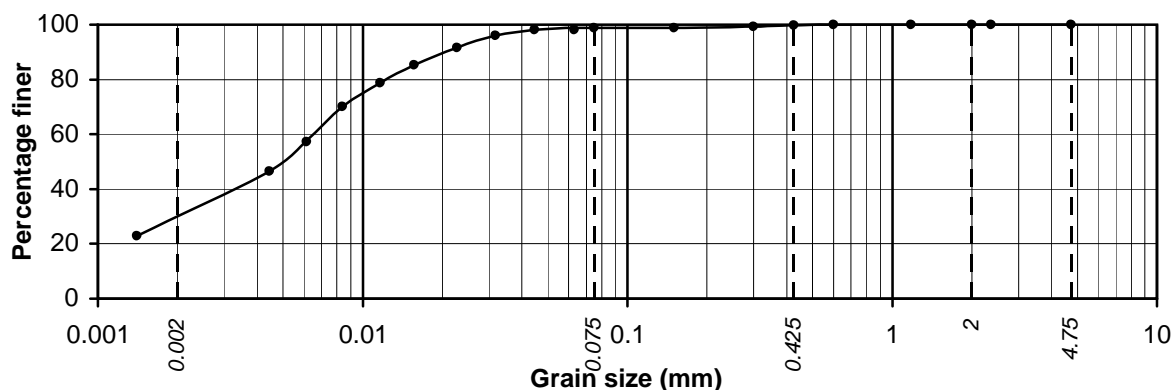

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 9.50m	30.1	68.8	0.9	0.2	0.0	0.0

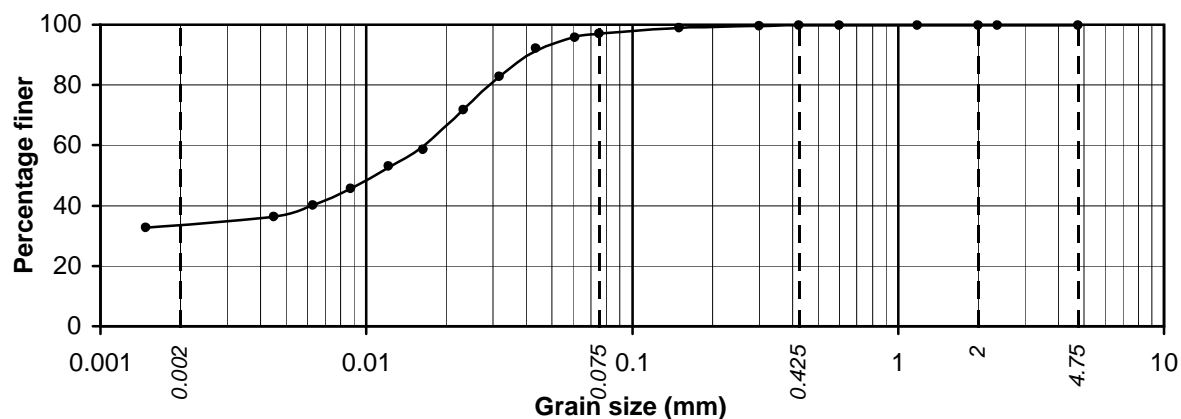

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 11.00m	33.7	63.3	2.7	0.1	0.0	0.2

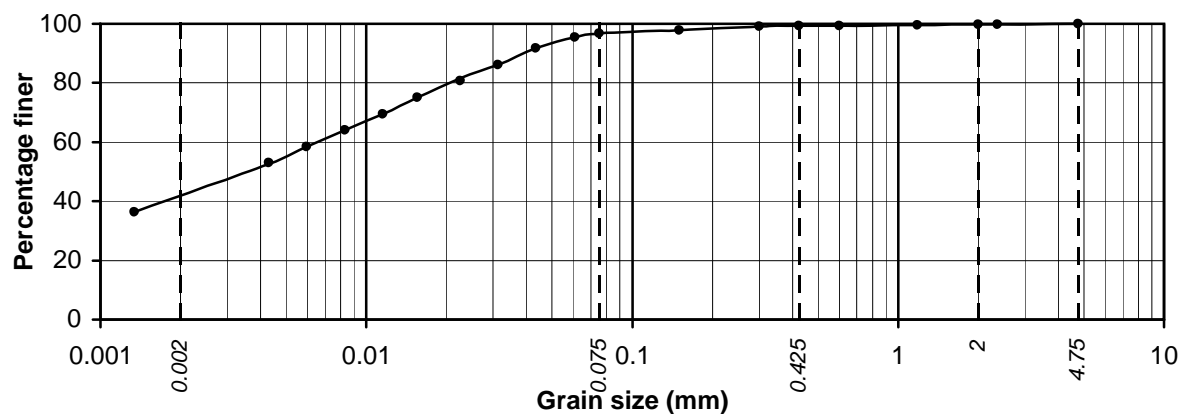


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 11.50m	42.0	54.7	2.7	0.5	0.1	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/3


### GRAIN SIZE DISTRIBUTION CURVES

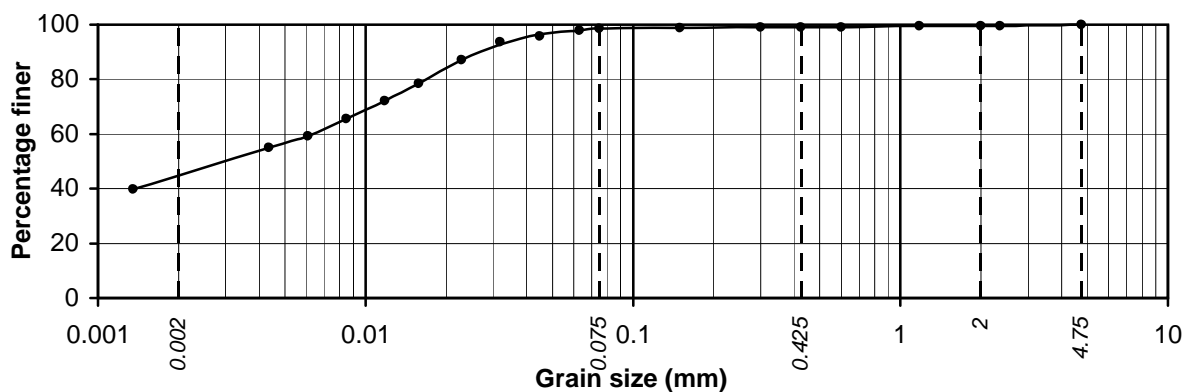

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 14.00m	44.9	53.8	0.4	0.5	0.4	0.0

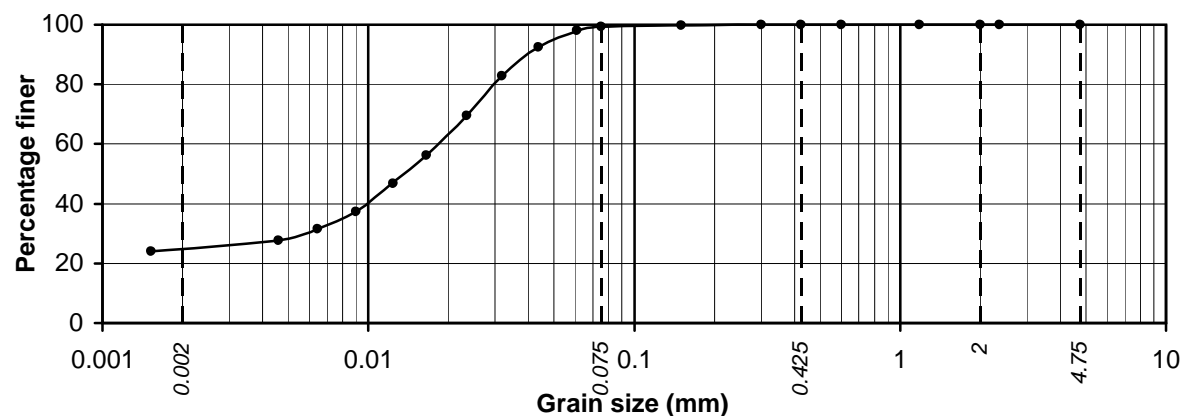

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 17.00m	24.9	74.4	0.7	0.0	0.0	0.0

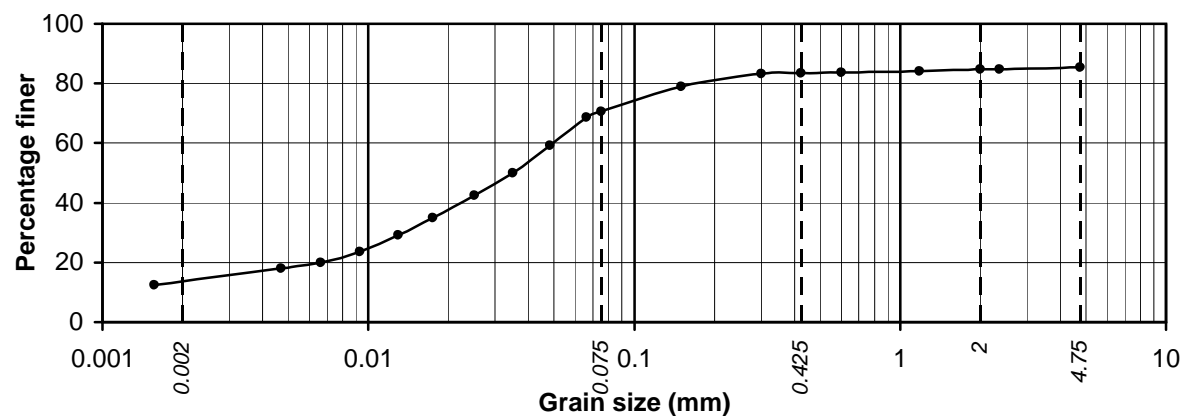


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 17.50m	13.6	56.9	12.9	1.4	0.6	14.6

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/4


### GRAIN SIZE DISTRIBUTION CURVES

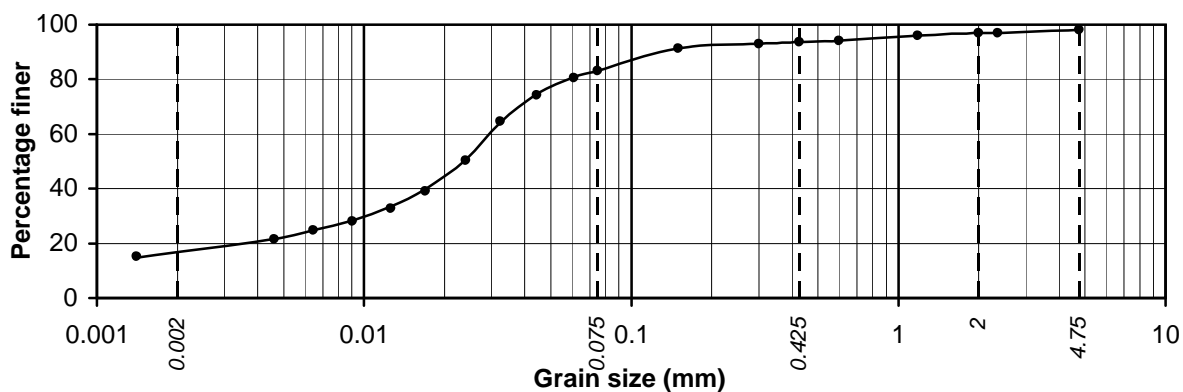

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 19.00m	16.7	66.4	10.5	3.4	1.1	1.9

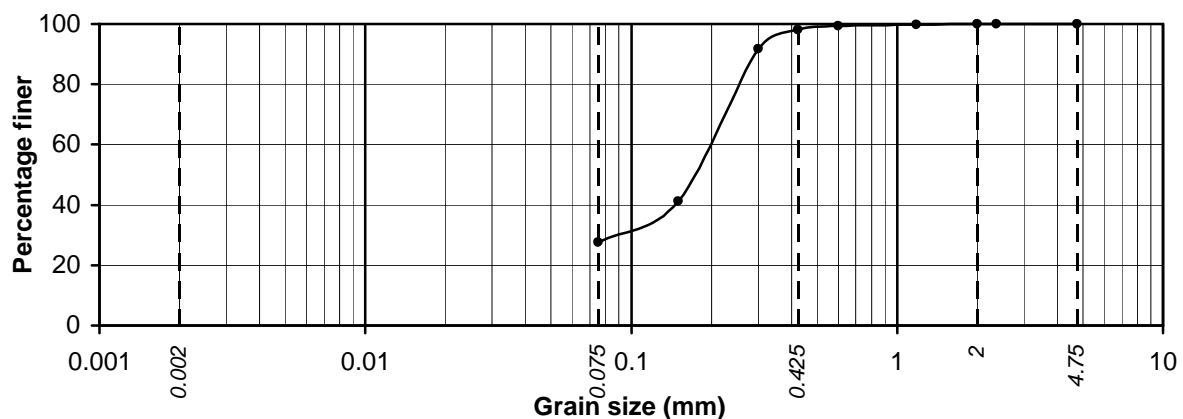

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 22.00m	27.5	70.6	1.9	0.0	0.0	0.0

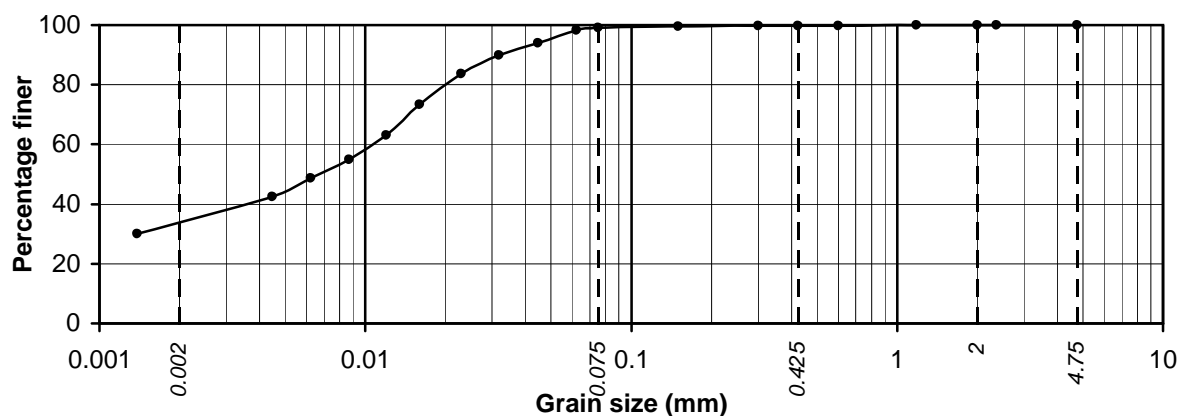

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 26.00m	34.0	65.2	0.7	0.1	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/5


### GRAIN SIZE DISTRIBUTION CURVES

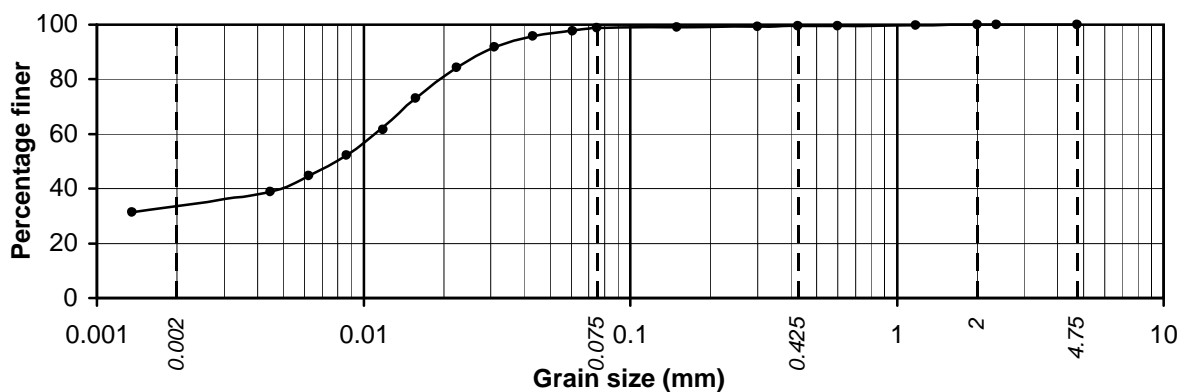

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 29.00m	33.9	64.9	0.7	0.5	0.0	0.0

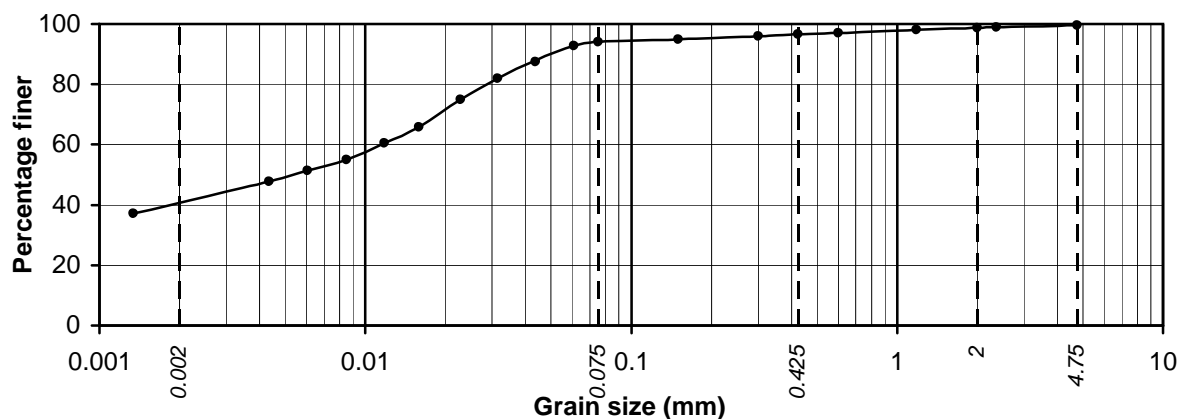

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 31.00m	40.8	53.2	2.6	2.1	1.0	0.3

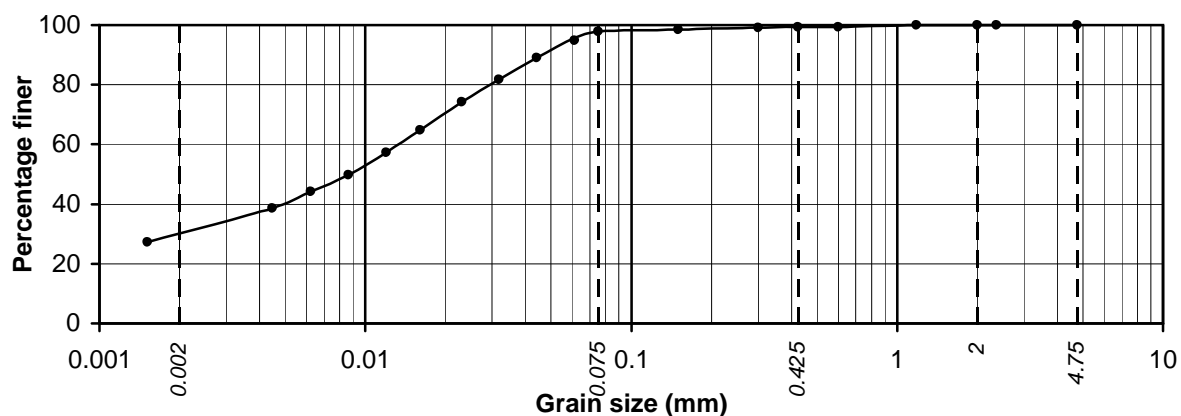


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 34.00m	30.2	67.6	1.5	0.7	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/6


### GRAIN SIZE DISTRIBUTION CURVES

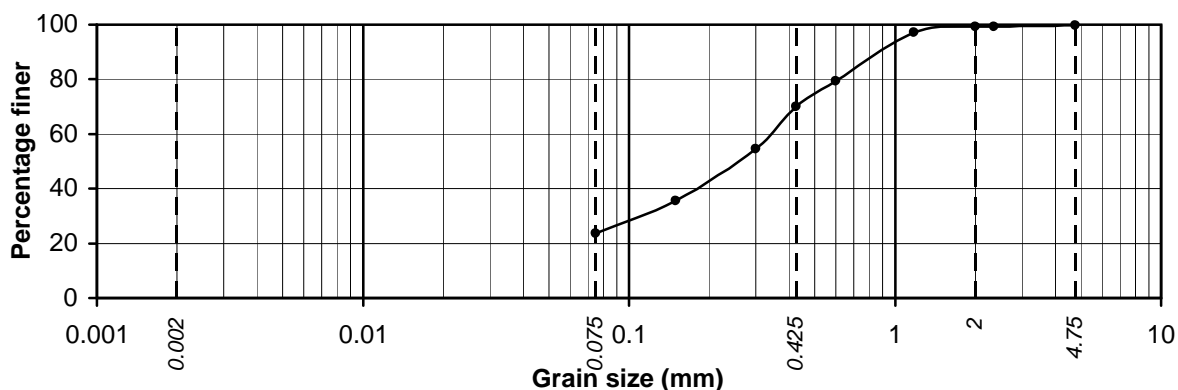

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 37.00m		*23.6	46.5	29.2	0.6	0.1

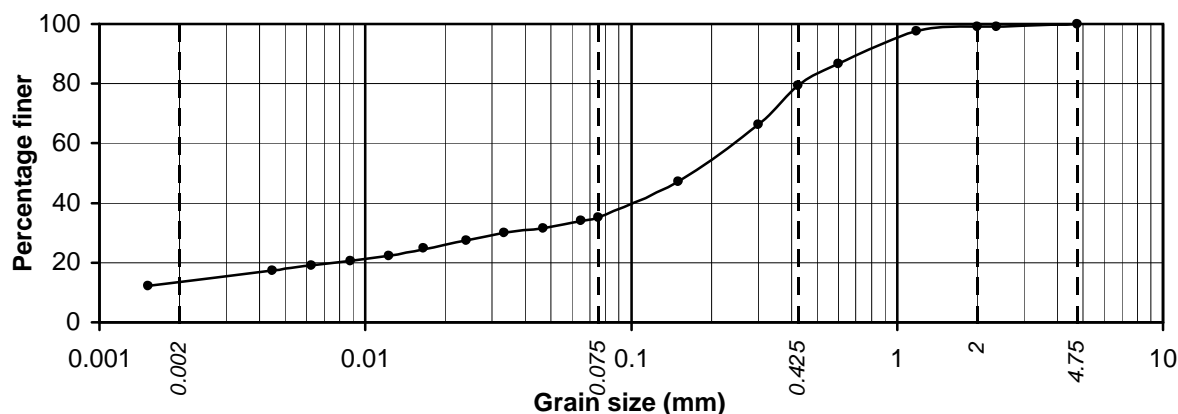

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 38.50m	13.6	21.6	44.2	19.6	1.0	0.0

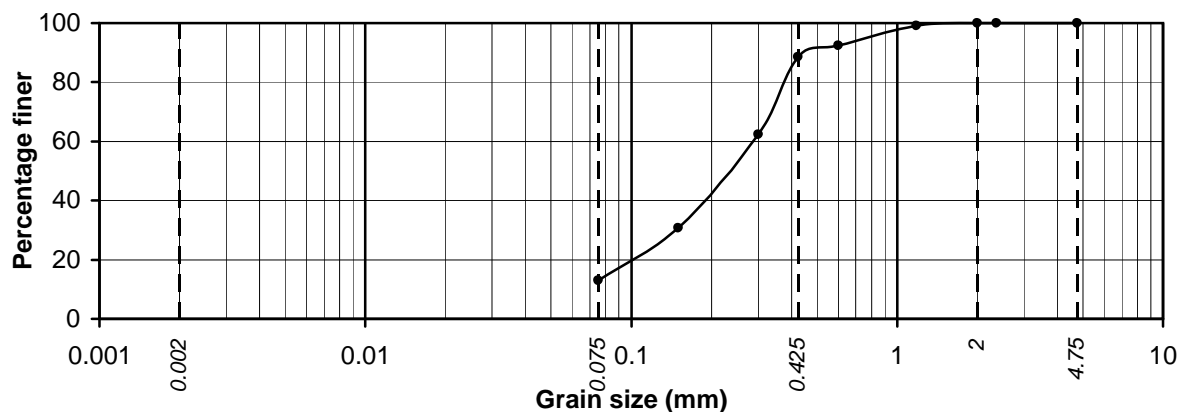

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 41.50m		*12.9	75.6	11.5	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/7


### GRAIN SIZE DISTRIBUTION CURVES

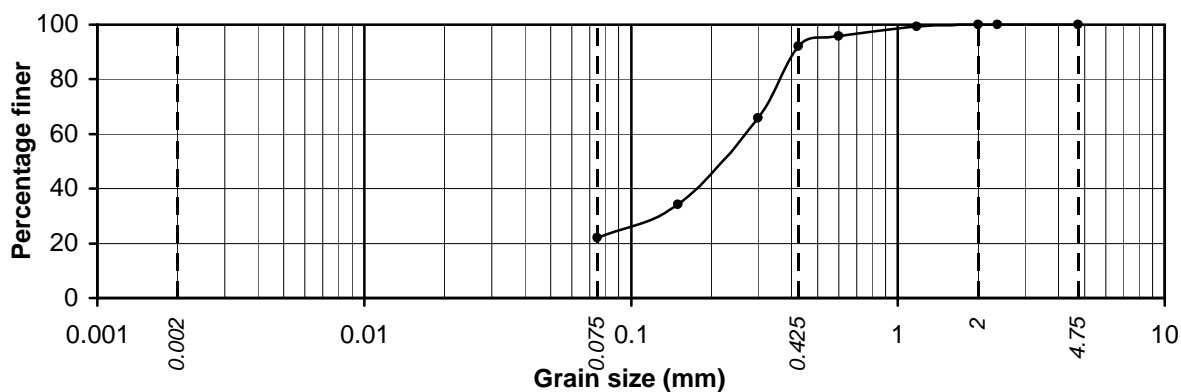

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 44.50m		*21.9	70.0	8.1	0.0	0.0

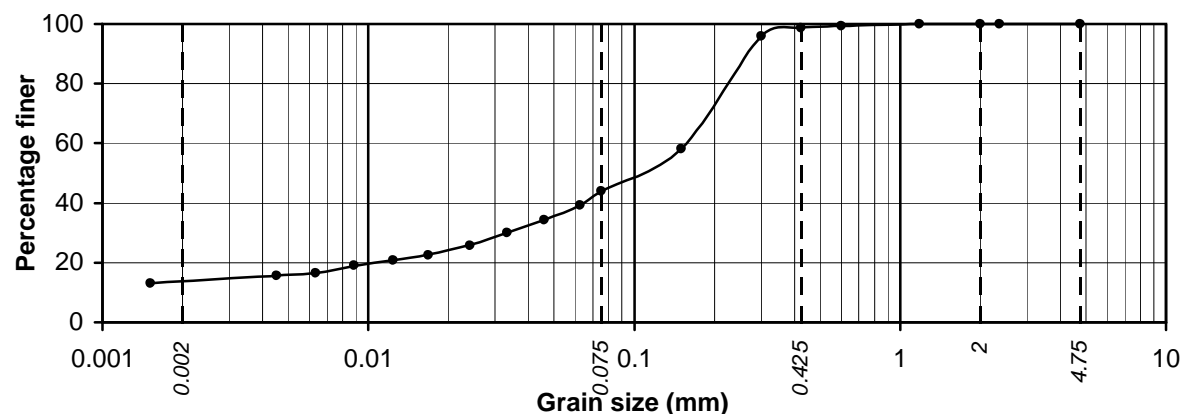

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-1, 48.00m	13.8	30.3	54.7	1.2	0.0	0.0

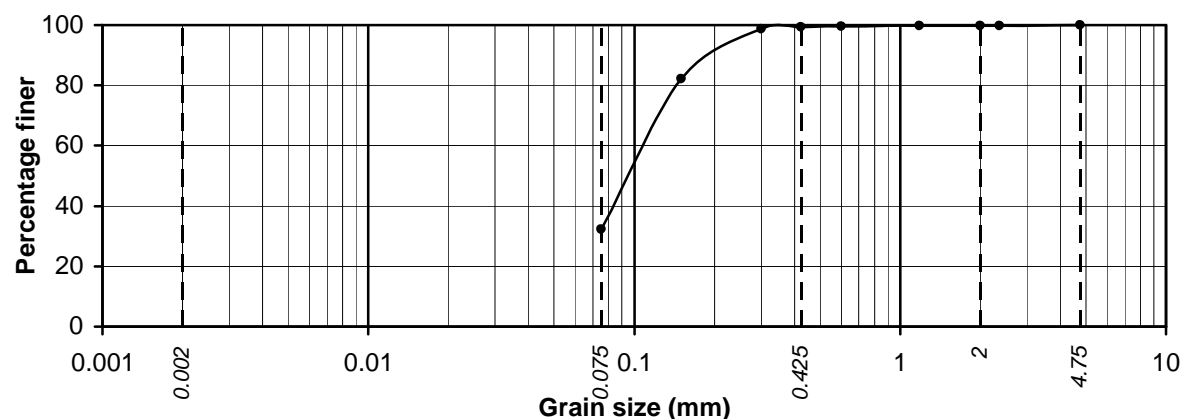

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 0.00m		*32.3	67.1	0.4	0.2	0.0

\*Silt & Clay


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211


Fig. No.  
E/8




### GRAIN SIZE DISTRIBUTION CURVES

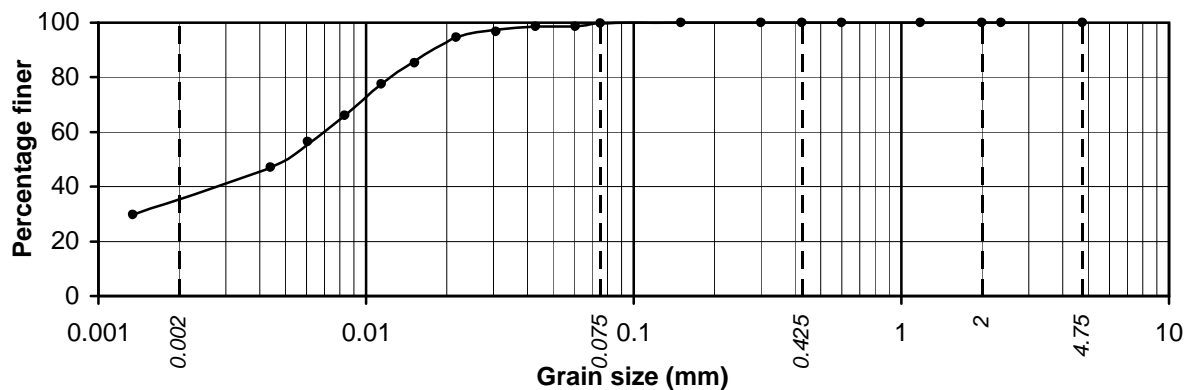

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 3.00m	35.5	64.2	0.3	0.0	0.0	0.0

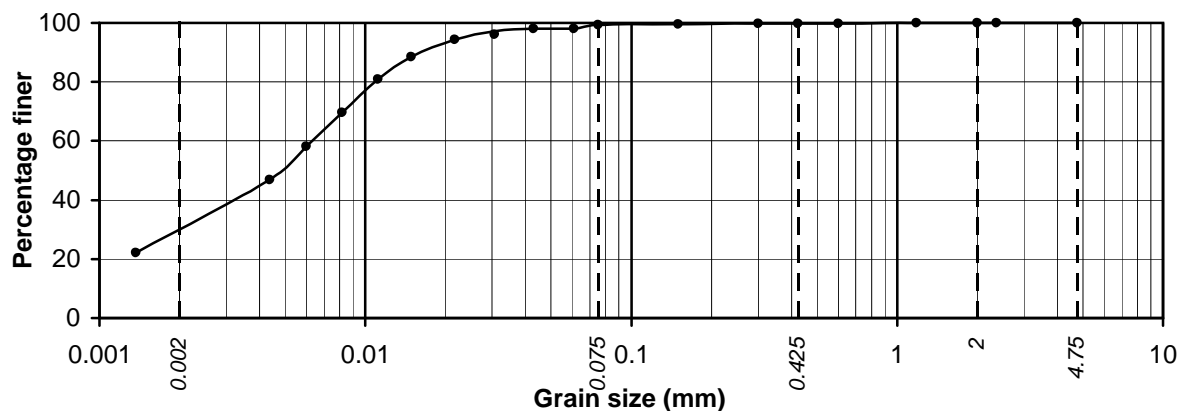

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 5.00m	30.1	69.2	0.5	0.2	0.0	0.0

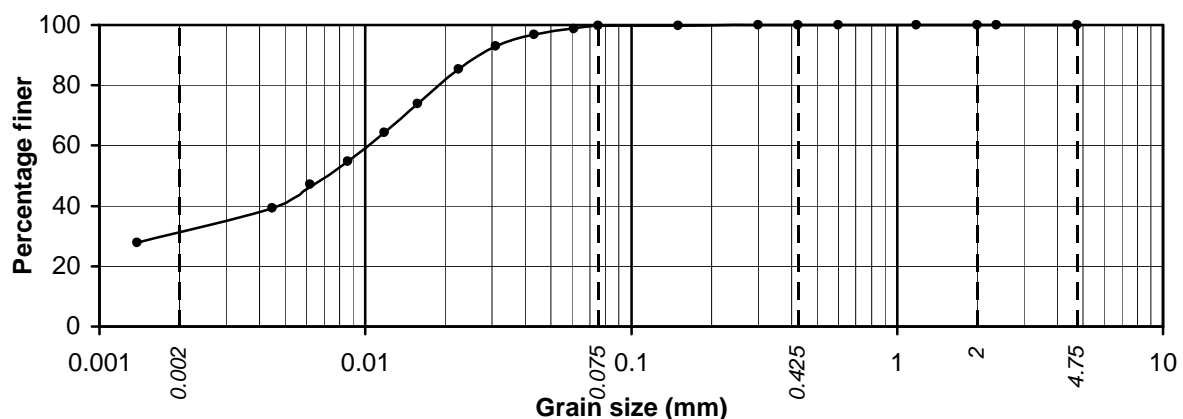


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 6.00m	31.5	68.4	0.1	0.0	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/9


### GRAIN SIZE DISTRIBUTION CURVES

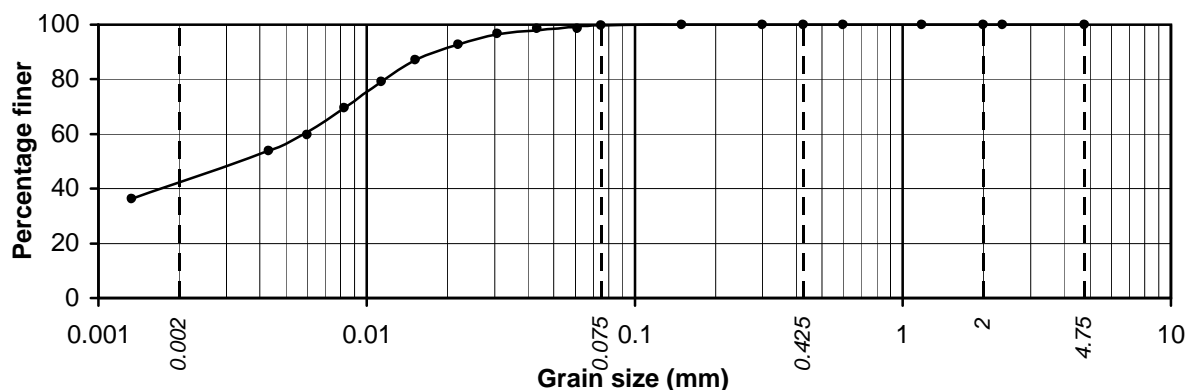

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 8.00m	42.4	57.5	0.1	0.0	0.0	0.0

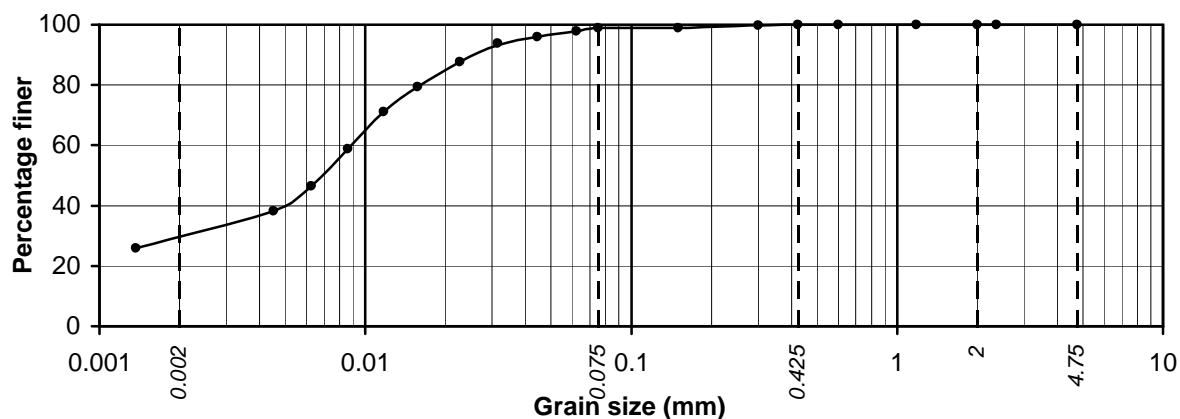

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 9.00m	29.8	69.1	1.1	0.0	0.0	0.0

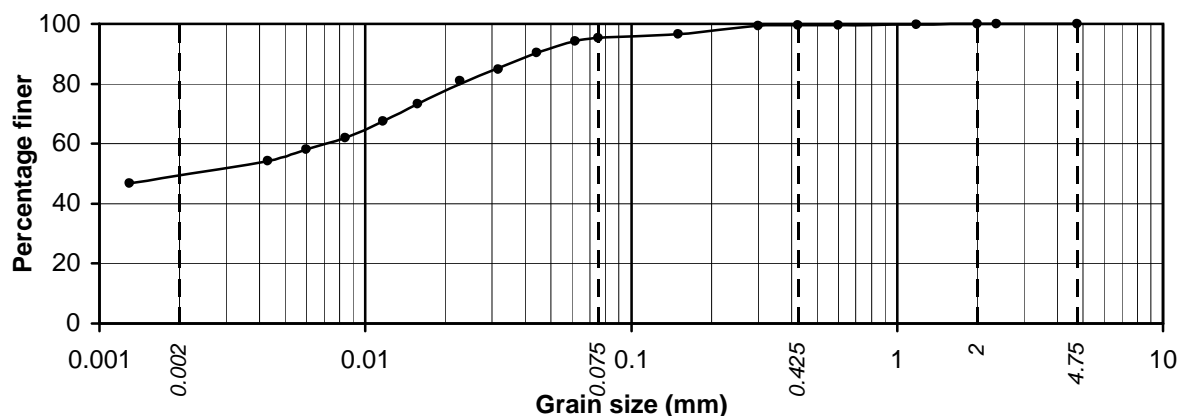


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 11.00m	49.5	45.8	4.3	0.4	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/10


### GRAIN SIZE DISTRIBUTION CURVES

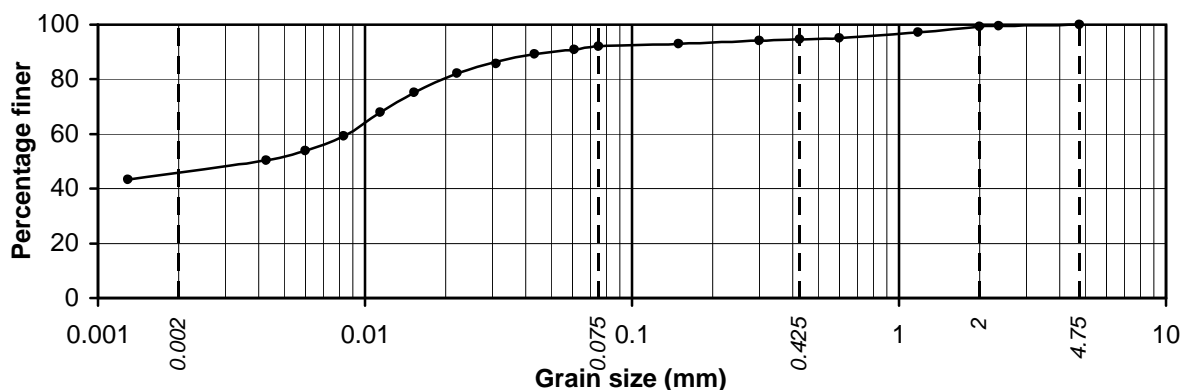

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 12.00m	45.9	46.1	2.6	4.7	0.7	0.0

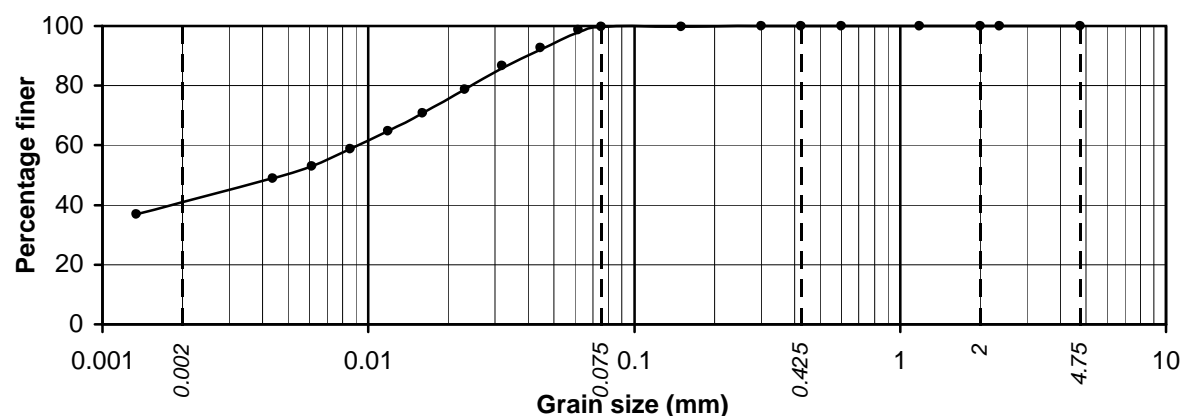

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 14.00m	41.0	58.8	0.2	0.0	0.0	0.0

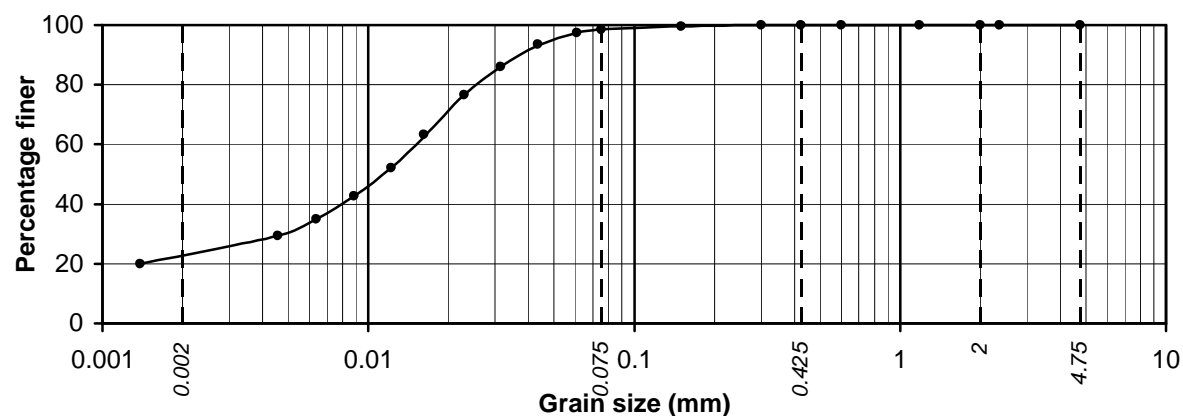


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 15.00m	22.9	75.6	1.5	0.0	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/11


### GRAIN SIZE DISTRIBUTION CURVES

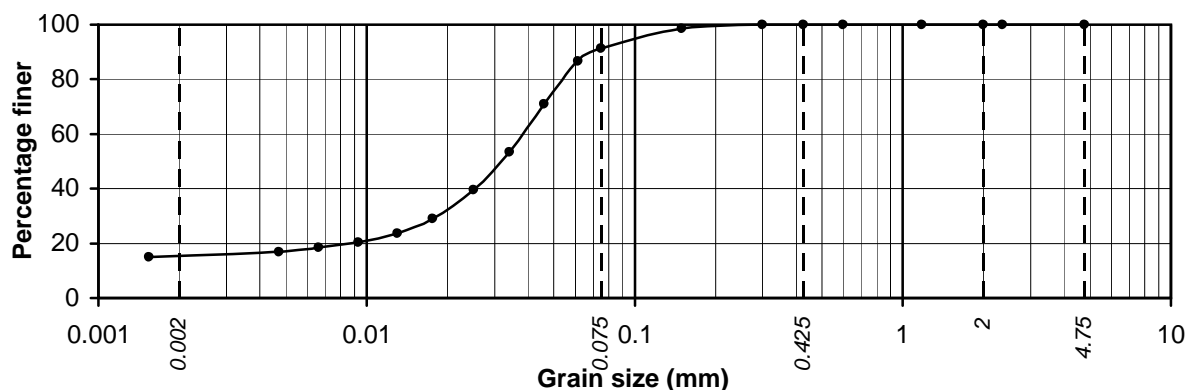

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 17.00m	15.4	75.8	8.7	0.1	0.0	0.0

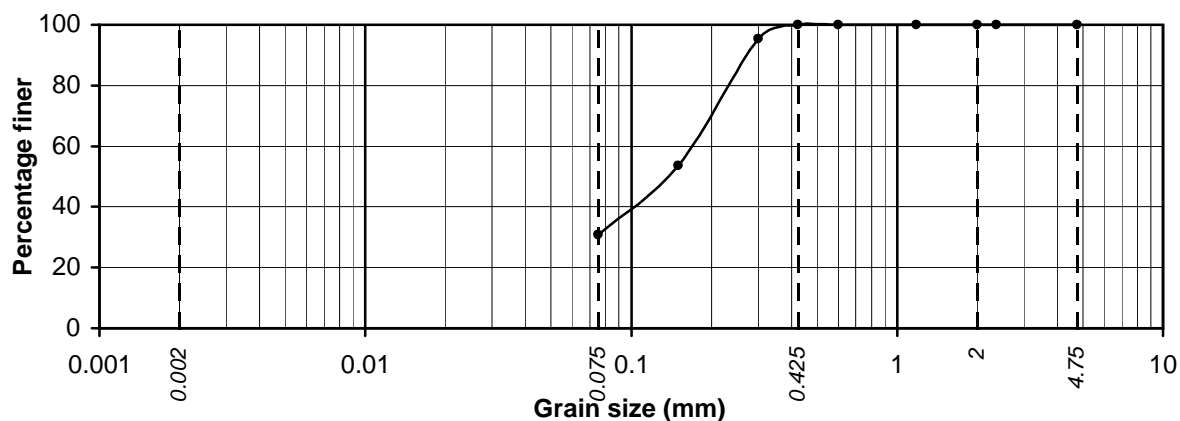

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 18.50m	*30.9		69.0	0.1	0.0	0.0

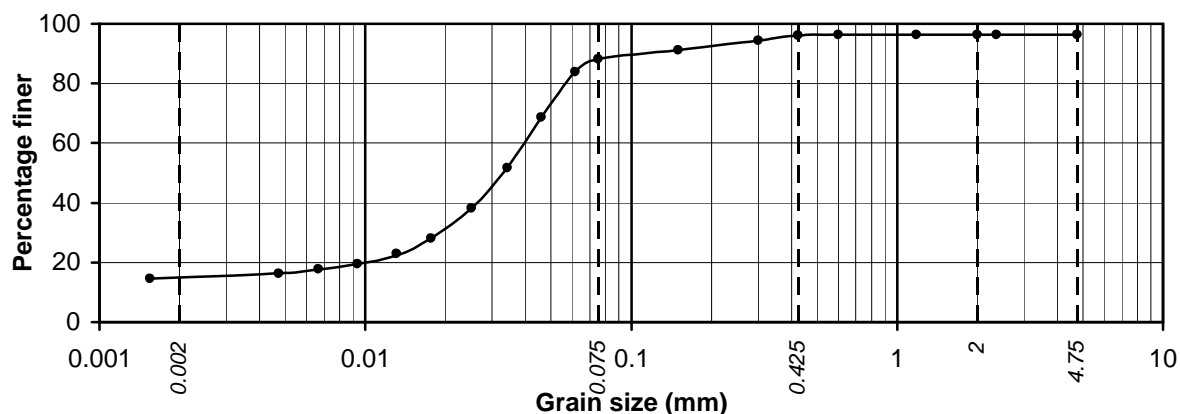

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 21.50m	15.0	73.3	7.9	0.1	0.0	3.7


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/12


### GRAIN SIZE DISTRIBUTION CURVES

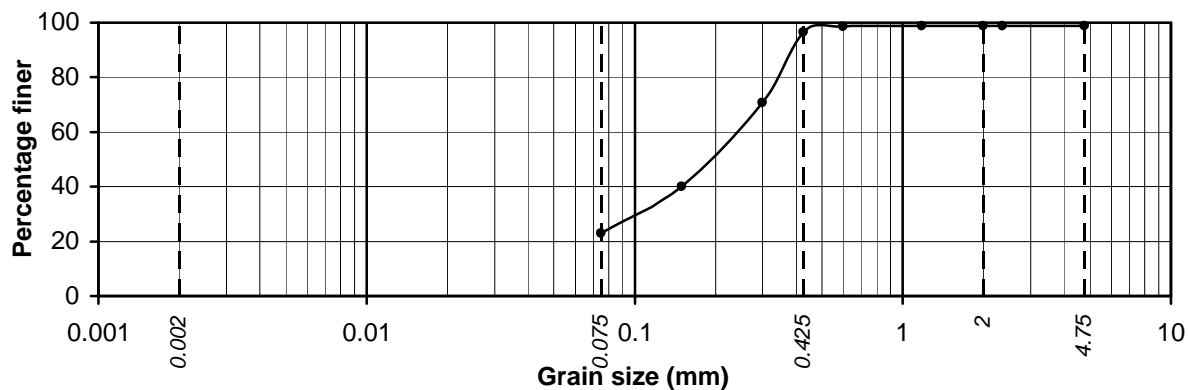

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-2, 24.50m		*23.1	73.5	2.2	0.1	1.1

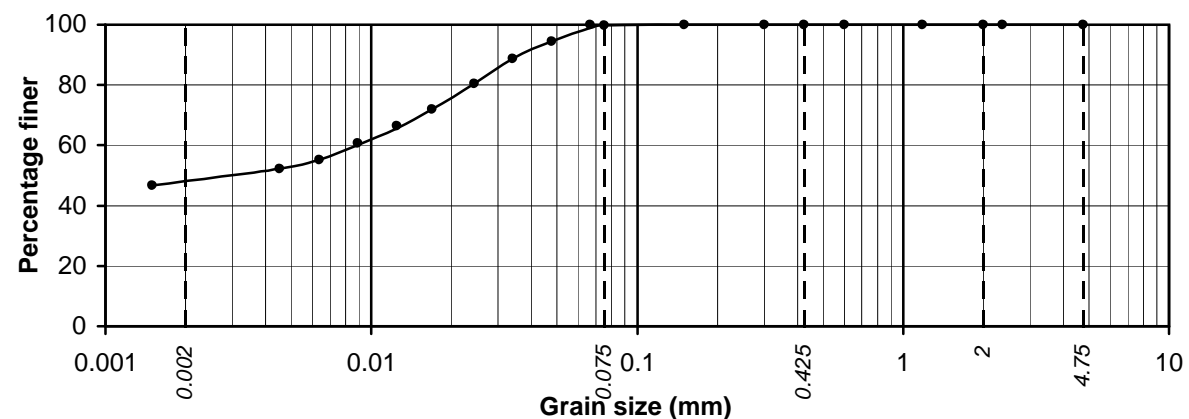

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-2, 25.50m	48.1	51.8	0.1	0.0	0.0	0.0

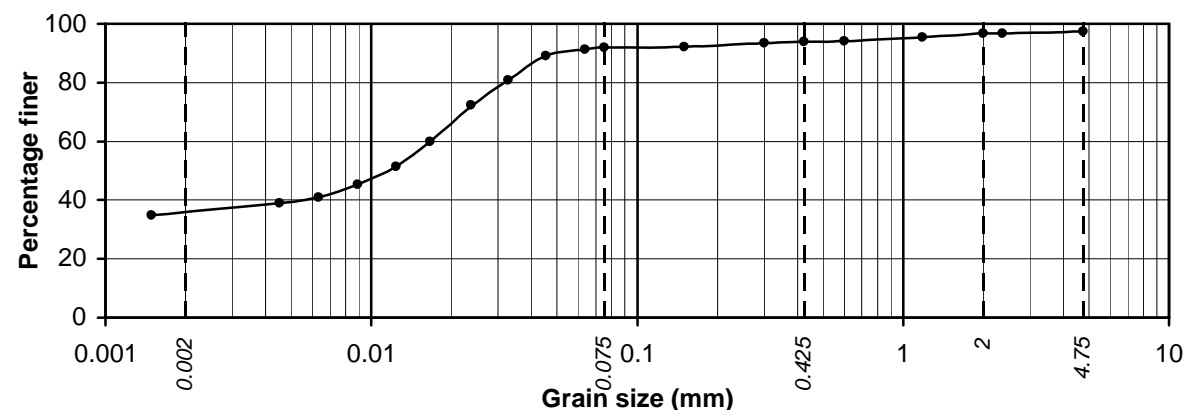

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-2, 27.00m	35.9	55.9	2.1	2.8	0.6	2.7


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/13


### GRAIN SIZE DISTRIBUTION CURVES

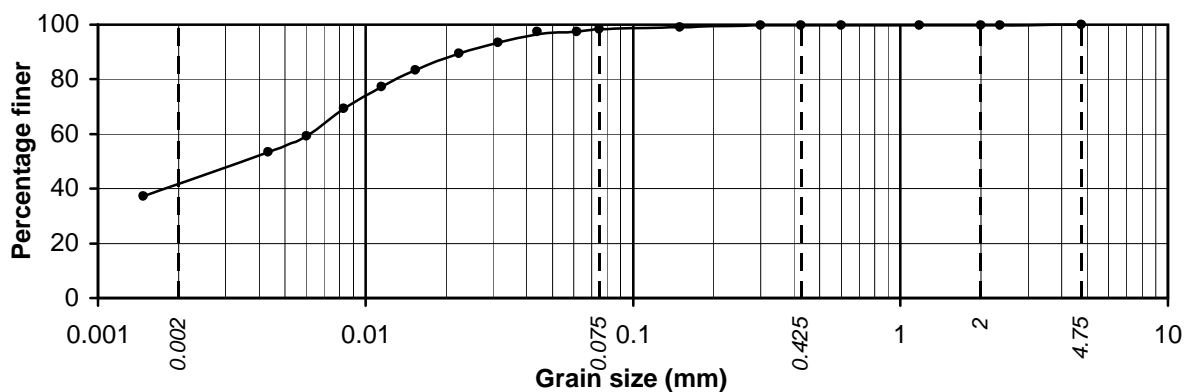

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 30.00m	41.7	56.7	1.3	0.2	0.1	0.0

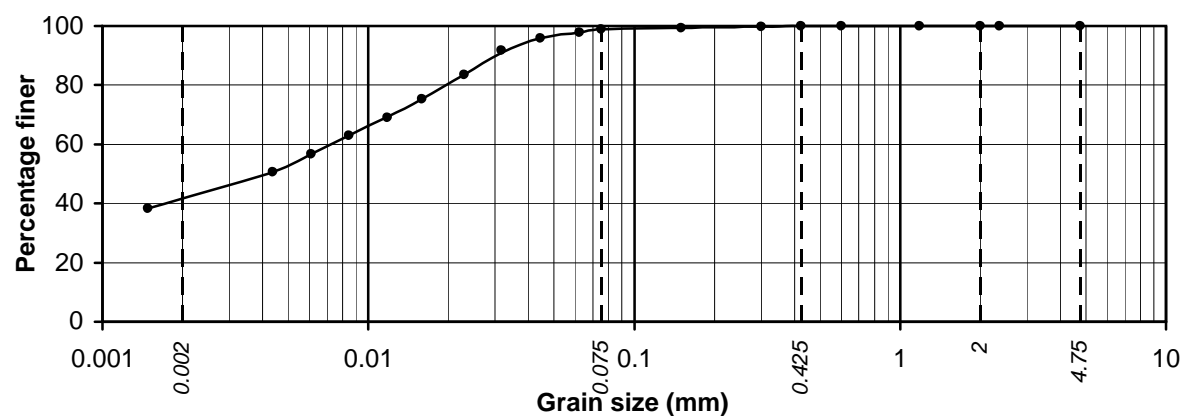

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 32.00m	41.7	57.1	1.1	0.1	0.0	0.0

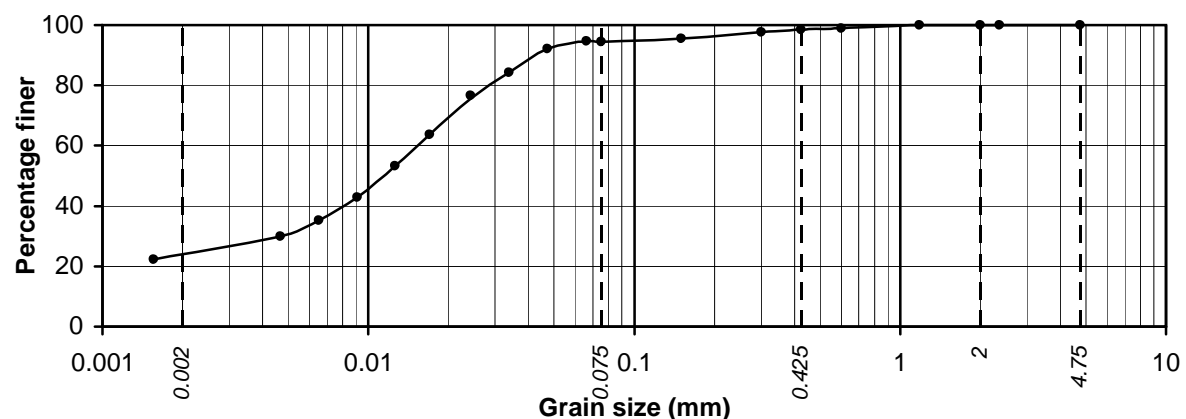


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 35.00m	24.0	70.5	3.9	1.6	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/14


### GRAIN SIZE DISTRIBUTION CURVES

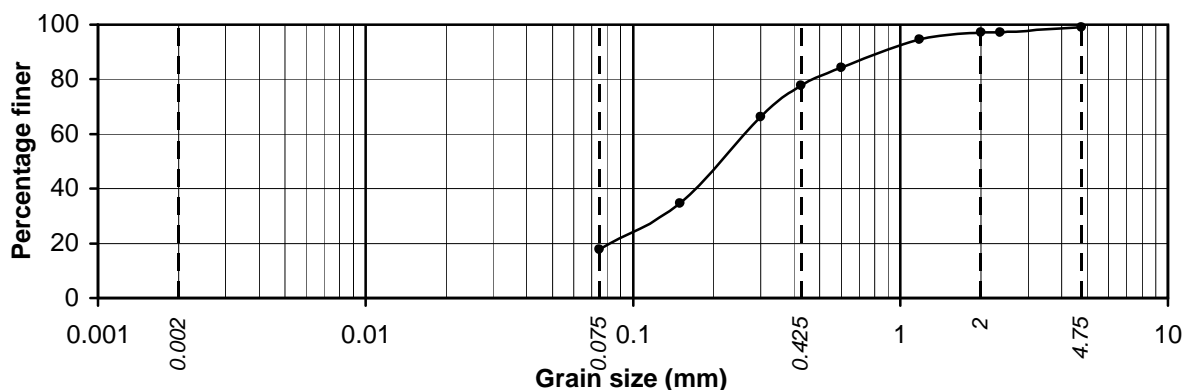

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-2, 38.00m		*17.8	59.9	19.6	1.7	1.0

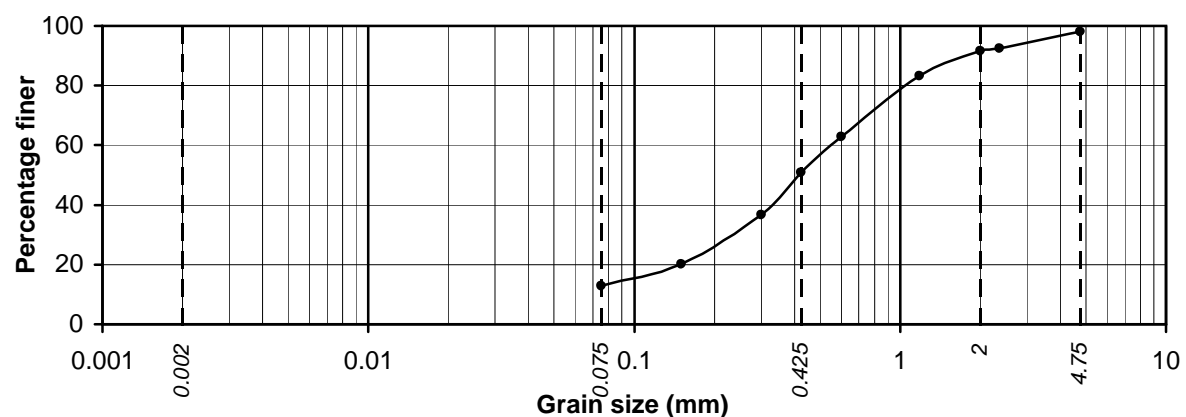

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-2, 41.00m		*12.8	38.0	40.8	6.4	2.0

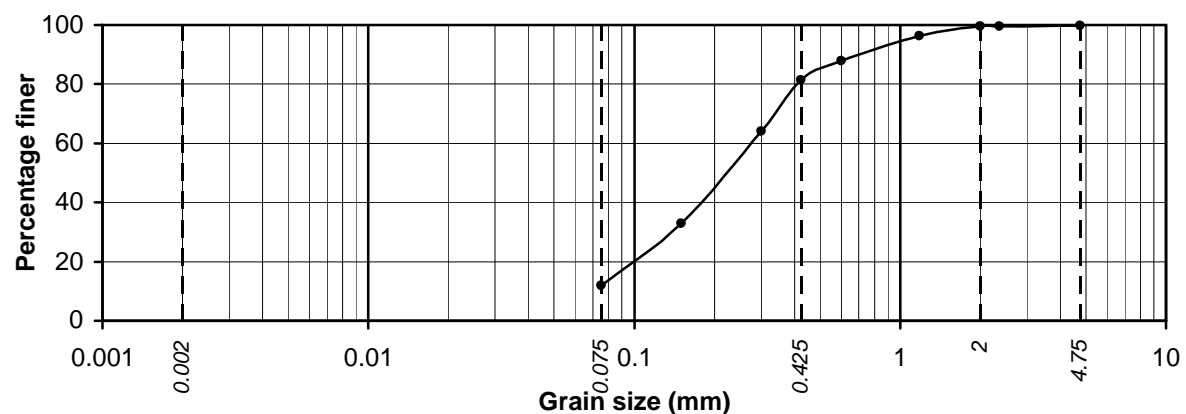

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-2, 44.00m		*12.0	69.5	18.0	0.2	0.3


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/15


### GRAIN SIZE DISTRIBUTION CURVES

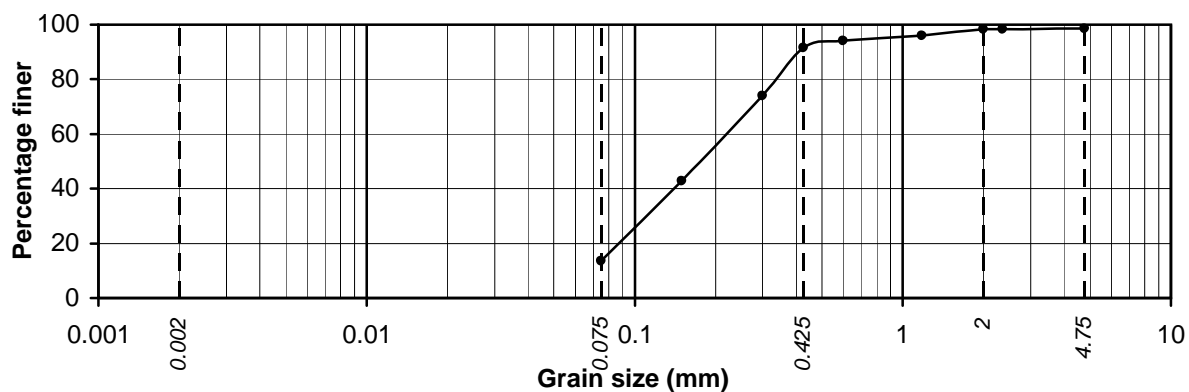

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-2, 48.50m		*13.5	78.0	6.8	0.2	1.5

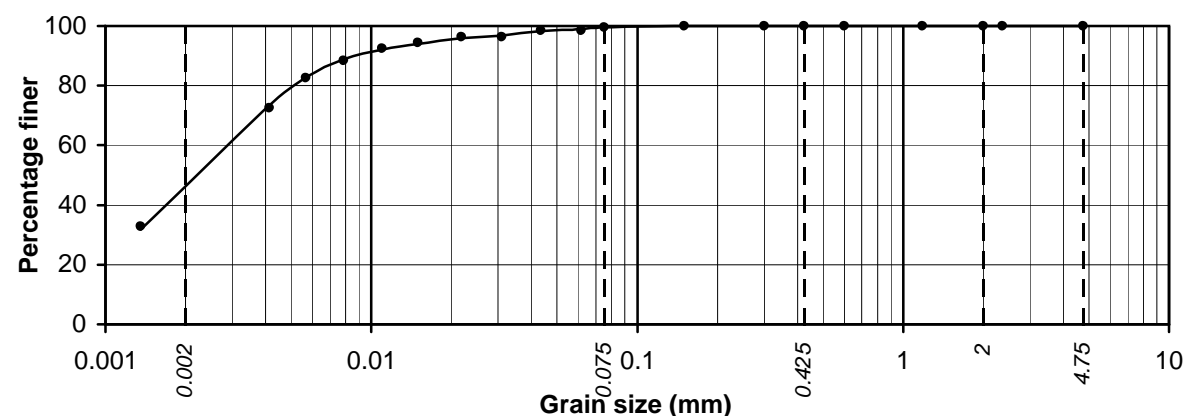

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 1.00m	46.3	53.2	0.5	0.0	0.0	0.0

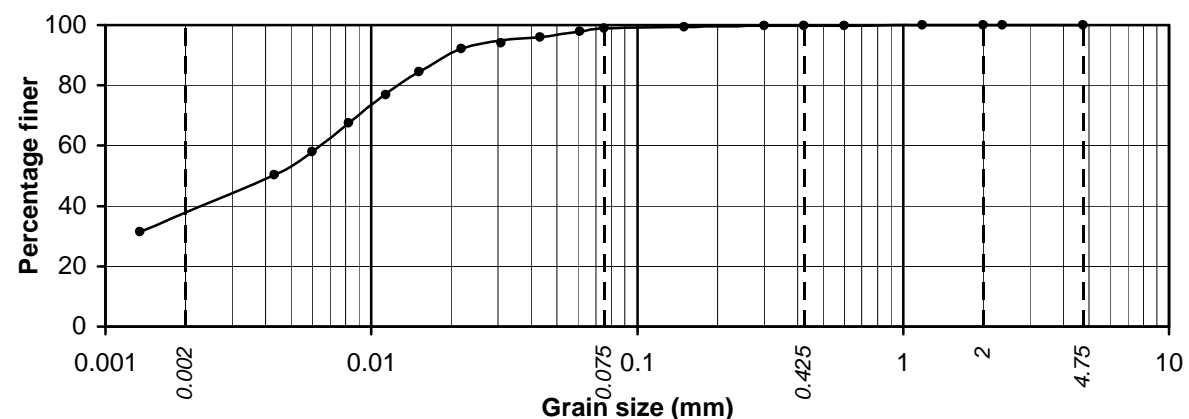

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 2.50m	37.8	61.2	0.9	0.1	0.0	0.0

\*Silt & Clay


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211


Fig. No.  
E/16




### GRAIN SIZE DISTRIBUTION CURVES

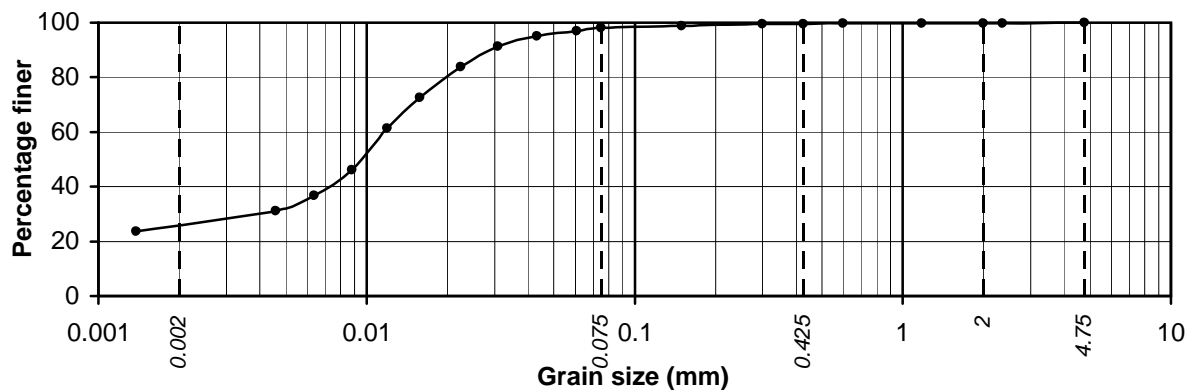

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 4.00m	26.0	72.2	1.4	0.2	0.2	0.0

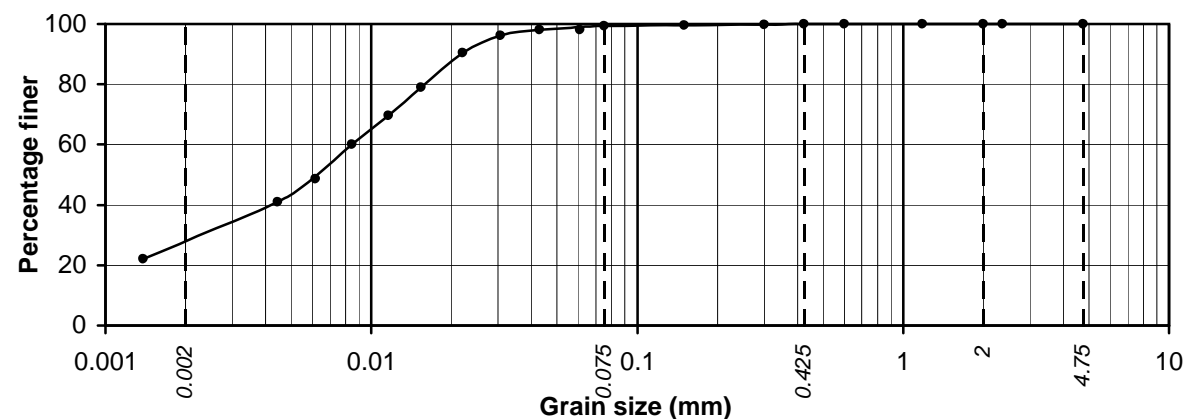

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 5.50m	28.0	71.3	0.6	0.1	0.0	0.0

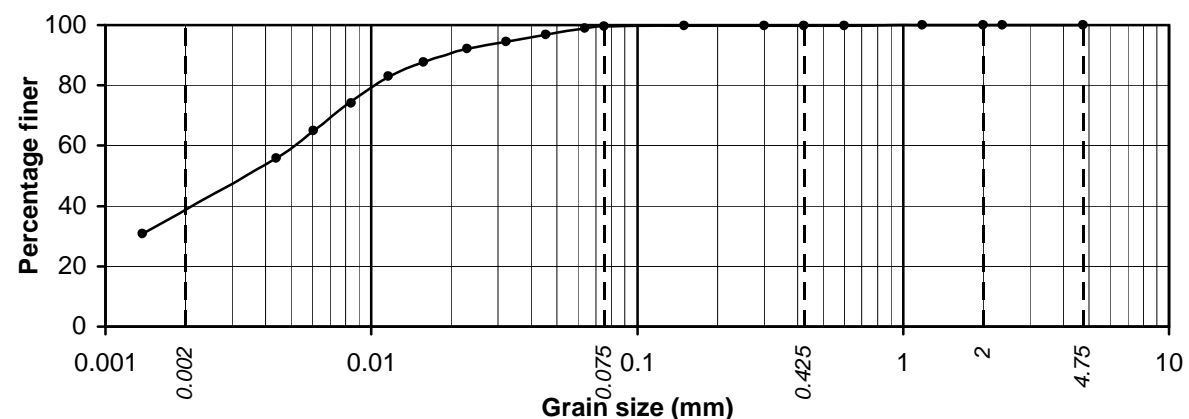


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 7.00m	38.9	60.8	0.2	0.1	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/17


### GRAIN SIZE DISTRIBUTION CURVES

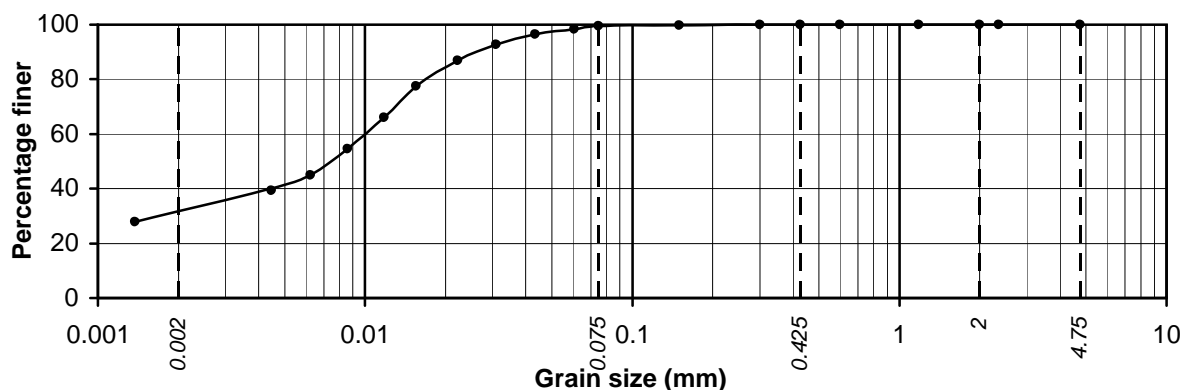

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 8.50m	31.7	67.9	0.4	0.0	0.0	0.0

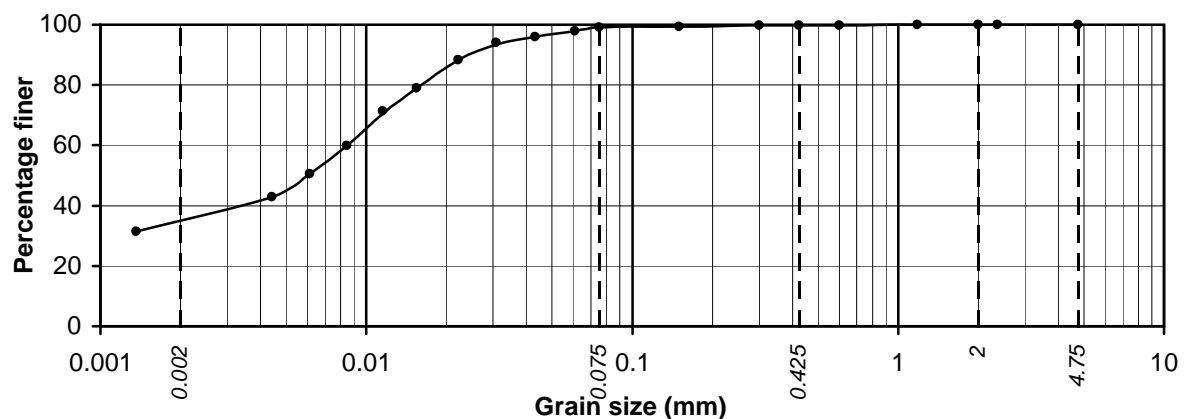

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 10.00m	35.2	63.8	0.8	0.2	0.0	0.0

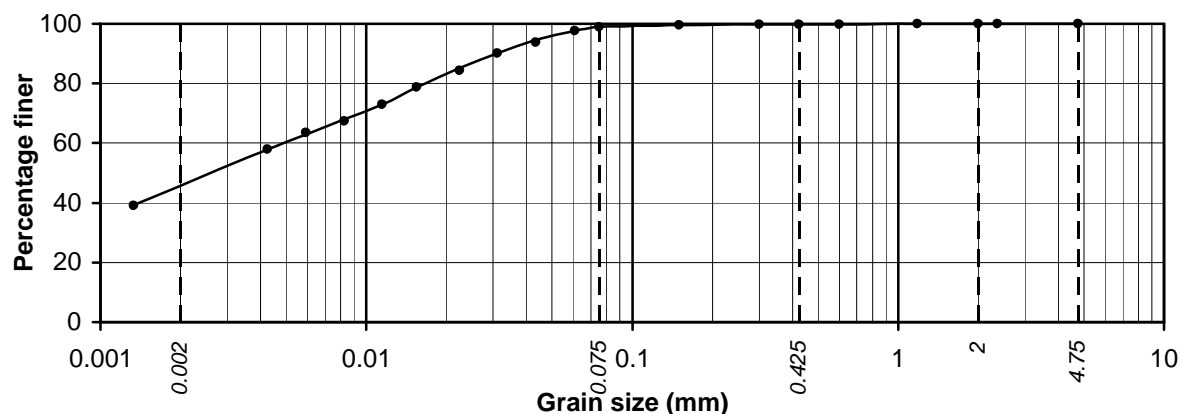


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 13.00m	45.7	53.2	1.0	0.1	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/18


### GRAIN SIZE DISTRIBUTION CURVES

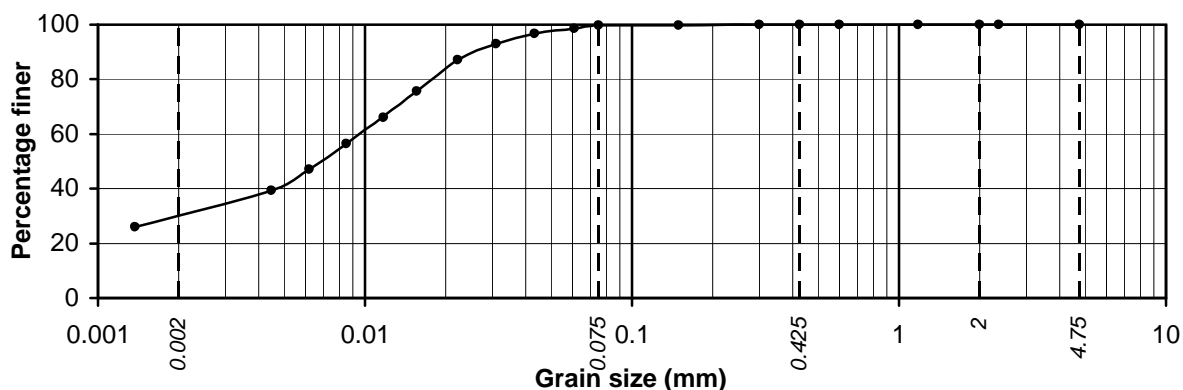

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 16.00m	30.2	69.6	0.1	0.1	0.0	0.0

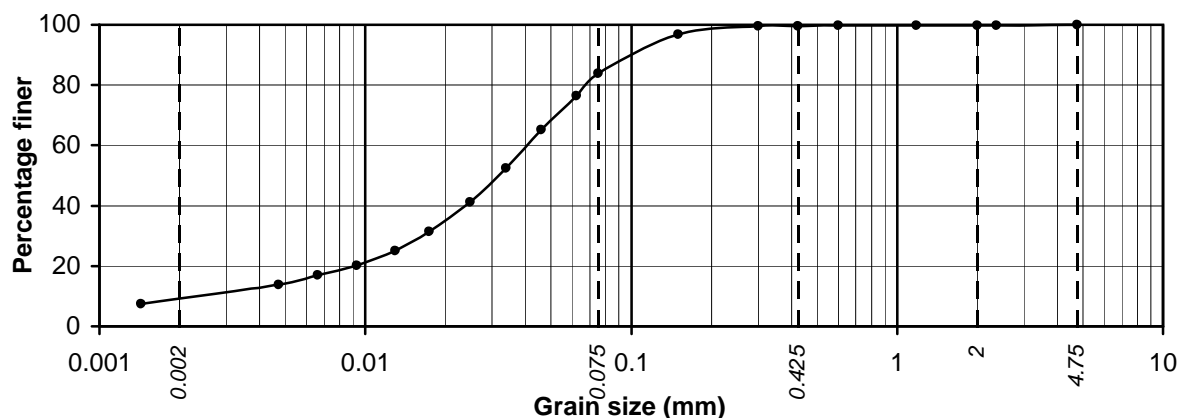

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 18.00m	9.2	74.7	15.8	0.1	0.2	0.0

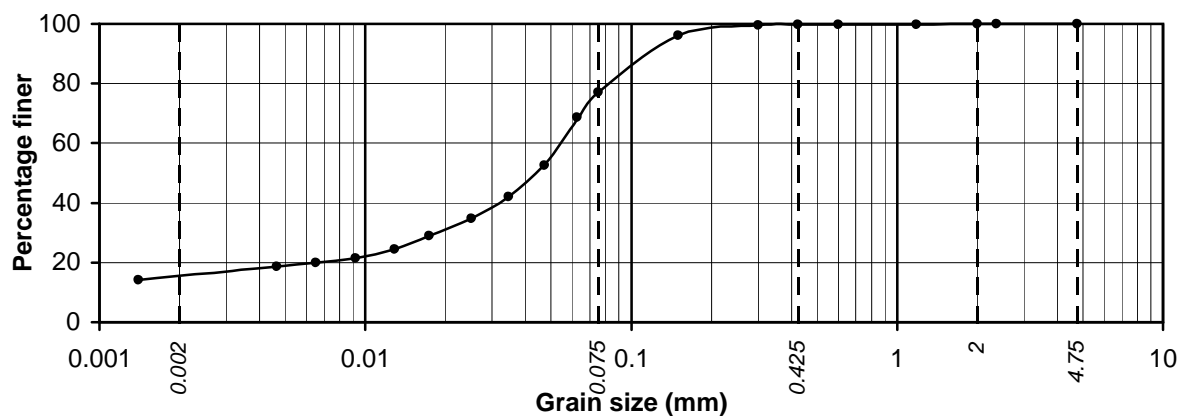


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 21.00m	15.5	61.5	22.8	0.1	0.1	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/19


### GRAIN SIZE DISTRIBUTION CURVES

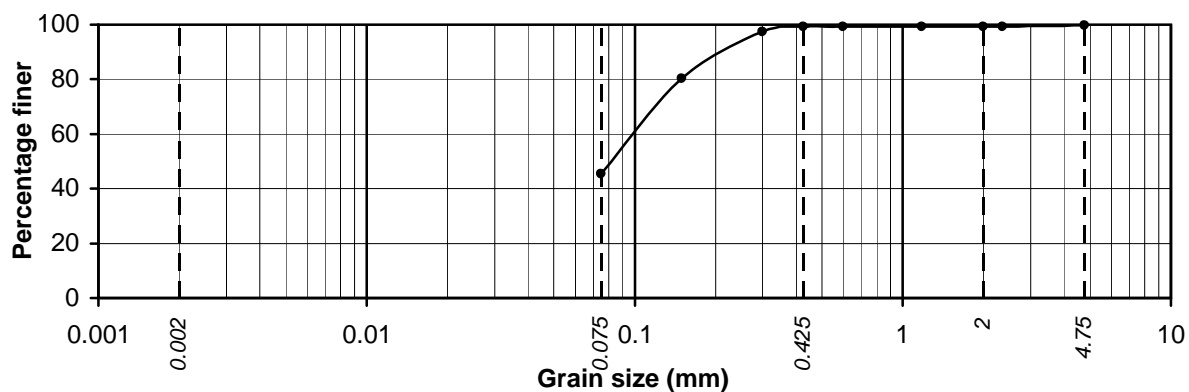

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 22.50m		*45.4	53.9	0.0	0.4	0.3

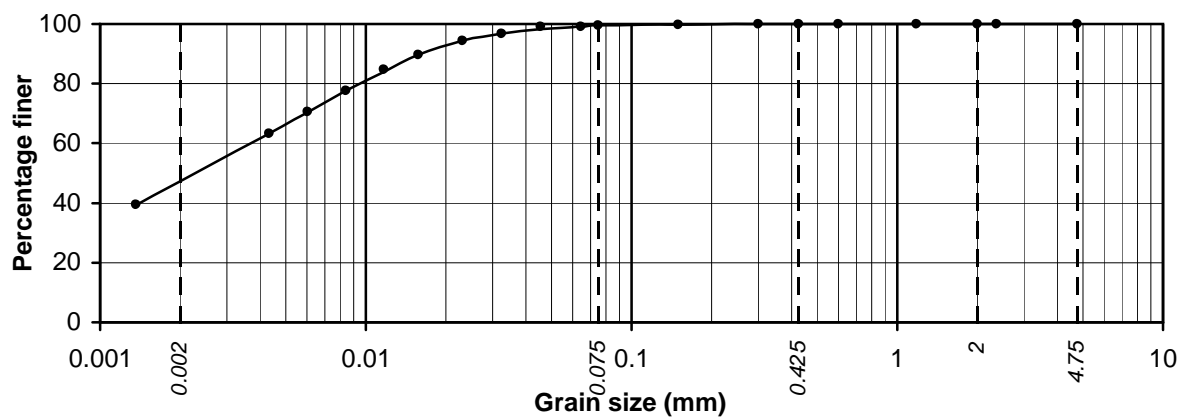

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 25.00m	47.2	52.4	0.4	0.0	0.0	0.0

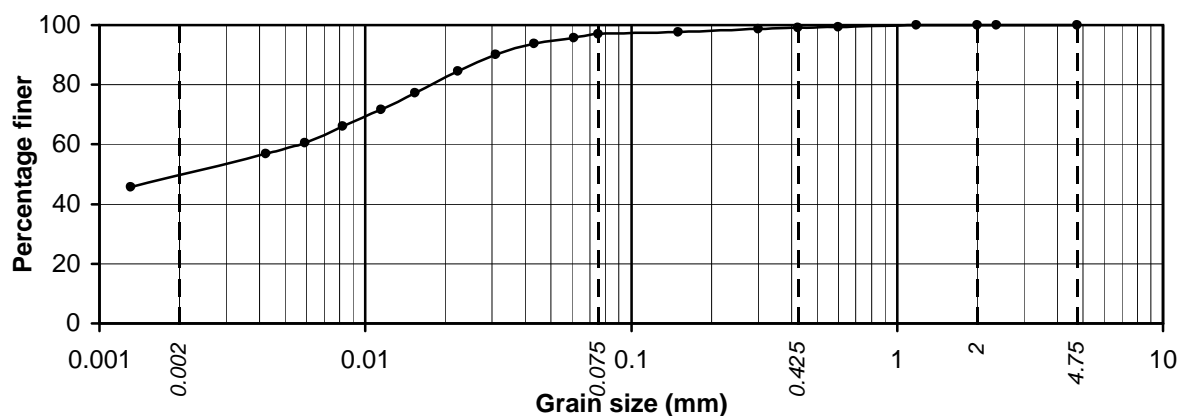

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-3, 28.00m	49.6	47.3	2.3	0.8	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/20


### GRAIN SIZE DISTRIBUTION CURVES

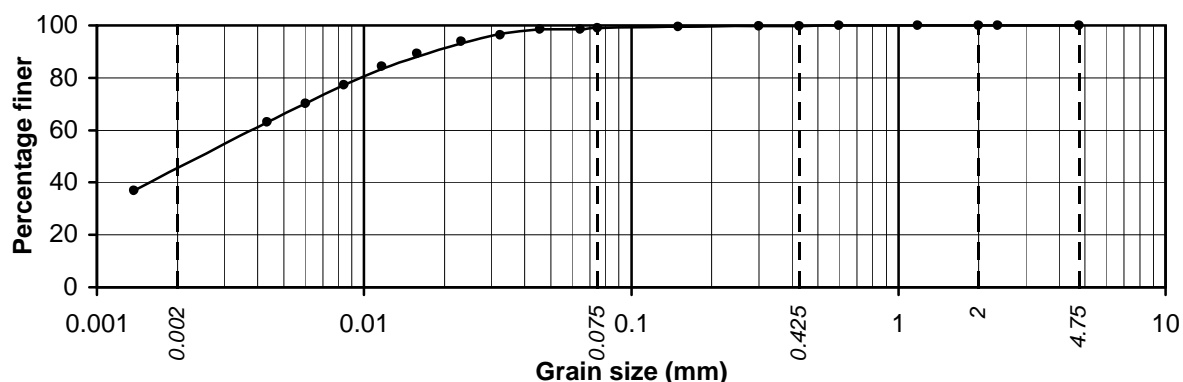

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 30.00m	45.5	53.6	0.8	0.1	0.0	0.0

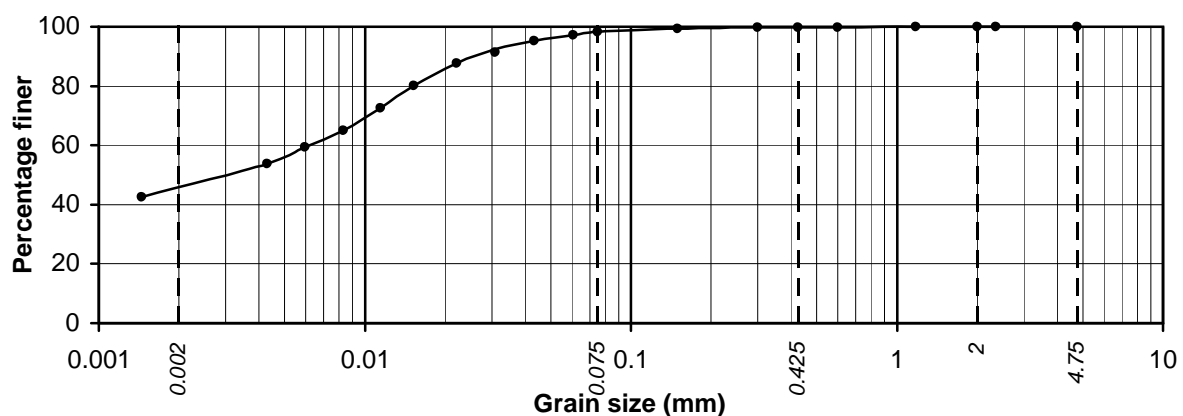

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 33.00m	45.9	52.4	1.5	0.2	0.0	0.0

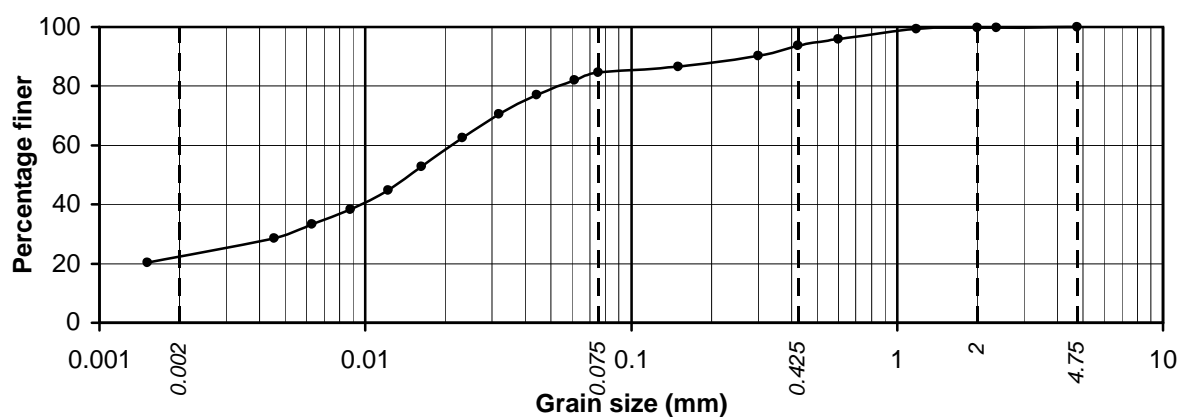


Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 36.00m	22.5	62.1	9.1	6.1	0.2	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/21


### GRAIN SIZE DISTRIBUTION CURVES

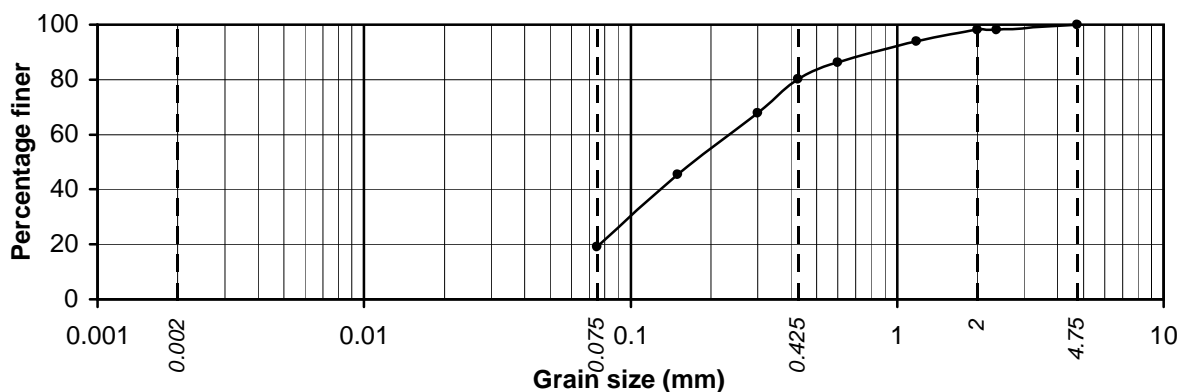

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 37.50m		*19.0	61.1	18.0	1.9	0.0

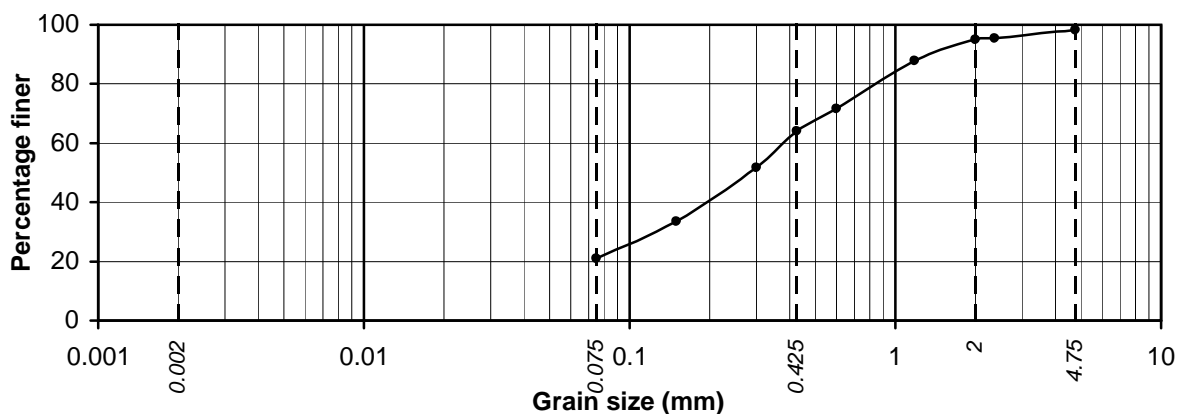

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 40.50m		*21.0	43.0	31.0	3.3	1.7

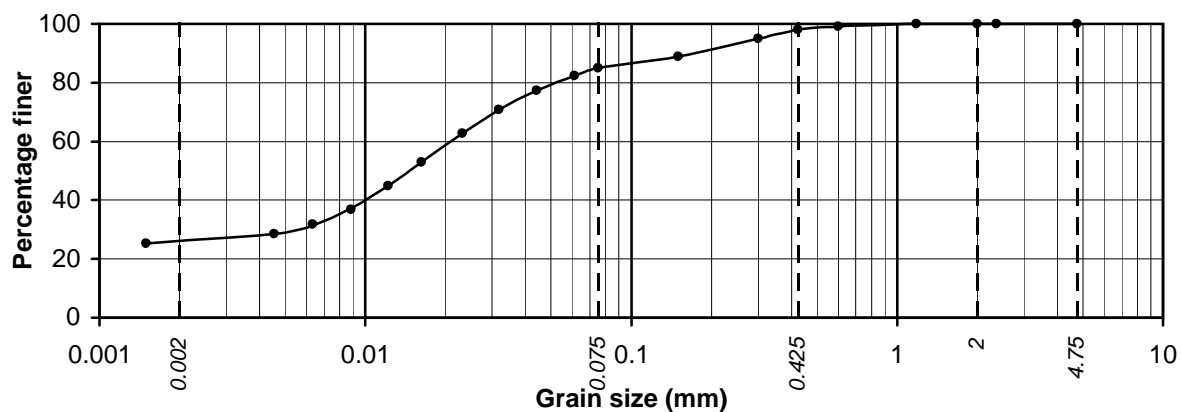

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 43.50m	26.2	58.7	13.2	1.9	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/22


### GRAIN SIZE DISTRIBUTION CURVES

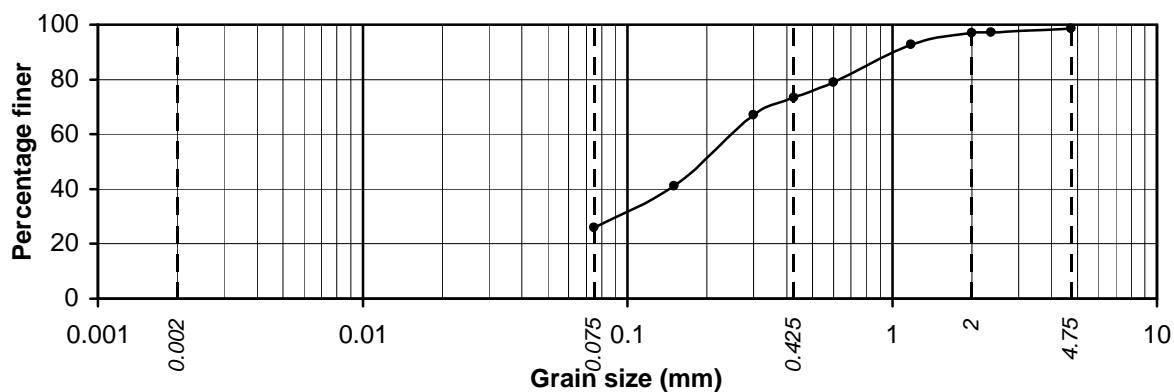

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 45.00m		*26.0	47.5	23.5	1.7	1.3

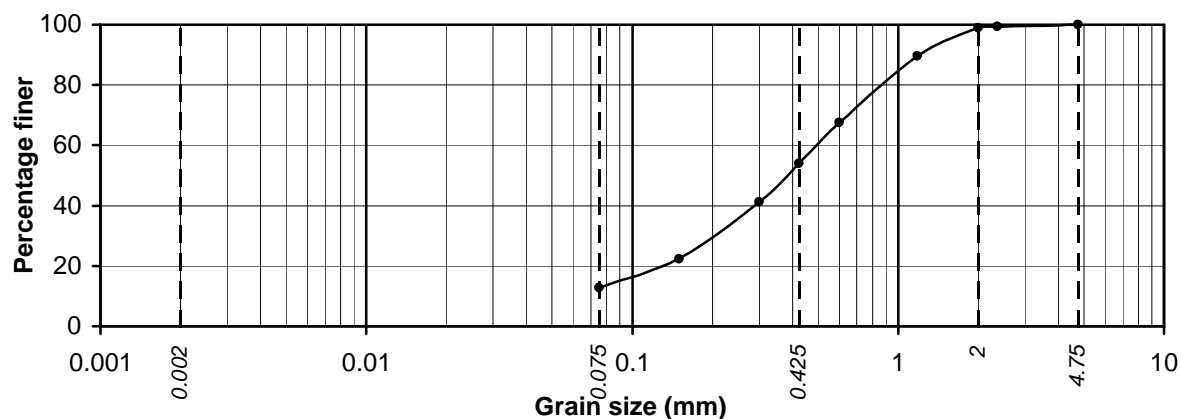

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-3, 48.00m		*12.7	41.3	45.0	1.0	0.0

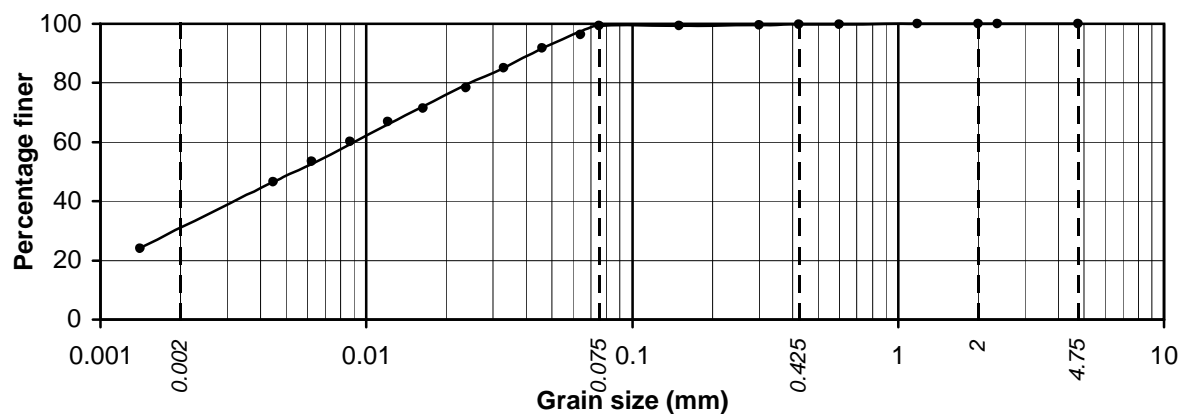

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-4, 0.50m	31.0	68.3	0.4	0.3	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/23


### GRAIN SIZE DISTRIBUTION CURVES

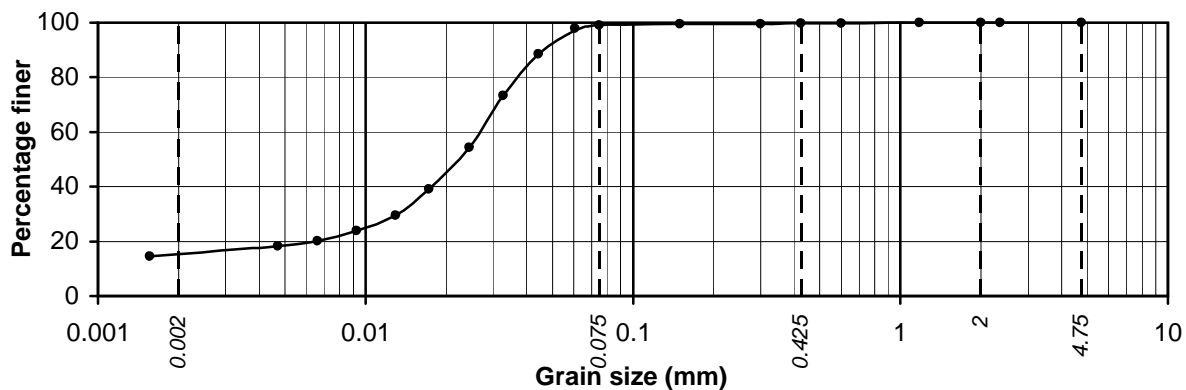

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 2.00m	15.3	83.9	0.5	0.3	0.0	0.0

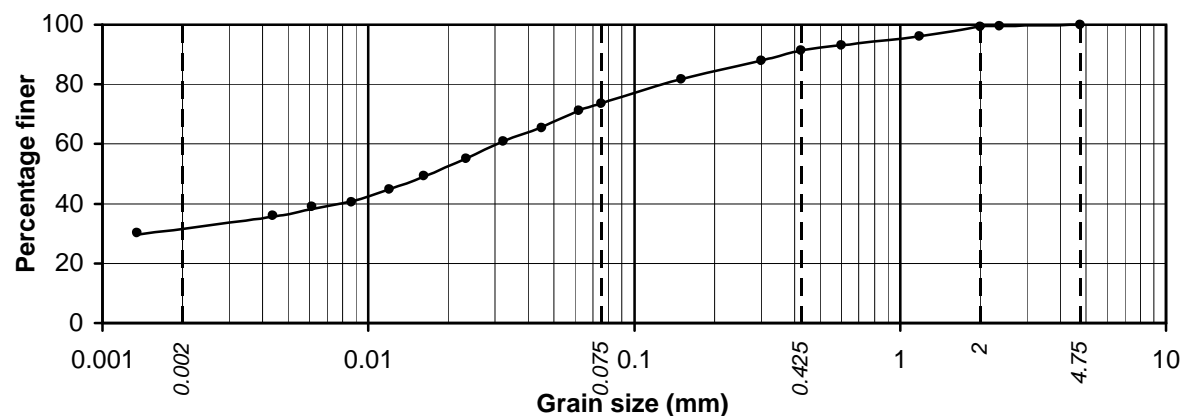

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 3.50m	31.6	42.0	17.9	8.0	0.5	0.0

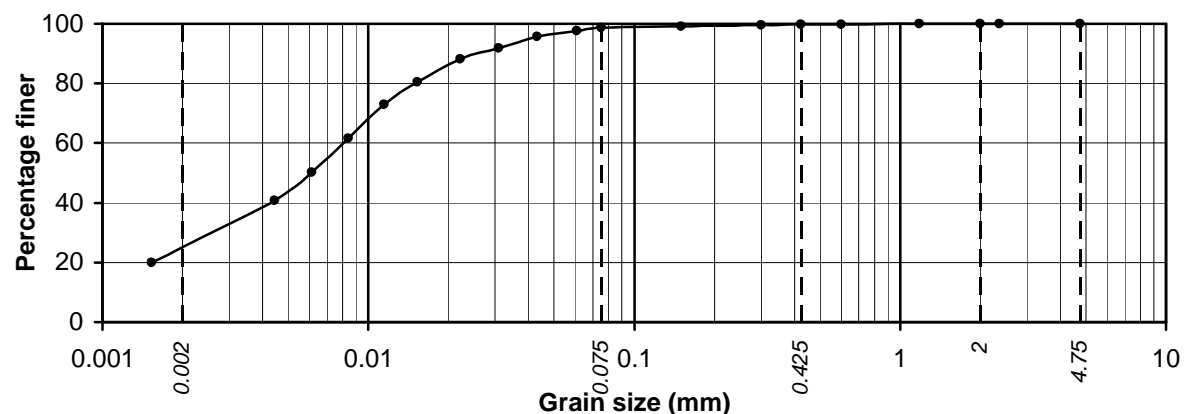

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 5.00m	25.3	73.5	1.0	0.2	0.0	0.0


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211


**Fig. No.**  
E/24




### GRAIN SIZE DISTRIBUTION CURVES

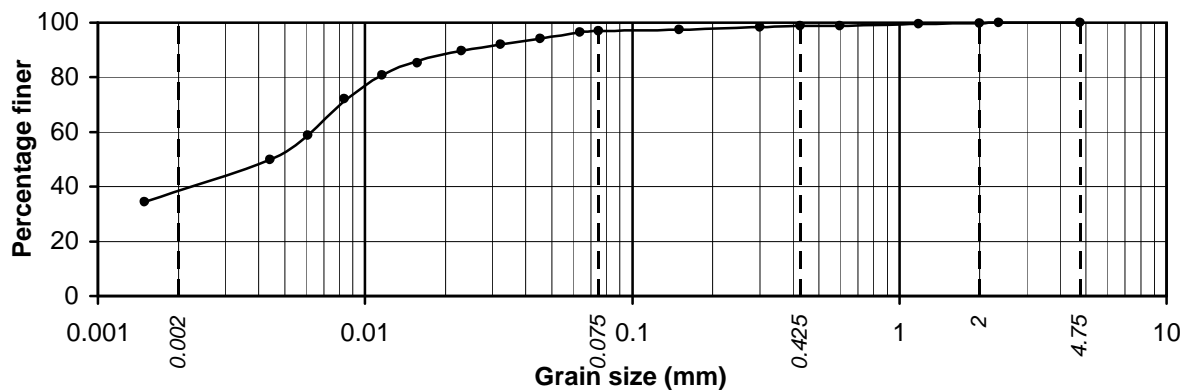

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 6.50m	38.6	58.5	1.7	1.1	0.1	0.0

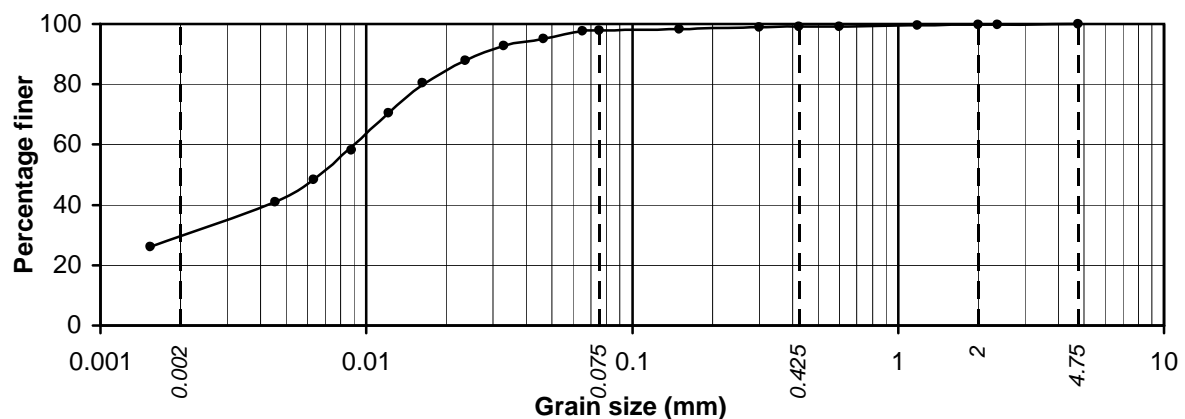

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 8.00m	29.7	68.3	1.1	0.7	0.2	0.0

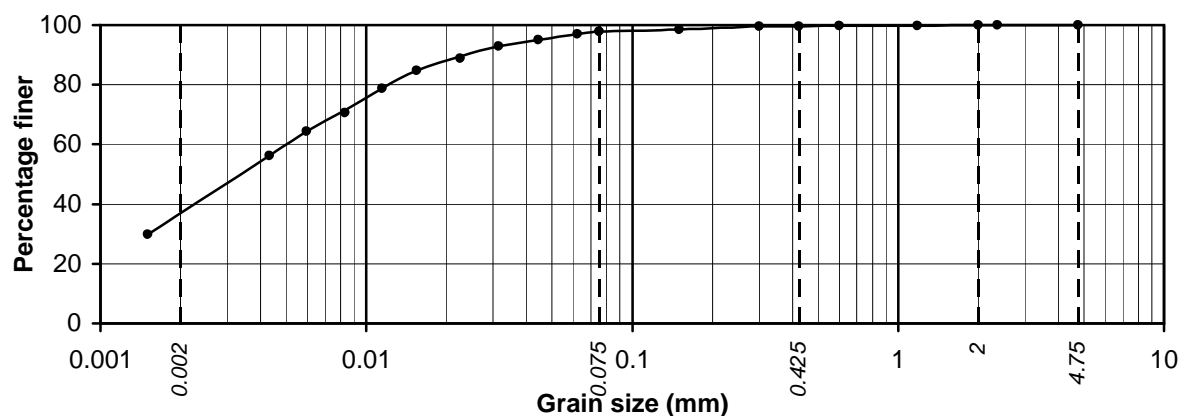


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 9.50m	36.8	61.2	1.7	0.3	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/25


### GRAIN SIZE DISTRIBUTION CURVES

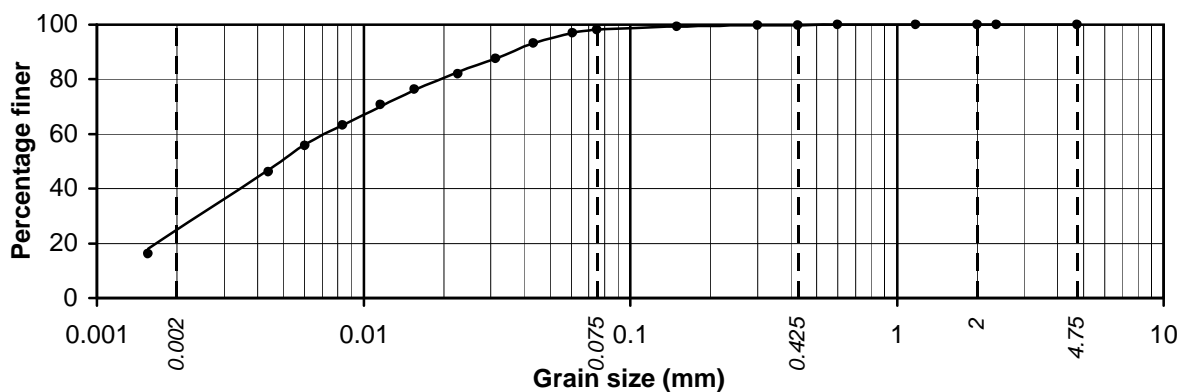

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 11.00m	25.0	73.2	1.7	0.1	0.0	0.0

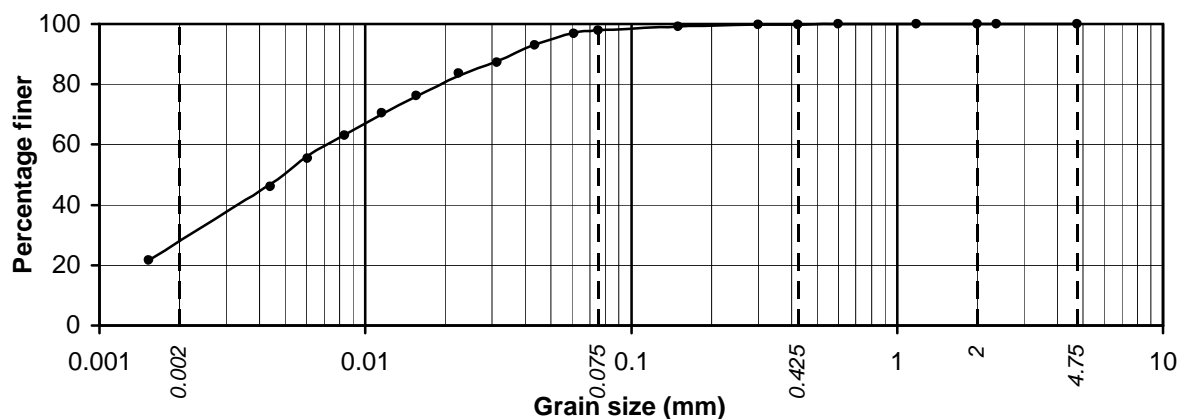

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 11.50m	28.0	70.0	1.9	0.1	0.0	0.0

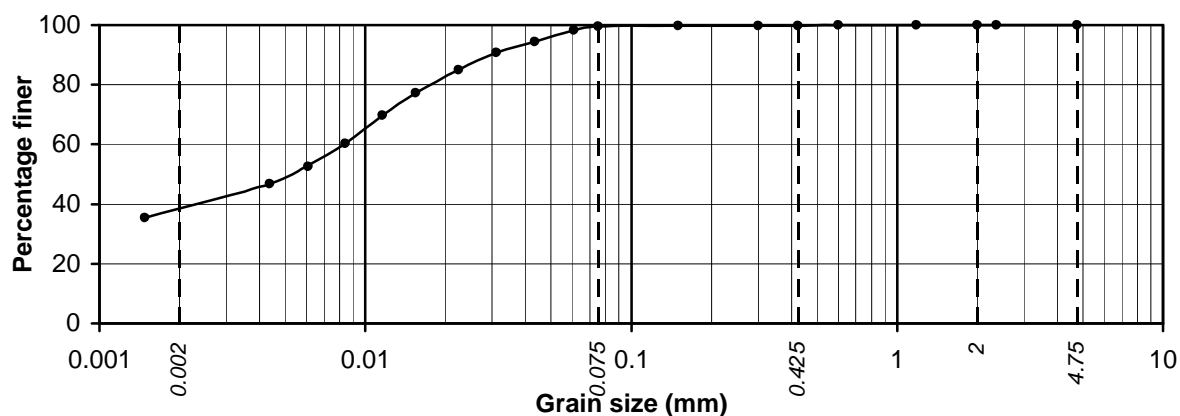


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 14.00m	38.6	60.9	0.4	0.1	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/26


### GRAIN SIZE DISTRIBUTION CURVES

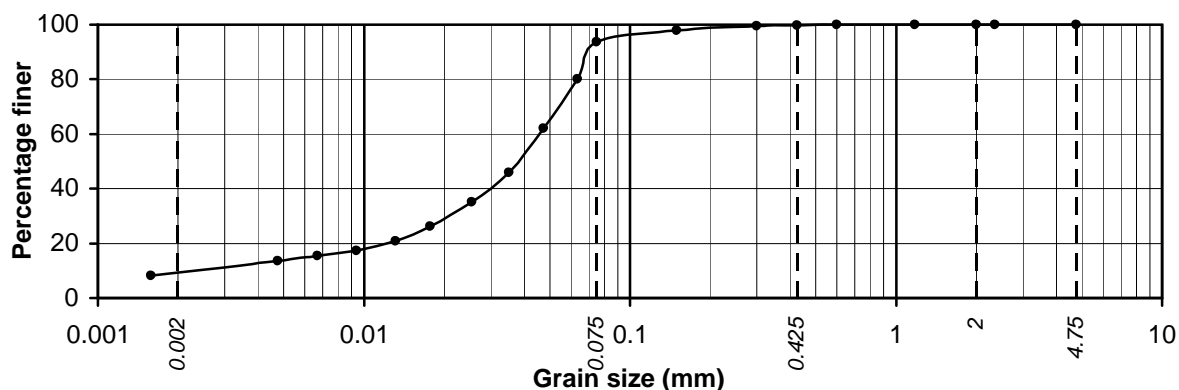

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 17.00m	9.4	84.3	6.1	0.2	0.0	0.0

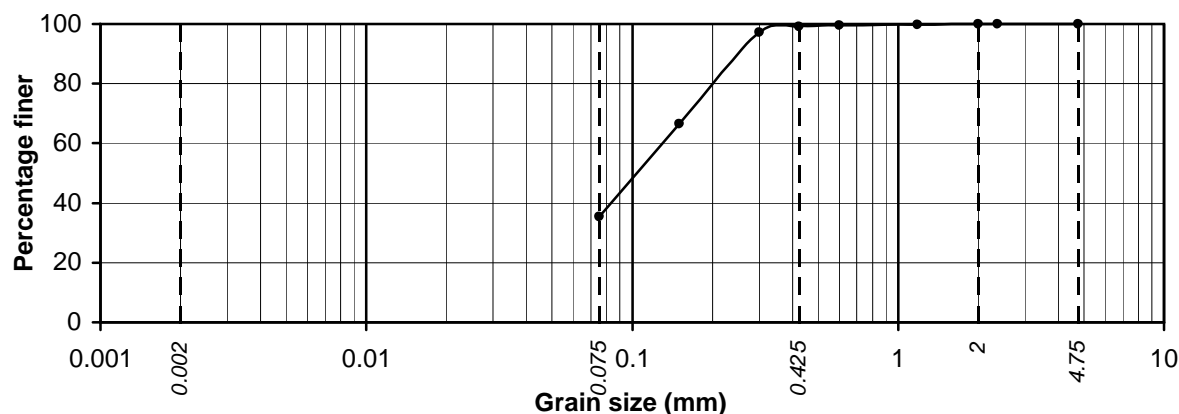

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 17.50m		*35.4	63.8	0.8	0.0	0.0

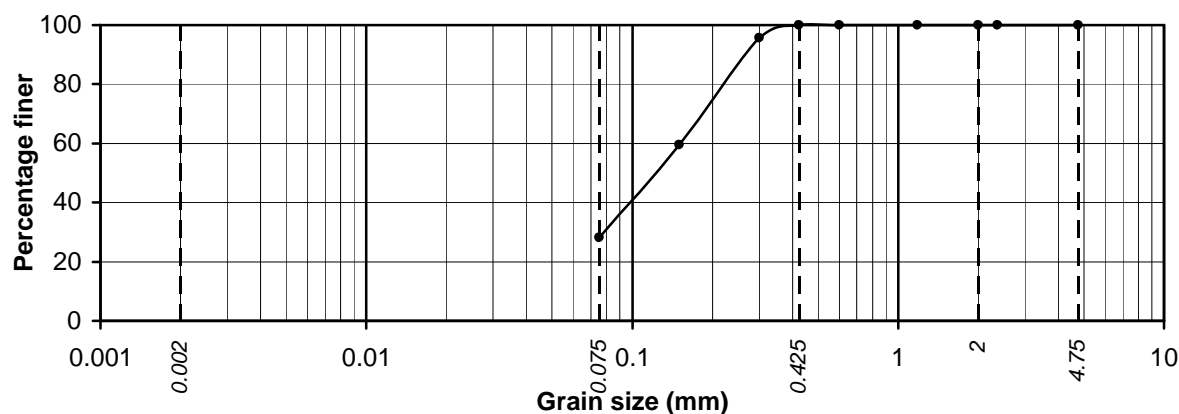

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 20.50m		*28.2	71.8	0.0	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/27


### GRAIN SIZE DISTRIBUTION CURVES

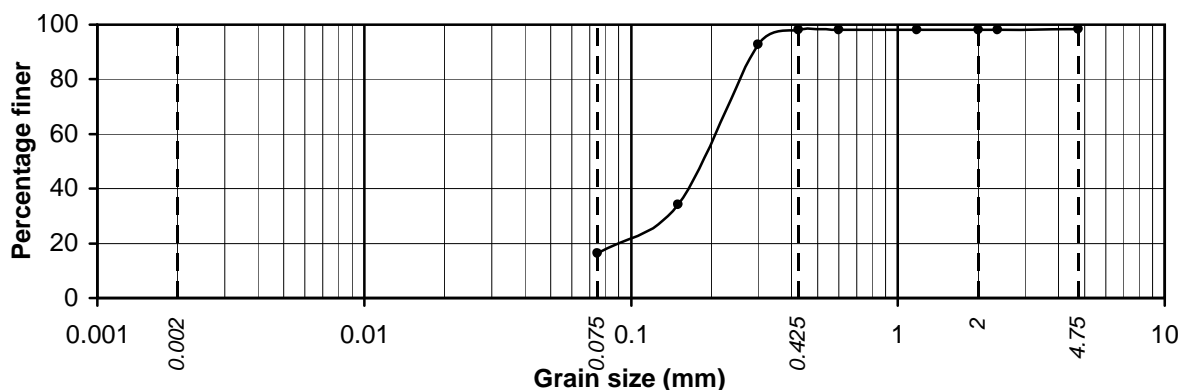

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 23.50m		*16.5	81.7	0.0	0.2	1.6

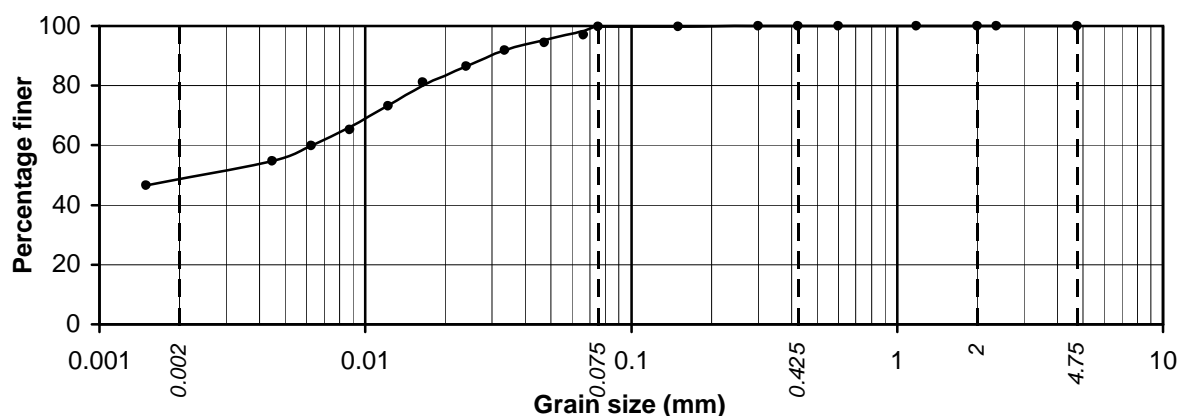

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 25.00m	48.8	50.9	0.3	0.0	0.0	0.0

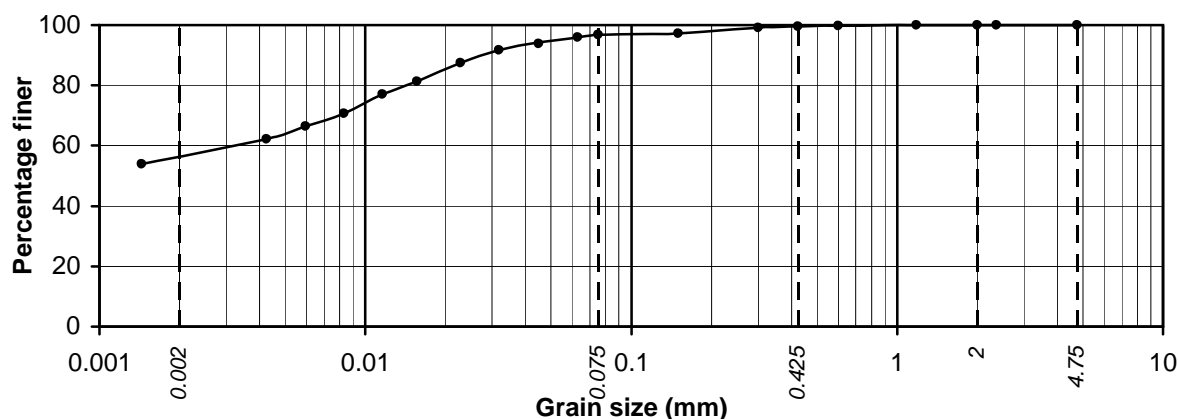

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 26.00m	56.5	40.3	2.8	0.4	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/28


### GRAIN SIZE DISTRIBUTION CURVES

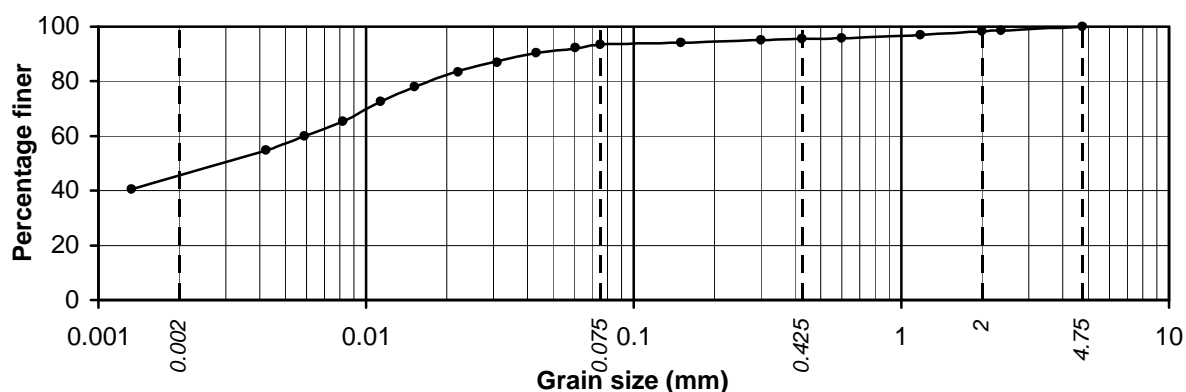

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 28.00m	45.4	48.0	2.1	2.8	1.7	0.0

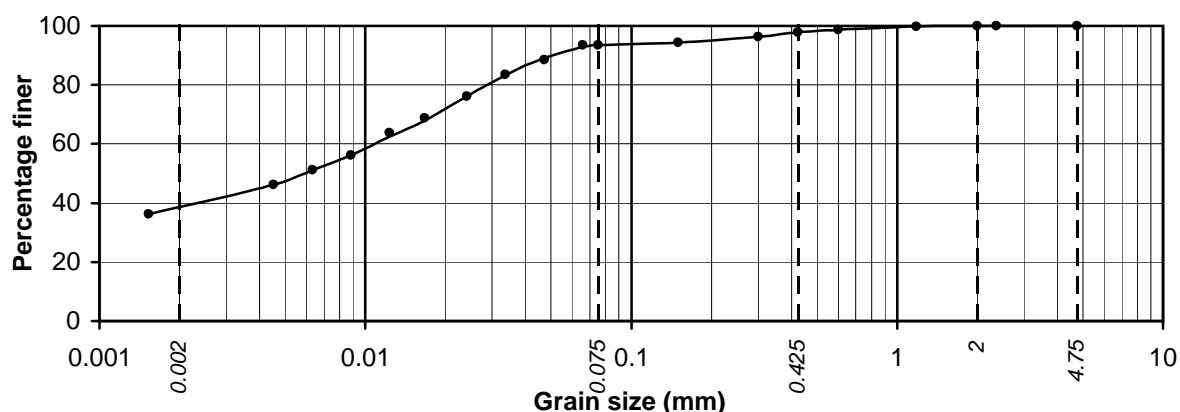

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 31.00m	38.8	54.8	4.2	2.2	0.0	0.0

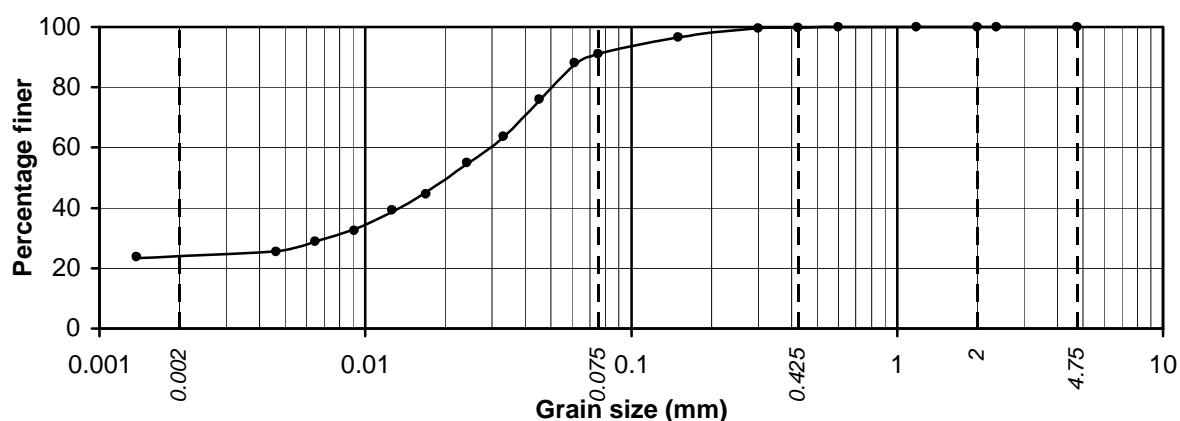


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 32.50m	24.0	67.0	8.8	0.2	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/29


### GRAIN SIZE DISTRIBUTION CURVES

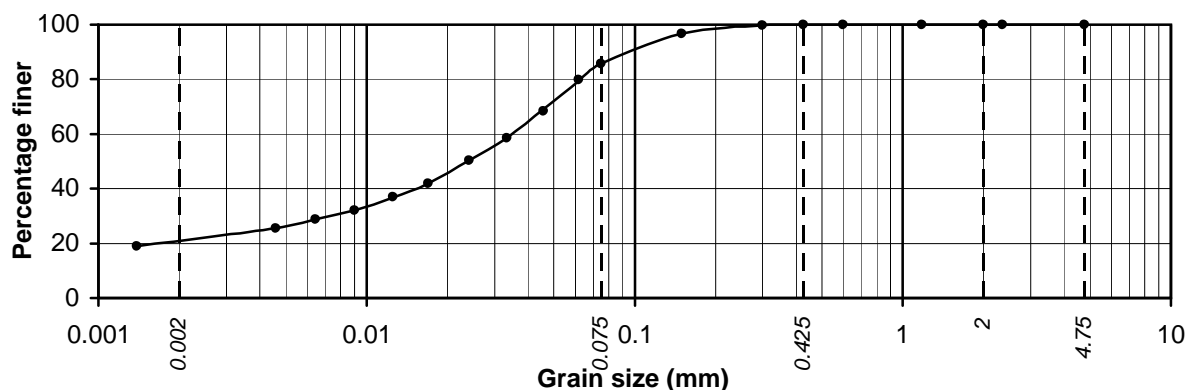

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 34.00m	21.0	64.7	14.2	0.1	0.0	0.0

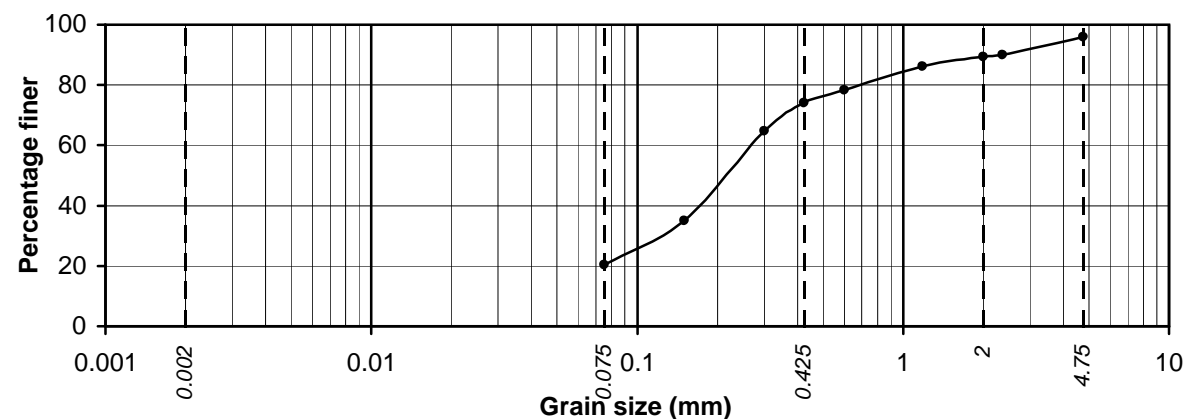

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 37.00m	*20.3		53.8	15.4	6.4	4.1

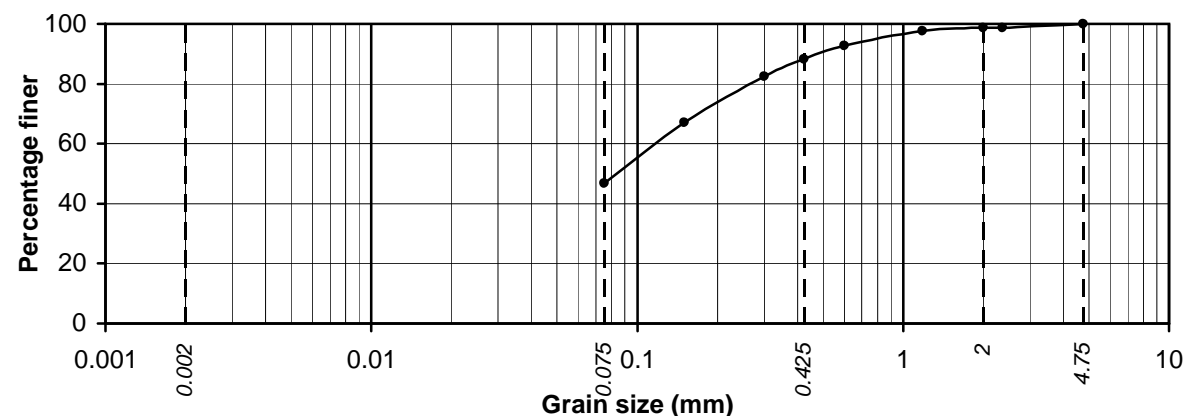

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-4, 40.00m	*46.8		41.5	10.5	1.2	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/30


### GRAIN SIZE DISTRIBUTION CURVES

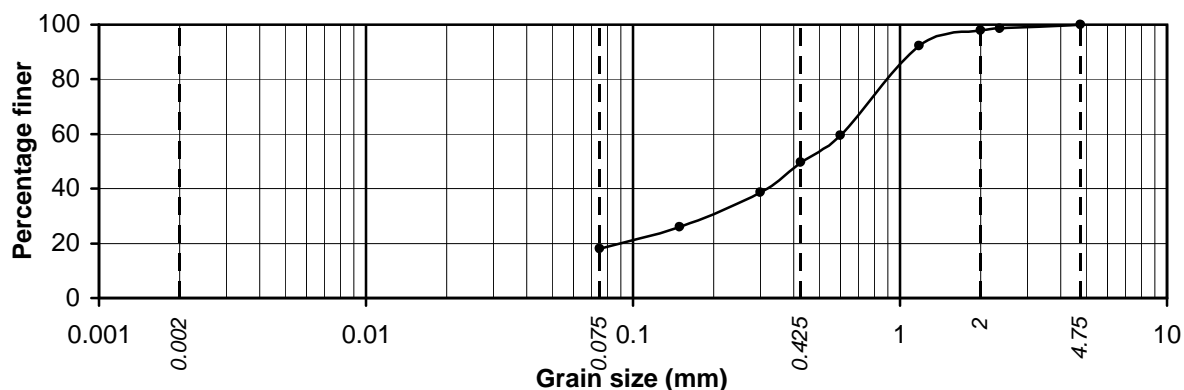

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-4, 43.00m		*18.0	31.7	48.3	2.0	0.0

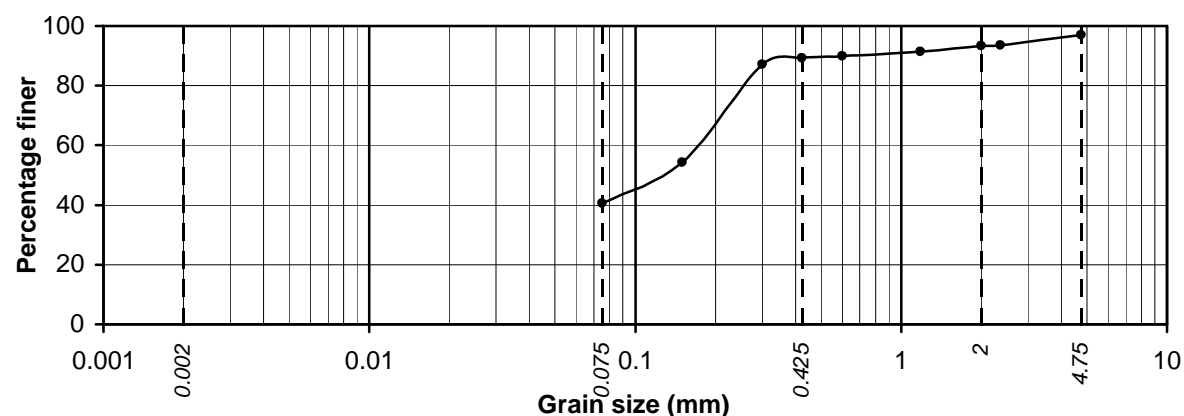

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-4, 48.00m		*40.5	48.9	3.9	3.7	3.0

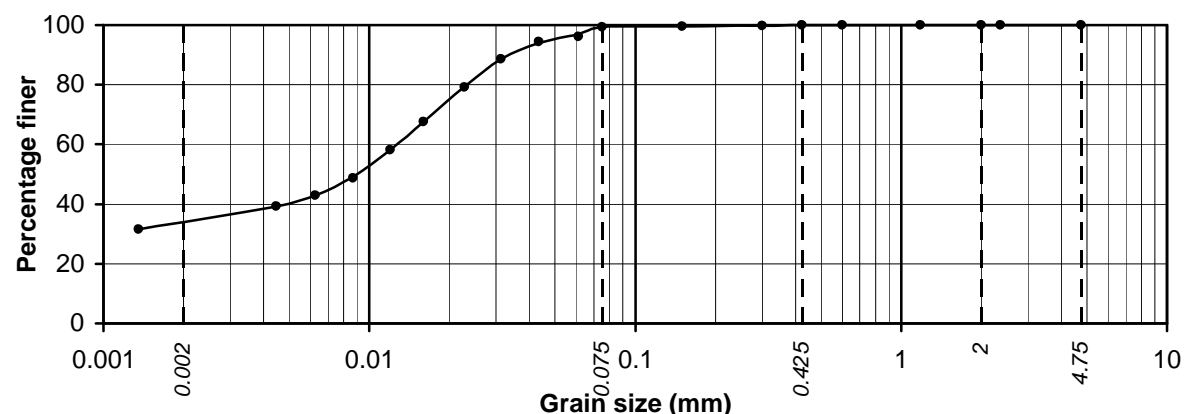

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-5, 1.00m	34.0	65.3	0.6	0.1	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/31


### GRAIN SIZE DISTRIBUTION CURVES

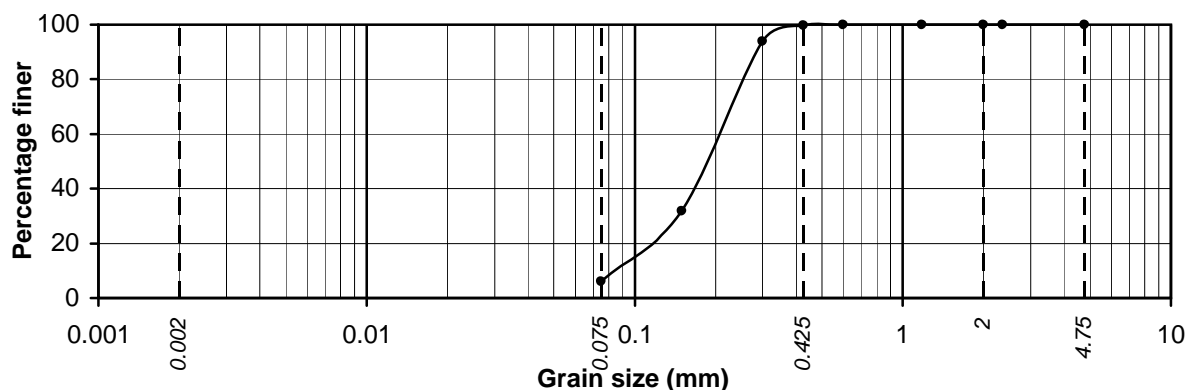

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 2.50m		*6.1	93.7	0.2	0.0	0.0

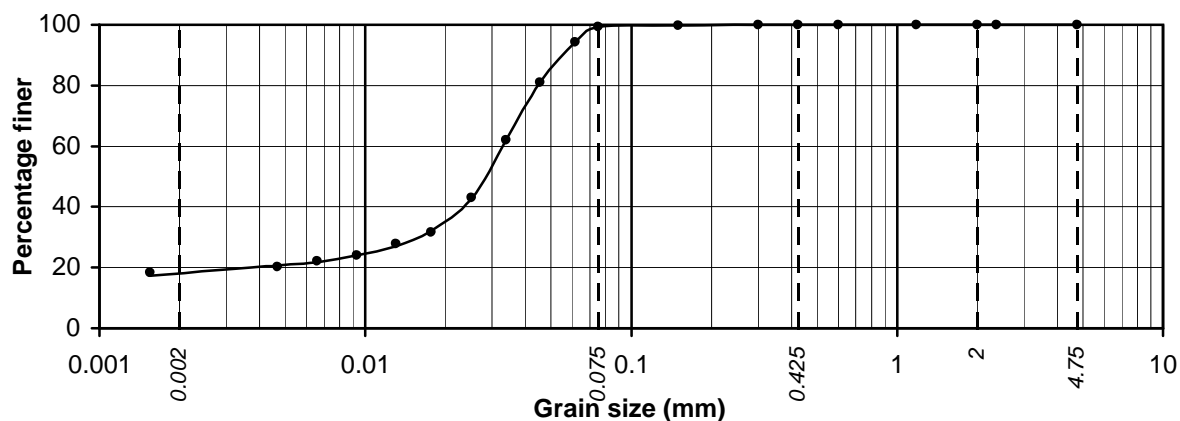

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 4.00m	18.0	81.3	0.6	0.1	0.0	0.0

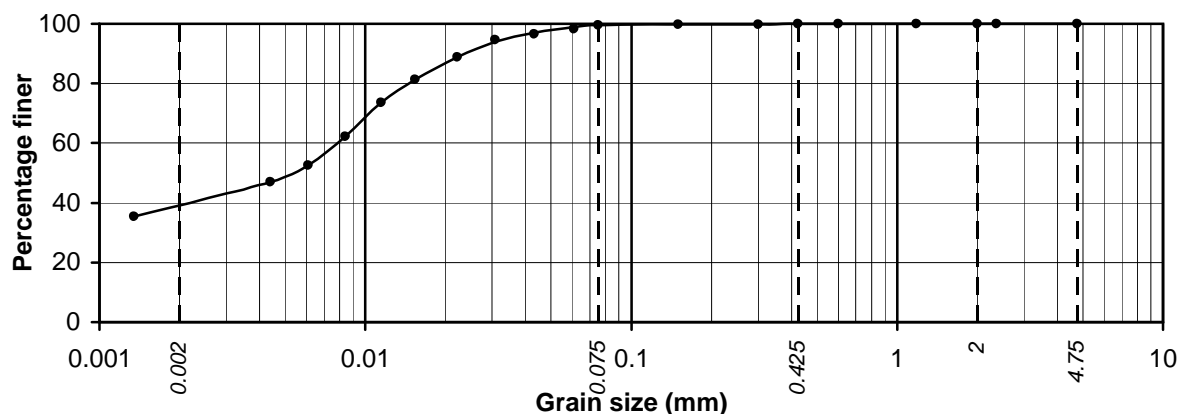

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 5.50m	39.3	60.3	0.3	0.1	0.0	0.0

\*Silt & Clay


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211


**Fig. No.**  
E/32




### GRAIN SIZE DISTRIBUTION CURVES

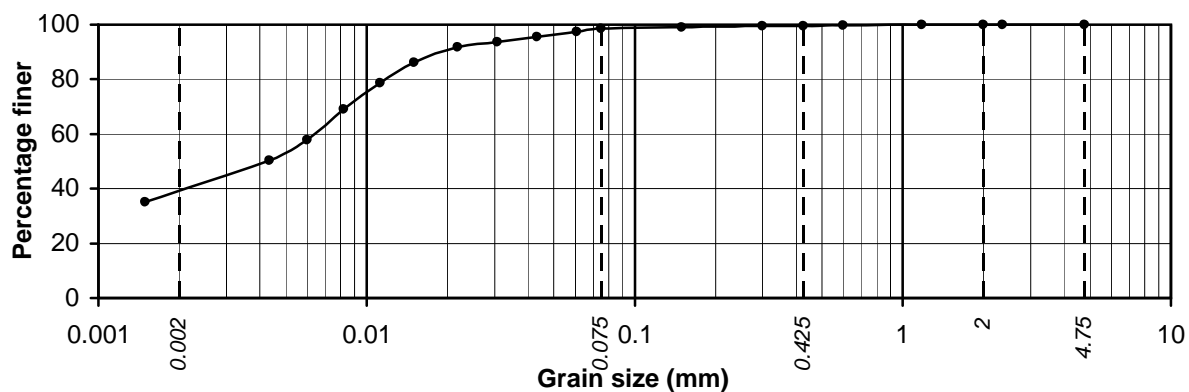

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 7.00m	39.3	59.4	0.9	0.4	0.0	0.0

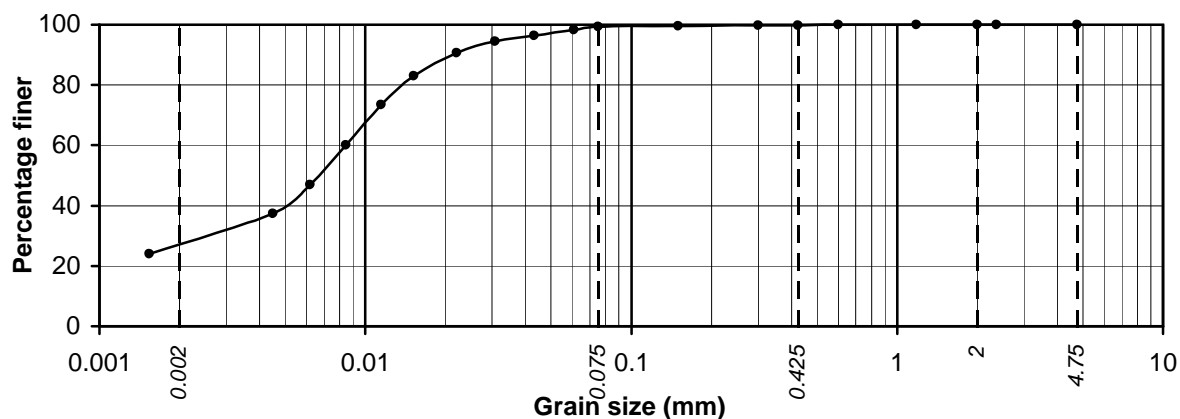

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 8.50m	27.2	72.3	0.4	0.1	0.0	0.0

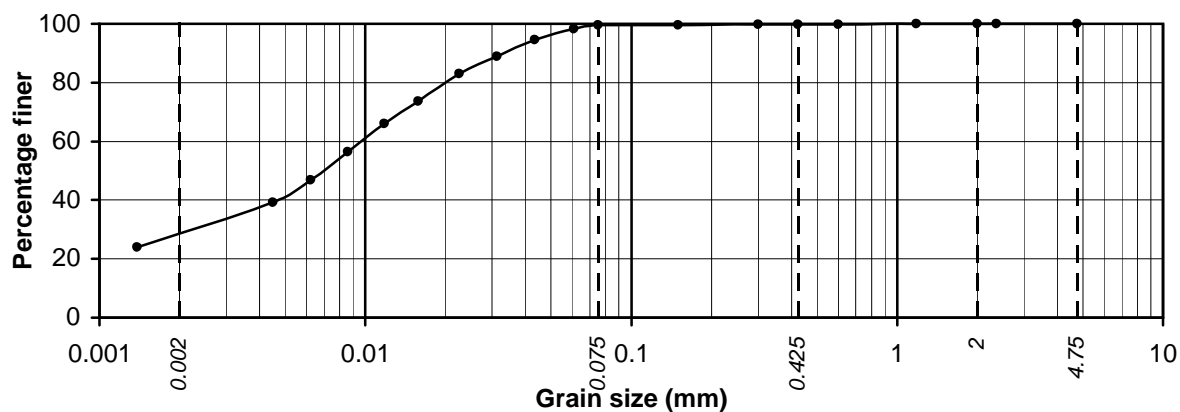


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 10.00m	28.8	70.7	0.3	0.2	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/33


### GRAIN SIZE DISTRIBUTION CURVES

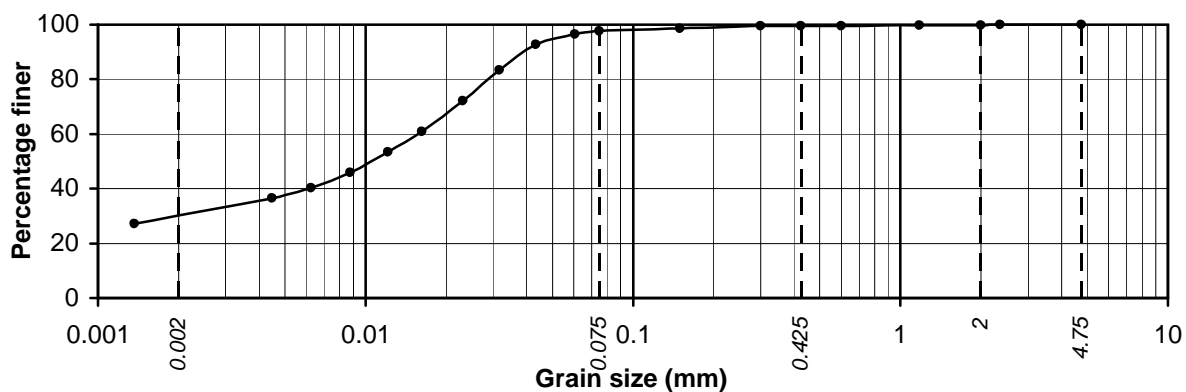

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 13.00m	30.3	67.3	2.0	0.3	0.1	0.0

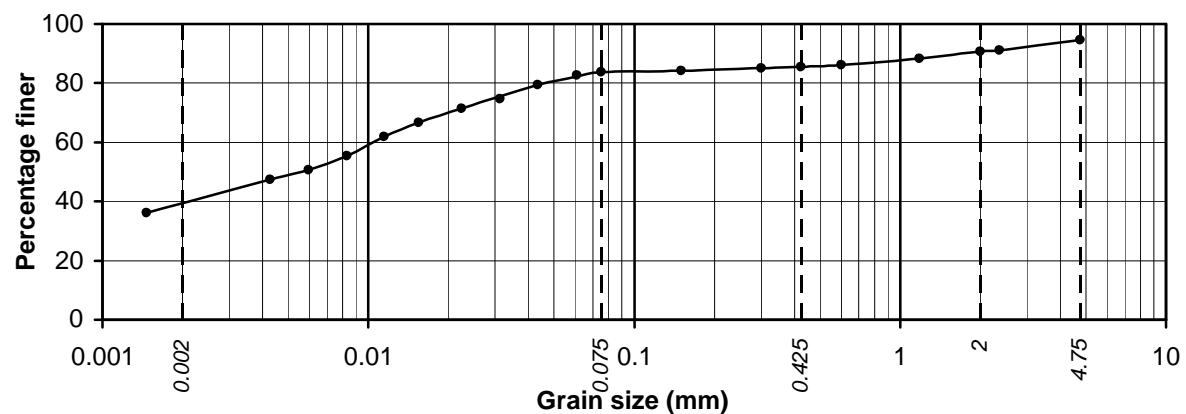

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 15.00m	39.5	44.2	1.8	5.1	4.0	5.4

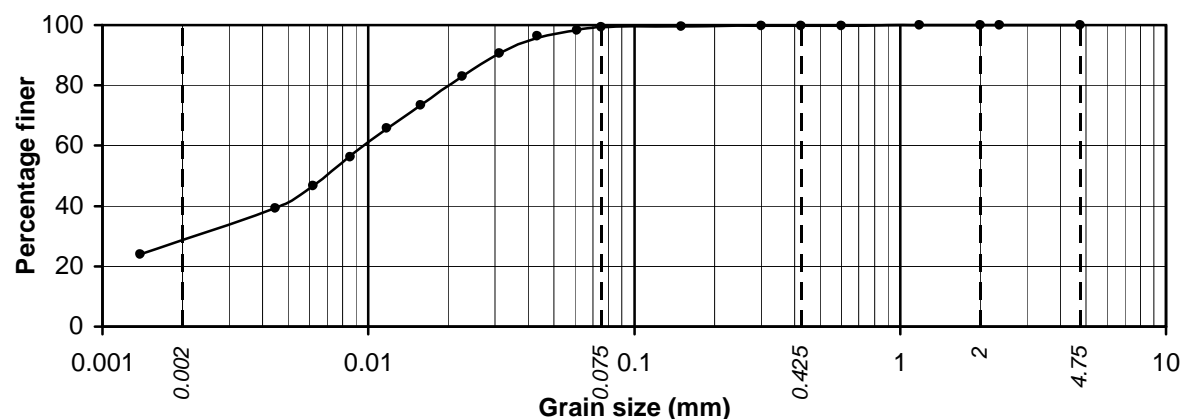


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 16.00m	28.7	70.7	0.4	0.2	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/34


### GRAIN SIZE DISTRIBUTION CURVES

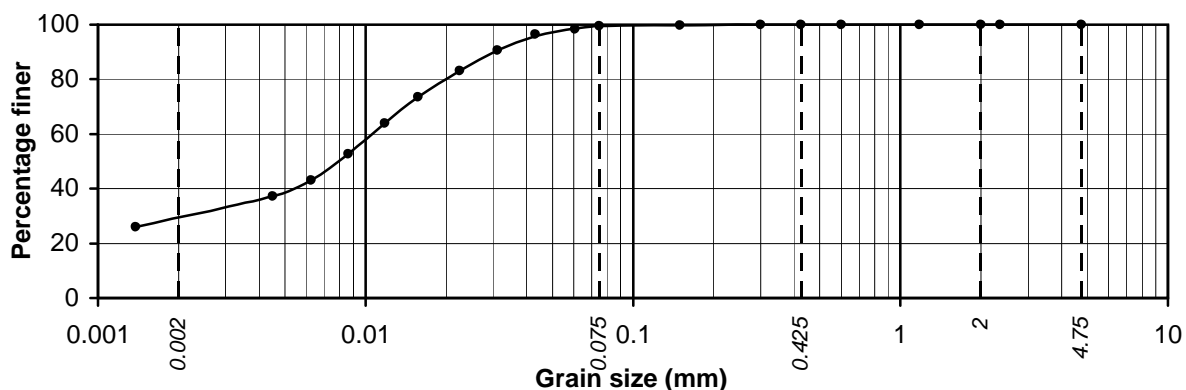

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 18.00m	29.5	70.0	0.4	0.1	0.0	0.0

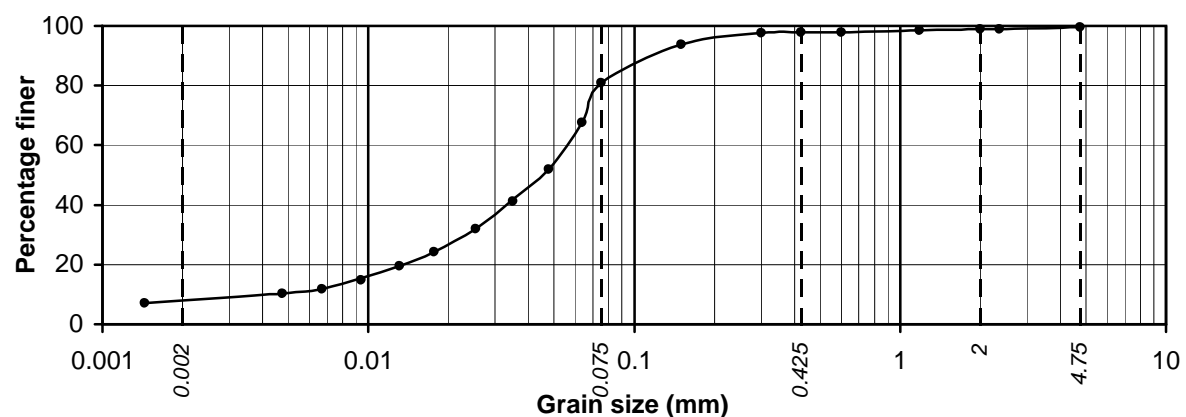

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 21.00m	8.0	72.9	16.9	1.1	0.7	0.4

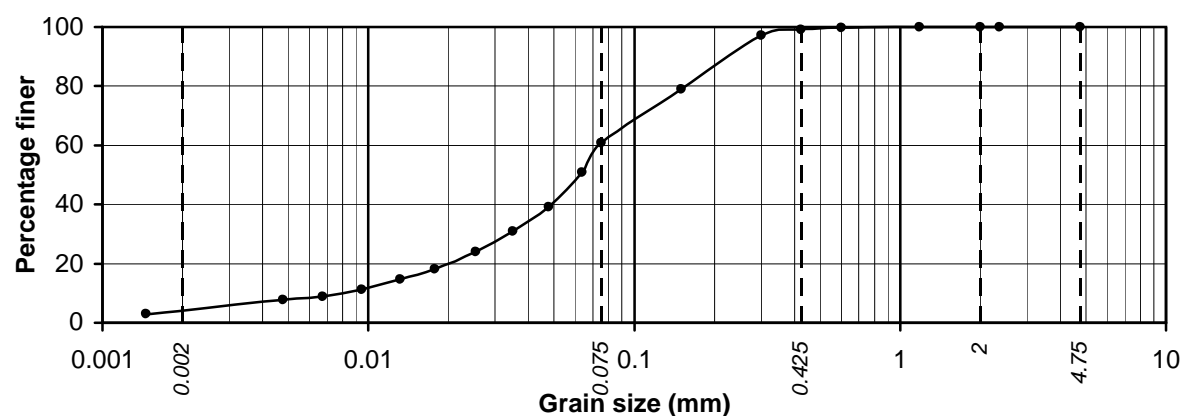


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 22.50m	4.1	56.8	38.2	0.9	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/35


### GRAIN SIZE DISTRIBUTION CURVES

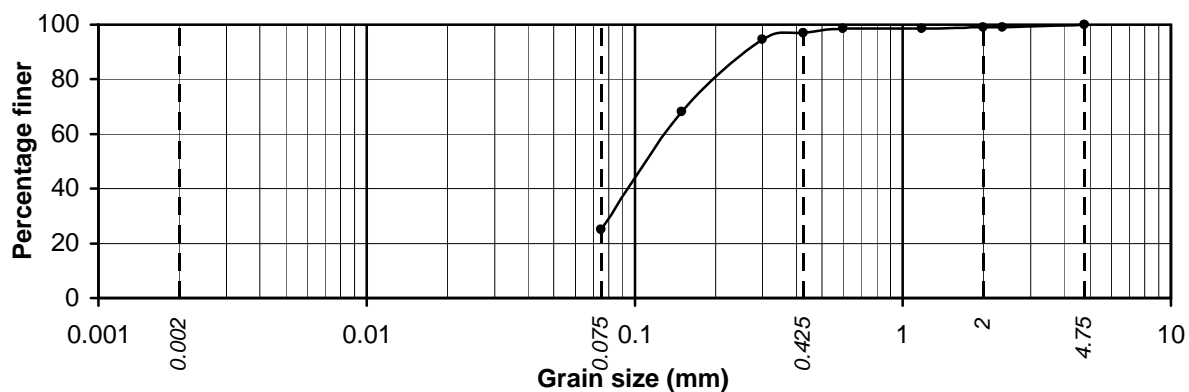

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 24.00m		*25.0	72.0	2.0	1.0	0.0

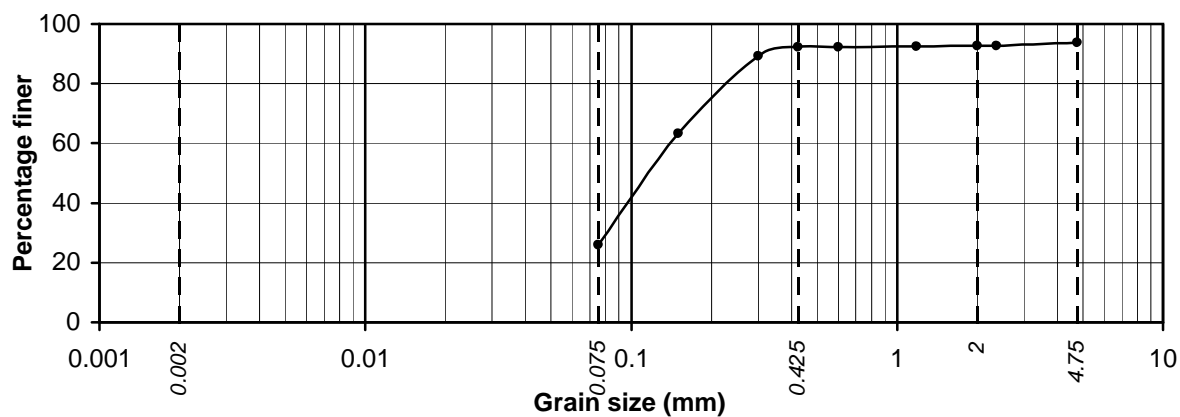

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 27.00m		*26.0	66.2	0.6	1.0	6.2

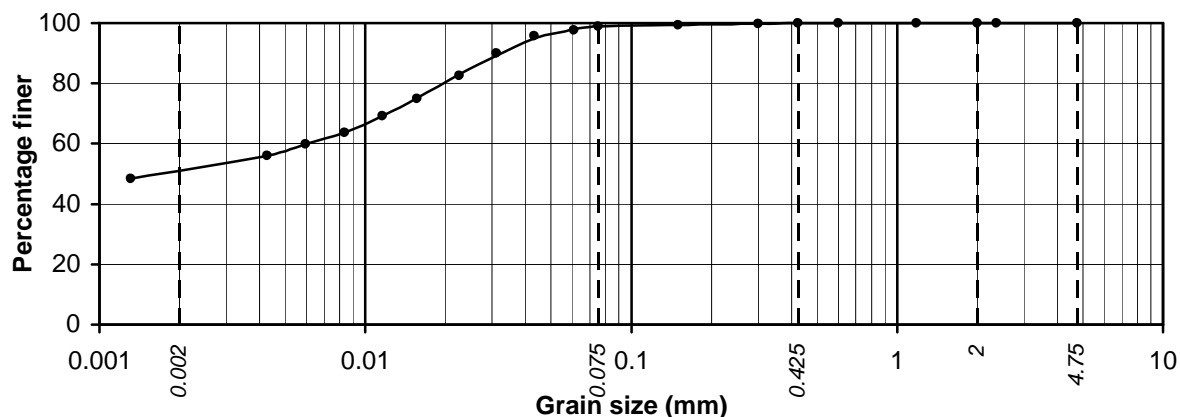

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 28.50m	51.1	47.7	1.1	0.1	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/36


### GRAIN SIZE DISTRIBUTION CURVES

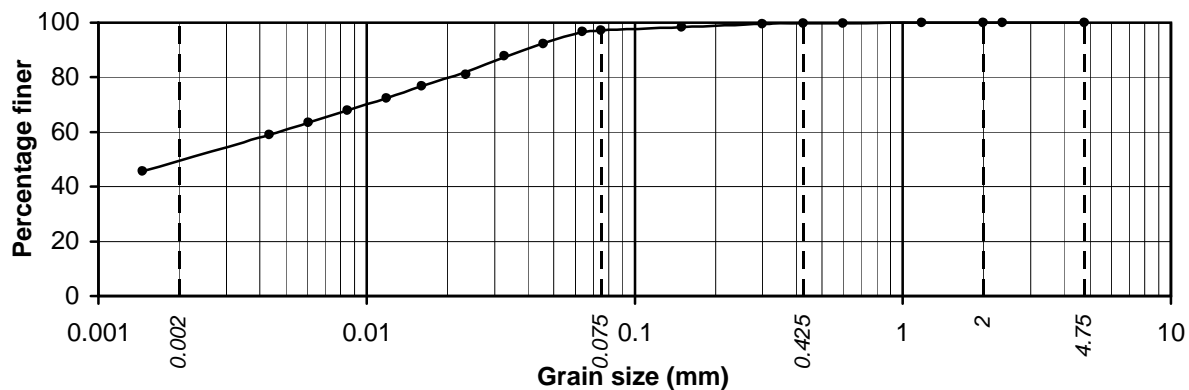

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 29.50m	49.5	47.8	2.4	0.3	0.0	0.0

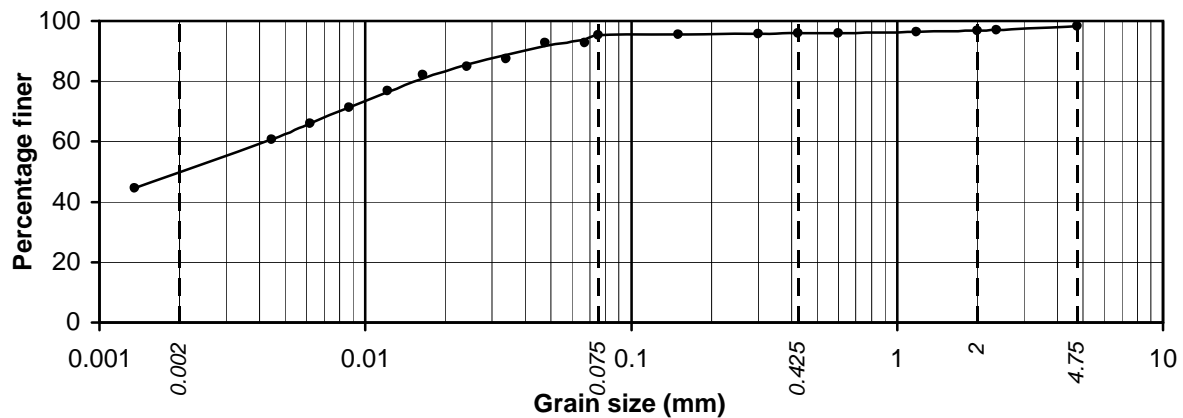

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 32.50m	49.8	45.5	0.6	1.0	1.4	1.7

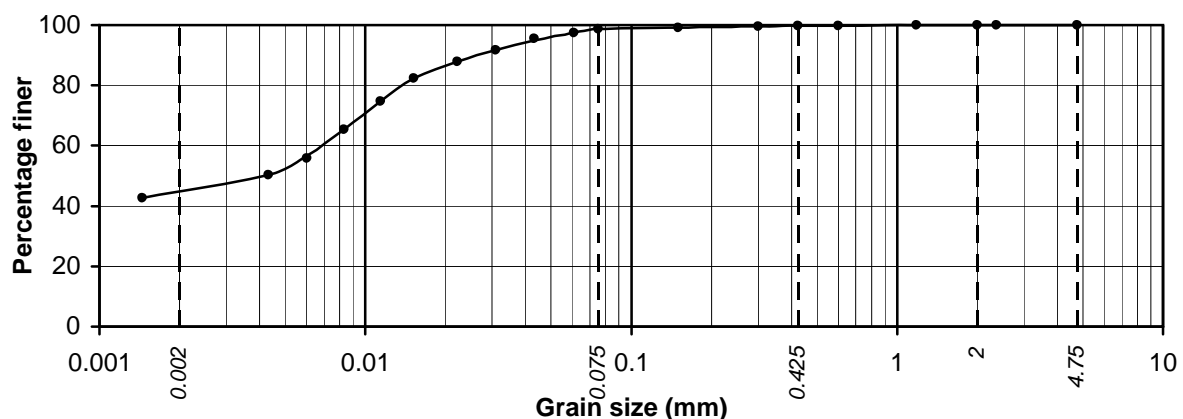


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 34.50m	44.9	53.8	1.1	0.2	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/37


### GRAIN SIZE DISTRIBUTION CURVES

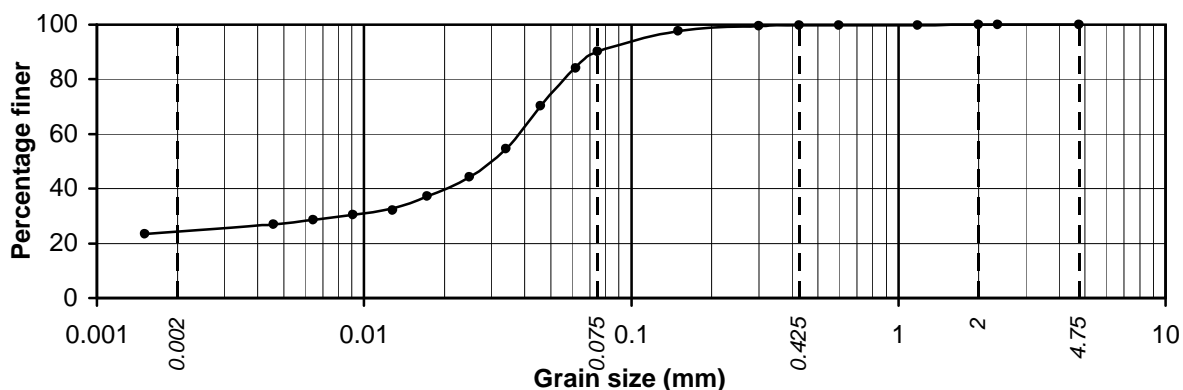

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 37.50m	24.4	65.8	9.4	0.3	0.1	0.0

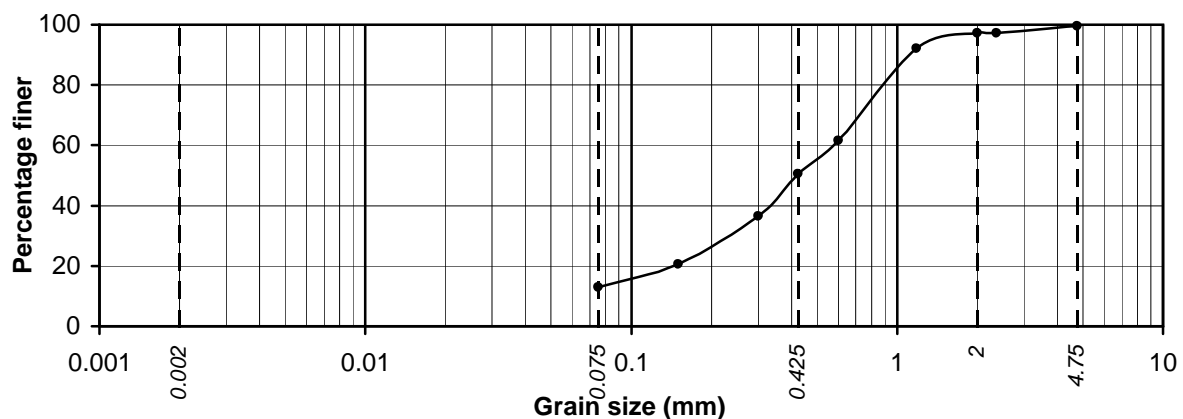

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 40.50m	*12.9		37.7	46.6	2.3	0.5

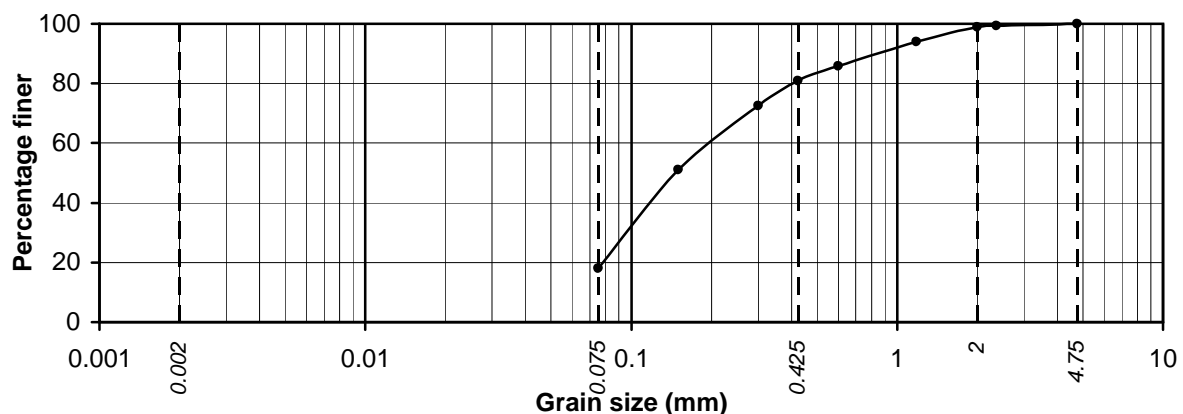

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 42.00m	*18.0		63.0	18.0	1.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/38


### GRAIN SIZE DISTRIBUTION CURVES

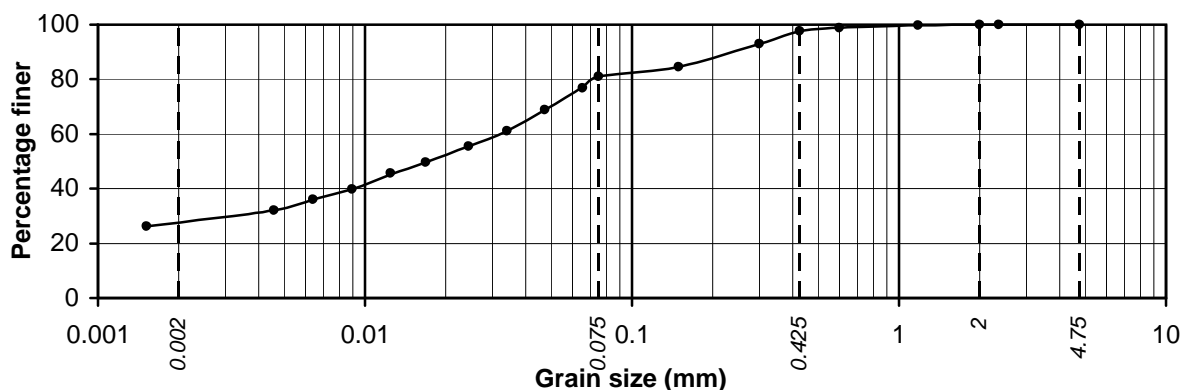

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 45.00m	27.8	53.2	16.7	2.3	0.0	0.0

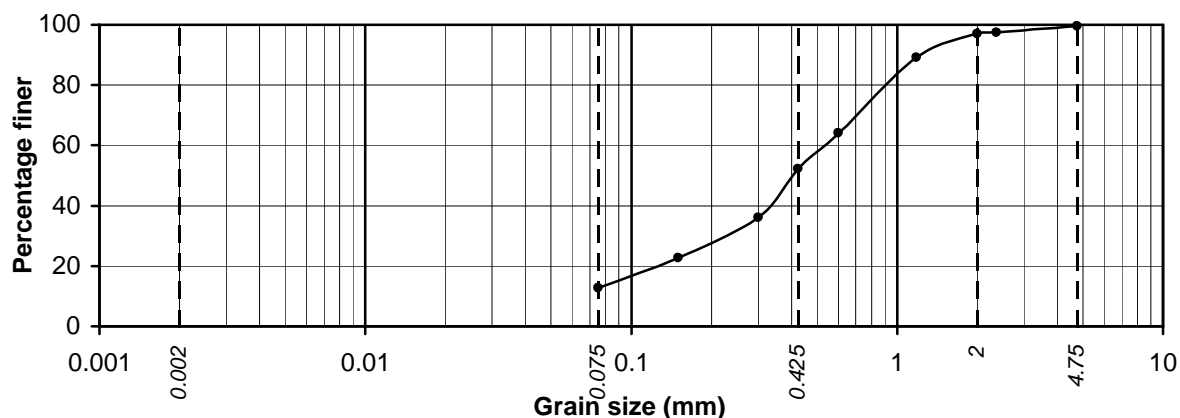

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-5, 48.00m	*12.8		39.4	44.7	2.7	0.4

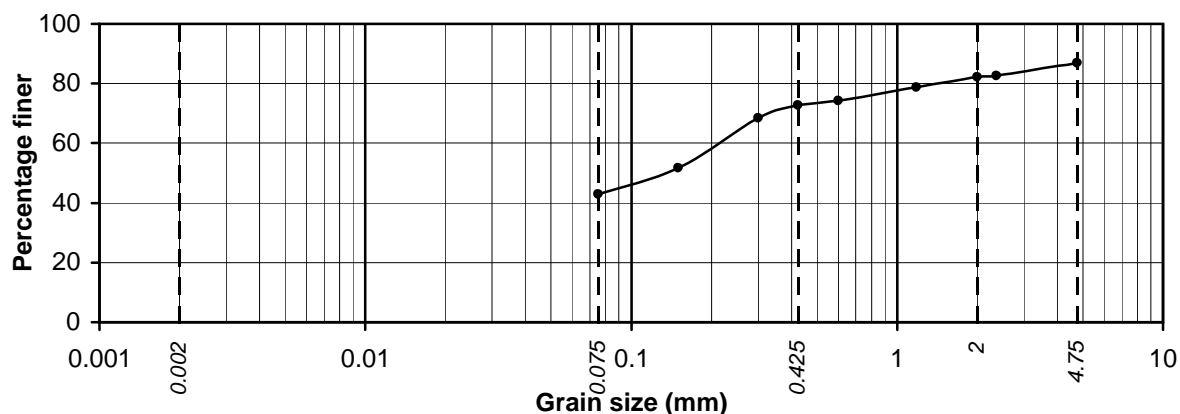

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 1.50m	*43.1		29.7	9.4	4.7	13.1


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/39


### GRAIN SIZE DISTRIBUTION CURVES

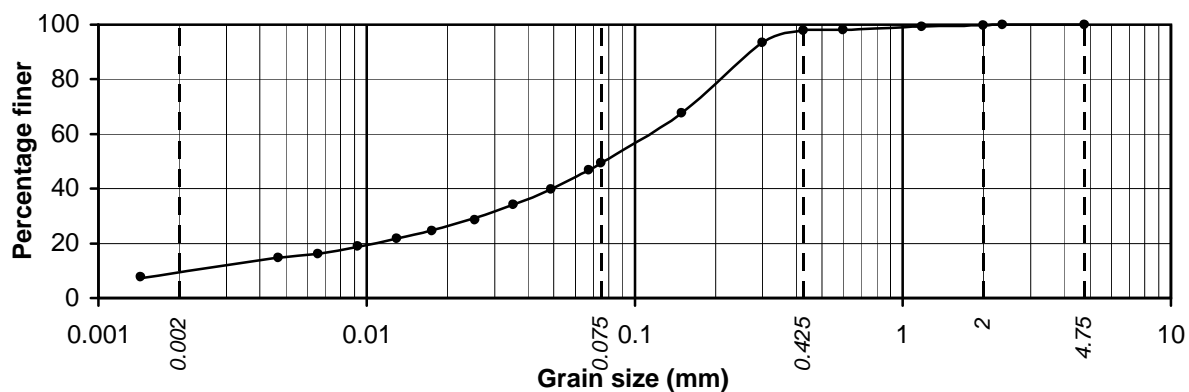

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 3.00m	9.4	40.0	48.4	1.9	0.3	0.0

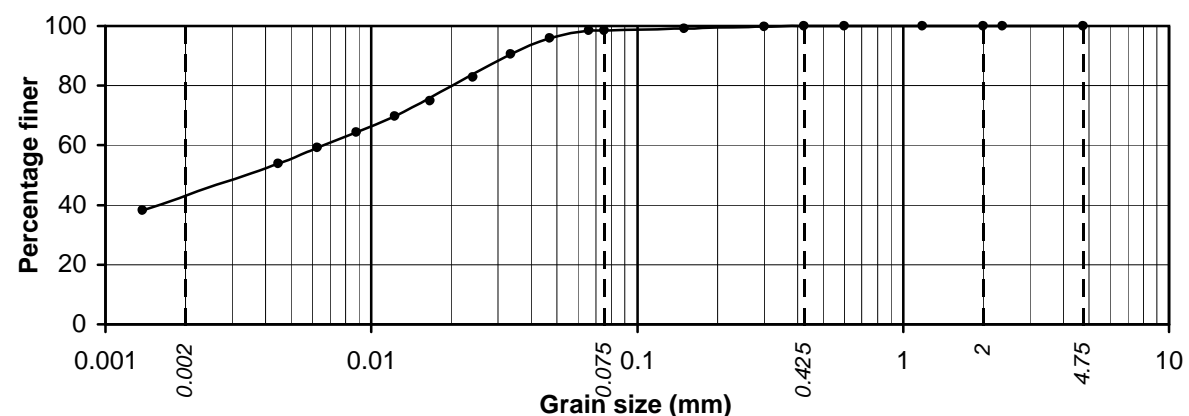

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 4.50m	43.2	55.3	1.4	0.1	0.0	0.0

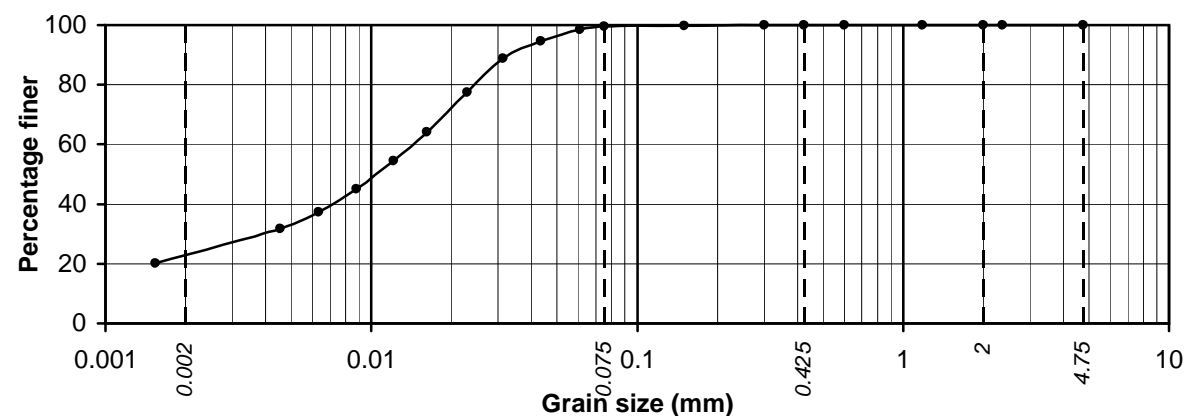

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 6.00m	23.0	76.7	0.3	0.0	0.0	0.0


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211


**Fig. No.**  
E/40




### GRAIN SIZE DISTRIBUTION CURVES

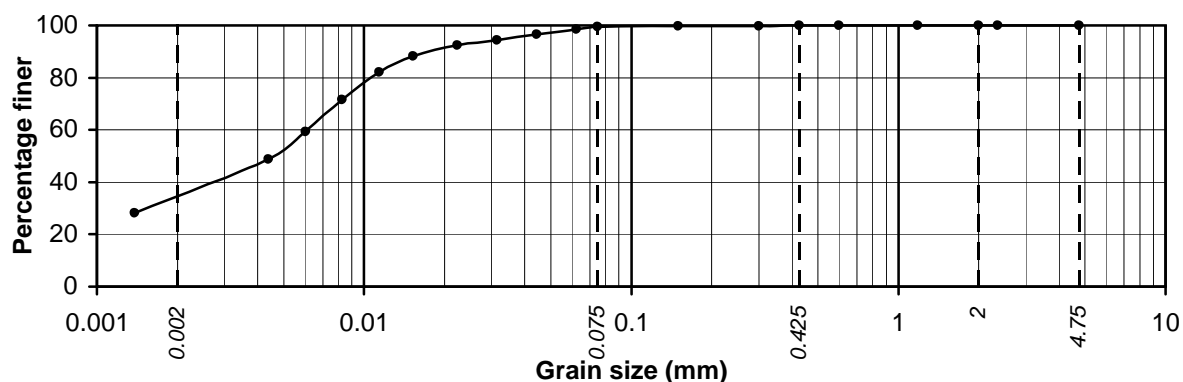

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-6, 7.50m	34.8	64.7	0.4	0.1	0.0	0.0

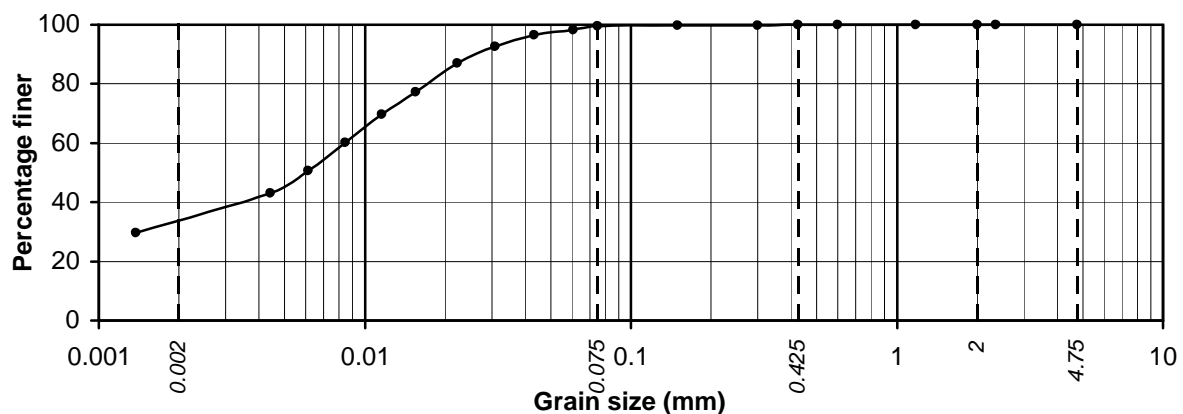

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-6, 9.00m	34.0	65.5	0.4	0.1	0.0	0.0

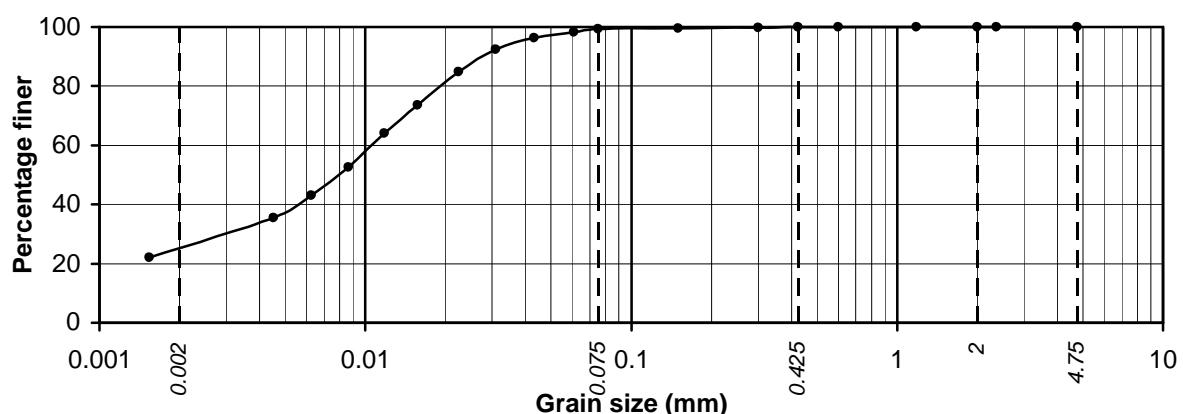


Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-6, 10.50m	25.3	74.2	0.5	0.0	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/41


### GRAIN SIZE DISTRIBUTION CURVES

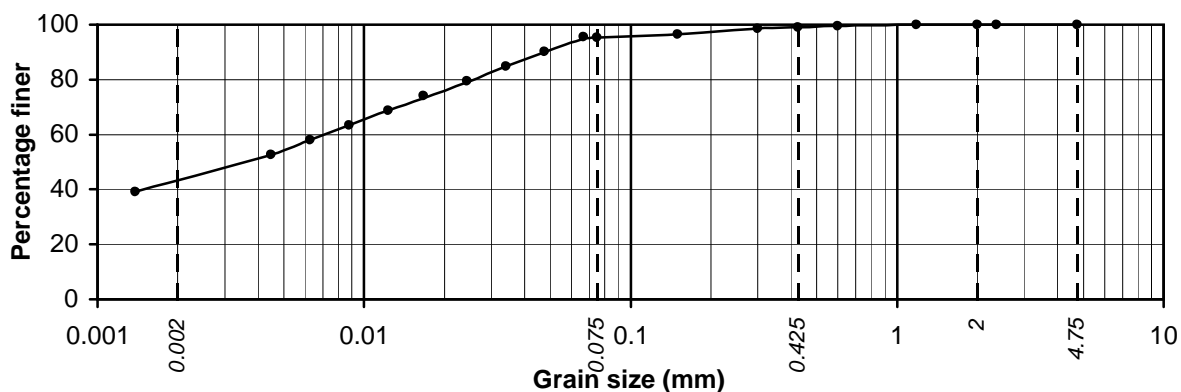

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 13.50m	43.3	52.0	3.9	0.8	0.0	0.0

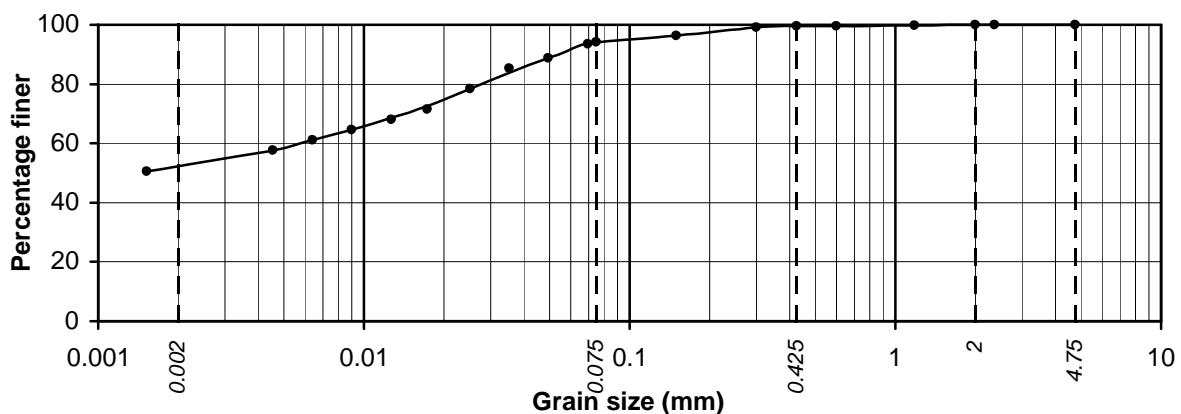

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 15.50m	52.4	41.8	5.3	0.5	0.0	0.0

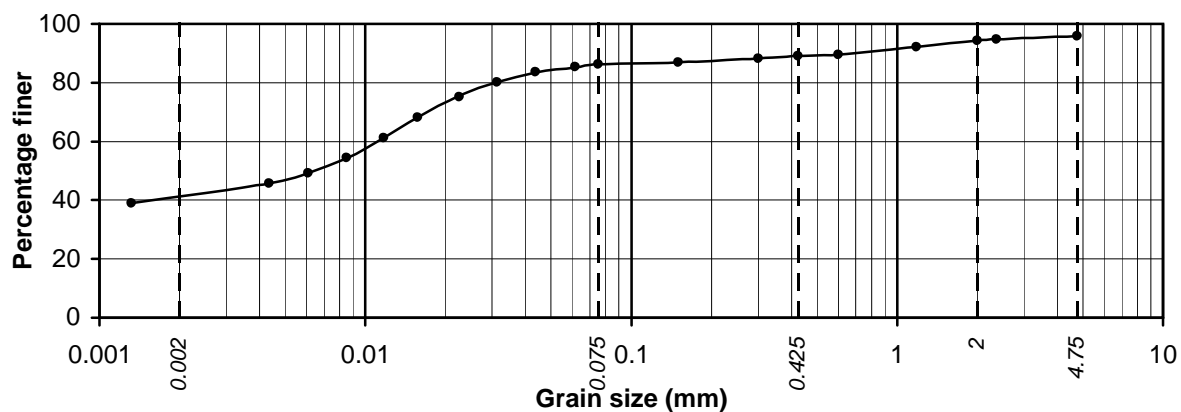


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 16.50m	41.3	45.0	2.7	5.4	1.4	4.2

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/42


### GRAIN SIZE DISTRIBUTION CURVES

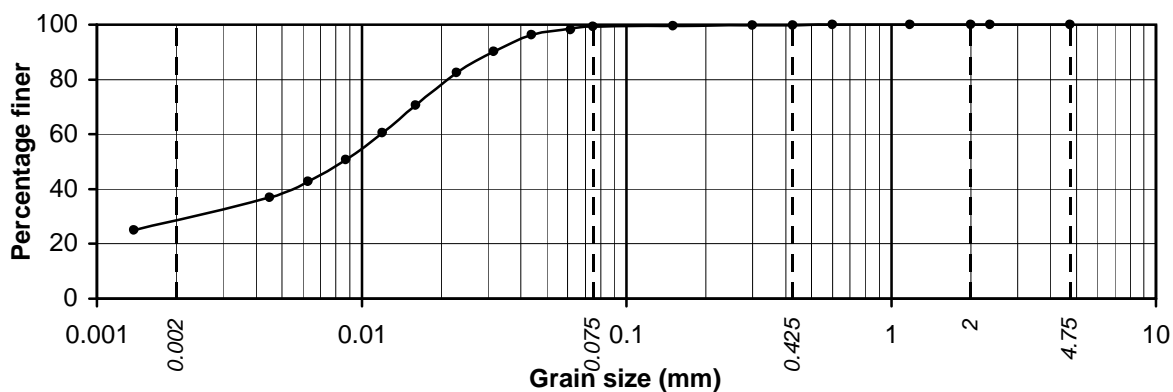

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 18.50m	28.7	70.6	0.6	0.1	0.0	0.0

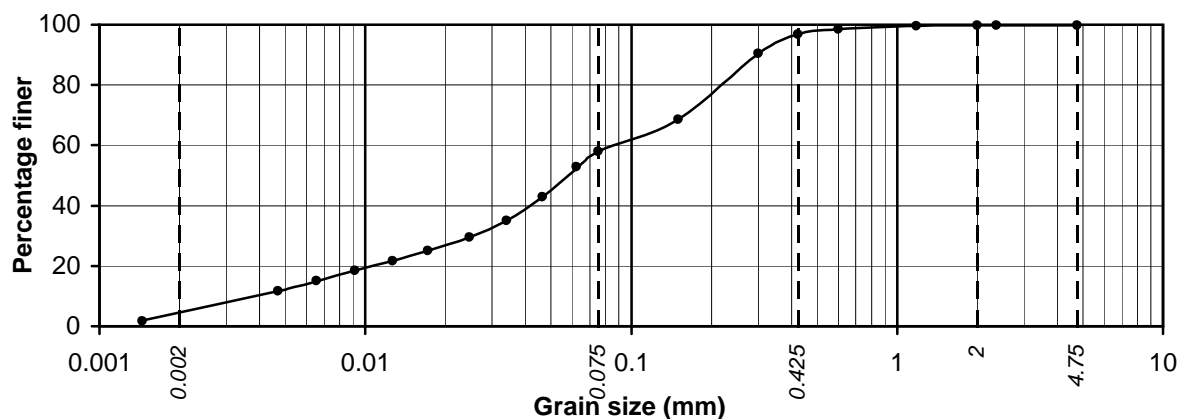

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 21.50m	4.5	53.6	38.9	2.8	0.1	0.1

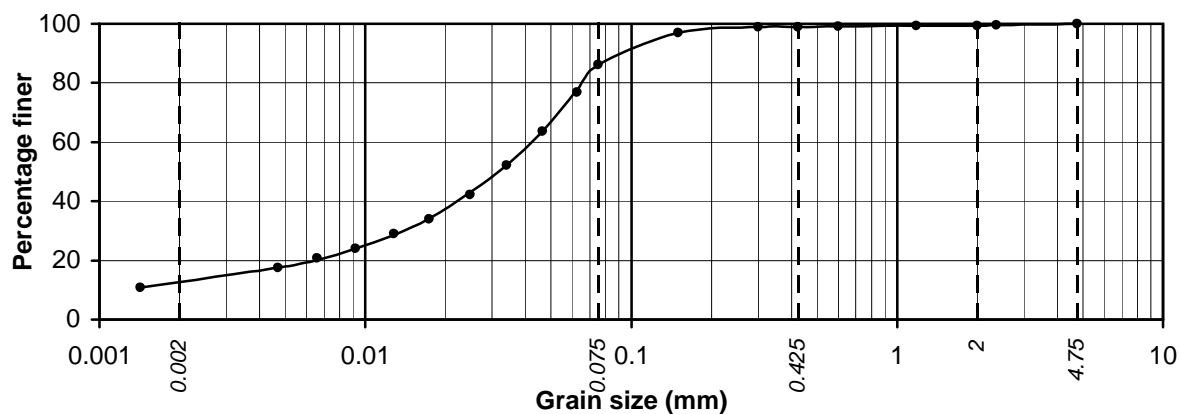


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 23.00m	12.8	73.4	12.8	0.4	0.6	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/43


### GRAIN SIZE DISTRIBUTION CURVES

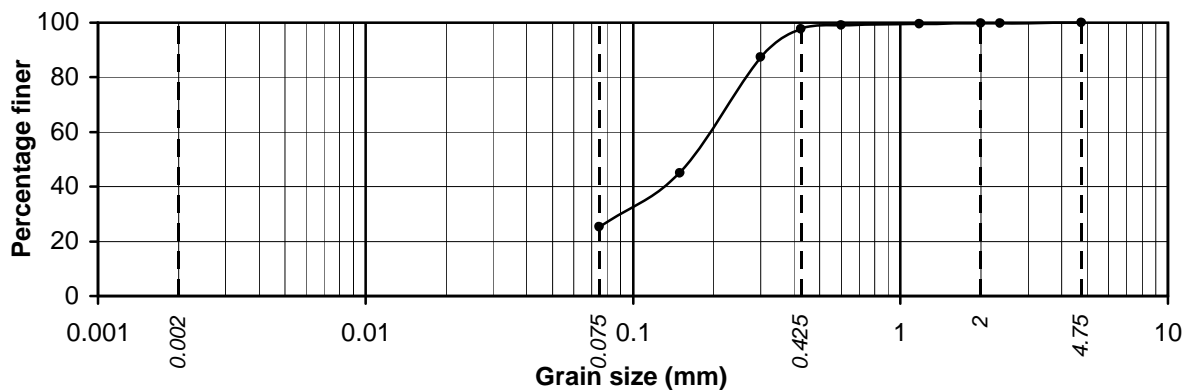

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 24.50m		*25.2	72.4	2.2	0.2	0.0

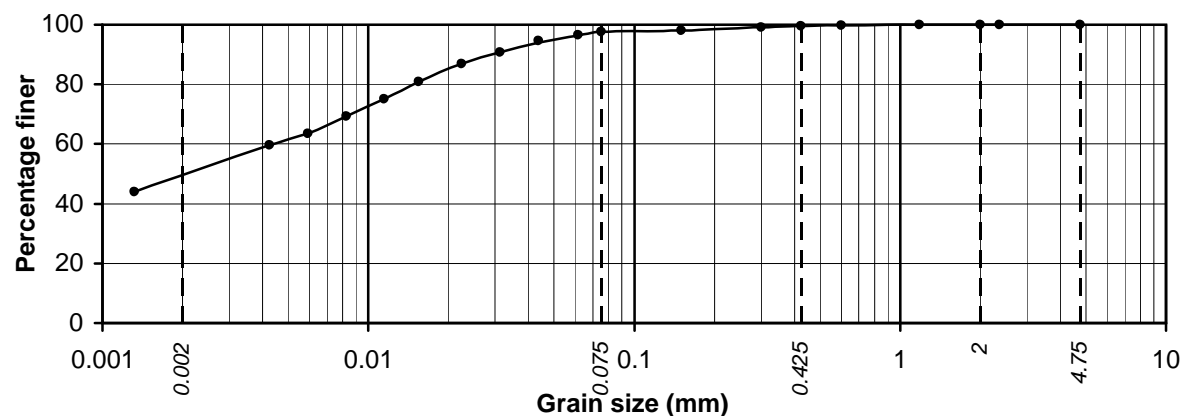

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 27.00m	49.5	48.1	1.9	0.5	0.0	0.0

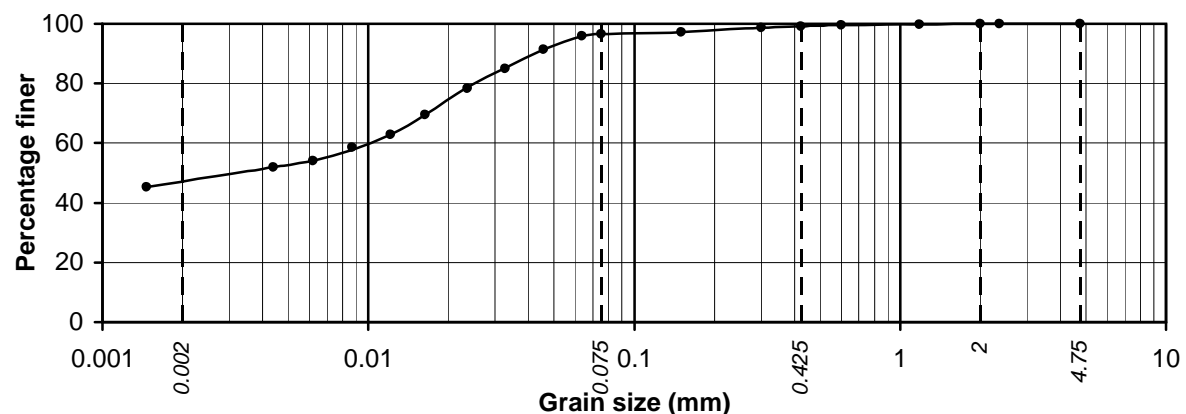

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 30.00m	47.2	49.3	2.7	0.8	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/44


### GRAIN SIZE DISTRIBUTION CURVES

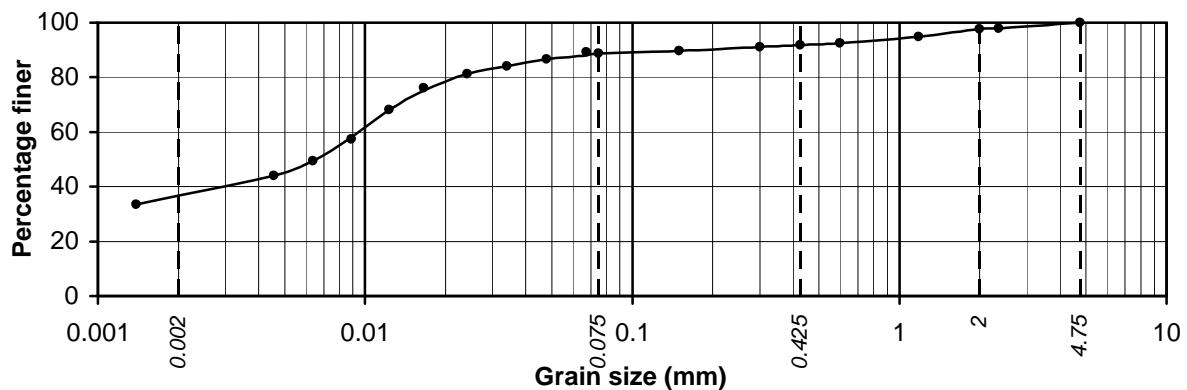

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 33.50m	36.7	52.1	3.0	5.8	2.4	0.0

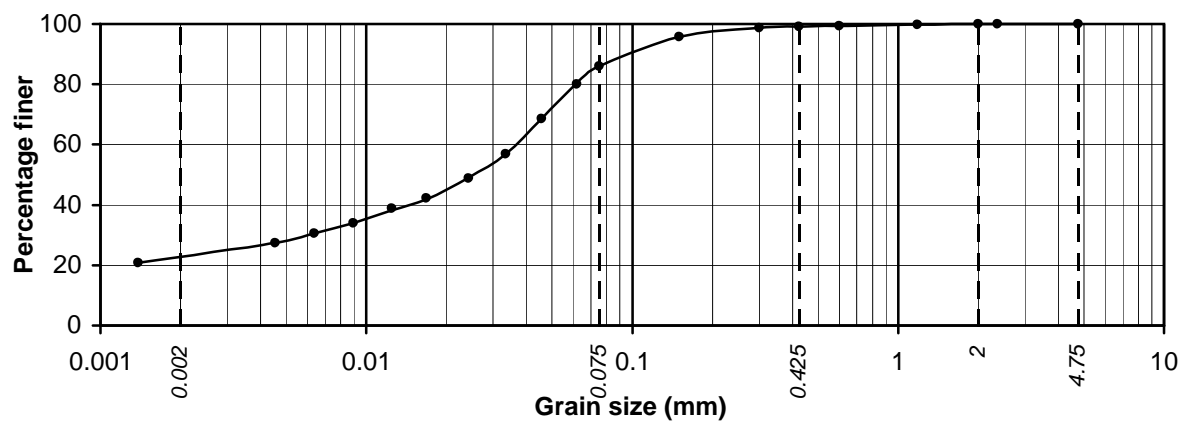

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 36.50m	22.8	63.3	13.0	0.9	0.0	0.0

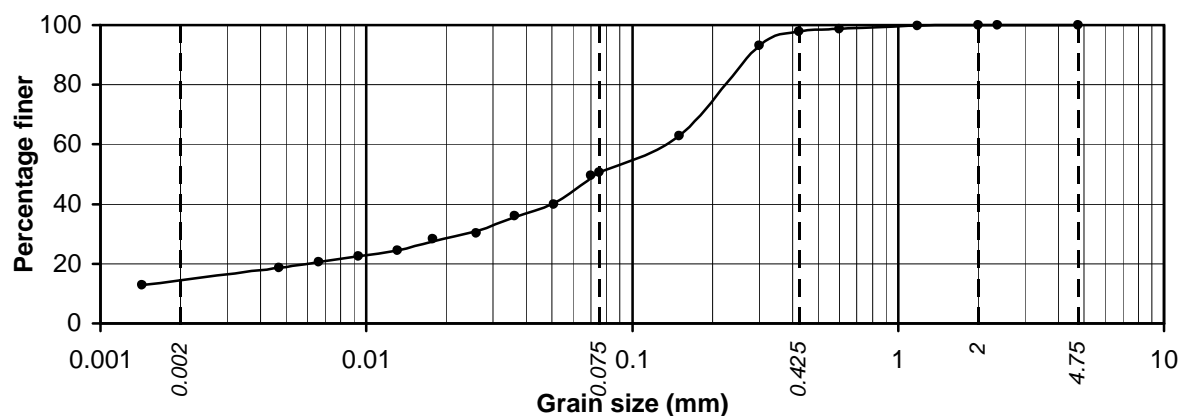


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 38.00m	14.4	36.2	47.4	2.0	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/45


### GRAIN SIZE DISTRIBUTION CURVES

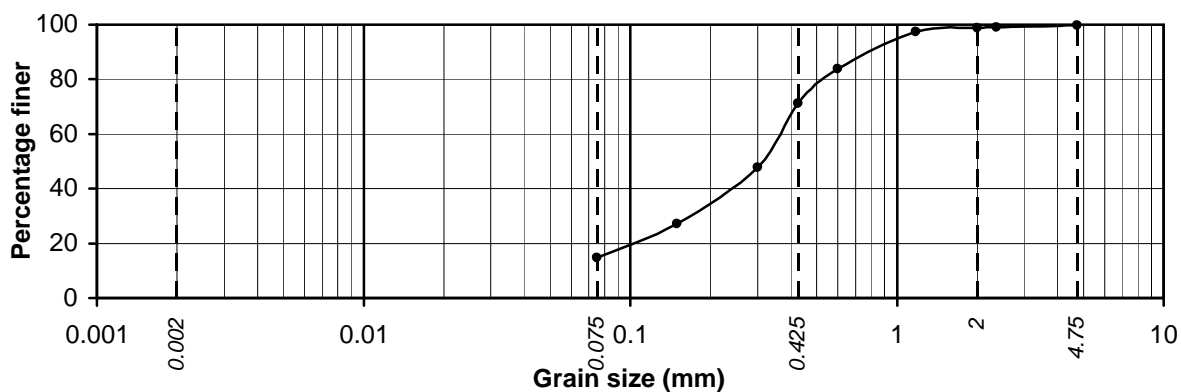

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 41.00m		*14.6	56.6	27.7	0.8	0.3

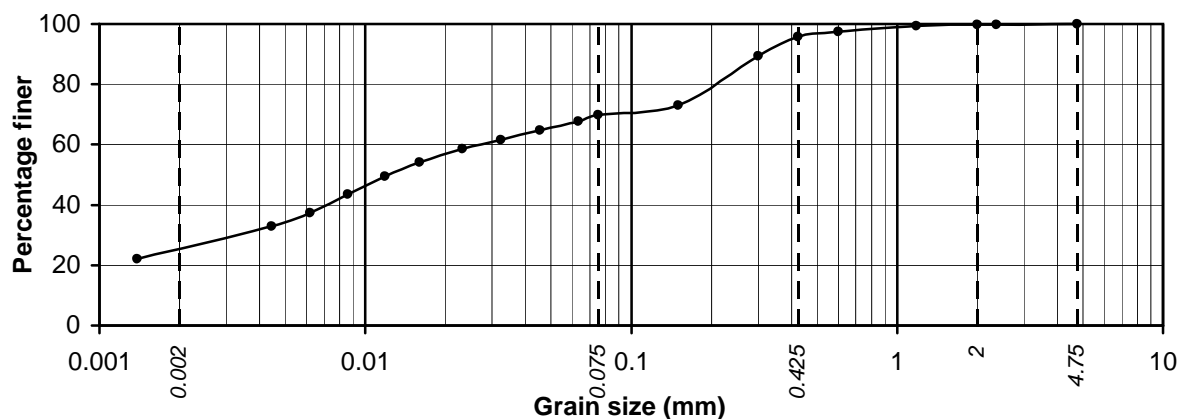

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 44.00m	25.5	44.3	26.0	4.0	0.2	0.0

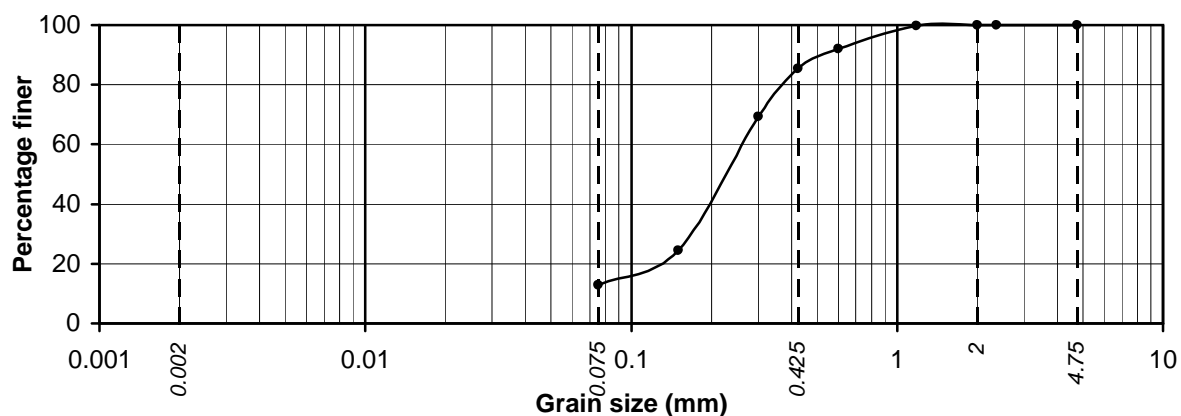

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 45.50m		*12.9	72.5	14.6	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/46


### GRAIN SIZE DISTRIBUTION CURVES

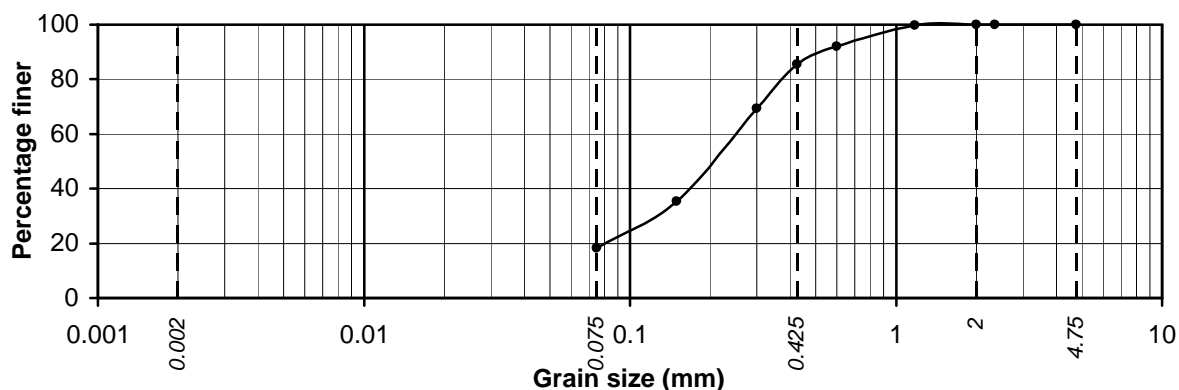

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-6, 48.50m		*18.2	67.2	14.6	0.0	0.0

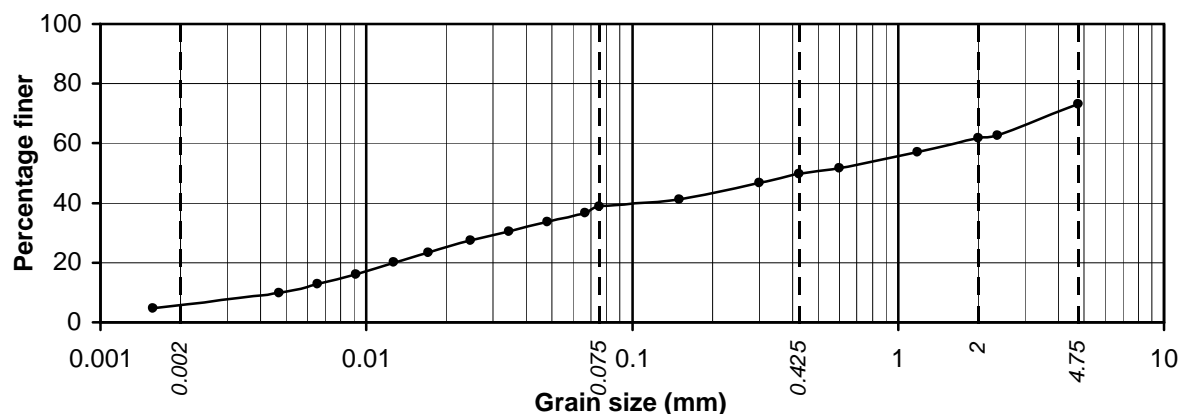

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 1.00m	5.9	32.8	11.1	11.9	11.4	26.9

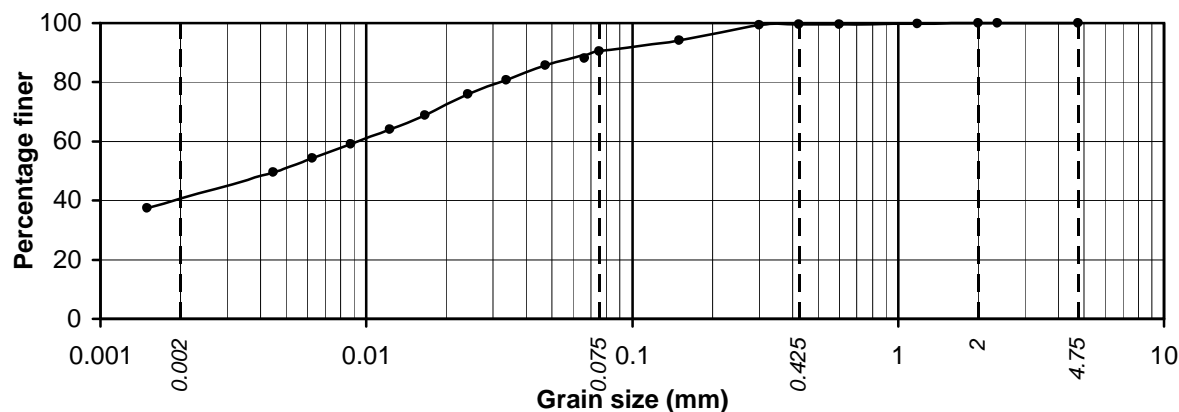

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 2.50m	40.7	49.8	9.0	0.4	0.1	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/47


### GRAIN SIZE DISTRIBUTION CURVES

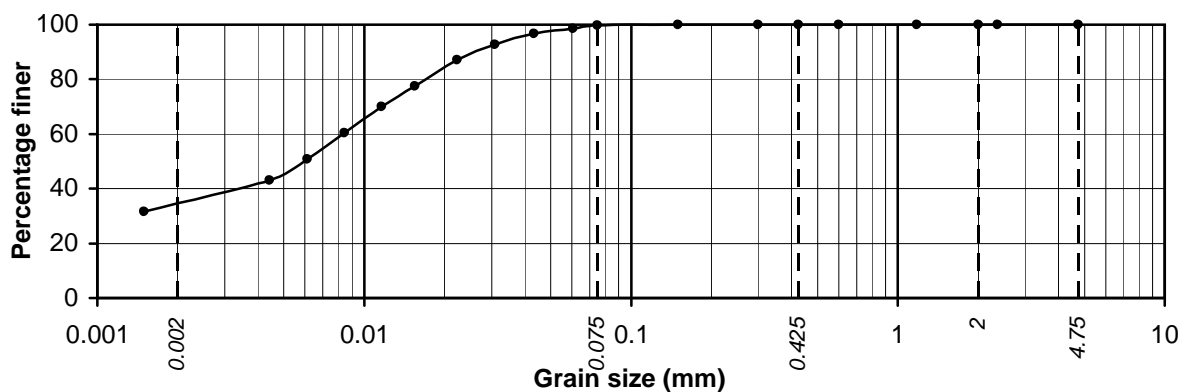

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 4.00m	34.8	65.0	0.2	0.0	0.0	0.0

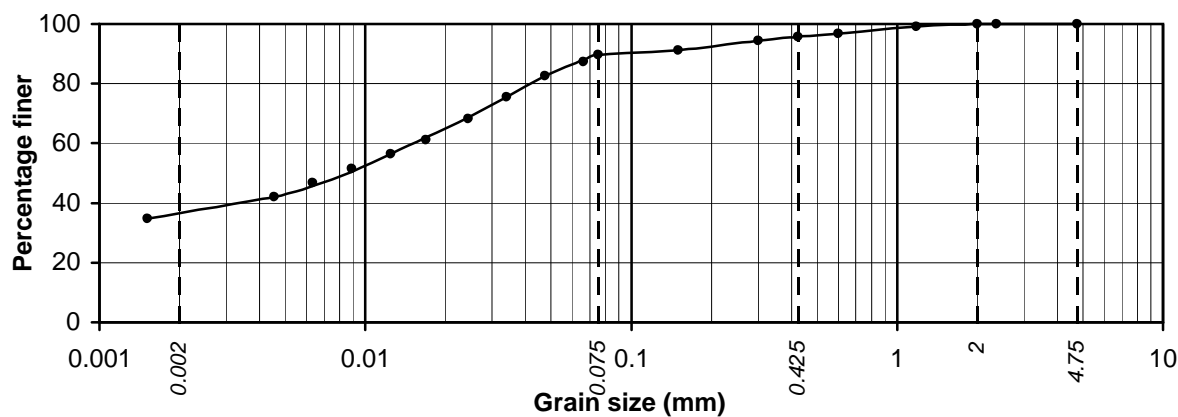

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 5.50m	36.7	53.0	6.0	4.2	0.1	0.0

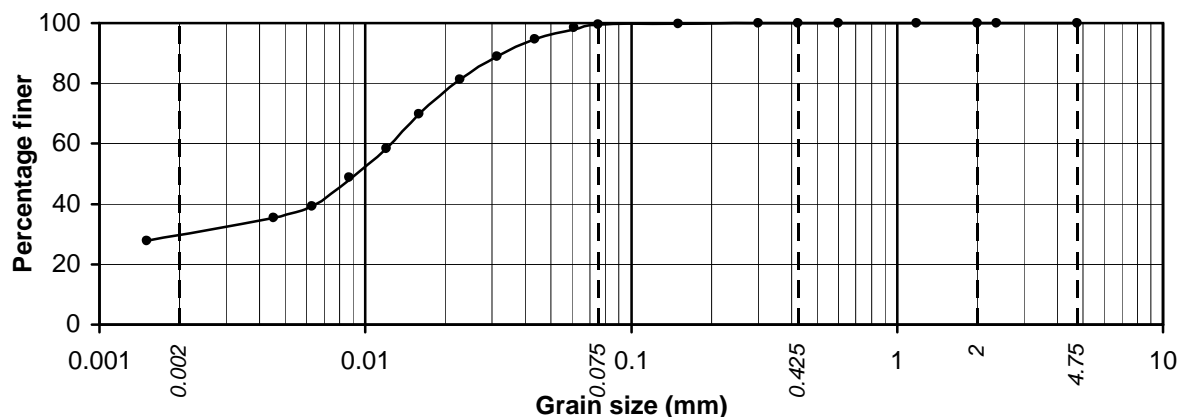

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 7.00m	29.8	69.8	0.3	0.1	0.0	0.0


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211


Fig. No.  
E/48




### GRAIN SIZE DISTRIBUTION CURVES

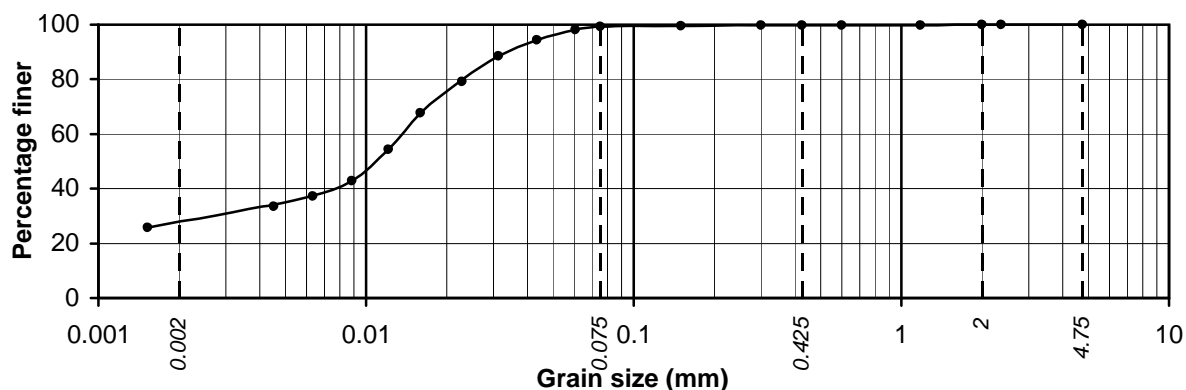

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 8.50m	28.0	71.3	0.4	0.3	0.0	0.0

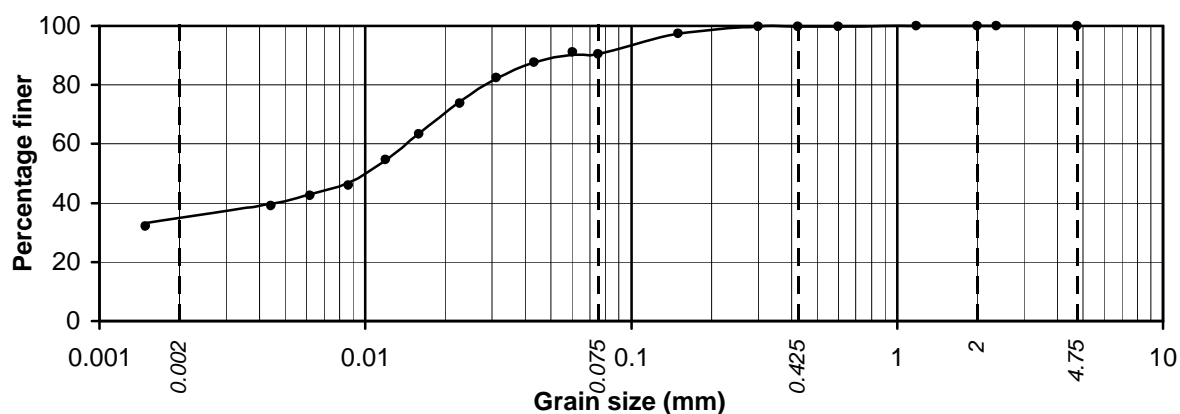

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 10.00m	35.0	55.4	9.4	0.2	0.0	0.0

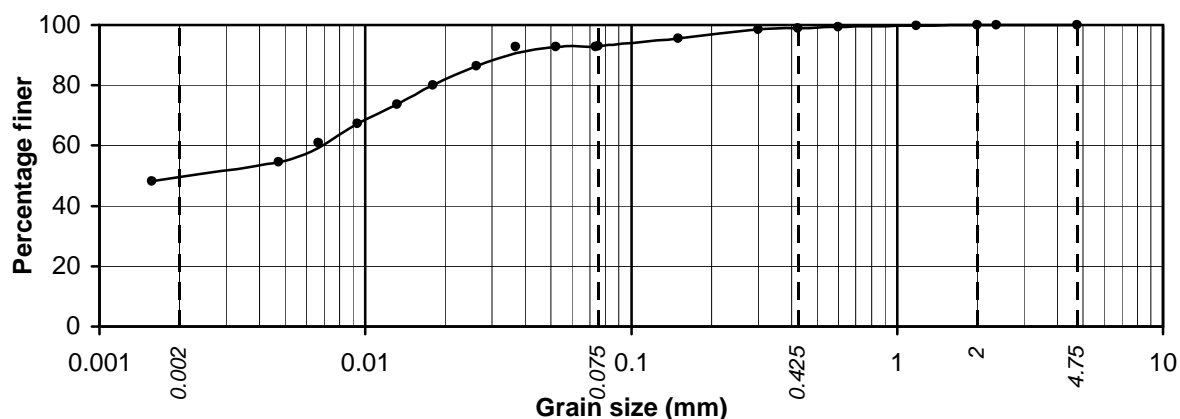


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 13.00m	49.7	43.2	6.1	1.0	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/49


### GRAIN SIZE DISTRIBUTION CURVES

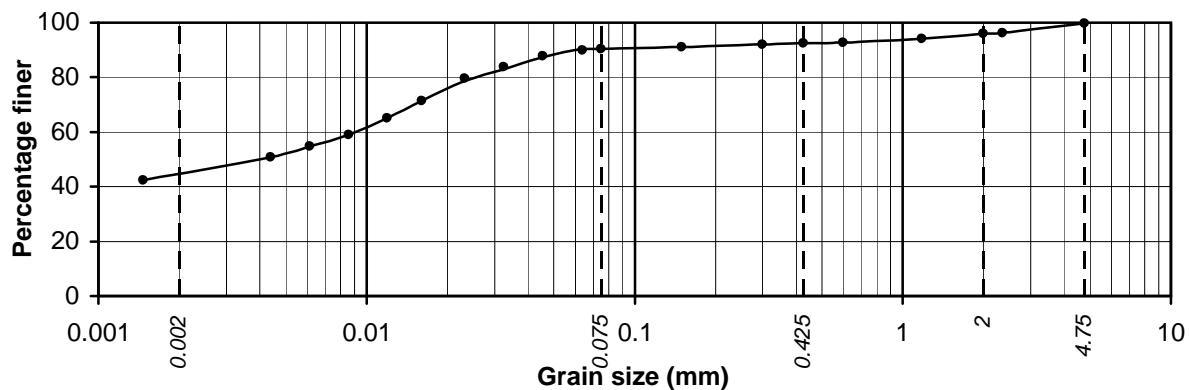

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 16.00m	44.8	45.7	1.9	3.5	3.8	0.3

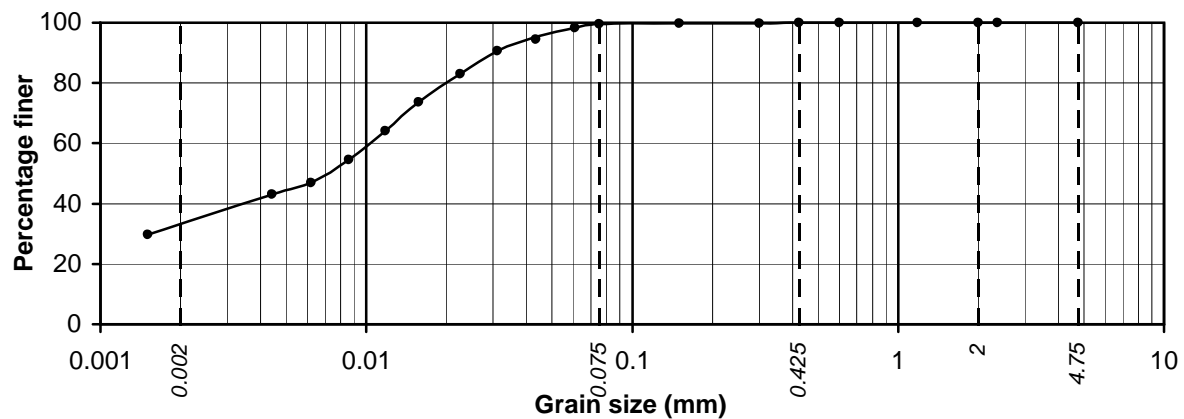

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 18.00m	33.2	66.3	0.4	0.1	0.0	0.0

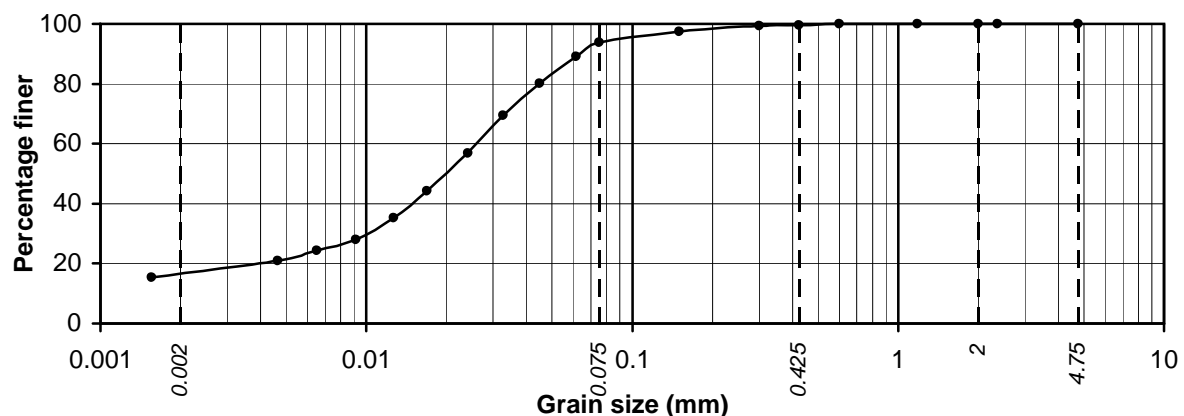


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 21.00m	16.7	77.1	5.8	0.4	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/50


### GRAIN SIZE DISTRIBUTION CURVES

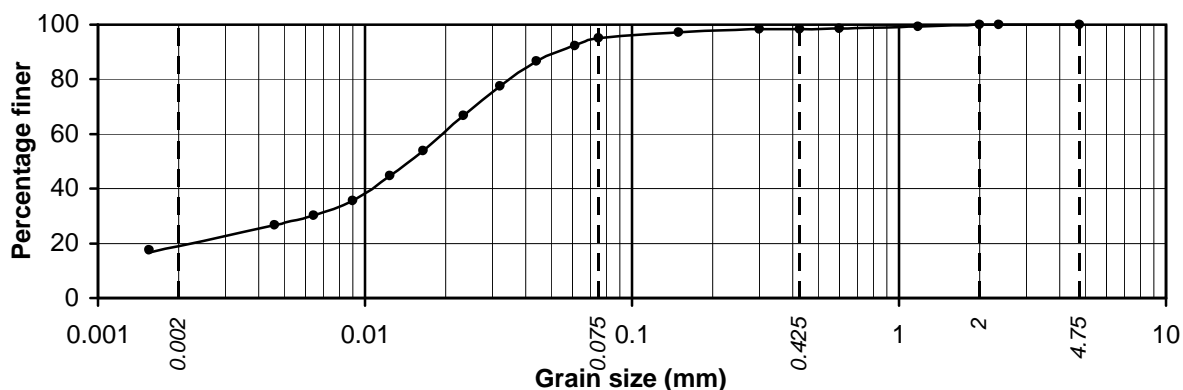

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 24.00m	19.0	76.1	3.3	1.6	0.0	0.0

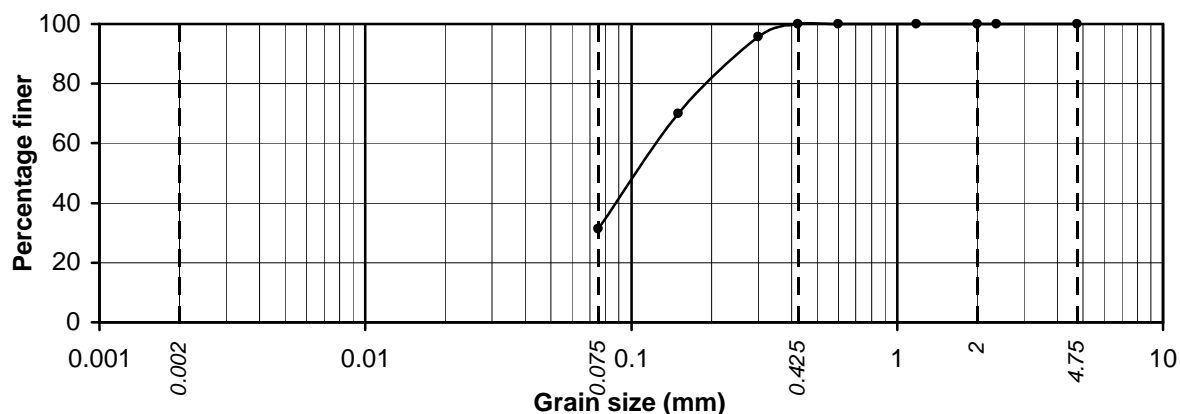

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 25.50m		*31.4	68.5	0.1	0.0	0.0

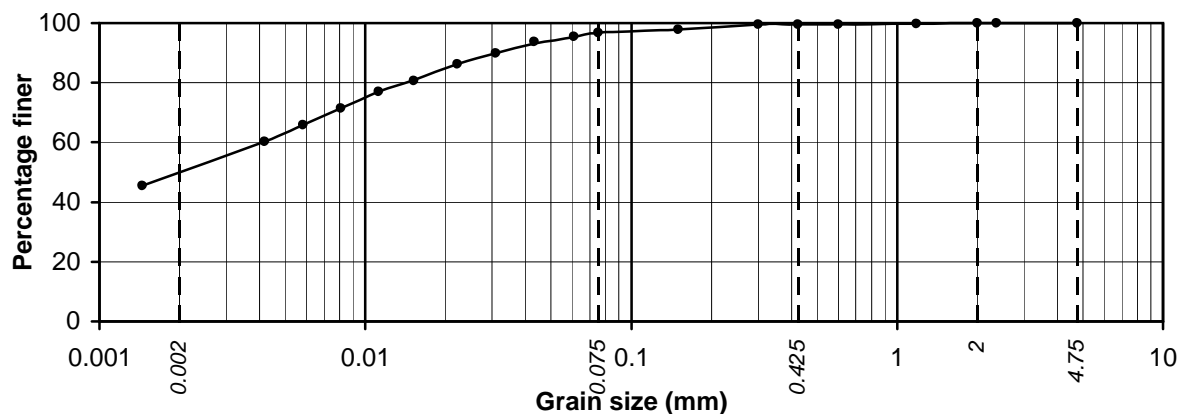

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 28.00m	50.1	46.7	2.8	0.4	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/51


### GRAIN SIZE DISTRIBUTION CURVES

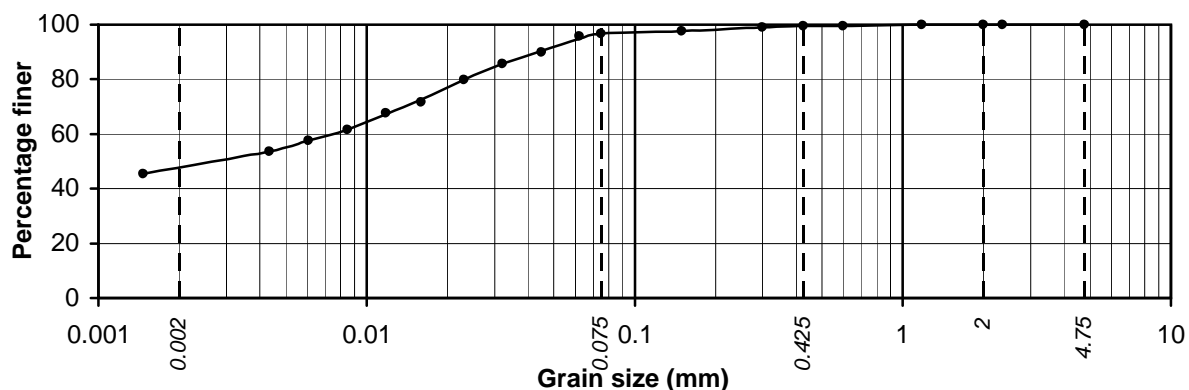

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 31.00m	47.8	49.1	2.6	0.5	0.0	0.0

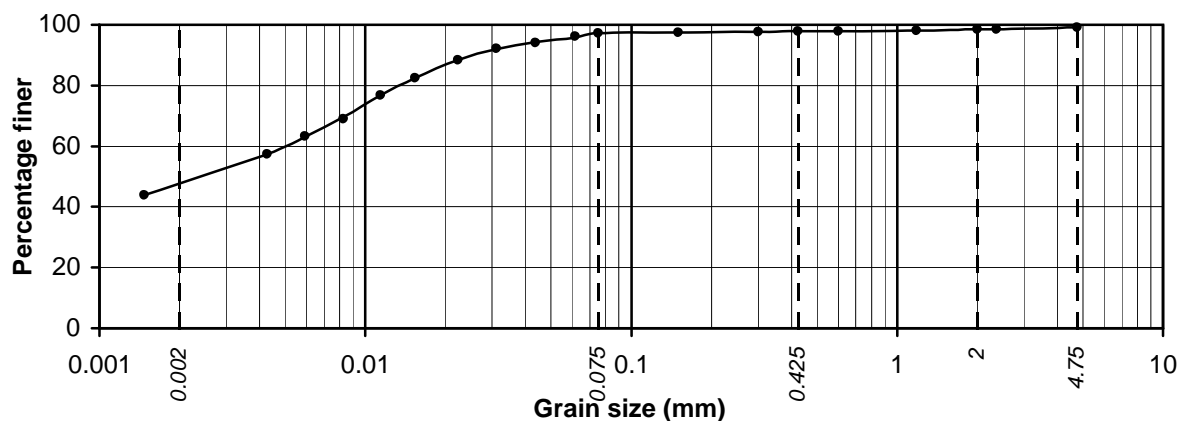

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 33.00m	47.7	49.6	0.6	0.6	0.7	0.8

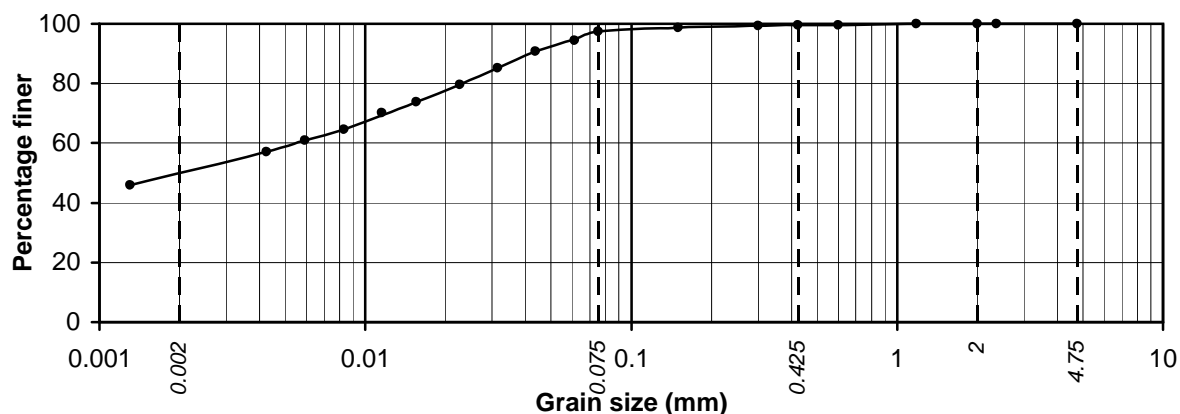


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 36.00m	49.9	47.5	2.1	0.5	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/52


### GRAIN SIZE DISTRIBUTION CURVES

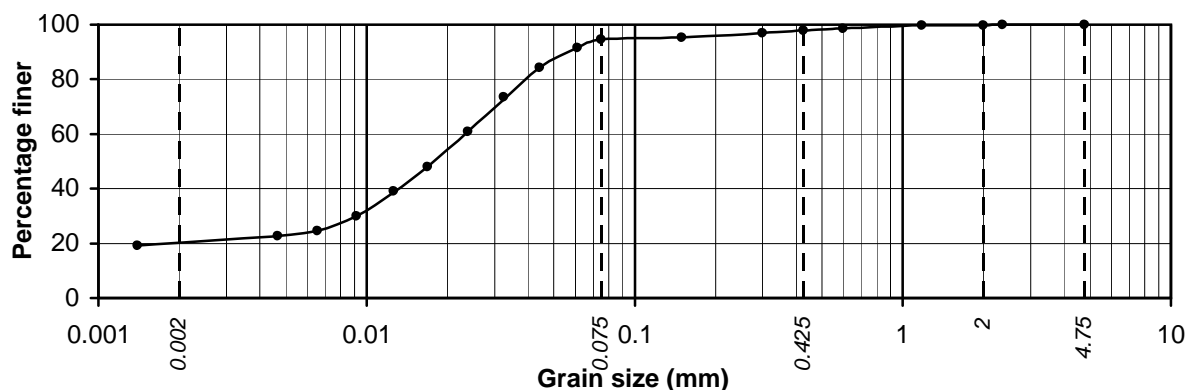

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 39.00m	20.2	74.3	3.5	1.9	0.1	0.0

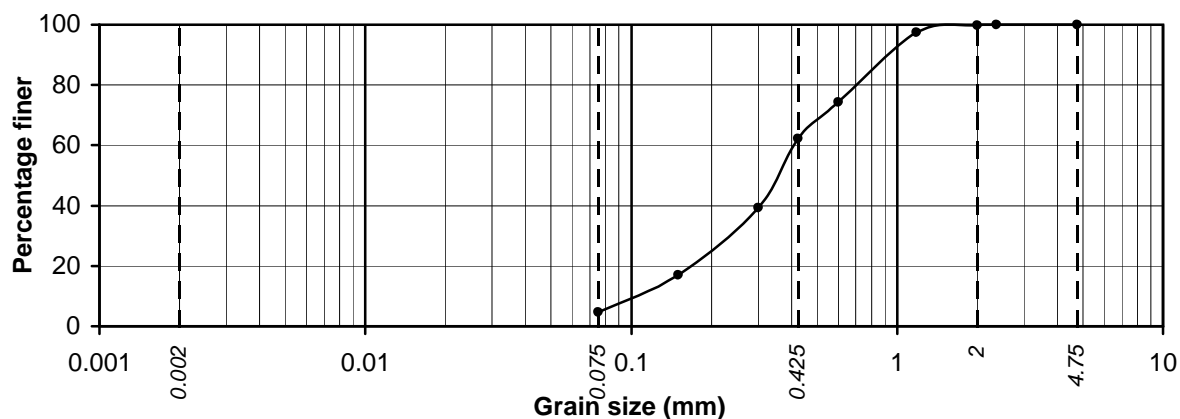

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 42.00m		*4.7	57.5	37.5	0.3	0.0

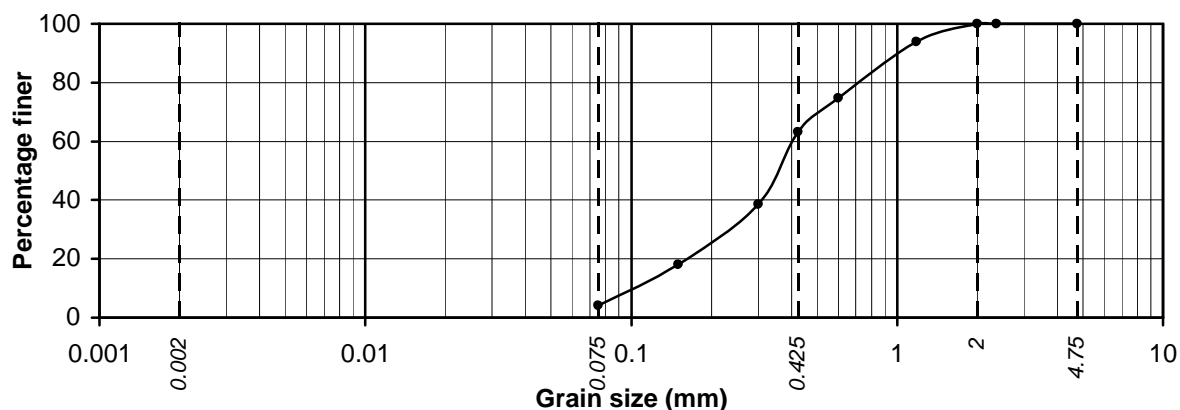

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 45.00m		*4.2	58.9	36.9	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/53


### GRAIN SIZE DISTRIBUTION CURVES

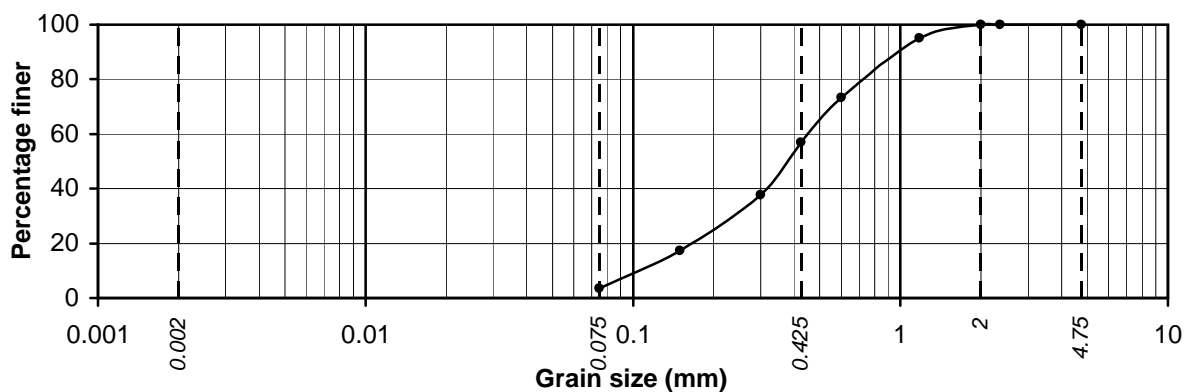

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-7, 48.00m		*3.5	53.4	43.1	0.0	0.0

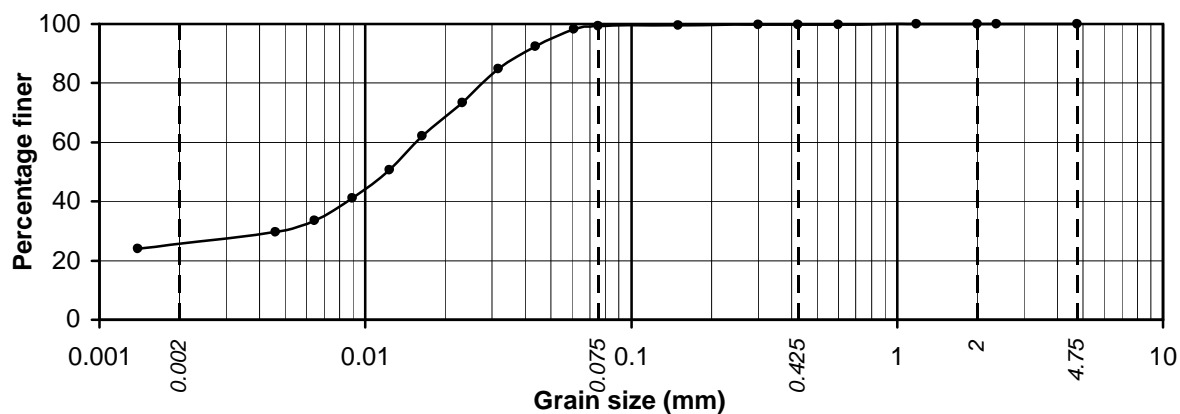

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 1.00m	25.7	73.7	0.4	0.2	0.0	0.0

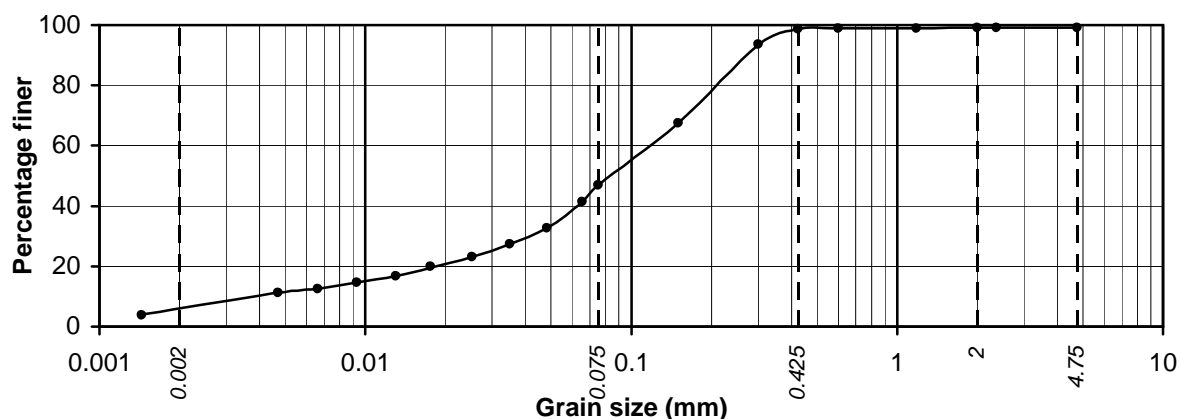

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 2.50m	6.0	41.0	51.7	0.3	0.1	0.9


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/54


### GRAIN SIZE DISTRIBUTION CURVES

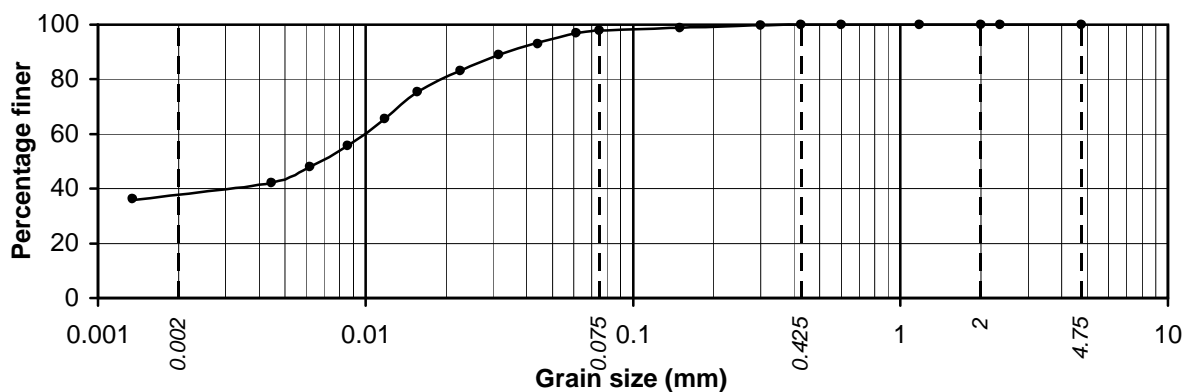

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 4.00m	38.0	59.9	2.0	0.1	0.0	0.0

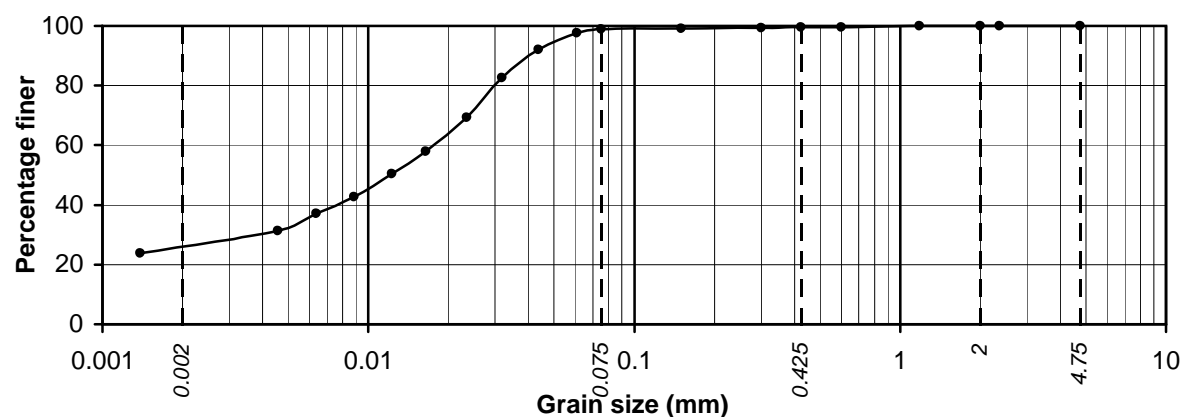

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 5.50m	26.2	72.7	0.7	0.4	0.0	0.0

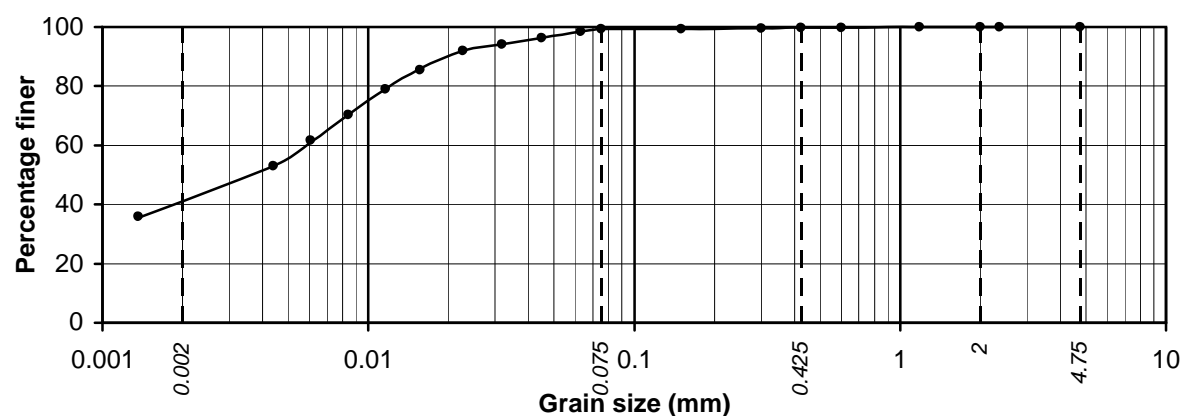


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 7.00m	41.2	58.0	0.5	0.3	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/55


### GRAIN SIZE DISTRIBUTION CURVES

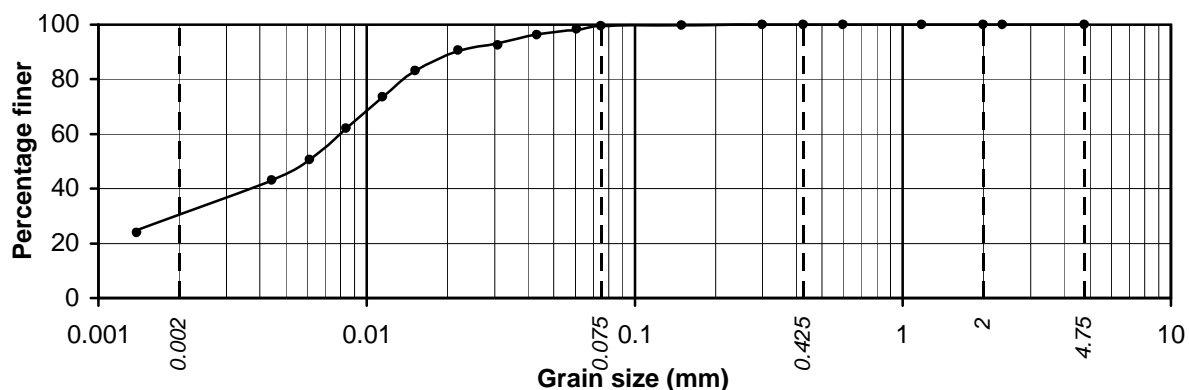

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 8.50m	30.5	69.0	0.5	0.0	0.0	0.0

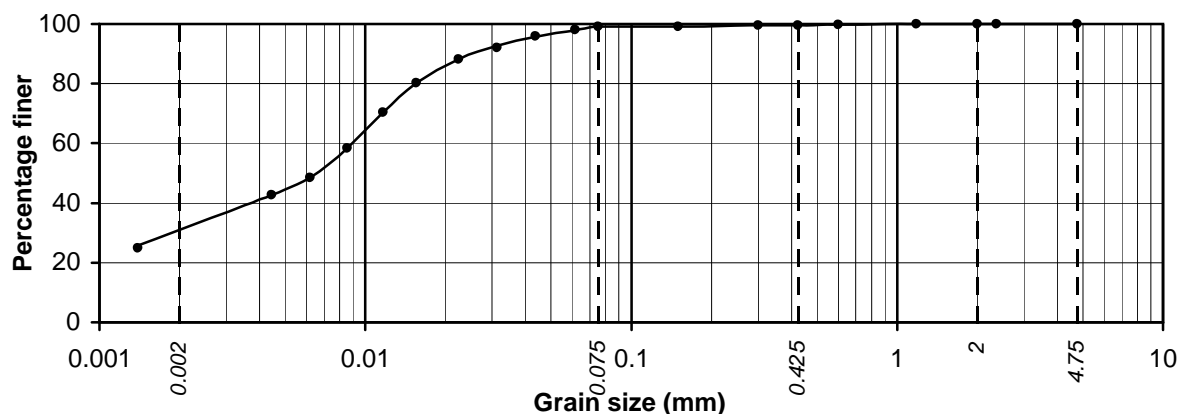

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 10.00m	31.0	68.1	0.6	0.3	0.0	0.0

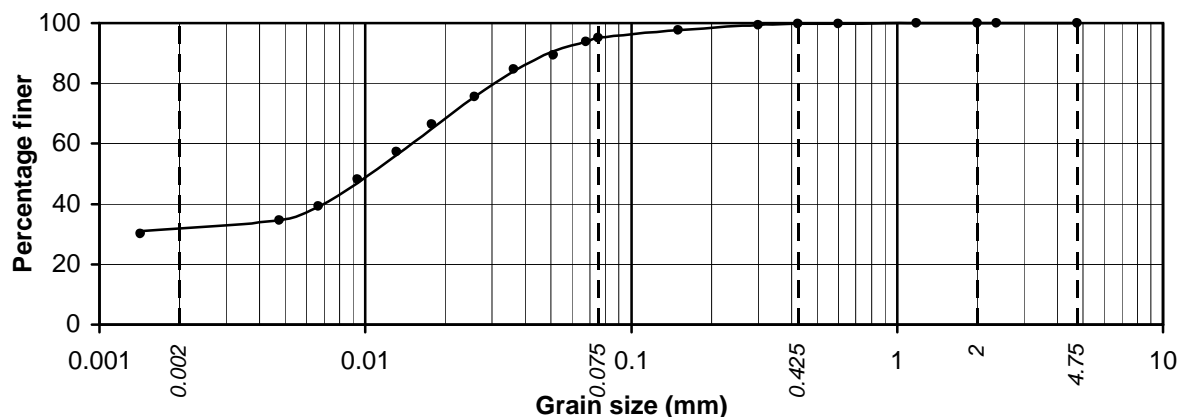

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 13.00m	32.0	63.2	4.5	0.3	0.0	0.0


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211


Fig. No.  
E/56




### GRAIN SIZE DISTRIBUTION CURVES

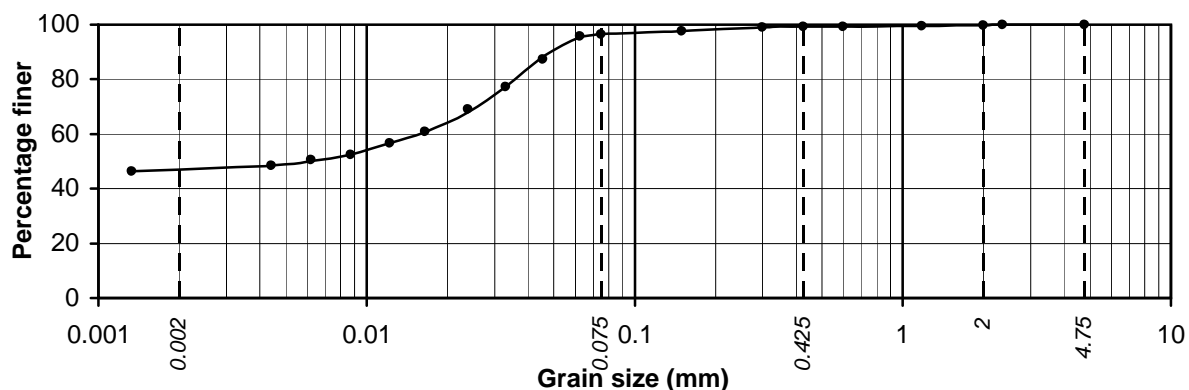

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 15.00m	47.1	49.4	2.7	0.6	0.2	0.0

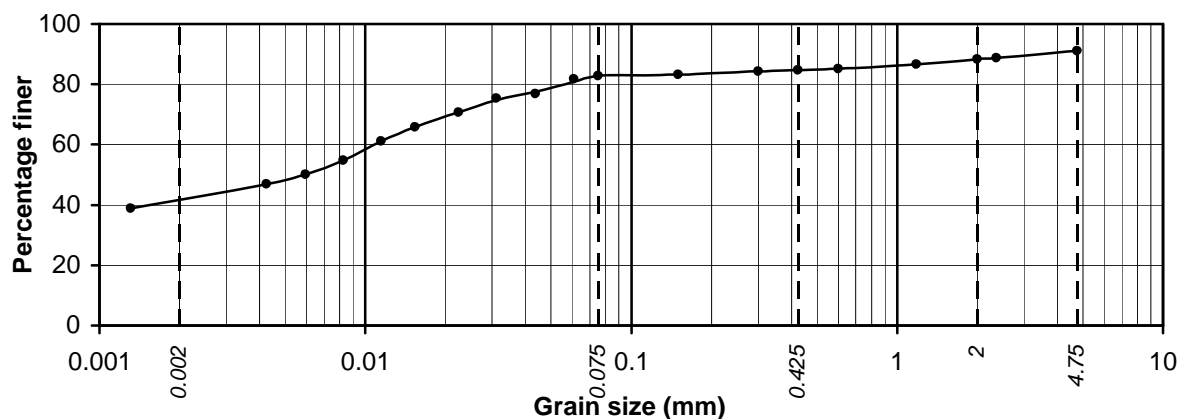

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 16.00m	41.8	40.9	2.0	3.6	2.8	8.9

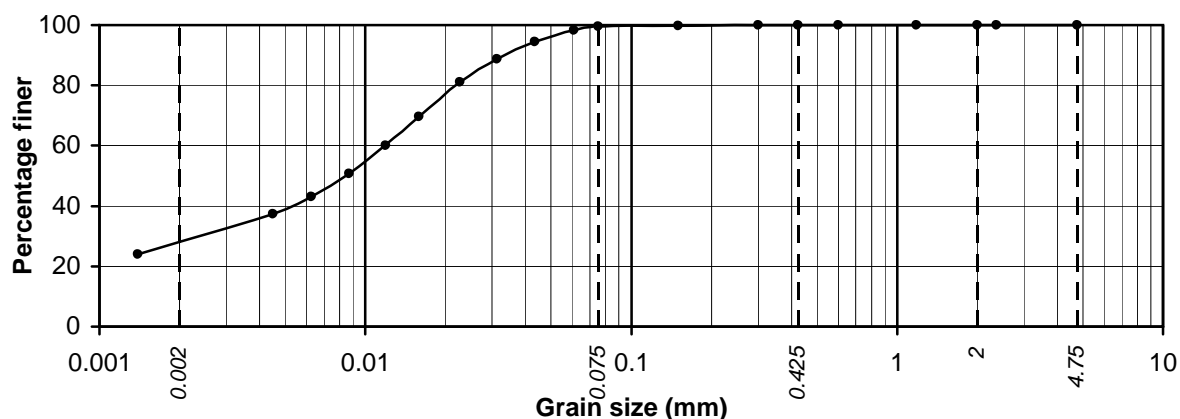


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 18.00m	28.1	71.4	0.5	0.0	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/57


### GRAIN SIZE DISTRIBUTION CURVES

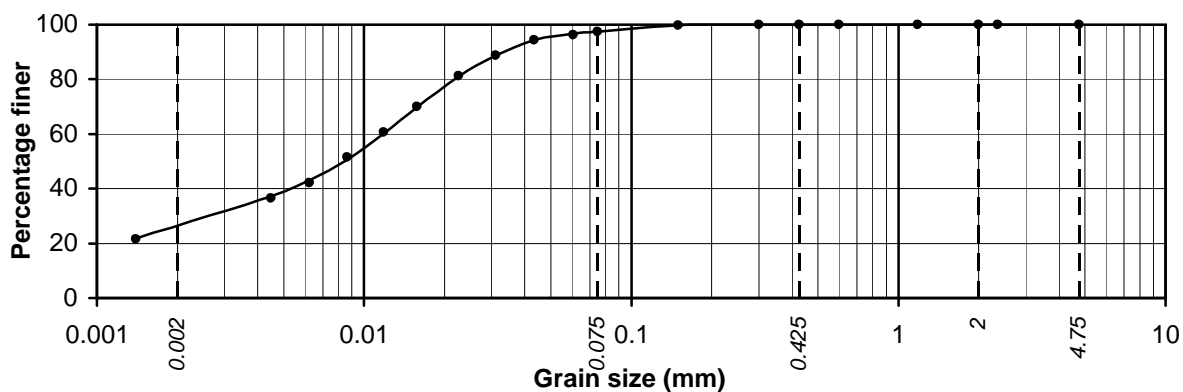

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 21.00m	26.5	70.9	2.6	0.0	0.0	0.0

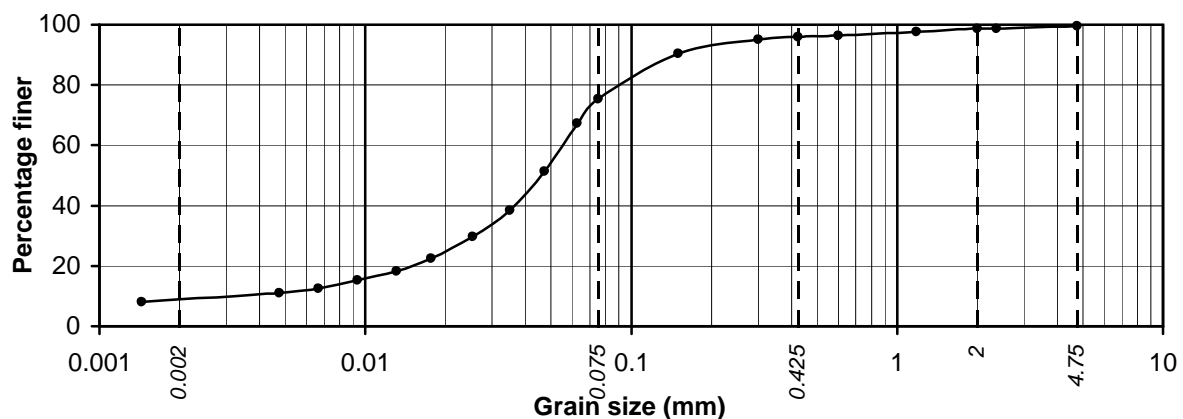

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 22.50m	8.9	66.5	20.5	2.8	0.8	0.5

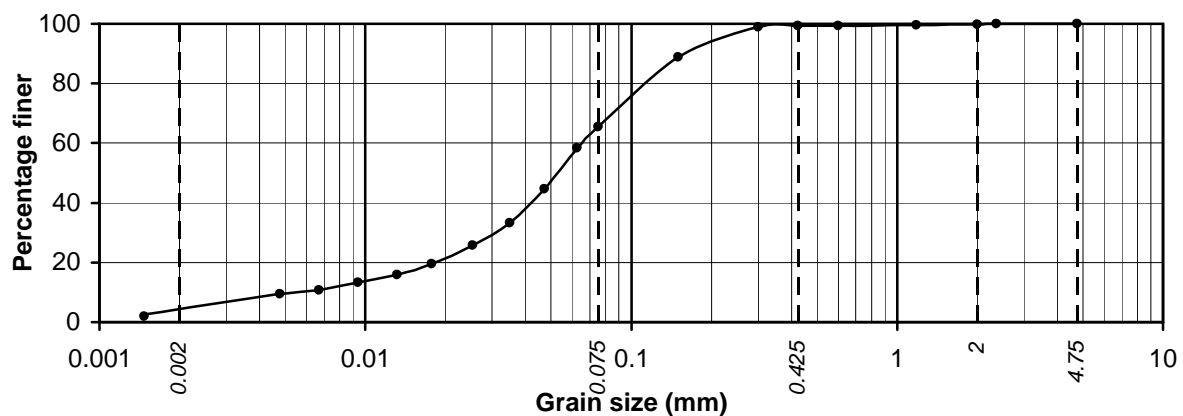


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 24.00m	4.4	61.0	34.0	0.4	0.2	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/58


### GRAIN SIZE DISTRIBUTION CURVES

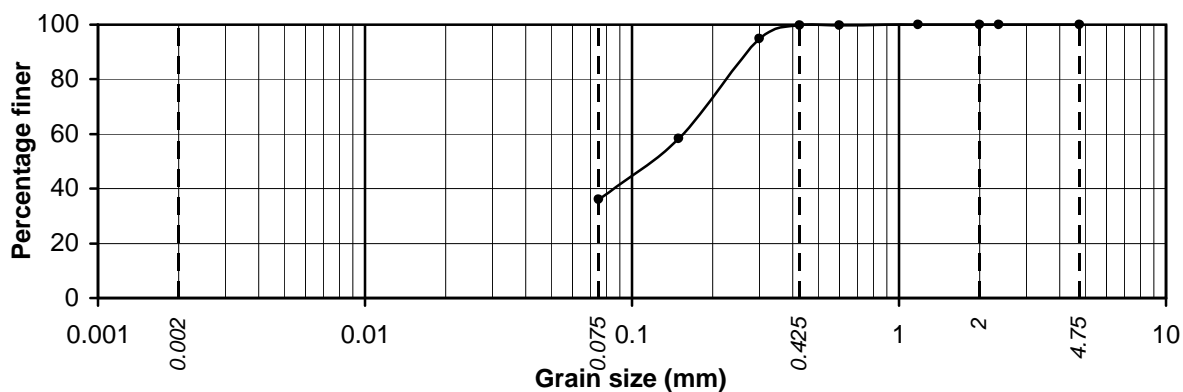

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-8, 25.50m		*36.0	63.7	0.3	0.0	0.0

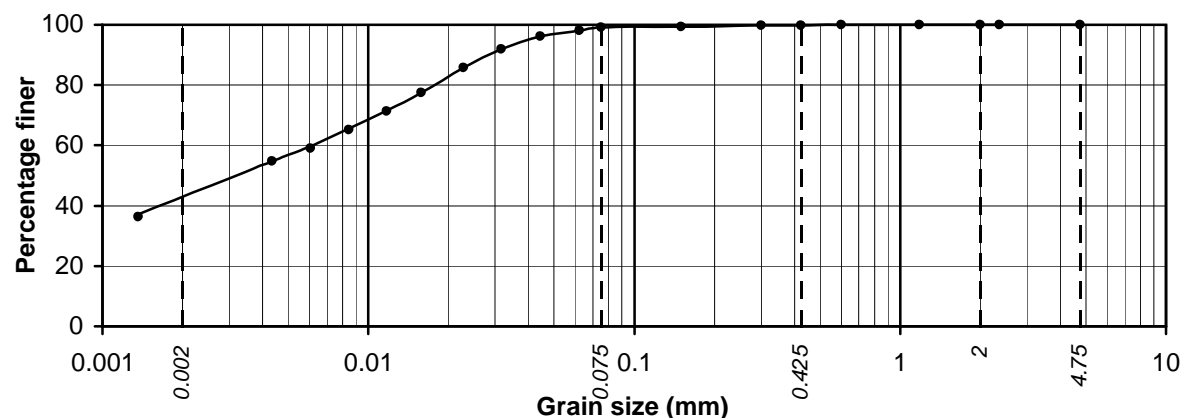

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-8, 28.00m	43.0	56.2	0.7	0.1	0.0	0.0

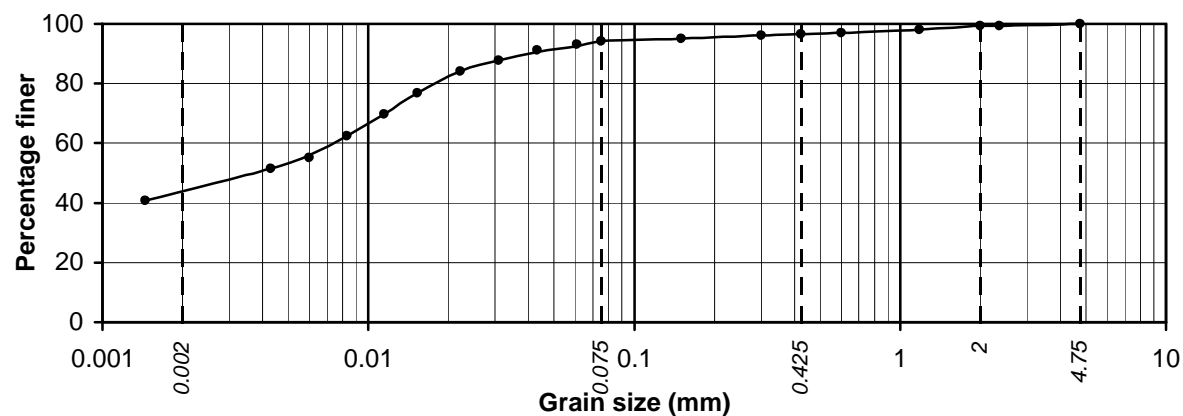

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-8, 31.00m	44.0	50.1	2.3	2.8	0.8	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/59


### GRAIN SIZE DISTRIBUTION CURVES

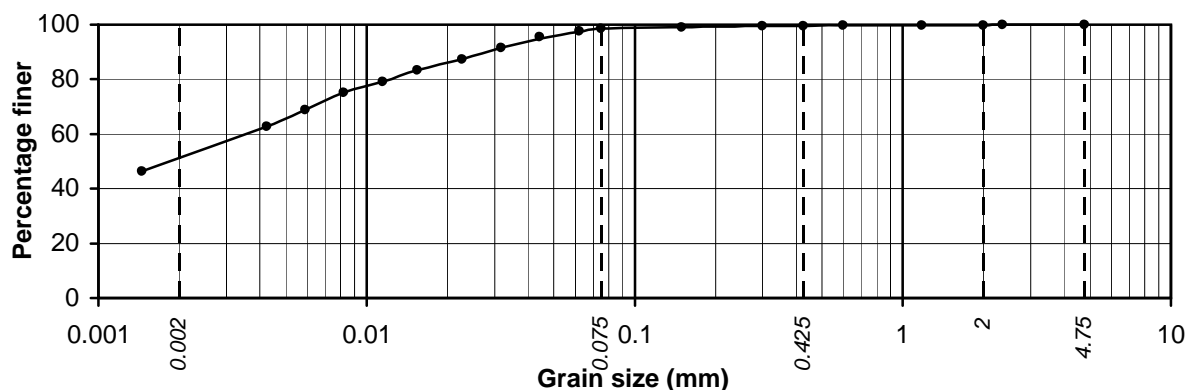

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 33.00m	51.2	47.3	1.1	0.2	0.2	0.0

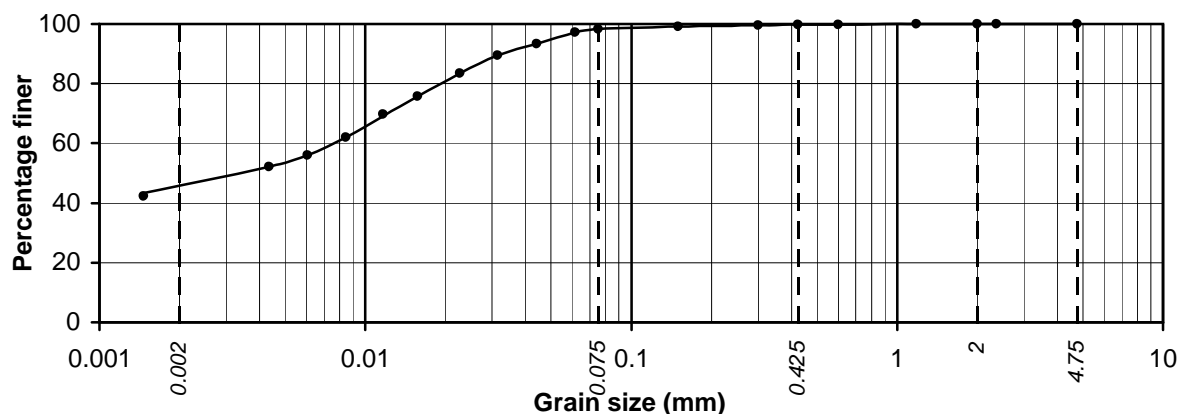

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 36.00m	45.8	52.5	1.4	0.3	0.0	0.0

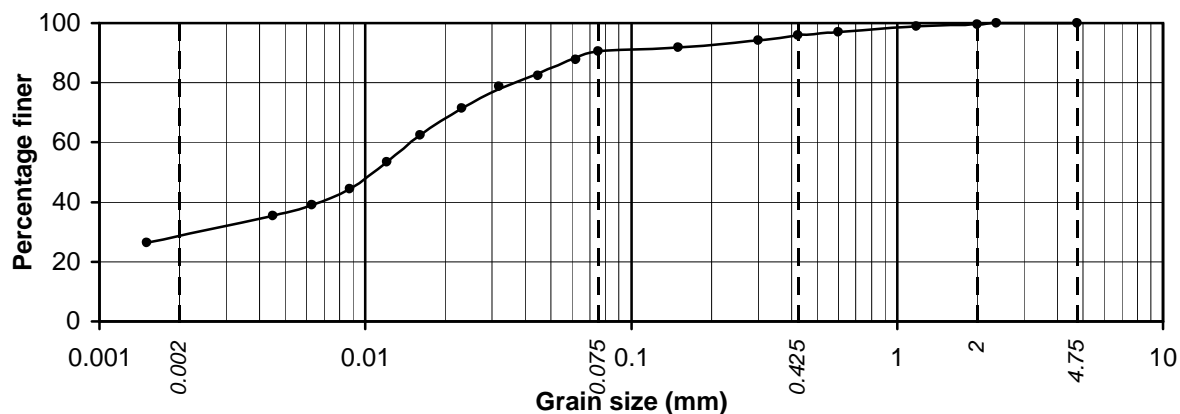




Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-8, 39.00m	28.7	61.8	5.5	3.5	0.5	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
E/60

### GRAIN SIZE DISTRIBUTION CURVES

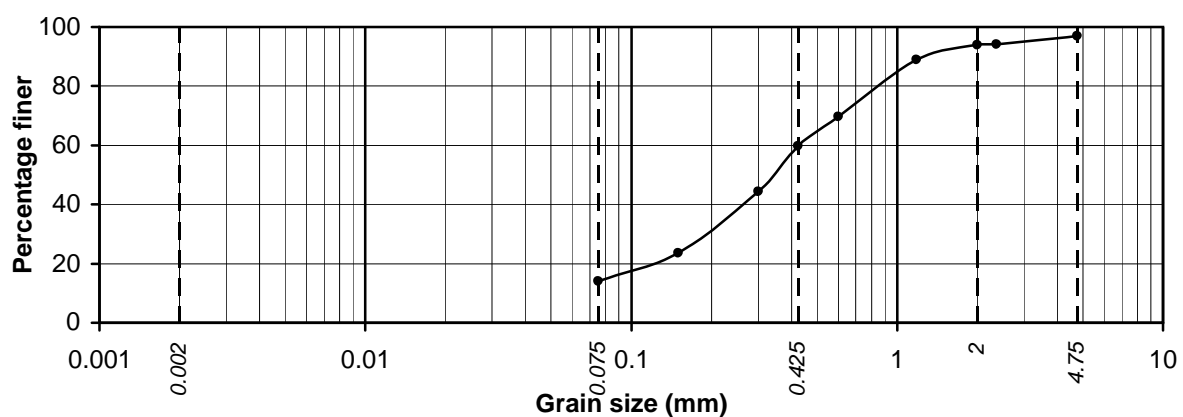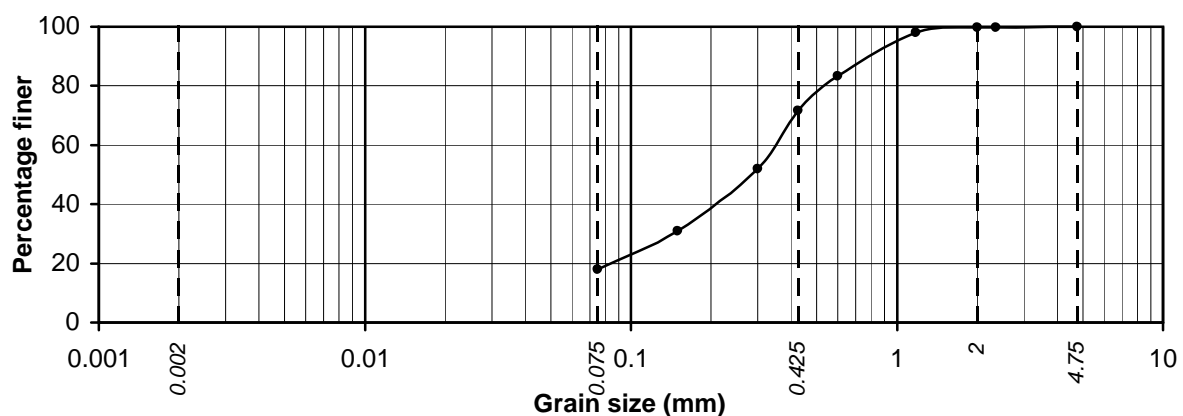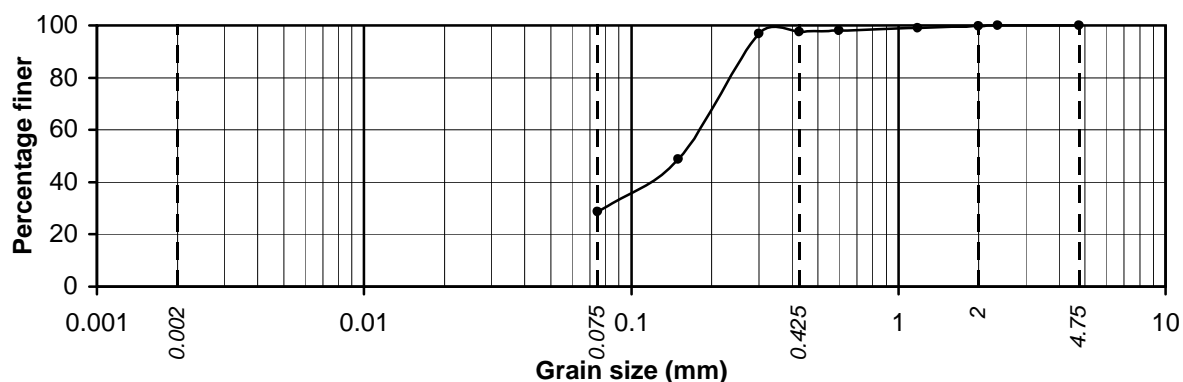


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/61


### GRAIN SIZE DISTRIBUTION CURVES

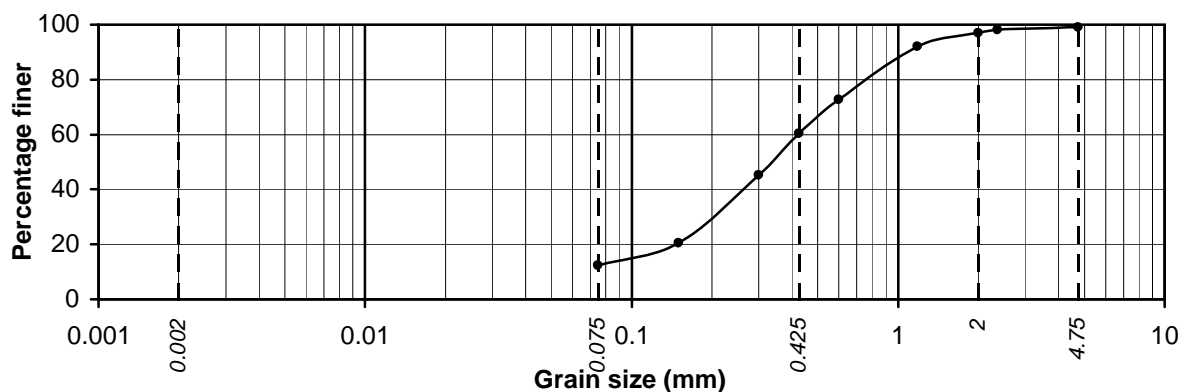

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-8, 50.00m		*12.5	48.0	36.6	2.0	0.9

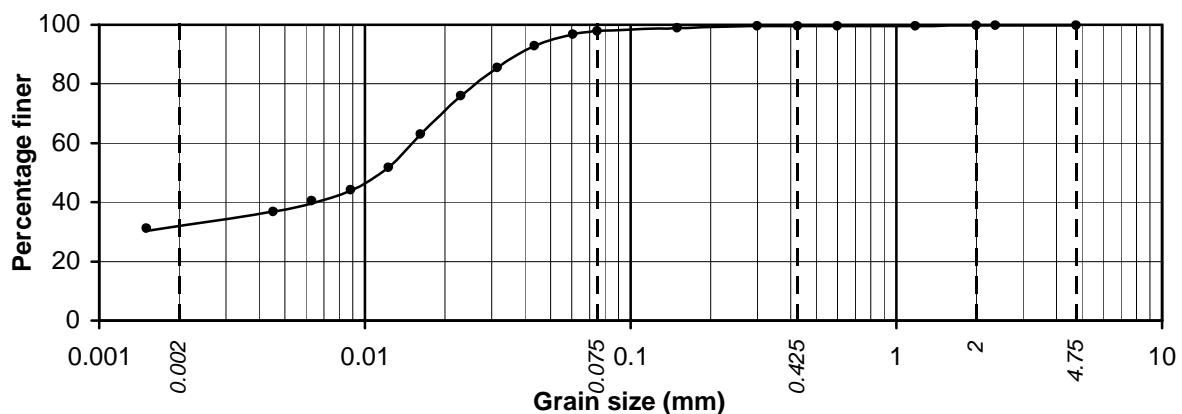

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-10, 1.50m	32.0	65.8	1.7	0.2	0.1	0.2

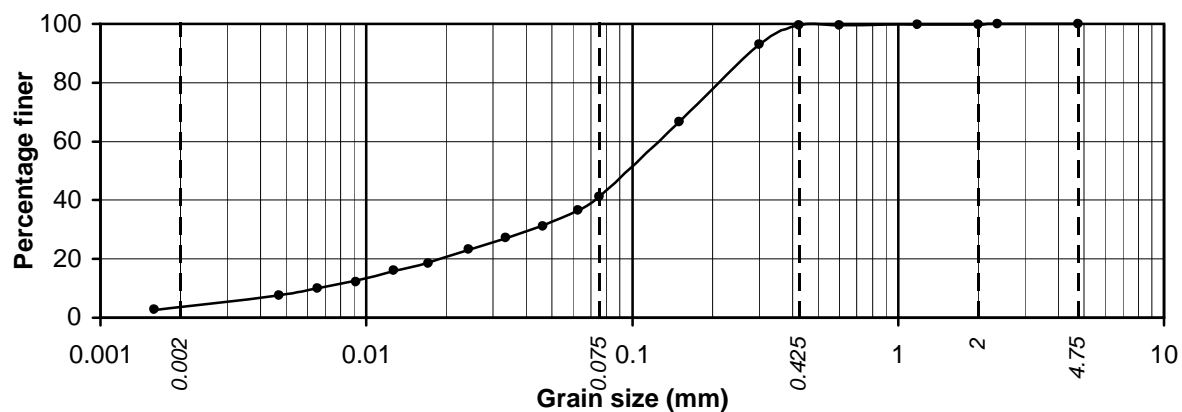

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-10, 3.00m	3.7	37.4	58.4	0.4	0.1	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/62


### GRAIN SIZE DISTRIBUTION CURVES

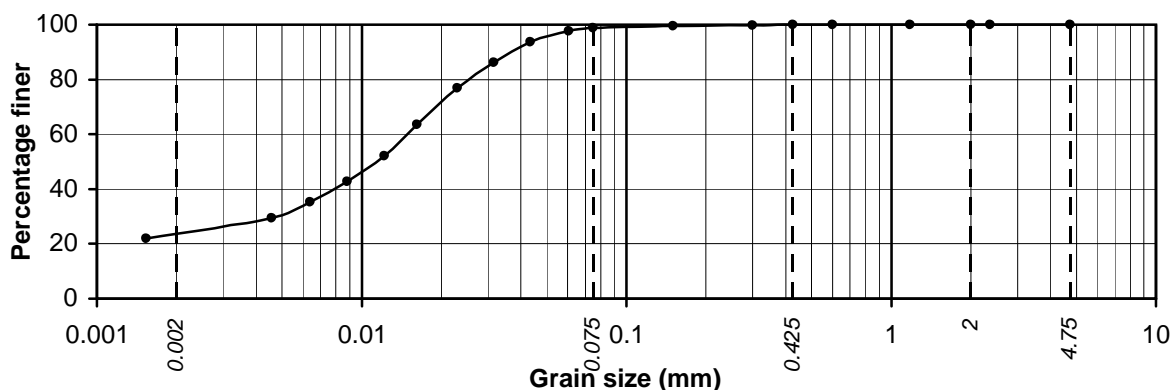

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 4.50m	23.8	74.9	1.2	0.1	0.0	0.0

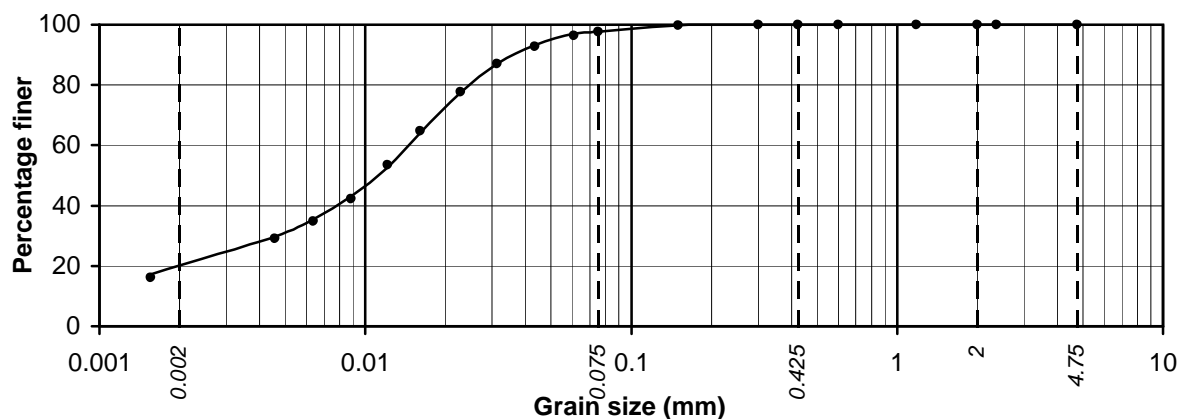

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 6.00m	20.0	77.6	2.4	0.0	0.0	0.0

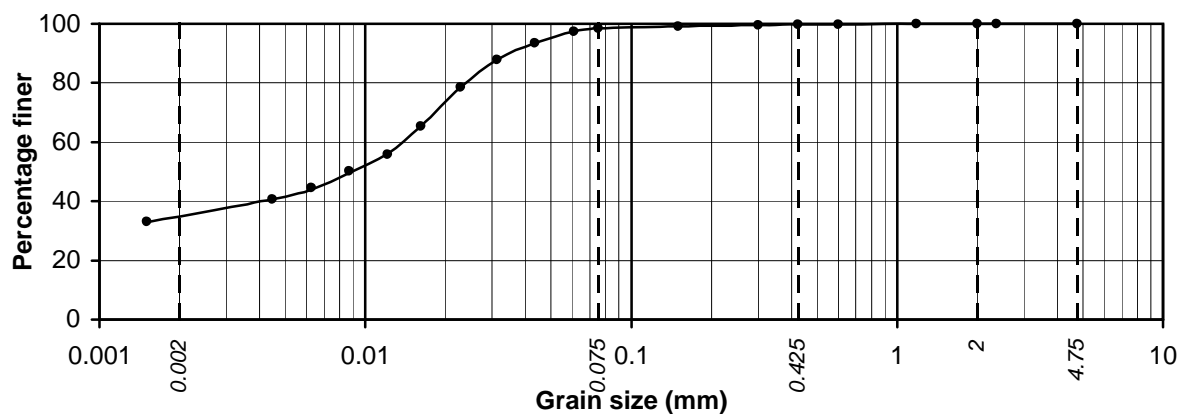


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 7.50m	35.0	63.6	1.1	0.3	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/63


### GRAIN SIZE DISTRIBUTION CURVES

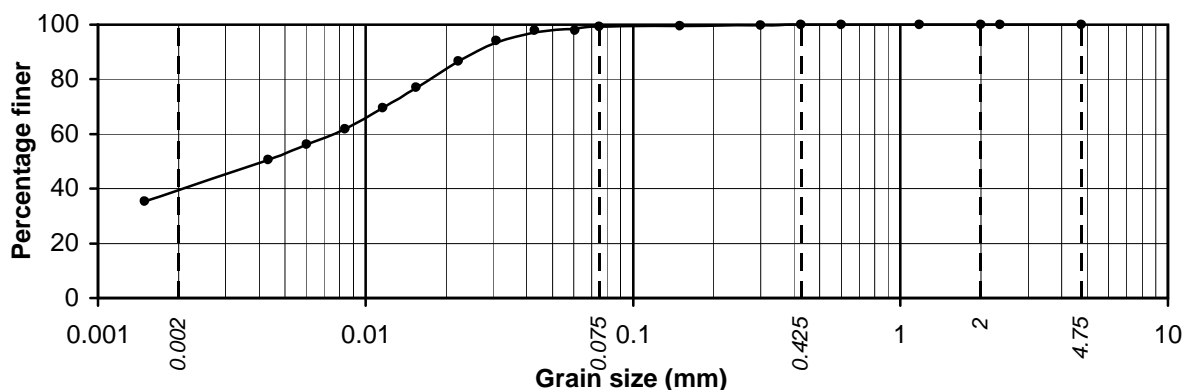

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 9.00m	39.5	59.7	0.8	0.0	0.0	0.0

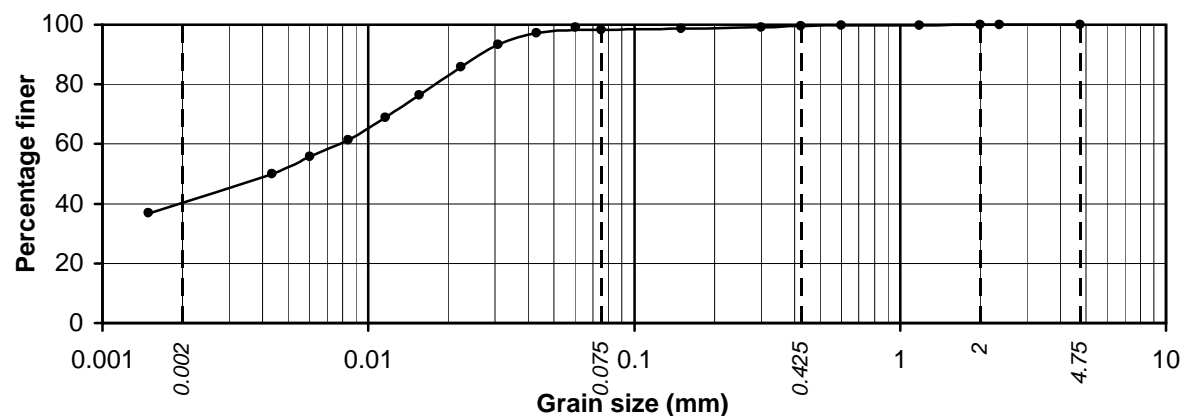

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 10.50m	40.4	58.0	1.2	0.3	0.0	0.1

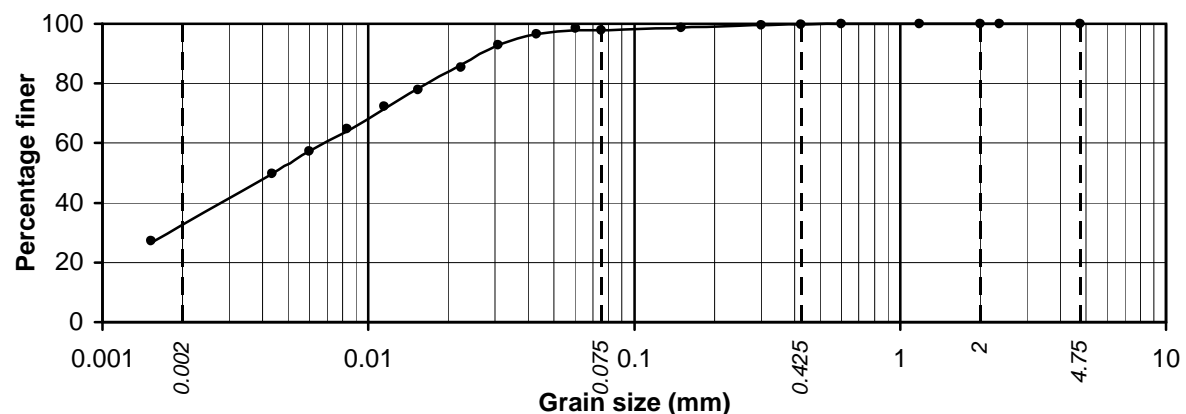

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 12.00m	32.6	65.2	2.0	0.2	0.0	0.0


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211


**Fig. No.**  
E/64




### GRAIN SIZE DISTRIBUTION CURVES

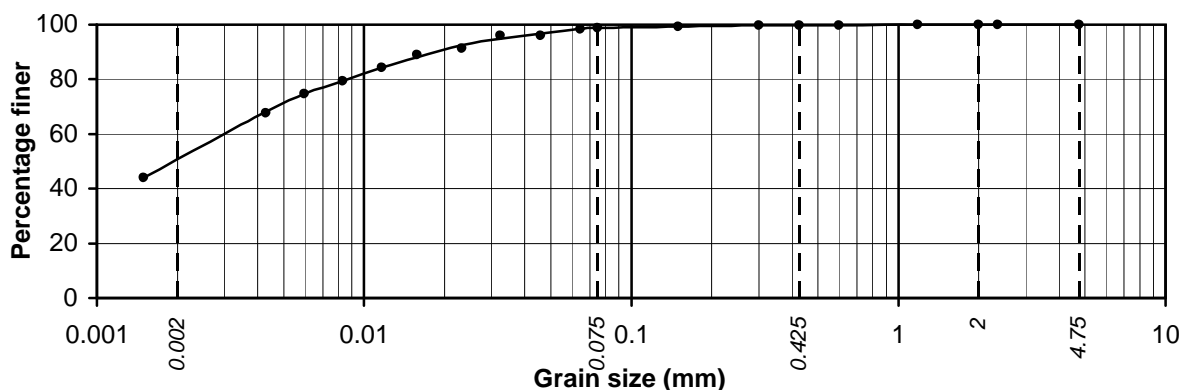

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 13.50m	50.7	48.1	0.9	0.3	0.0	0.0

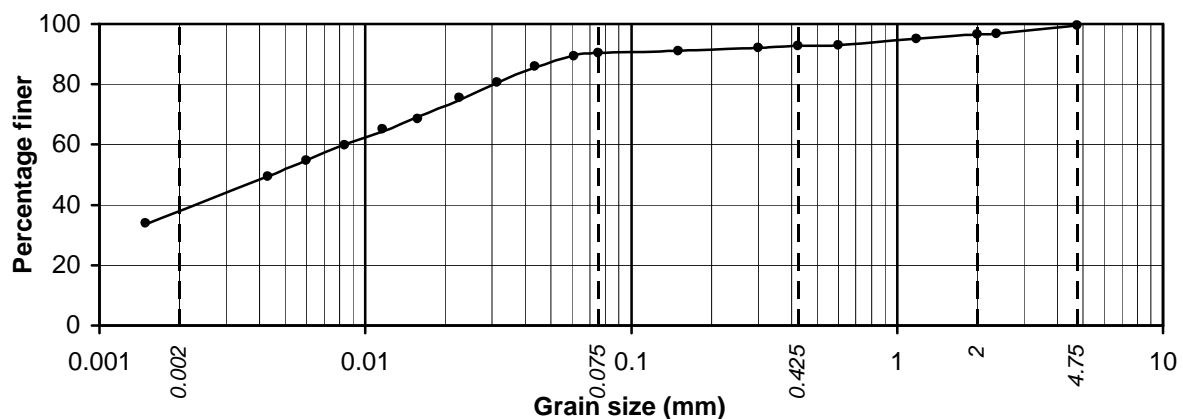

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 16.50m	38.0	52.5	2.2	3.9	3.0	0.4

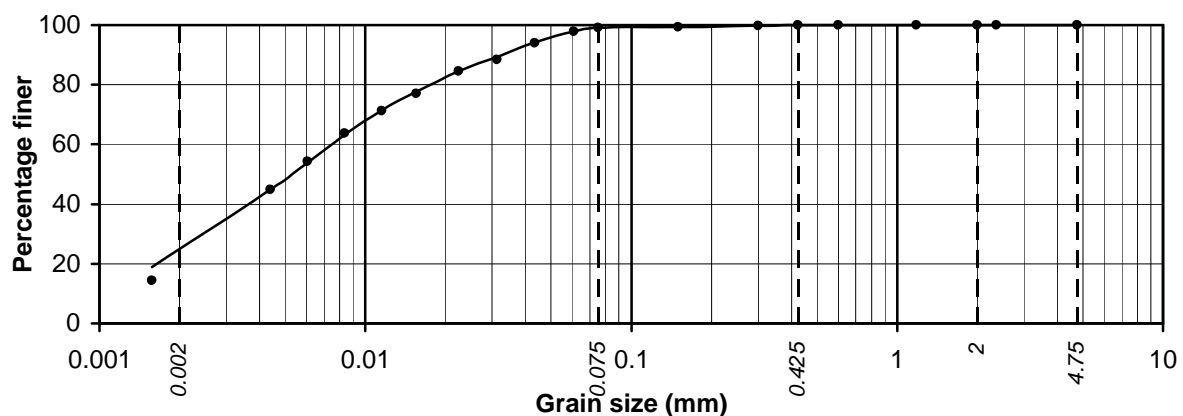


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 18.50m	25.0	74.0	0.9	0.1	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/65


### GRAIN SIZE DISTRIBUTION CURVES

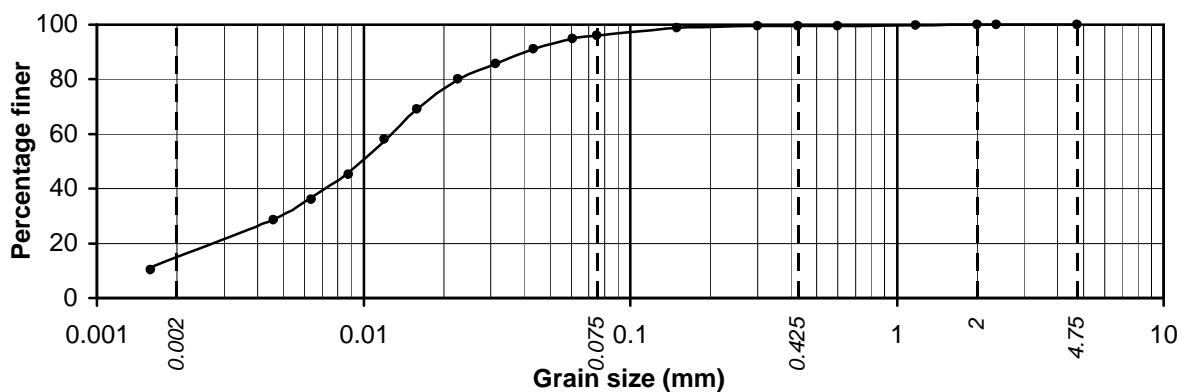

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 19.50m	15.0	81.0	3.6	0.3	0.1	0.0

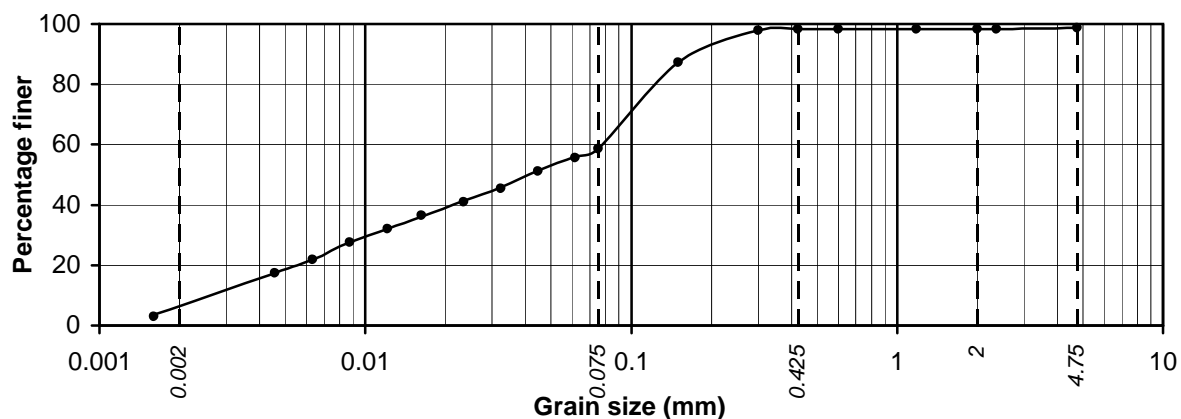

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 21.50m	6.5	52.0	39.7	0.2	0.3	1.3

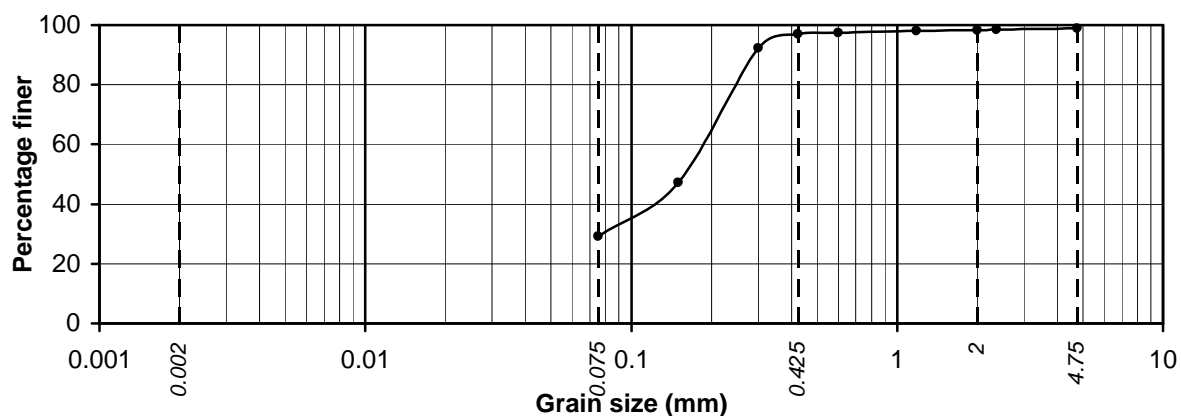

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 23.00m	*29.3	67.7	1.4	0.5	1.1	


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/66


### GRAIN SIZE DISTRIBUTION CURVES

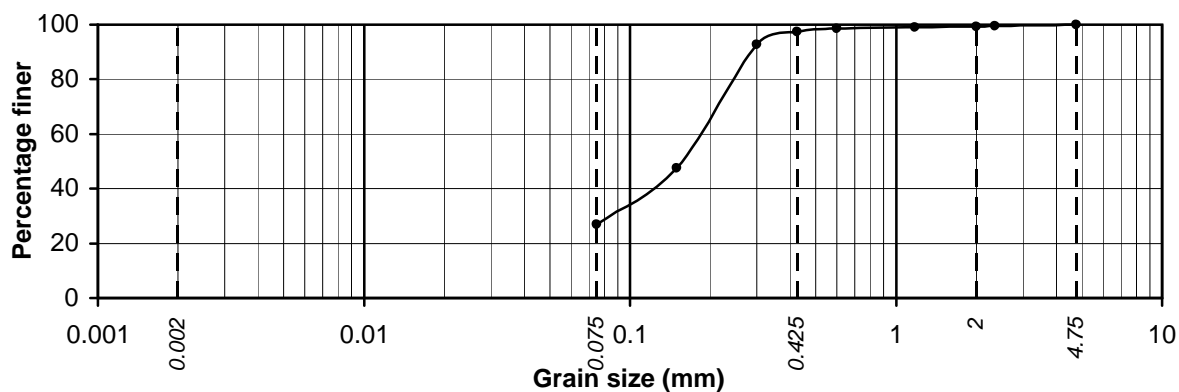

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 26.00m		*27.0	70.4	2.0	0.6	0.0

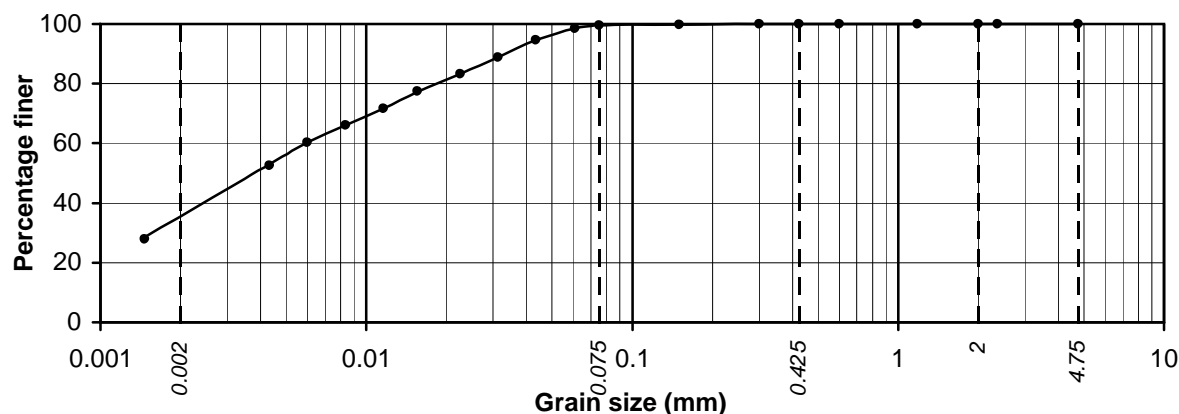

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 27.00m	35.0	64.6	0.3	0.1	0.0	0.0

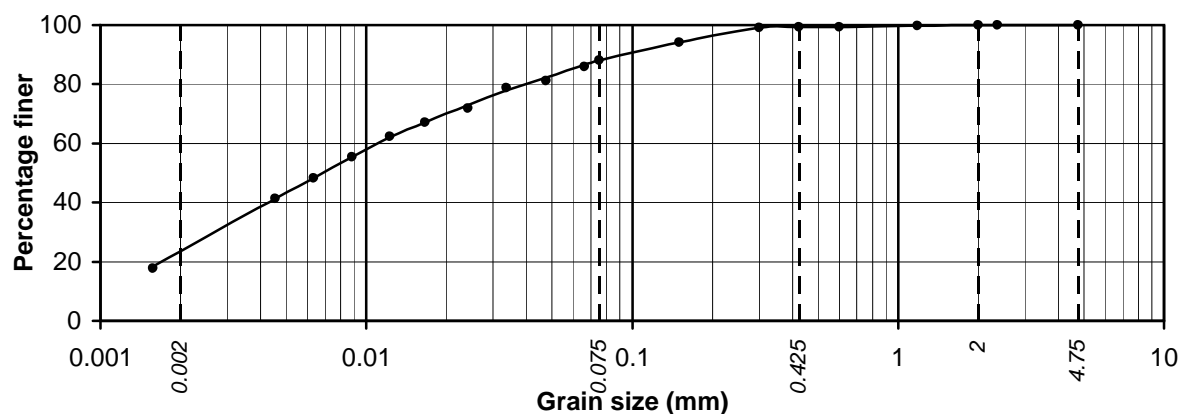

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 30.00m	23.5	64.7	11.1	0.7	0.0	0.0


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/67


### GRAIN SIZE DISTRIBUTION CURVES

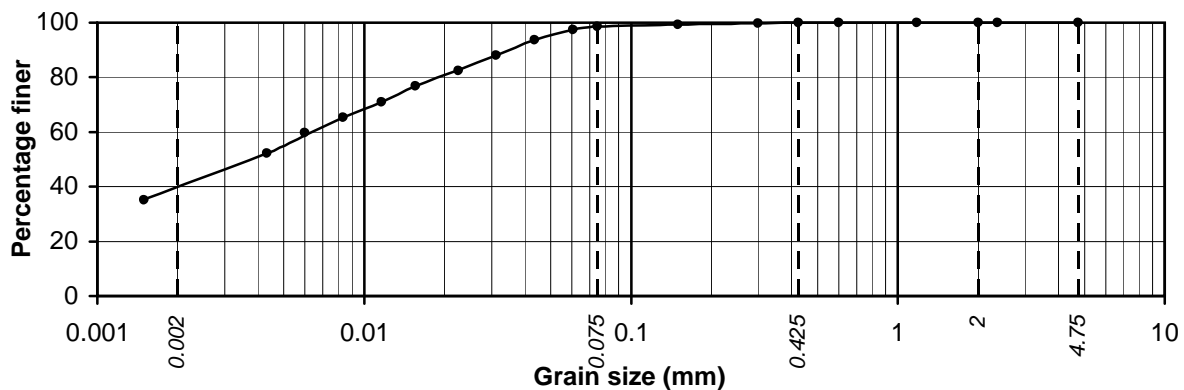

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 32.00m	40.0	58.7	1.2	0.1	0.0	0.0

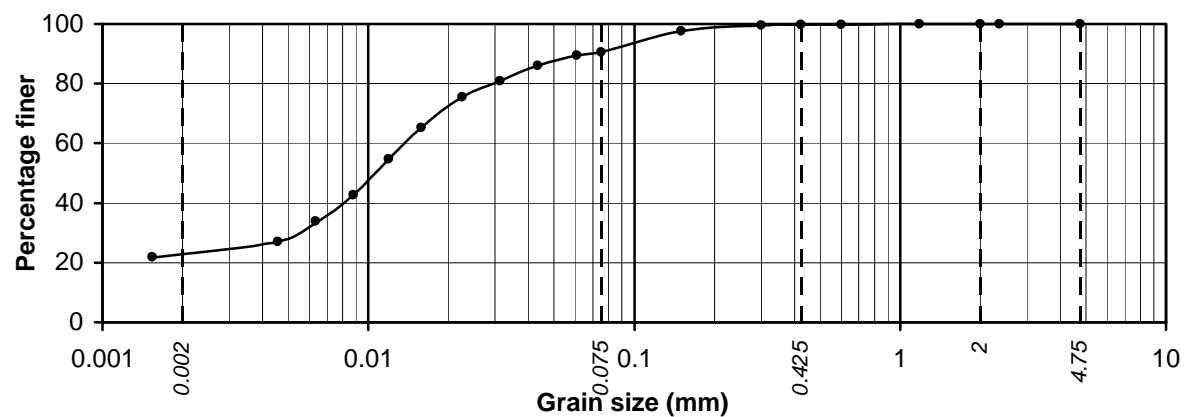

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 35.00m	23.0	67.6	9.2	0.2	0.0	0.0

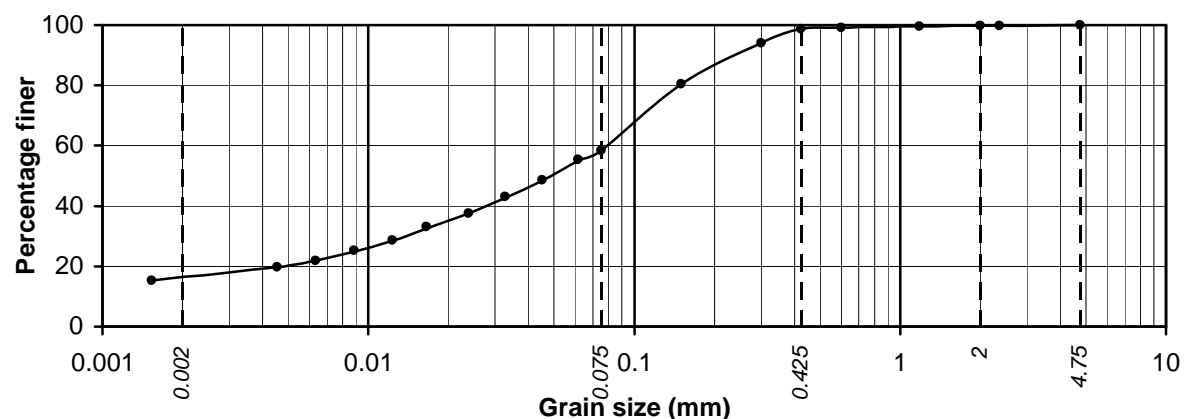


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 36.50m	16.3	42.0	40.5	1.0	0.2	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/68


### GRAIN SIZE DISTRIBUTION CURVES

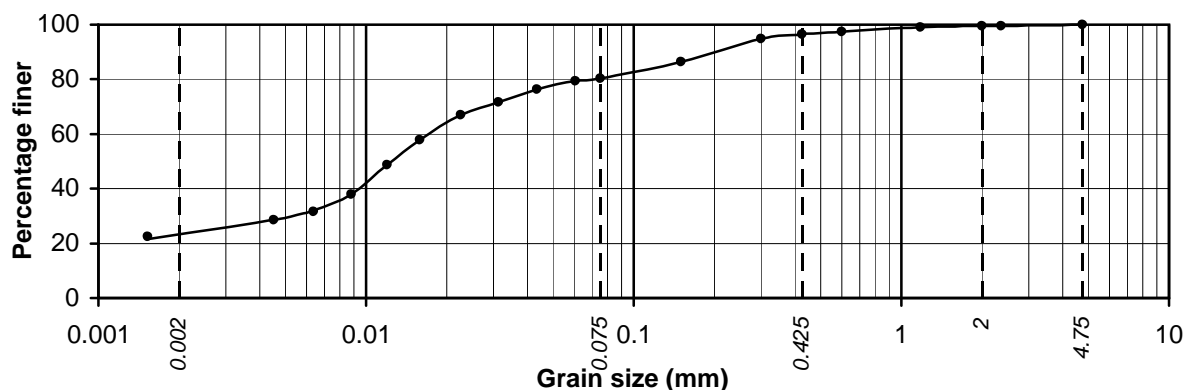

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 39.50m	23.3	57.0	16.2	3.0	0.4	0.1

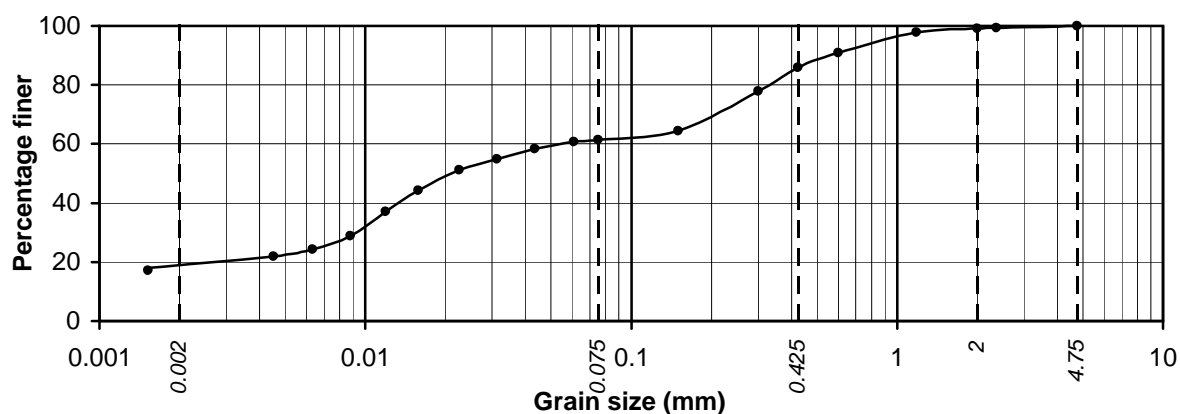

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 42.50m	19.0	42.5	24.5	13.2	0.8	0.0

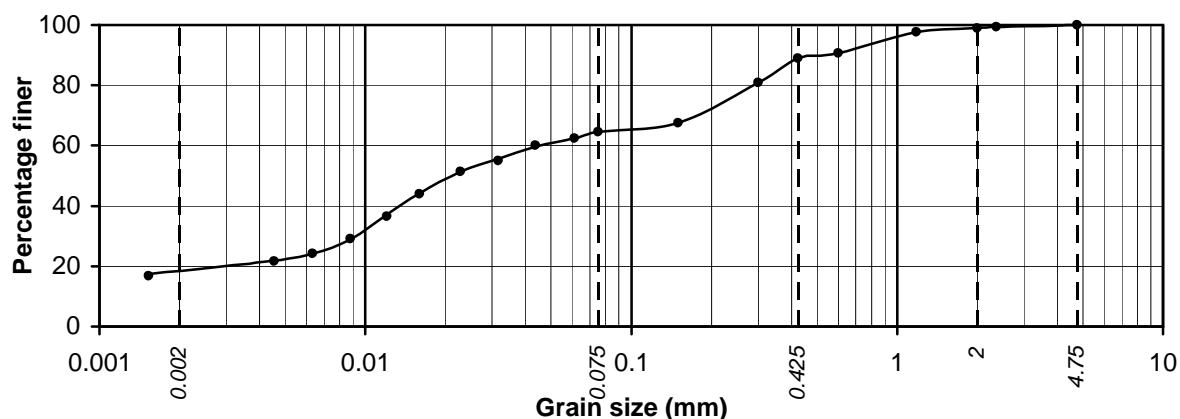


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 44.00m	18.5	46.0	24.5	10.0	1.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/69


### GRAIN SIZE DISTRIBUTION CURVES

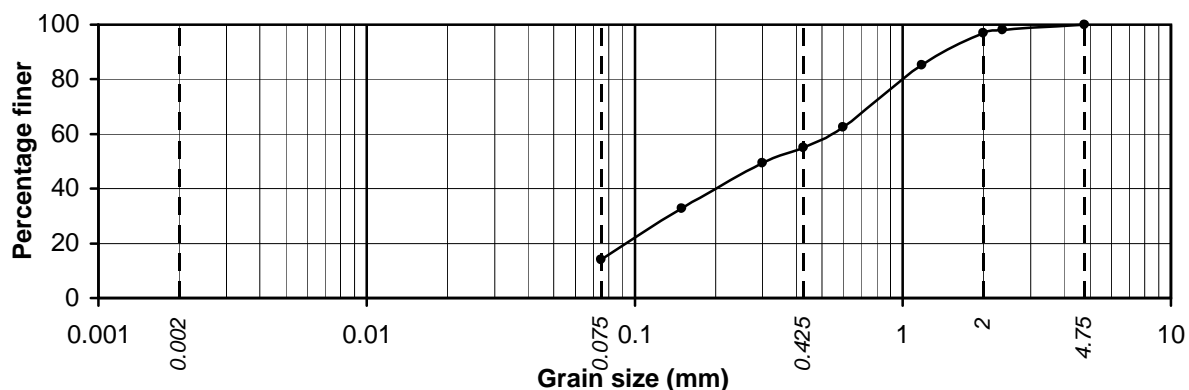

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 47.00m		*14.0	41.0	42.0	3.0	0.0

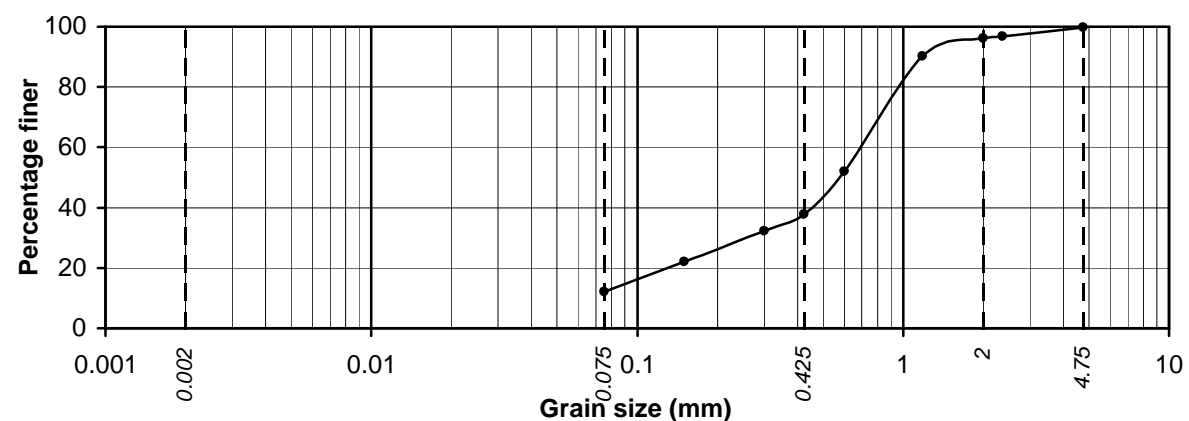

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-10, 50.00m		*12.1	25.7	58.4	3.7	0.1

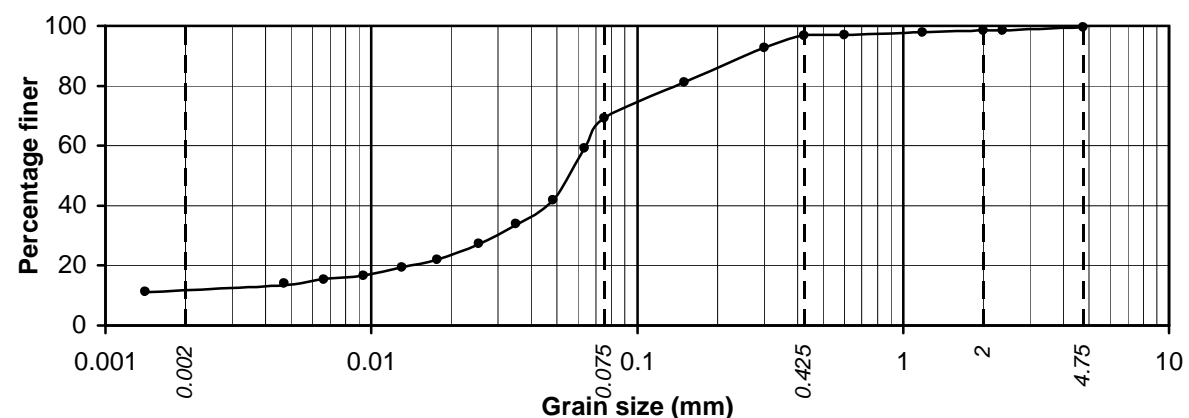

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 1.00m	11.8	57.4	27.6	1.7	1.2	0.3


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/70


### GRAIN SIZE DISTRIBUTION CURVES

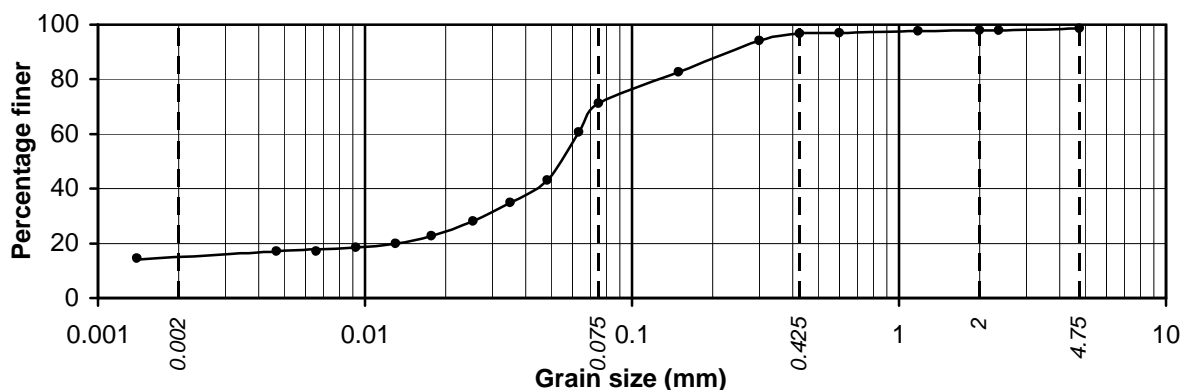

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 2.50m	15.0	56.1	25.6	1.2	0.7	1.4

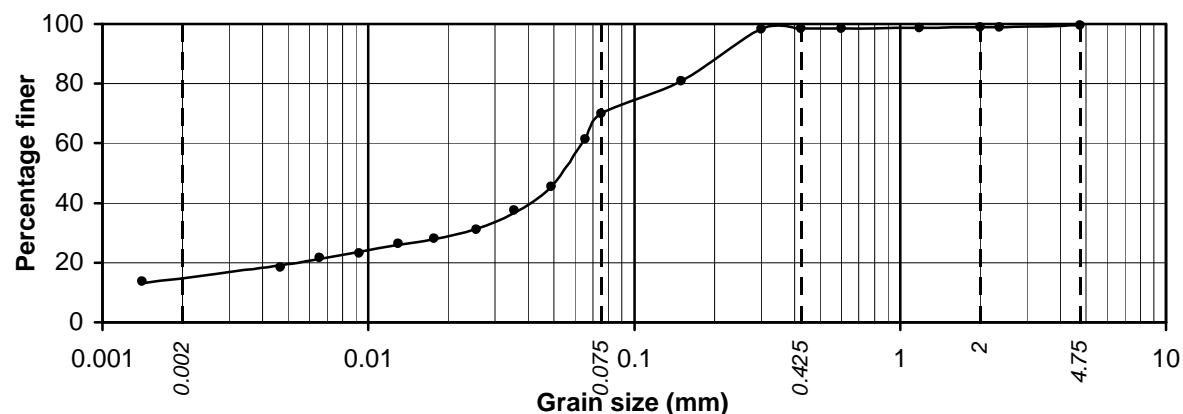

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 4.00m	14.8	55.0	28.7	0.4	0.6	0.5

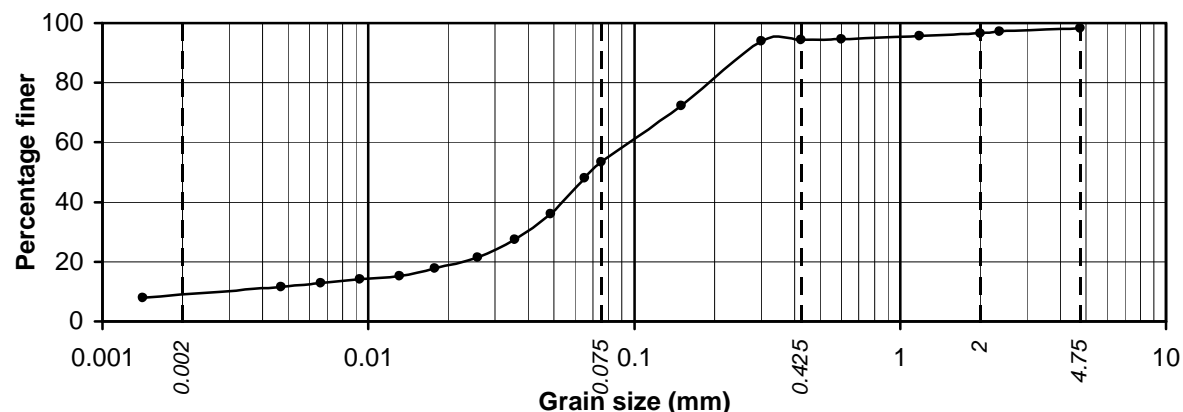


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 4.50m	9.1	44.2	41.1	2.0	1.9	1.7

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/71


### GRAIN SIZE DISTRIBUTION CURVES

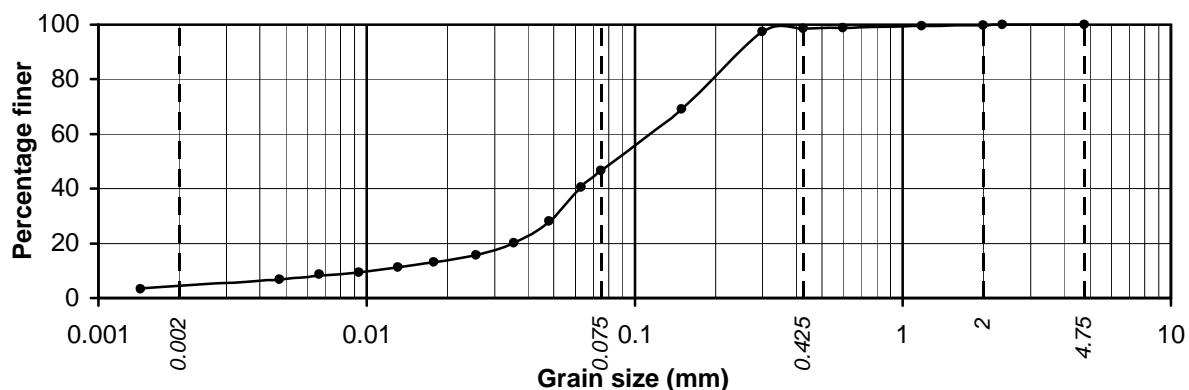

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 7.00m	4.5	42.0	52.1	1.2	0.2	0.0

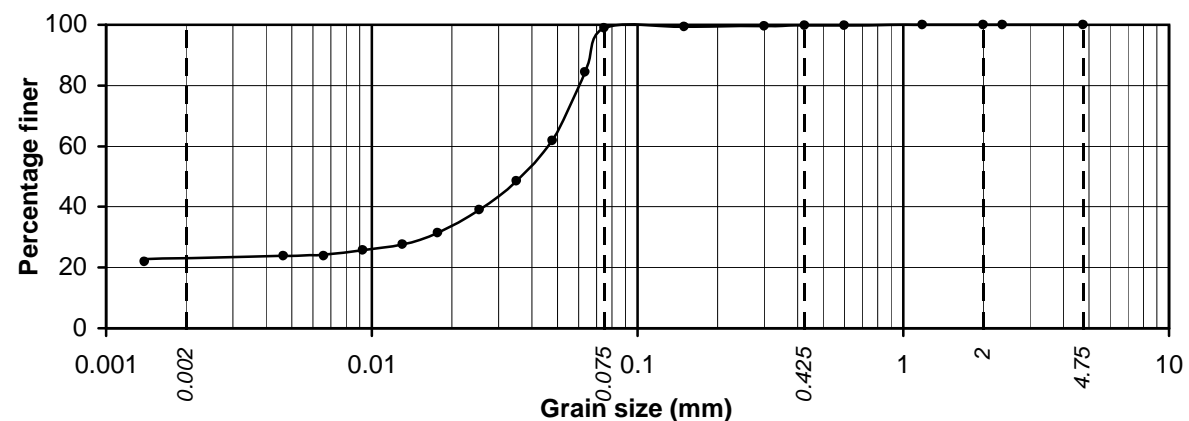

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 8.50m	23.0	75.9	0.9	0.2	0.0	0.0

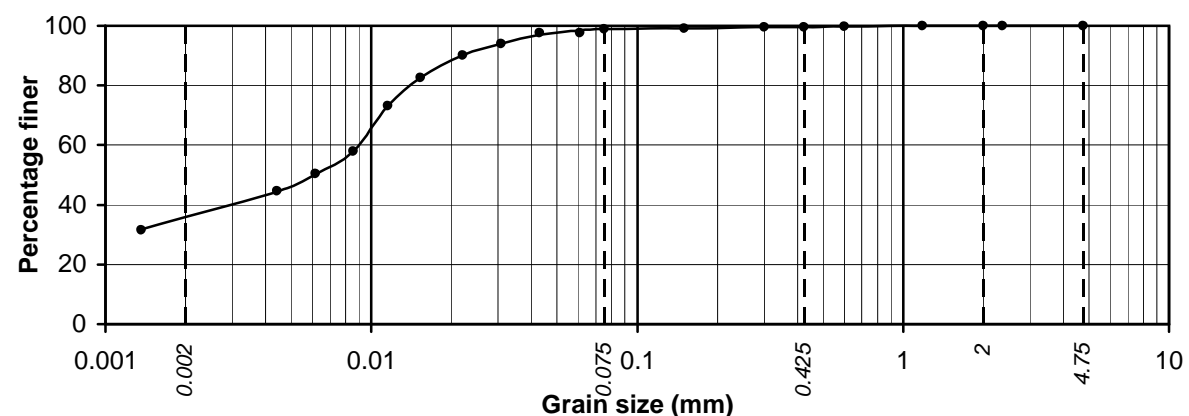

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 10.00m	35.9	63.0	0.7	0.4	0.0	0.0


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211


**Fig. No.**  
E/72




### GRAIN SIZE DISTRIBUTION CURVES

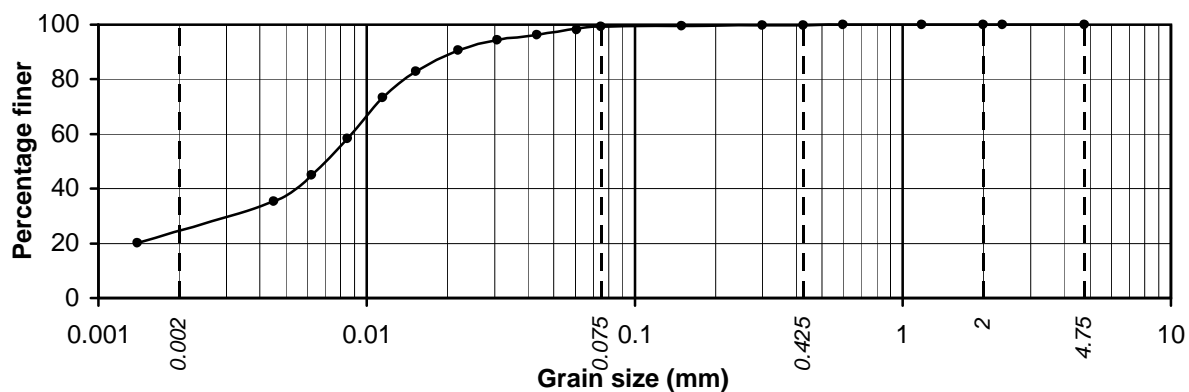

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 11.50m	24.8	74.6	0.5	0.1	0.0	0.0

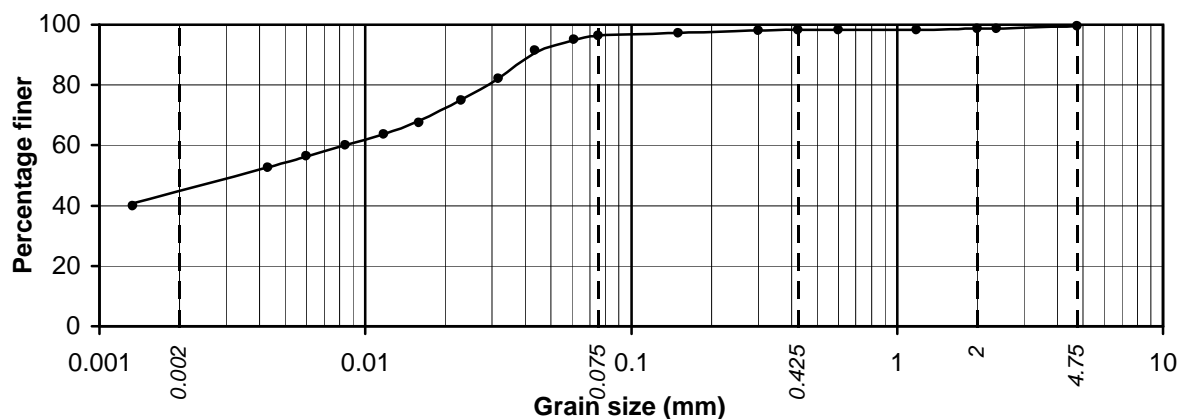

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 14.50m	45.0	51.2	2.0	0.5	0.9	0.4

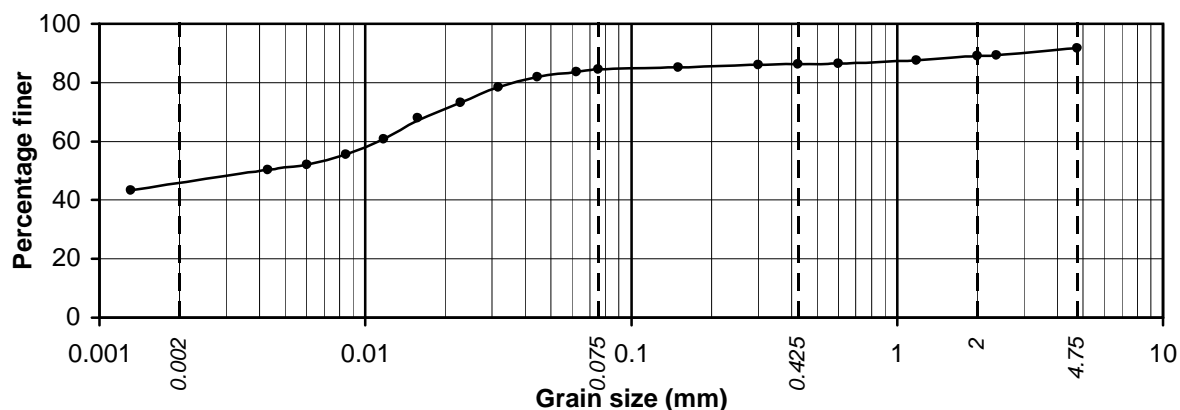


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 16.50m	45.7	38.8	1.7	2.8	2.7	8.3

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


**Job No.**  
CCPL/20101211

**Fig. No.**  
E/73


### GRAIN SIZE DISTRIBUTION CURVES

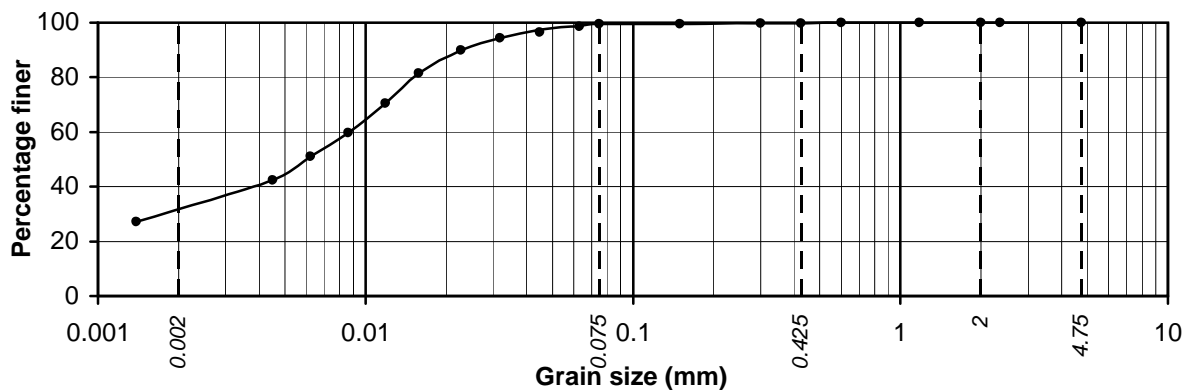

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 17.50m	32.0	67.5	0.4	0.1	0.0	0.0

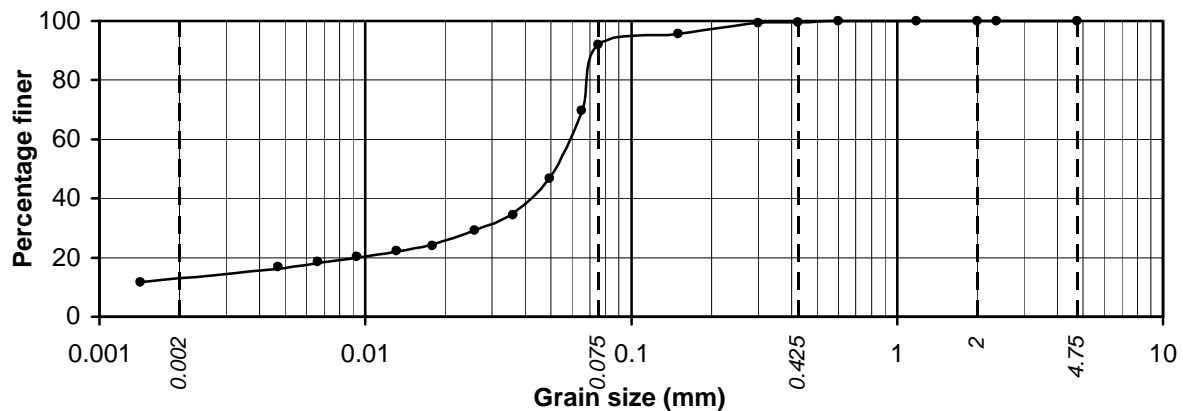

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 18.00m	13.0	79.0	7.5	0.5	0.0	0.0

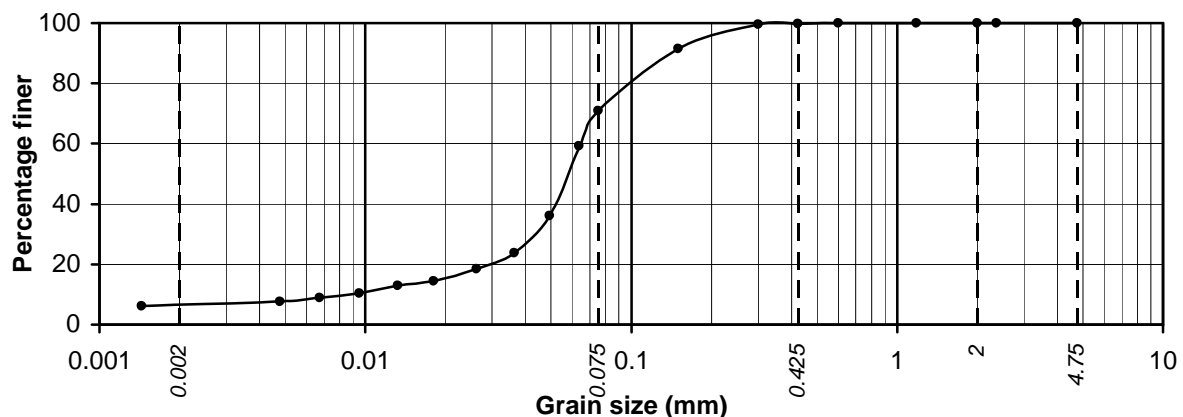




Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 19.50m	6.6	64.2	29.0	0.2	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
E/74

### GRAIN SIZE DISTRIBUTION CURVES

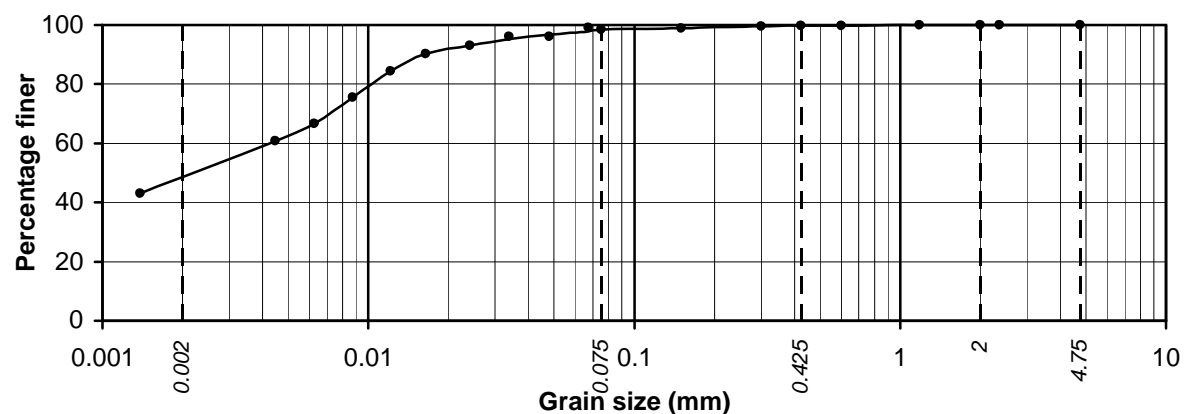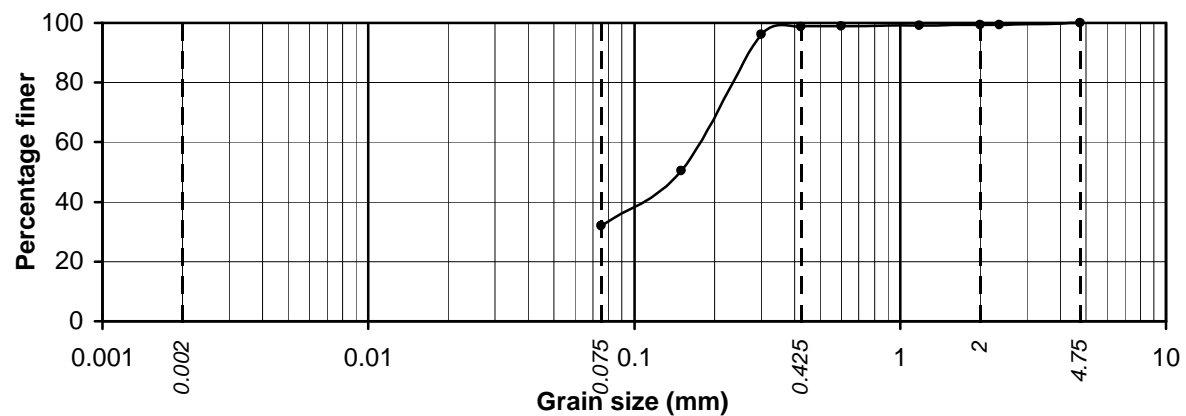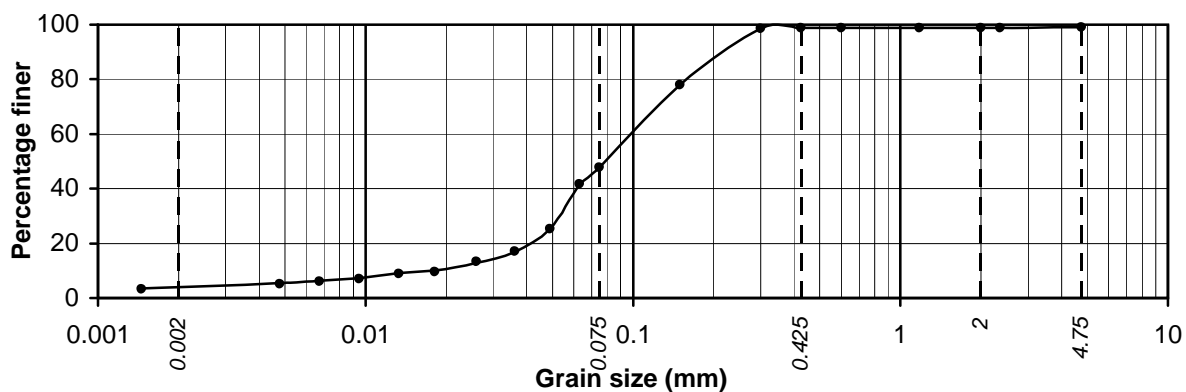


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/75


### GRAIN SIZE DISTRIBUTION CURVES

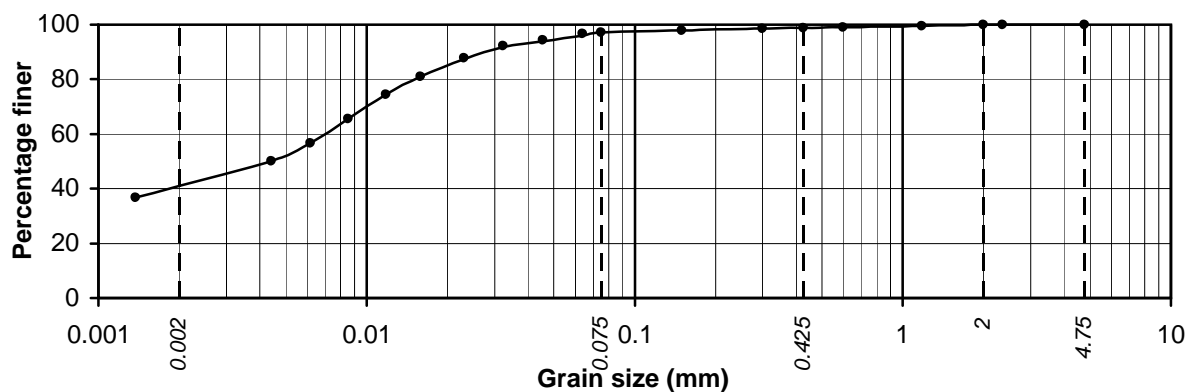

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 30.00m	41.1	56.1	1.7	1.0	0.1	0.0

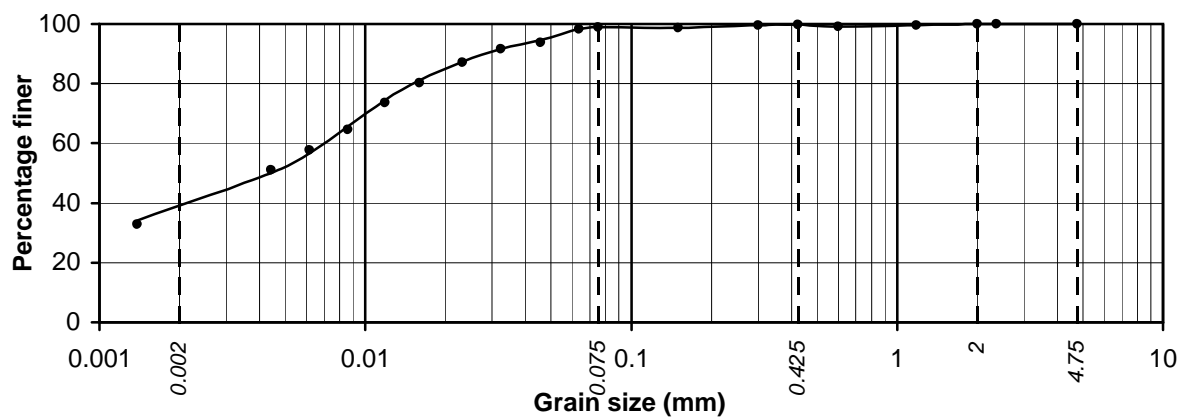

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 31.00m	39.2	59.8	0.8	0.1	0.1	0.0

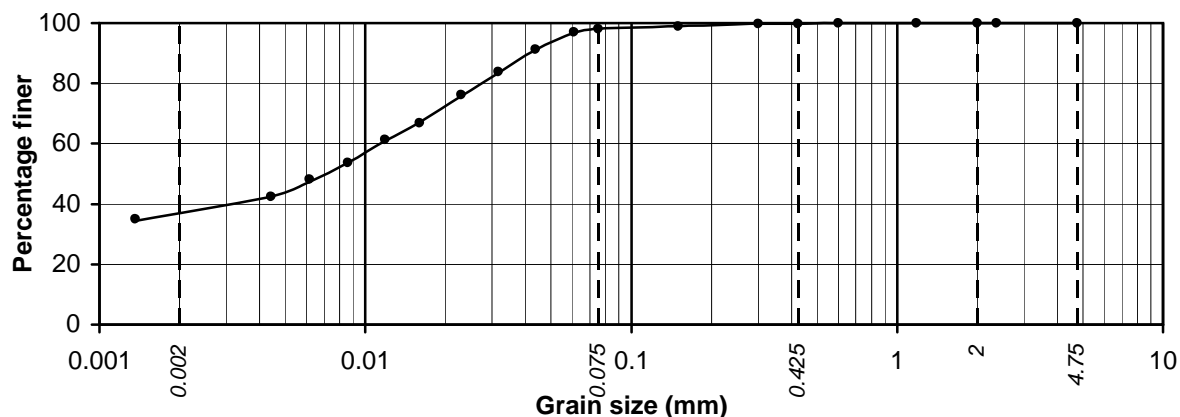


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 33.00m	37.0	61.1	1.7	0.2	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/76


### GRAIN SIZE DISTRIBUTION CURVES

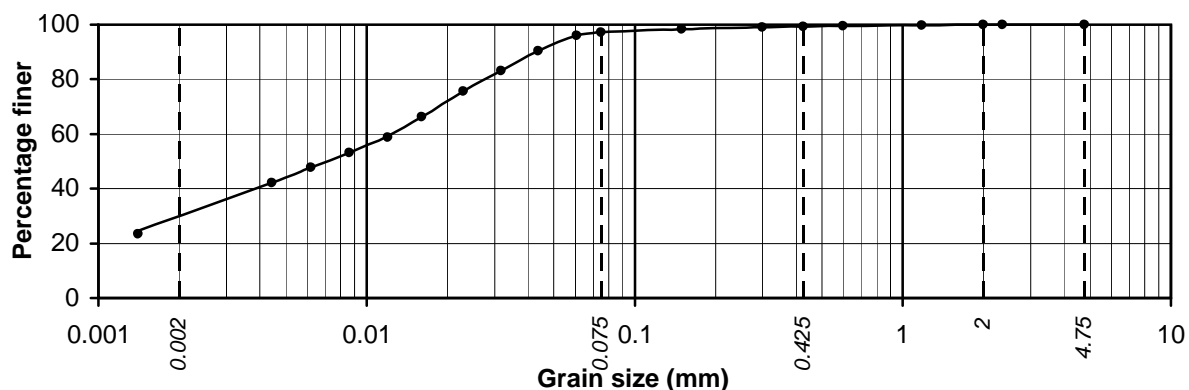

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 36.00m	30.0	67.3	2.0	0.7	0.0	0.0

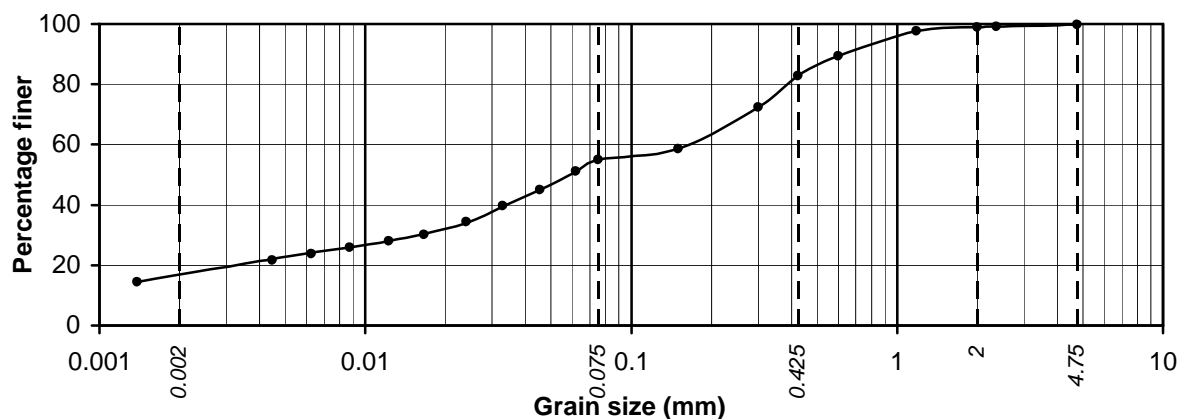

Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 39.00m	16.8	38.3	27.8	16.0	0.8	0.3

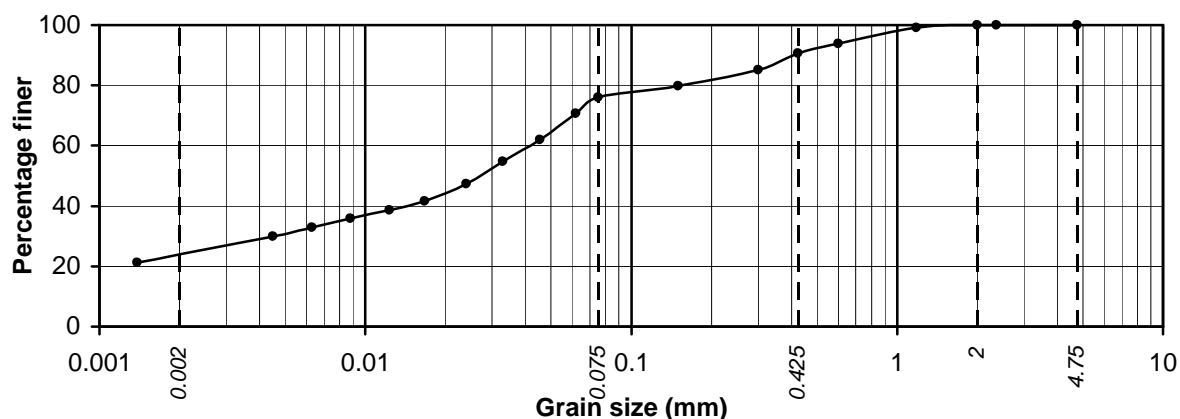


Grain size (mm)	<0.002	0.002-0.075	0.075-0.425	0.425-2.0	2.0-4.75	>4.75
Sample No.	Clay (%)	Silt (%)	Fine sand (%)	Medium sand (%)	Coarse sand (%)	Gravel (%)
BH-11, 43.50m	24.0	52.0	14.7	9.3	0.0	0.0

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock


Job No.  
CCPL/20101211

Fig. No.  
E/77


### GRAIN SIZE DISTRIBUTION CURVES

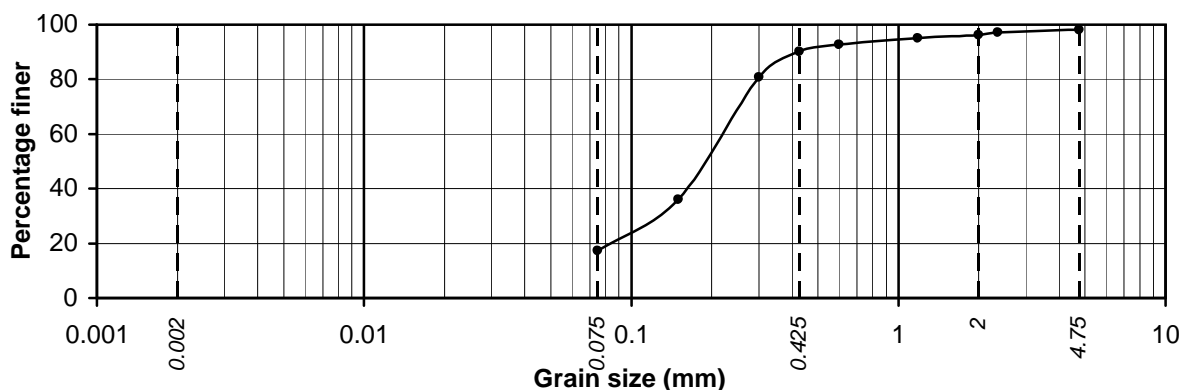

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-11, 45.00m	*17.3		73.0	5.9	2.0	1.8

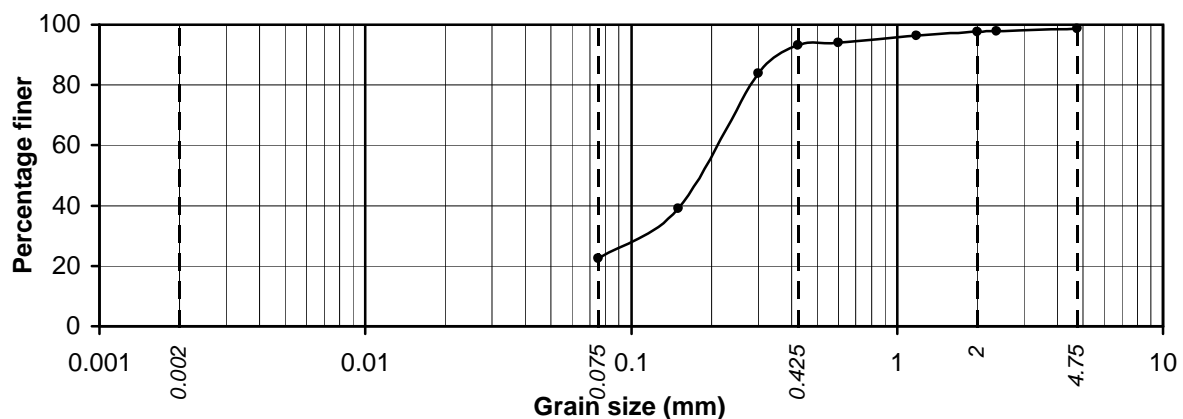

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-11, 48.00m	*22.6		70.7	4.4	1.1	1.2

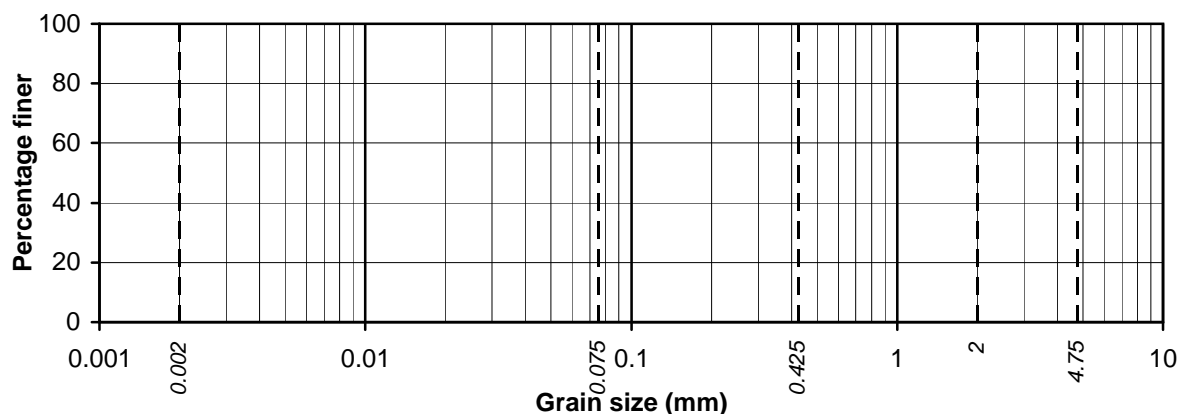

Grain size (mm)	<0.002 Clay (%)	0.002-0.075 Silt (%)	0.075-0.425 Fine sand (%)	0.425-2.0 Medium sand (%)	2.0-4.75 Coarse sand (%)	>4.75 Gravel (%)
Sample No.						
BH-11, 48.00m	*22.6		70.7	4.4	1.1	1.2


\*Silt & Clay

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
E/78

**Mohr-Diagram**

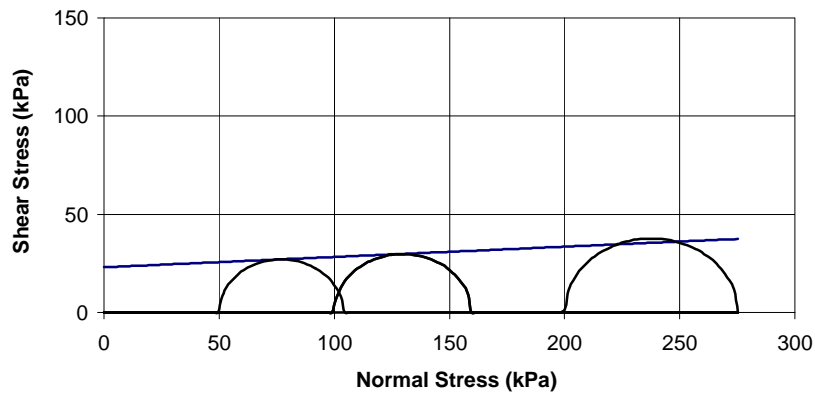


BH No.: BH-1  
Depth: 0.50 m

**Test Type: UU**

$c : 23 \text{ kPa}$   
 $\phi : 3.0^\circ$

**Mohr-Diagram**

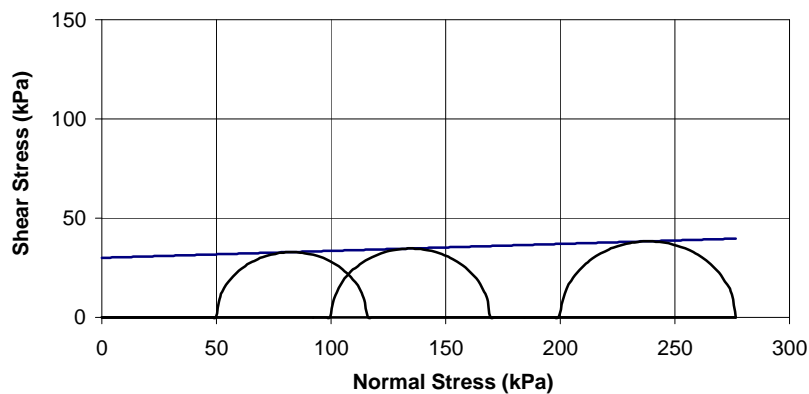


BH No.: BH-1  
Depth: 2.00 m

**Test Type: UU**

$c : 30 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

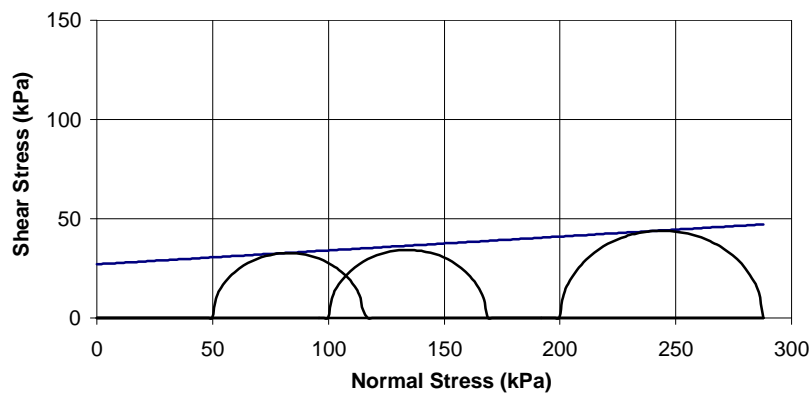

BH No.: BH-1  
Depth: 3.50 m

**Test Type: UU**


$c : 27 \text{ kPa}$   
 $\phi : 4.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/1

**Mohr-Diagram**

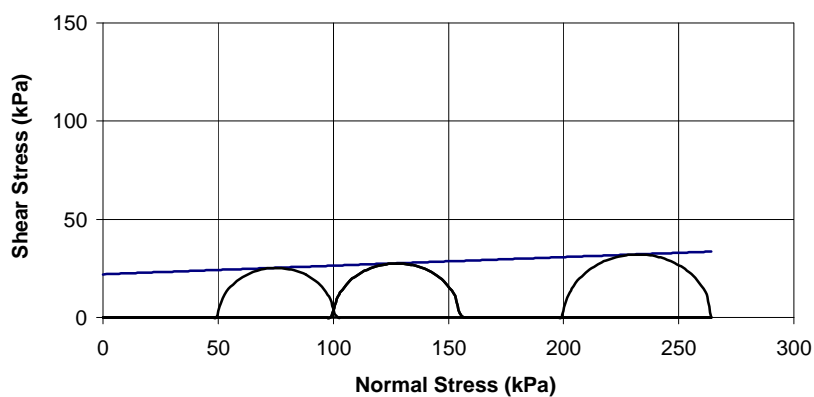


BH No.: BH-1  
Depth: 5.00 m

**Test Type: UU**

$c : 22 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

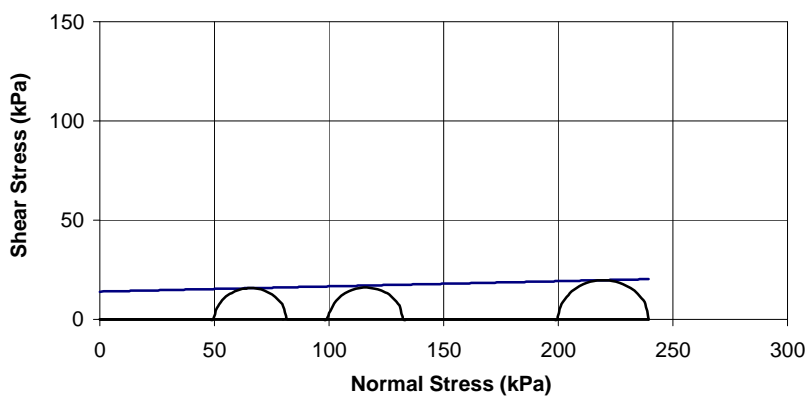


BH No.: BH-1  
Depth: 6.50 m

**Test Type: UU**

$c : 14 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

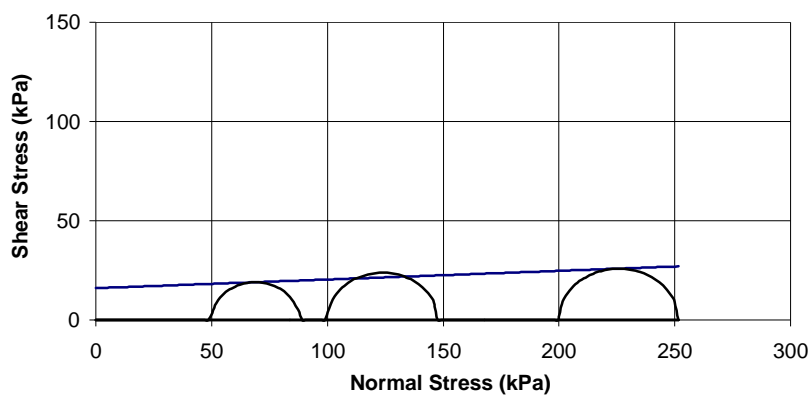

BH No.: BH-1  
Depth: 8.00 m

**Test Type: UU**

$c : 16 \text{ kPa}$   
 $\phi : 2.5^\circ$


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/2



**Mohr-Diagram**

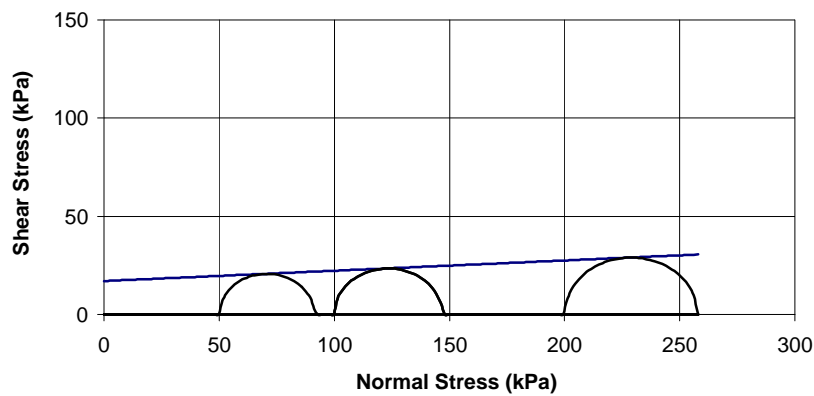


BH No.: BH-1  
Depth: 9.50 m

**Test Type: UU**

$c : 17 \text{ kPa}$   
 $\phi : 3.0^\circ$

**Mohr-Diagram**

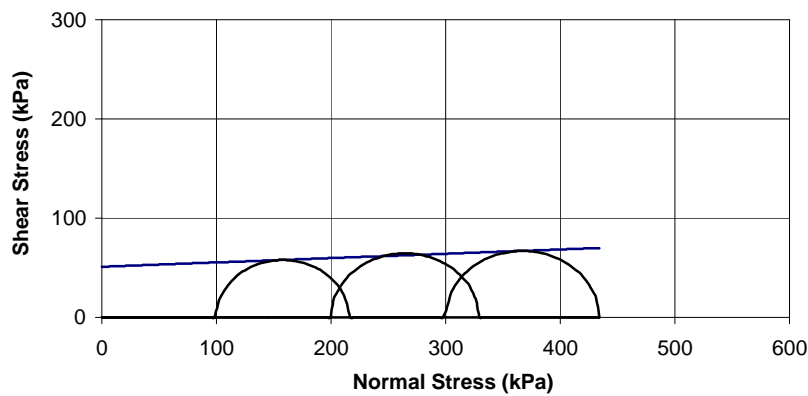


BH No.: BH-1  
Depth: 11.00 m

**Test Type: UU**

$c : 51 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

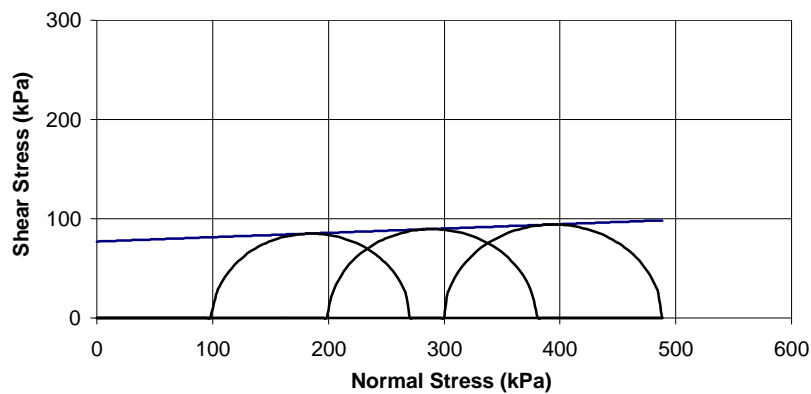

BH No.: BH-1  
Depth: 14.00 m

**Test Type: UU**


$c : 77 \text{ kPa}$   
 $\phi : 2.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/3

**Mohr-Diagram**

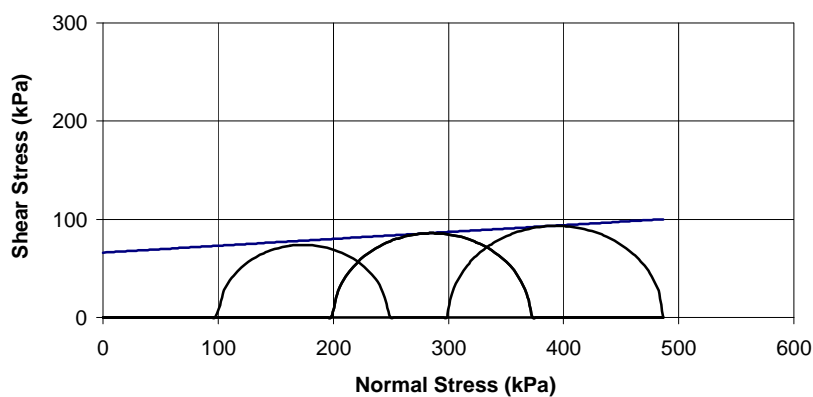


BH No.: BH-1  
Depth: 17.00 m

**Test Type: UU**

$c : 66 \text{ kPa}$   
 $\phi : 4.0^\circ$

**Direct Shear Test**

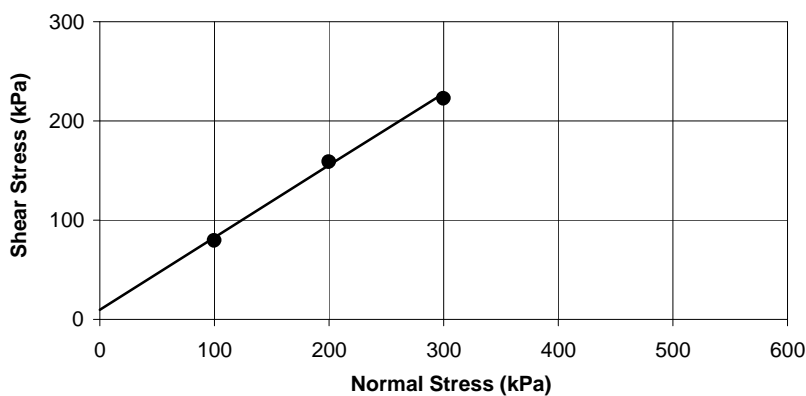


BH No.: BH-1  
Depth: 22.00 m

**Test Type: DS<sub>R</sub>**

$c : 10 \text{ kPa}$   
 $\phi : 36.0^\circ$

**Mohr-Diagram**

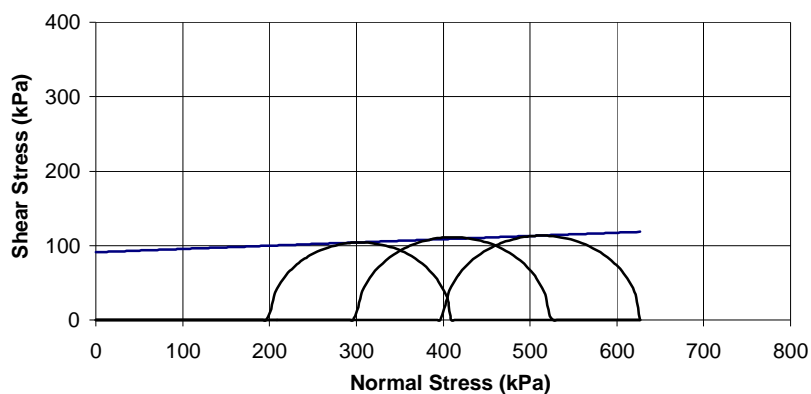

BH No.: BH-1  
Depth: 26.00 m

**Test Type: UU**


$c : 91 \text{ kPa}$   
 $\phi : 2.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/4

**Mohr-Diagram**

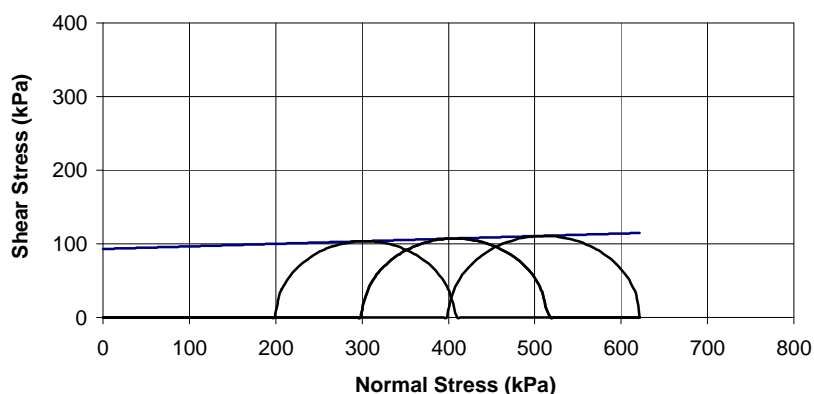


BH No.: BH-1  
Depth: 29.00 m

**Test Type: UU**

$c : 93 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Direct Shear Test**

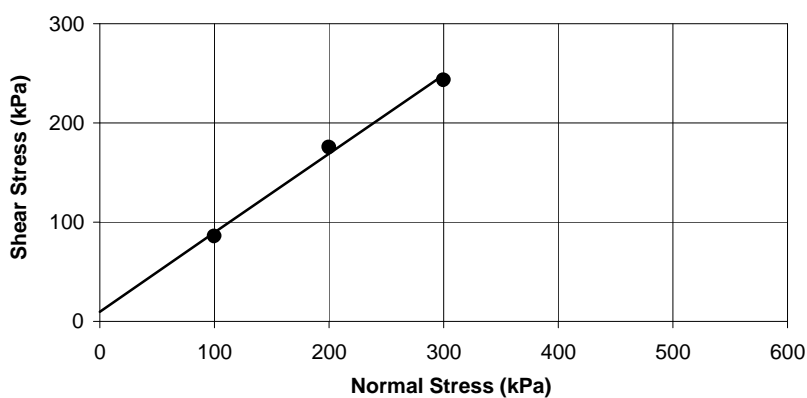


BH No.: BH-1  
Depth: 37.00 m

**Test Type: DS<sub>R</sub>**

$c : 10 \text{ kPa}$   
 $\phi : 38.5^\circ$

**Direct Shear Test**

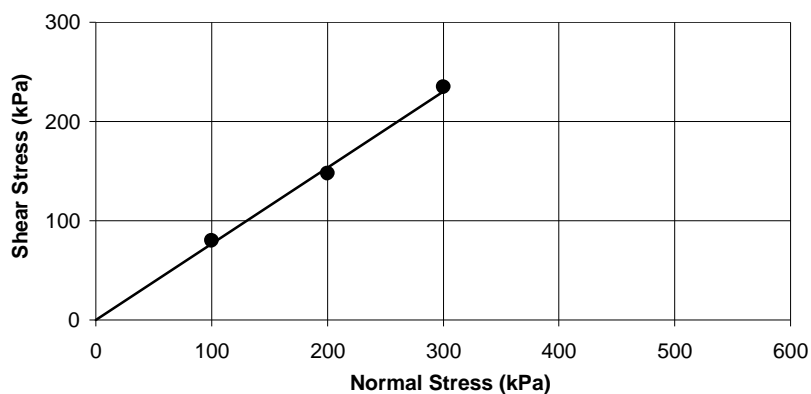

BH No.: BH-1  
Depth: 41.50 m

**Test Type: DS<sub>R</sub>**


$c : 0 \text{ kPa}$   
 $\phi : 37.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/5

### Direct Shear Test

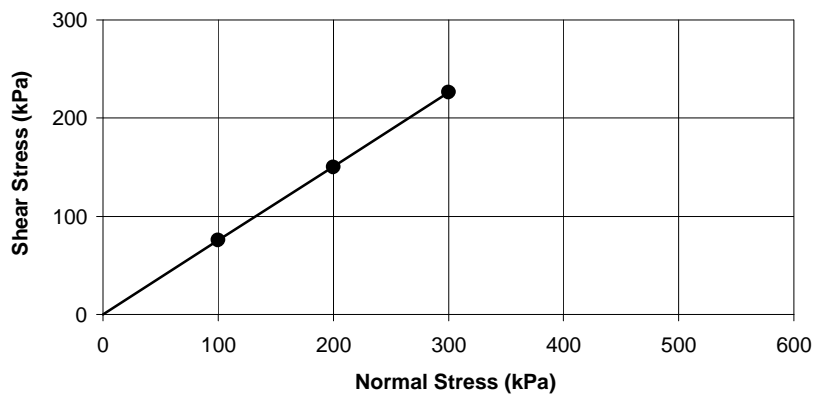


BH No.: BH-1  
Depth: 44.50 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.0^\circ$

### Direct Shear Test

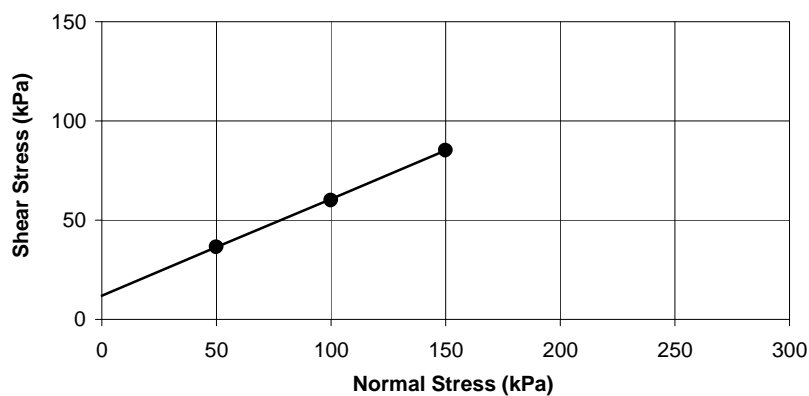


BH No.: BH-2  
Depth: 0.00 m

Test Type: DS

$c$  : 12 kPa  
 $\phi$  :  $26.0^\circ$

### Mohr-Diagram

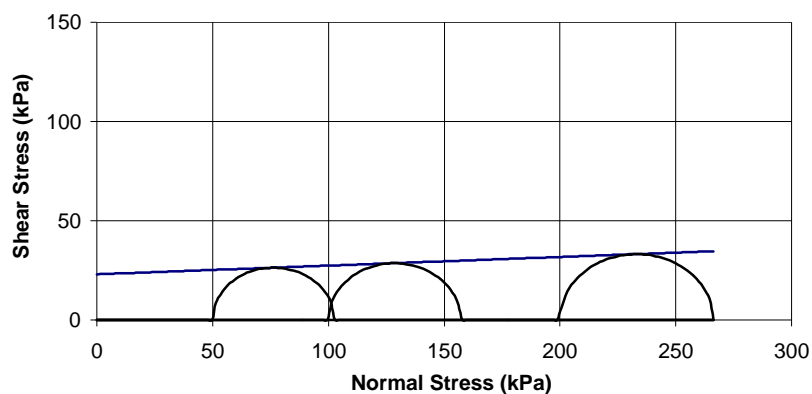

BH No.: BH-2  
Depth: 3.00 m

Test Type: UU


$c$  : 23 kPa  
 $\phi$  :  $2.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/6

**Mohr-Diagram**

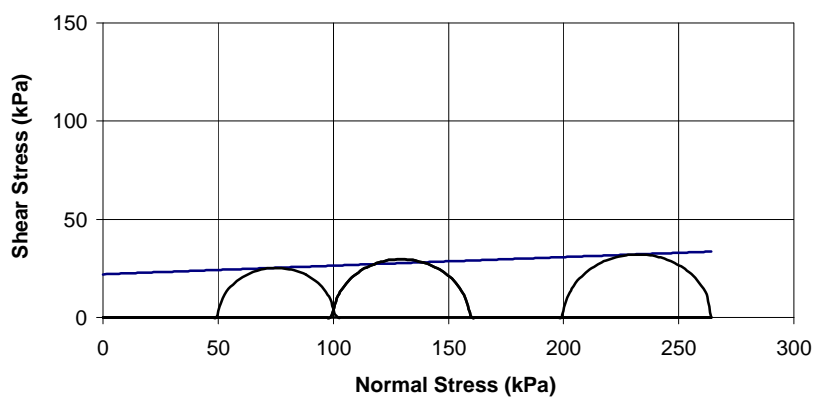


BH No.: BH-2  
Depth: 6.00 m

**Test Type: UU**

$c : 22 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

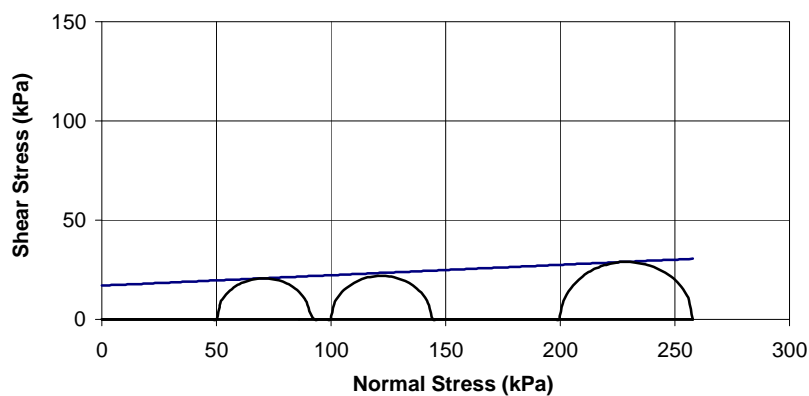


BH No.: BH-2  
Depth: 9.00 m

**Test Type: UU**

$c : 17 \text{ kPa}$   
 $\phi : 3.0^\circ$

**Mohr-Diagram**

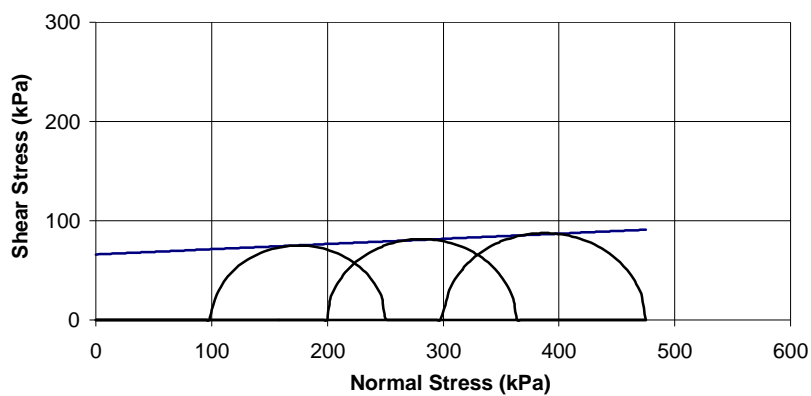

BH No.: BH-2  
Depth: 12.00 m

**Test Type: UU**


$c : 66 \text{ kPa}$   
 $\phi : 3.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/7

**Mohr-Diagram**

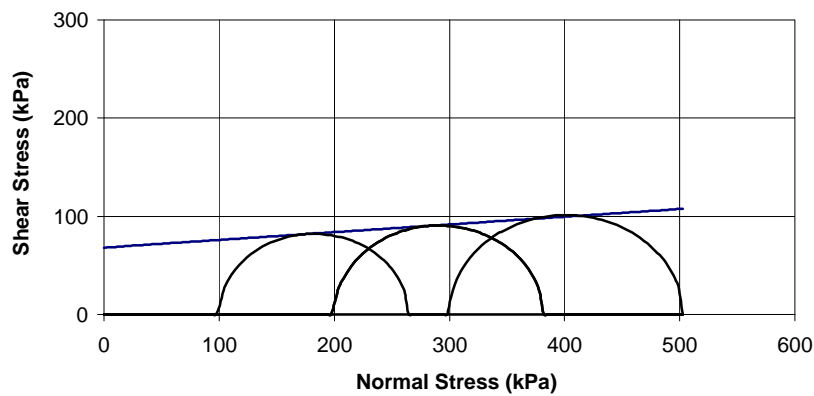


BH No.: BH-2  
Depth: 15.00 m

**Test Type: UU**

$c : 68 \text{ kPa}$   
 $\phi : 4.5^\circ$

**Direct Shear Test**

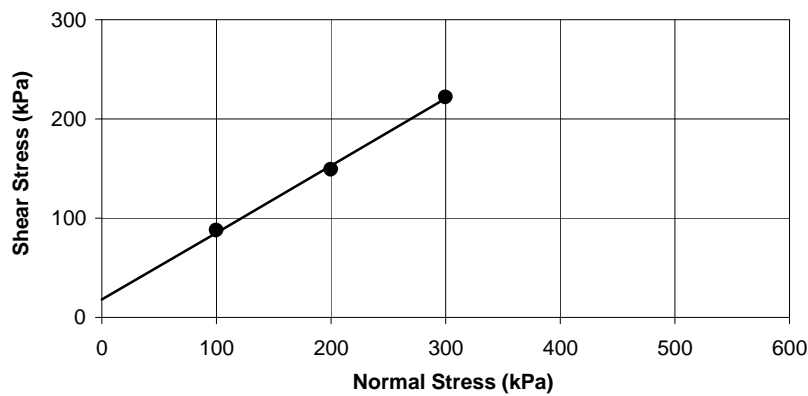


BH No.: BH-2  
Depth: 18.50 m

**Test Type: DS<sub>R</sub>**

$c : 18 \text{ kPa}$   
 $\phi : 34.0^\circ$

**Direct Shear Test**

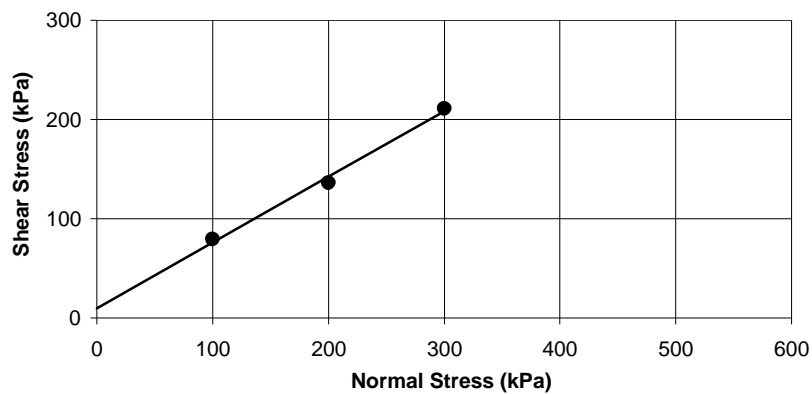

BH No.: BH-2  
Depth: 24.50 m

**Test Type: DS<sub>R</sub>**


$c : 10 \text{ kPa}$   
 $\phi : 33.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/8

**Mohr-Diagram**

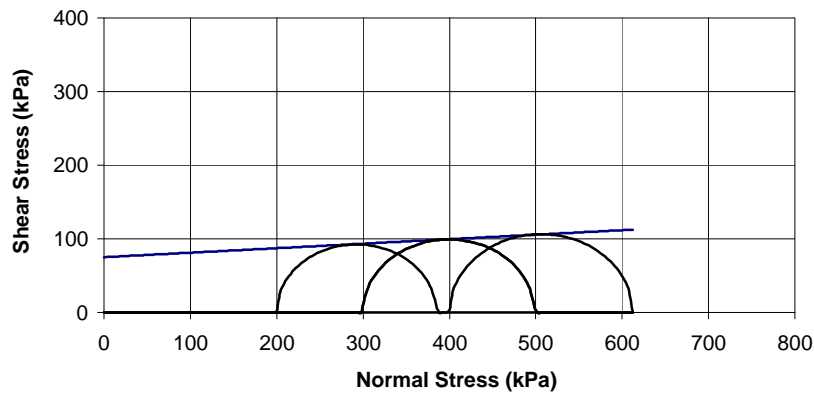


BH No.: BH-2  
Depth: 25.50 m

**Test Type: UU**

$c : 75 \text{ kPa}$   
 $\phi : 3.5^\circ$

**Mohr-Diagram**

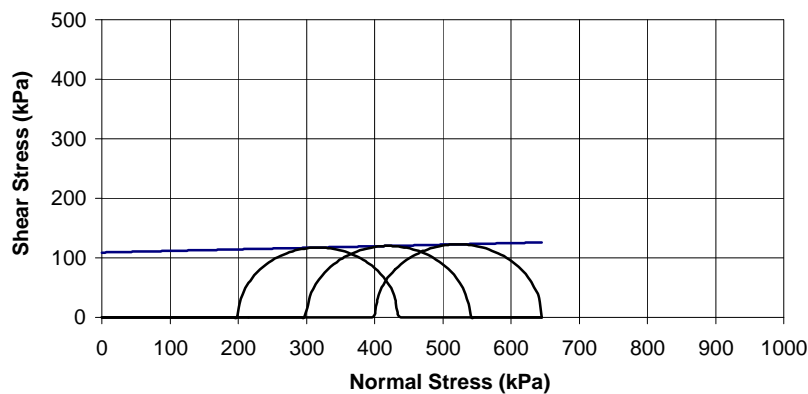


BH No.: BH-2  
Depth: 27.00 m

**Test Type: UU**

$c : 109 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

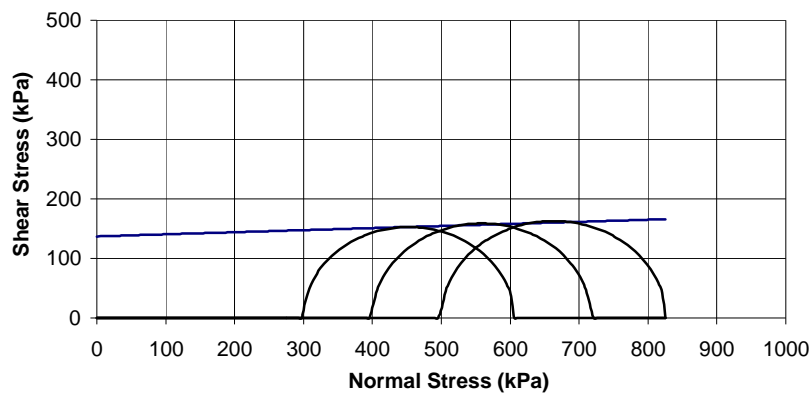

BH No.: BH-2  
Depth: 30.00 m

**Test Type: UU**


$c : 137 \text{ kPa}$   
 $\phi : 2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/9

### Direct Shear Test

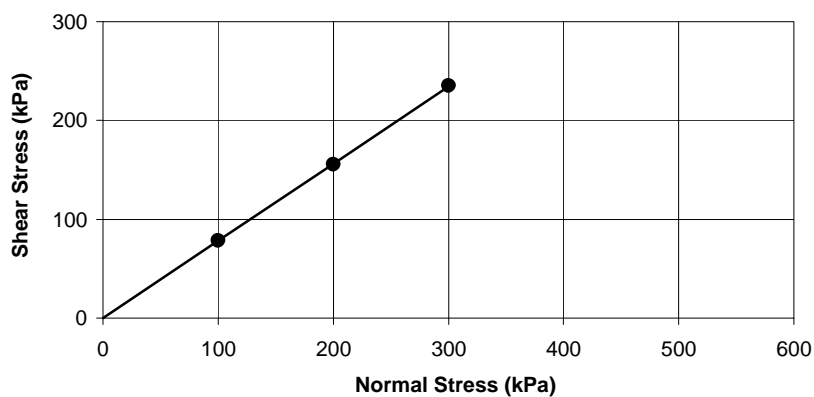


BH No.: BH-2  
Depth: 38.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  : 38.0°

### Direct Shear Test

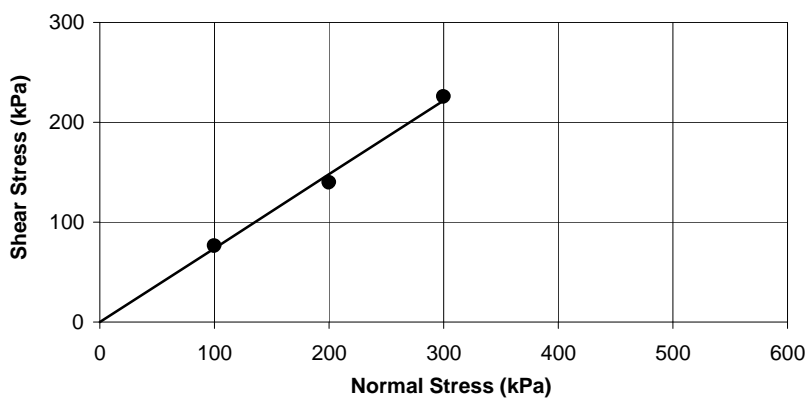


BH No.: BH-2  
Depth: 41.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  : 36.5°

### Direct Shear Test

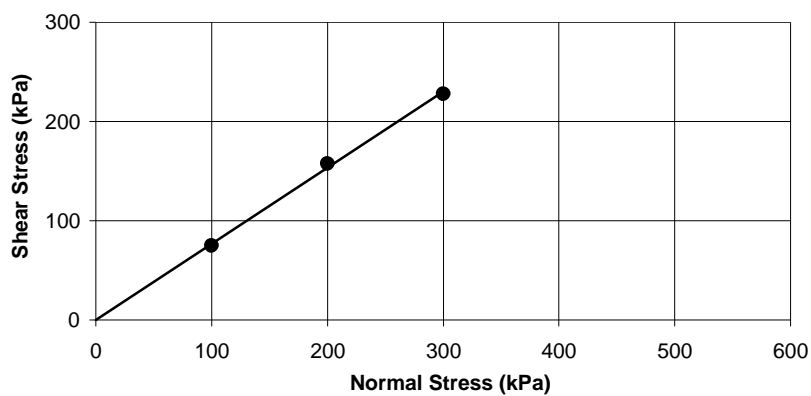

BH No.: BH-2  
Depth: 44.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  : 37.5°


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/10



### Direct Shear Test

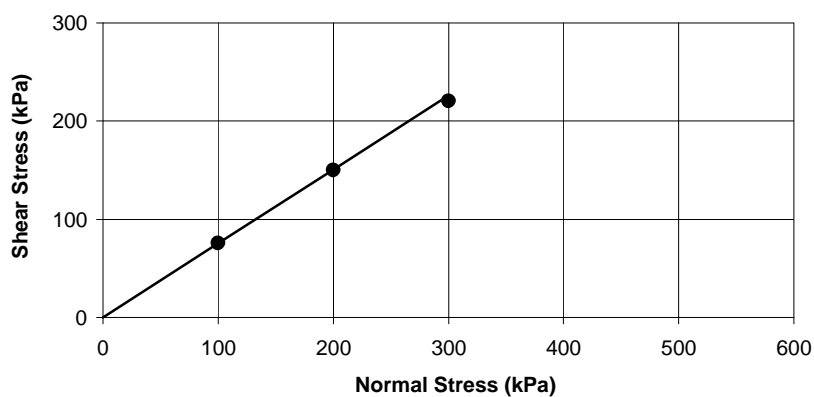


BH No.: BH-2  
Depth: 48.50 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.0^\circ$

### Mohr-Diagram

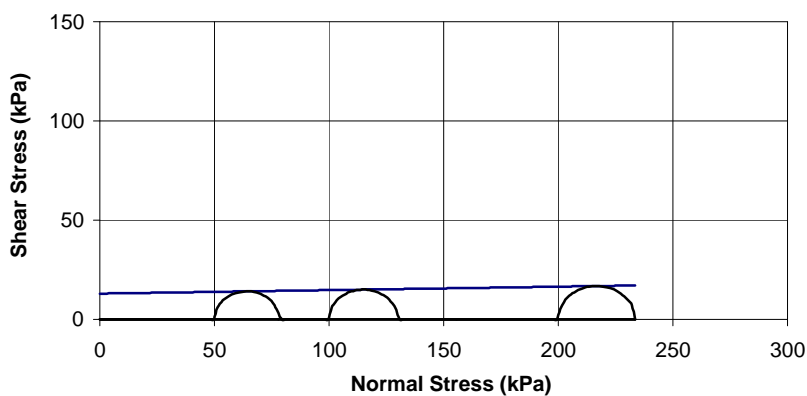


BH No.: BH-3  
Depth: 1.00 m

Test Type: UU

$c$  : 13 kPa  
 $\phi$  :  $1.0^\circ$

### Mohr-Diagram

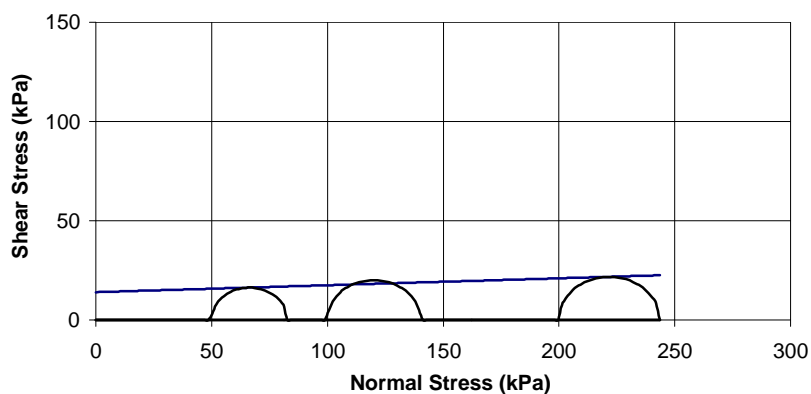

BH No.: BH-3  
Depth: 2.50 m

Test Type: UU


$c$  : 14 kPa  
 $\phi$  :  $2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/11

**Mohr-Diagram**

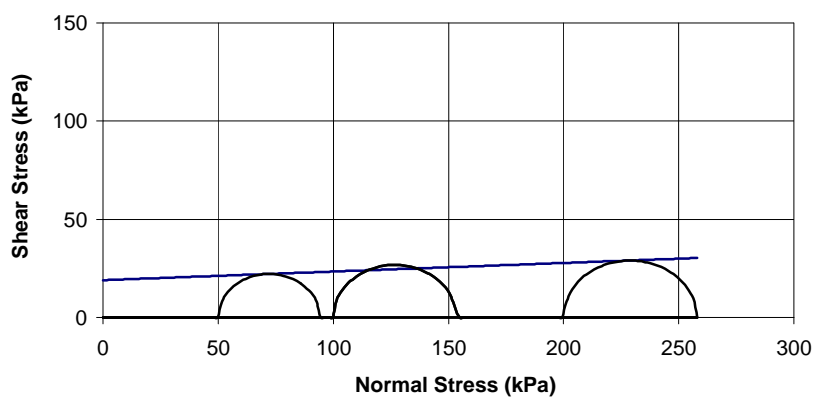


BH No.: BH-3  
Depth: 4.00 m

**Test Type: UU**

$c$  : 19 kPa  
 $\phi$  : 2.5°

**Mohr-Diagram**

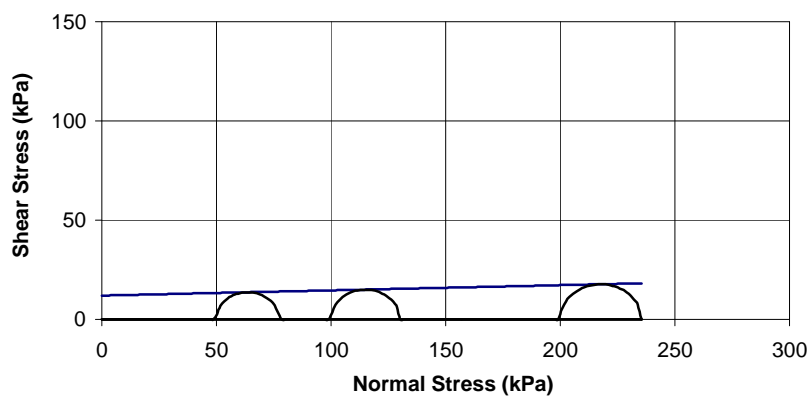


BH No.: BH-3  
Depth: 5.50 m

**Test Type: UU**

$c$  : 12 kPa  
 $\phi$  : 1.5°

**Mohr-Diagram**

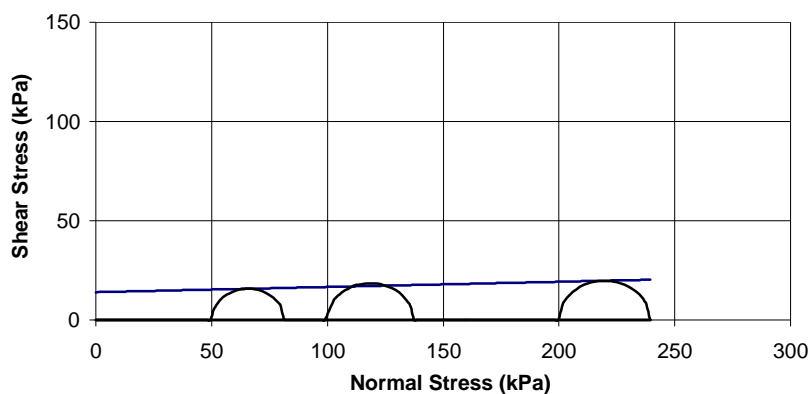

BH No.: BH-3  
Depth: 7.00 m

**Test Type: UU**


$c$  : 14 kPa  
 $\phi$  : 1.5°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/12

**Mohr-Diagram**

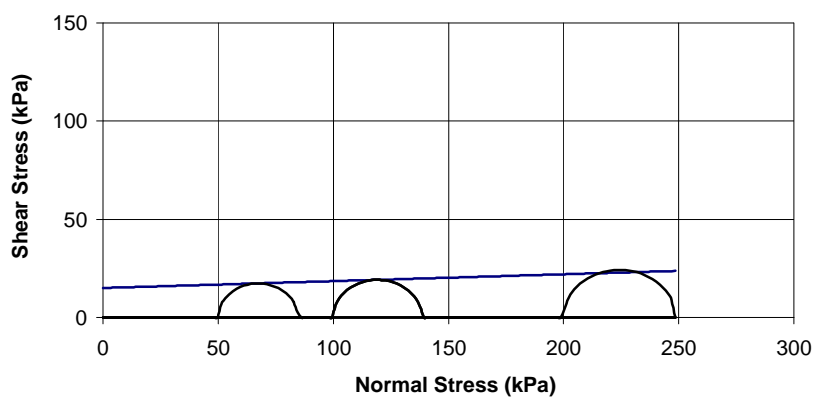


BH No.: BH-3  
Depth: 8.50 m

**Test Type: UU**

$c : 15 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

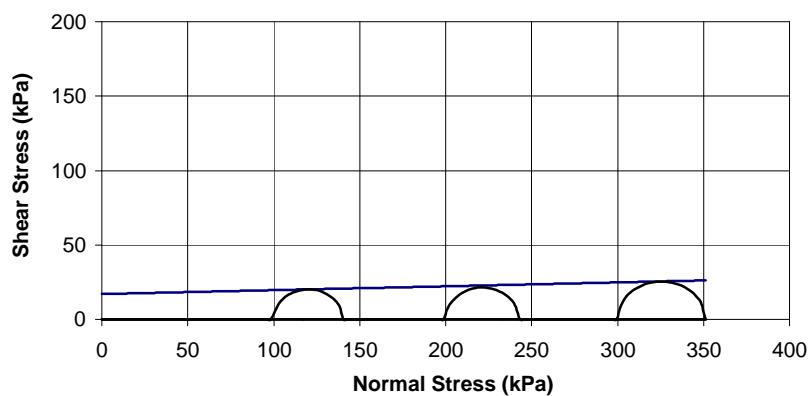


BH No.: BH-3  
Depth: 10.00 m

**Test Type: UU**

$c : 17 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

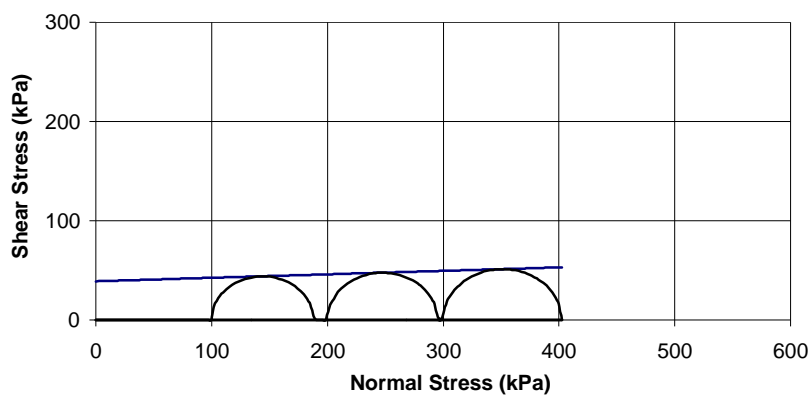

BH No.: BH-3  
Depth: 13.00 m

**Test Type: UU**


$c : 39 \text{ kPa}$   
 $\phi : 2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/13

**Mohr-Diagram**

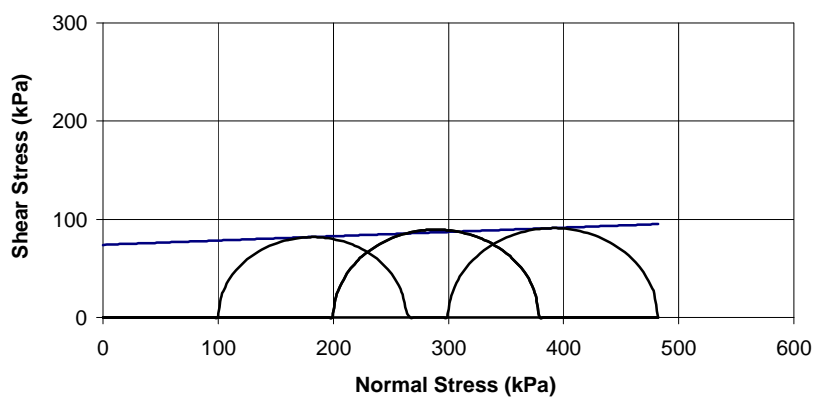


BH No.: BH-3  
Depth: 16.00 m

**Test Type: UU**

$c : 74 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Direct Shear Test**

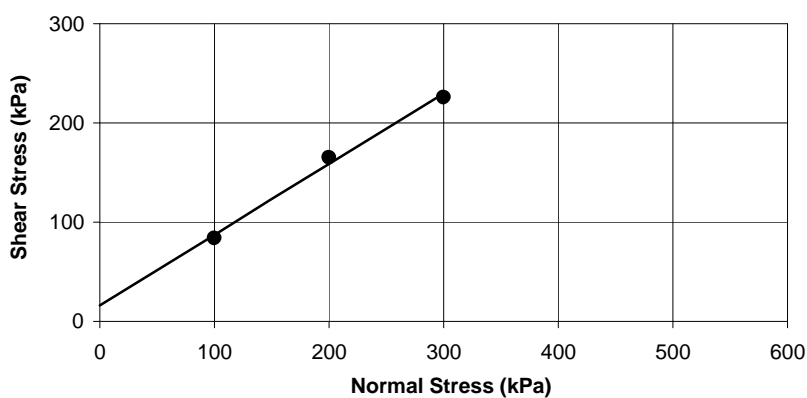


BH No.: BH-3  
Depth: 22.50 m

**Test Type: DS<sub>R</sub>**

$c : 16 \text{ kPa}$   
 $\phi : 35.5^\circ$

**Mohr-Diagram**

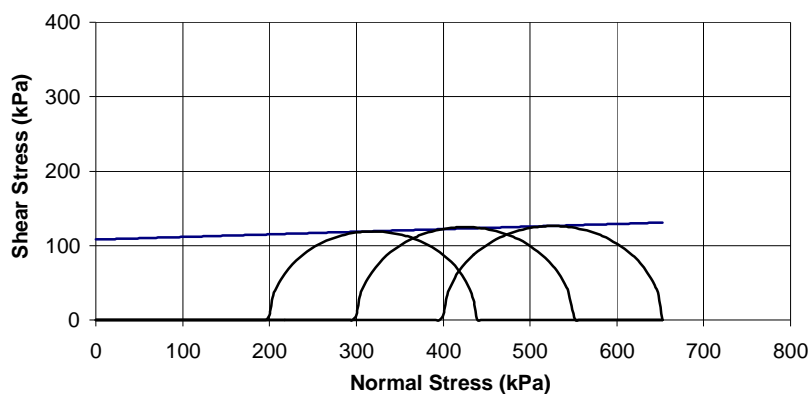

BH No.: BH-3  
Depth: 25.00 m

**Test Type: UU**


$c : 108 \text{ kPa}$   
 $\phi : 2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/14

**Mohr-Diagram**

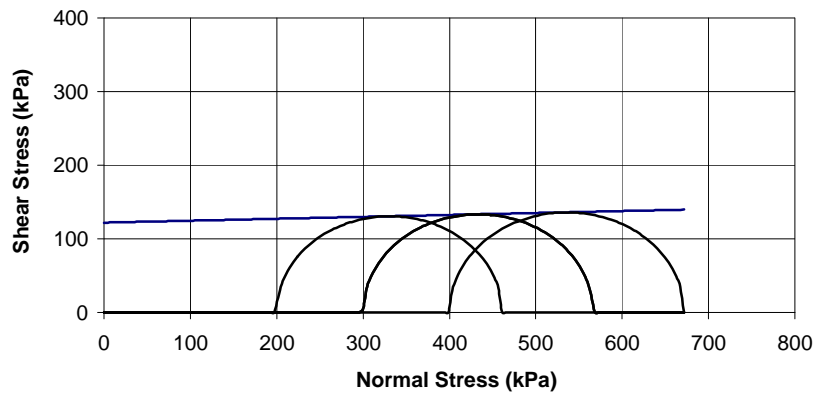


BH No.: BH-3  
Depth: 28.00 m

**Test Type: UU**

$c : 122 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Direct Shear Test**

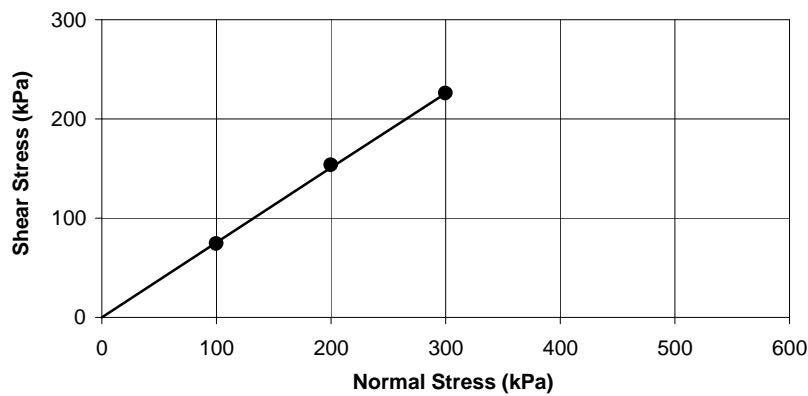


BH No.: BH-3  
Depth: 37.50 m

**Test Type: DS<sub>R</sub>**

$c : 0 \text{ kPa}$   
 $\phi : 37.0^\circ$

**Direct Shear Test**

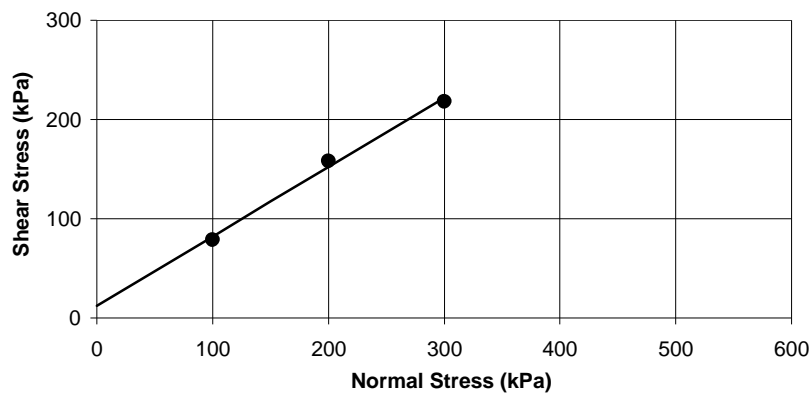

BH No.: BH-3  
Depth: 40.50 m

**Test Type: DS<sub>R</sub>**


$c : 12 \text{ kPa}$   
 $\phi : 35.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/15

### Direct Shear Test

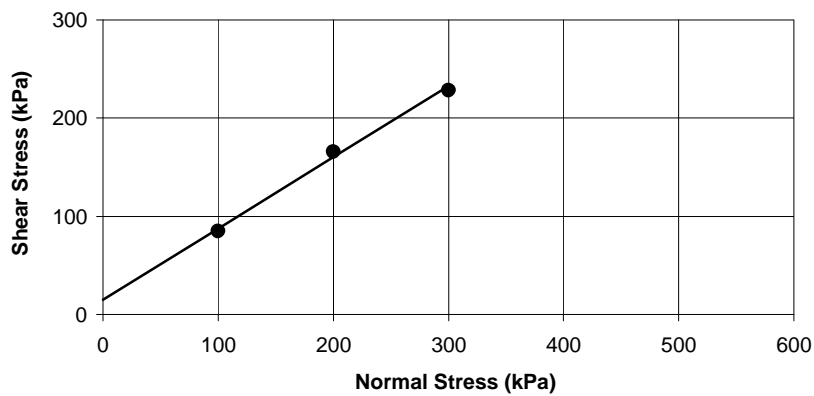


BH No.: BH-3  
Depth: 45.00 m

Test Type:  $DS_R$

$c$  : 15 kPa  
 $\phi$  :  $36.0^\circ$

### Direct Shear Test

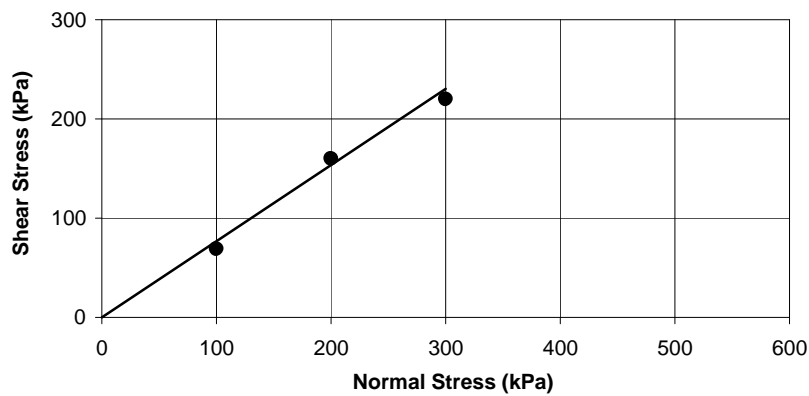


BH No.: BH-3  
Depth: 48.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.5^\circ$

### Mohr-Diagram

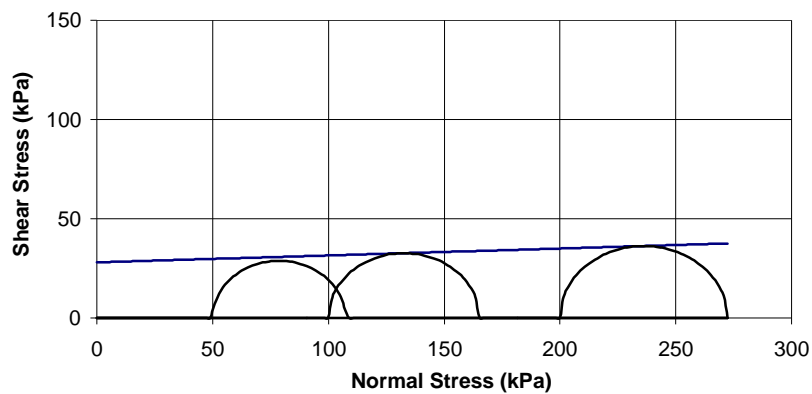

BH No.: BH-4  
Depth: 0.50 m

Test Type:  $UU$


$c$  : 28 kPa  
 $\phi$  :  $2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/16

**Mohr-Diagram**

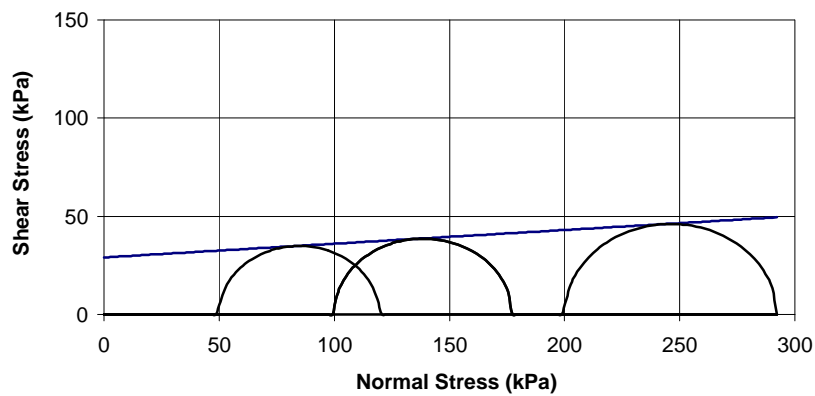


BH No.: BH-4  
Depth: 2.00 m

**Test Type: UU**

$c : 29 \text{ kPa}$   
 $\phi : 4.0^\circ$

**Mohr-Diagram**

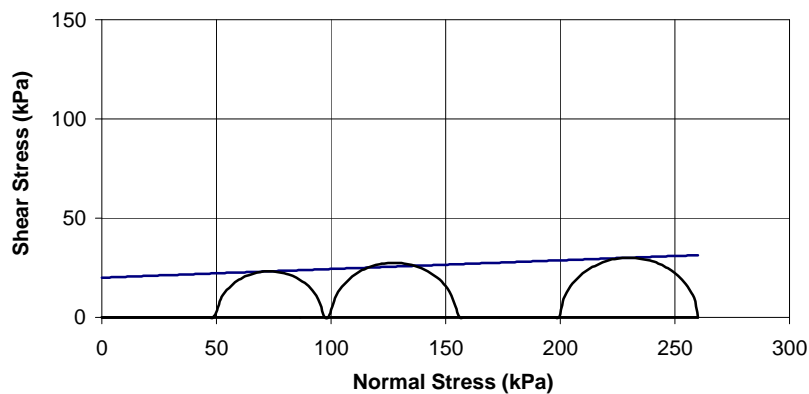


BH No.: BH-4  
Depth: 3.50 m

**Test Type: UU**

$c : 20 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

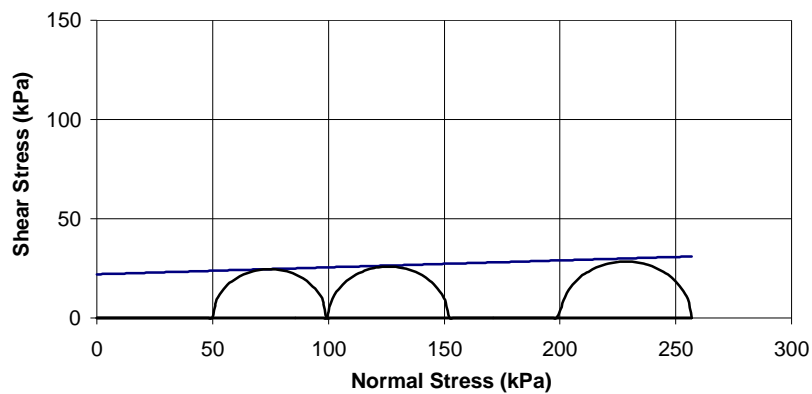

BH No.: BH-4  
Depth: 5.00 m

**Test Type: UU**


$c : 22 \text{ kPa}$   
 $\phi : 2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/17

**Mohr-Diagram**

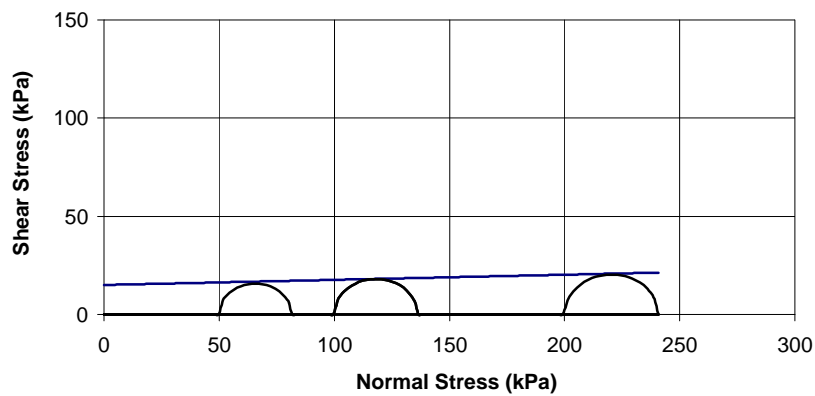


BH No.: BH-4  
Depth: 6.50 m

**Test Type: UU**

$c : 15 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

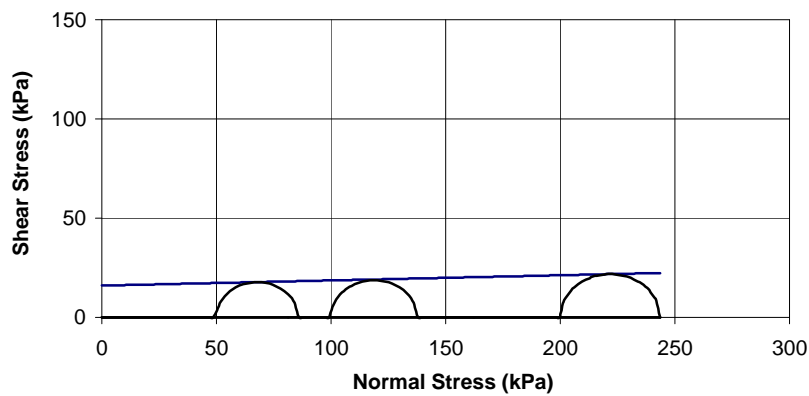


BH No.: BH-4  
Depth: 8.00 m

**Test Type: UU**

$c : 16 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

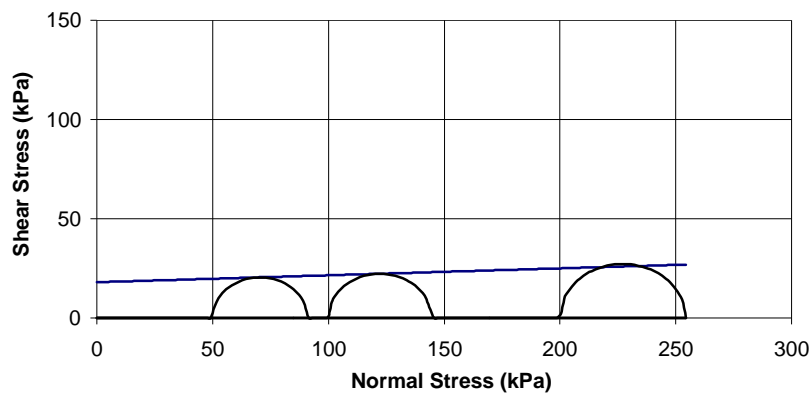

BH No.: BH-4  
Depth: 9.50 m

**Test Type: UU**

$c : 18 \text{ kPa}$   
 $\phi : 2.0^\circ$


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/18



**Mohr-Diagram**

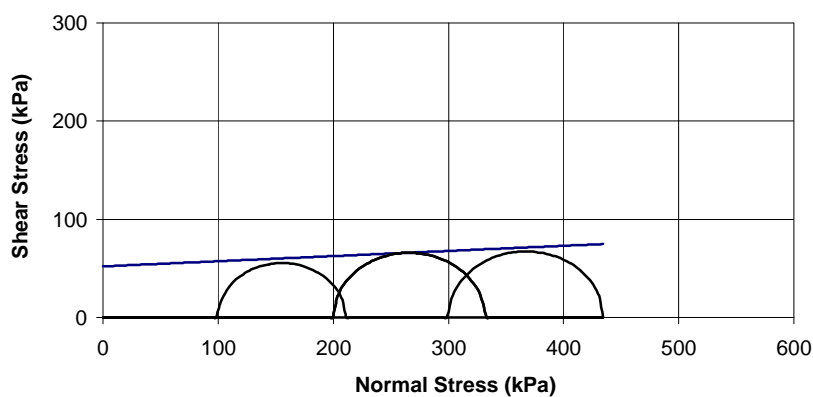


BH No.: BH-4  
Depth: 11.00 m

**Test Type: UU**

c : 52 kPa  
 $\phi$  : 3.0°

**Mohr-Diagram**

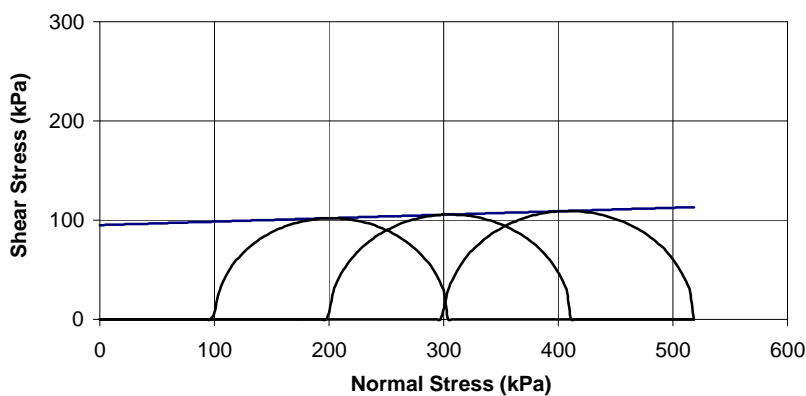


BH No.: BH-4  
Depth: 14.00 m

**Test Type: UU**

c : 95 kPa  
 $\phi$  : 2.0°

**Mohr-Diagram**

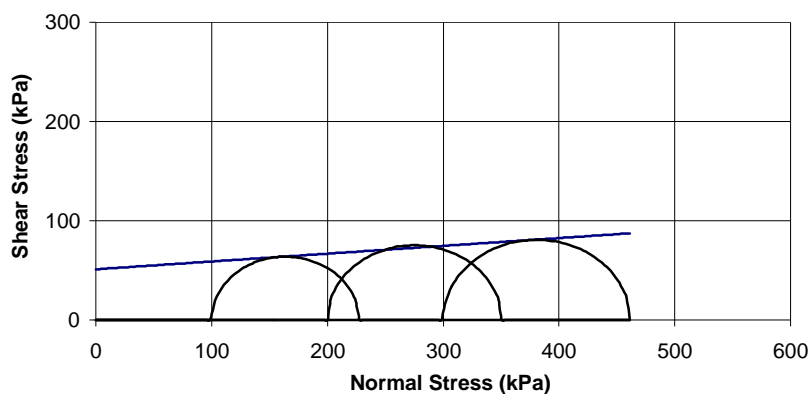

BH No.: BH-4  
Depth: 17.00 m

**Test Type: UU**


c : 51 kPa  
 $\phi$  : 4.5°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/19

### Direct Shear Test

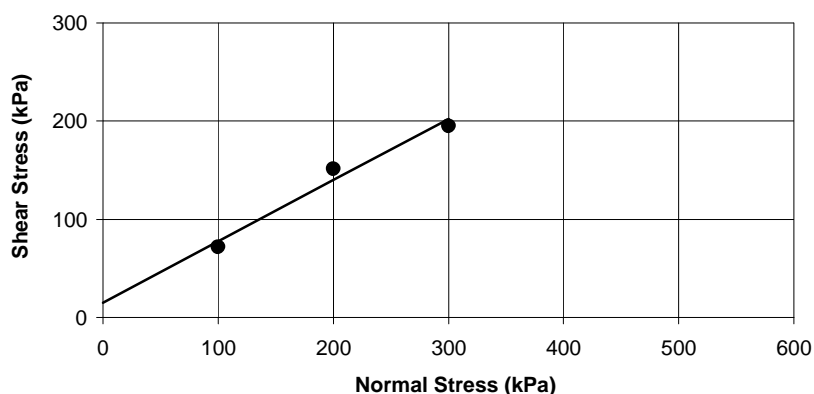


BH No.: BH-4  
Depth: 17.50 m

Test Type:  $DS_R$

$c$  : 15 kPa  
 $\phi$  :  $32.0^\circ$

### Direct Shear Test

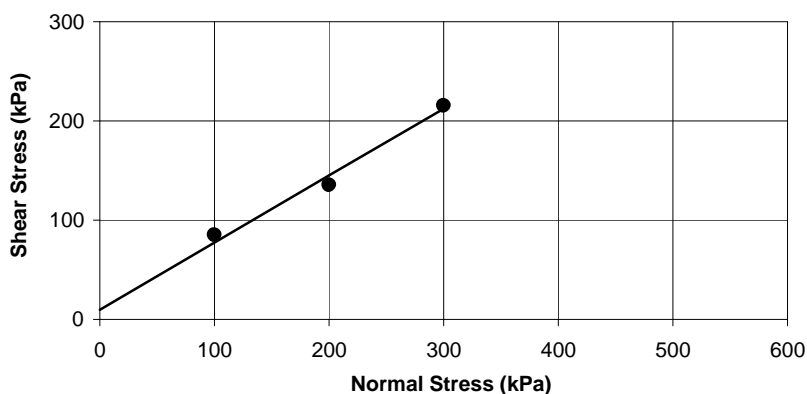


BH No.: BH-4  
Depth: 20.50 m

Test Type:  $DS_R$

$c$  : 10 kPa  
 $\phi$  :  $34.0^\circ$

### Direct Shear Test

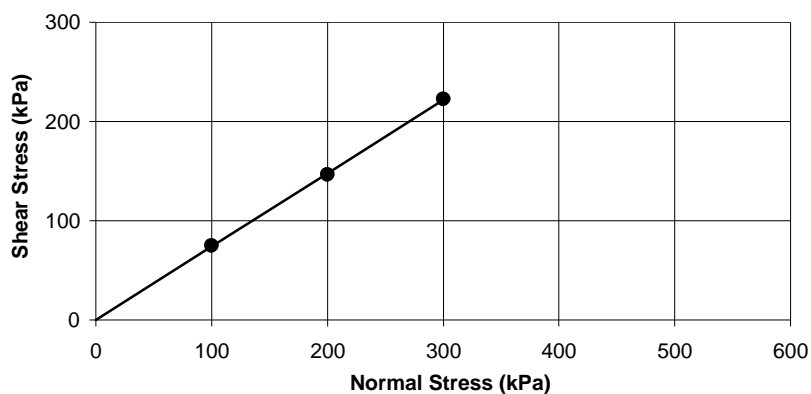

BH No.: BH-4  
Depth: 23.50 m

Test Type:  $DS_R$


$c$  : 0 kPa  
 $\phi$  :  $36.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/20

**Mohr-Diagram**

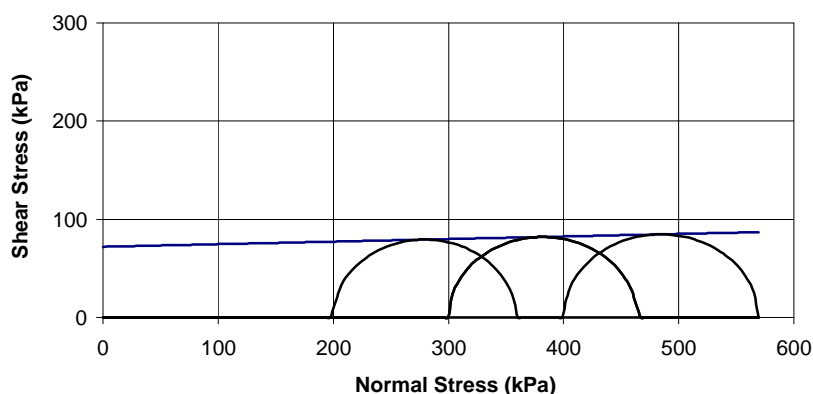


BH No.: BH-4  
Depth: 26.00 m

**Test Type: UU**

$c : 72 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Direct Shear Test**

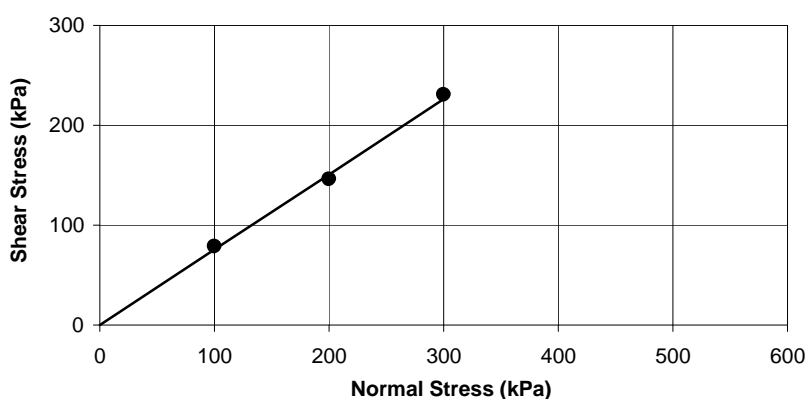


BH No.: BH-4  
Depth: 37.00 m

**Test Type: DS<sub>R</sub>**

$c : 0 \text{ kPa}$   
 $\phi : 37.0^\circ$

**Direct Shear Test**

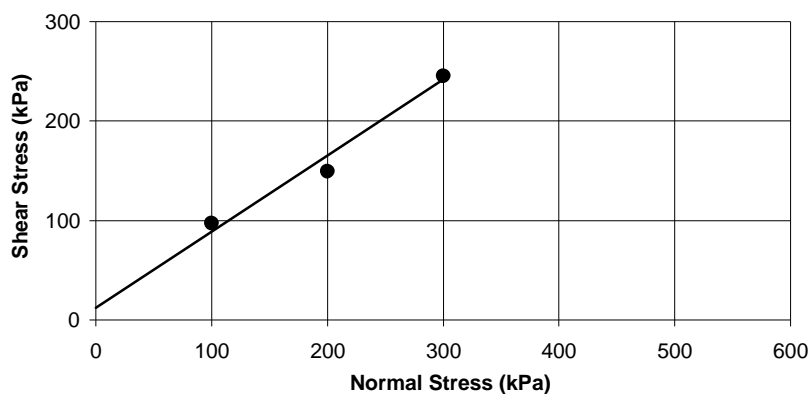

BH No.: BH-4  
Depth: 40.00 m

**Test Type: DS<sub>R</sub>**


$c : 12 \text{ kPa}$   
 $\phi : 37.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/21

### Direct Shear Test

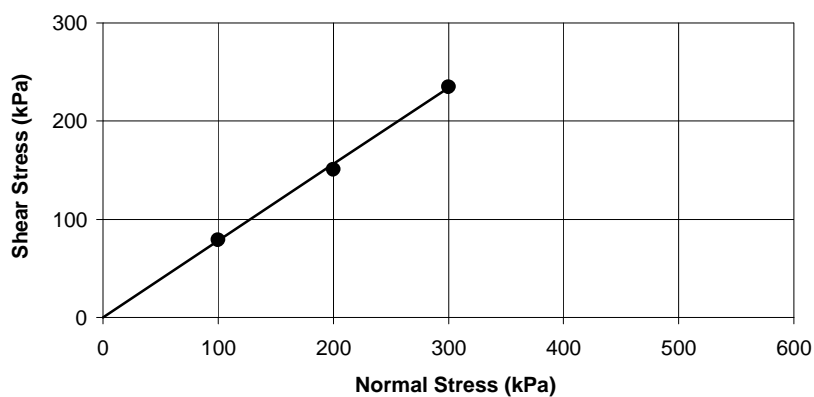


BH No.: BH-4  
Depth: 43.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $38.0^\circ$

### Direct Shear Test

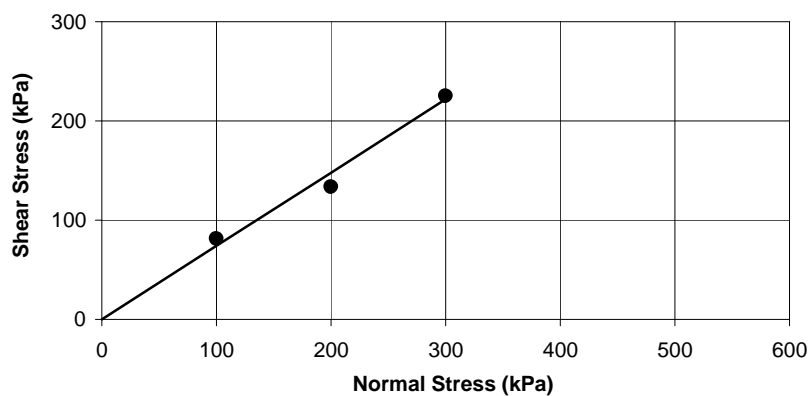


BH No.: BH-4  
Depth: 48.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $36.5^\circ$

### Mohr-Diagram

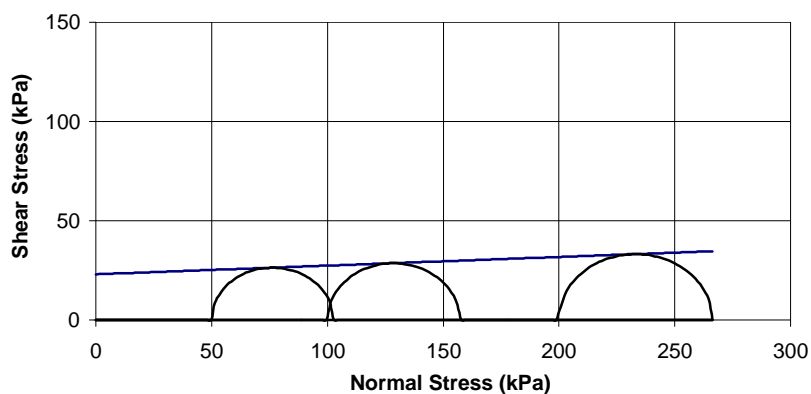

BH No.: BH-5  
Depth: 1.00 m

Test Type:  $UU$


$c$  : 23 kPa  
 $\phi$  :  $2.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/22

### Direct Shear Test

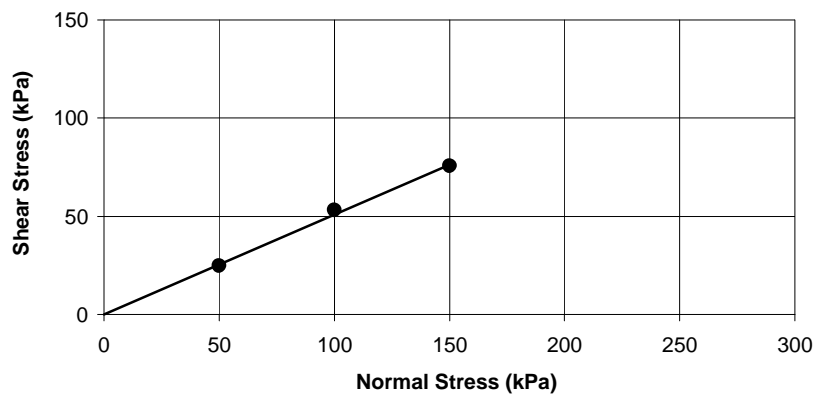


BH No.: BH-5  
Depth: 2.50 m

Test Type: DS

c : 0 kPa  
 $\phi$  : 27.0°

### Mohr-Diagram

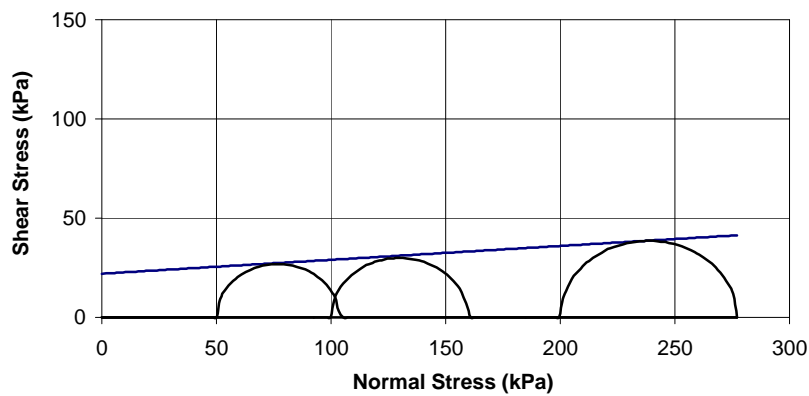


BH No.: BH-5  
Depth: 4.00 m

Test Type: UU

c : 22 kPa  
 $\phi$  : 4.0°

### Mohr-Diagram

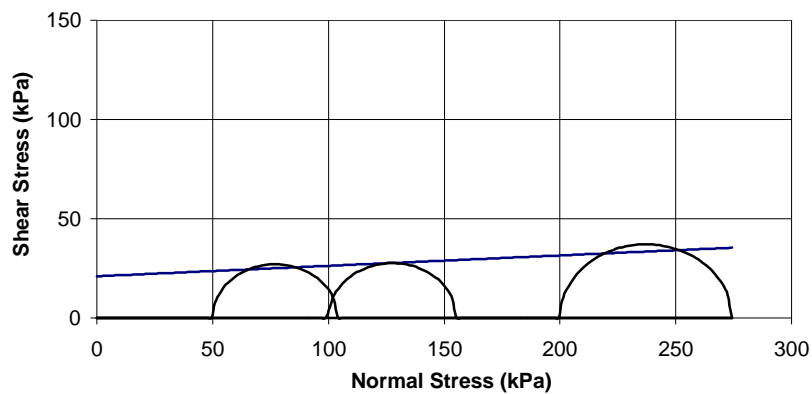

BH No.: BH-5  
Depth: 5.50 m

Test Type: UU


c : 21 kPa  
 $\phi$  : 3.0°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/23

**Mohr-Diagram**

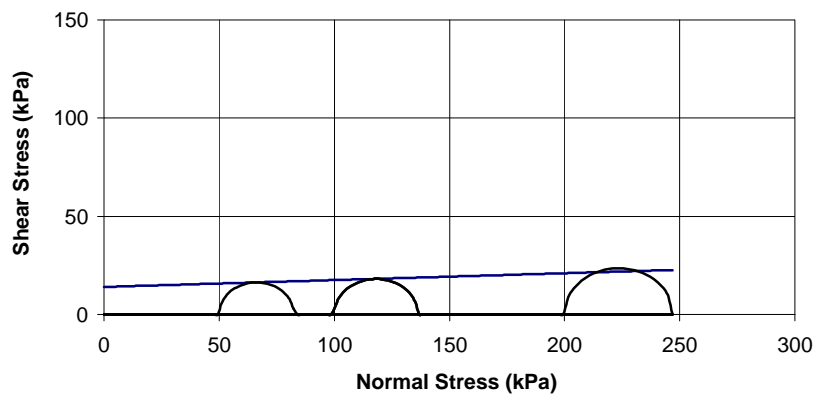


BH No.: BH-5  
Depth: 7.00 m

**Test Type: UU**

$c : 14 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

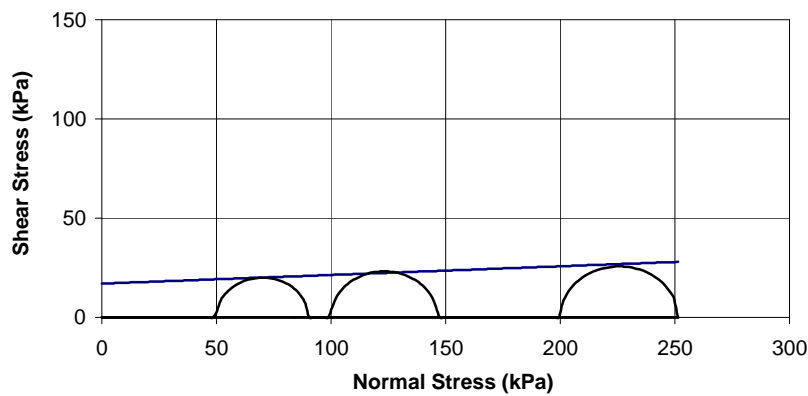


BH No.: BH-5  
Depth: 8.50 m

**Test Type: UU**

$c : 17 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

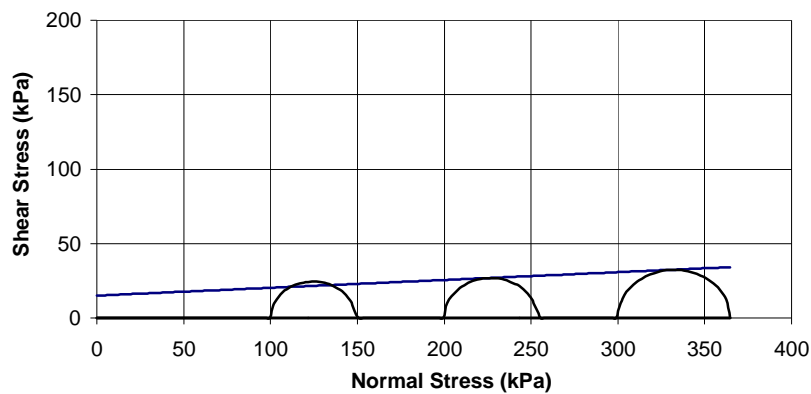

BH No.: BH-5  
Depth: 10.00 m

**Test Type: UU**


$c : 15 \text{ kPa}$   
 $\phi : 3.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/24

**Mohr-Diagram**

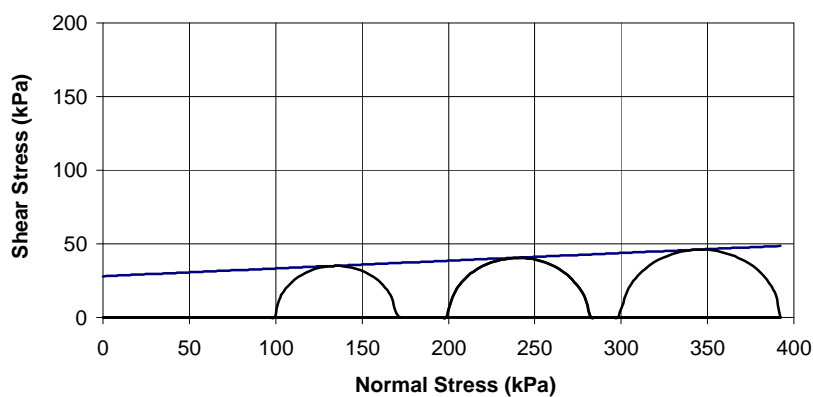


BH No.: BH-5  
Depth: 13.00 m

**Test Type: UU**

$c : 28 \text{ kPa}$   
 $\phi : 3.0^\circ$

**Mohr-Diagram**

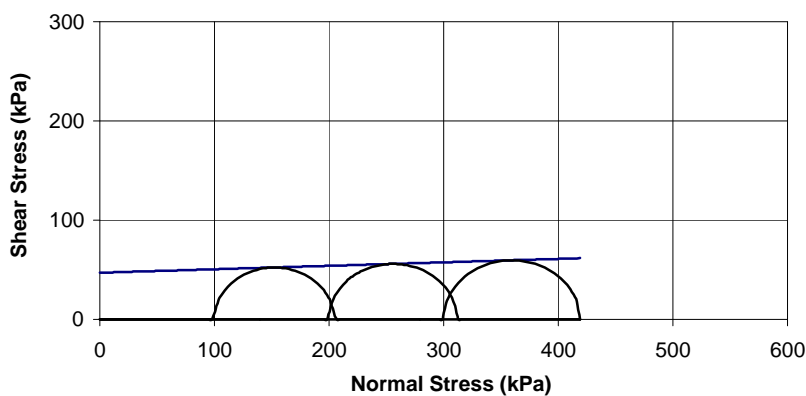


BH No.: BH-5  
Depth: 16.00 m

**Test Type: UU**

$c : 47 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Direct Shear Test**

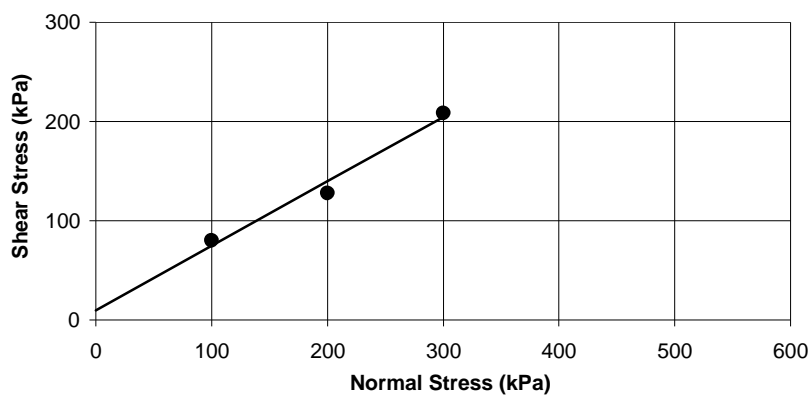

BH No.: BH-5  
Depth: 24.00 m

**Test Type: DS<sub>R</sub>**


$c : 10 \text{ kPa}$   
 $\phi : 33.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/25

### Direct Shear Test

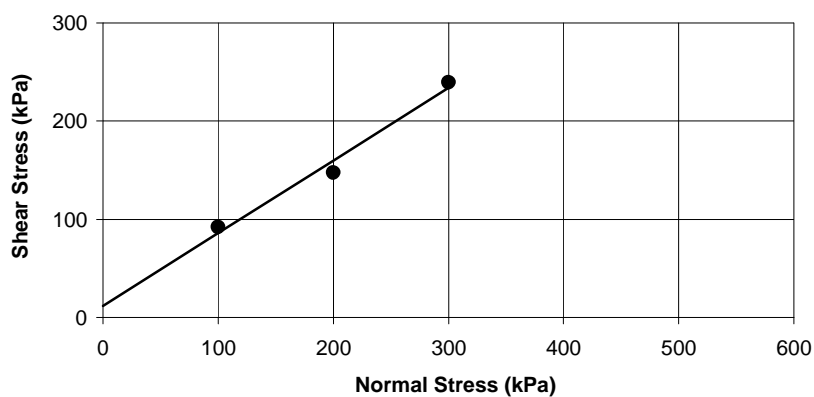


BH No.: BH-5  
Depth: 27.00 m

Test Type:  $DS_R$

$c$  : 12 kPa  
 $\phi$  :  $36.5^\circ$

### Mohr-Diagram

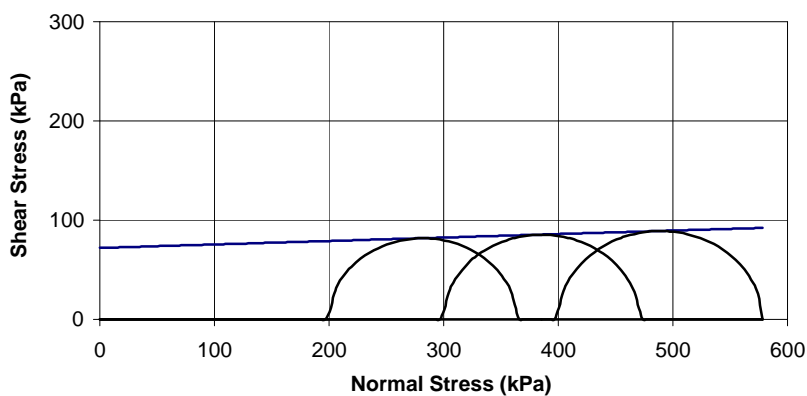


BH No.: BH-5  
Depth: 29.50 m

Test Type:  $UU$

$c$  : 72 kPa  
 $\phi$  :  $2.0^\circ$

### Mohr-Diagram

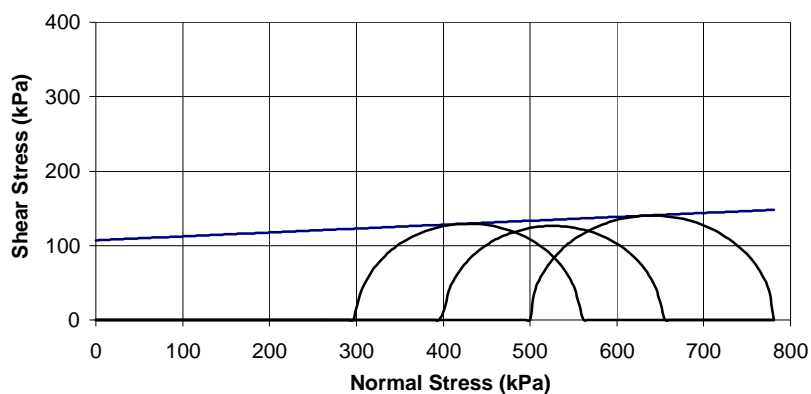

BH No.: BH-5  
Depth: 32.50 m

Test Type:  $UU$

$c$  : 107 kPa  
 $\phi$  :  $3.0^\circ$


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/26



### Direct Shear Test

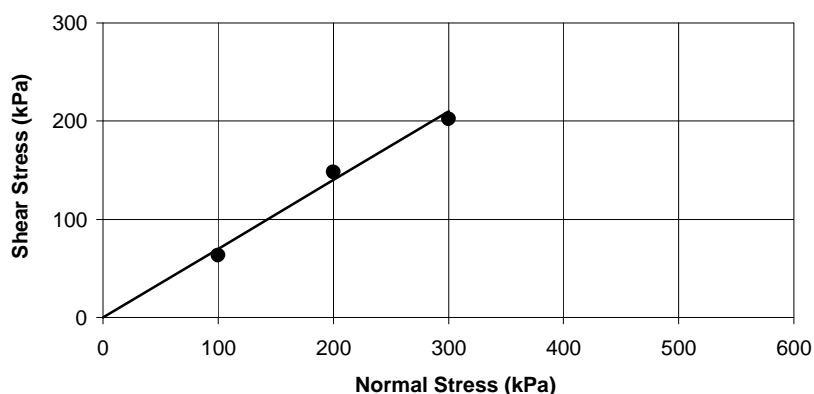


BH No.: BH-5  
Depth: 40.50 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $35.0^\circ$

### Direct Shear Test

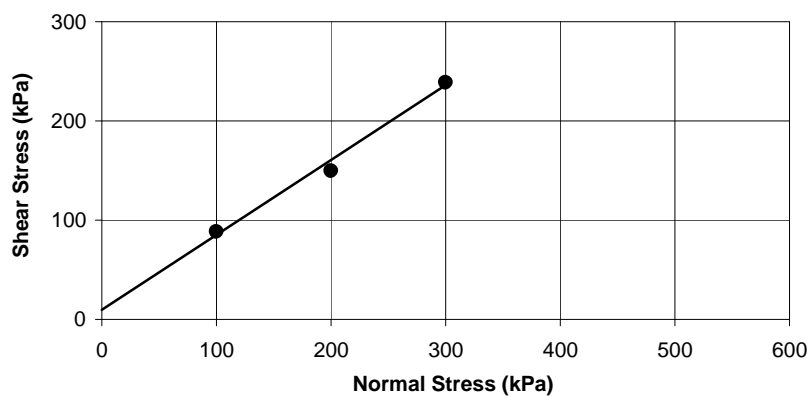


BH No.: BH-5  
Depth: 42.00 m

Test Type:  $DS_R$

$c$  : 10 kPa  
 $\phi$  :  $37.0^\circ$

### Direct Shear Test

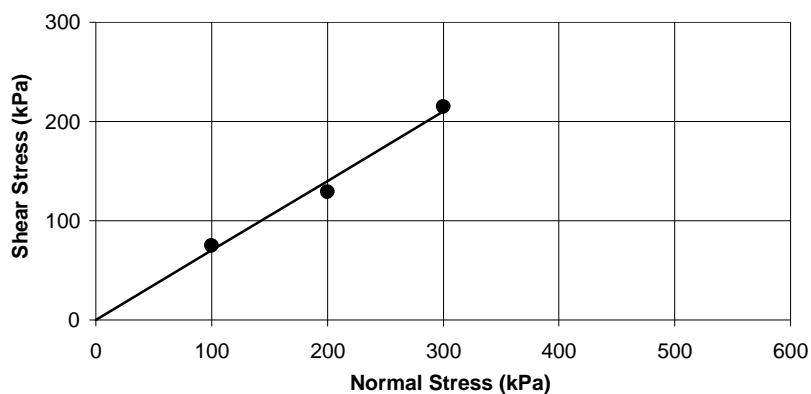

BH No.: BH-5  
Depth: 48.00 m

Test Type:  $DS_R$


$c$  : 0 kPa  
 $\phi$  :  $35.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/27

### Direct Shear Test

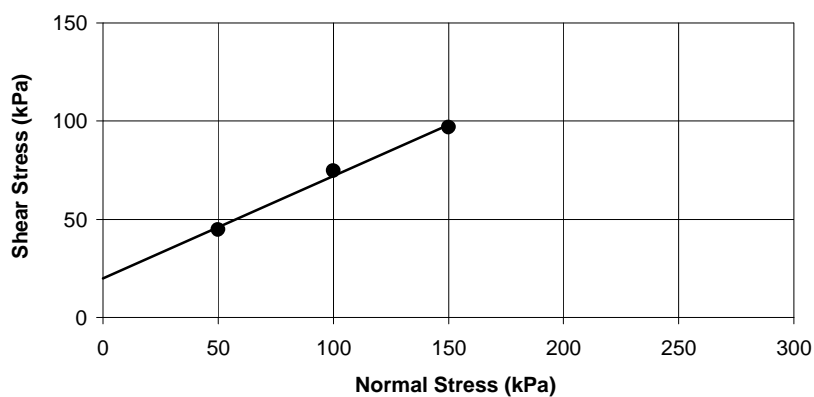


BH No.: BH-6  
Depth: 3.00 m

Test Type: DS

c : 20 kPa  
 $\phi$  : 27.5°

### Mohr-Diagram

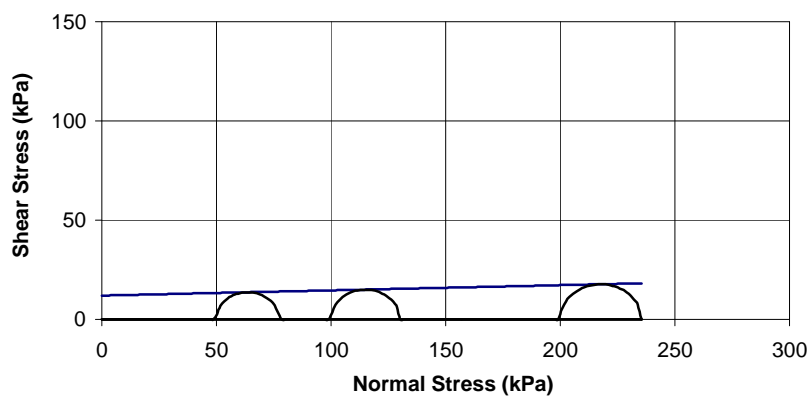


BH No.: BH-6  
Depth: 4.50 m

Test Type: UU

c : 12 kPa  
 $\phi$  : 1.5°

### Mohr-Diagram

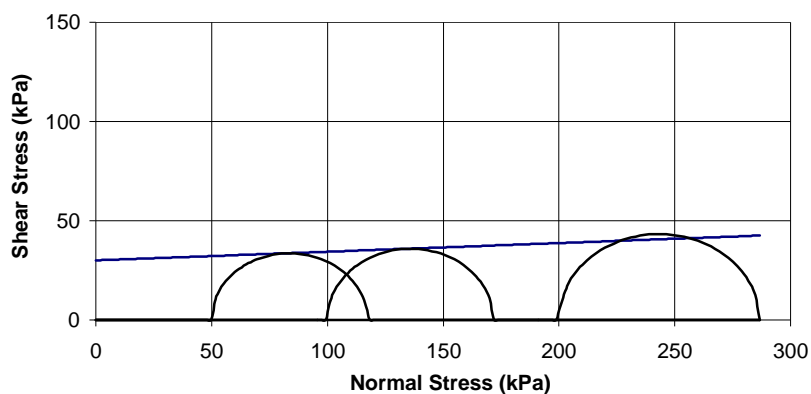

BH No.: BH-6  
Depth: 6.00 m

Test Type: UU


c : 30 kPa  
 $\phi$  : 2.5°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/28

**Mohr-Diagram**

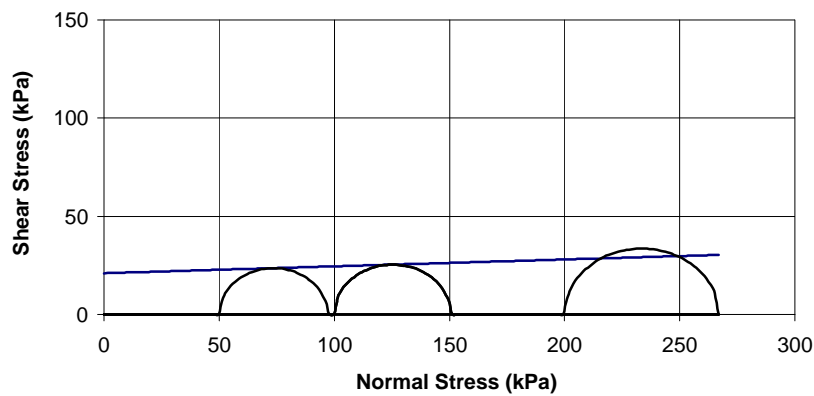


BH No.: BH-6  
Depth: 7.50 m

**Test Type: UU**

$c : 21 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

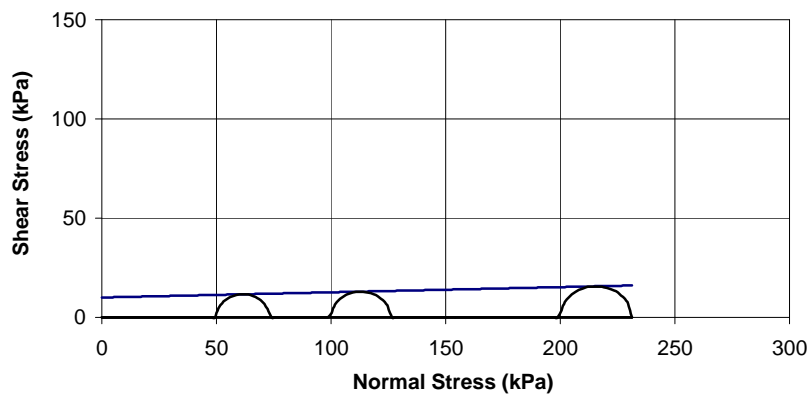


BH No.: BH-6  
Depth: 9.00 m

**Test Type: UU**

$c : 10 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

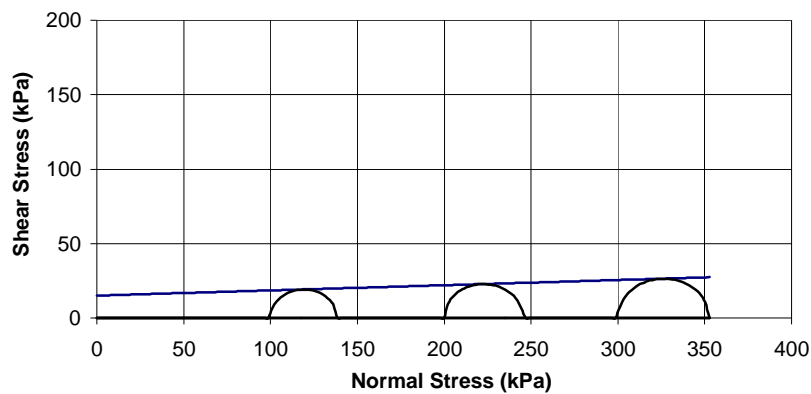

BH No.: BH-6  
Depth: 10.50 m

**Test Type: UU**


$c : 15 \text{ kPa}$   
 $\phi : 2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/29

**Mohr-Diagram**

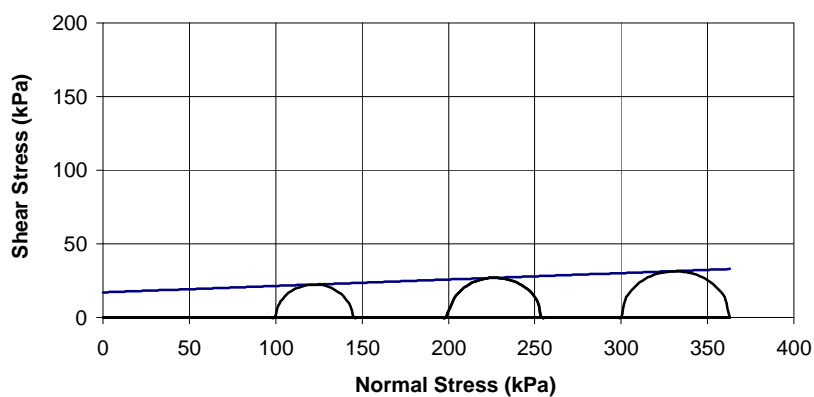


BH No.: BH-6  
Depth: 13.50 m

**Test Type: UU**

$c : 17 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

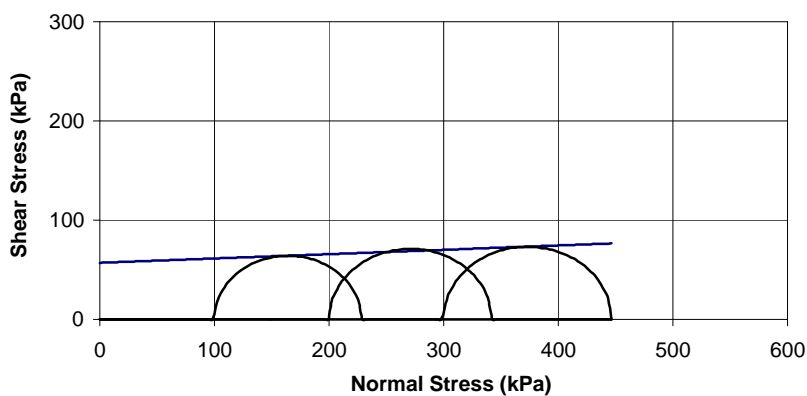


BH No.: BH-6  
Depth: 16.50 m

**Test Type: UU**

$c : 57 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Direct Shear Test**

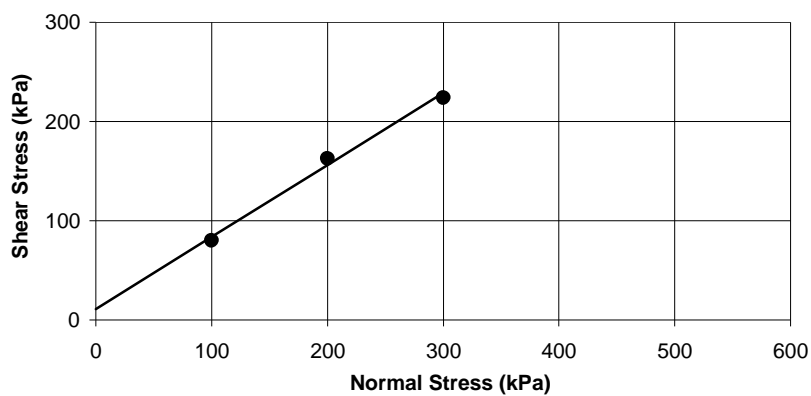

BH No.: BH-6  
Depth: 24.50 m

**Test Type: DS<sub>R</sub>**


$c : 11 \text{ kPa}$   
 $\phi : 36.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/30

**Mohr-Diagram**

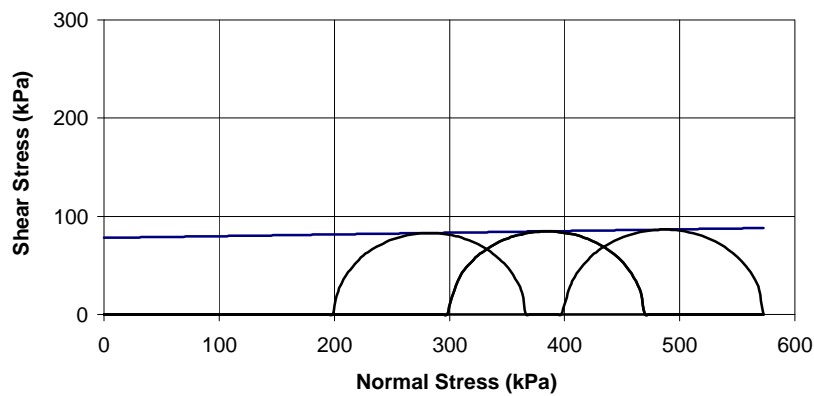


BH No.: BH-6  
Depth: 27.00 m

**Test Type: UU**

c : 78 kPa  
 $\phi$  : 1.0°

**Mohr-Diagram**

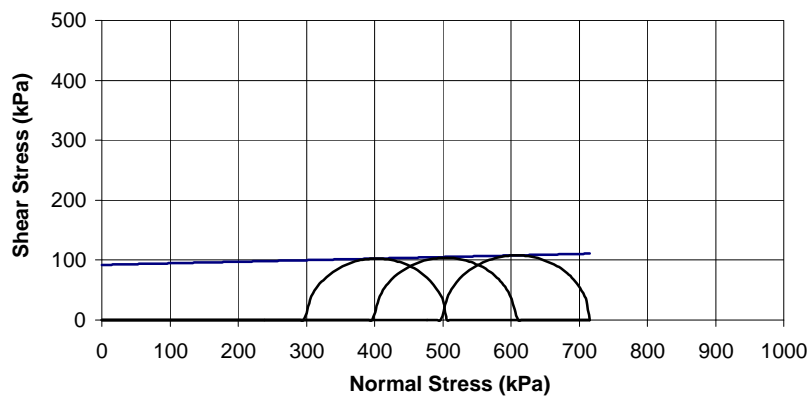


BH No.: BH-6  
Depth: 30.00 m

**Test Type: UU**

c : 92 kPa  
 $\phi$  : 1.5°

**Direct Shear Test**

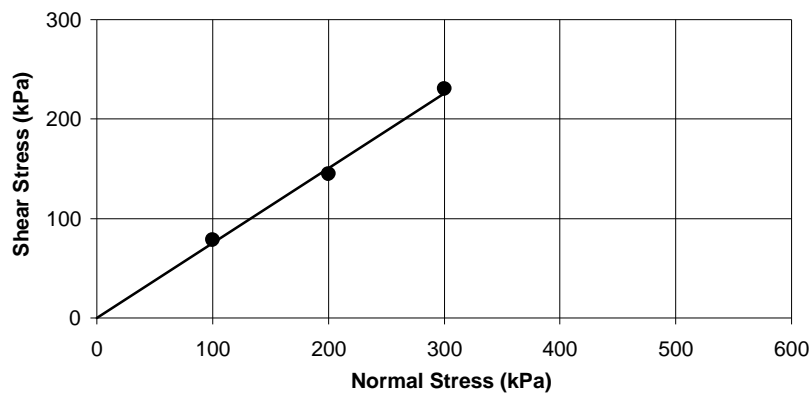

BH No.: BH-6  
Depth: 41.00 m

**Test Type: DS<sub>R</sub>**


c : 0 kPa  
 $\phi$  : 37.0°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/31

### Direct Shear Test

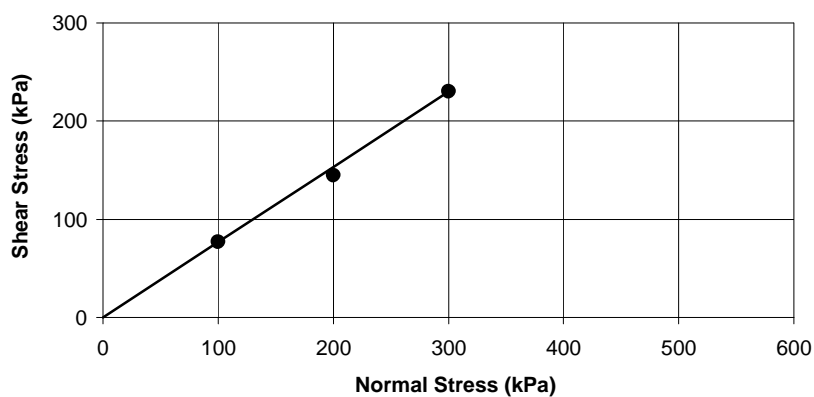


BH No.: BH-6  
Depth: 45.50 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.5^\circ$

### Direct Shear Test

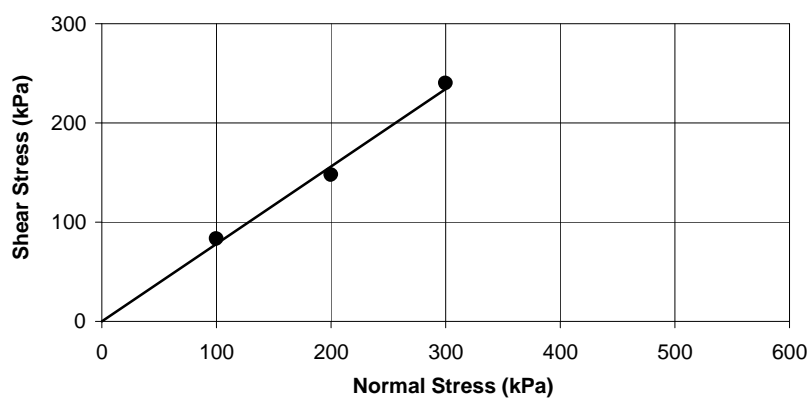


BH No.: BH-6  
Depth: 48.50 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $38.0^\circ$

### Mohr-Diagram

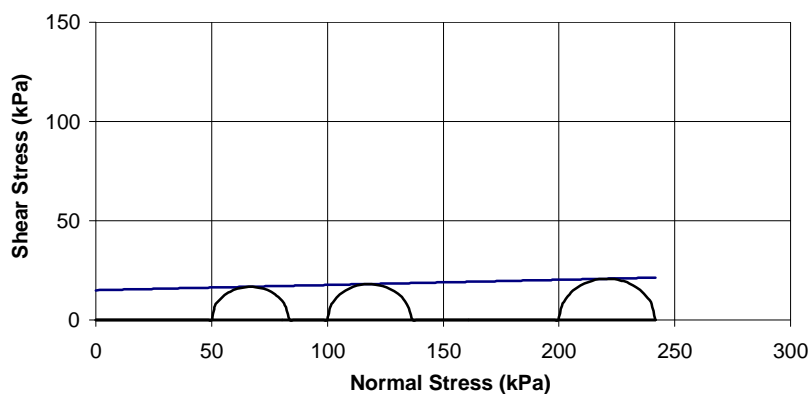

BH No.: BH-7  
Depth: 2.50 m

Test Type:  $UU$


$c$  : 15 kPa  
 $\phi$  :  $1.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/32

**Mohr-Diagram**

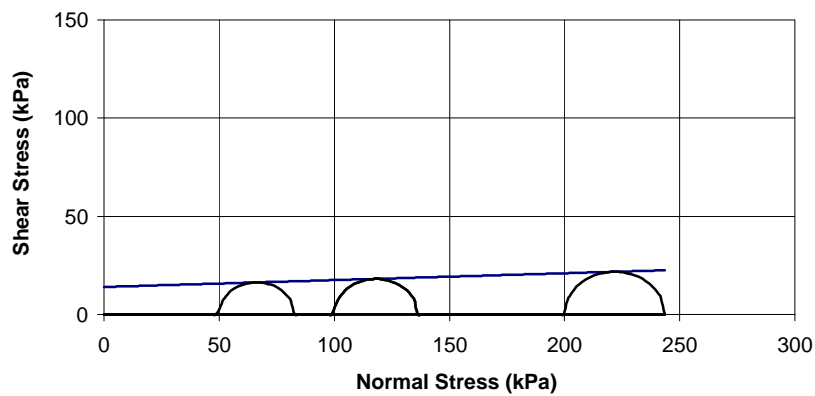


BH No.: BH-7  
Depth: 4.00 m

**Test Type: UU**

$c$  : 14 kPa  
 $\phi$  : 2.0°

**Mohr-Diagram**

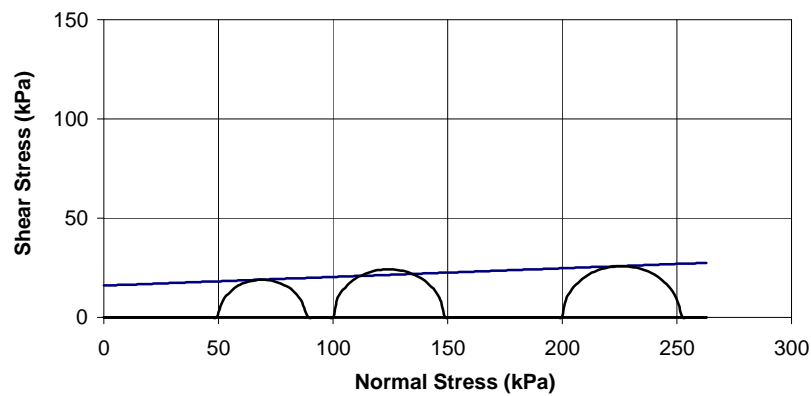


BH No.: BH-7  
Depth: 5.50 m

**Test Type: UU**

$c$  : 16 kPa  
 $\phi$  : 2.5°

**Mohr-Diagram**

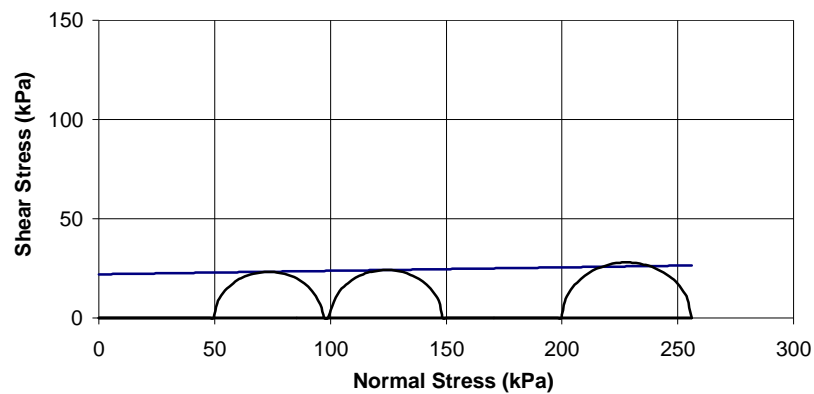

BH No.: BH-7  
Depth: 7.00 m

**Test Type: UU**


$c$  : 22 kPa  
 $\phi$  : 1.0°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/33

**Mohr-Diagram**

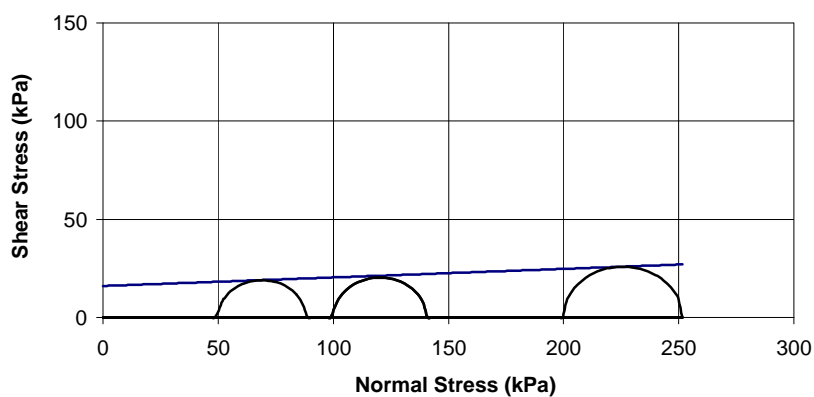


BH No.: BH-7  
Depth: 8.50 m

**Test Type: UU**

$c : 16 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

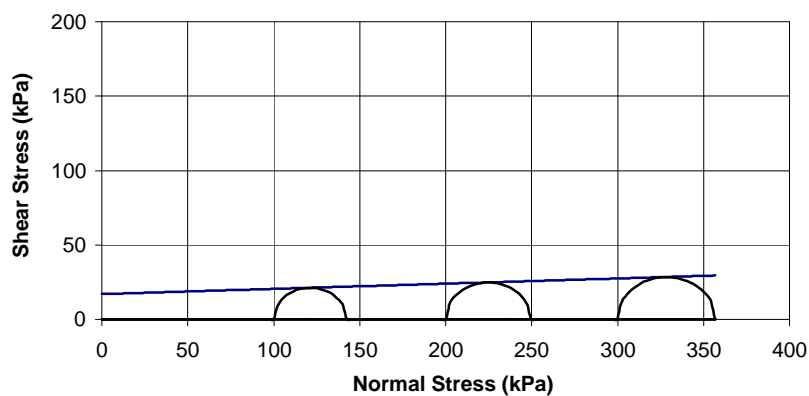


BH No.: BH-7  
Depth: 10.00 m

**Test Type: UU**

$c : 17 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

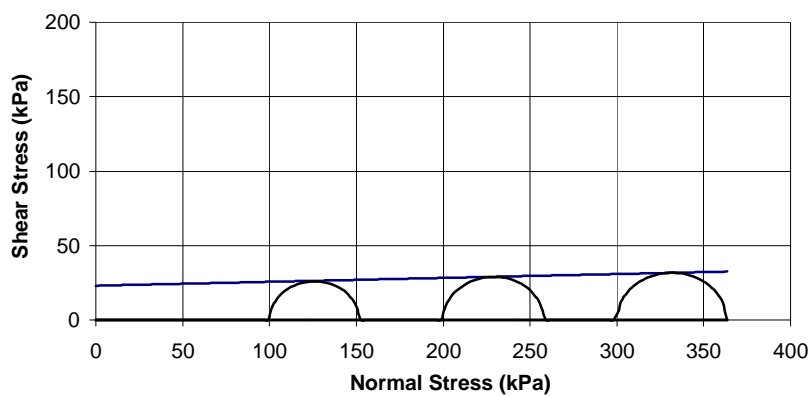

BH No.: BH-7  
Depth: 13.00 m

**Test Type: UU**

$c : 23 \text{ kPa}$   
 $\phi : 1.5^\circ$


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/34



**Mohr-Diagram**

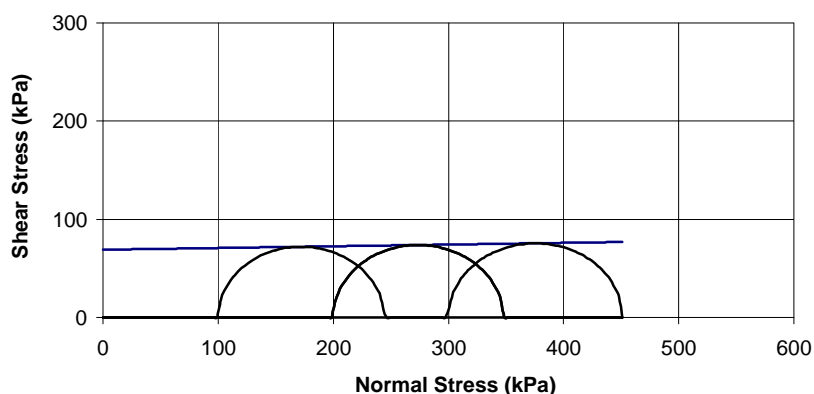


BH No.: BH-7  
Depth: 16.00 m

**Test Type: UU**

$c : 69 \text{ kPa}$   
 $\phi : 1.0^\circ$

**Direct Shear Test**

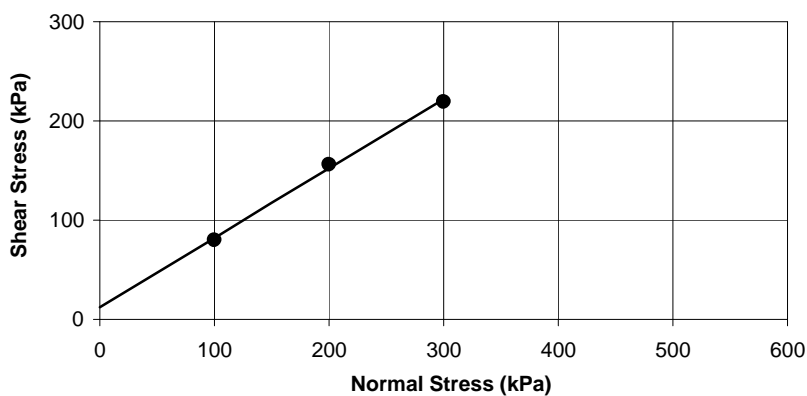


BH No.: BH-7  
Depth: 25.50 m

**Test Type: DS<sub>R</sub>**

$c : 12 \text{ kPa}$   
 $\phi : 35.0^\circ$

**Mohr-Diagram**

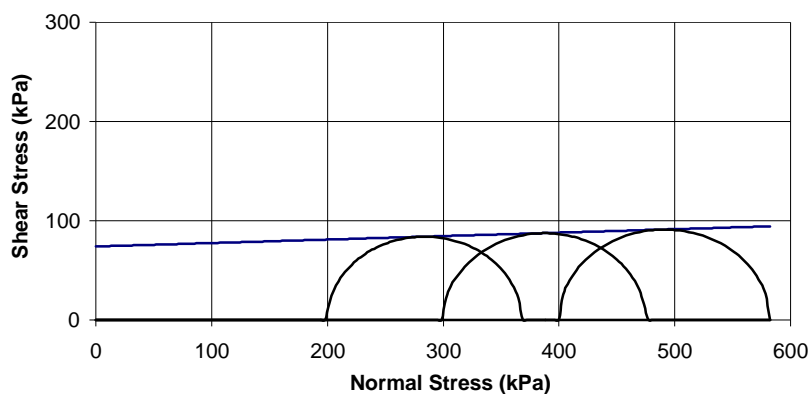

BH No.: BH-7  
Depth: 28.00 m

**Test Type: UU**


$c : 74 \text{ kPa}$   
 $\phi : 2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/35

**Mohr-Diagram**

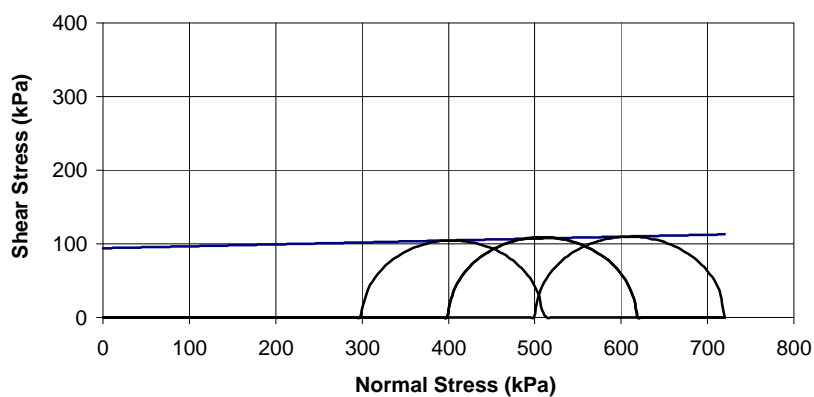


BH No.: BH-7  
Depth: 31.00 m

**Test Type: UU**

$c : 94 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Direct Shear Test**

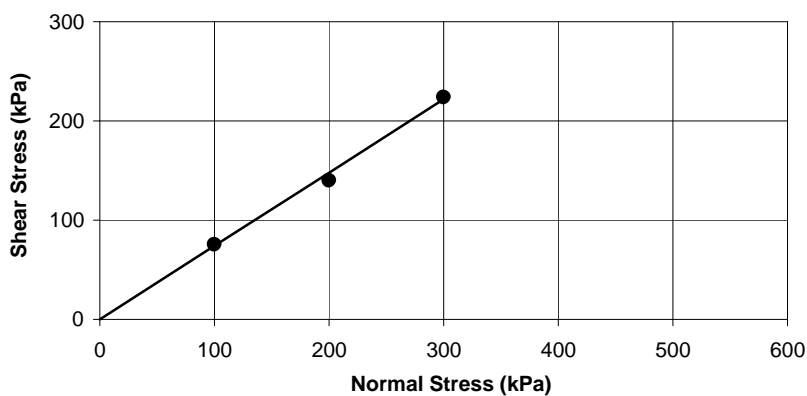


BH No.: BH-7  
Depth: 42.00 m

**Test Type: DS<sub>R</sub>**

$c : 0 \text{ kPa}$   
 $\phi : 36.5^\circ$

**Direct Shear Test**

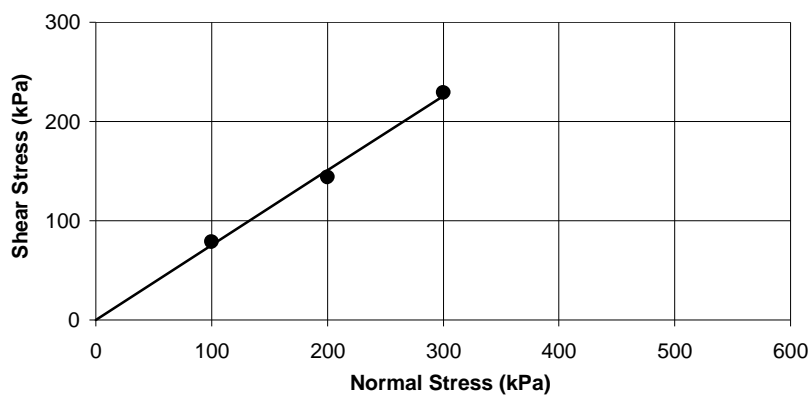

BH No.: BH-7  
Depth: 45.00 m

**Test Type: DS<sub>R</sub>**


$c : 0 \text{ kPa}$   
 $\phi : 37.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/36

### Direct Shear Test

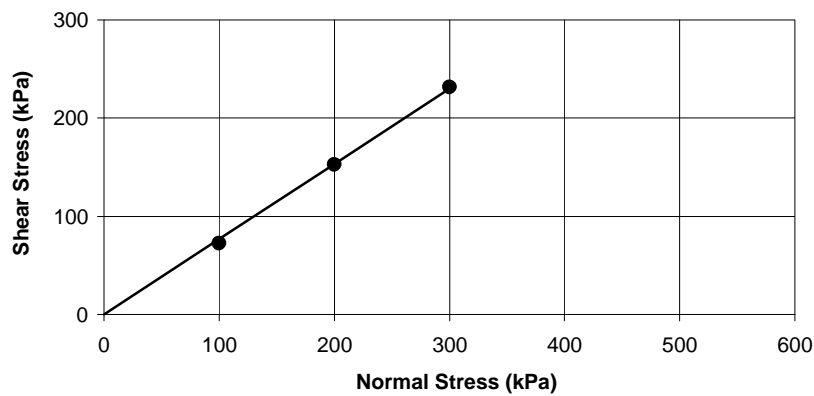


BH No.: BH-7  
Depth: 48.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.5^\circ$

### Mohr-Diagram

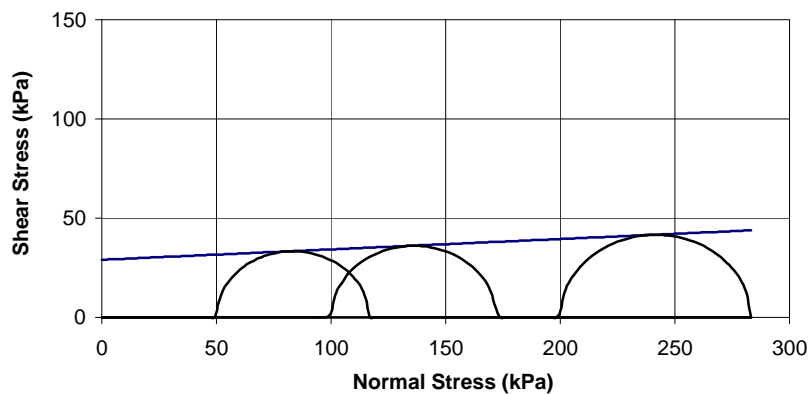


BH No.: BH-8  
Depth: 1.00 m

Test Type: UU

$c$  : 29 kPa  
 $\phi$  :  $3.0^\circ$

### Direct Shear Test

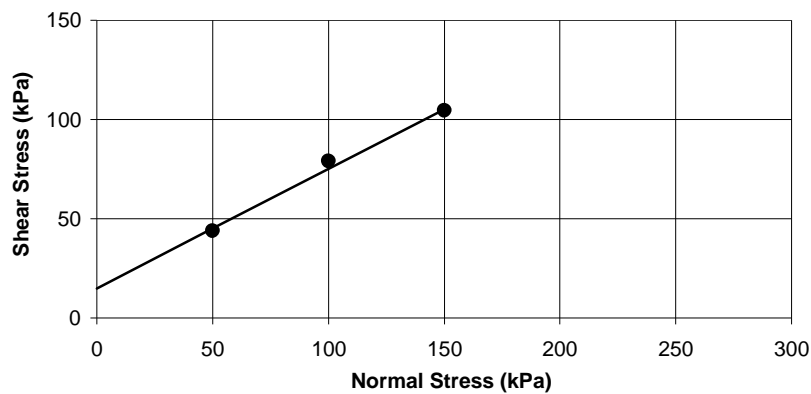

BH No.: BH-8  
Depth: 2.50 m

Test Type: DS


$c$  : 15 kPa  
 $\phi$  :  $31.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/37

**Mohr-Diagram**

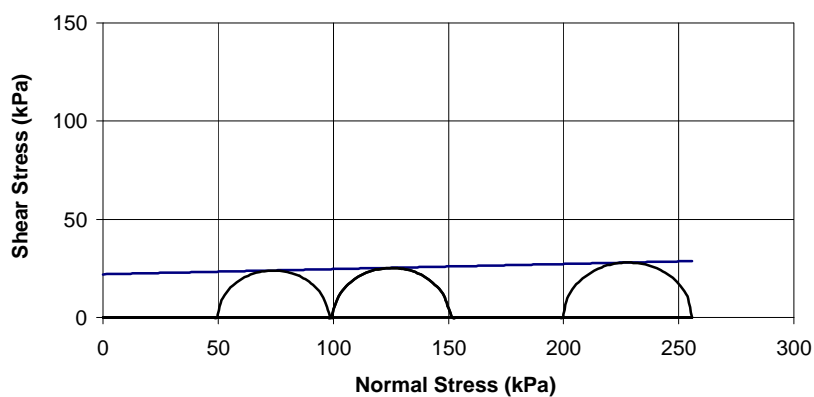


BH No.: BH-8  
Depth: 4.00 m

**Test Type: UU**

$c : 22 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

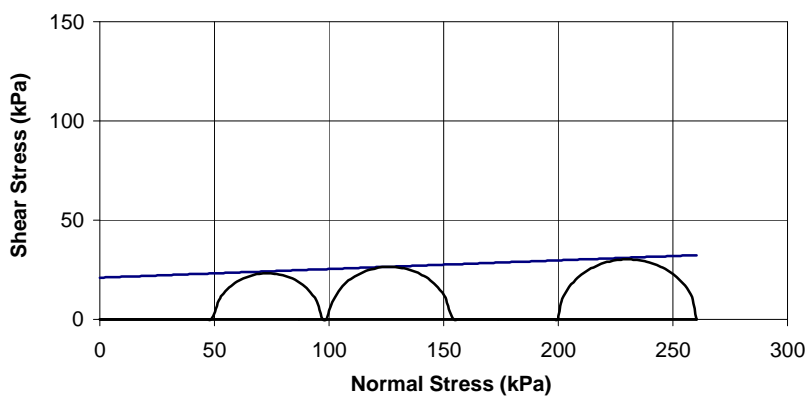


BH No.: BH-8  
Depth: 5.50 m

**Test Type: UU**

$c : 21 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

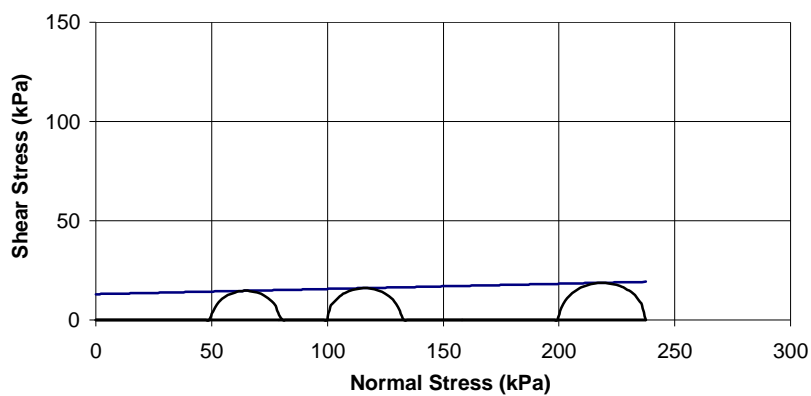

BH No.: BH-8  
Depth: 7.00 m

**Test Type: UU**


$c : 13 \text{ kPa}$   
 $\phi : 1.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/38

**Mohr-Diagram**

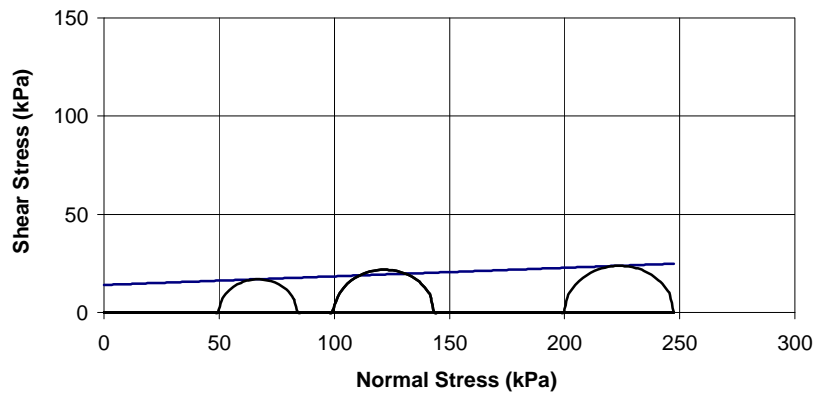


BH No.: BH-8  
Depth: 8.50 m

**Test Type: UU**

$c : 14 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

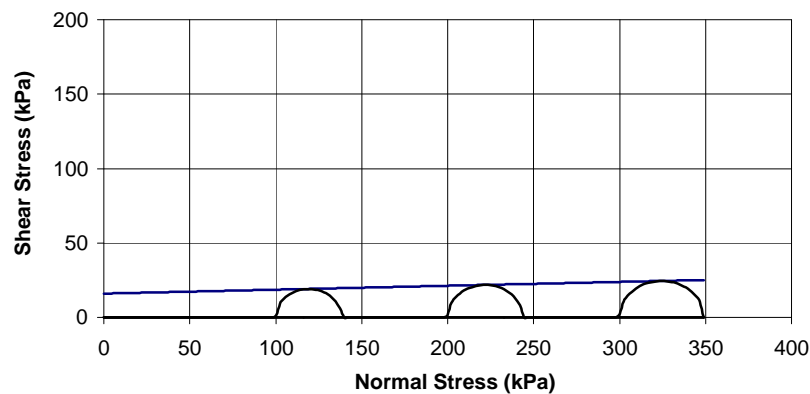


BH No.: BH-8  
Depth: 10.00 m

**Test Type: UU**

$c : 16 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

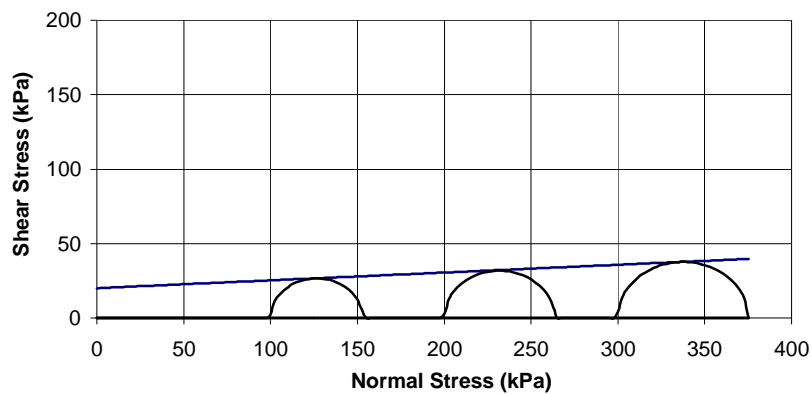

BH No.: BH-8  
Depth: 13.00 m

**Test Type: UU**


$c : 20 \text{ kPa}$   
 $\phi : 3.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/39

**Mohr-Diagram**

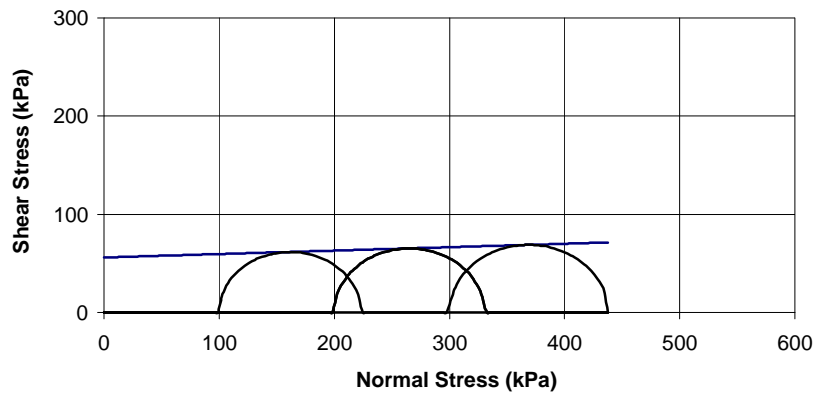


BH No.: BH-8  
Depth: 16.00 m

**Test Type: UU**

$c : 56 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Direct Shear Test**

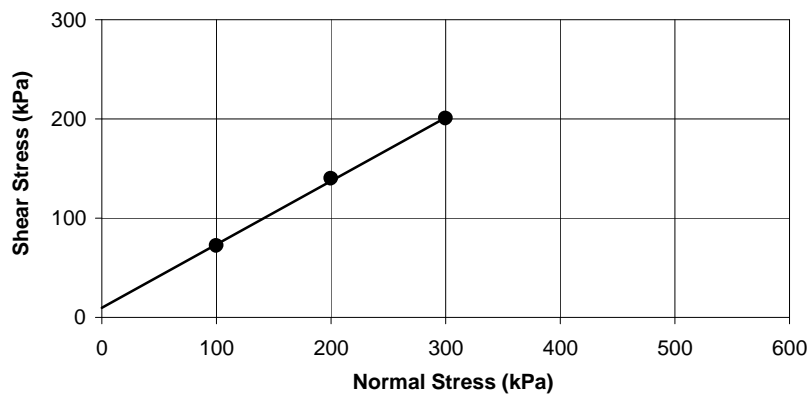


BH No.: BH-8  
Depth: 25.50 m

**Test Type: DS<sub>R</sub>**

$c : 10 \text{ kPa}$   
 $\phi : 32.5^\circ$

**Mohr-Diagram**

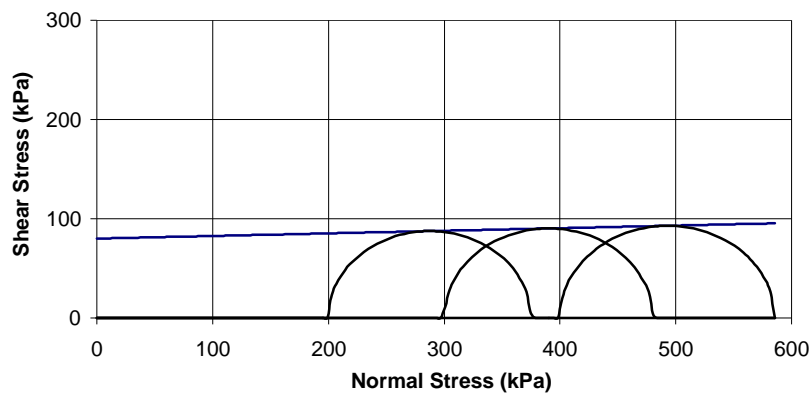

BH No.: BH-8  
Depth: 28.00 m

**Test Type: UU**


$c : 80 \text{ kPa}$   
 $\phi : 1.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/40

**Mohr-Diagram**

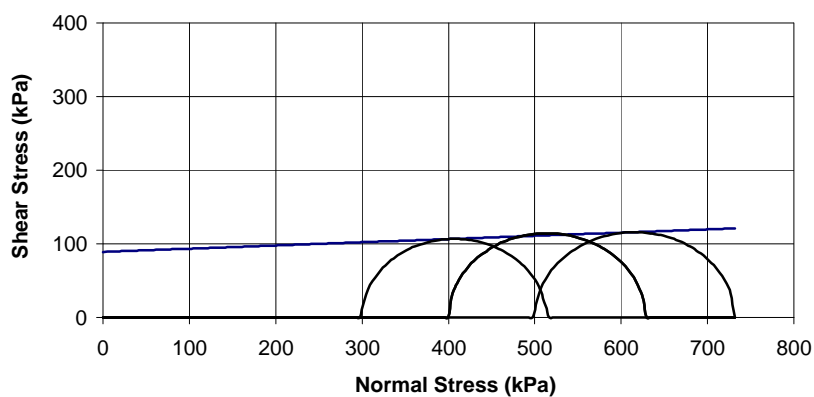


BH No.: BH-8  
Depth: 31.00 m

**Test Type: UU**

$c : 89 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Direct Shear Test**

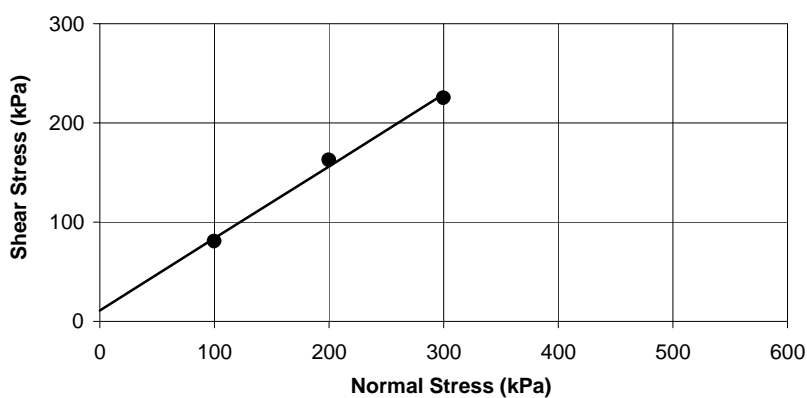


BH No.: BH-8  
Depth: 40.50 m

**Test Type: DS<sub>R</sub>**

$c : 11 \text{ kPa}$   
 $\phi : 36.0^\circ$

**Direct Shear Test**

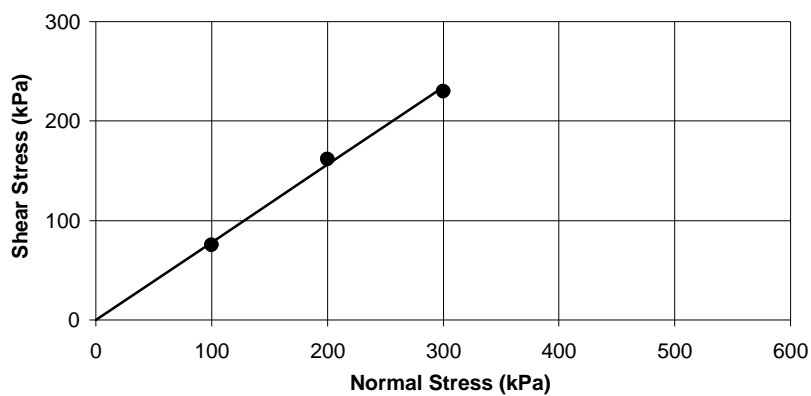

BH No.: BH-8  
Depth: 43.50 m

**Test Type: DS<sub>R</sub>**


$c : 0 \text{ kPa}$   
 $\phi : 38.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/41

### Direct Shear Test

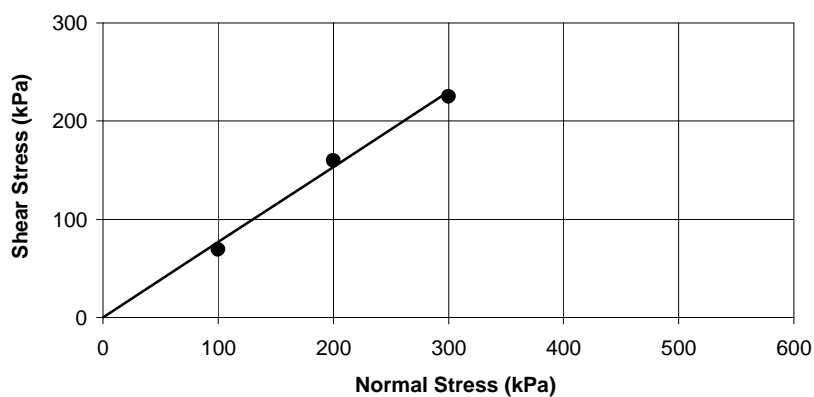


BH No.: BH-8  
Depth: 46.50 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.5^\circ$

### Direct Shear Test

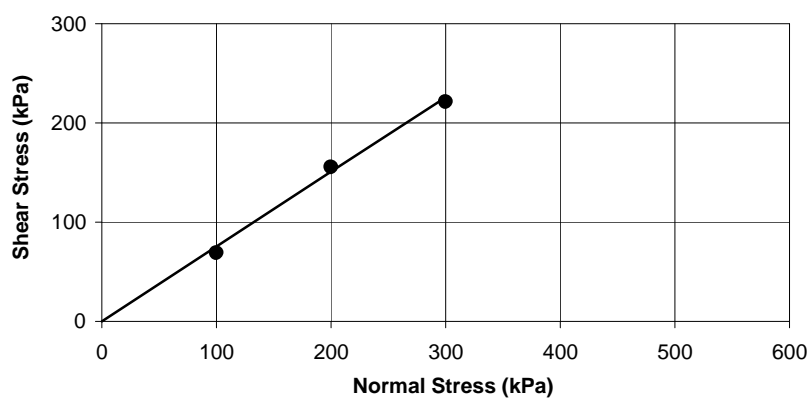


BH No.: BH-8  
Depth: 50.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.0^\circ$

### Mohr-Diagram

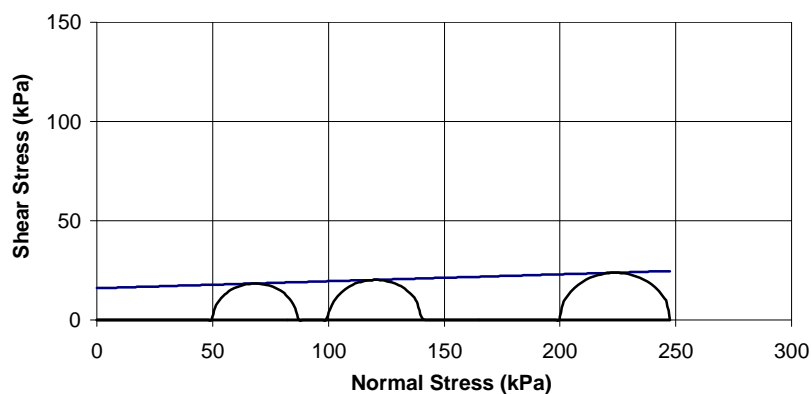

BH No.: BH-10  
Depth: 1.50 m

Test Type:  $UU$

$c$  : 16 kPa  
 $\phi$  :  $2.0^\circ$


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/42



### Direct Shear Test

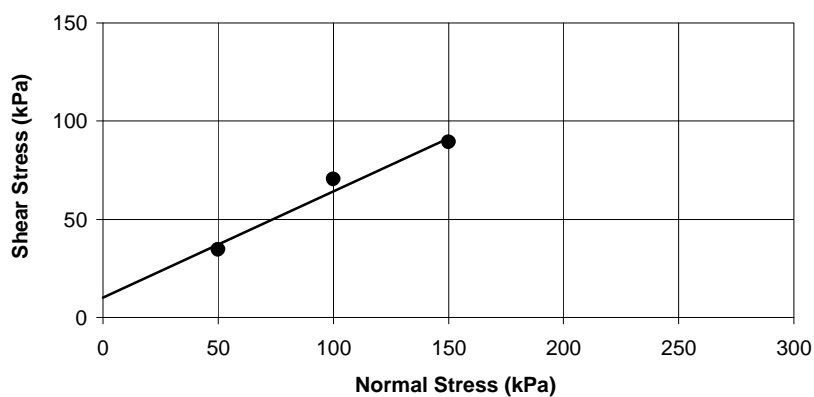


BH No.: BH-10  
Depth: 3.00 m

Test Type: DS

$c$  : 10 kPa  
 $\phi$  : 28.5°

### Mohr-Diagram

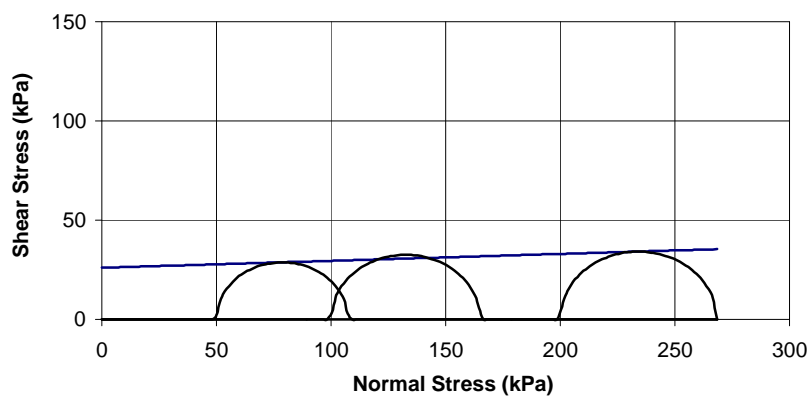


BH No.: BH-10  
Depth: 4.50 m

Test Type: UU

$c$  : 26 kPa  
 $\phi$  : 2.0°

### Mohr-Diagram

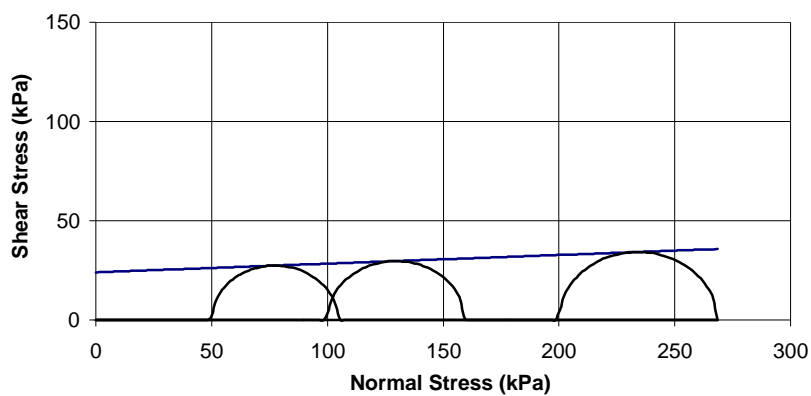

BH No.: BH-10  
Depth: 6.00 m

Test Type: UU


$c$  : 24 kPa  
 $\phi$  : 2.5°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/43

**Mohr-Diagram**

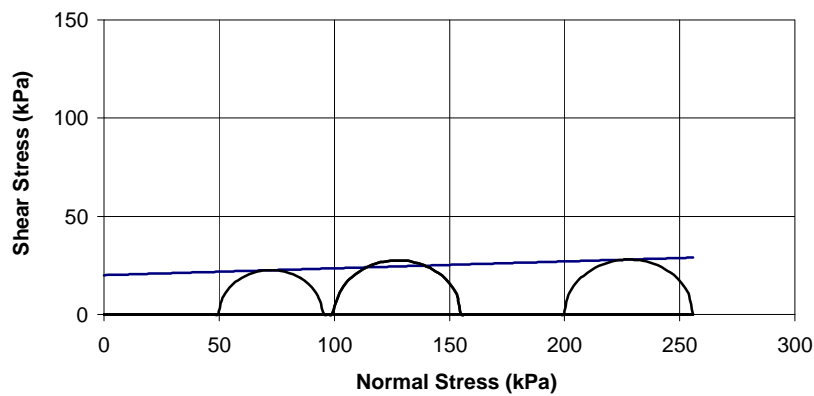


BH No.: BH-10  
Depth: 7.50 m

**Test Type: UU**

$c : 20 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

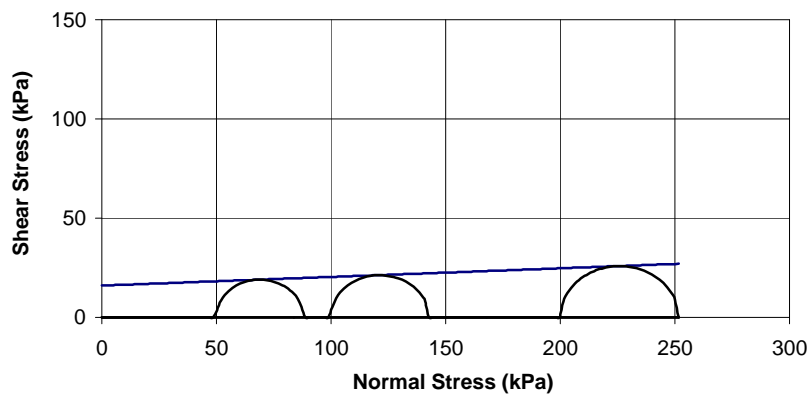


BH No.: BH-10  
Depth: 9.00 m

**Test Type: UU**

$c : 16 \text{ kPa}$   
 $\phi : 2.5^\circ$

**Mohr-Diagram**

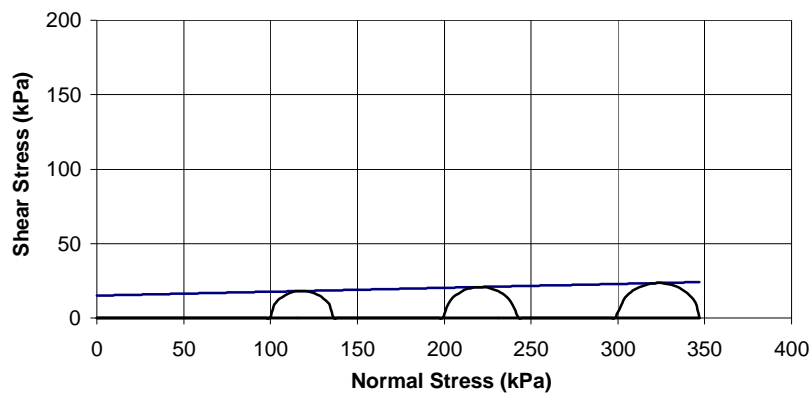

BH No.: BH-10  
Depth: 10.50 m

**Test Type: UU**


$c : 15 \text{ kPa}$   
 $\phi : 1.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/44

**Mohr-Diagram**

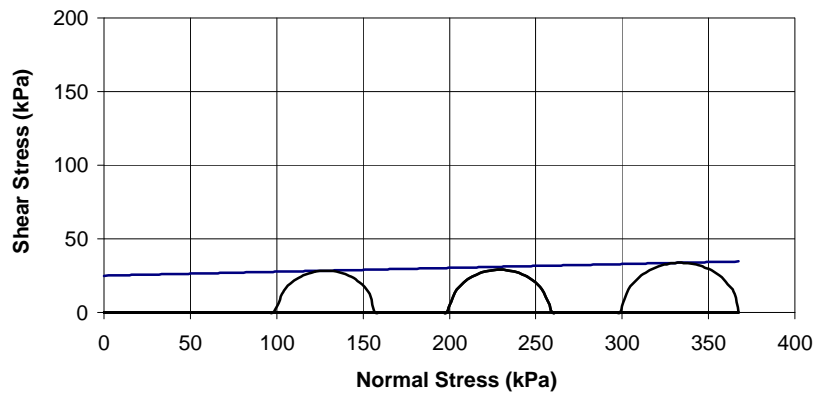


BH No.: BH-10  
Depth: 12.00 m

**Test Type: UU**

$c : 25 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

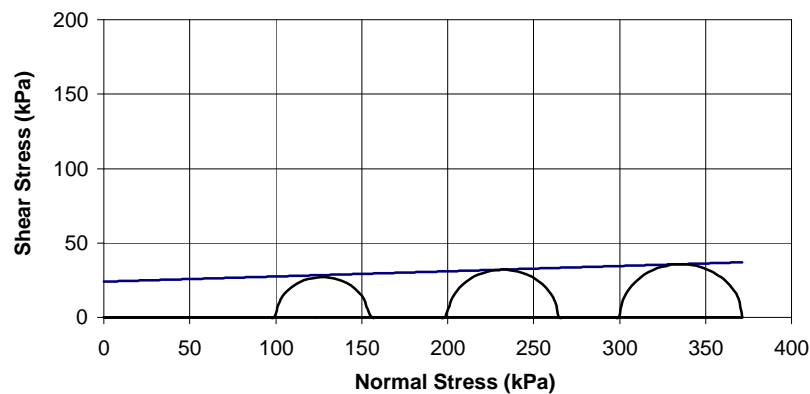


BH No.: BH-10  
Depth: 13.50 m

**Test Type: UU**

$c : 24 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

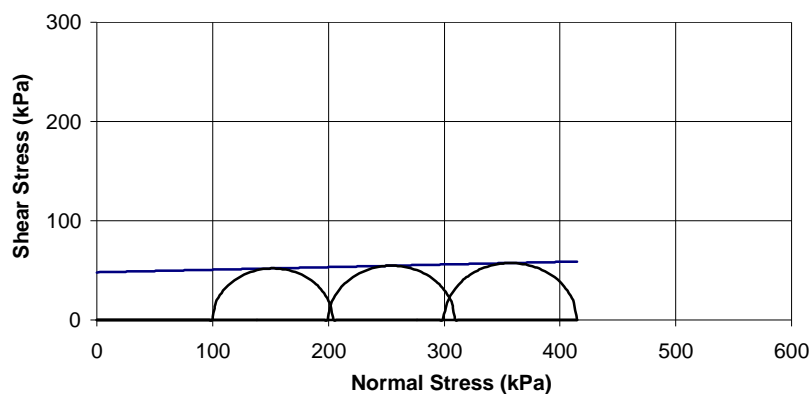

BH No.: BH-10  
Depth: 16.50 m

**Test Type: UU**


$c : 48 \text{ kPa}$   
 $\phi : 1.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/45

**Mohr-Diagram**

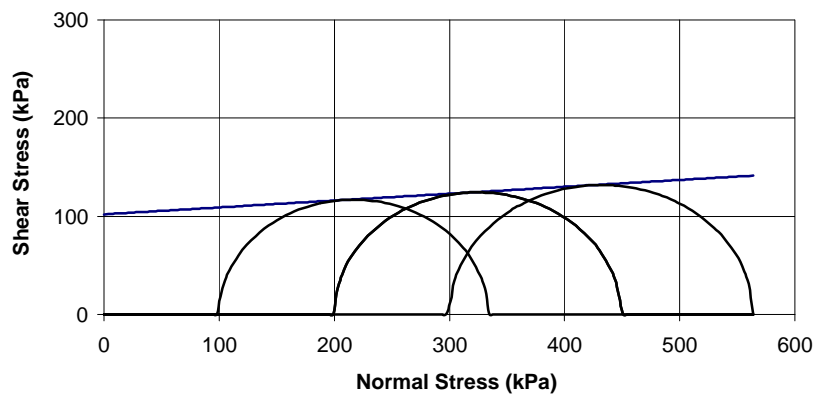


BH No.: BH-10  
Depth: 19.50 m

**Test Type: UU**

$c : 102 \text{ kPa}$   
 $\phi : 4.0^\circ$

**Direct Shear Test**

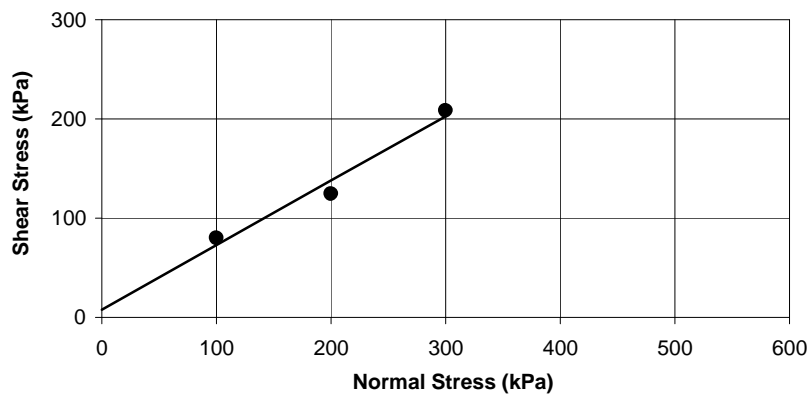


BH No.: BH-10  
Depth: 23.00 m

**Test Type: DS<sub>R</sub>**

$c : 8 \text{ kPa}$   
 $\phi : 33.0^\circ$

**Direct Shear Test**

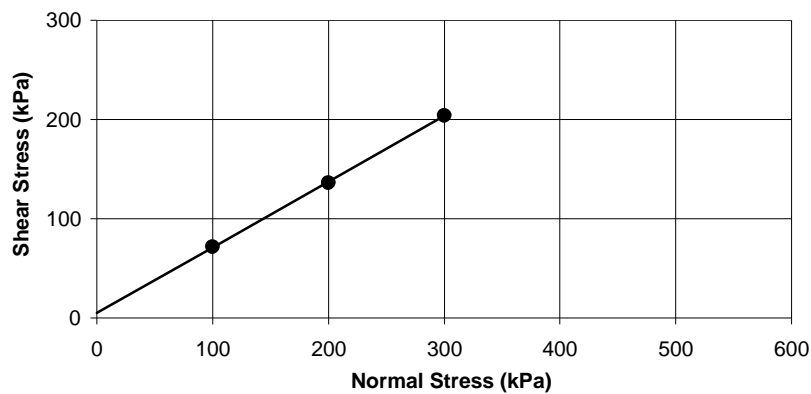

BH No.: BH-10  
Depth: 26.00 m

**Test Type: DS<sub>R</sub>**


$c : 5 \text{ kPa}$   
 $\phi : 33.5^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/46

**Mohr-Diagram**

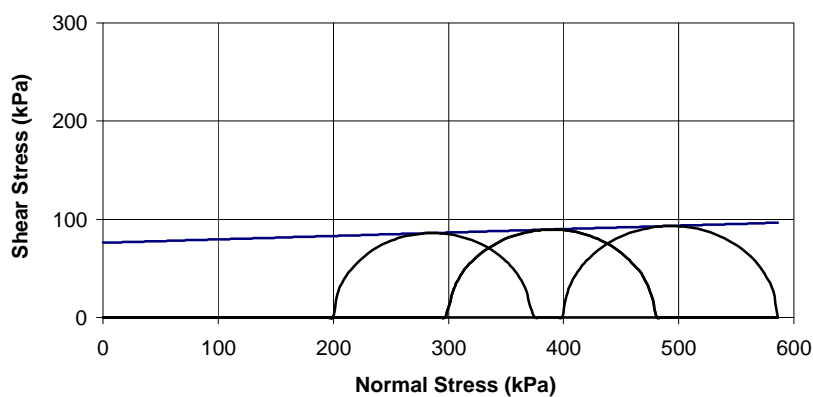


BH No.: BH-10  
Depth: 27.00 m

**Test Type: UU**

$c : 76 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

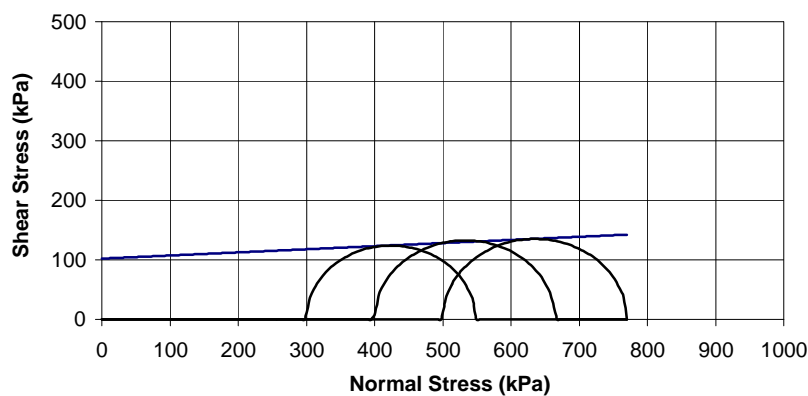


BH No.: BH-10  
Depth: 30.00 m

**Test Type: UU**

$c : 102 \text{ kPa}$   
 $\phi : 3.0^\circ$

**Direct Shear Test**

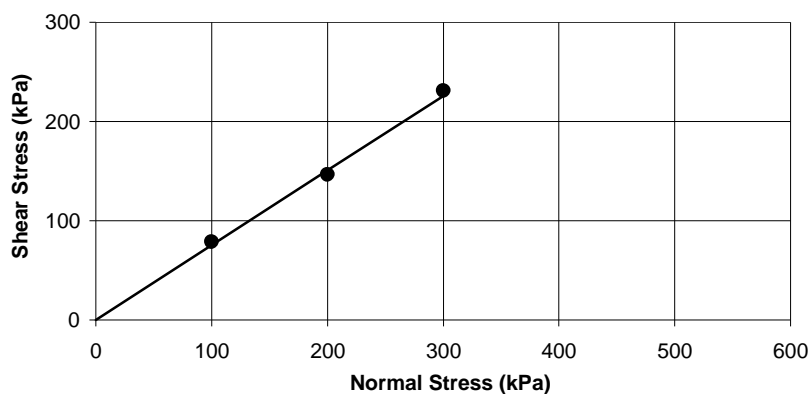

BH No.: BH-10  
Depth: 47.00 m

**Test Type: DS<sub>R</sub>**


$c : 0 \text{ kPa}$   
 $\phi : 37.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/47

### Direct Shear Test

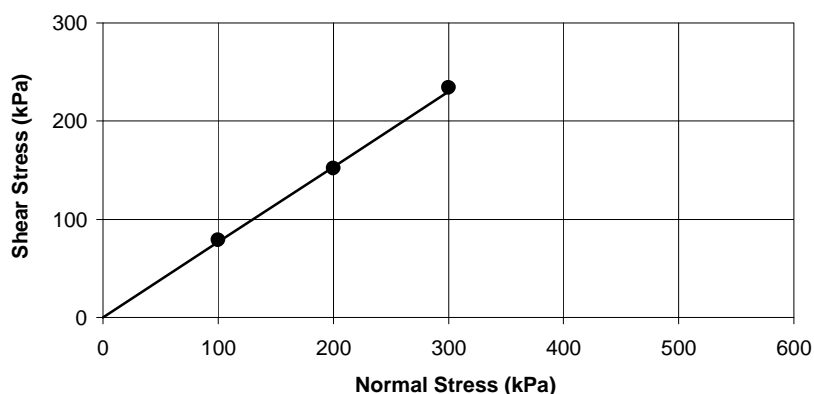


BH No.: BH-10  
Depth: 50.00 m

Test Type:  $DS_R$

$c$  : 0 kPa  
 $\phi$  :  $37.5^\circ$

### Mohr-Diagram

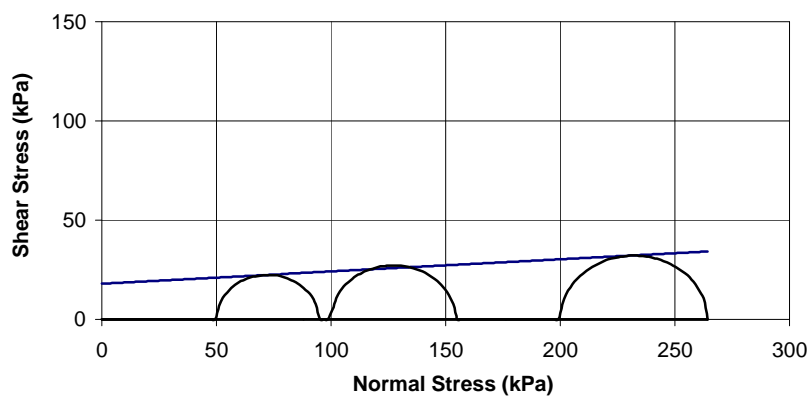


BH No.: BH-11  
Depth: 1.00 m

Test Type: UU

$c$  : 18 kPa  
 $\phi$  :  $3.5^\circ$

### Mohr-Diagram

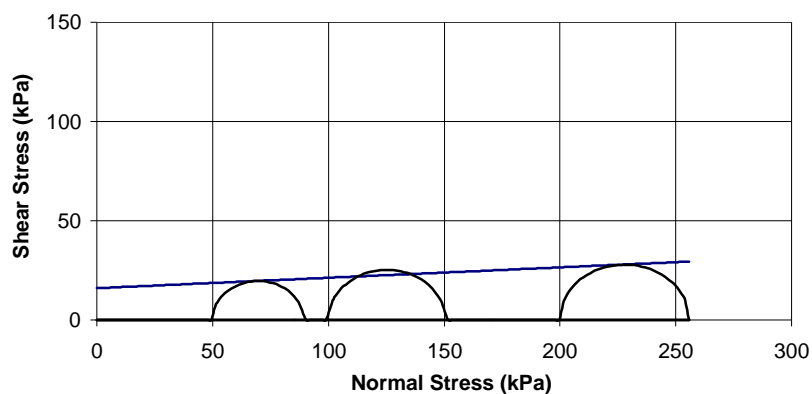

BH No.: BH-11  
Depth: 2.50 m

Test Type: UU


$c$  : 16 kPa  
 $\phi$  :  $3.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

Job No.  
CCPL/20101211

Fig. No.  
F/48

**Mohr-Diagram**

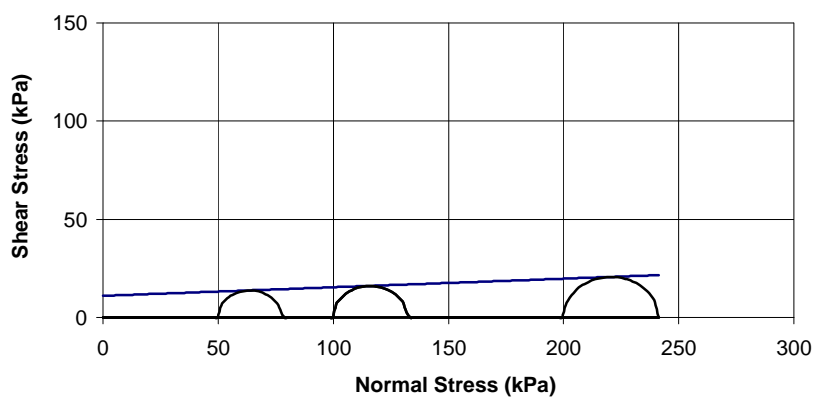


BH No.: BH-11  
Depth: 4.00 m

**Test Type: UU**

$c$  : 11 kPa  
 $\phi$  : 2.5°

**Direct Shear Test**

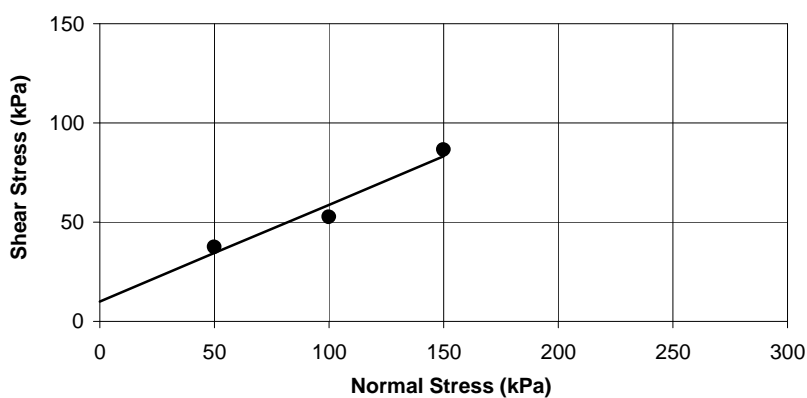


BH No.: BH-11  
Depth: 7.00 m

**Test Type: DS**

$c$  : 10 kPa  
 $\phi$  : 26.0°

**Mohr-Diagram**

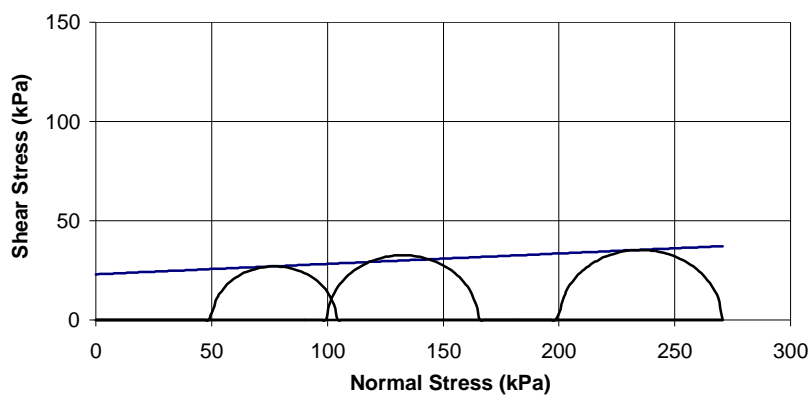

BH No.: BH-11  
Depth: 8.50 m

**Test Type: UU**


$c$  : 23 kPa  
 $\phi$  : 3.0°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/49

**Mohr-Diagram**

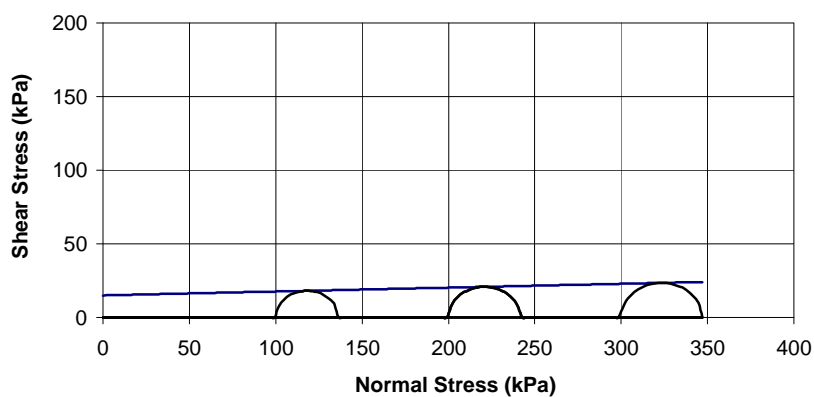


BH No.: BH-11  
Depth: 10.00 m

**Test Type: UU**

$c : 15 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

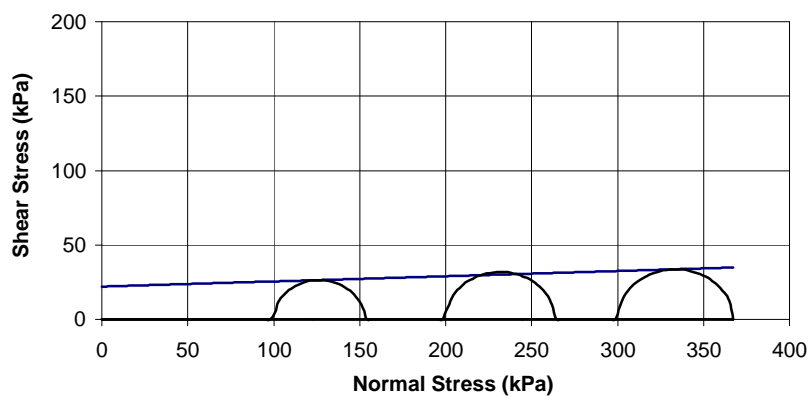


BH No.: BH-11  
Depth: 11.50 m

**Test Type: UU**

$c : 22 \text{ kPa}$   
 $\phi : 2.0^\circ$

**Mohr-Diagram**

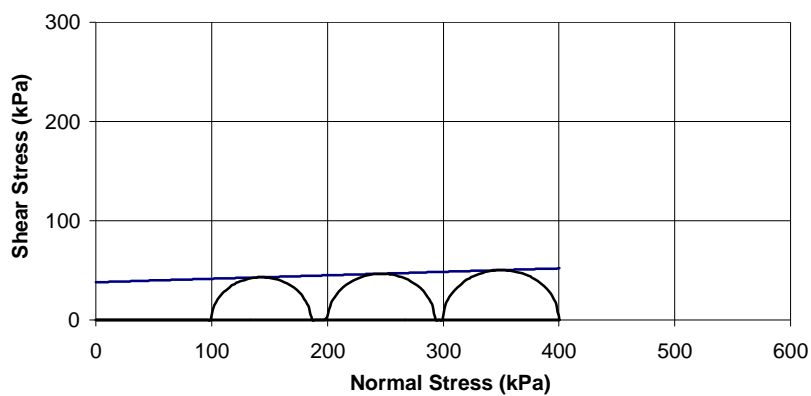

BH No.: BH-11  
Depth: 14.50 m

**Test Type: UU**

$c : 38 \text{ kPa}$   
 $\phi : 2.0^\circ$


Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/50



**Mohr-Diagram**

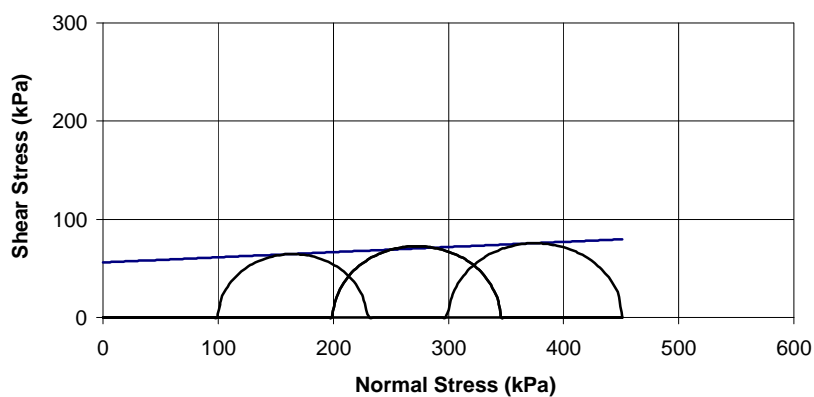


BH No.: BH-11  
Depth: 17.50 m

**Test Type: UU**

$c : 56 \text{ kPa}$   
 $\phi : 3.0^\circ$

**Direct Shear Test**

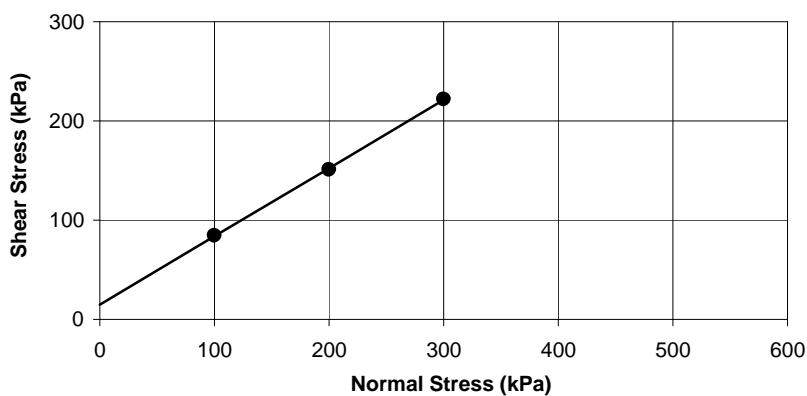


BH No.: BH-11  
Depth: 22.50 m

**Test Type: DS<sub>R</sub>**

$c : 15 \text{ kPa}$   
 $\phi : 34.5^\circ$

**Direct Shear Test**

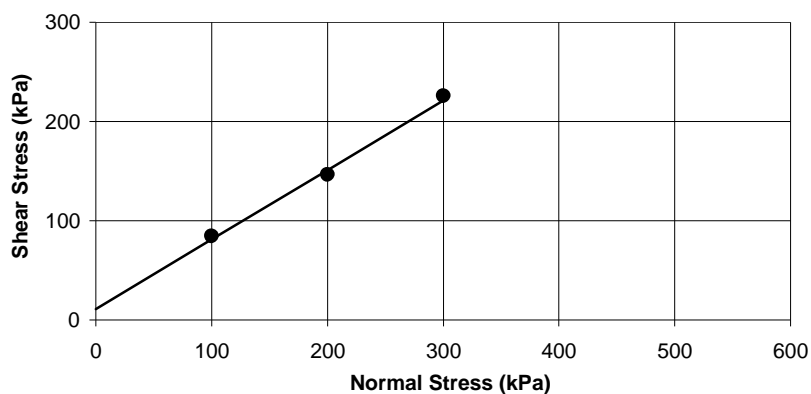

BH No.: BH-11  
Depth: 25.50 m

**Test Type: DS<sub>R</sub>**


$c : 11 \text{ kPa}$   
 $\phi : 35.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/51

**Mohr-Diagram**

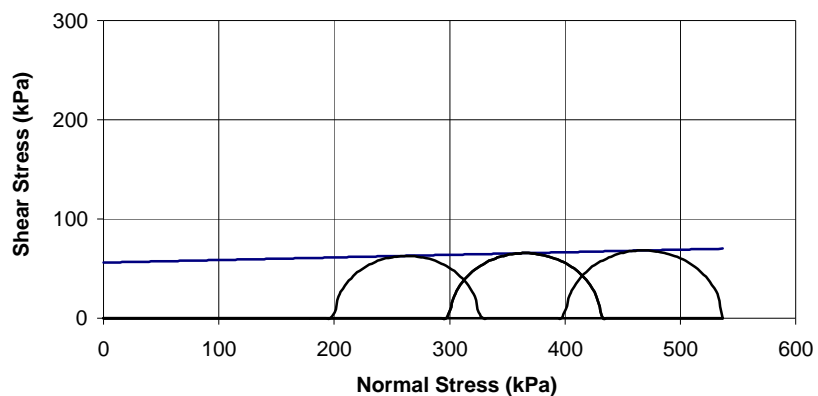


BH No.: BH-11  
Depth: 28.00 m

**Test Type: UU**

$c : 56 \text{ kPa}$   
 $\phi : 1.5^\circ$

**Mohr-Diagram**

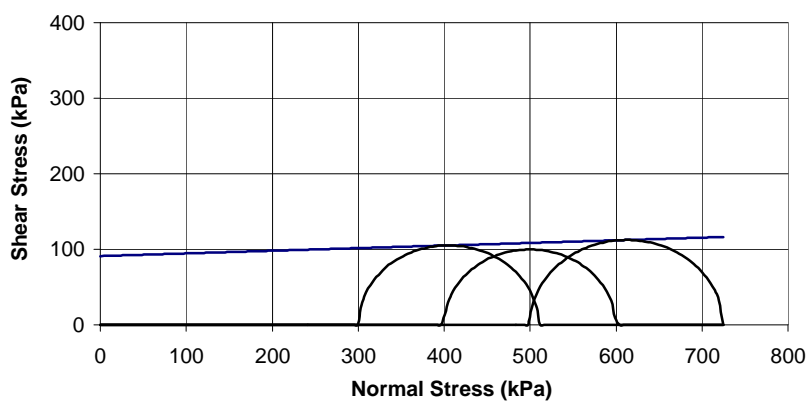

BH No.: BH-11  
Depth: 31.00 m

**Test Type: UU**


$c : 91 \text{ kPa}$   
 $\phi : 2.0^\circ$

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211

**Fig. No.**  
F/52

**Direct Shear Test**

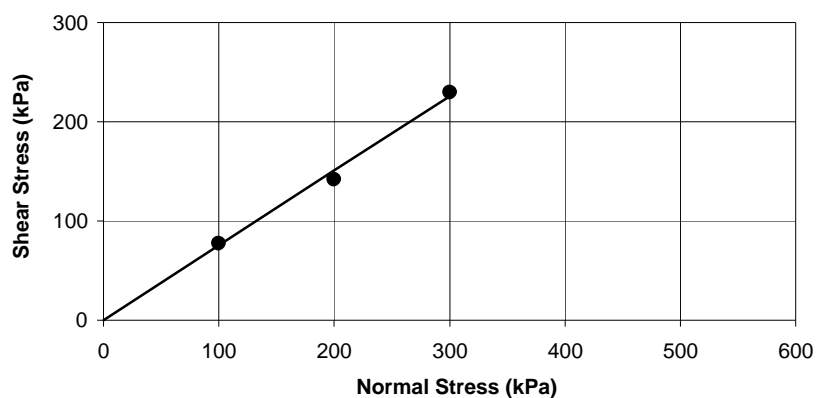


BH No.: BH-11  
Depth: 45.00 m

**Test Type: DS<sub>R</sub>**

c : 0 kPa  
 $\phi$  : 37.0°

**Direct Shear Test**

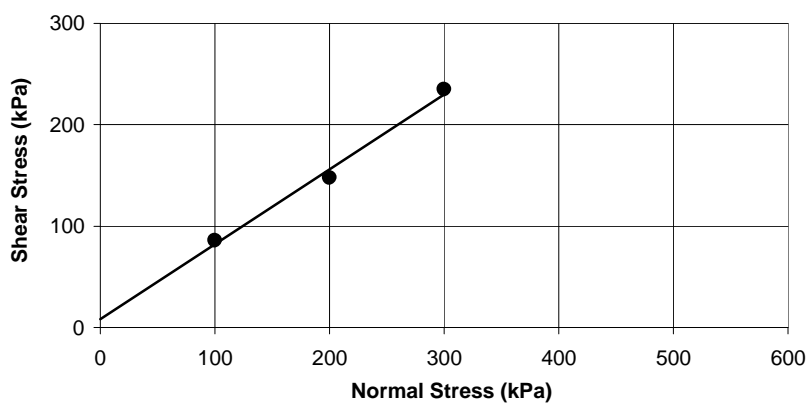

BH No.: BH-11  
Depth: 48.00 m

**Test Type: DS<sub>R</sub>**


c : 8 kPa  
 $\phi$  : 36.5°

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No.**  
CCPL/20101211


**Fig. No.**  
F/53

**e-logp curve**

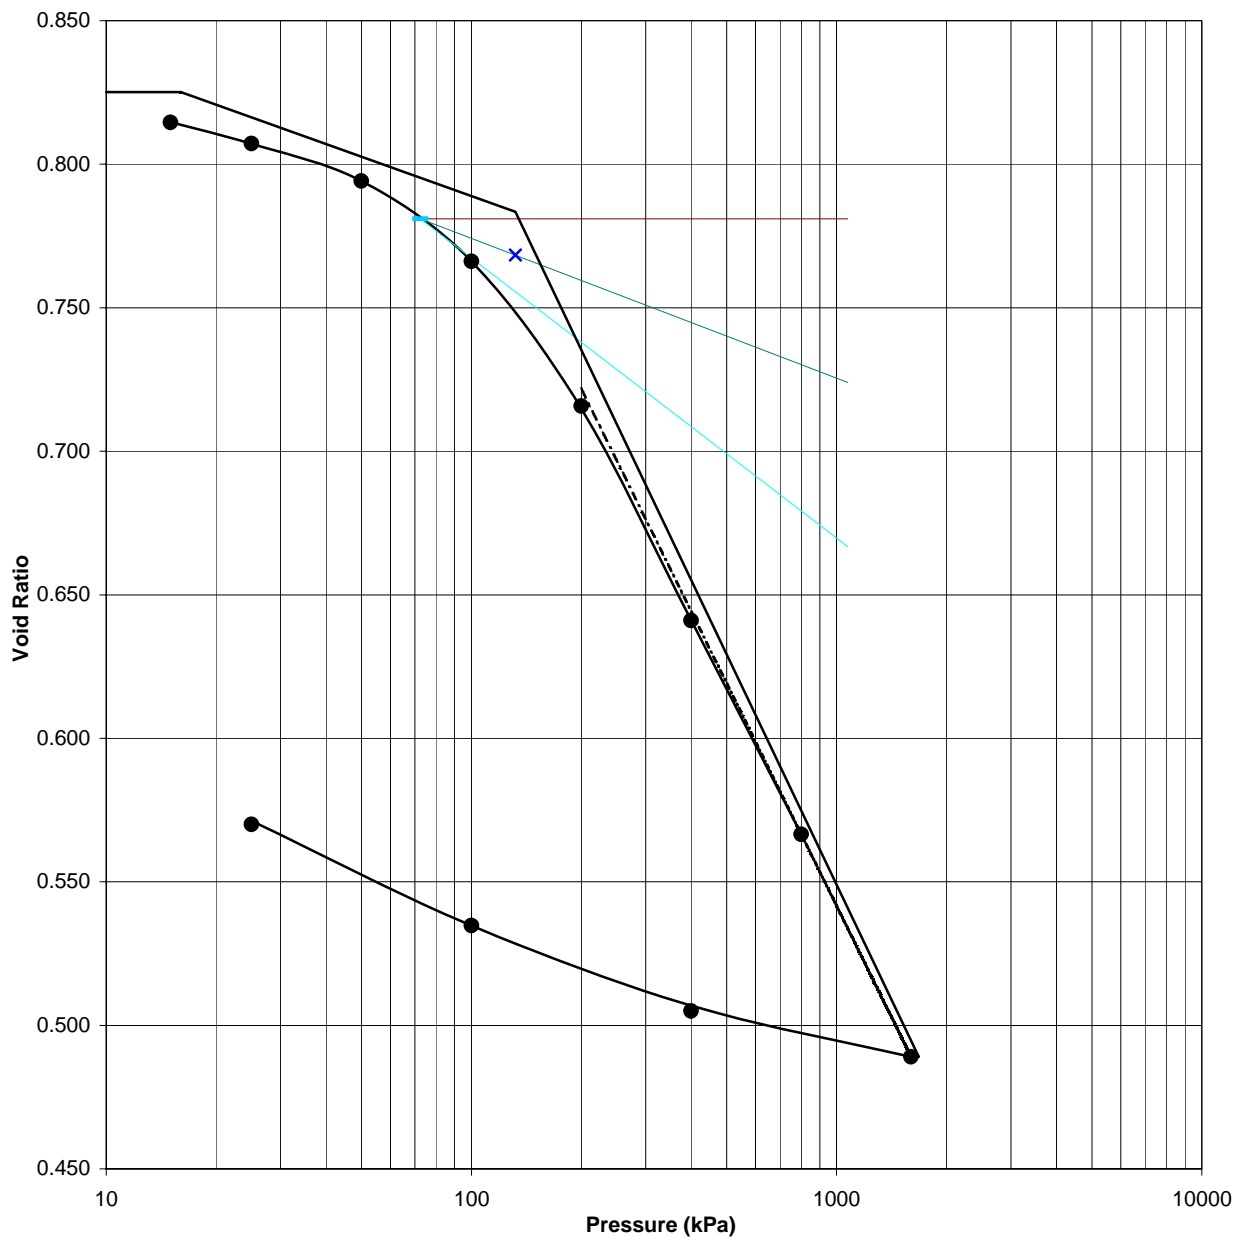


Bore hole No.: BH-1		Depth : 2.00m	
Initial Void Ratio, $e_0$	= 0.8251	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 16 kPa		
Compression Index $C_c$	= 0.2666	25 - 50	0.000285
$C_c/(1+e_0)$	= 0.1461	50 - 100	0.000307
Pre-consolidation Pressure, $p_c$	= 132 kPa	100 - 200	0.000276
Swelling Index, $C_s$	= 0.0455	200 - 400	0.000204
Recompression Index, $C_r$	$\approx$ 0.0455	400 - 800	0.000102
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/1

**e-logp curve**

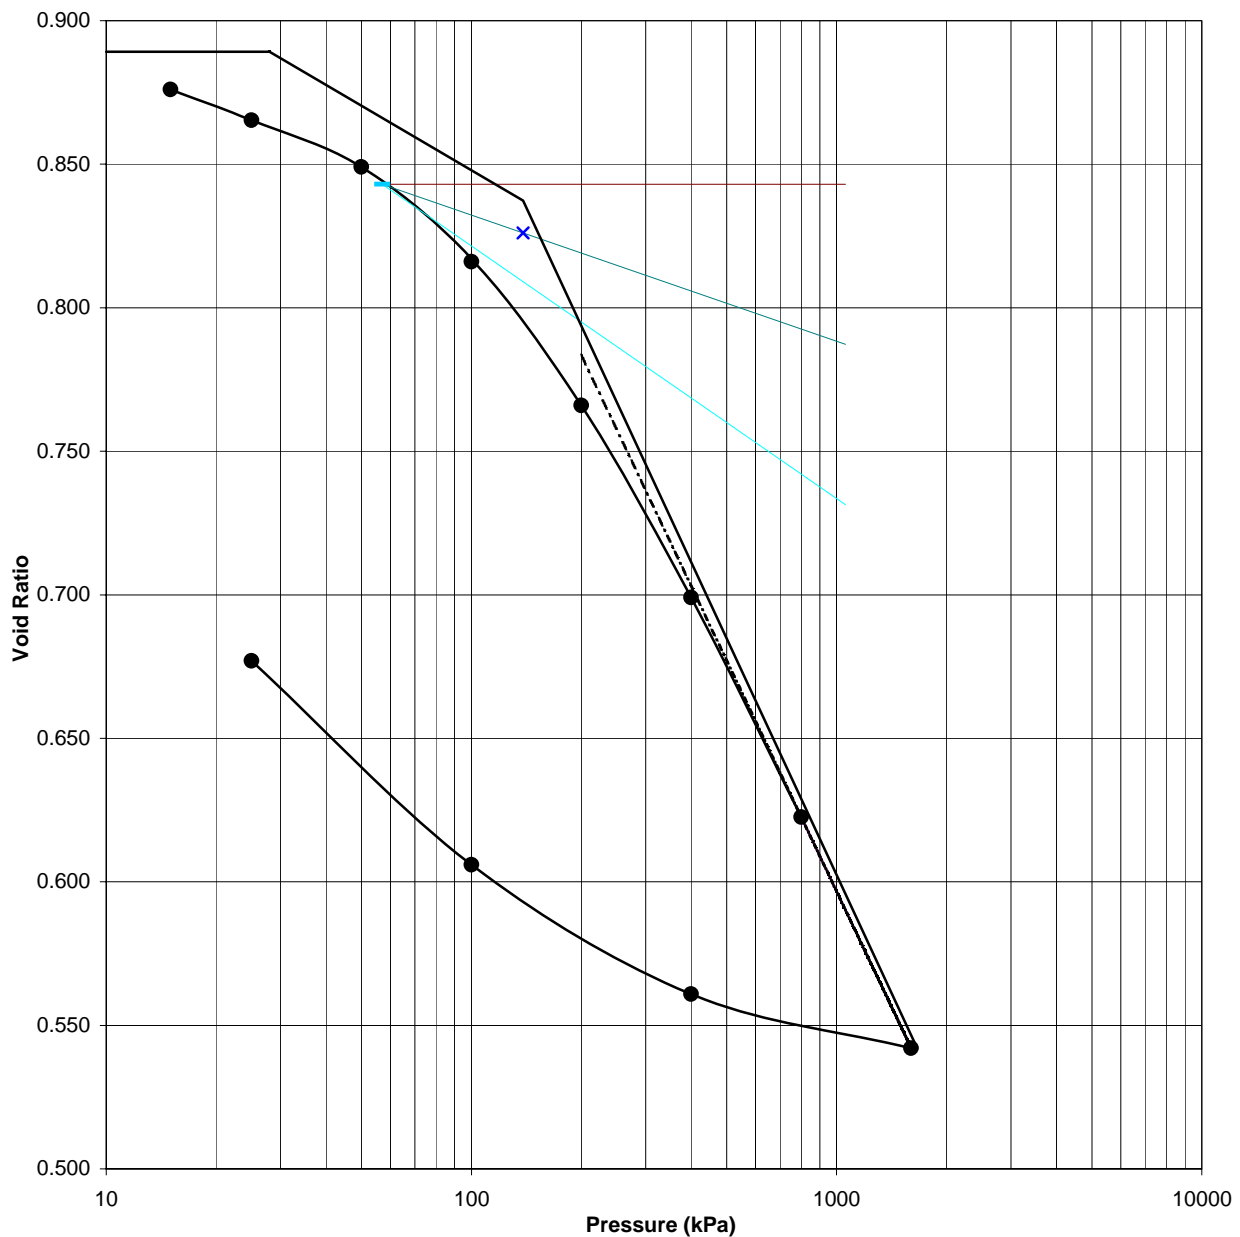


Bore hole No.: BH-1		Depth : 3.50m	
Initial Void Ratio, $e_0$	=	0.8892	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	28 kPa	
Compression Index $C_c$	=	0.2737	0.000344
$C_c/(1+e_0)$	=	0.1449	0.000349
Pre-consolidation Pressure, $p_c$	=	138 kPa	0.000265
Swelling Index, $C_s$	=	0.0747	0.000177
Recompression Index, $C_r$	≈	0.0747	0.000101
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/2

**e-logp curve**

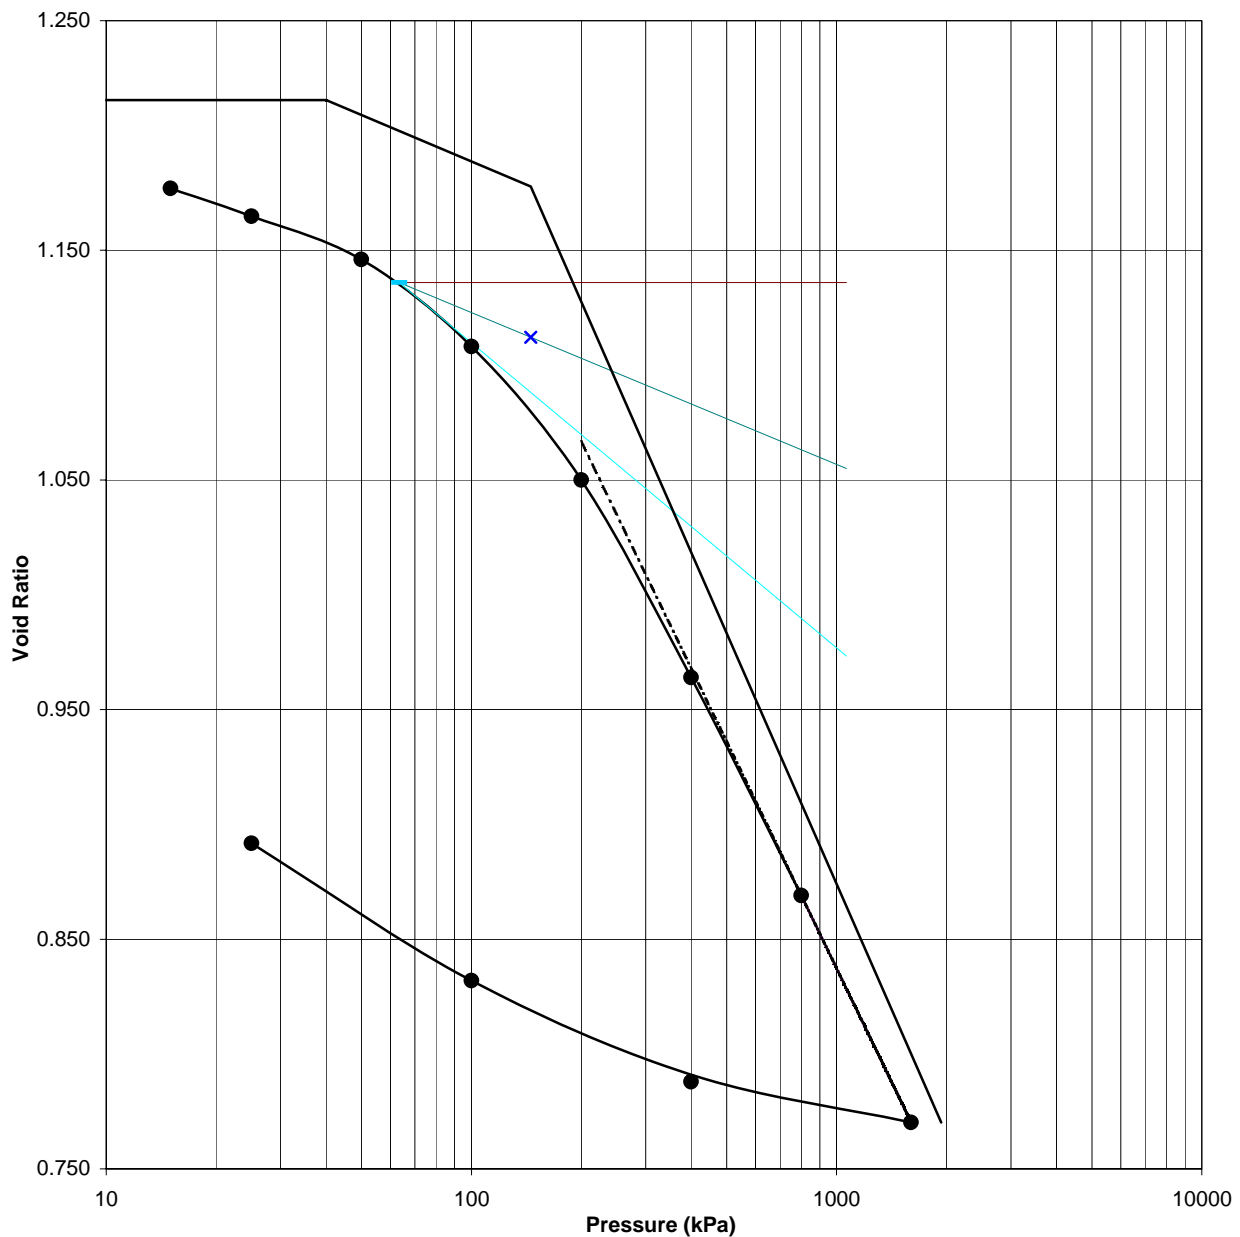


Bore hole No.: BH-1		Depth : 5.00m	
Initial Void Ratio, $e_0$	= 1.2155	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 40 kPa		
Compression Index $C_c$	= 0.3626	25 - 50	0.000341
$C_c/(1+e_0)$	= 0.1637	50 - 100	0.000342
Pre-consolidation Pressure, $p_c$	= 145 kPa	100 - 200	0.000262
Swelling Index, $C_s$	= 0.0673	200 - 400	0.000194
Recompression Index, $C_r$	≈ 0.0673	400 - 800	0.000107
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			<div>Job No. : CCPL/20101211</div> <div>Fig. No. G/3</div>

**e-logp curve**

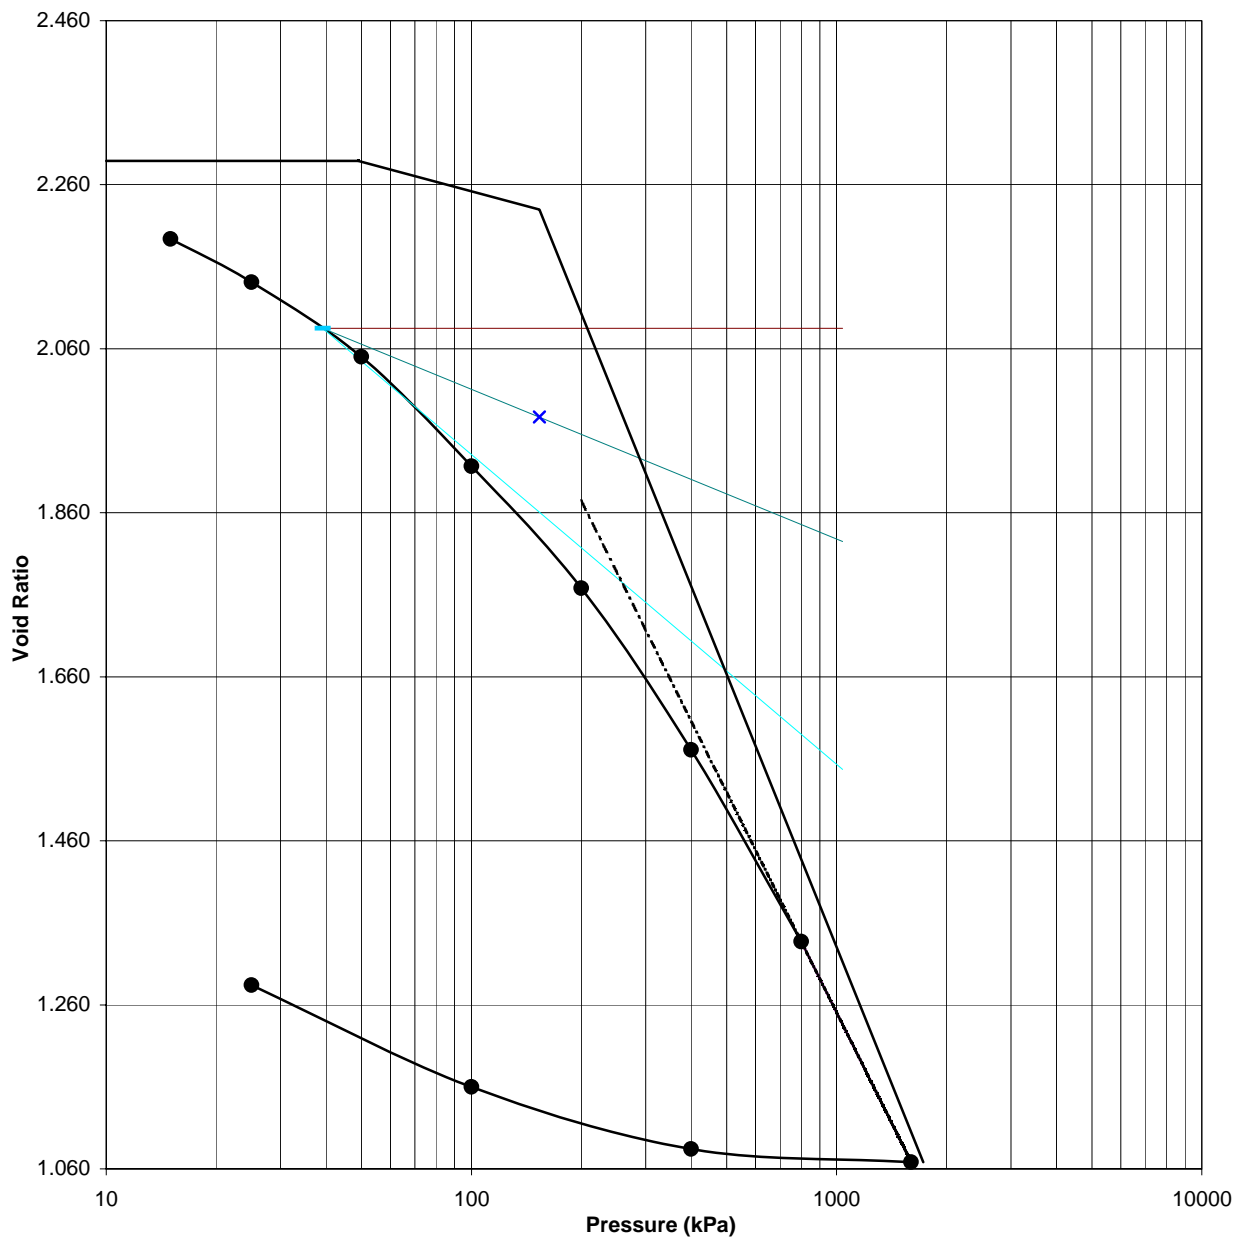

Bore hole No.: BH-1		Depth : 6.50m	
Initial Void Ratio, $e_0$	= 2.2890	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 49 kPa		
Compression Index $C_c$	= 1.1049	25 - 50	0.001103
$C_c/(1+e_0)$	= 0.3359	50 - 100	0.000812
Pre-consolidation Pressure, $p_c$	= 153 kPa	100 - 200	0.000452
Swelling Index, $C_s$	= 0.1194	200 - 400	0.000299
Recompression Index, $C_r$	$\approx$ 0.1194	400 - 800	0.000178
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/4


**e-logp curve**

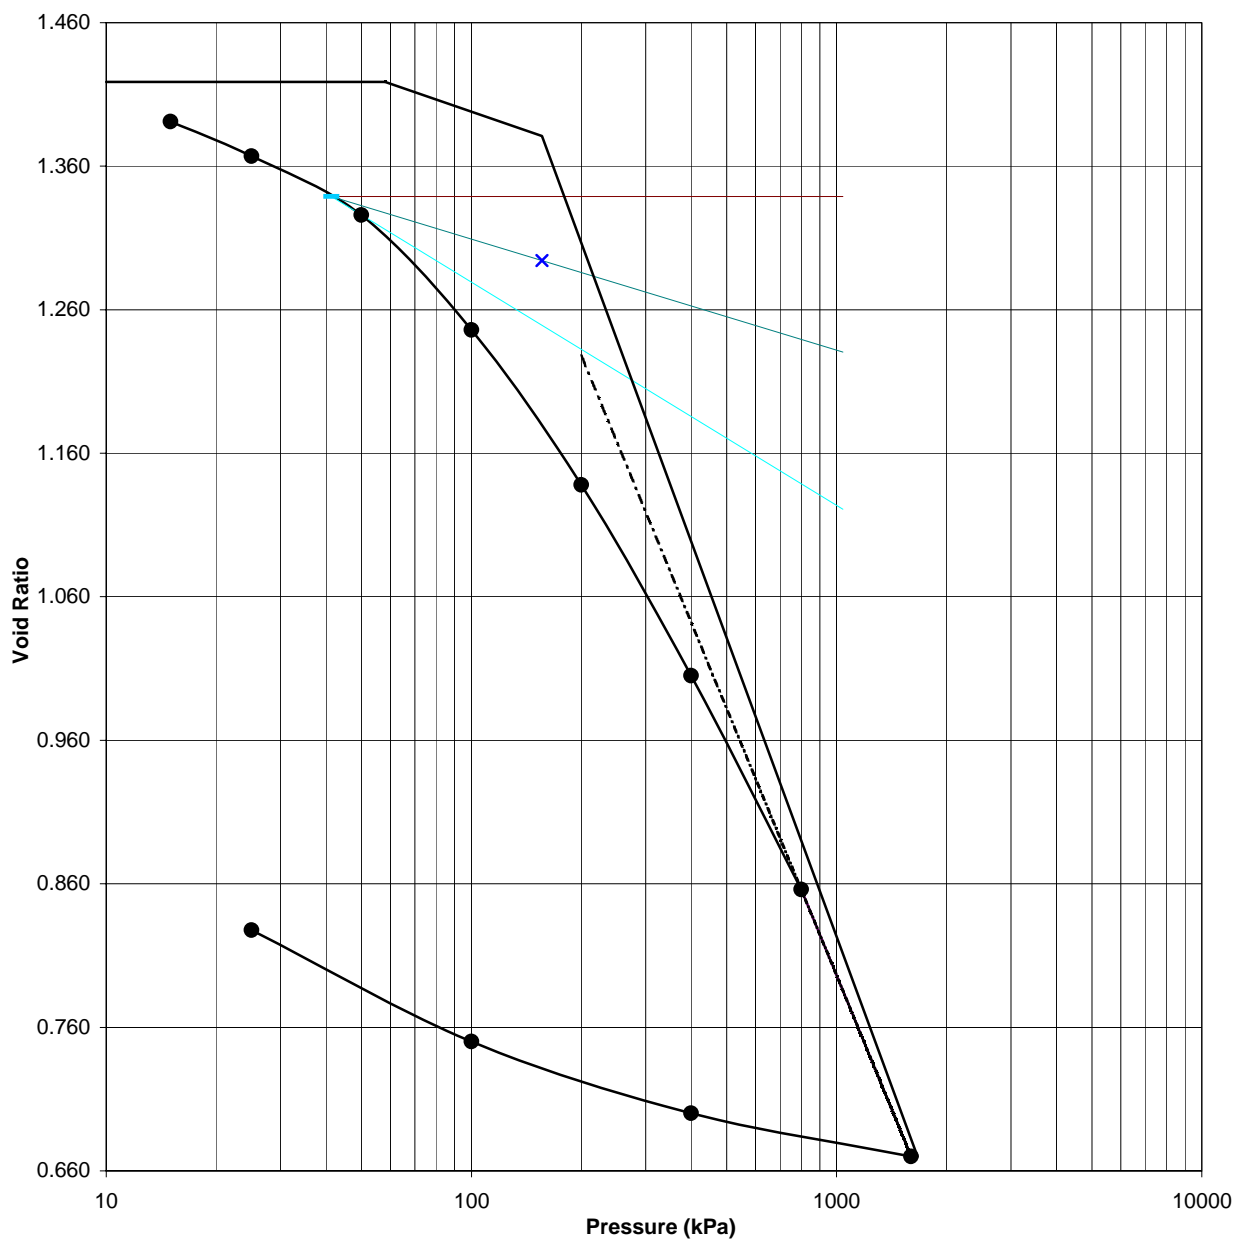

Bore hole No.: BH-1		Depth : 8.00m	
Initial Void Ratio, $e_0$	=	1.4187	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	58 kPa	
Compression Index $C_c$	=	0.6916	0.000679
$C_c/(1+e_0)$	=	0.2859	0.000662
Pre-consolidation Pressure, $p_c$	=	156 kPa	0.000446
Swelling Index, $C_s$	=	0.0874	0.000275
Recompression Index, $C_r$	≈	0.0874	0.000154
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/5




**e-logp curve**

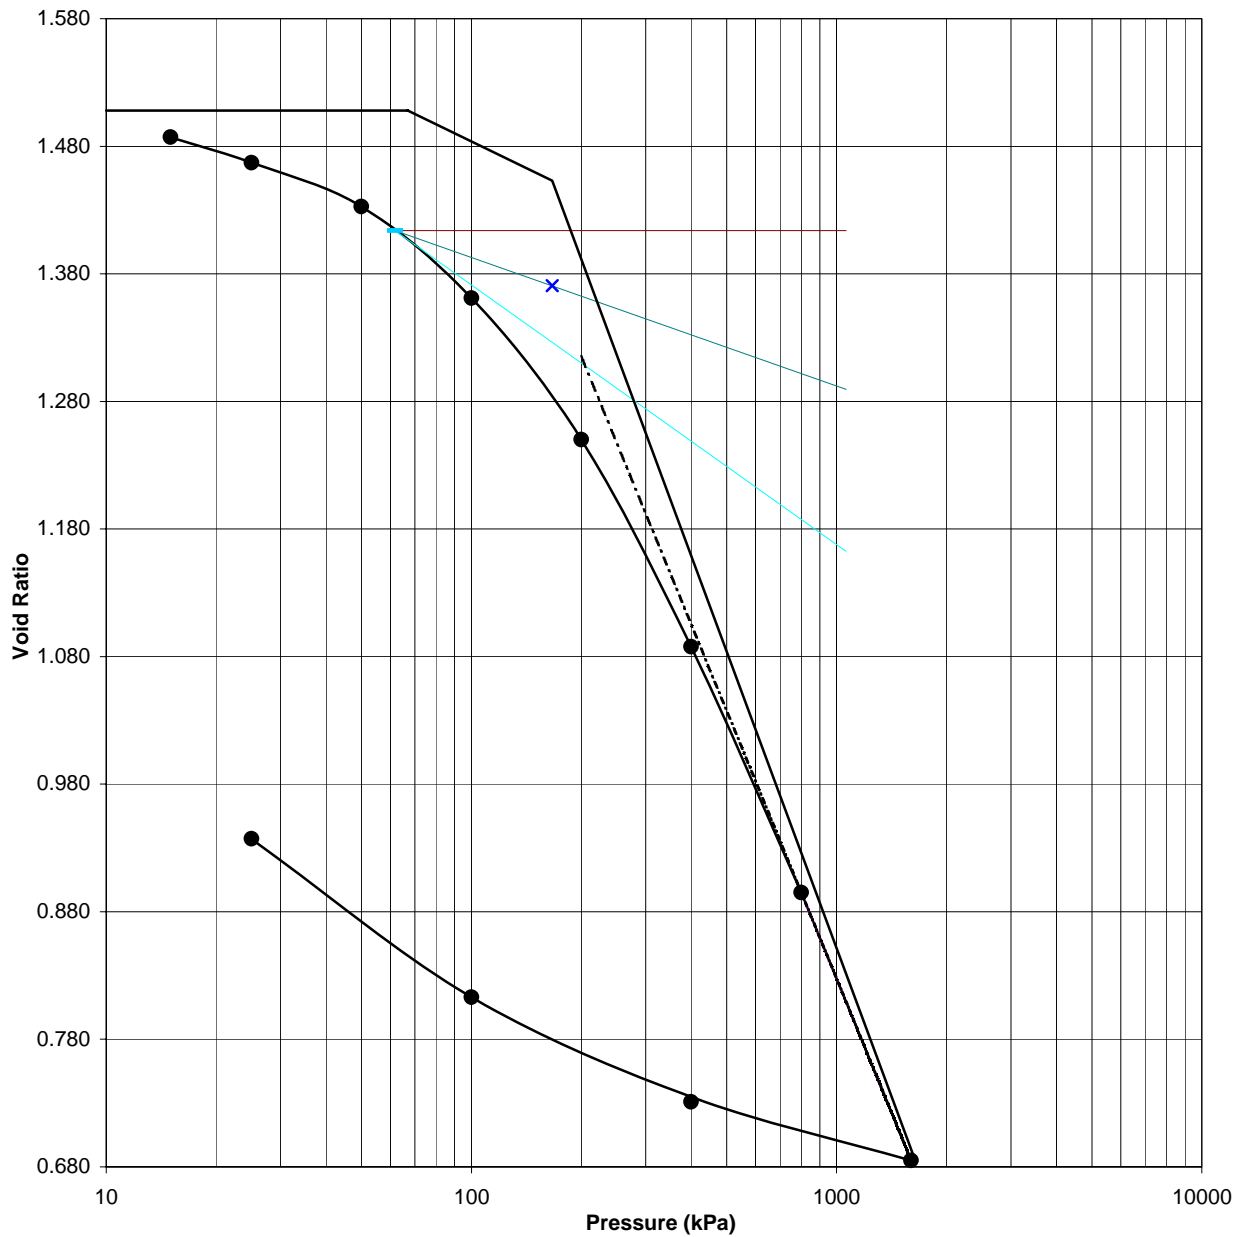


Bore hole No.: BH-1		Depth : 9.50m	
Initial Void Ratio, $e_0$	=	1.5081	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	67 kPa	
Compression Index $C_c$	=	0.7723	25 - 50
$C_c/(1+e_0)$	=	0.3079	50 - 100
Pre-consolidation Pressure, $p_c$	=	166 kPa	100 - 200
Swelling Index, $C_s$	=	0.1395	200 - 400
Recompression Index, $C_r$	$\approx$	0.1395	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/6

**e-logp curve**

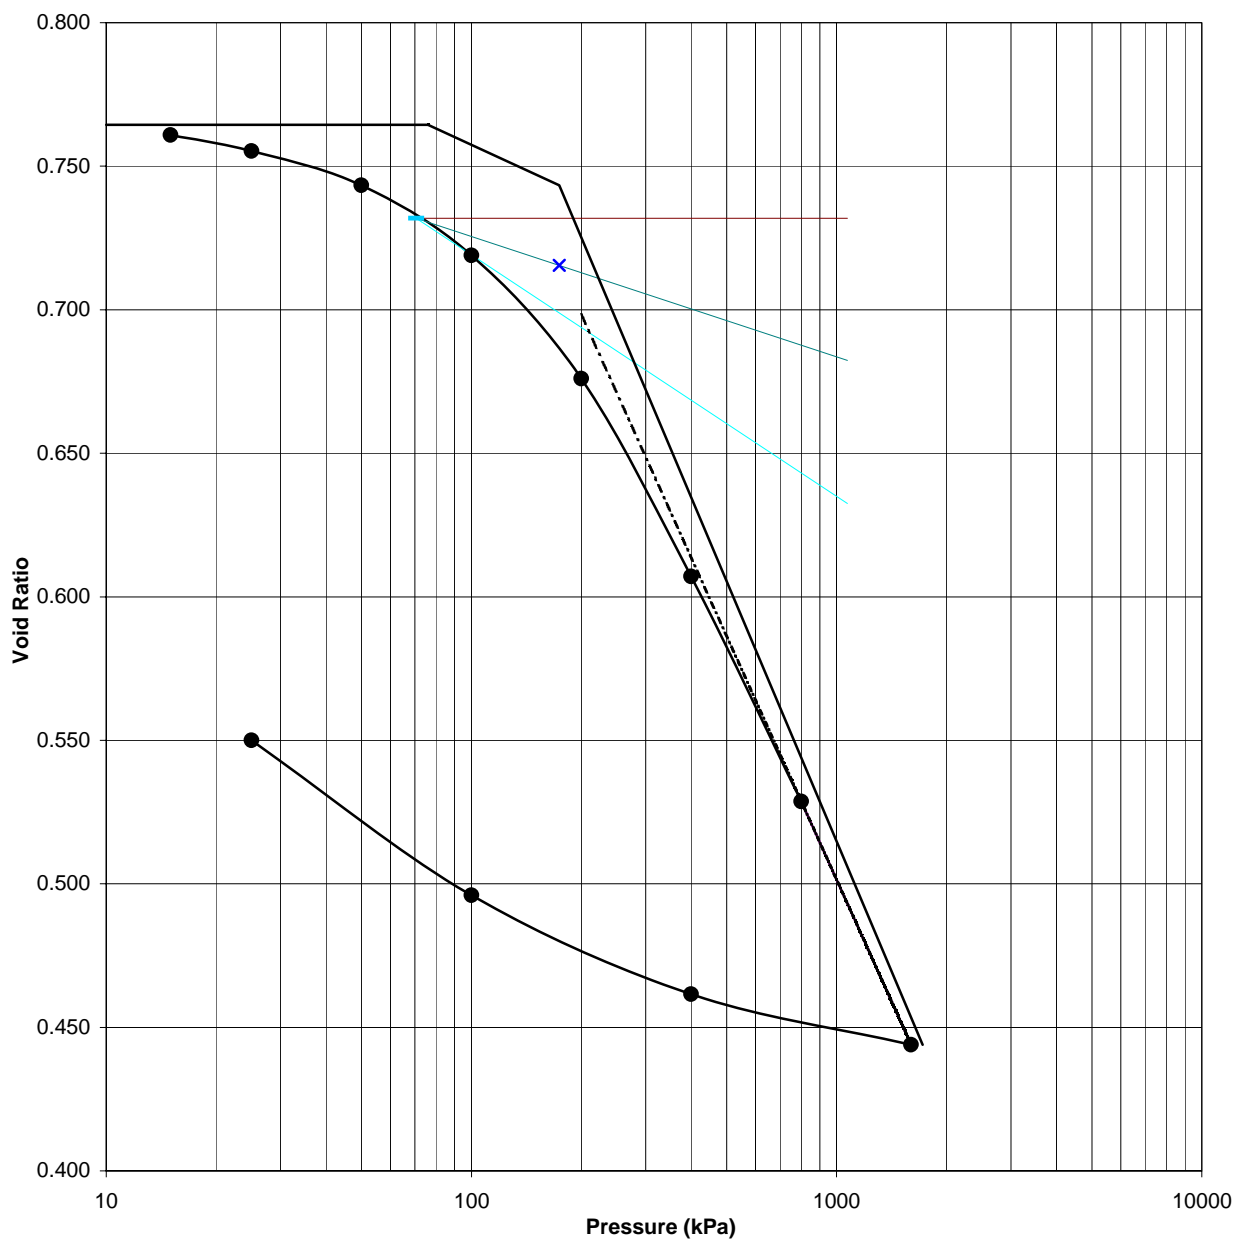


Bore hole No.: BH-1		Depth : 11.00m	
Initial Void Ratio, $e_0$	= 0.7644	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 76 kPa		
Compression Index $C_c$	= 0.3008	25 - 50	0.000270
$C_c/(1+e_0)$	= 0.1705	50 - 100	0.000276
Pre-consolidation Pressure, $p_c$	= 174 kPa	100 - 200	0.000243
Swelling Index, $C_s$	= 0.0587	200 - 400	0.000196
Recompression Index, $C_r$	$\approx$ 0.0587	400 - 800	0.000111
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/7


**e-logp curve**

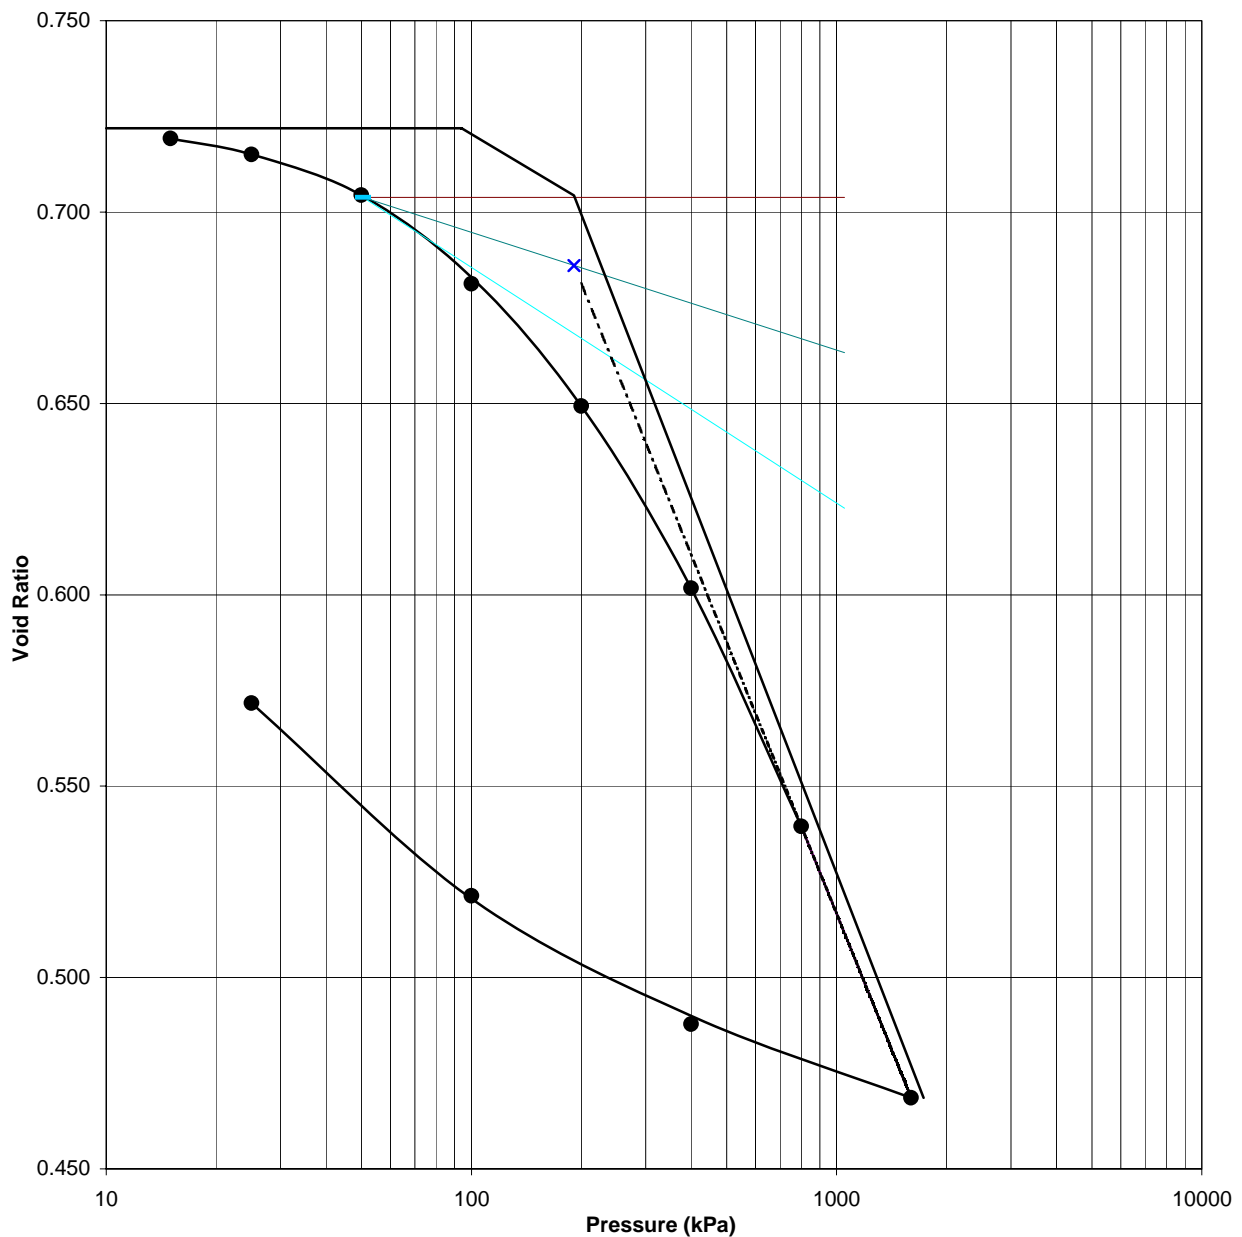

Bore hole No.: BH-1		Depth : 14.00m	
Initial Void Ratio, $e_0$	= 0.7219	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 94 kPa		
Compression Index $C_c$	= 0.2463	25 - 50	0.000246
$C_c/(1+e_0)$	= 0.1431	50 - 100	0.000269
Pre-consolidation Pressure, $p_c$	= 191 kPa	100 - 200	0.000186
Swelling Index, $C_s$	= 0.0571	200 - 400	0.000138
Recompression Index, $C_r$	$\approx$ 0.0571	400 - 800	0.000090
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			<b>Job No. :</b> CCPL/20101211
			<b>Fig. No.</b> G/8

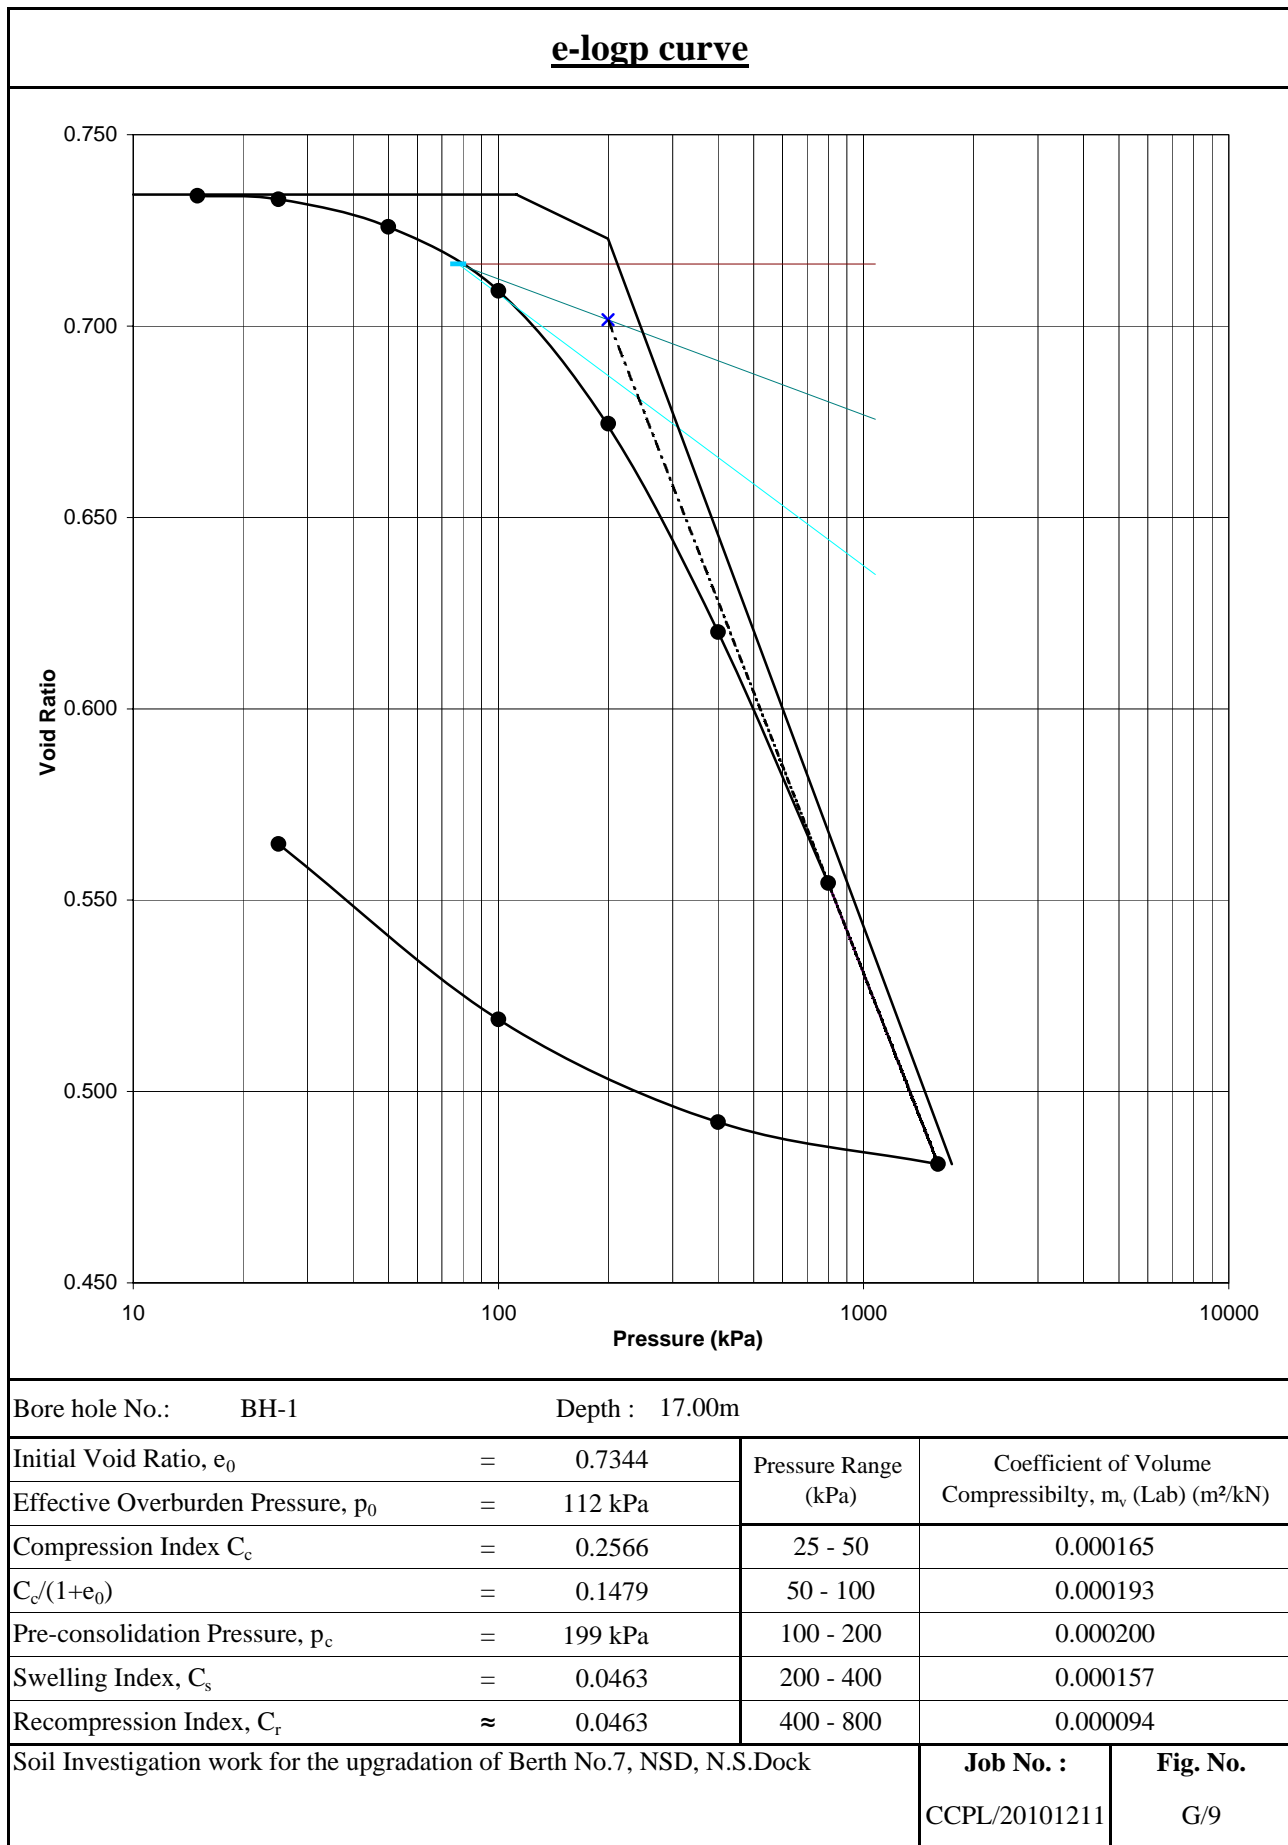


**e-logp curve**

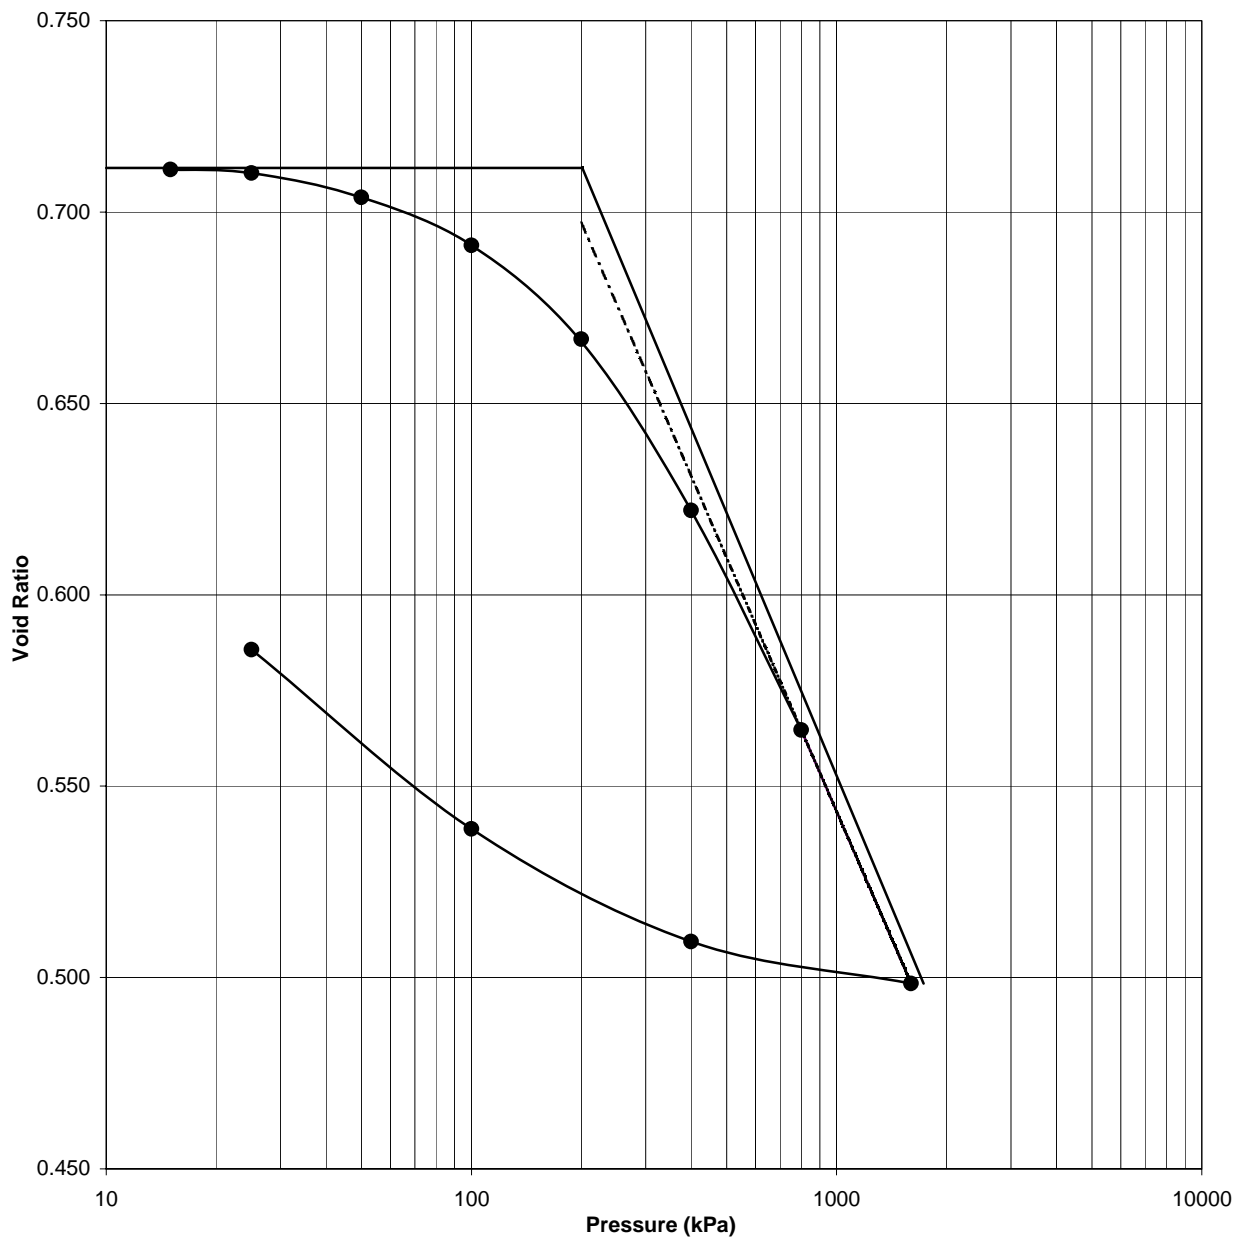


Bore hole No.: BH-1		Depth : 26.00m	
Initial Void Ratio, $e_0$	= 0.7115	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 201 kPa		
Compression Index $C_c$	= 0.2279	25 - 50	0.000149
$C_c/(1+e_0)$	= 0.1332	50 - 100	0.000146
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000143
Swelling Index, $C_s$	= 0.0483	200 - 400	0.000131
Recompression Index, $C_r$	$\approx$ 0.0483	400 - 800	0.000084
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/10

**e-logp curve**

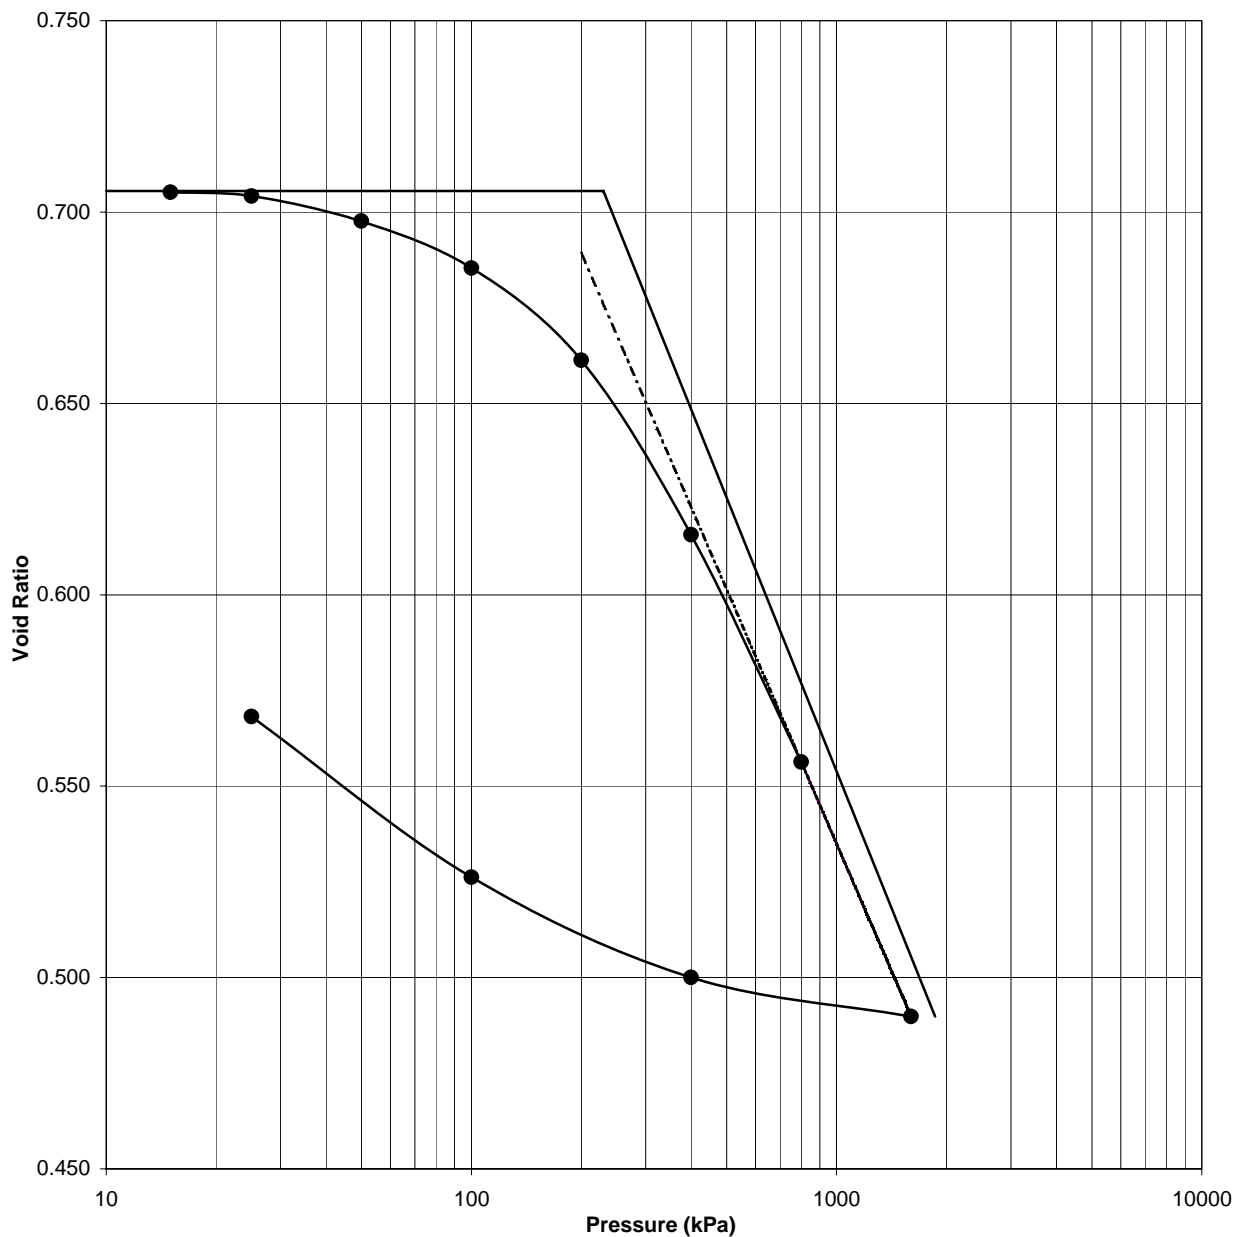


Bore hole No.: BH-1		Depth : 29.00m	
Initial Void Ratio, $e_0$	= 0.7055	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 230 kPa		
Compression Index $C_c$	= 0.2374	25 - 50	0.000154
$C_c/(1+e_0)$	= 0.1392	50 - 100	0.000144
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000141
Swelling Index, $C_s$	= 0.0434	200 - 400	0.000134
Recompression Index, $C_r$	$\approx$ 0.0434	400 - 800	0.000087
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/11

**e-logp curve**

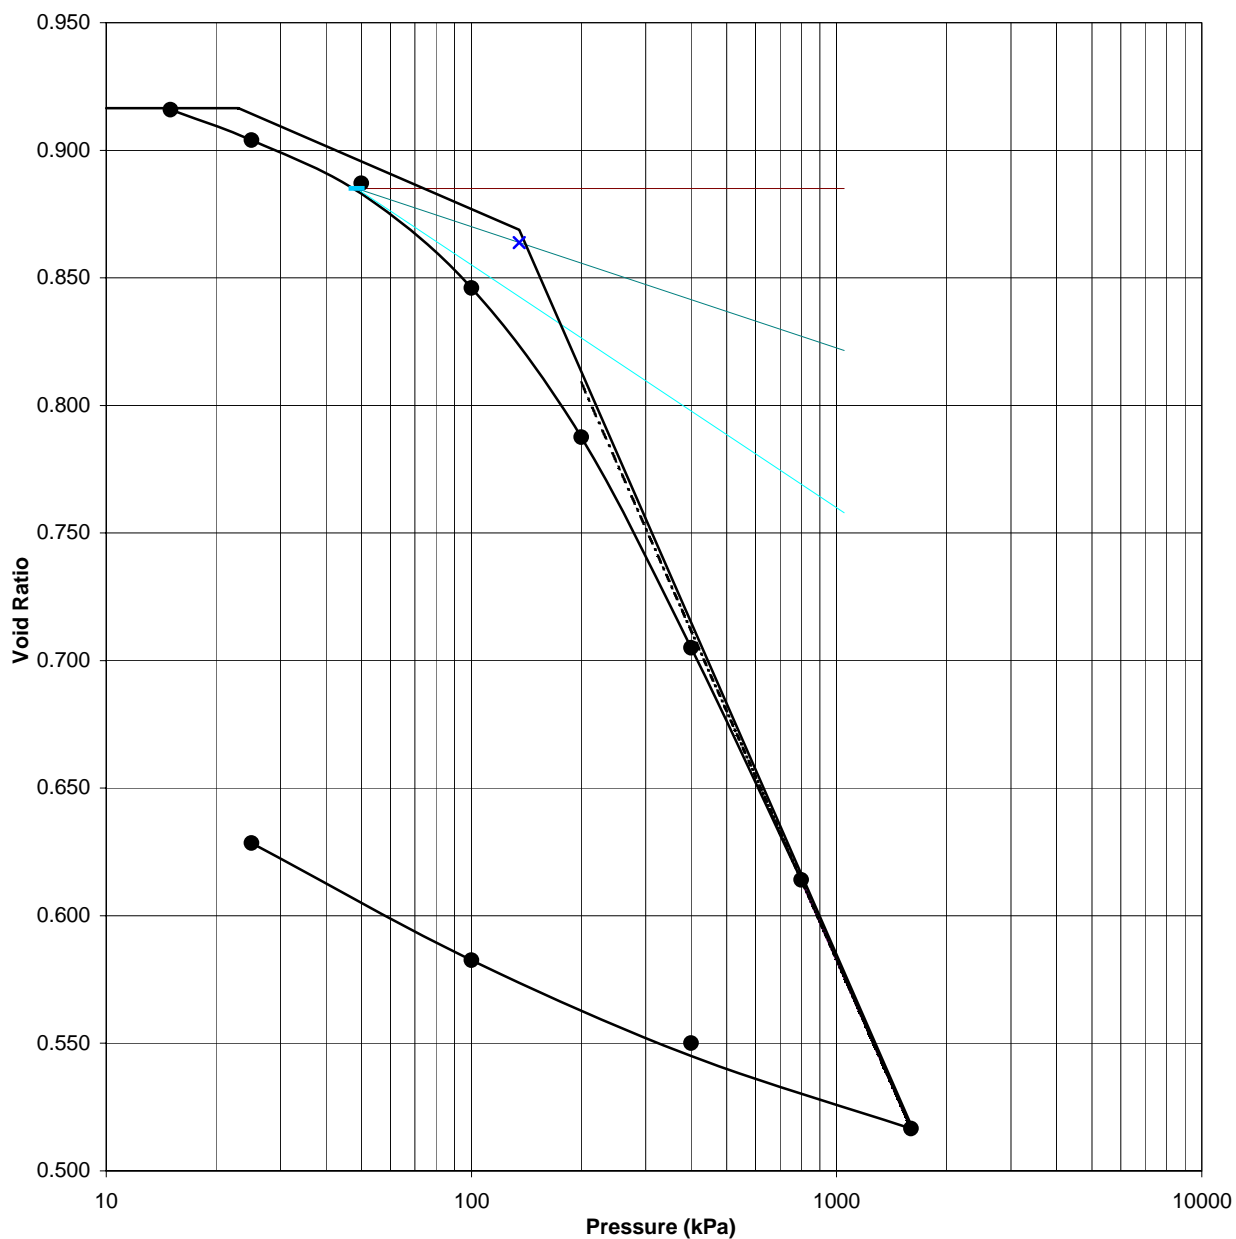

Bore hole No.: BH-2		Depth : 3.00m	
Initial Void Ratio, $e_0$	= 0.9165	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 23 kPa		
Compression Index $C_c$	= 0.3269	25 - 50	0.000354
$C_c/(1+e_0)$	= 0.1706	50 - 100	0.000428
Pre-consolidation Pressure, $p_c$	= 135 kPa	100 - 200	0.000305
Swelling Index, $C_s$	= 0.0619	200 - 400	0.000215
Recompression Index, $C_r$	$\approx$ 0.0619	400 - 800	0.000119
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/12


**e-logp curve**

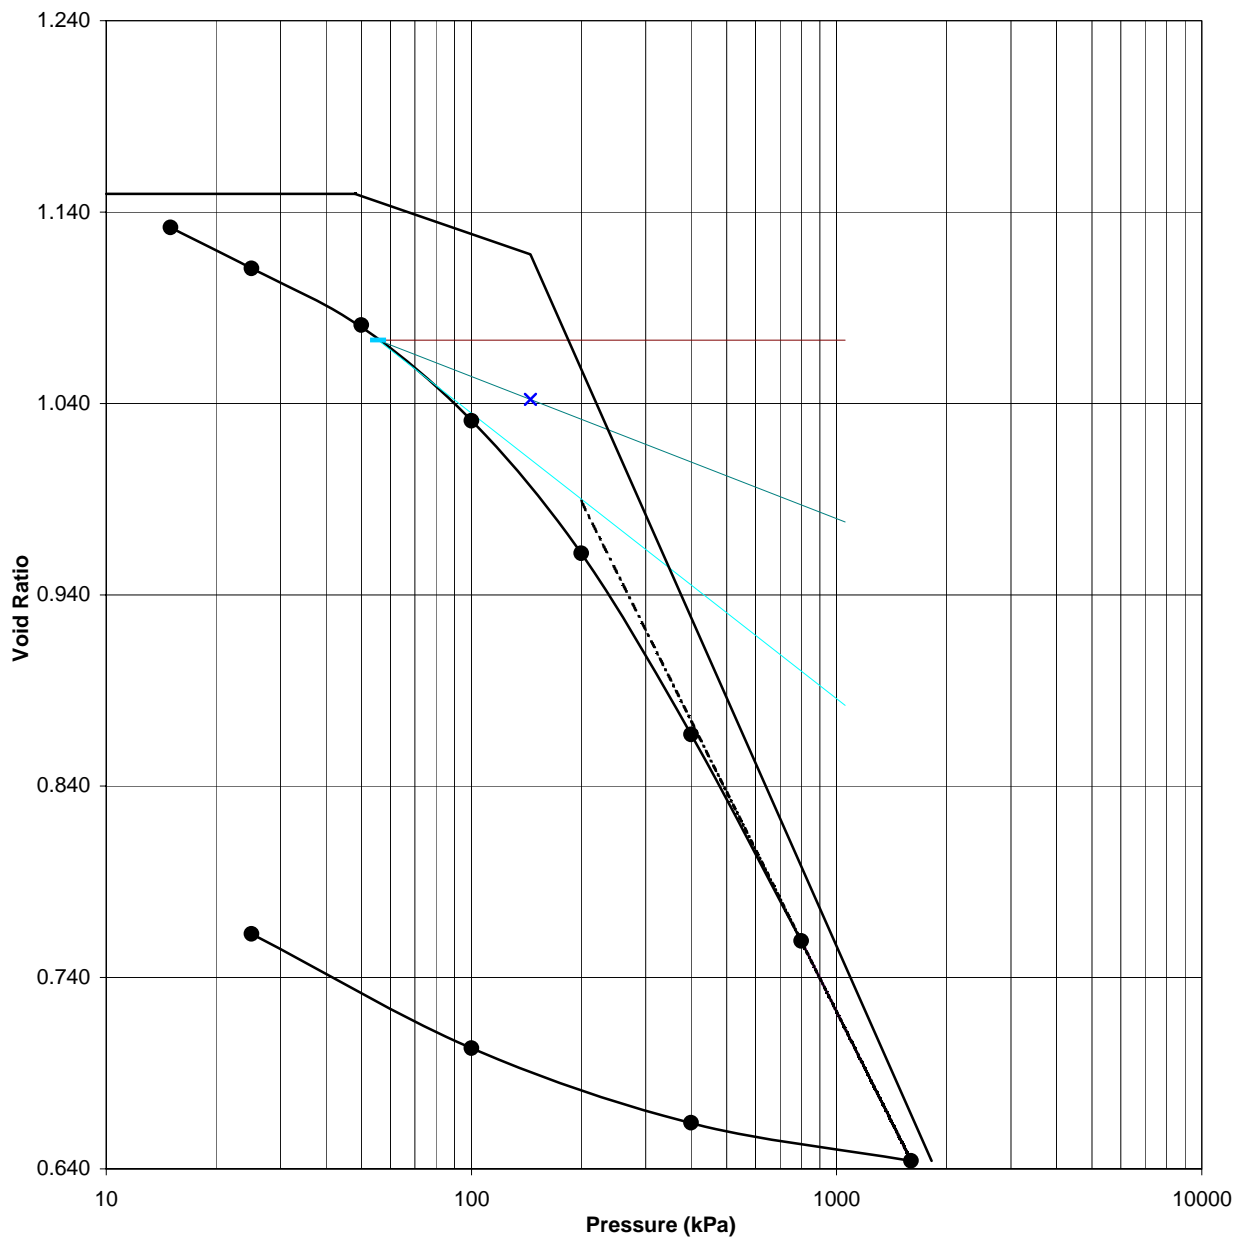


Bore hole No.: BH-2		Depth : 6.00m	
Initial Void Ratio, $e_0$	= 1.1495	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 48 kPa		
Compression Index $C_c$	= 0.4314	25 - 50	0.000549
$C_c/(1+e_0)$	= 0.2007	50 - 100	0.000465
Pre-consolidation Pressure, $p_c$	= 145 kPa	100 - 200	0.000323
Swelling Index, $C_s$	= 0.0657	200 - 400	0.000220
Recompression Index, $C_r$	$\approx$ 0.0657	400 - 800	0.000126
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/13




**e-logp curve**

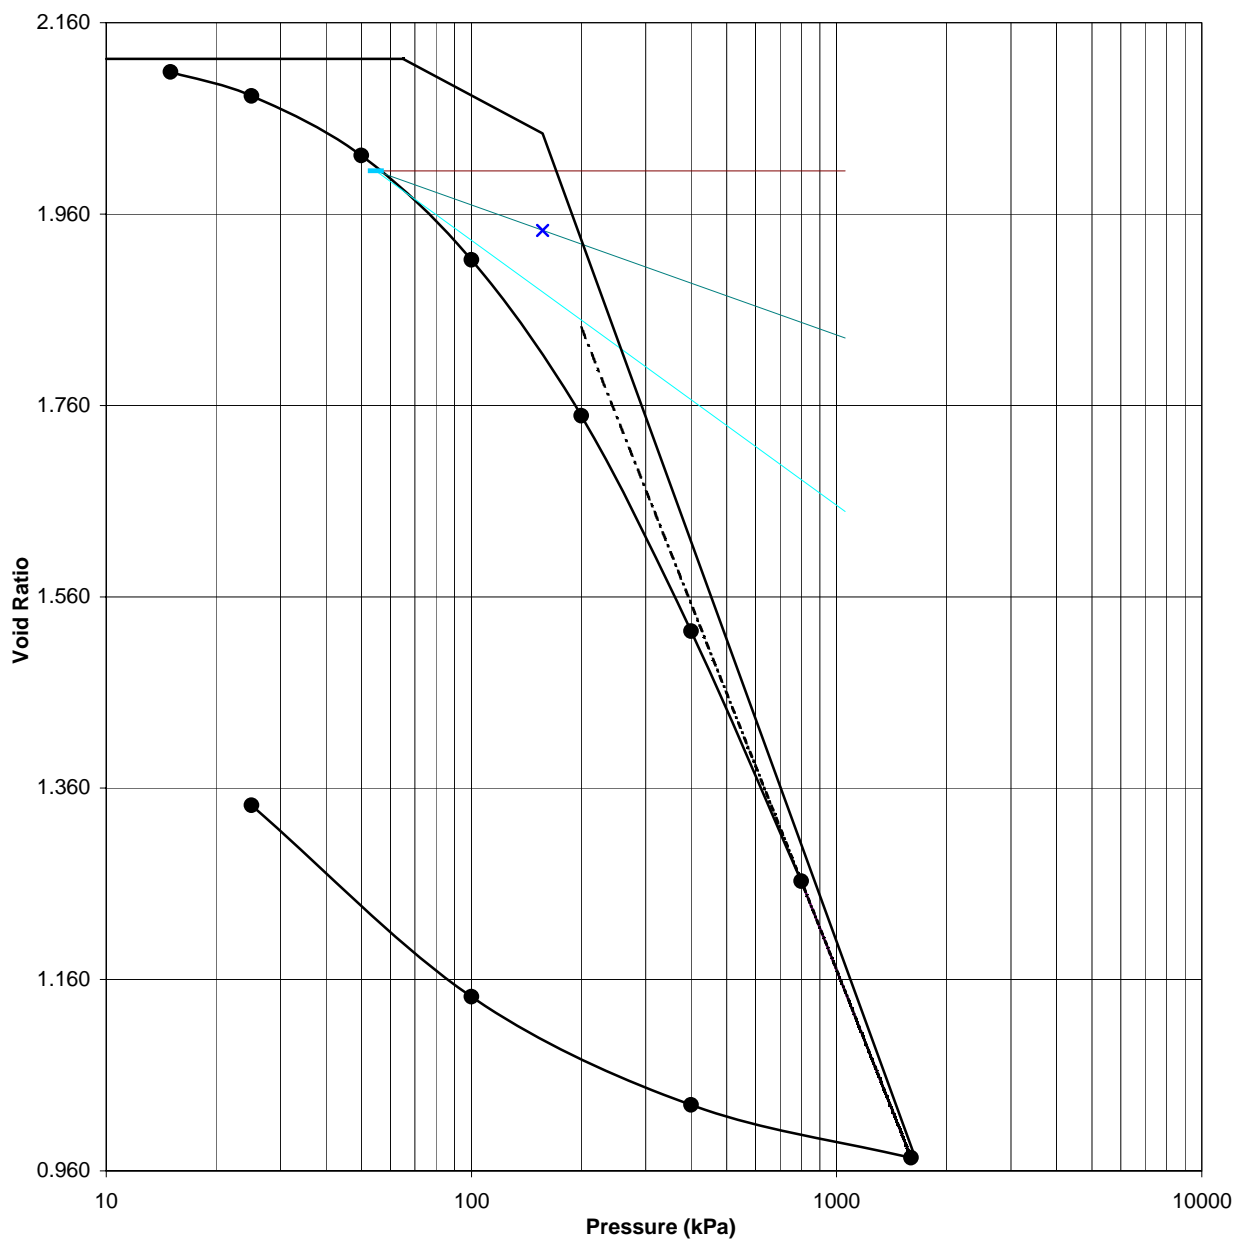

Bore hole No.: BH-2		Depth : 9.00m	
Initial Void Ratio, $e_0$	=	2.1221	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	65 kPa	
Compression Index $C_c$	=	1.0496	0.000797
$C_c/(1+e_0)$	=	0.3362	0.000700
Pre-consolidation Pressure, $p_c$	=	157 kPa	0.000522
Swelling Index, $C_s$	=	0.2039	0.000360
Recompression Index, $C_r$	$\approx$	0.2039	0.000209
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/14

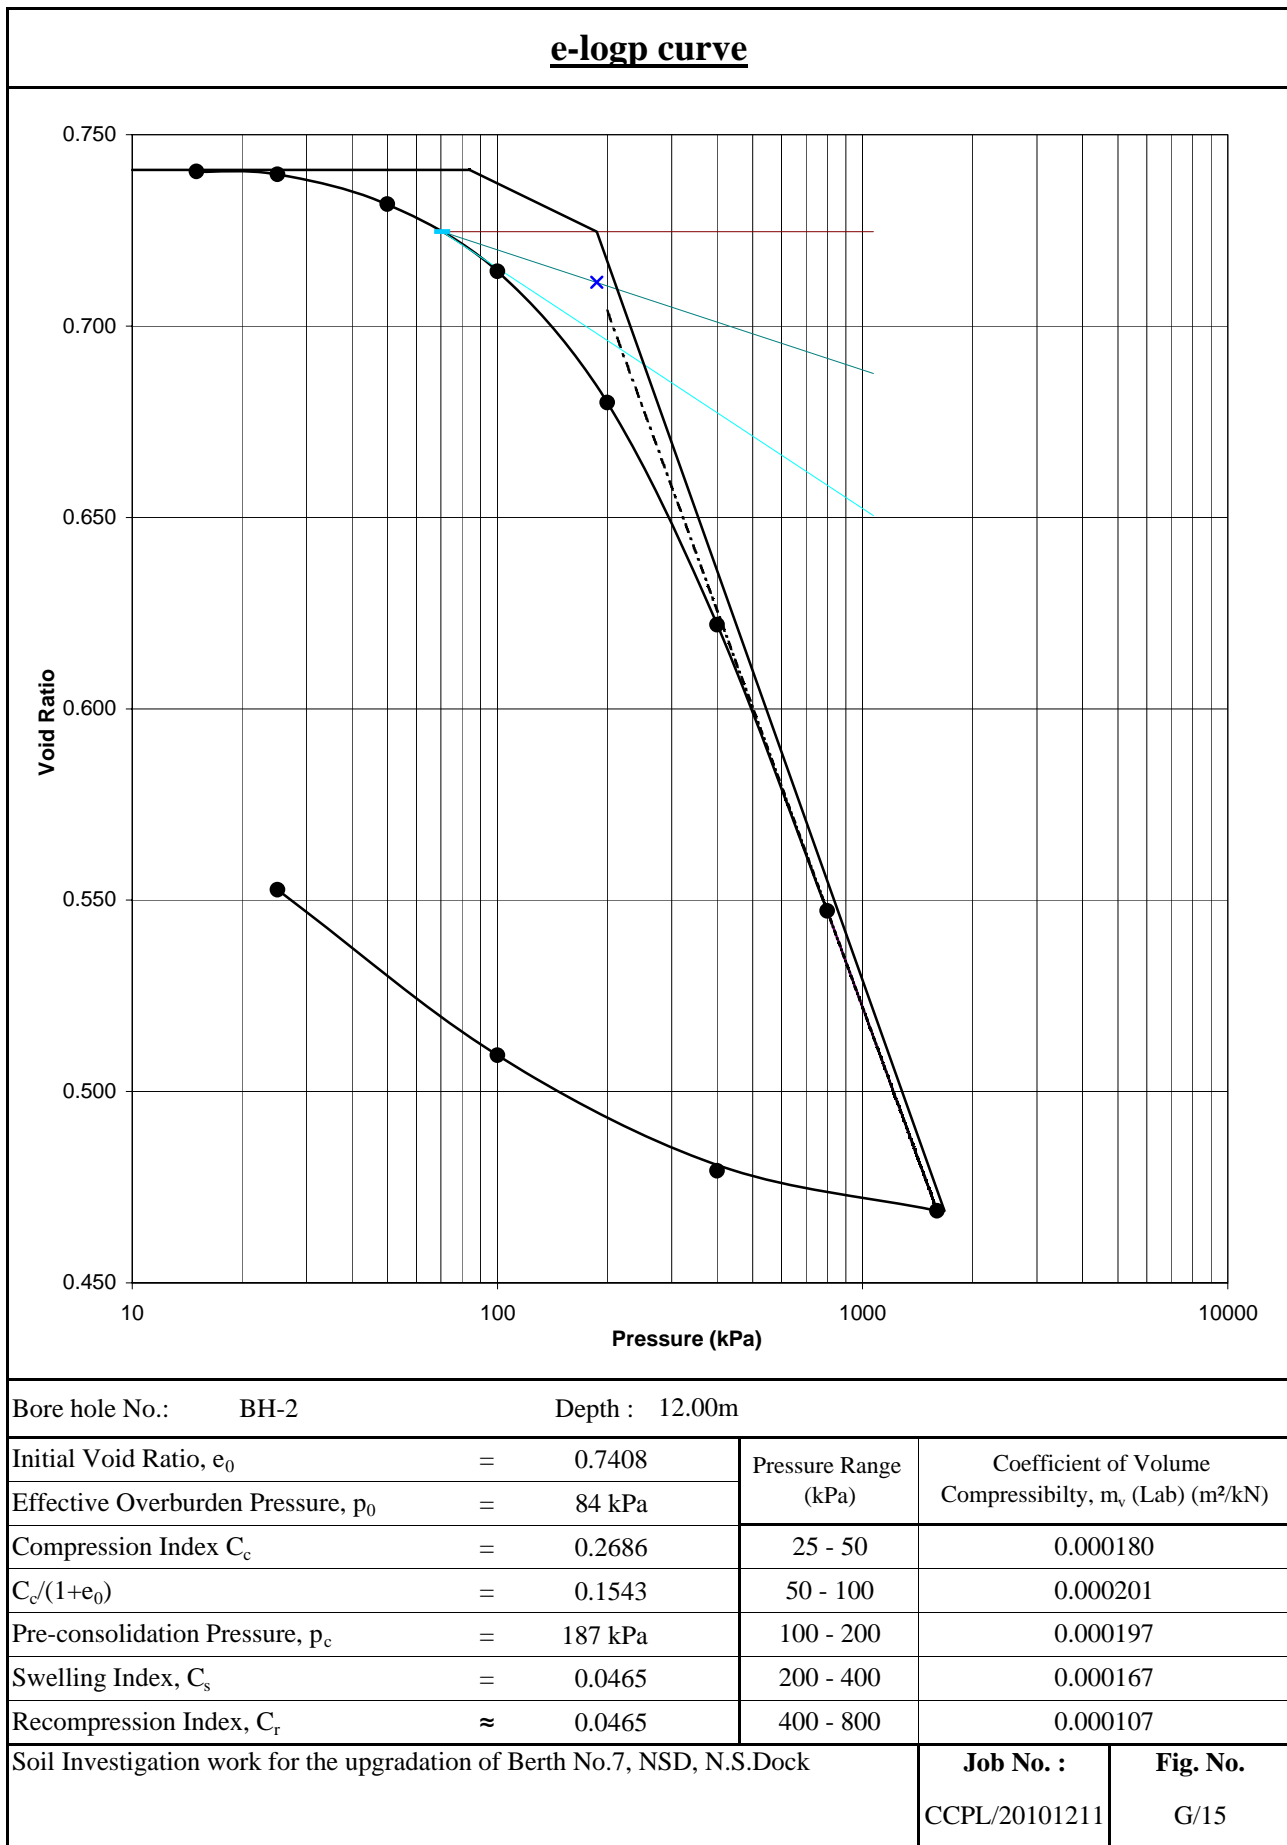


**e-logp curve**

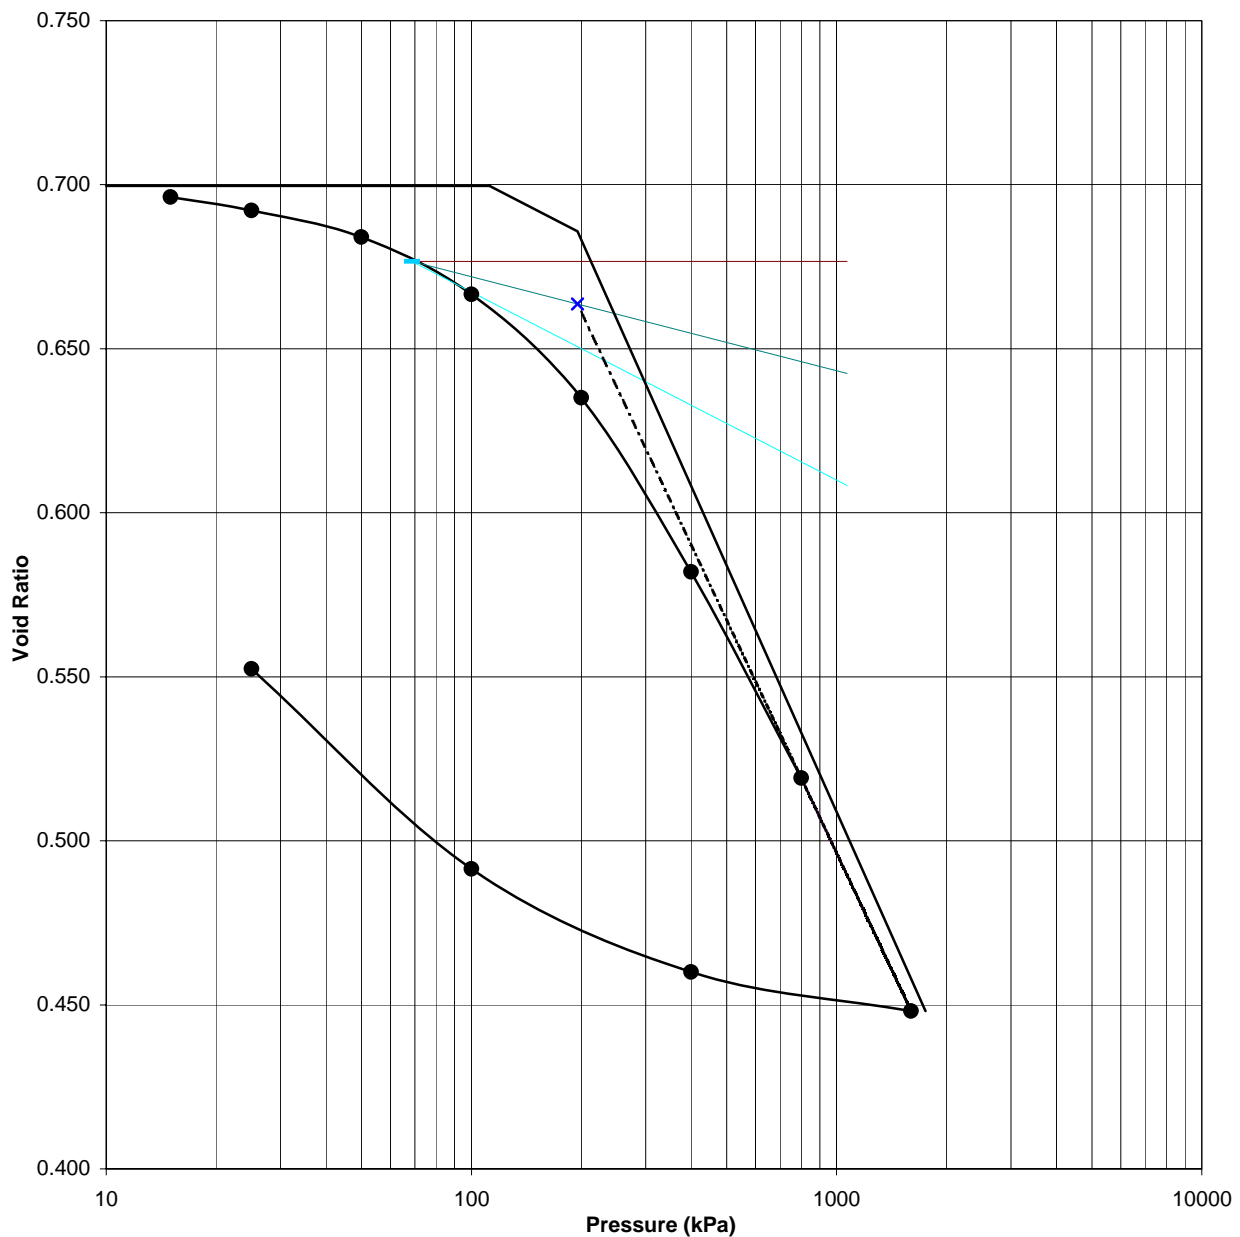


Bore hole No.: BH-2		Depth : 15.00m	
Initial Void Ratio, $e_0$	= 0.6997	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 112 kPa		
Compression Index $C_c$	= 0.2495	25 - 50	0.000188
$C_c/(1+e_0)$	= 0.1468	50 - 100	0.000207
Pre-consolidation Pressure, $p_c$	= 195 kPa	100 - 200	0.000185
Swelling Index, $C_s$	= 0.0578	200 - 400	0.000156
Recompression Index, $C_r$	$\approx$ 0.0578	400 - 800	0.000092
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/16

**e-logp curve**

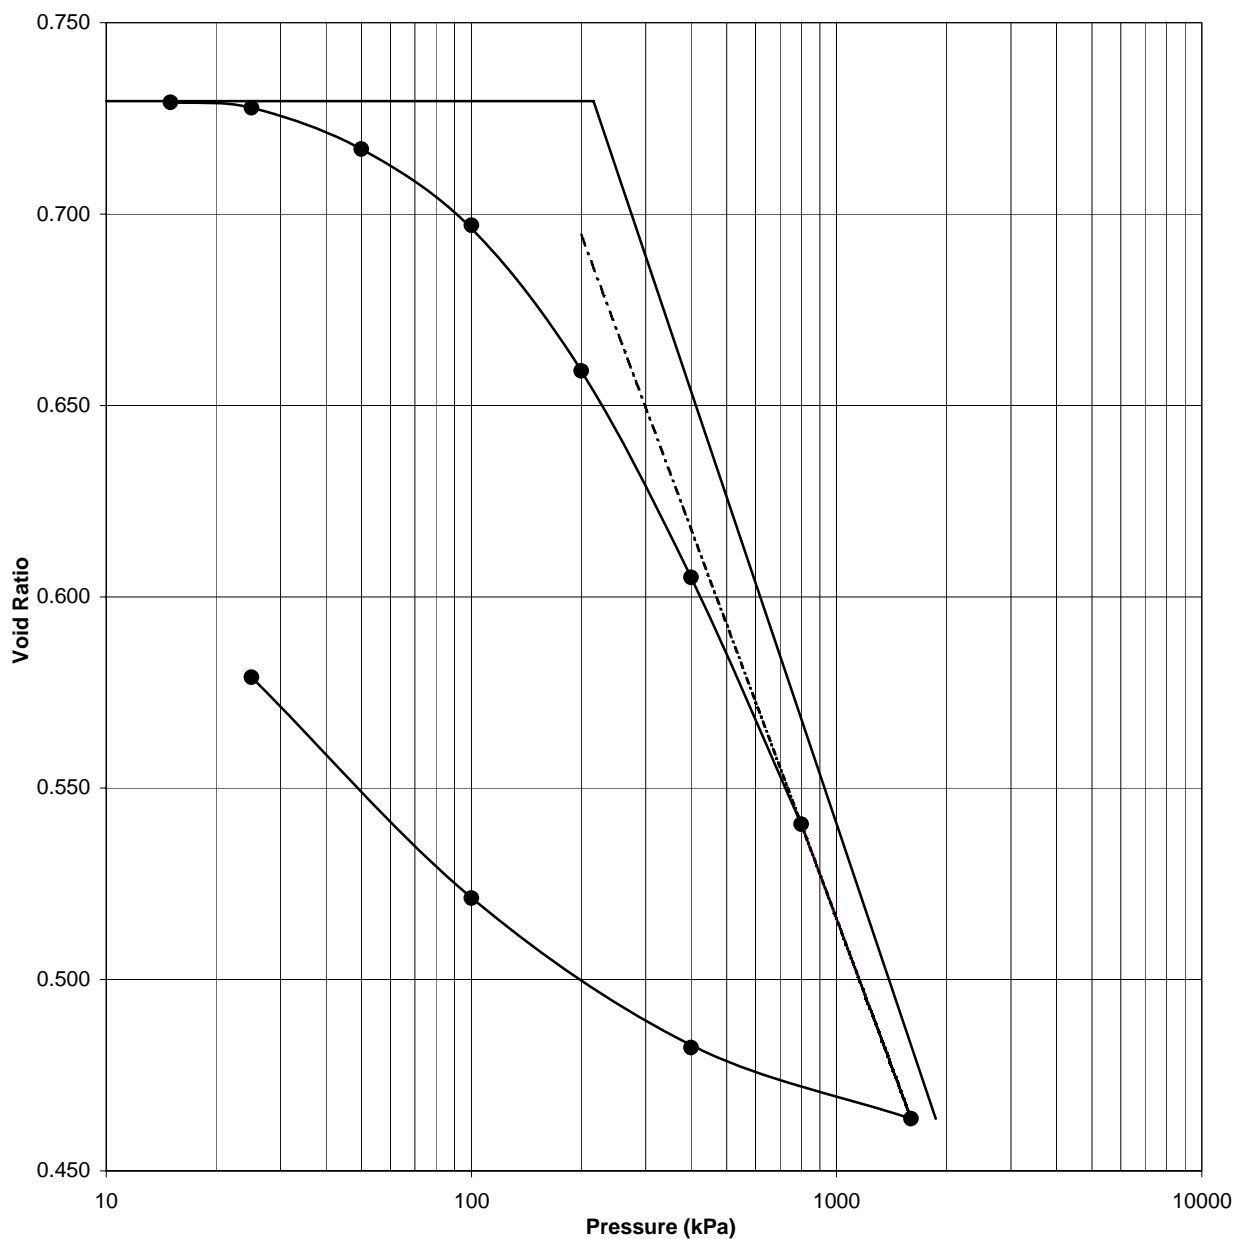


Bore hole No.: BH-2		Depth : 25.50m	
Initial Void Ratio, $e_0$	= 0.7295	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 216 kPa		
Compression Index $C_c$	= 0.2839	25 - 50	0.000250
$C_c/(1+e_0)$	= 0.1641	50 - 100	0.000231
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000220
Swelling Index, $C_s$	= 0.0639	200 - 400	0.000156
Recompression Index, $C_r$	$\approx$ 0.0639	400 - 800	0.000093
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/17

**e-logp curve**

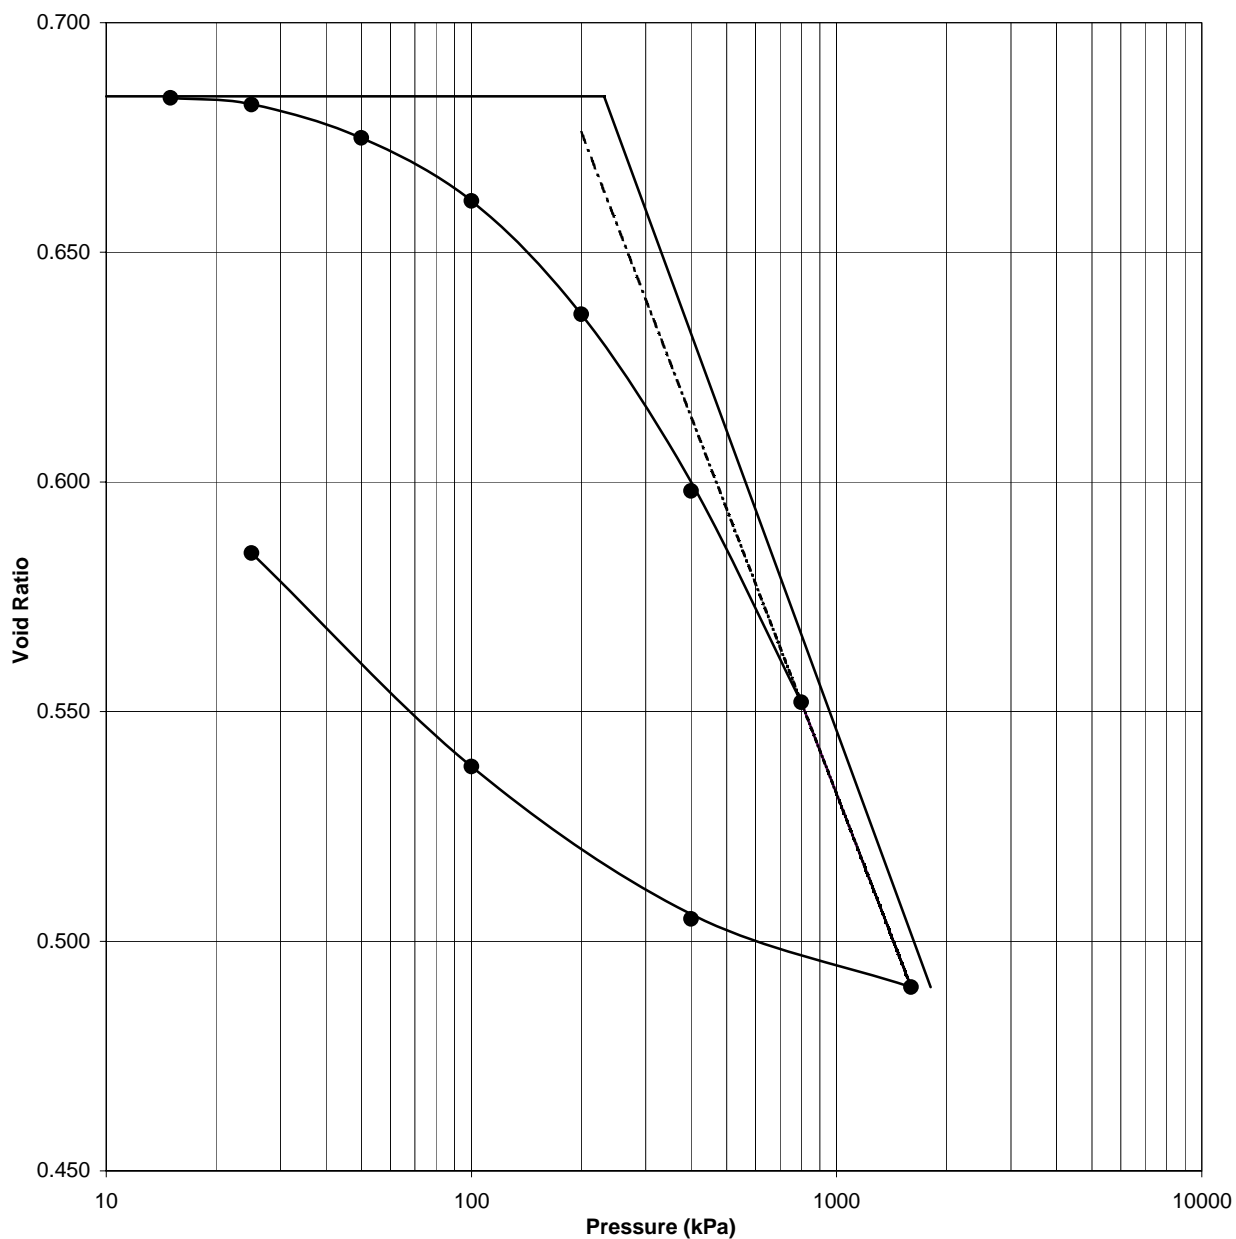


Bore hole No.: BH-2		Depth : 27.00m	
Initial Void Ratio, $e_0$	= 0.6840	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 231 kPa		
Compression Index $C_c$	= 0.2171	25 - 50	0.000172
$C_c/(1+e_0)$	= 0.1289	50 - 100	0.000163
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000146
Swelling Index, $C_s$	= 0.0523	200 - 400	0.000114
Recompression Index, $C_r$	$\approx$ 0.0523	400 - 800	0.000068
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/18

**e-logp curve**

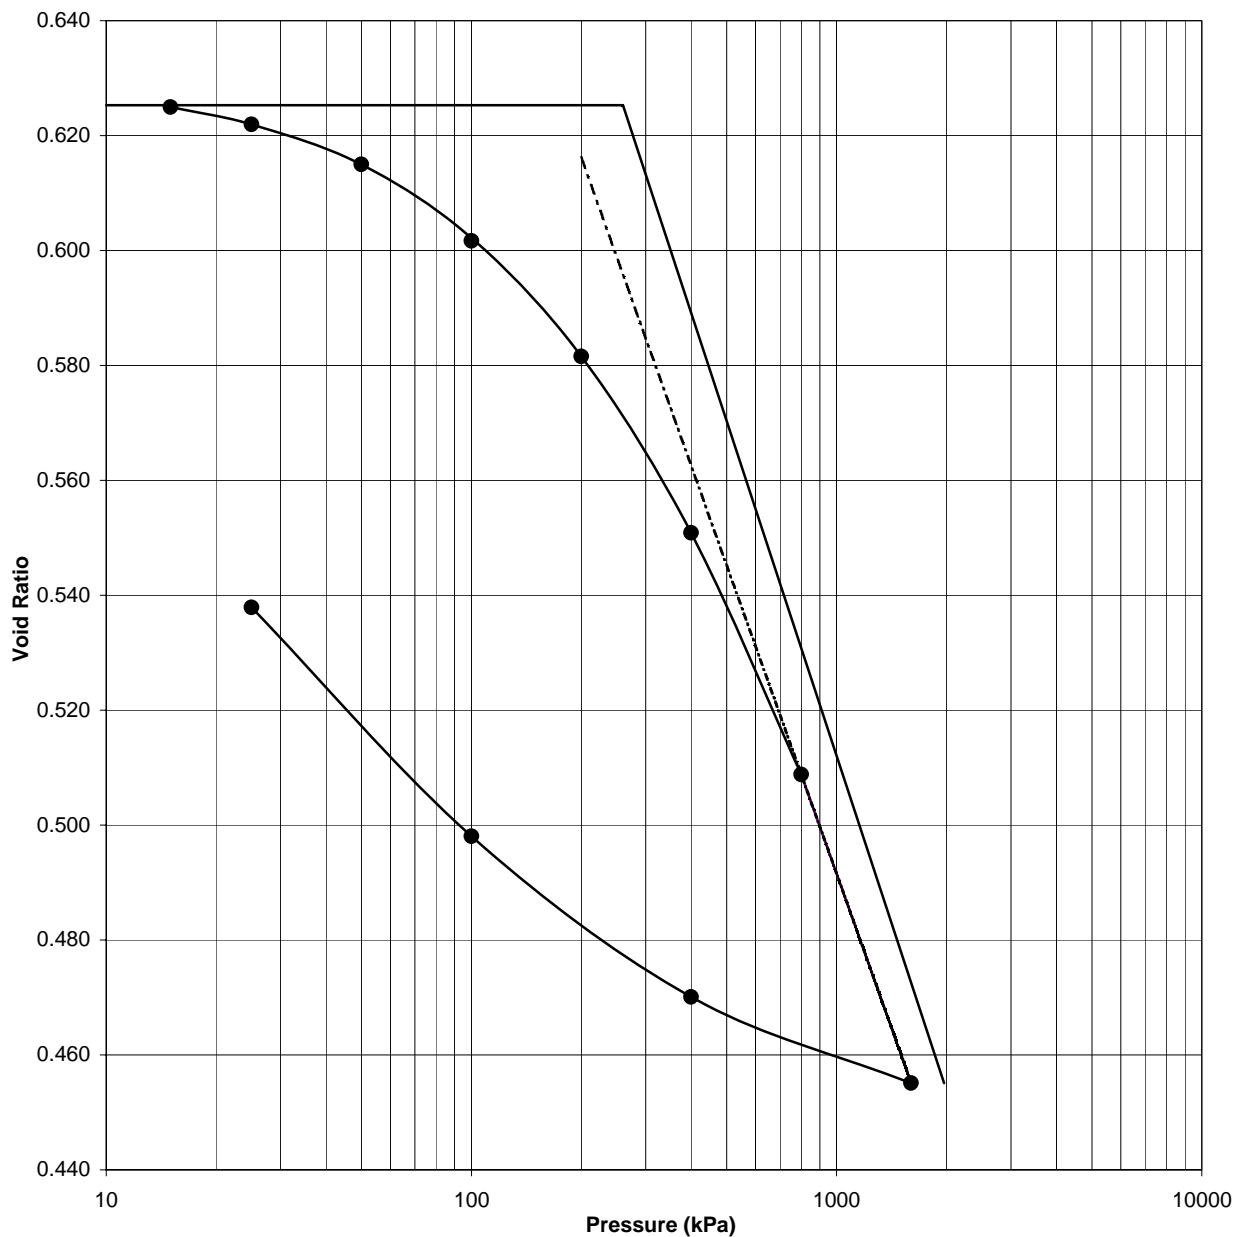


Bore hole No.: BH-2		Depth : 30.00m	
Initial Void Ratio, $e_0$	= 0.6253	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 260 kPa		
Compression Index $C_c$	= 0.1935	25 - 50	0.000172
$C_c/(1+e_0)$	= 0.1191	50 - 100	0.000164
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000124
Swelling Index, $C_s$	= 0.0458	200 - 400	0.000095
Recompression Index, $C_r$	$\approx$ 0.0458	400 - 800	0.000065
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/19

**e-logp curve**

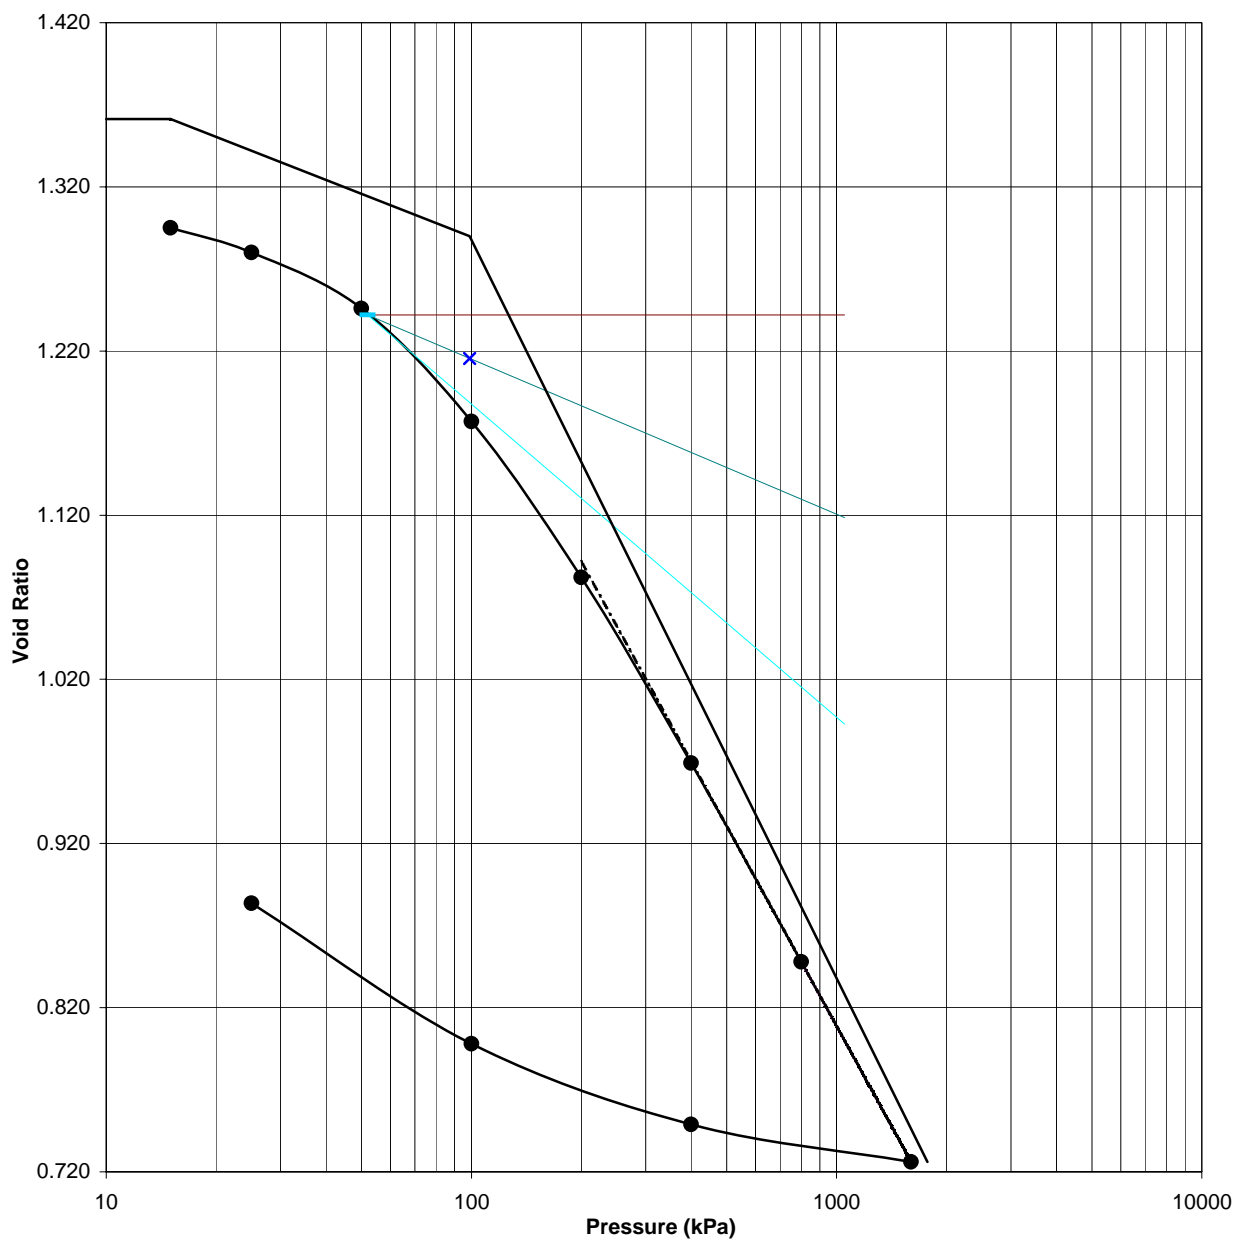

Bore hole No.: BH-3		Depth : 2.50m	
Initial Void Ratio, $e_0$	= 1.3613	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 15 kPa		
Compression Index $C_c$	= 0.4496	25 - 50	0.000576
$C_c/(1+e_0)$	= 0.1904	50 - 100	0.000584
Pre-consolidation Pressure, $p_c$	= 99 kPa	100 - 200	0.000402
Swelling Index, $C_s$	= 0.0872	200 - 400	0.000239
Recompression Index, $C_r$	≈ 0.0872	400 - 800	0.000128
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/20


**e-logp curve**

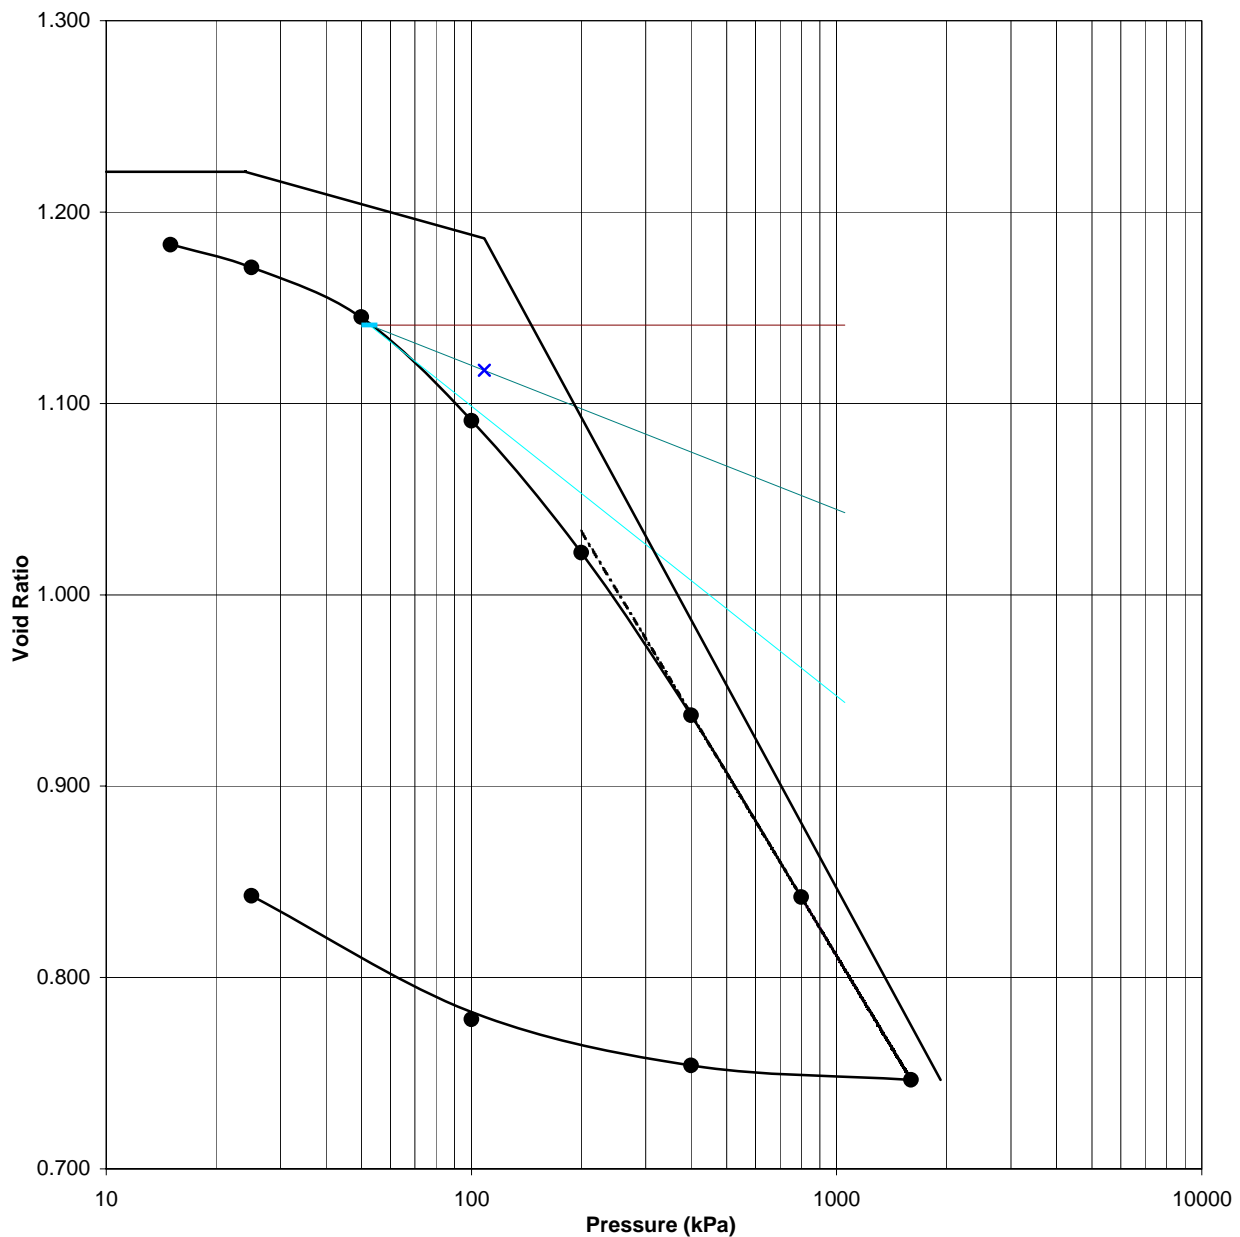

Bore hole No.: BH-3		Depth : 4.00m	
Initial Void Ratio, $e_0$	=	1.2211	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	24 kPa	
Compression Index $C_c$	=	0.3520	0.000468
$C_c/(1+e_0)$	=	0.1585	0.000487
Pre-consolidation Pressure, $p_c$	=	108 kPa	0.000311
Swelling Index, $C_s$	=	0.0533	0.000191
Recompression Index, $C_r$	≈	0.0533	0.000107
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/21




**e-logp curve**

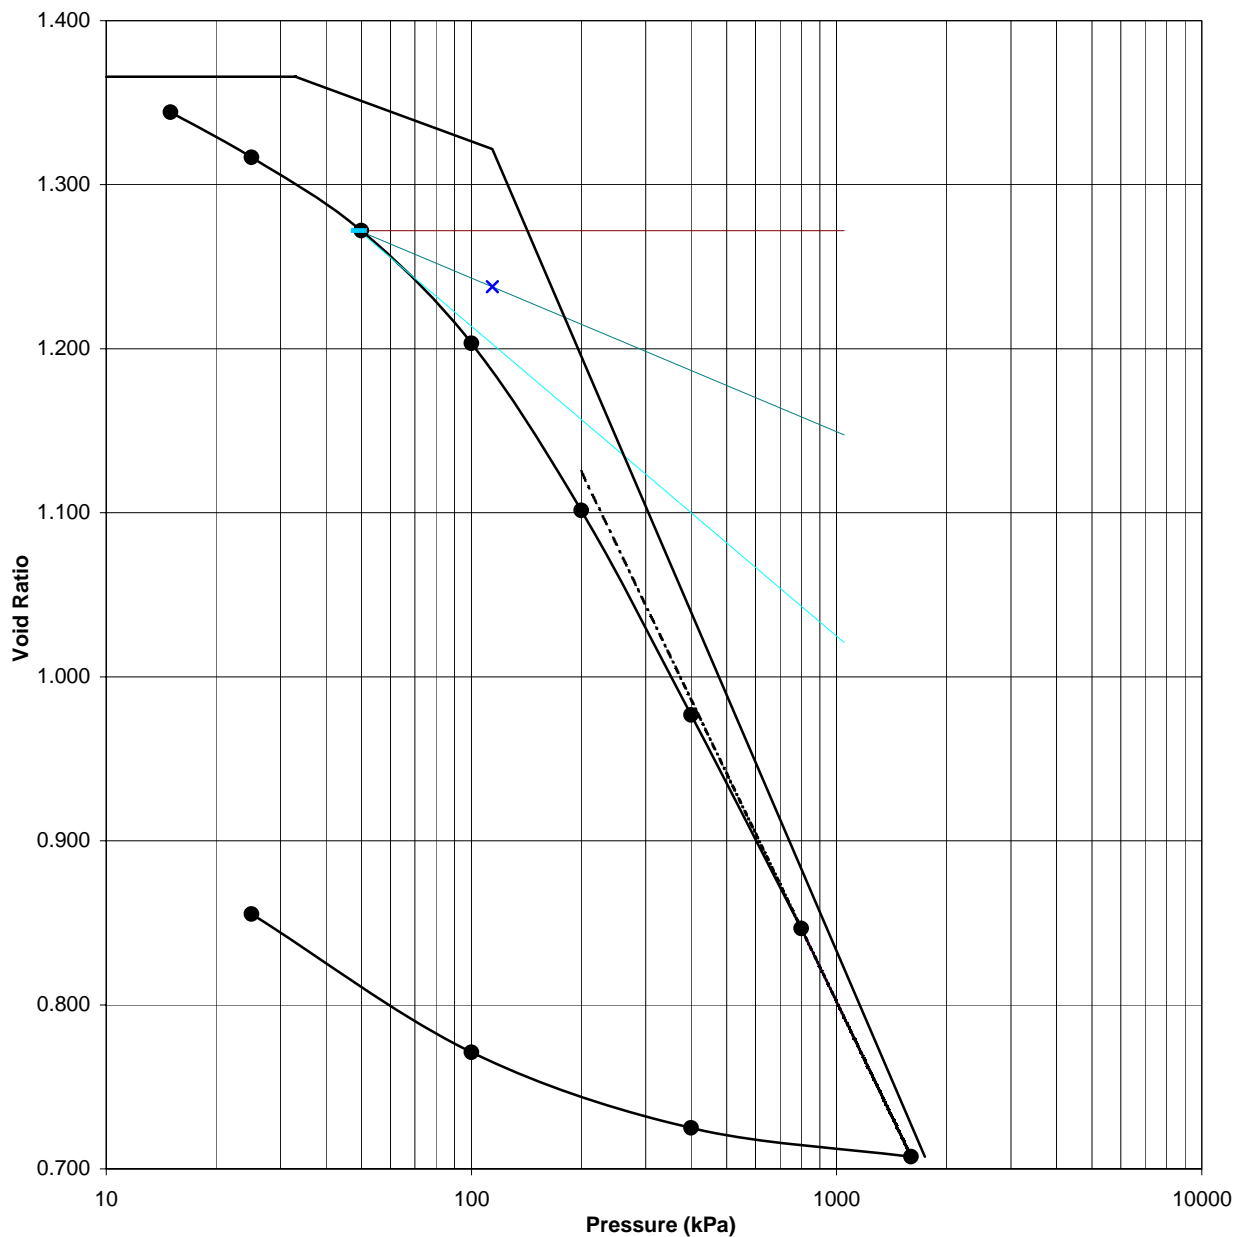


Bore hole No.: BH-3		Depth : 5.50m	
Initial Void Ratio, $e_0$	=	1.3658	Pressure Range (kPa)
Effective Overburden Pressure, $p_0$	=	33 kPa	
Compression Index $C_c$	=	0.5185	25 - 50
$C_c/(1+e_0)$	=	0.2191	50 - 100
Pre-consolidation Pressure, $p_c$	=	114 kPa	100 - 200
Swelling Index, $C_s$	=	0.0819	200 - 400
Recompression Index, $C_r$	≈	0.0819	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/22

**e-logp curve**

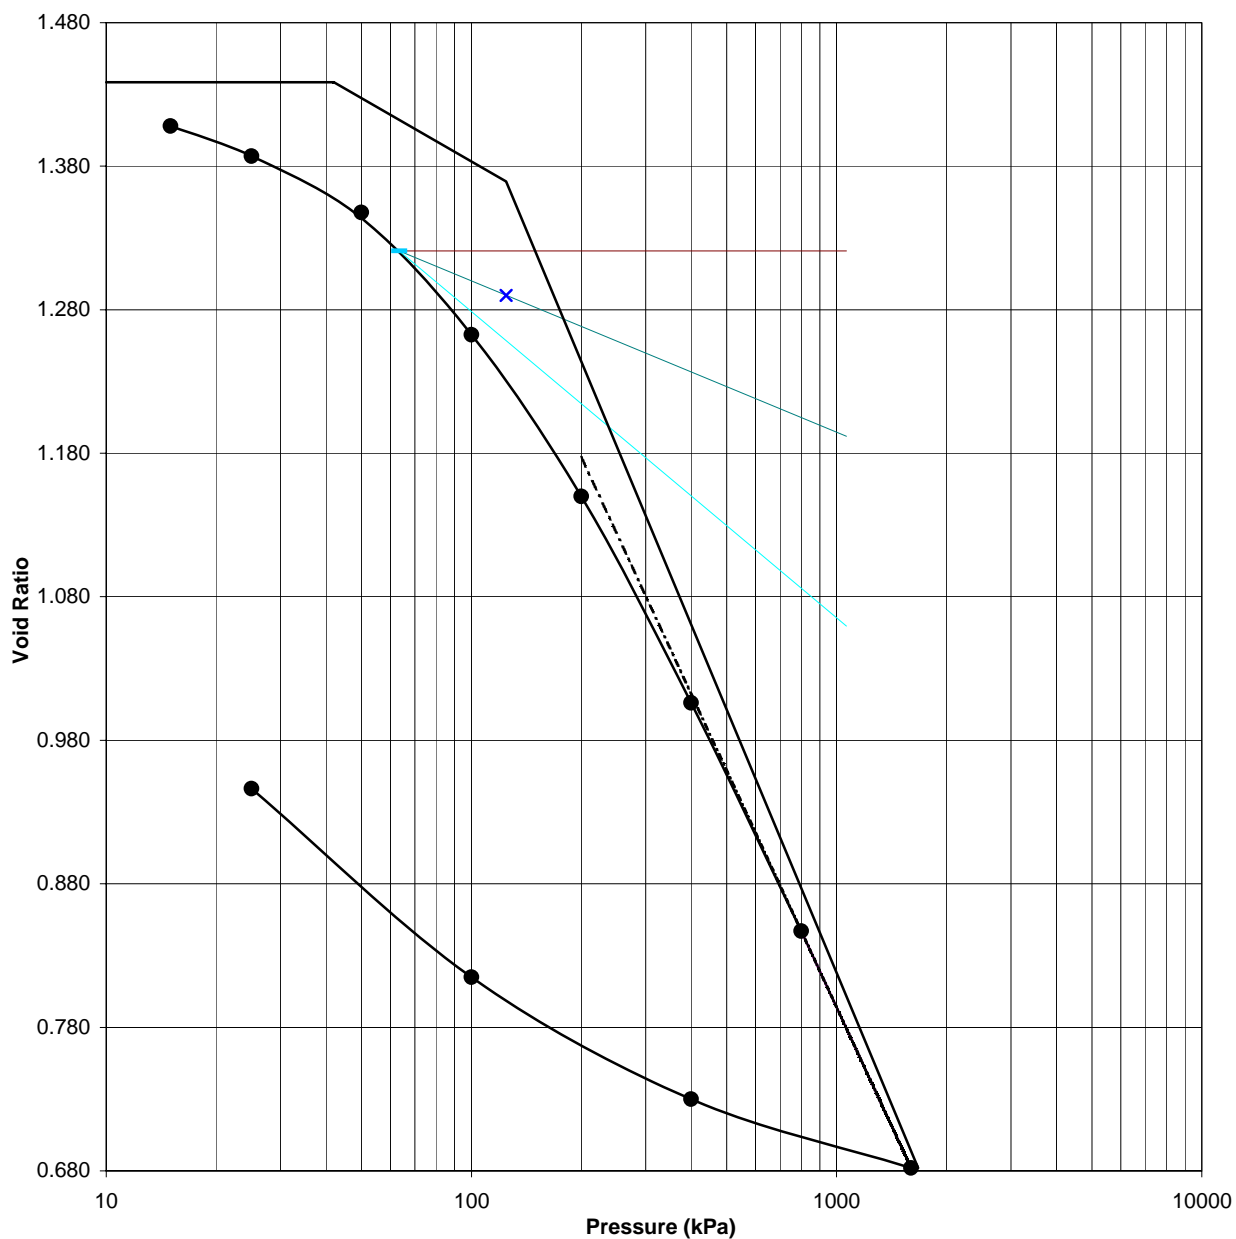


Bore hole No.: BH-3		Depth : 7.00m	
Initial Void Ratio, $e_0$	= 1.4385	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 42 kPa		
Compression Index $C_c$	= 0.6093	25 - 50	0.000646
$C_c/(1+e_0)$	= 0.2499	50 - 100	0.000699
Pre-consolidation Pressure, $p_c$	= 124 kPa	100 - 200	0.000462
Swelling Index, $C_s$	= 0.1464	200 - 400	0.000295
Recompression Index, $C_r$	≈ 0.1464	400 - 800	0.000163
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/23

**e-logp curve**

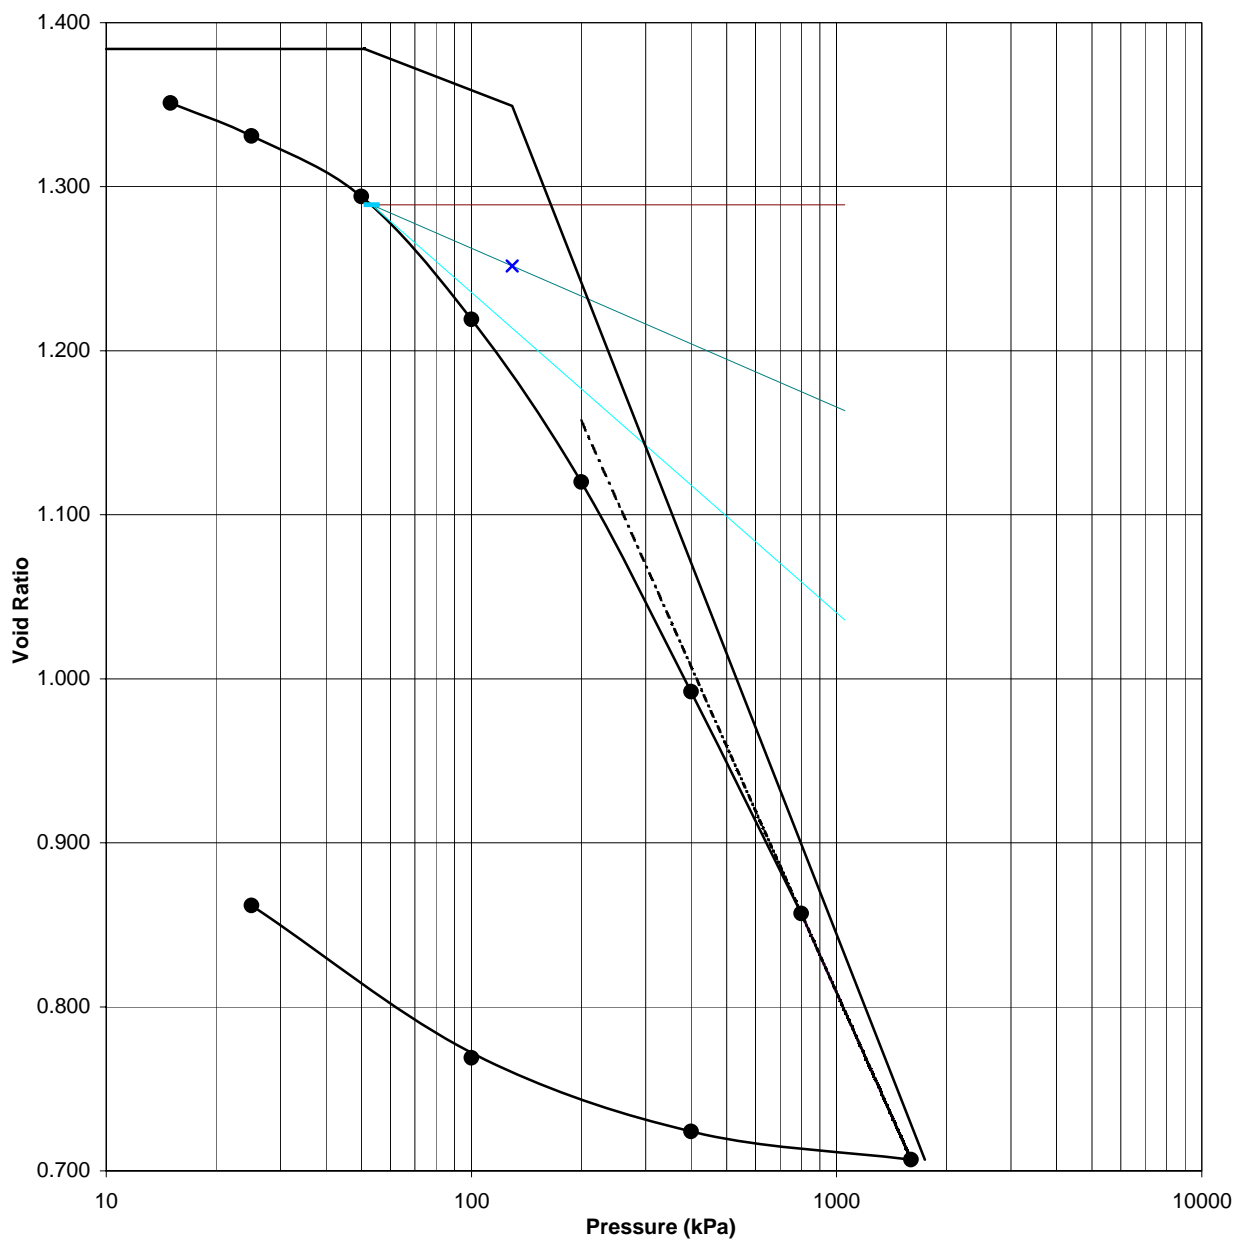


Bore hole No.: BH-3		Depth : 8.50m	
Initial Void Ratio, $e_0$	= 1.3840	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 51 kPa		
Compression Index $C_c$	= 0.5685	25 - 50	0.000620
$C_c/(1+e_0)$	= 0.2385	50 - 100	0.000629
Pre-consolidation Pressure, $p_c$	= 129 kPa	100 - 200	0.000416
Swelling Index, $C_s$	= 0.0858	200 - 400	0.000268
Recompression Index, $C_r$	$\approx$ 0.0858	400 - 800	0.000142
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			<div>Job No. :</div> <div>CCPL/20101211</div>
			<div>Fig. No.</div> <div>G/24</div>

**e-logp curve**

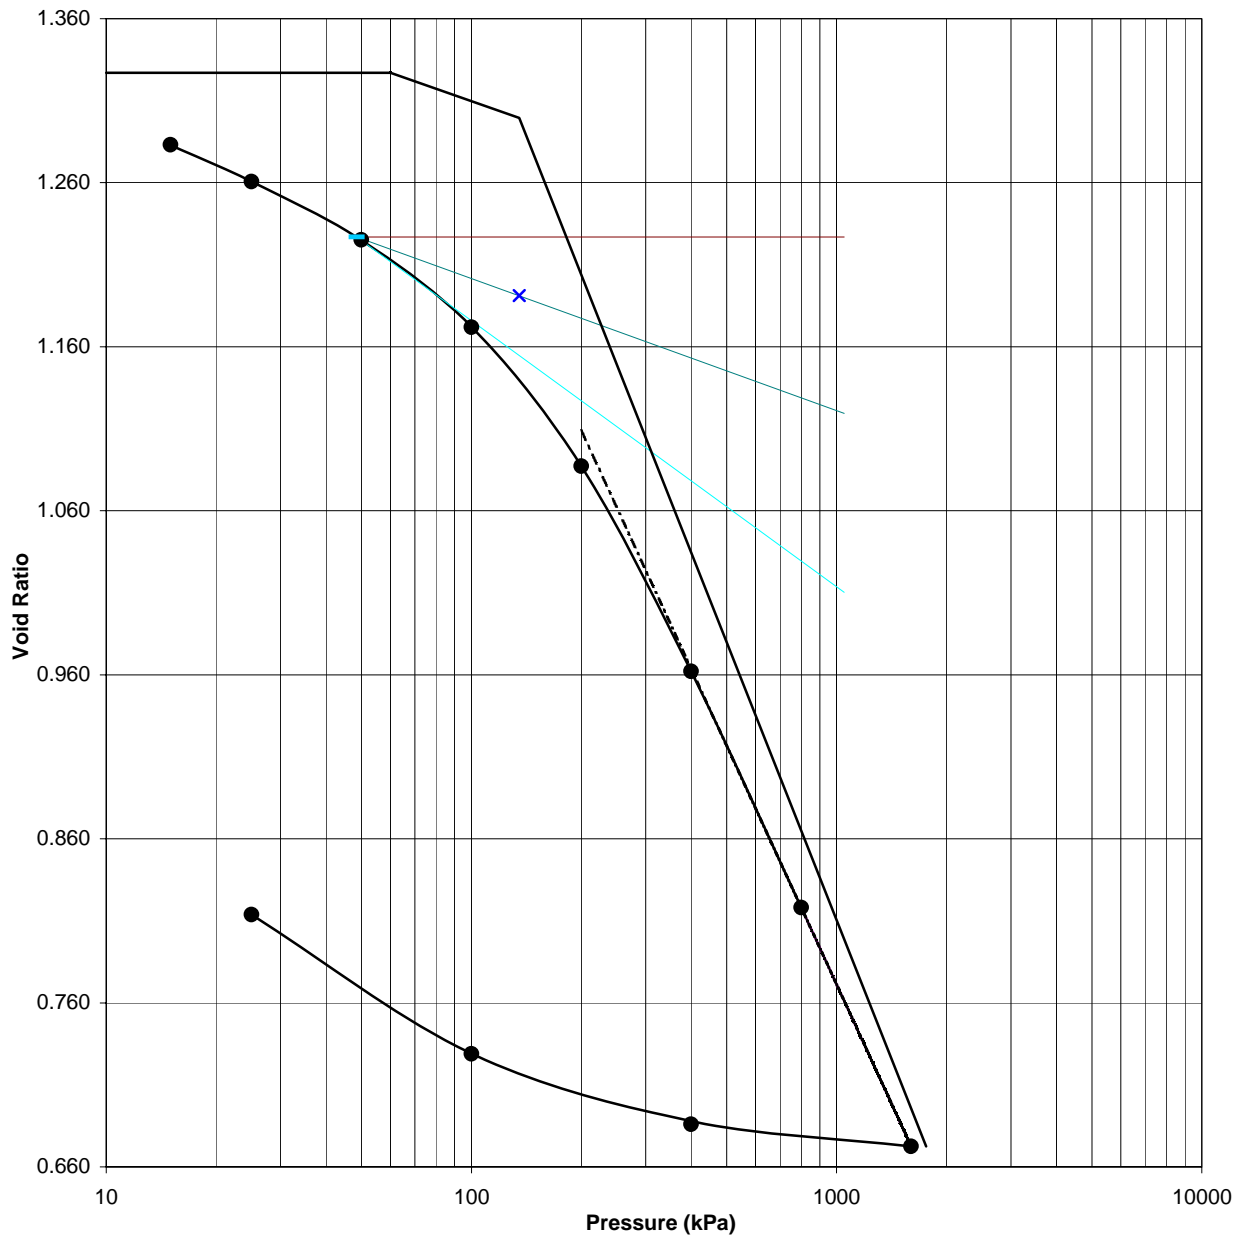


Bore hole No.: BH-3		Depth : 10.00m	
Initial Void Ratio, $e_0$	= 1.3271	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 60 kPa		
Compression Index $C_c$	= 0.5624	25 - 50	0.000614
$C_c/(1+e_0)$	= 0.2417	50 - 100	0.000456
Pre-consolidation Pressure, $p_c$	= 135 kPa	100 - 200	0.000364
Swelling Index, $C_s$	= 0.0782	200 - 400	0.000269
Recompression Index, $C_r$	≈ 0.0782	400 - 800	0.000155
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/25


**e-logp curve**

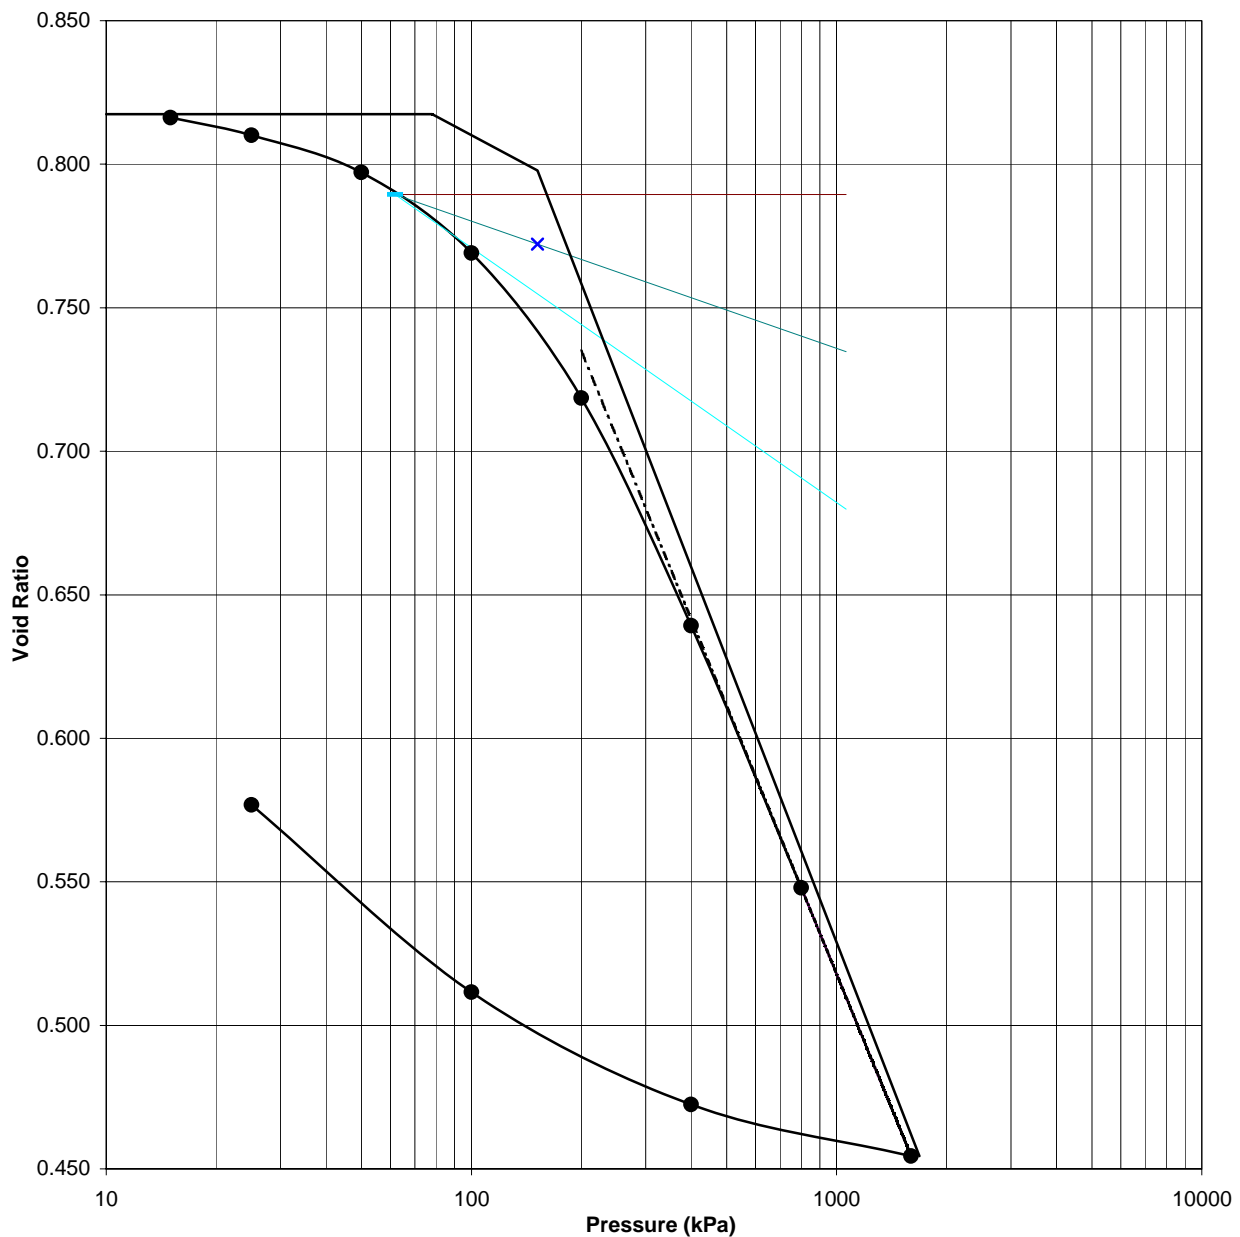

Bore hole No.: BH-3		Depth : 13.00m	
Initial Void Ratio, $e_0$	=	0.8174	Pressure Range (kPa)
Effective Overburden Pressure, $p_0$	=	78 kPa	
Compression Index $C_c$	=	0.3284	25 - 50
$C_c/(1+e_0)$	=	0.1807	50 - 100
Pre-consolidation Pressure, $p_c$	=	152 kPa	100 - 200
Swelling Index, $C_s$	=	0.0677	200 - 400
Recompression Index, $C_r$	≈	0.0677	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/26

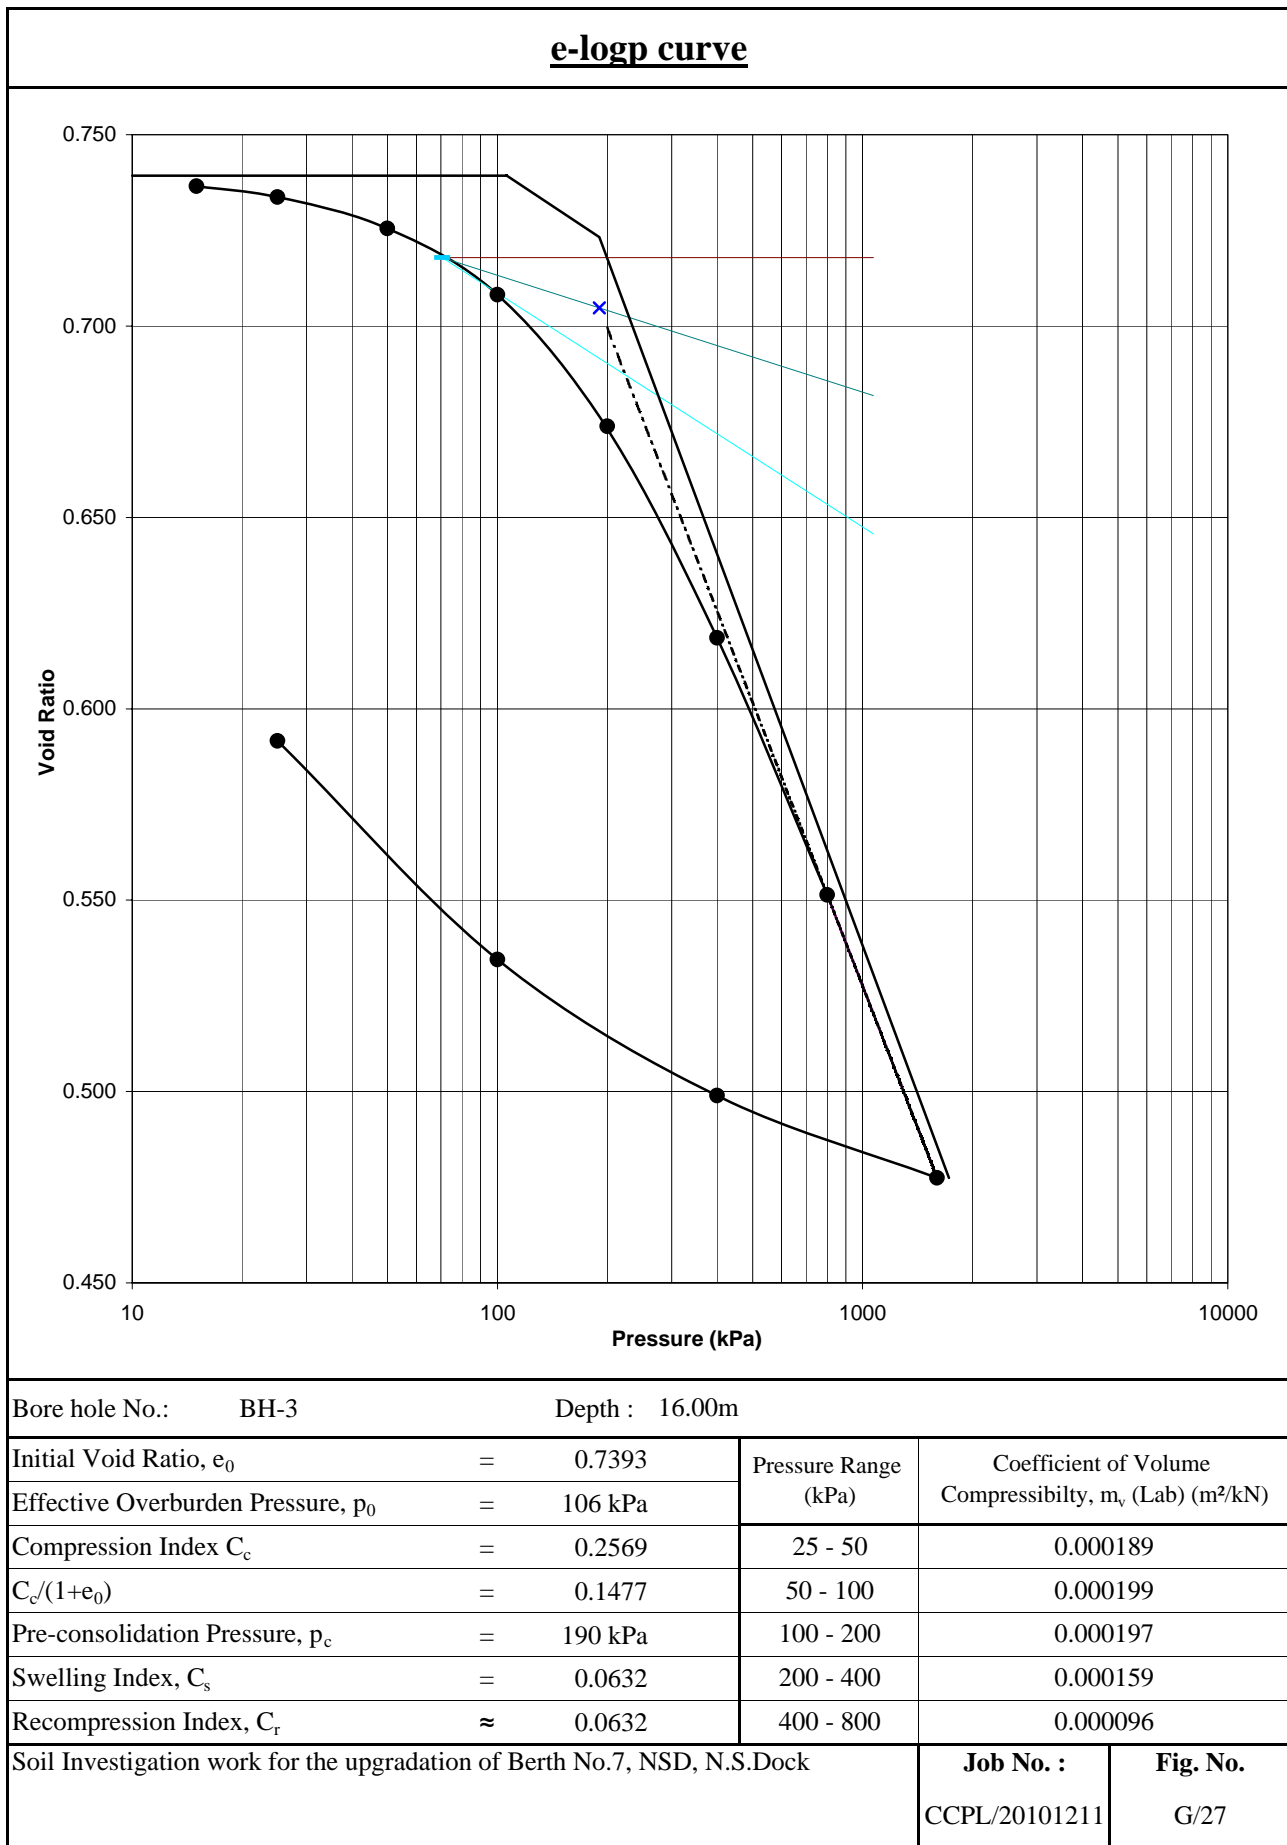


**e-logp curve**

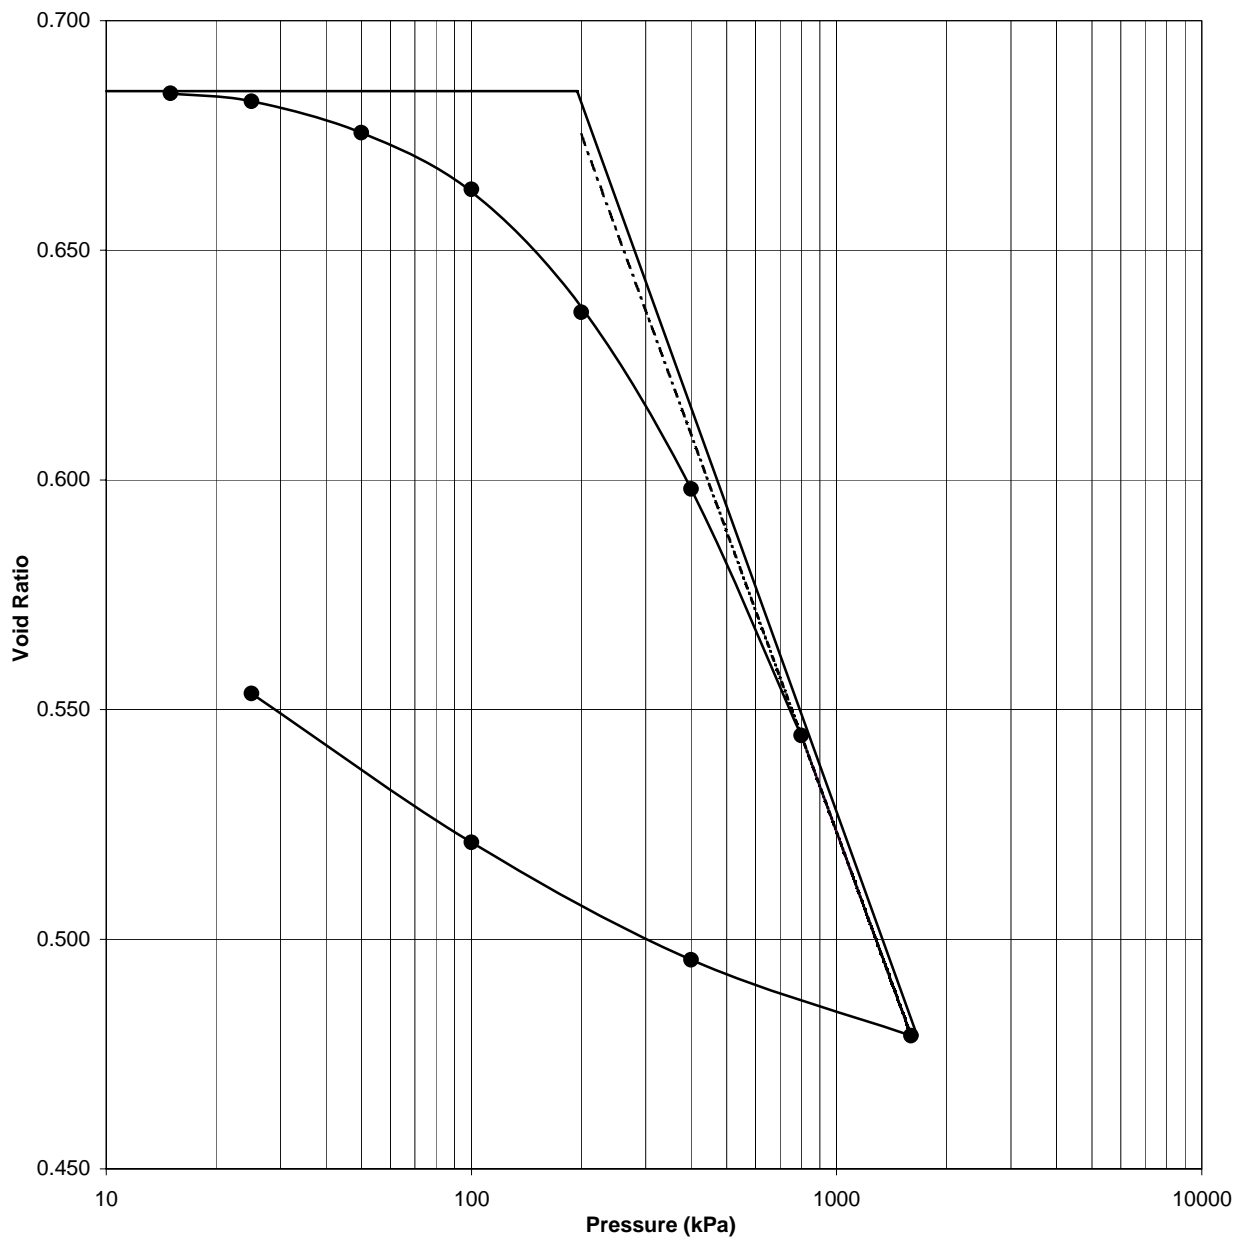

Bore hole No.: BH-3		Depth : 25.00m	
Initial Void Ratio, $e_0$	= 0.6847	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 195 kPa		
Compression Index $C_c$	= 0.2211	25 - 50	0.000162
$C_c/(1+e_0)$	= 0.1312	50 - 100	0.000147
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000159
Swelling Index, $C_s$	= 0.0412	200 - 400	0.000114
Recompression Index, $C_r$	$\approx$ 0.0412	400 - 800	0.000080
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/28

**e-logp curve**

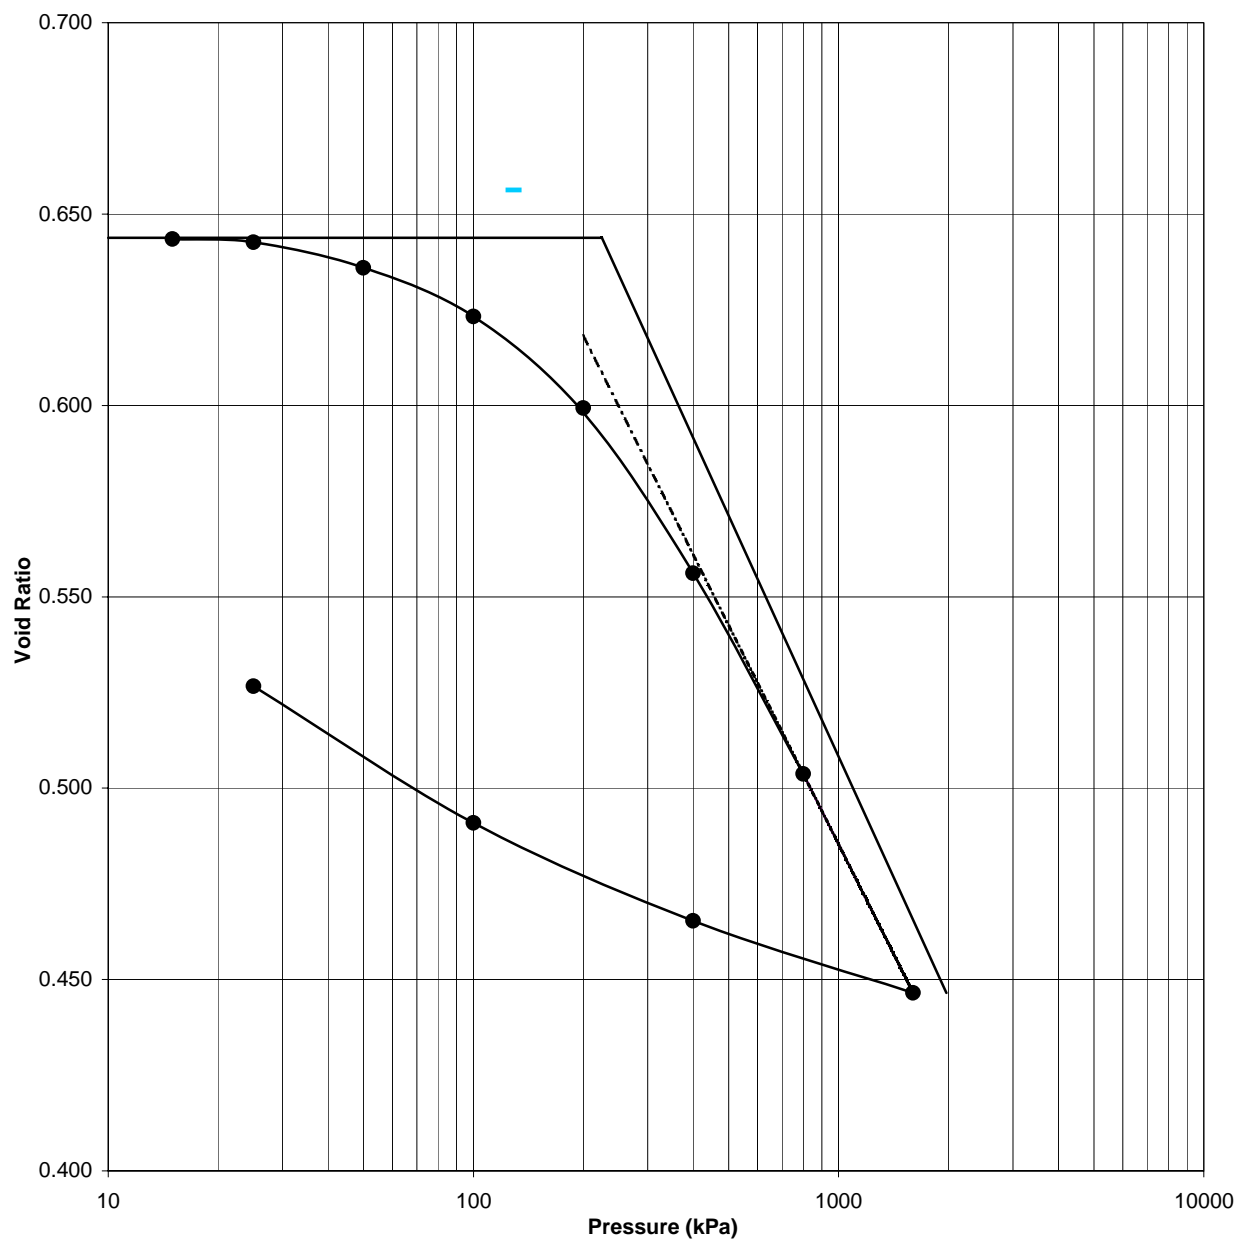

Bore hole No.: BH-3 Depth : 28.00m

Initial Void Ratio, $e_0$	=	0.6438	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	225 kPa		
Compression Index $C_c$	=	0.2092	25 - 50	0.000161
$C_c/(1+e_0)$	=	0.1273	50 - 100	0.000155
Pre-consolidation Pressure, $p_c$	=	--	100 - 200	0.000146
Swelling Index, $C_s$	=	0.0444	200 - 400	0.000131
Recompression Index, $C_r$	≈	0.0444	400 - 800	0.000080

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock

**Job No. :**


CCPL/20101211

**Fig. No.**


G/29




**e-logp curve**

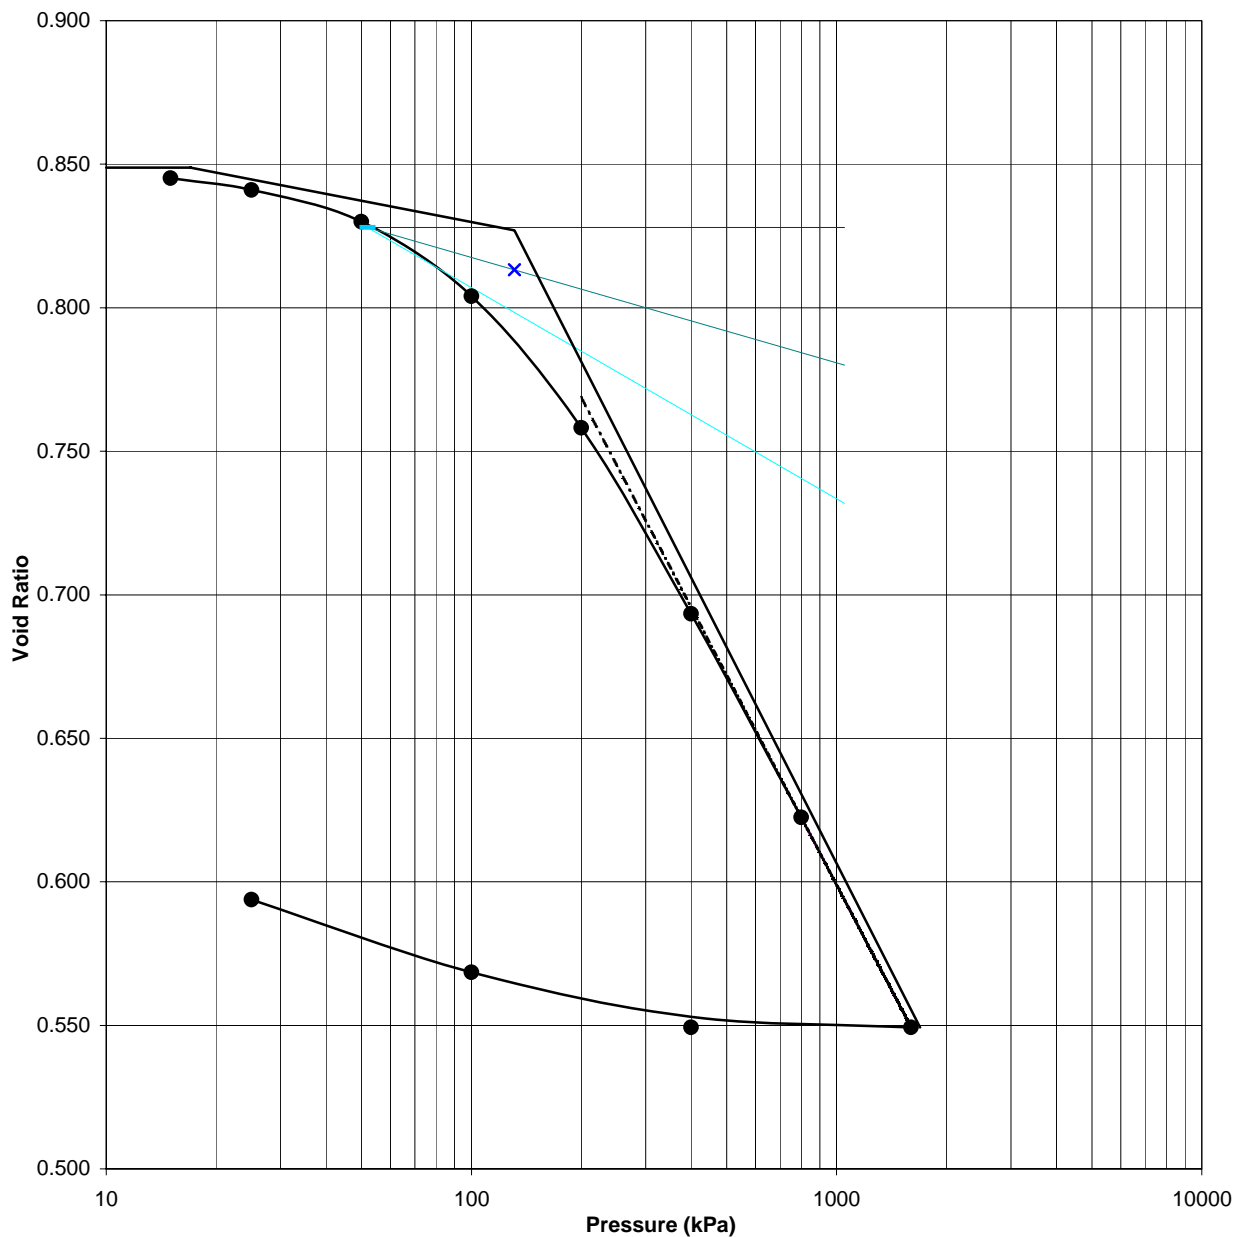

Bore hole No.: BH-4		Depth : 2.00m	
Initial Void Ratio, $e_0$	= 0.8488	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 17 kPa		
Compression Index $C_c$	= 0.2499	25 - 50	0.000239
$C_c/(1+e_0)$	= 0.1352	50 - 100	0.000282
Pre-consolidation Pressure, $p_c$	= 131 kPa	100 - 200	0.000247
Swelling Index, $C_s$	= 0.0246	200 - 400	0.000175
Recompression Index, $C_r$	≈ 0.0246	400 - 800	0.000096
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/30

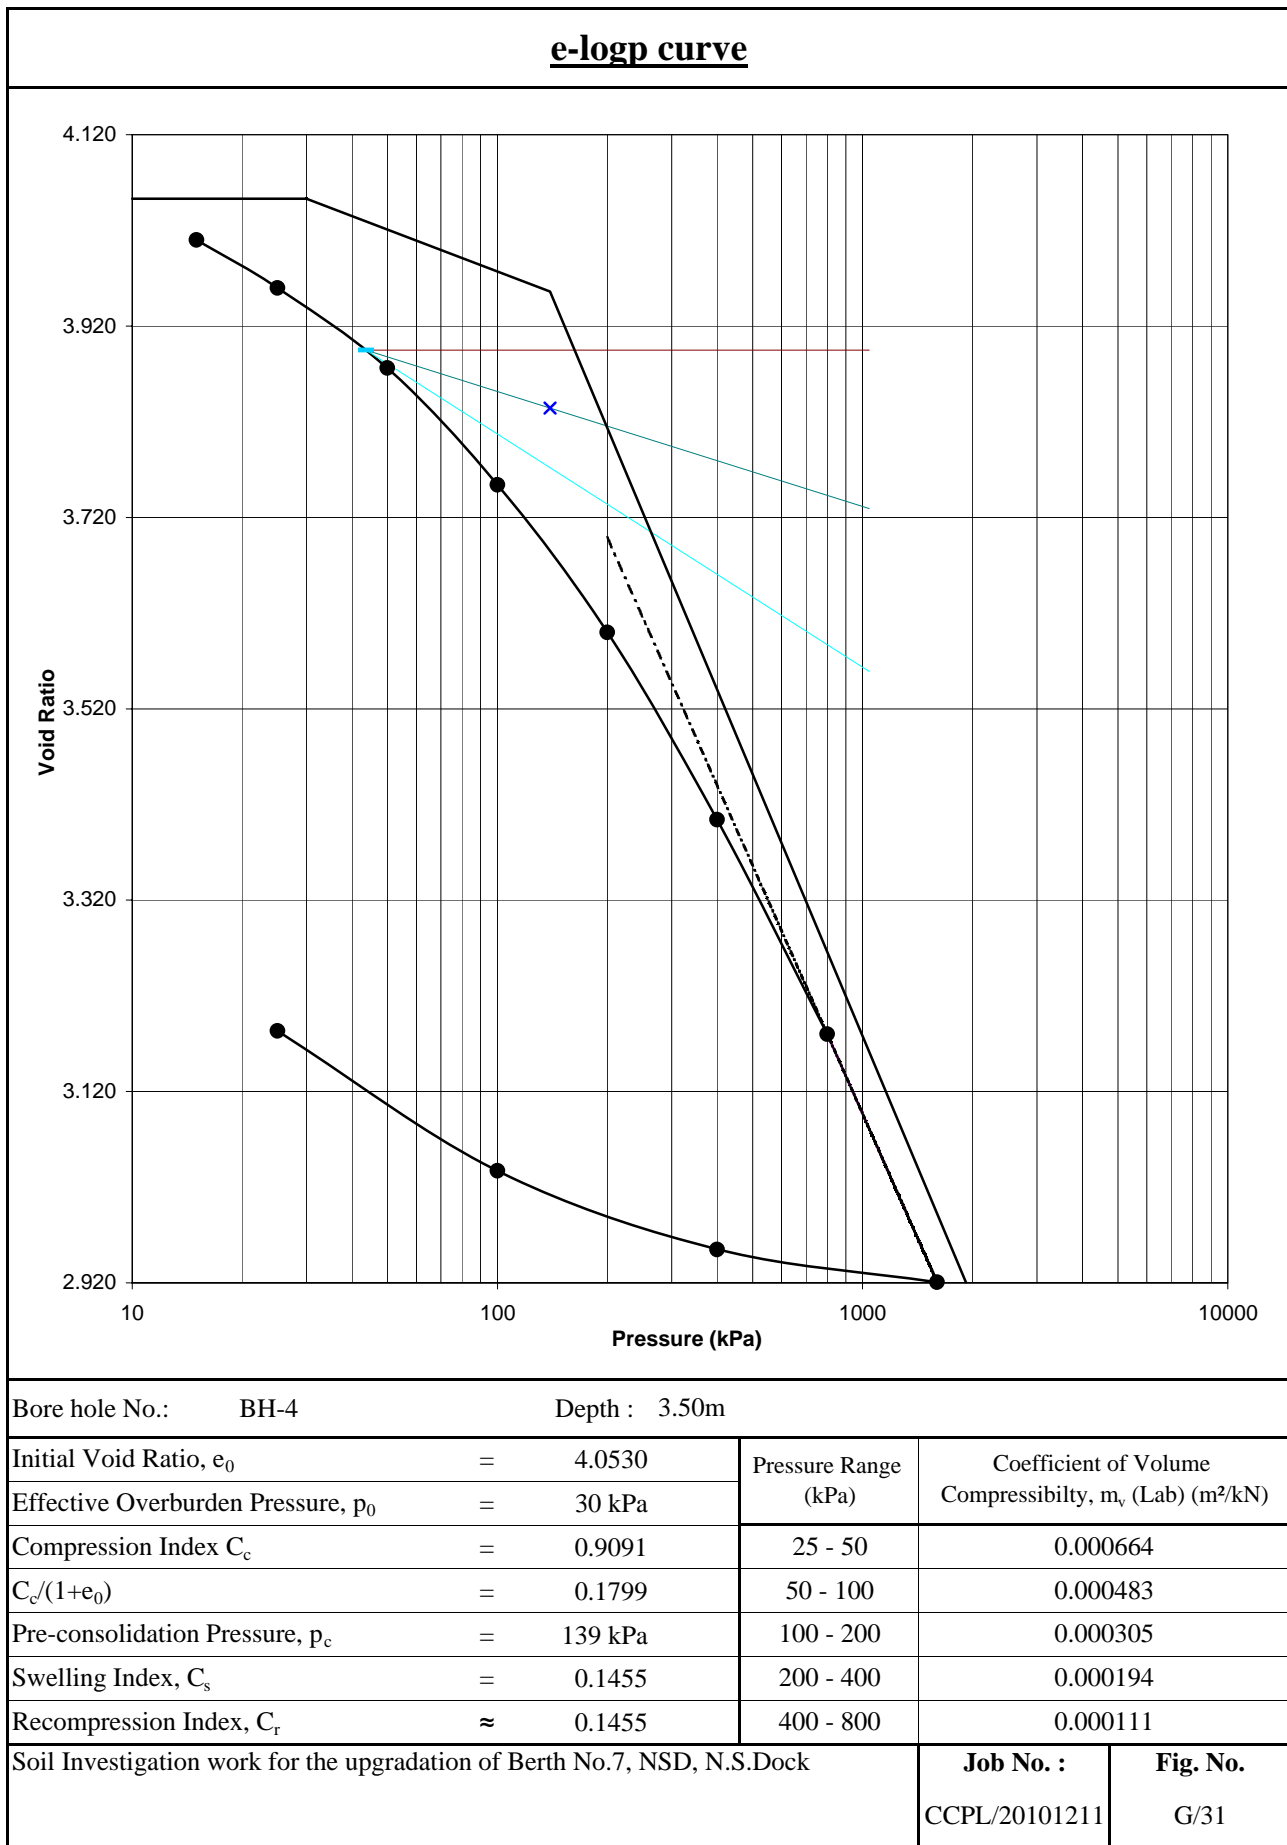


**e-logp curve**

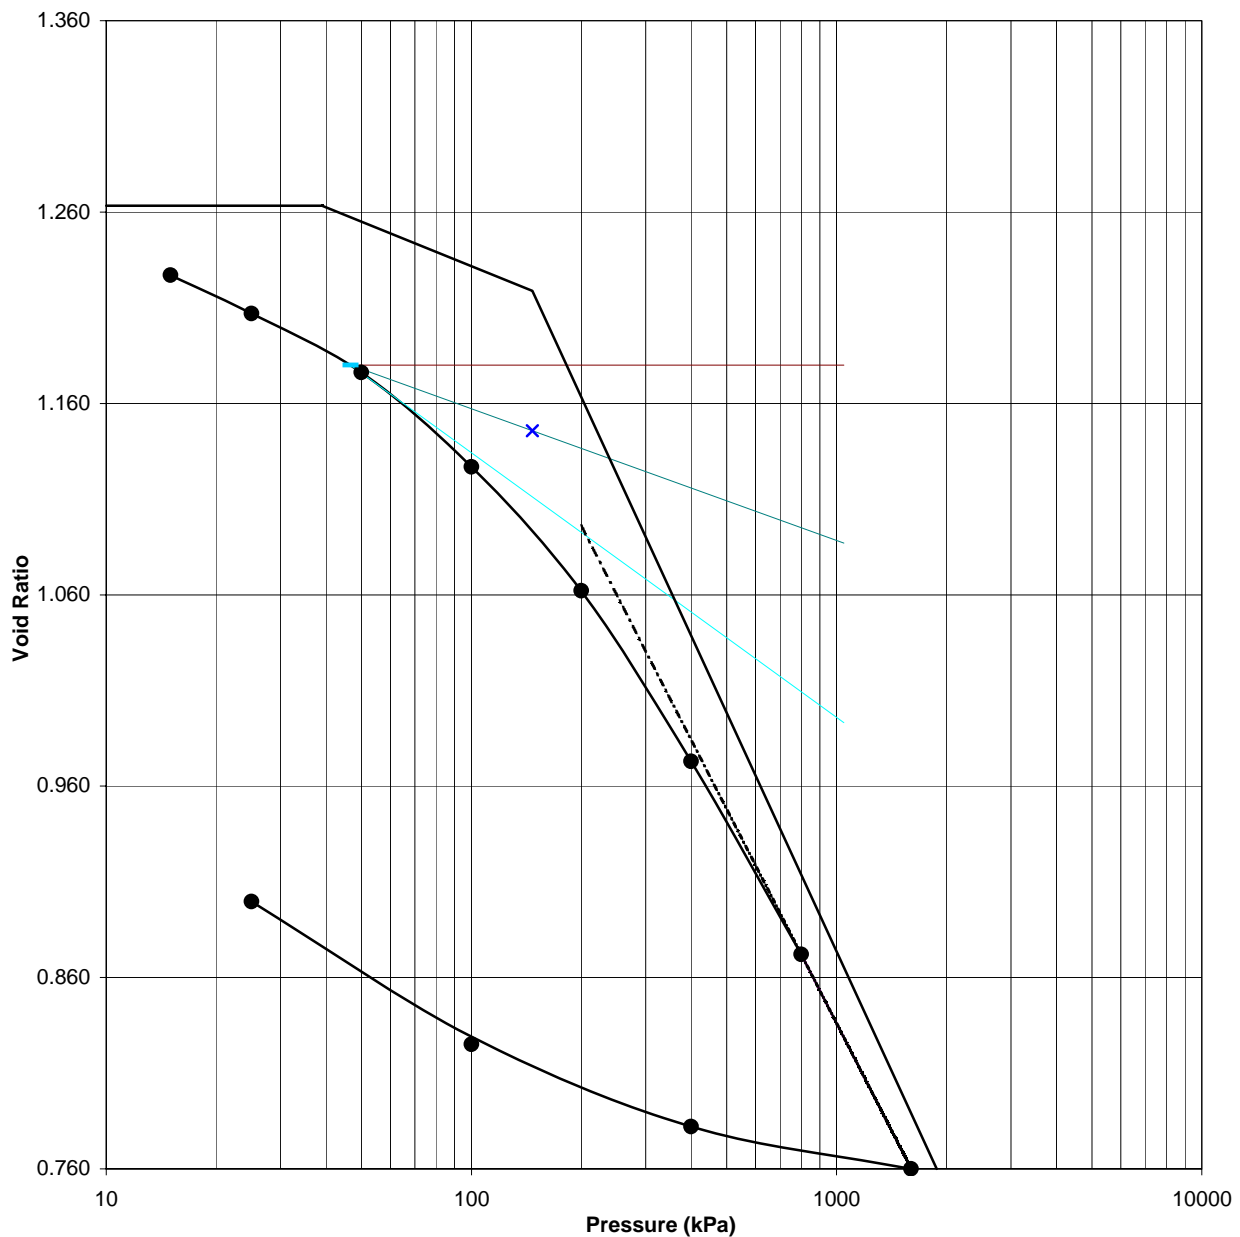


Bore hole No.: BH-4		Depth : 5.00m	
Initial Void Ratio, $e_0$	= 1.2633	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 39 kPa		
Compression Index $C_c$	= 0.4144	25 - 50	0.000544
$C_c/(1+e_0)$	= 0.1831	50 - 100	0.000437
Pre-consolidation Pressure, $p_c$	= 147 kPa	100 - 200	0.000286
Swelling Index, $C_s$	= 0.0773	200 - 400	0.000197
Recompression Index, $C_r$	$\approx$ 0.0773	400 - 800	0.000111
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/32

**e-logp curve**

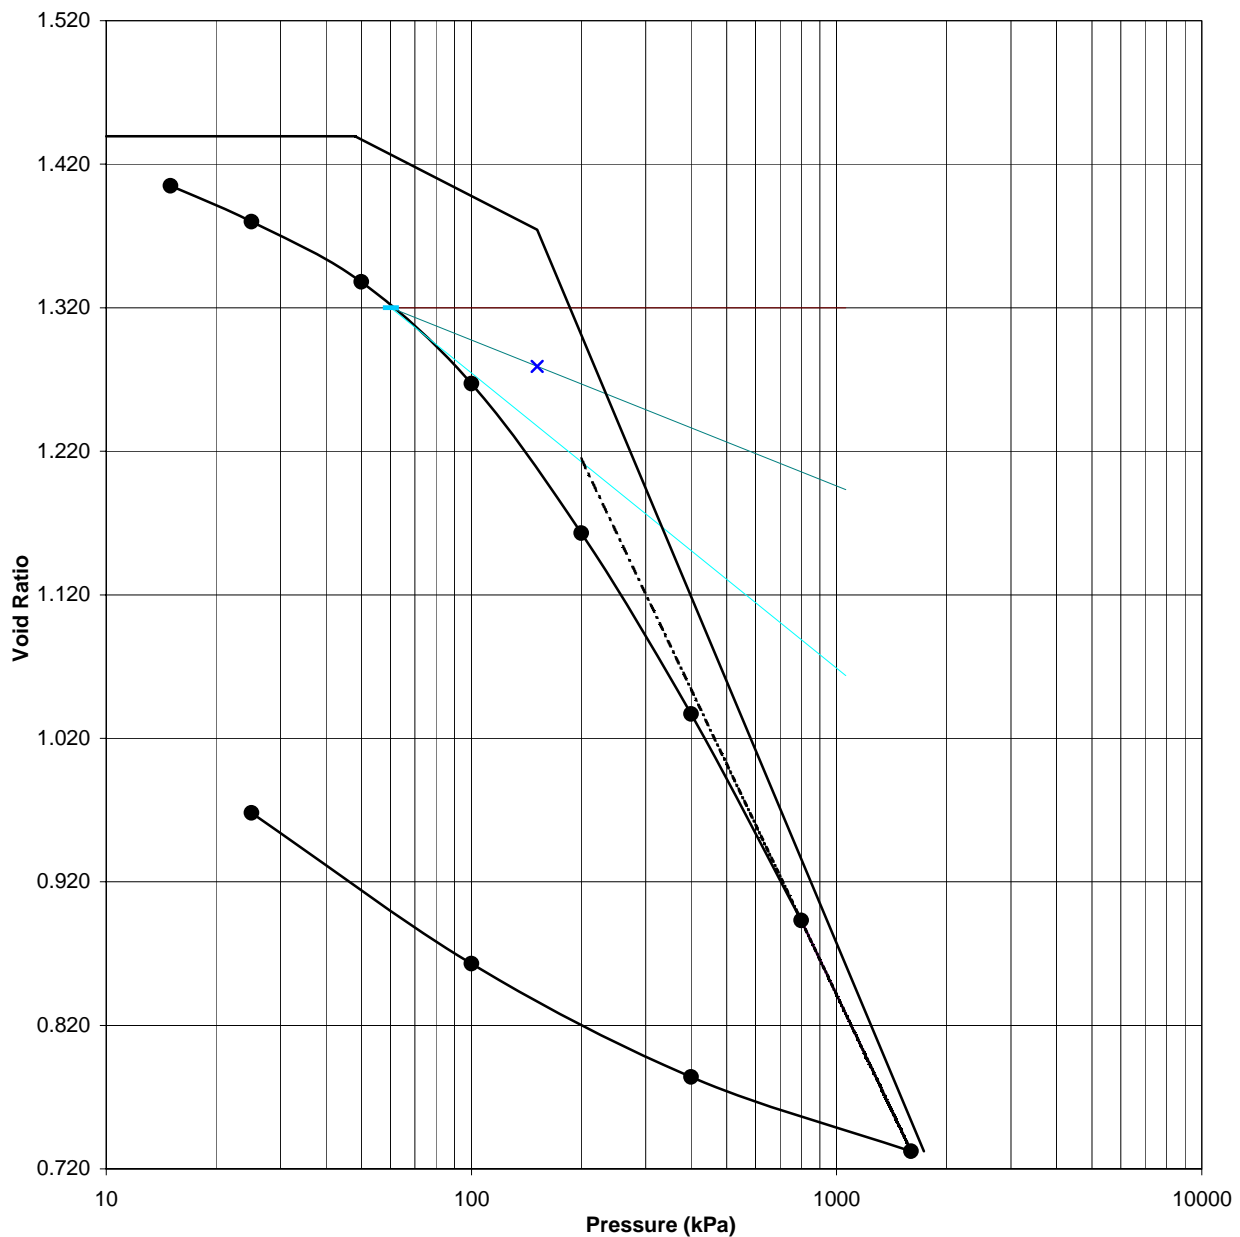


Bore hole No.: BH-4		Depth : 6.50m	
Initial Void Ratio, $e_0$	= 1.4394	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 48 kPa		
Compression Index $C_c$	= 0.6064	25 - 50	0.000690
$C_c/(1+e_0)$	= 0.2486	50 - 100	0.000581
Pre-consolidation Pressure, $p_c$	= 151 kPa	100 - 200	0.000427
Swelling Index, $C_s$	= 0.1305	200 - 400	0.000258
Recompression Index, $C_r$	$\approx$ 0.1305	400 - 800	0.000148
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/33

**e-logp curve**

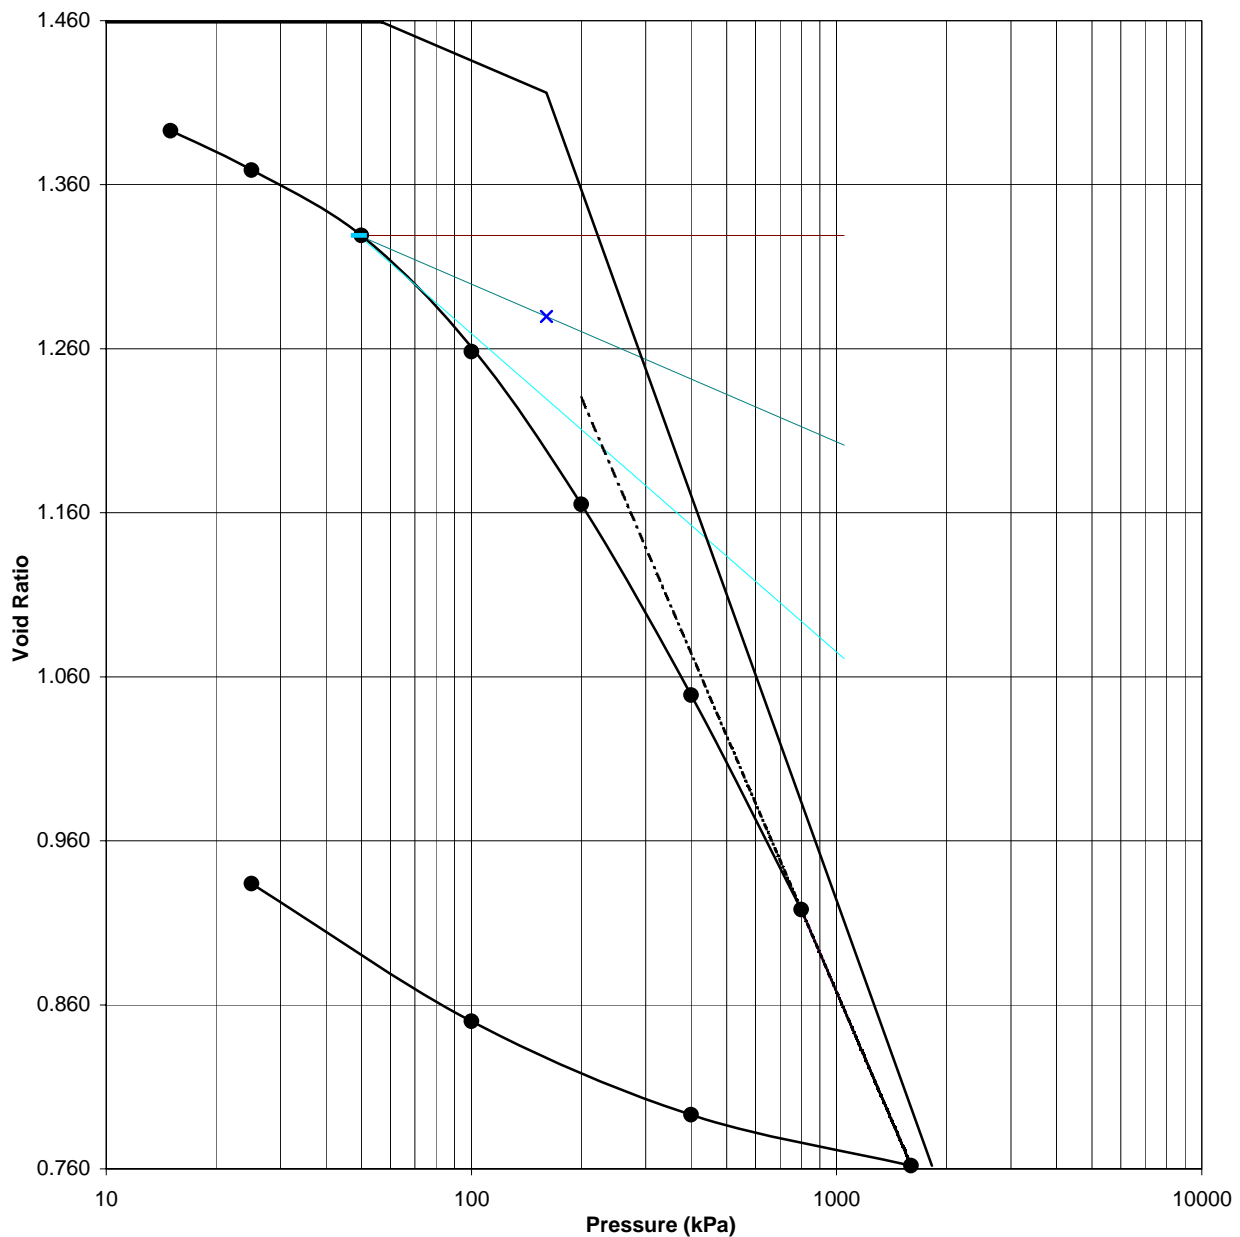


Bore hole No.: BH-4		Depth : 8.00m	
Initial Void Ratio, $e_0$	=	1.4590	Pressure Range (kPa)
Effective Overburden Pressure, $p_0$	=	57 kPa	
Compression Index $C_c$	=	0.6201	25 - 50
$C_c/(1+e_0)$	=	0.2522	50 - 100
Pre-consolidation Pressure, $p_c$	=	161 kPa	100 - 200
Swelling Index, $C_s$	=	0.0952	200 - 400
Recompression Index, $C_r$	≈	0.0952	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/34

**e-logp curve**

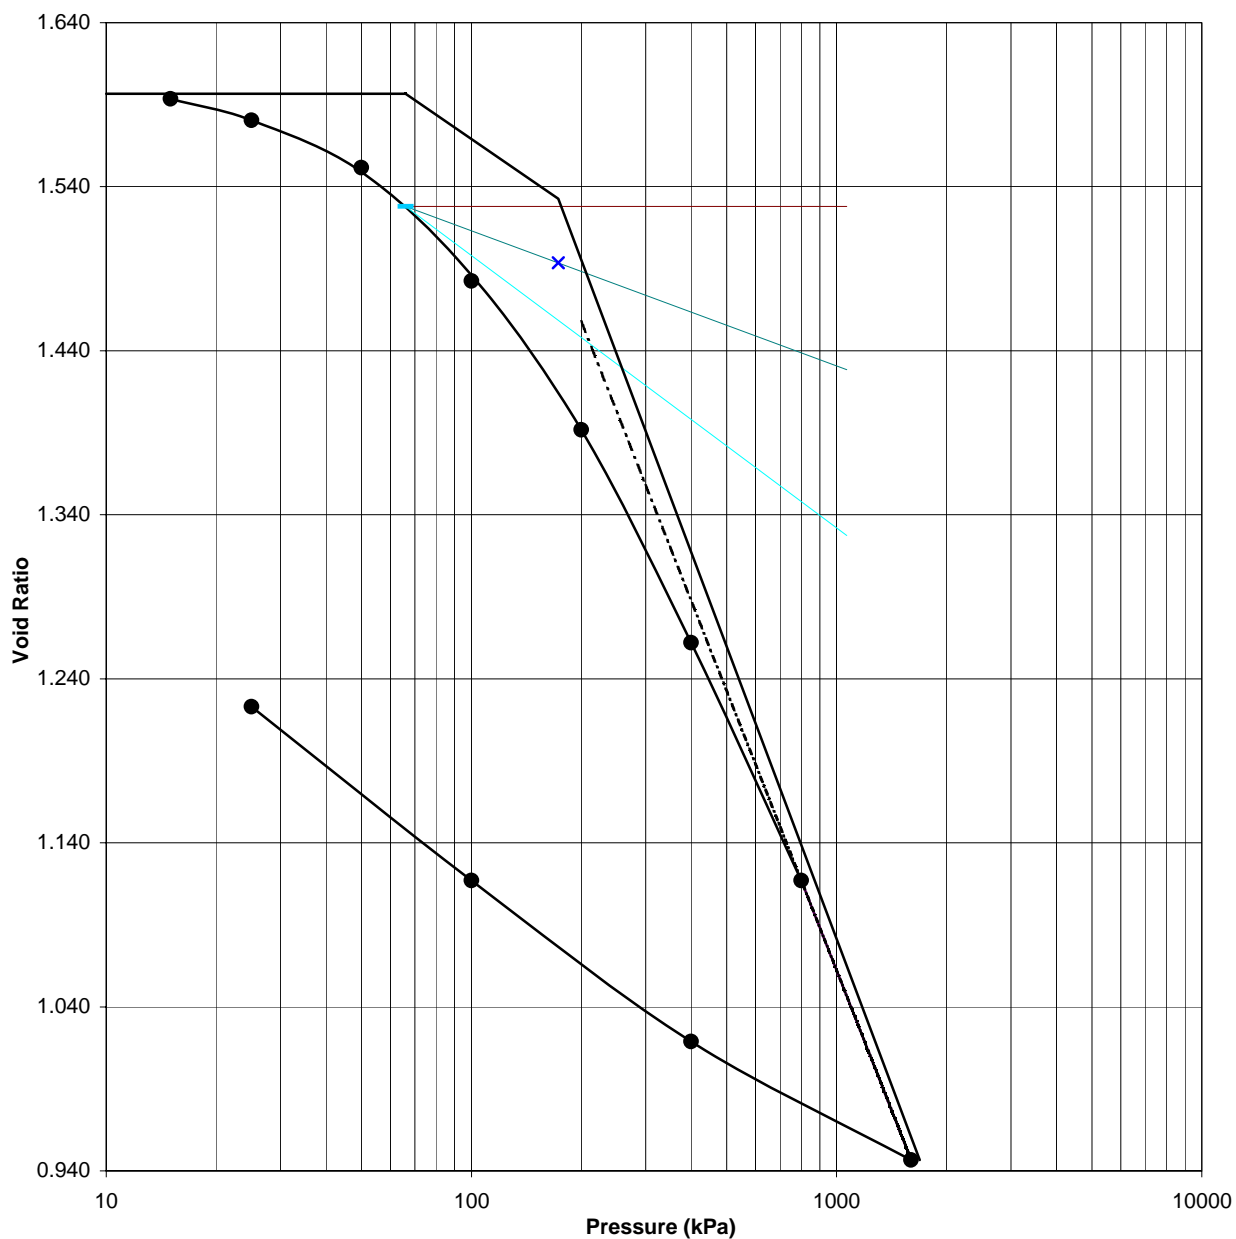


Bore hole No.: BH-4		Depth : 9.50m		
Initial Void Ratio, $e_0$	=	1.5967	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	66 kPa		
Compression Index $C_c$	=	0.5917	25 - 50	0.000446
$C_c/(1+e_0)$	=	0.2279	50 - 100	0.000532
Pre-consolidation Pressure, $p_c$	=	173 kPa	100 - 200	0.000350
Swelling Index, $C_s$	=	0.1530	200 - 400	0.000250
Recompression Index, $C_r$	$\approx$	0.1530	400 - 800	0.000140
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock				Job No. : CCPL/20101211
				Fig. No. G/35

**e-logp curve**

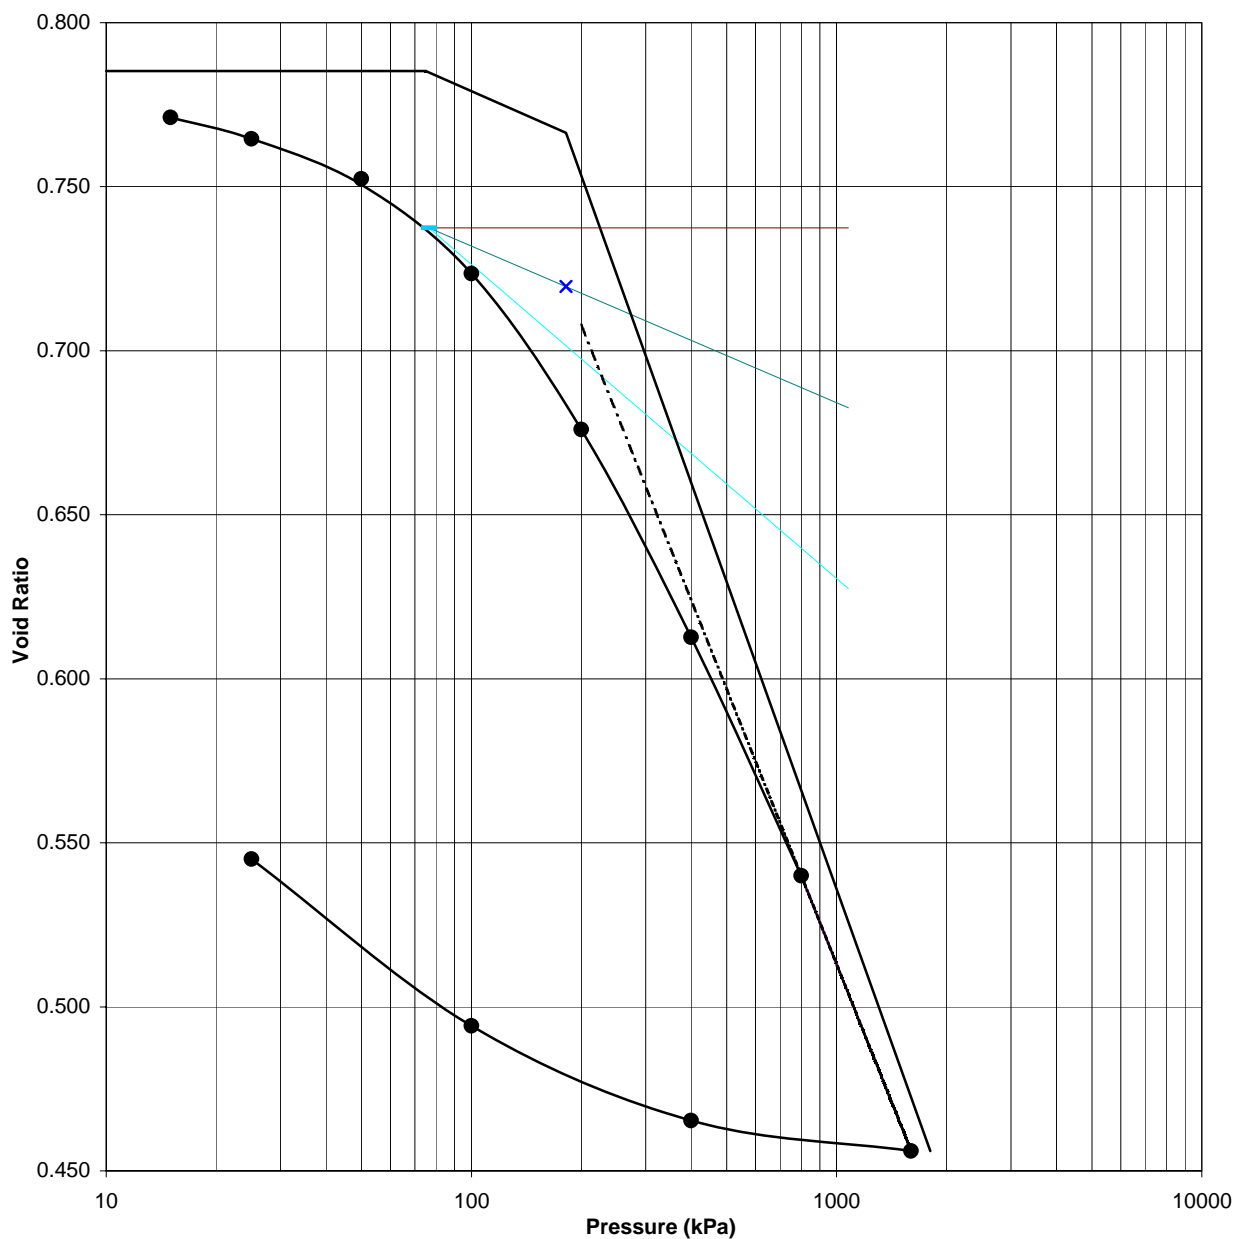

Bore hole No.: BH-4		Depth : 11.00m	
Initial Void Ratio, $e_0$	= 0.7853	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 75 kPa		
Compression Index $C_c$	= 0.3109	25 - 50	0.000273
$C_c/(1+e_0)$	= 0.1741	50 - 100	0.000323
Pre-consolidation Pressure, $p_c$	= 181 kPa	100 - 200	0.000266
Swelling Index, $C_s$	= 0.0492	200 - 400	0.000177
Recompression Index, $C_r$	≈ 0.0492	400 - 800	0.000102
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/36


**e-logp curve**

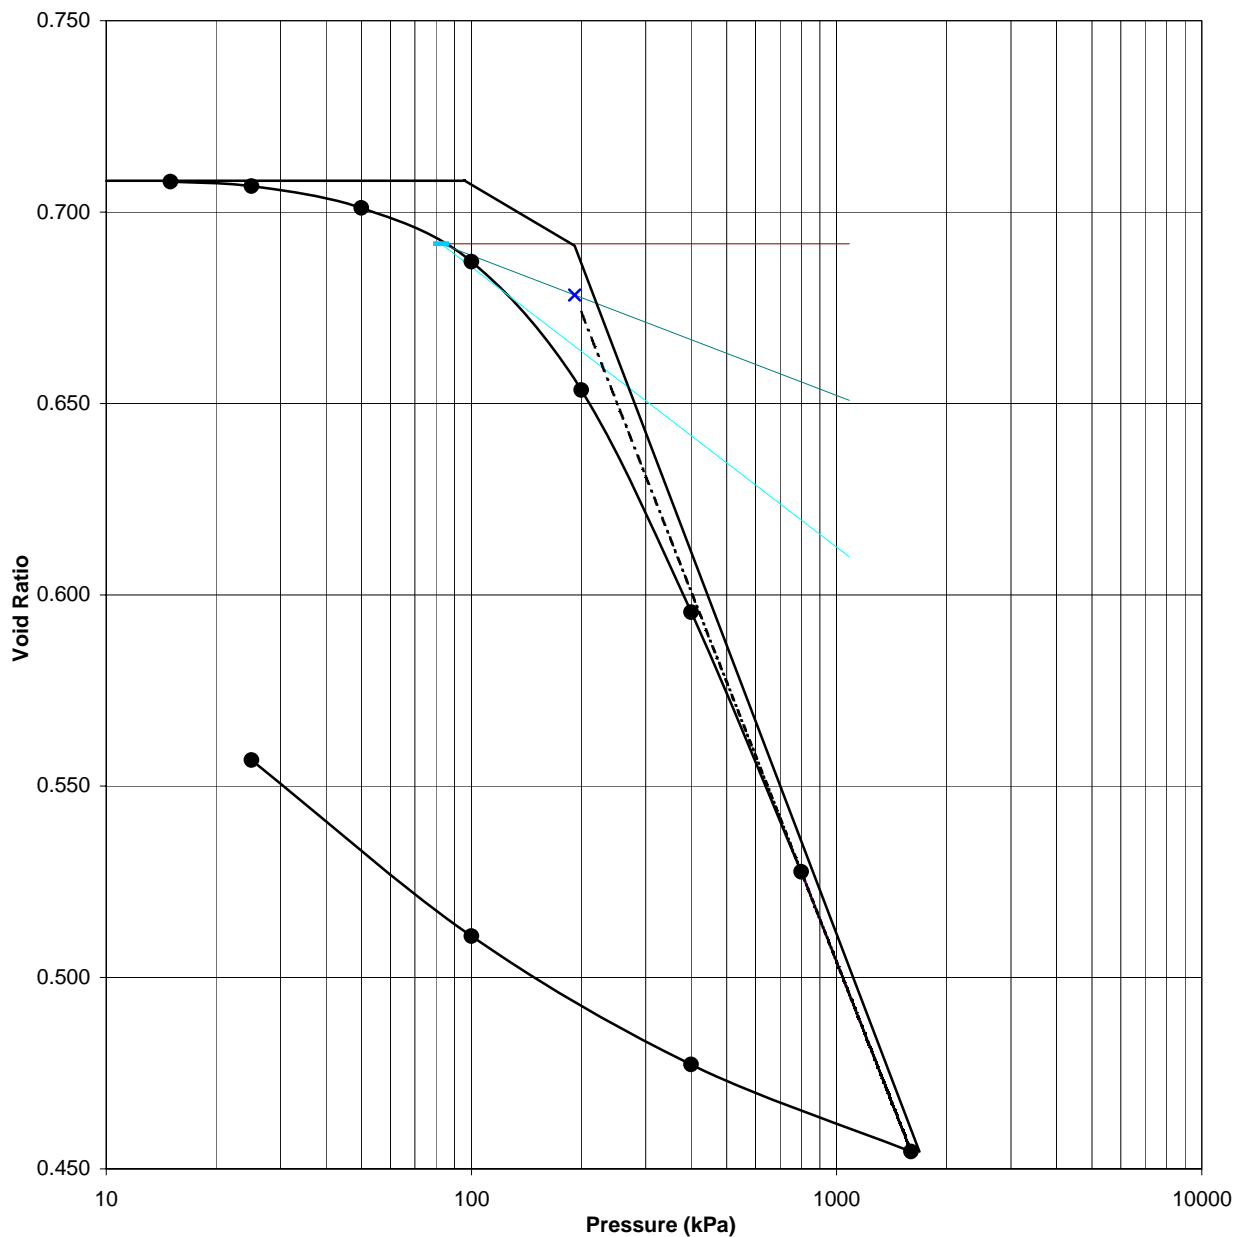

Bore hole No.: BH-4		Depth : 14.00m	
Initial Void Ratio, $e_0$	= 0.7082	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 96 kPa		
Compression Index $C_c$	= 0.2507	25 - 50	0.000134
$C_c/(1+e_0)$	= 0.1468	50 - 100	0.000164
Pre-consolidation Pressure, $p_c$	= 192 kPa	100 - 200	0.000196
Swelling Index, $C_s$	= 0.0566	200 - 400	0.000170
Recompression Index, $C_r$	$\approx$ 0.0566	400 - 800	0.000099
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/37




**e-logp curve**

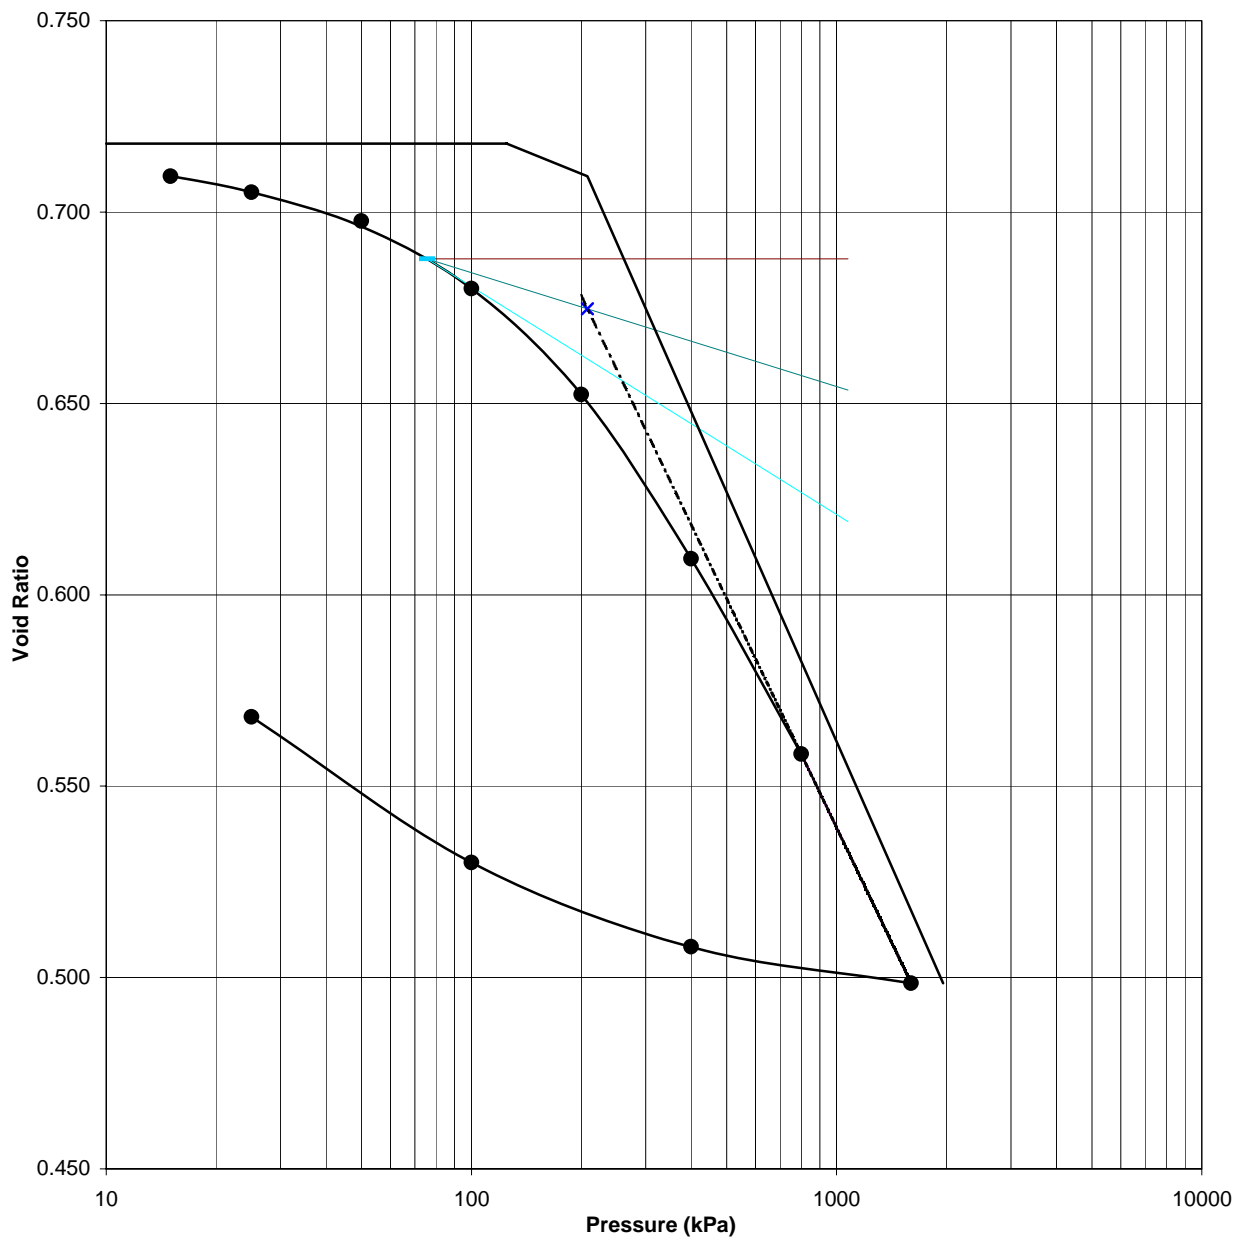


Bore hole No.: BH-4		Depth : 17.00m	
Initial Void Ratio, $e_0$	= 0.7179	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 125 kPa		
Compression Index $C_c$	= 0.2166	25 - 50	0.000176
$C_c/(1+e_0)$	= 0.1261	50 - 100	0.000206
Pre-consolidation Pressure, $p_c$	= 208 kPa	100 - 200	0.000161
Swelling Index, $C_s$	= 0.0385	200 - 400	0.000125
Recompression Index, $C_r$	$\approx$ 0.0385	400 - 800	0.000074
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/38


**e-logp curve**

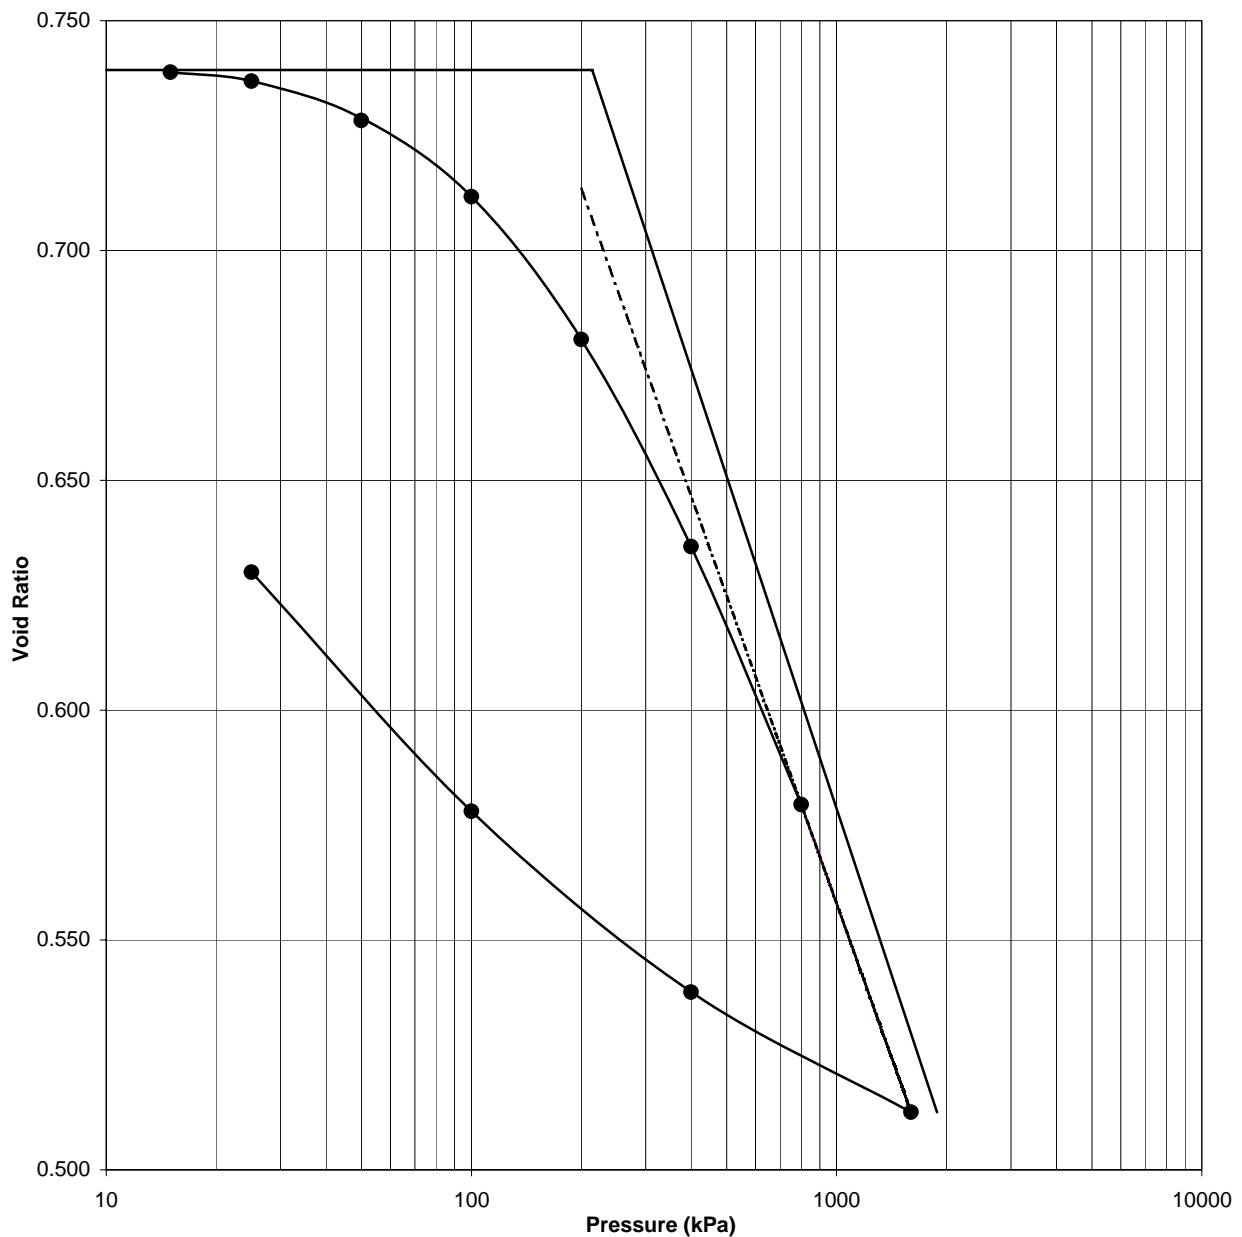

Bore hole No.: BH-4		Depth : 26.00m	
Initial Void Ratio, $e_0$	= 0.7393	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 214 kPa		
Compression Index $C_c$	= 0.2400	25 - 50	0.000196
$C_c/(1+e_0)$	= 0.1380	50 - 100	0.000191
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000178
Swelling Index, $C_s$	= 0.0650	200 - 400	0.000130
Recompression Index, $C_r$	$\approx$ 0.0650	400 - 800	0.000081
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/39

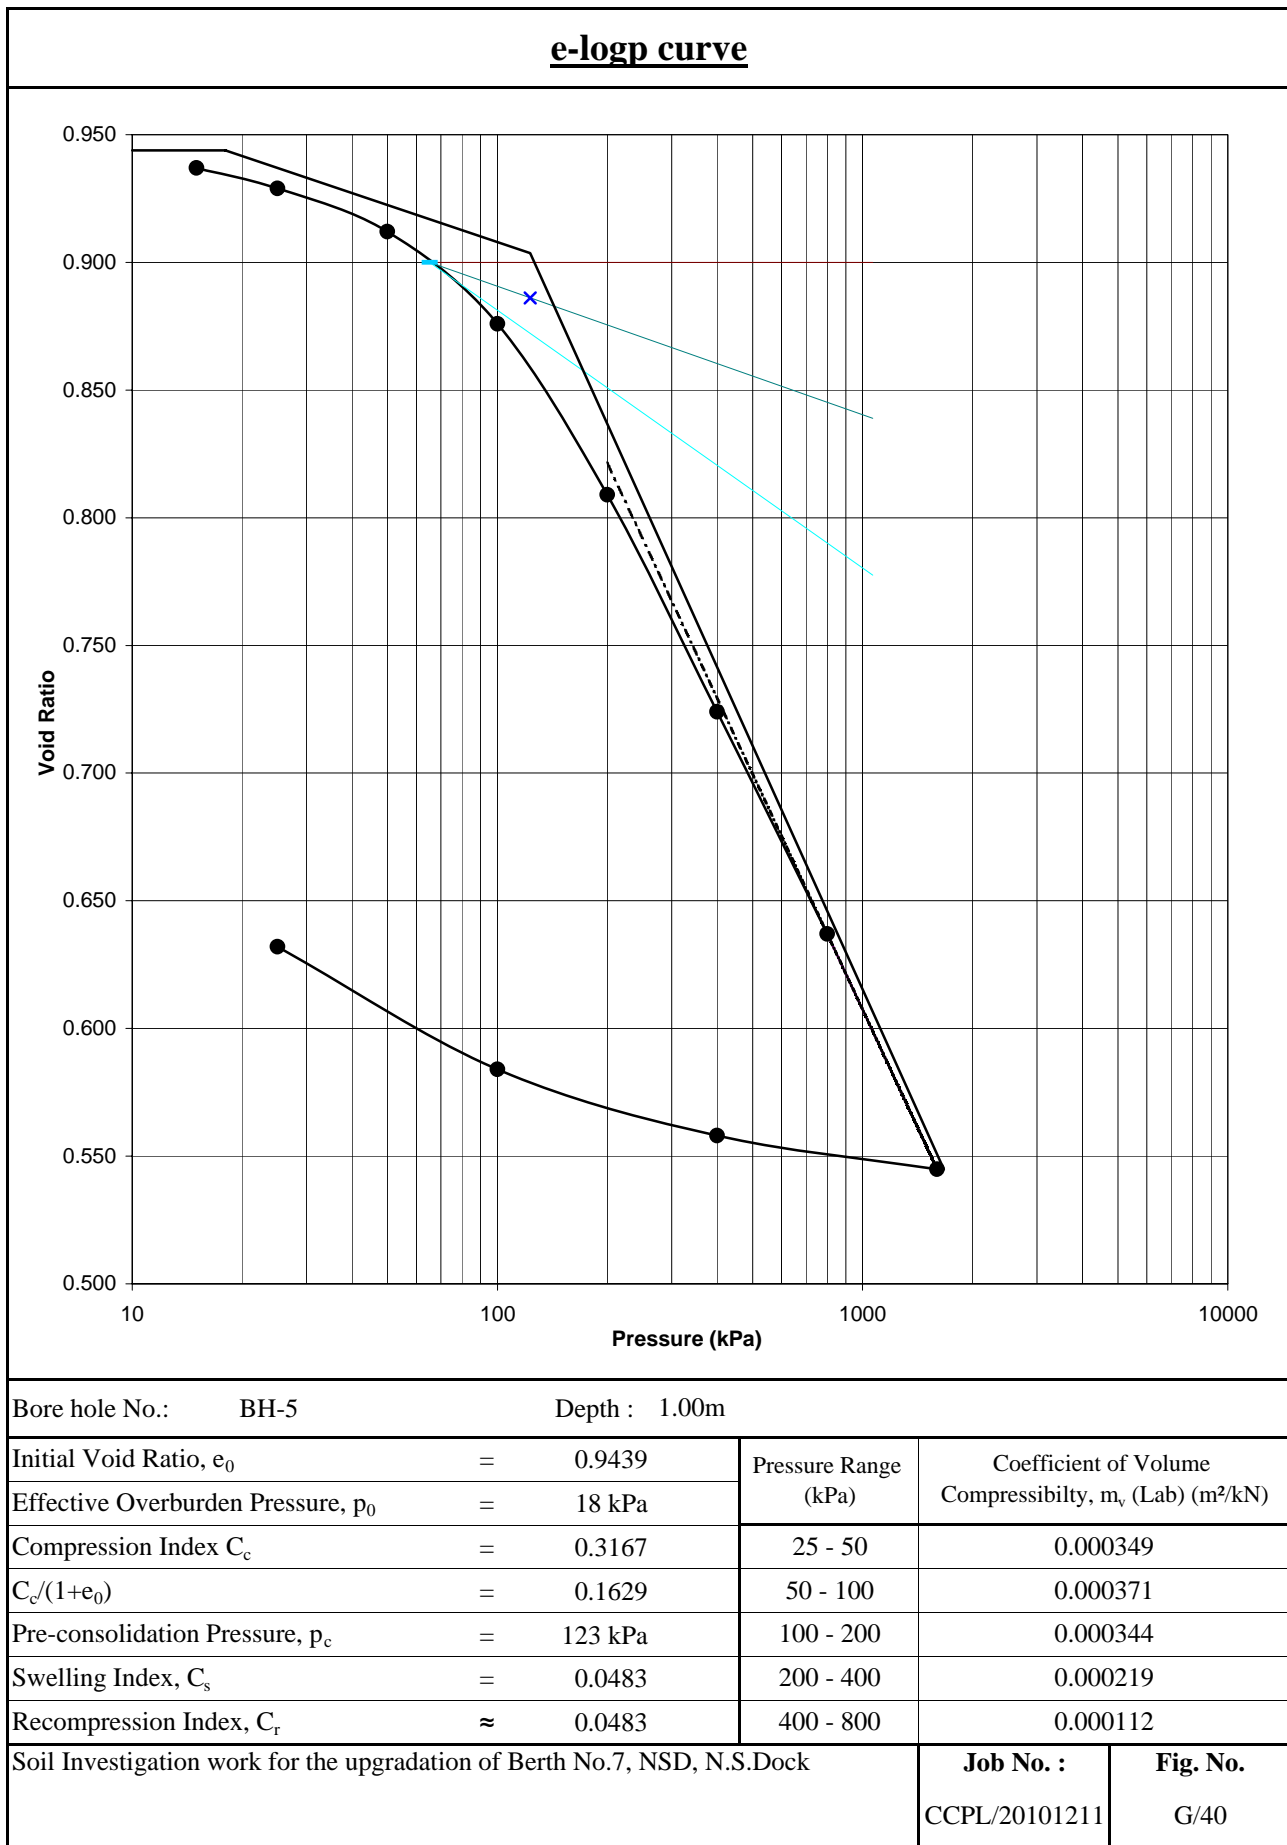


**e-logp curve**

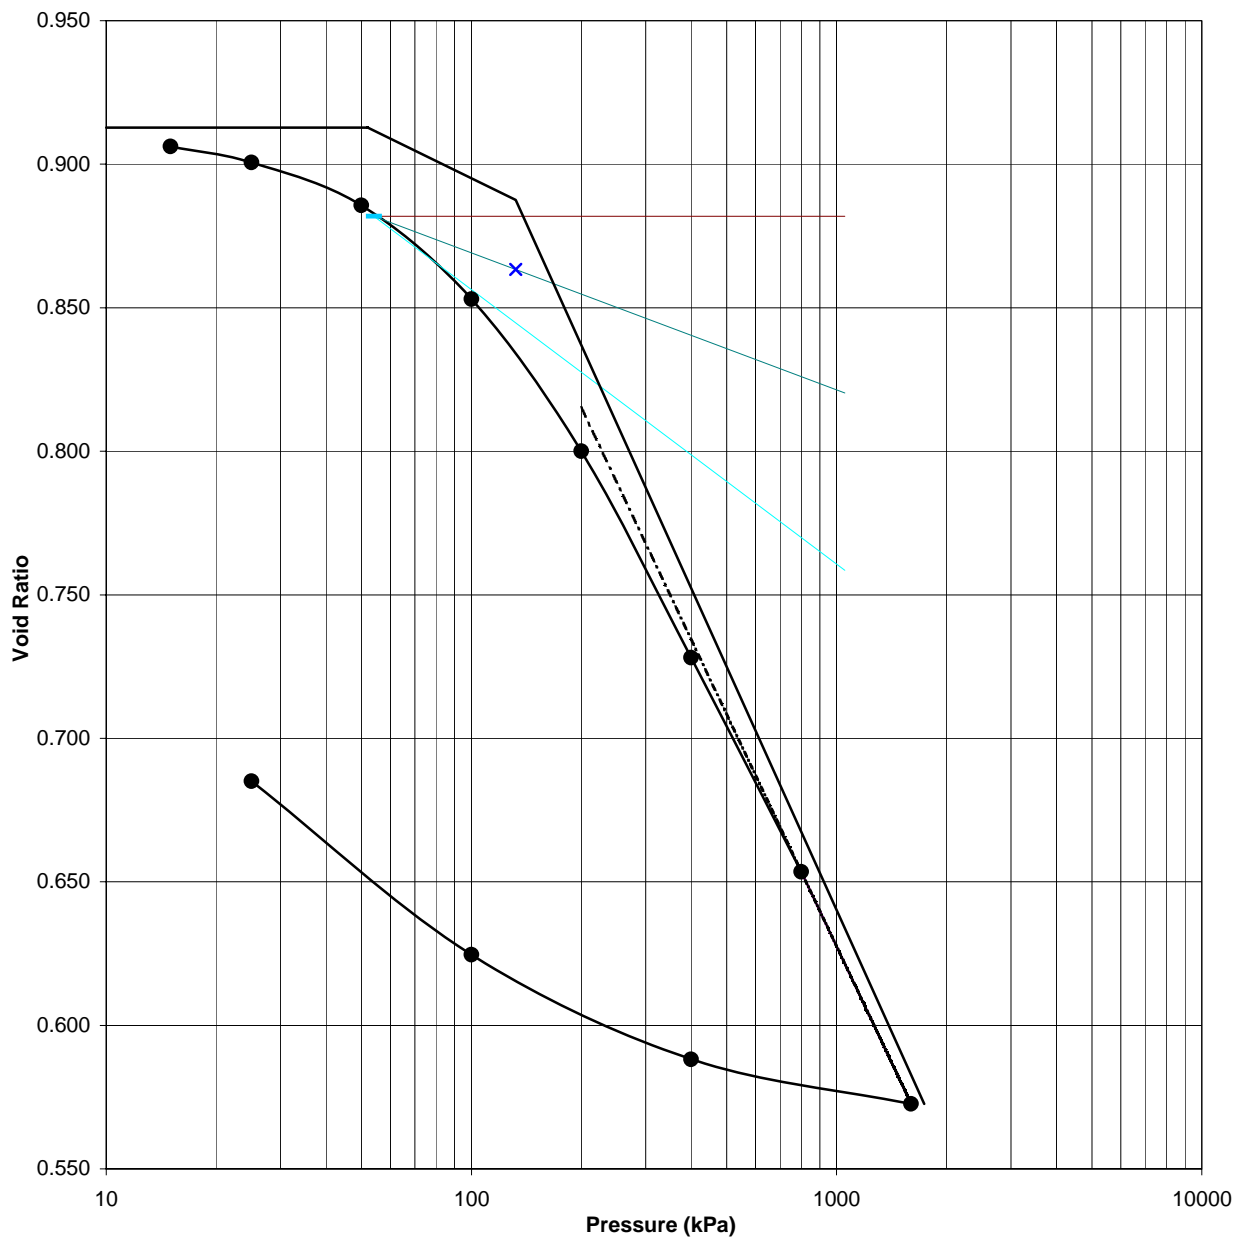


Bore hole No.: BH-5		Depth : 4.00m	
Initial Void Ratio, $e_0$	= 0.9128	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 52 kPa		
Compression Index $C_c$	= 0.2816	25 - 50	0.000313
$C_c/(1+e_0)$	= 0.1472	50 - 100	0.000342
Pre-consolidation Pressure, $p_c$	= 132 kPa	100 - 200	0.000277
Swelling Index, $C_s$	= 0.0622	200 - 400	0.000188
Recompression Index, $C_r$	$\approx$ 0.0622	400 - 800	0.000098
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/41

**e-logp curve**

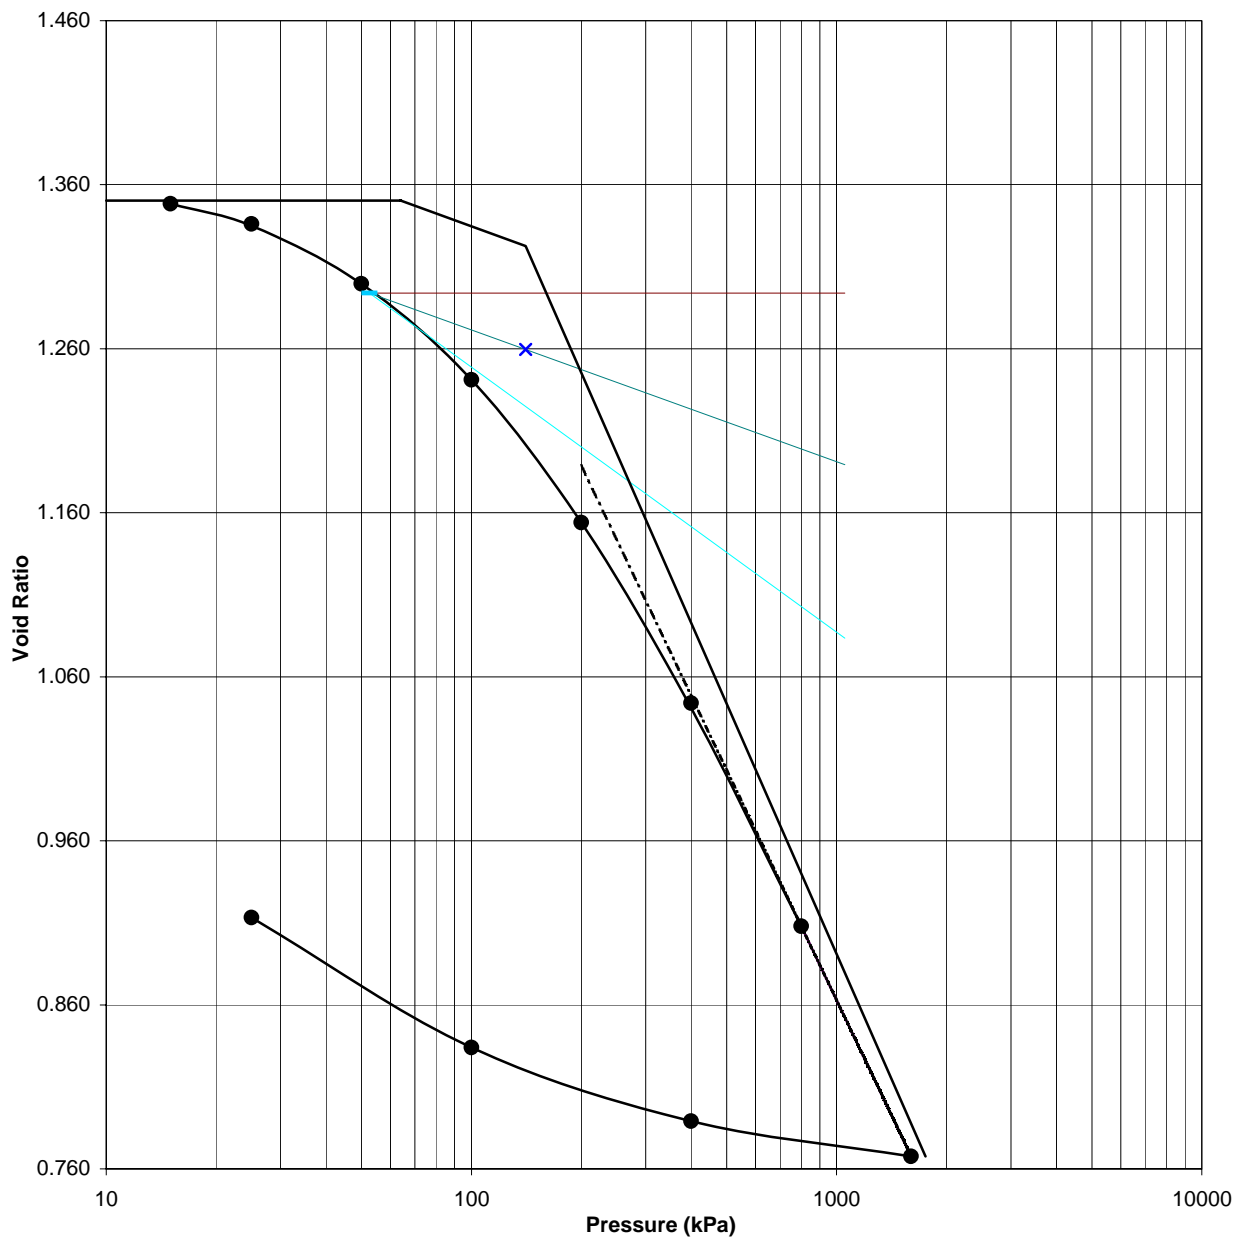


Bore hole No.: BH-5		Depth : 5.50m	
Initial Void Ratio, $e_0$	= 1.3503	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 64 kPa		
Compression Index $C_c$	= 0.5069	25 - 50	0.000621
$C_c/(1+e_0)$	= 0.2157	50 - 100	0.000499
Pre-consolidation Pressure, $p_c$	= 141 kPa	100 - 200	0.000370
Swelling Index, $C_s$	= 0.0806	200 - 400	0.000234
Recompression Index, $C_r$	$\approx$ 0.0806	400 - 800	0.000145
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/42

**e-logp curve**

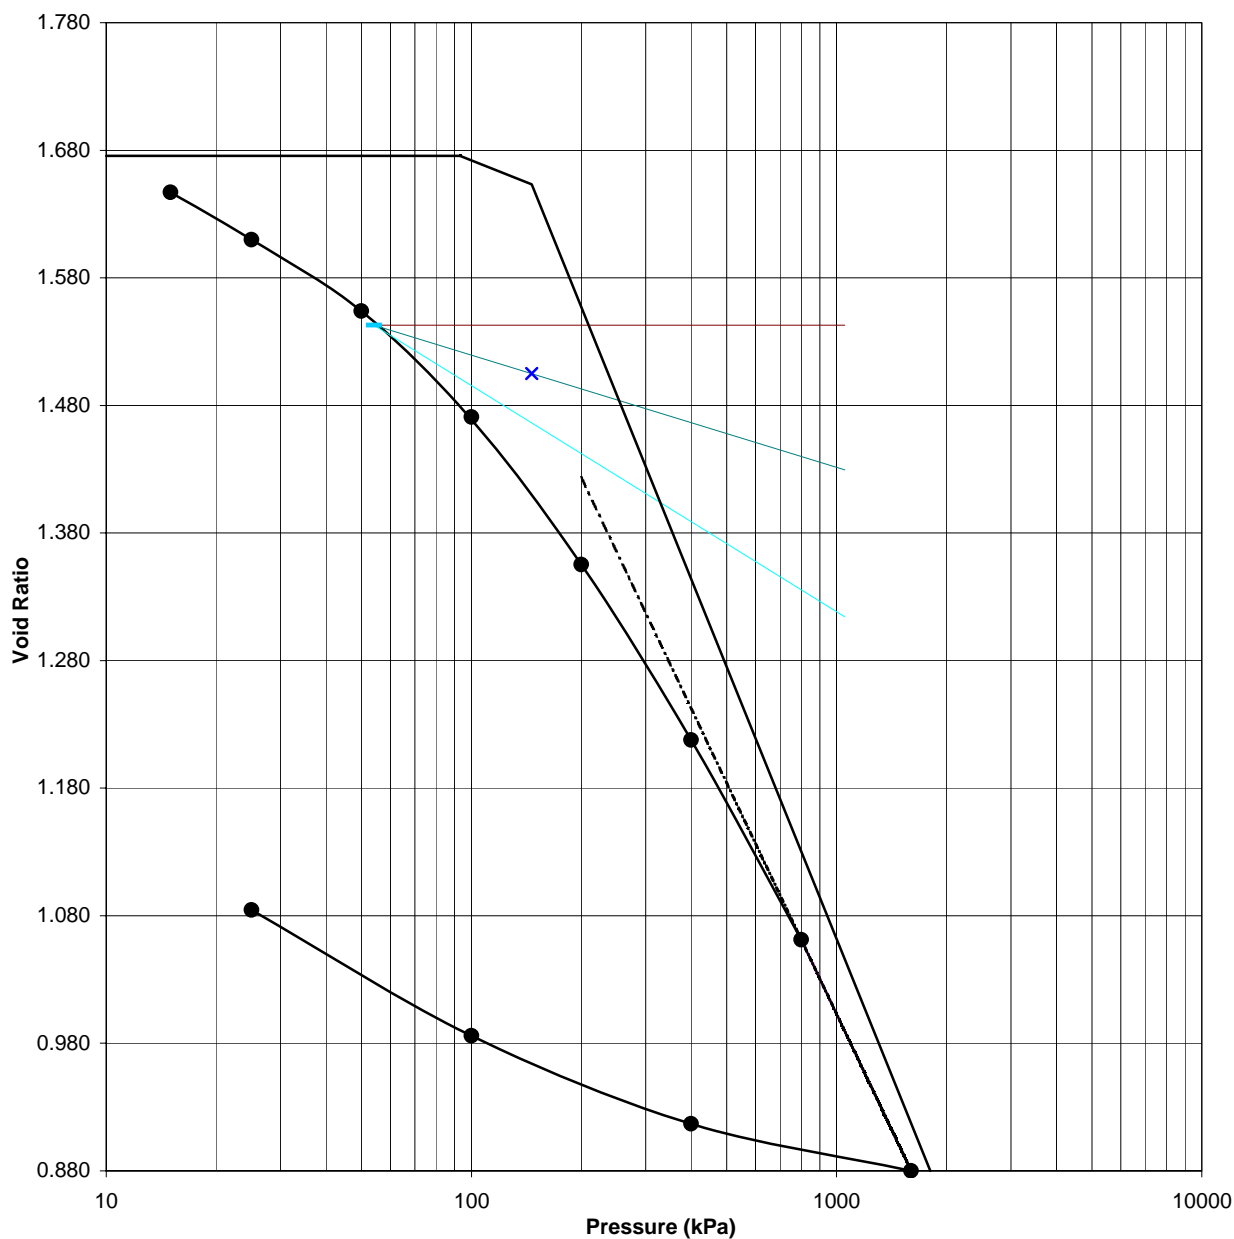


Bore hole No.: BH-5		Depth : 7.00m	
Initial Void Ratio, $e_0$	= 1.6755	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 93 kPa		
Compression Index $C_c$	= 0.7084	25 - 50	0.000837
$C_c/(1+e_0)$	= 0.2648	50 - 100	0.000621
Pre-consolidation Pressure, $p_c$	= 146 kPa	100 - 200	0.000433
Swelling Index, $C_s$	= 0.1132	200 - 400	0.000257
Recompression Index, $C_r$	$\approx$ 0.1132	400 - 800	0.000146
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/43

**e-logp curve**

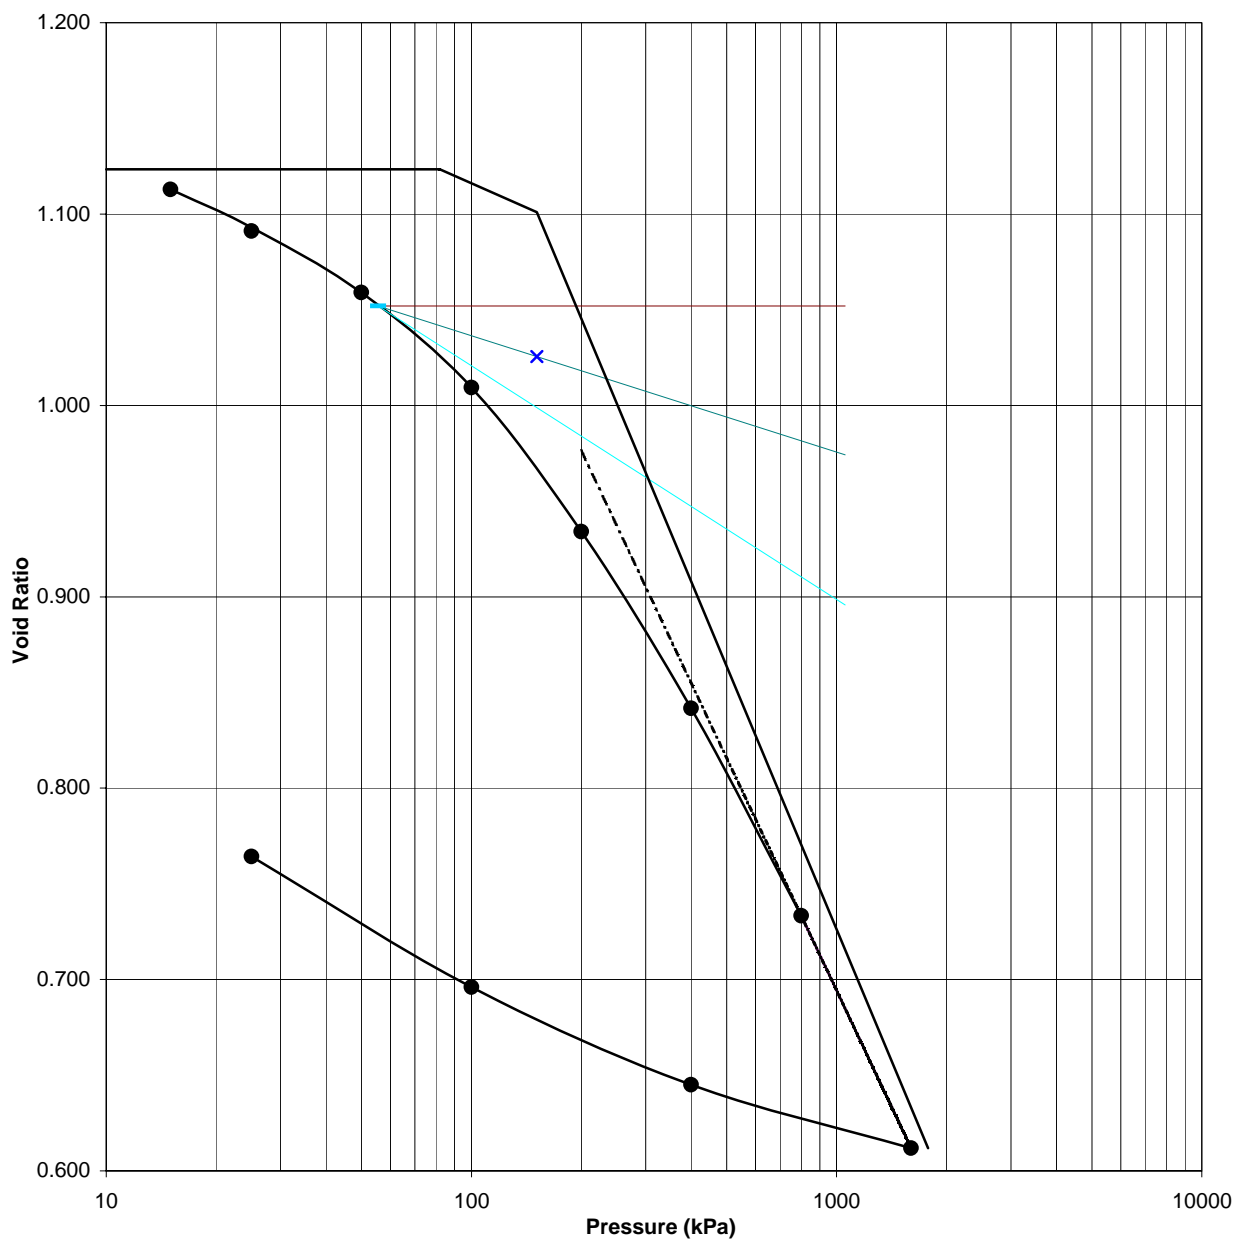

Bore hole No.: BH-5		Depth : 8.50m	
Initial Void Ratio, $e_0$	= 1.1234	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 82 kPa		
Compression Index $C_c$	= 0.4564	25 - 50	0.000605
$C_c/(1+e_0)$	= 0.2149	50 - 100	0.000468
Pre-consolidation Pressure, $p_c$	= 151 kPa	100 - 200	0.000354
Swelling Index, $C_s$	= 0.0844	200 - 400	0.000217
Recompression Index, $C_r$	$\approx$ 0.0844	400 - 800	0.000128
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/44


**e-logp curve**

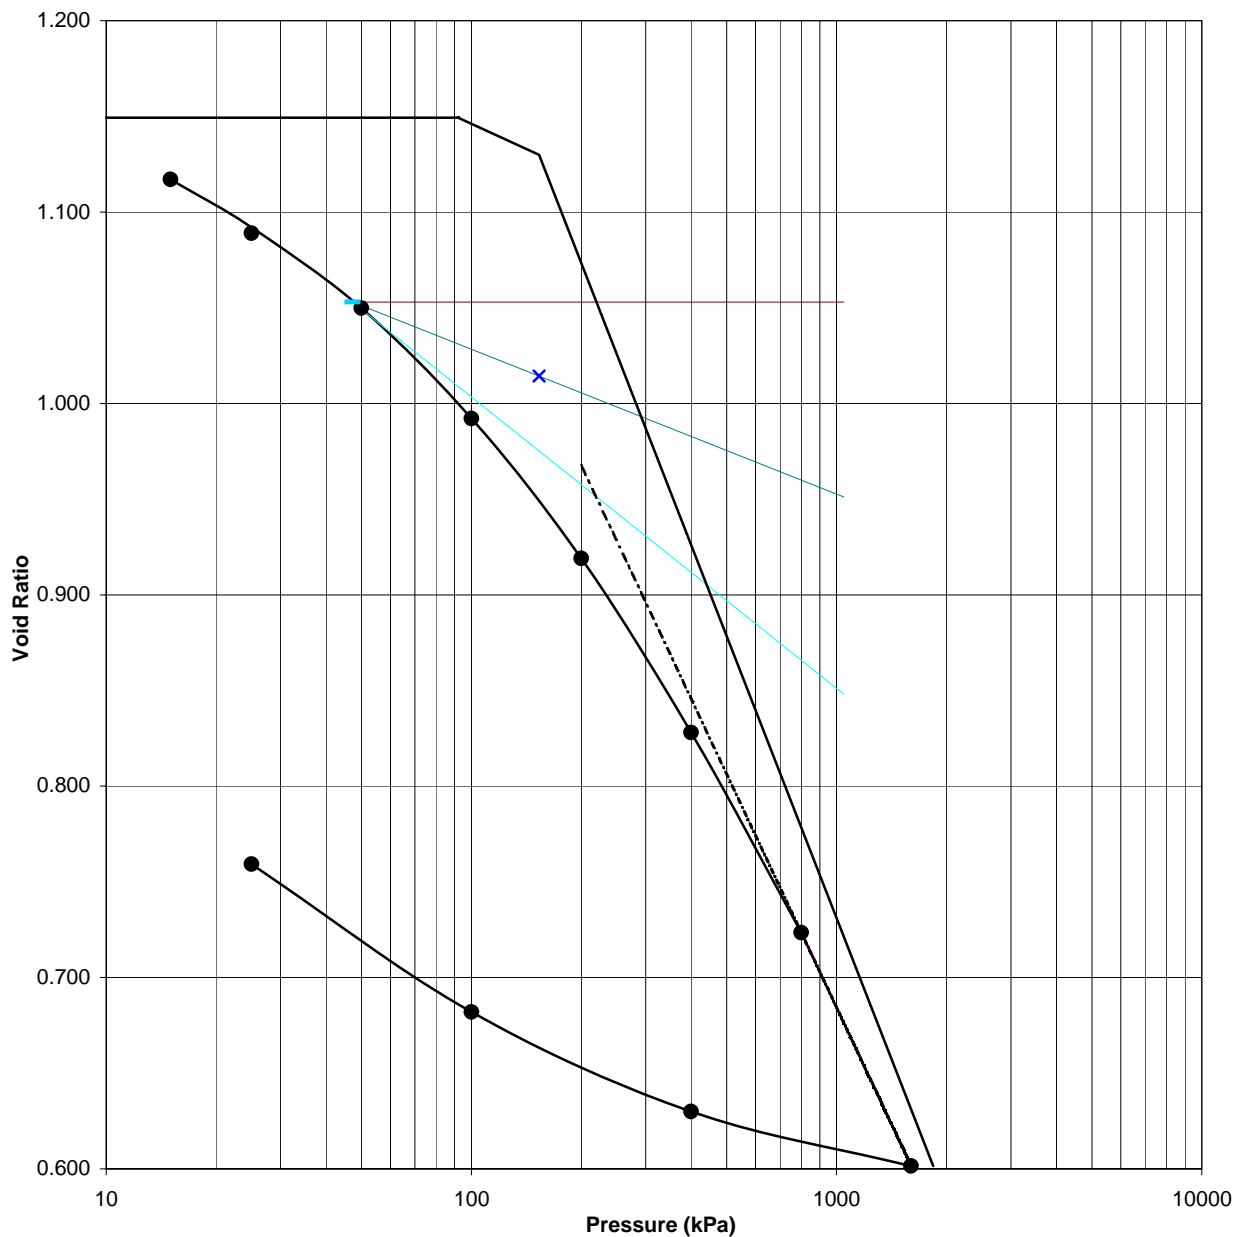

Bore hole No.: BH-5		Depth : 10.00m	
Initial Void Ratio, $e_0$	= 1.1493	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 92 kPa		
Compression Index $C_c$	= 0.4896	25 - 50	0.000729
$C_c/(1+e_0)$	= 0.2278	50 - 100	0.000537
Pre-consolidation Pressure, $p_c$	= 153 kPa	100 - 200	0.000340
Swelling Index, $C_s$	= 0.0873	200 - 400	0.000212
Recompression Index, $C_r$	$\approx$ 0.0873	400 - 800	0.000122
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/45




**e-logp curve**

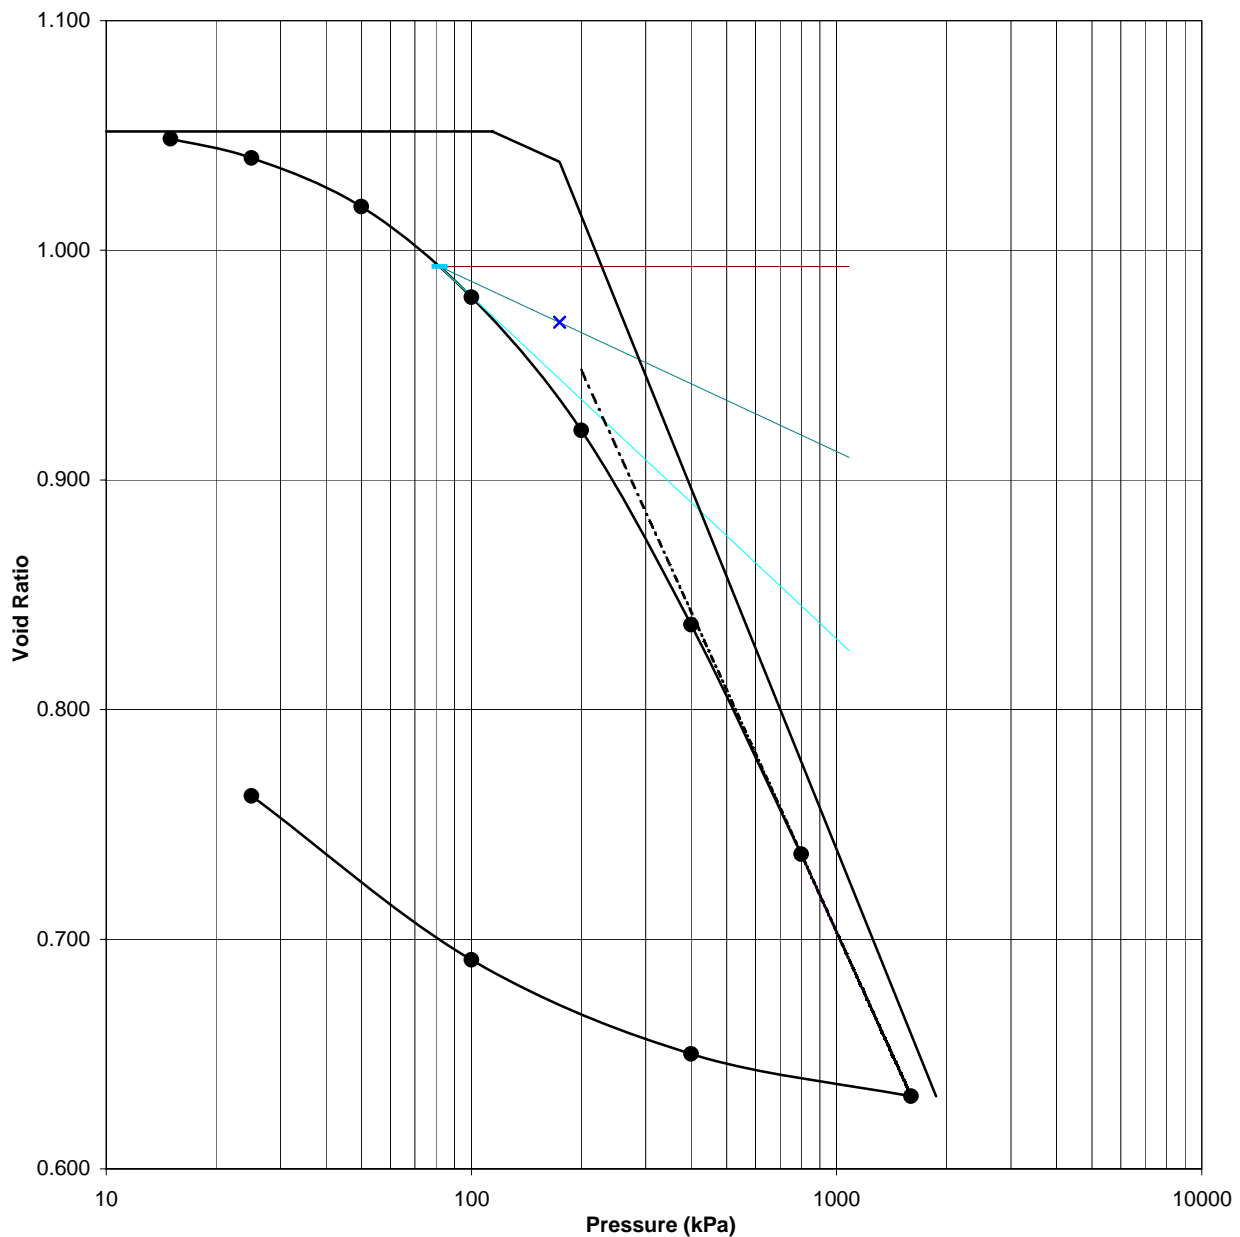


Bore hole No.: BH-5		Depth : 13.00m	
Initial Void Ratio, $e_0$	= 1.0518	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 114 kPa		
Compression Index $C_c$	= 0.3945	25 - 50	0.000413
$C_c/(1+e_0)$	= 0.1923	50 - 100	0.000385
Pre-consolidation Pressure, $p_c$	= 174 kPa	100 - 200	0.000283
Swelling Index, $C_s$	= 0.0724	200 - 400	0.000206
Recompression Index, $C_r$	≈ 0.0724	400 - 800	0.000122
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			<b>Job No. :</b>
			CCPL/20101211
			<b>Fig. No.</b>
			G/46

**e-logp curve**

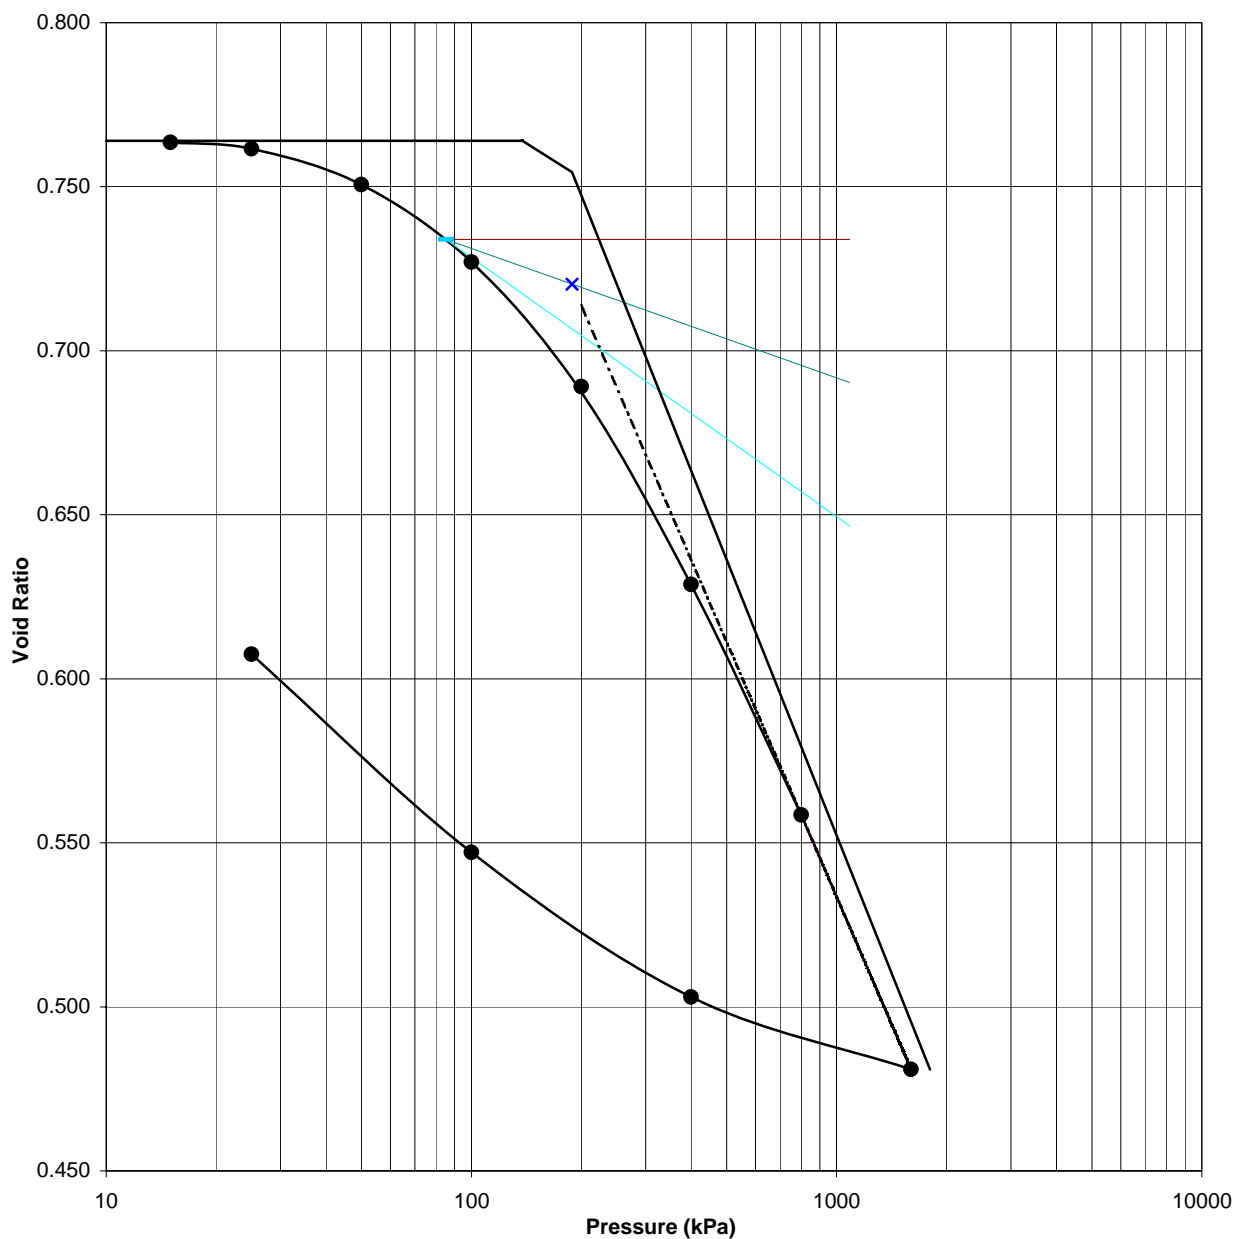


Bore hole No.: BH-5		Depth : 16.00m	
Initial Void Ratio, $e_0$	= 0.7640	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 138 kPa		
Compression Index $C_c$	= 0.2791	25 - 50	0.000247
$C_c/(1+e_0)$	= 0.1582	50 - 100	0.000267
Pre-consolidation Pressure, $p_c$	= 189 kPa	100 - 200	0.000216
Swelling Index, $C_s$	= 0.0701	200 - 400	0.000171
Recompression Index, $C_r$	≈ 0.0701	400 - 800	0.000099
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/47

**e-logp curve**

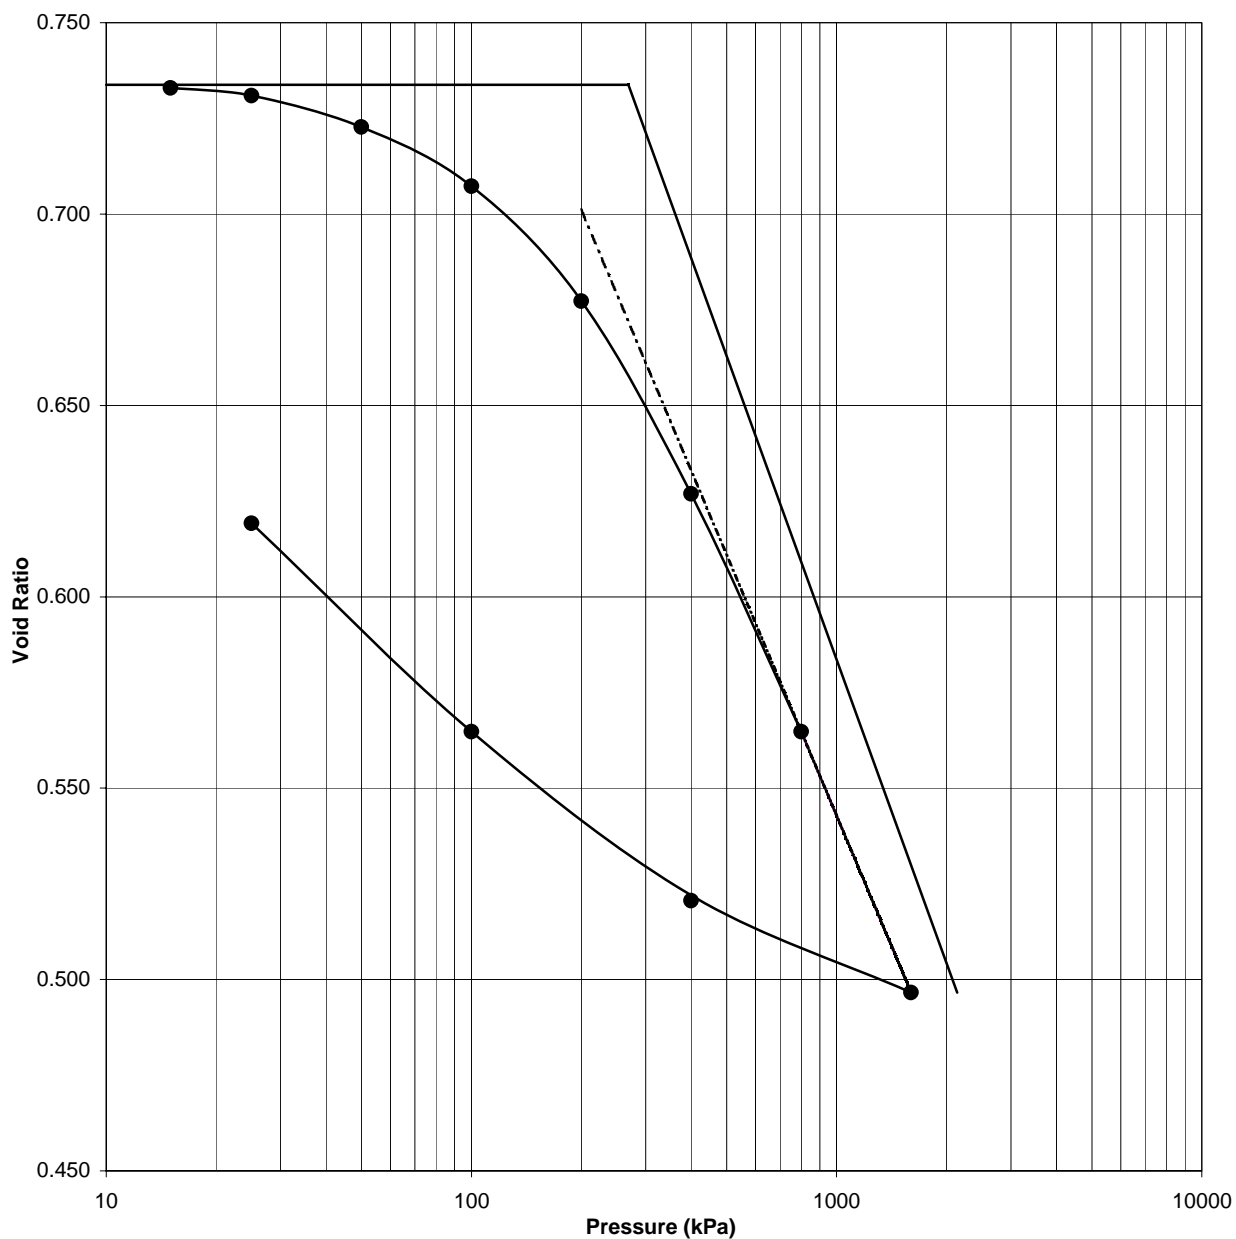


Bore hole No.: BH-5		Depth : 29.50m	
Initial Void Ratio, $e_0$	= 0.7338	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 269 kPa		
Compression Index $C_c$	= 0.2634	25 - 50	0.000191
$C_c/(1+e_0)$	= 0.1519	50 - 100	0.000178
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000173
Swelling Index, $C_s$	= 0.0679	200 - 400	0.000145
Recompression Index, $C_r$	$\approx$ 0.0679	400 - 800	0.000090
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/48

**e-logp curve**

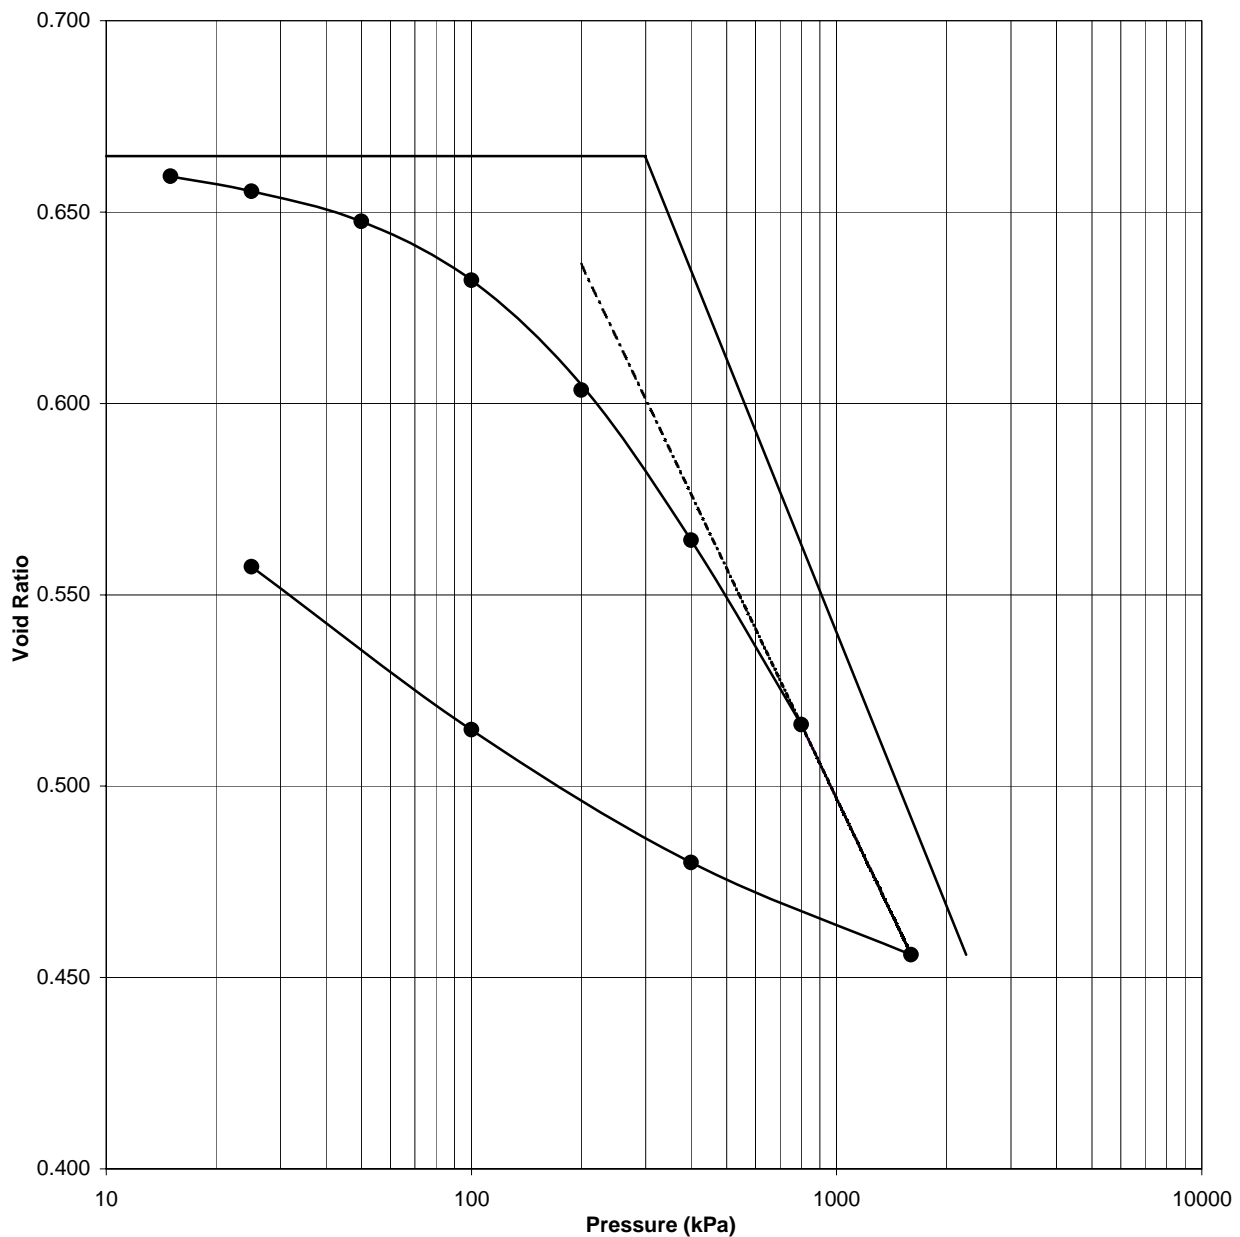


Bore hole No.: BH-5		Depth : 32.50m	
Initial Void Ratio, $e_0$	= 0.6646	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 299 kPa		
Compression Index $C_c$	= 0.2372	25 - 50	0.000188
$C_c/(1+e_0)$	= 0.1425	50 - 100	0.000185
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000172
Swelling Index, $C_s$	= 0.0561	200 - 400	0.000118
Recompression Index, $C_r$	$\approx$ 0.0561	400 - 800	0.000072
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			<b>Job No. :</b>
			CCPL/20101211
			<b>Fig. No.</b>
			G/49

**e-logp curve**

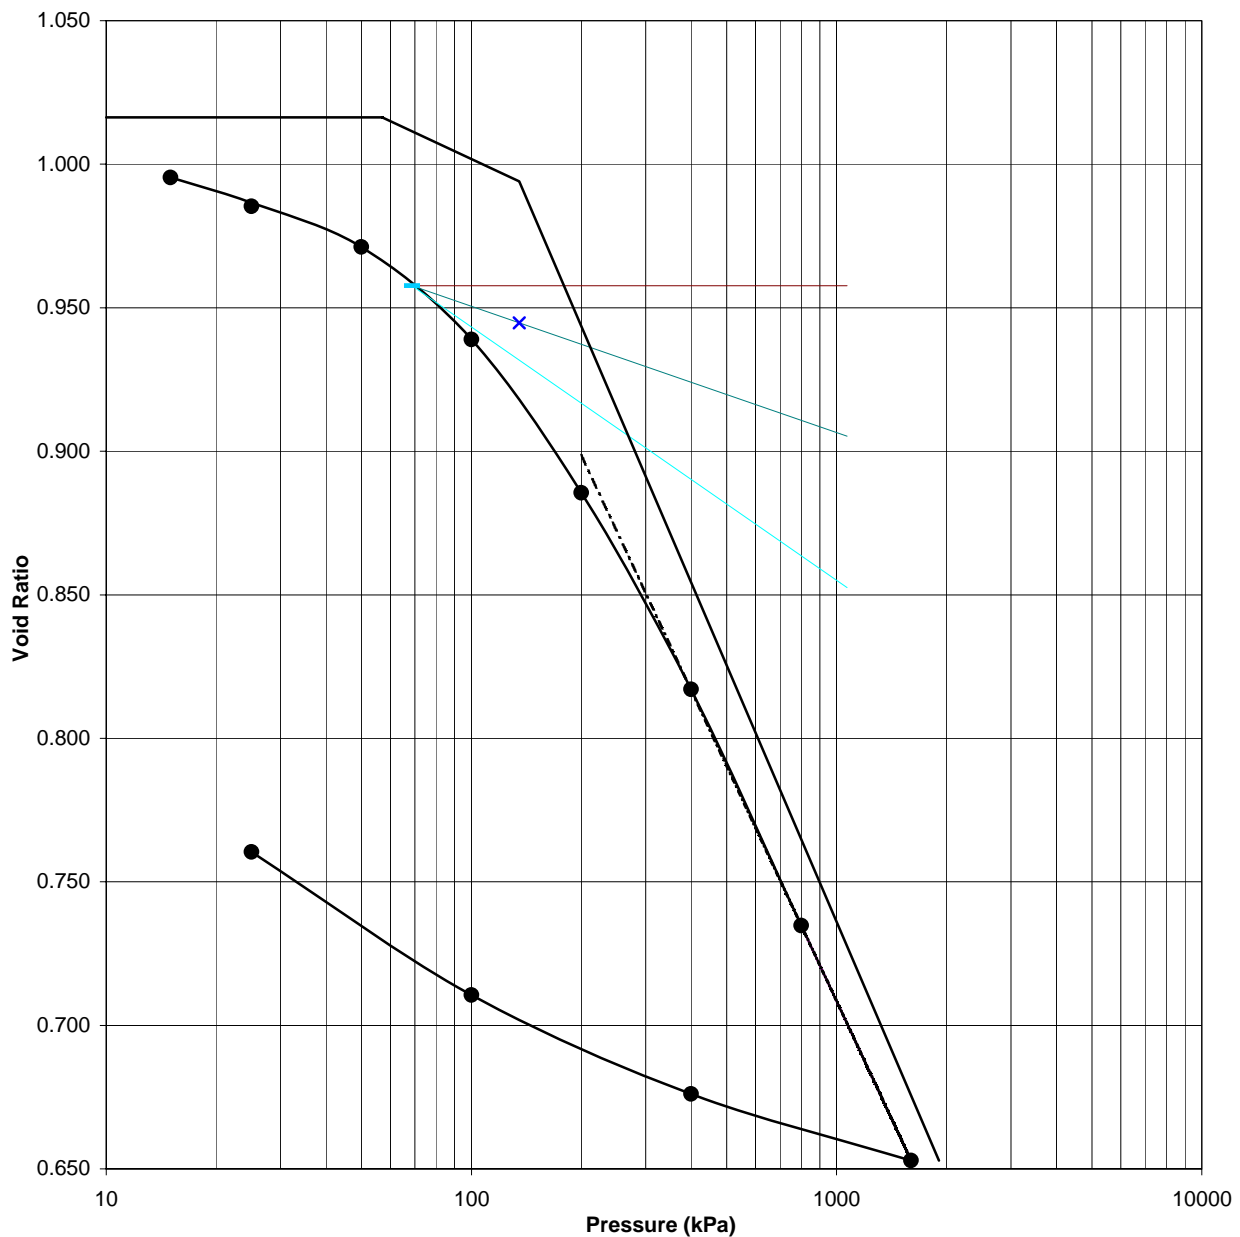


Bore hole No.: BH-6		Depth : 4.50m	
Initial Void Ratio, $e_0$	= 1.0163	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 57 kPa		
Compression Index $C_c$	= 0.2968	25 - 50	0.000281
$C_c/(1+e_0)$	= 0.1472	50 - 100	0.000320
Pre-consolidation Pressure, $p_c$	= 135 kPa	100 - 200	0.000265
Swelling Index, $C_s$	= 0.0595	200 - 400	0.000170
Recompression Index, $C_r$	$\approx$ 0.0595	400 - 800	0.000102
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/50


**e-logp curve**

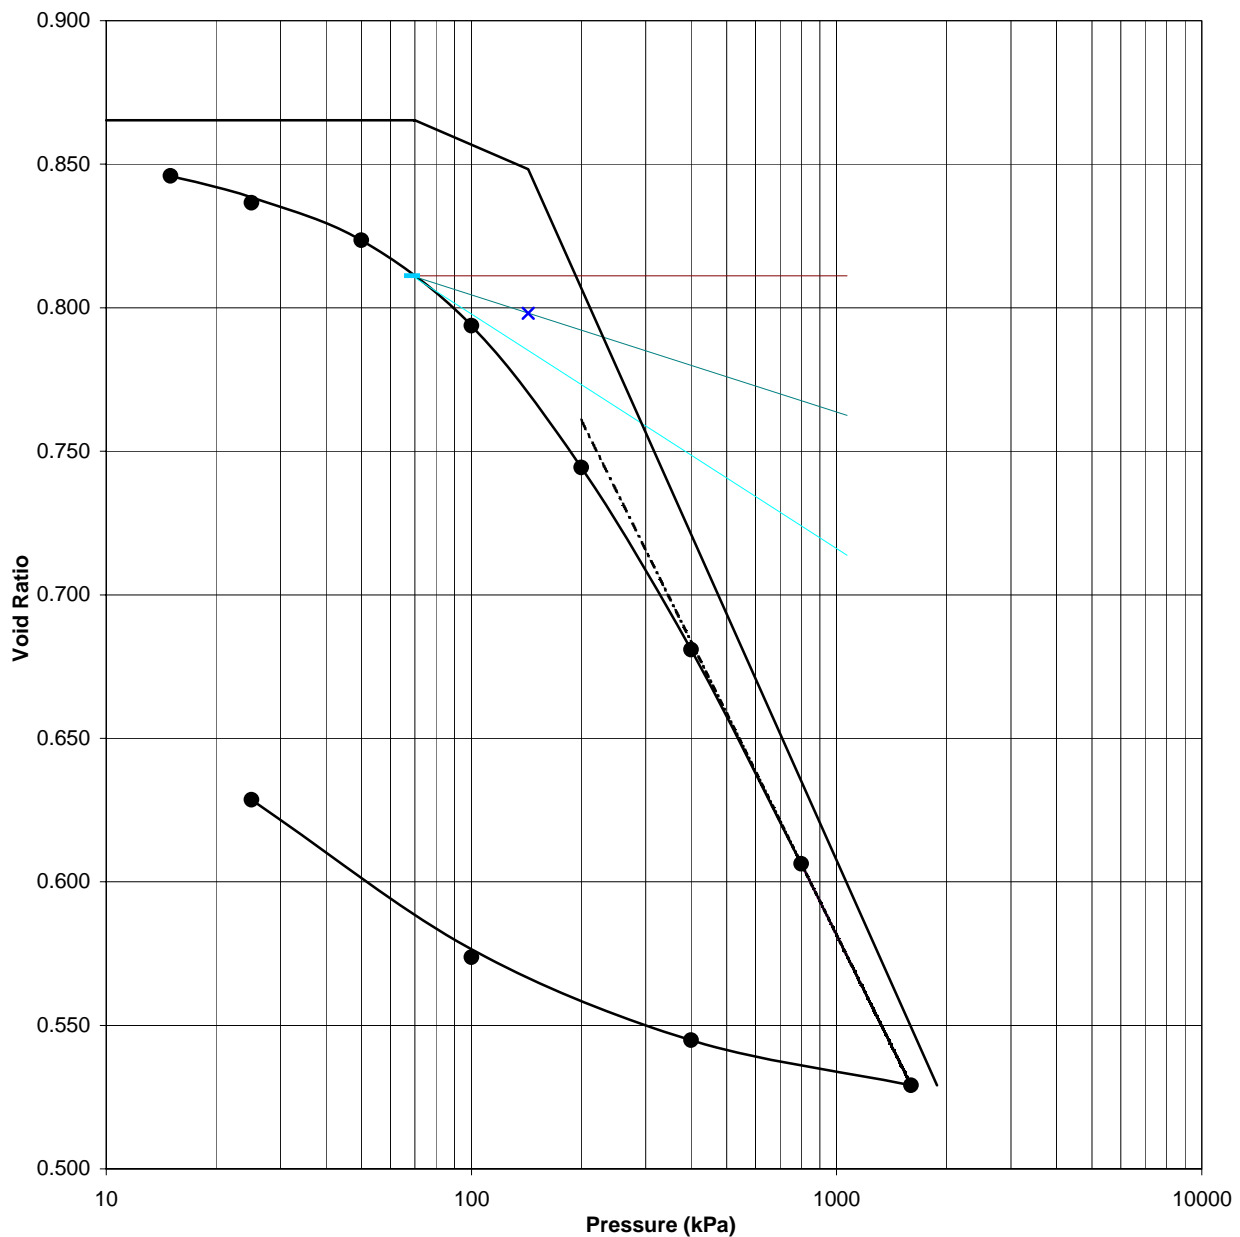

Bore hole No.: BH-6		Depth : 6.00m	
Initial Void Ratio, $e_0$	= 0.8653	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 70 kPa		
Compression Index $C_c$	= 0.2850	25 - 50	0.000281
$C_c/(1+e_0)$	= 0.1528	50 - 100	0.000320
Pre-consolidation Pressure, $p_c$	= 143 kPa	100 - 200	0.000265
Swelling Index, $C_s$	= 0.0551	200 - 400	0.000170
Recompression Index, $C_r$	≈ 0.0551	400 - 800	0.000100
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/51




**e-logp curve**

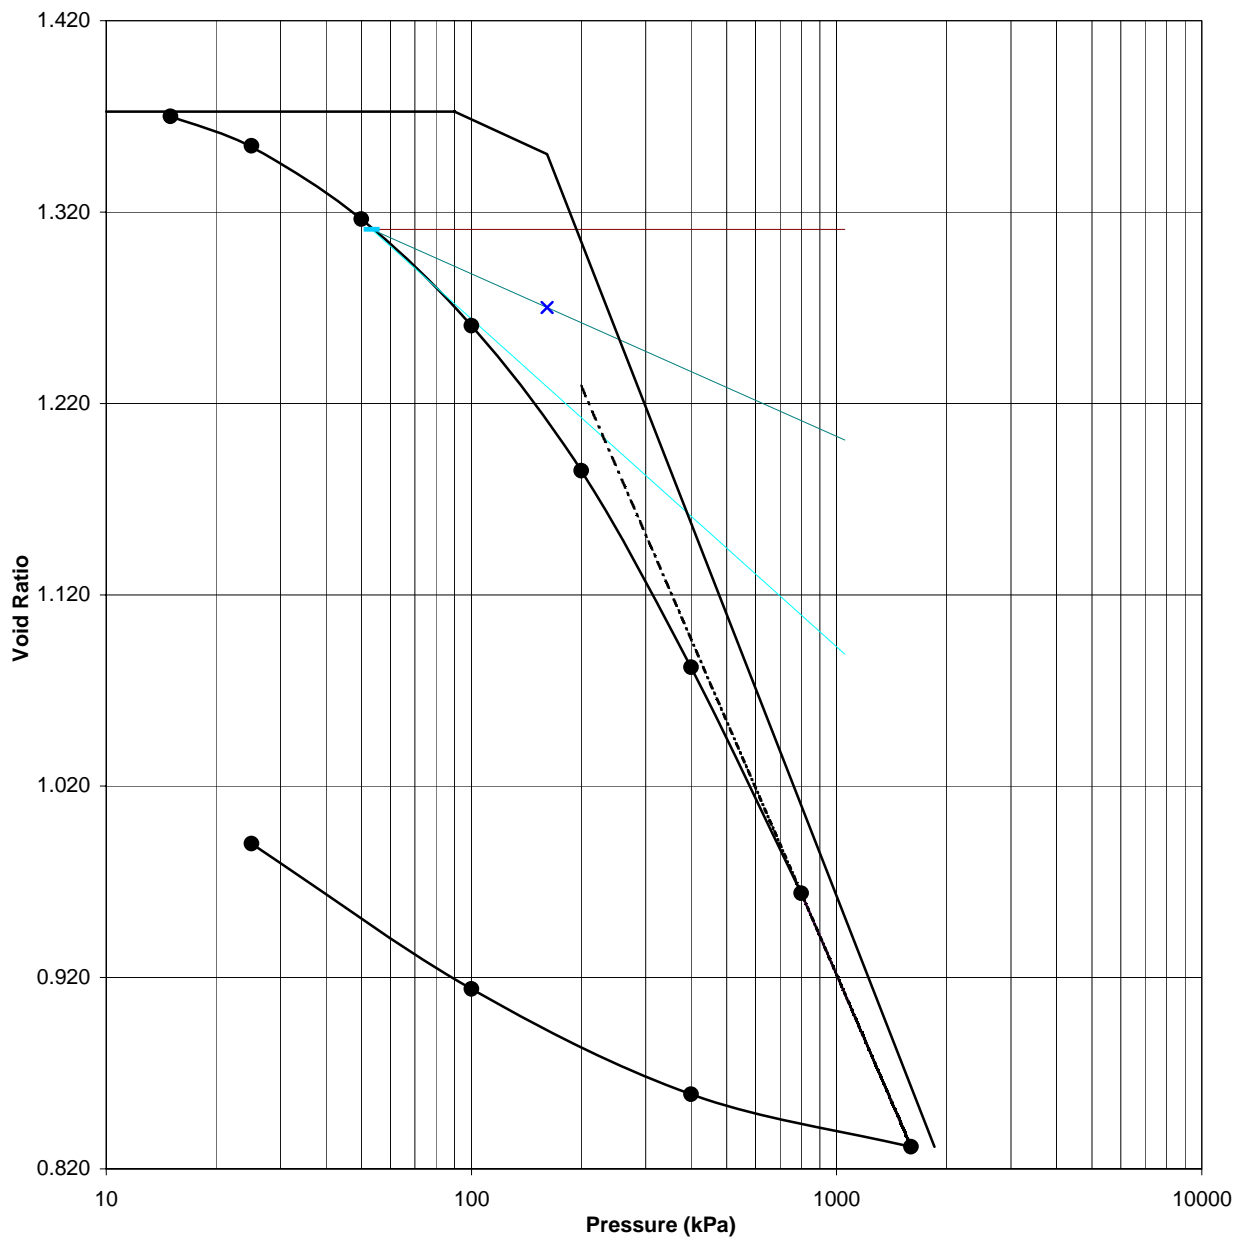

Bore hole No.: BH-6		Depth : 9.00m	
Initial Void Ratio, $e_0$	= 1.3725	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 90 kPa		
Compression Index $C_c$	= 0.4888	25 - 50	0.000646
$C_c/(1+e_0)$	= 0.2060	50 - 100	0.000470
Pre-consolidation Pressure, $p_c$	= 161 kPa	100 - 200	0.000320
Swelling Index, $C_s$	= 0.0877	200 - 400	0.000216
Recompression Index, $C_r$	$\approx$ 0.0877	400 - 800	0.000124
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/53




**e-logp curve**

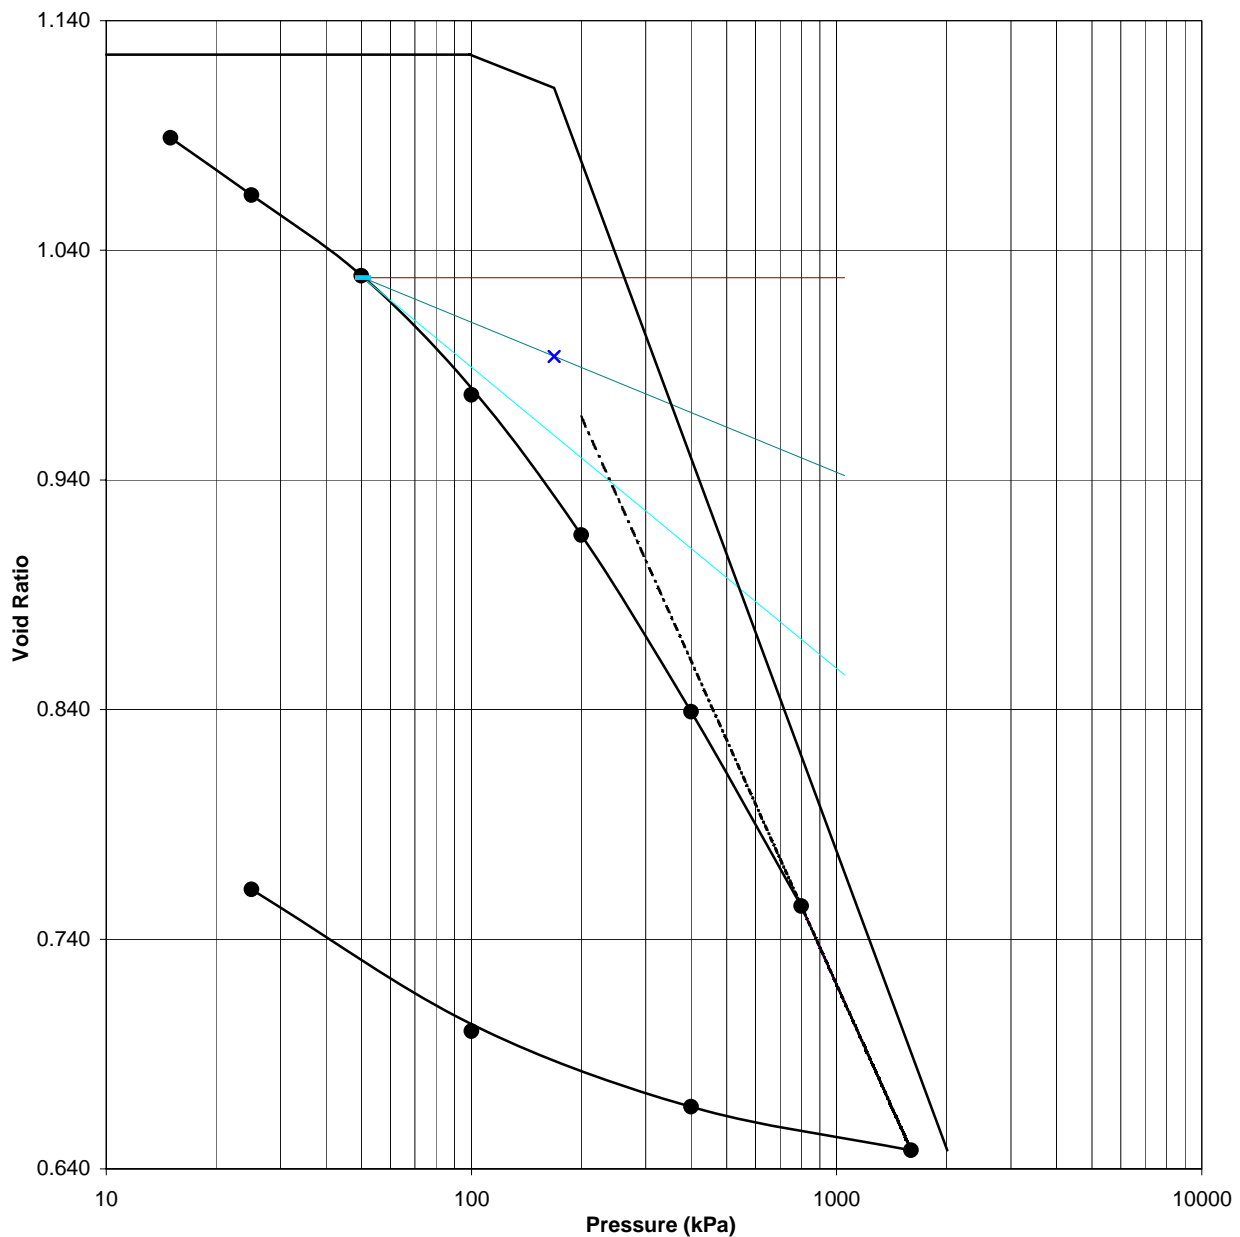


Bore hole No.: BH-6		Depth : 10.50m	
Initial Void Ratio, $e_0$	= 1.1252	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 99 kPa		
Compression Index $C_c$	= 0.4297	25 - 50	0.000661
$C_c/(1+e_0)$	= 0.2022	50 - 100	0.000489
Pre-consolidation Pressure, $p_c$	= 168 kPa	100 - 200	0.000287
Swelling Index, $C_s$	= 0.0629	200 - 400	0.000181
Recompression Index, $C_r$	$\approx$ 0.0629	400 - 800	0.000099
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/54

**e-logp curve**

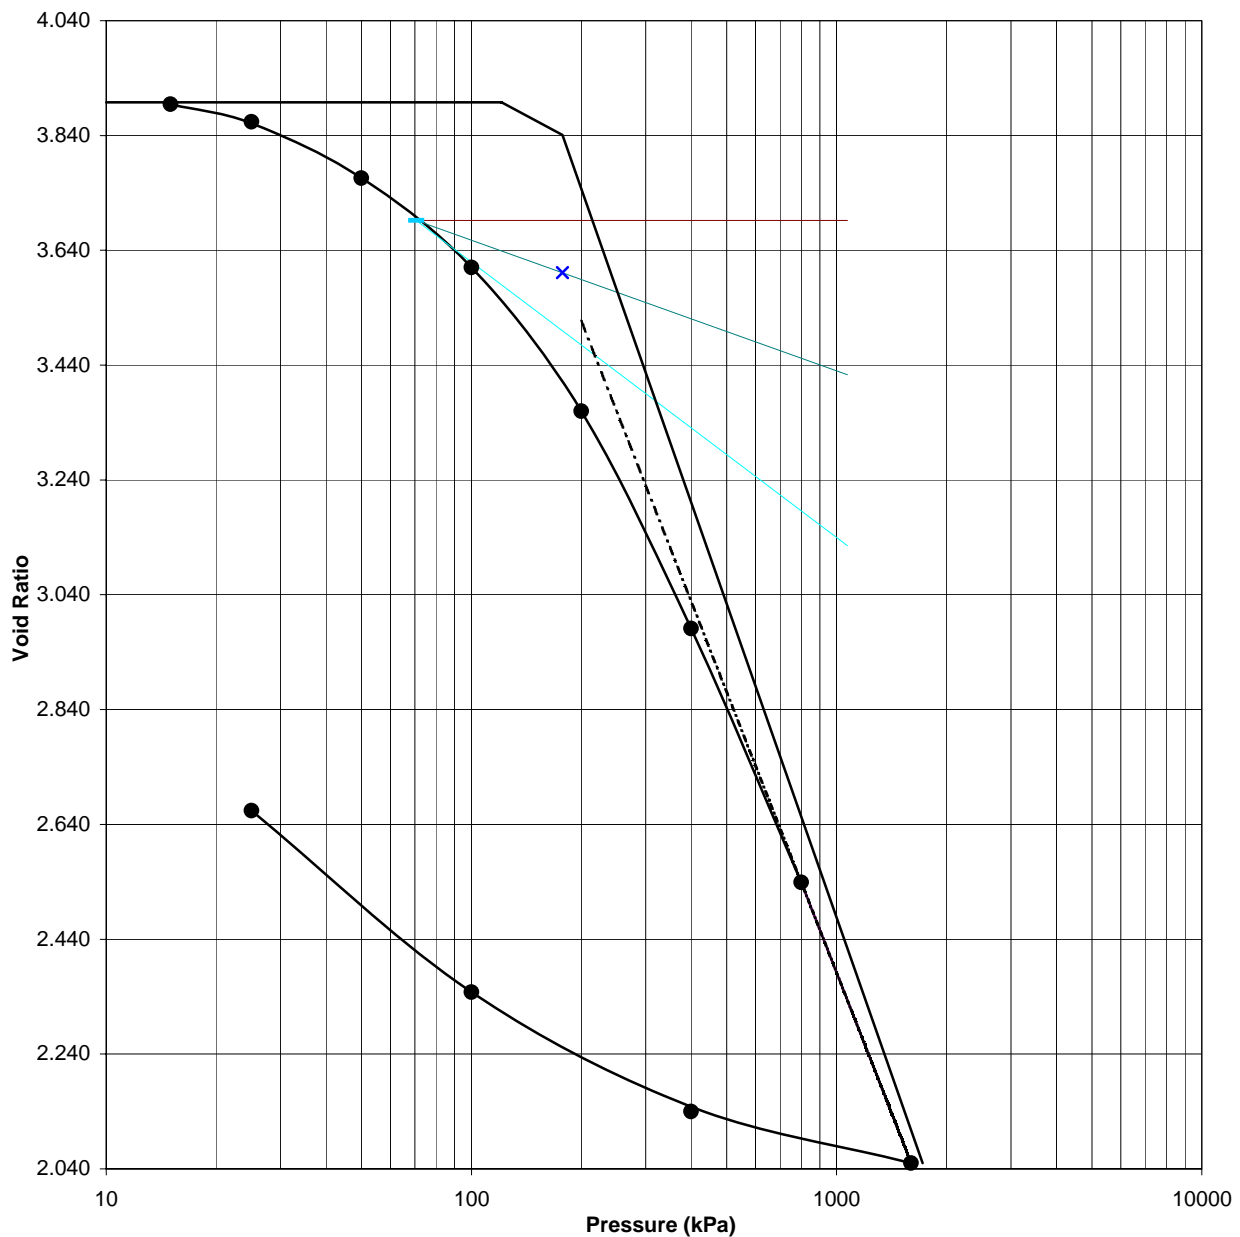


Bore hole No.: BH-6		Depth : 13.50m		
Initial Void Ratio, $e_0$	=	3.8976	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) (m <sup>2</sup> /kN)
Effective Overburden Pressure, $p_0$	=	121 kPa		
Compression Index $C_c$	=	1.8146	25 - 50	0.000800
$C_c/(1+e_0)$	=	0.3705	50 - 100	0.000637
Pre-consolidation Pressure, $p_c$	=	177 kPa	100 - 200	0.000510
Swelling Index, $C_s$	=	0.3398	200 - 400	0.000387
Recompression Index, $C_r$	≈	0.3398	400 - 800	0.000226
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :	Fig. No.
			CCPL/20101211	G/55

**e-logp curve**

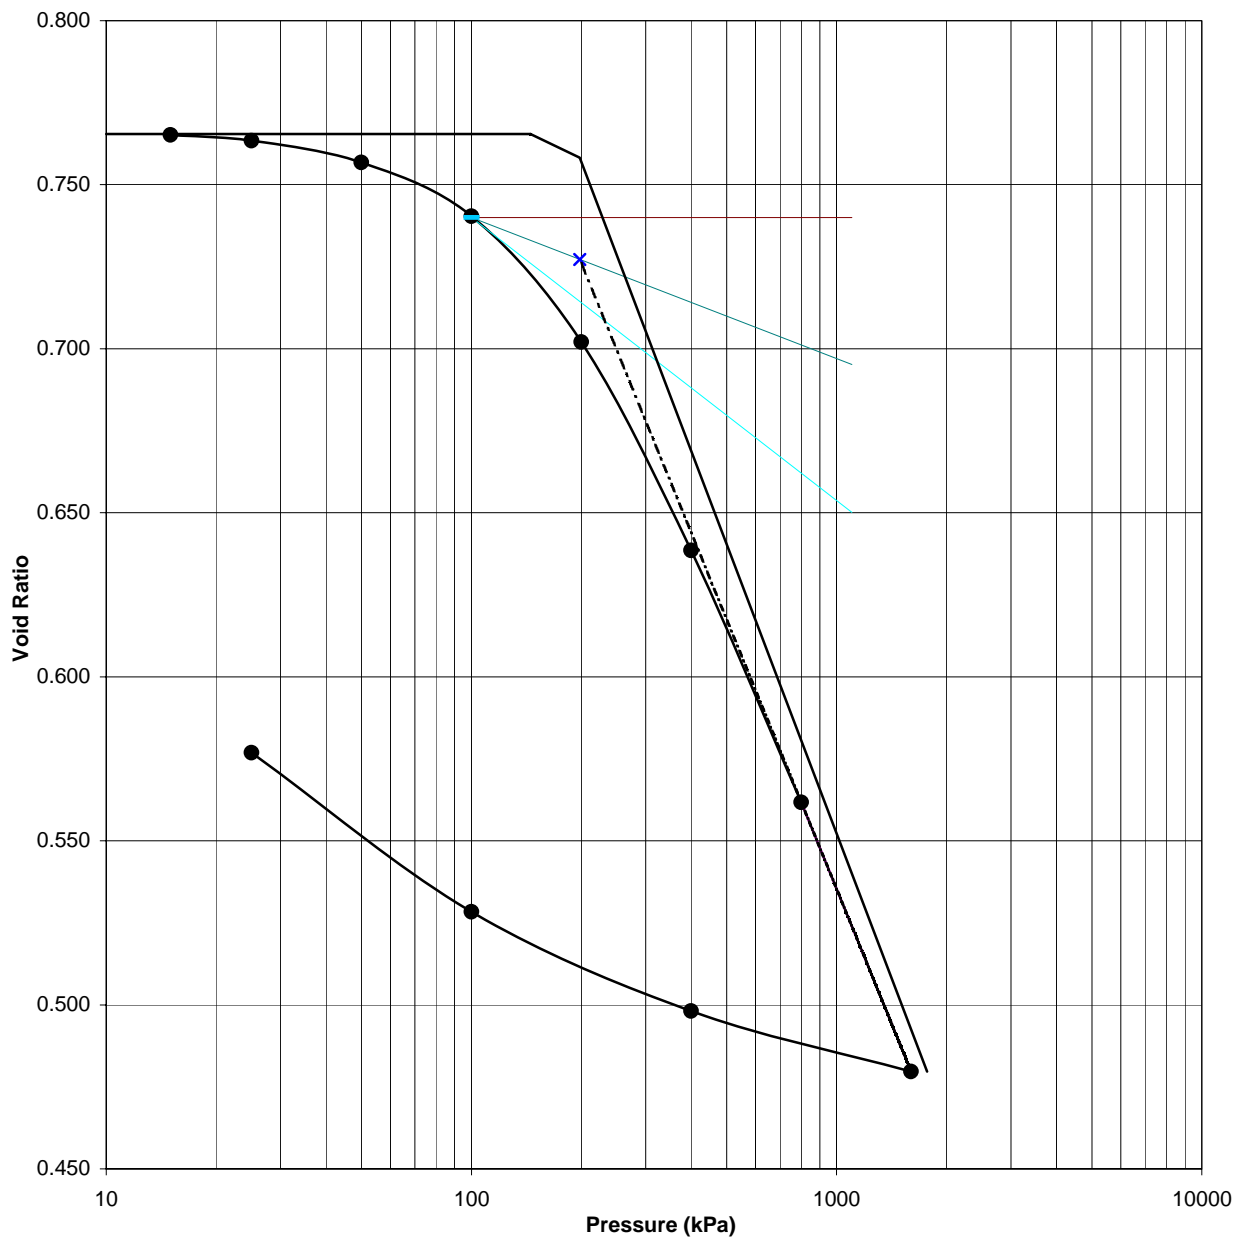


Bore hole No.: BH-6		Depth : 16.50m	
Initial Void Ratio, $e_0$	= 0.7655	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 145 kPa		
Compression Index $C_c$	= 0.2929	25 - 50	0.000148
$C_c/(1+e_0)$	= 0.1659	50 - 100	0.000186
Pre-consolidation Pressure, $p_c$	= 198 kPa	100 - 200	0.000217
Swelling Index, $C_s$	= 0.0538	200 - 400	0.000180
Recompression Index, $C_r$	$\approx$ 0.0538	400 - 800	0.000109
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/56

**e-logp curve**

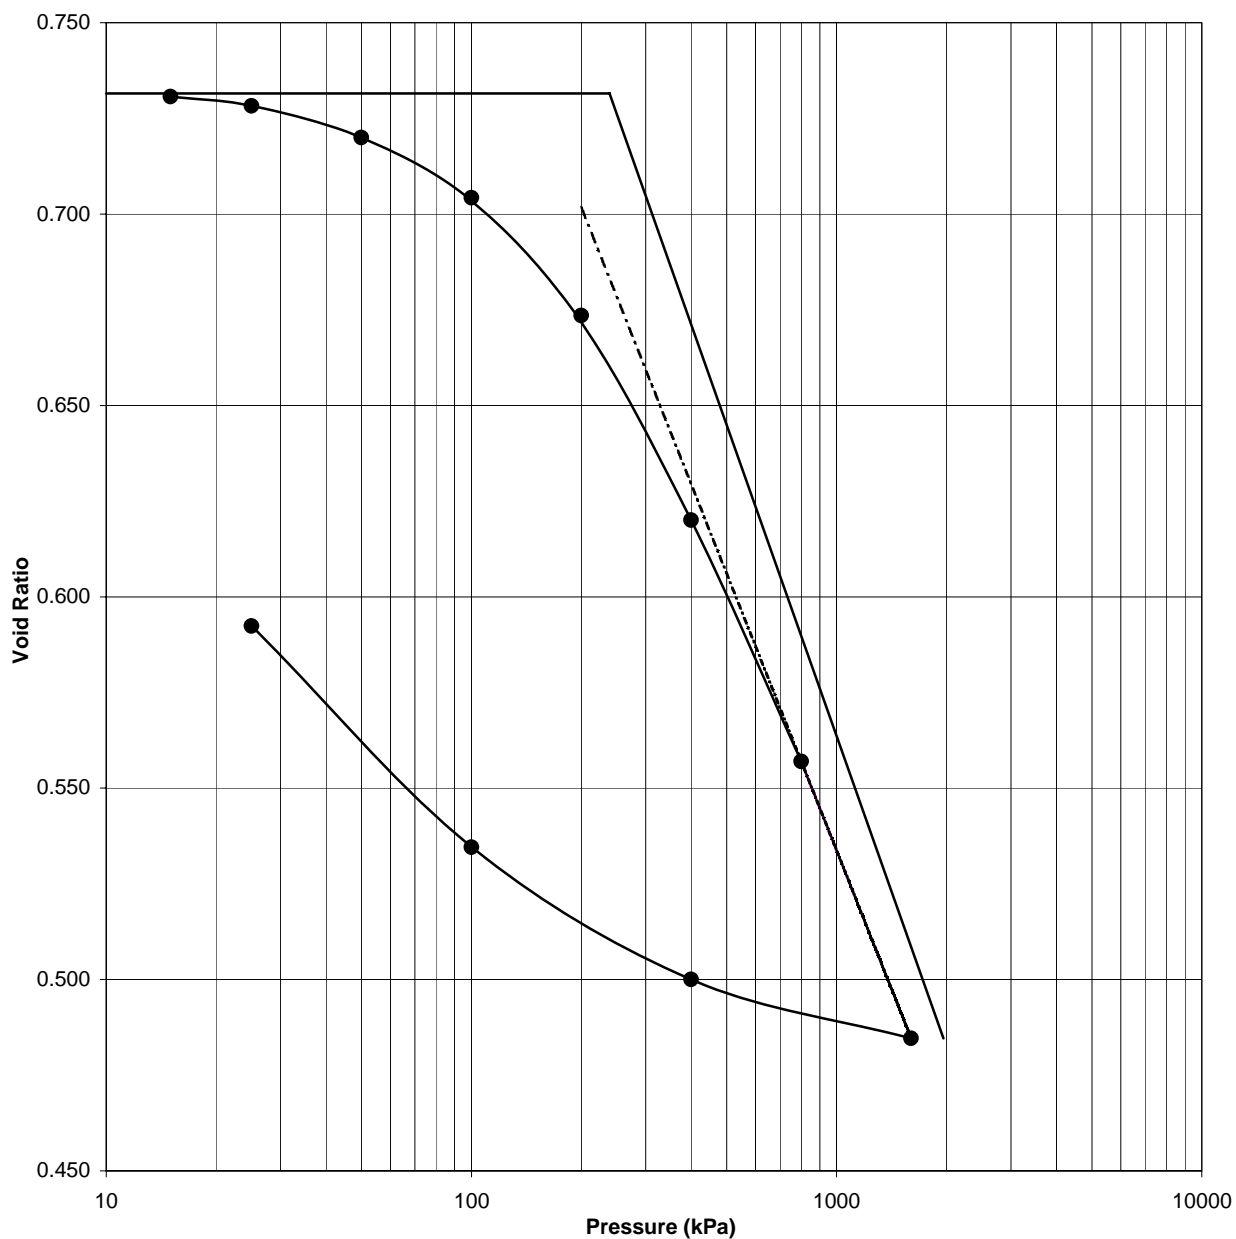


Bore hole No.: BH-6		Depth : 27.00m	
Initial Void Ratio, $e_0$	= 0.7315	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 239 kPa		
Compression Index $C_c$	= 0.2701	25 - 50	0.000191
$C_c/(1+e_0)$	= 0.1560	50 - 100	0.000181
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000178
Swelling Index, $C_s$	= 0.0597	200 - 400	0.000154
Recompression Index, $C_r$	$\approx$ 0.0597	400 - 800	0.000091
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/57

**e-logp curve**

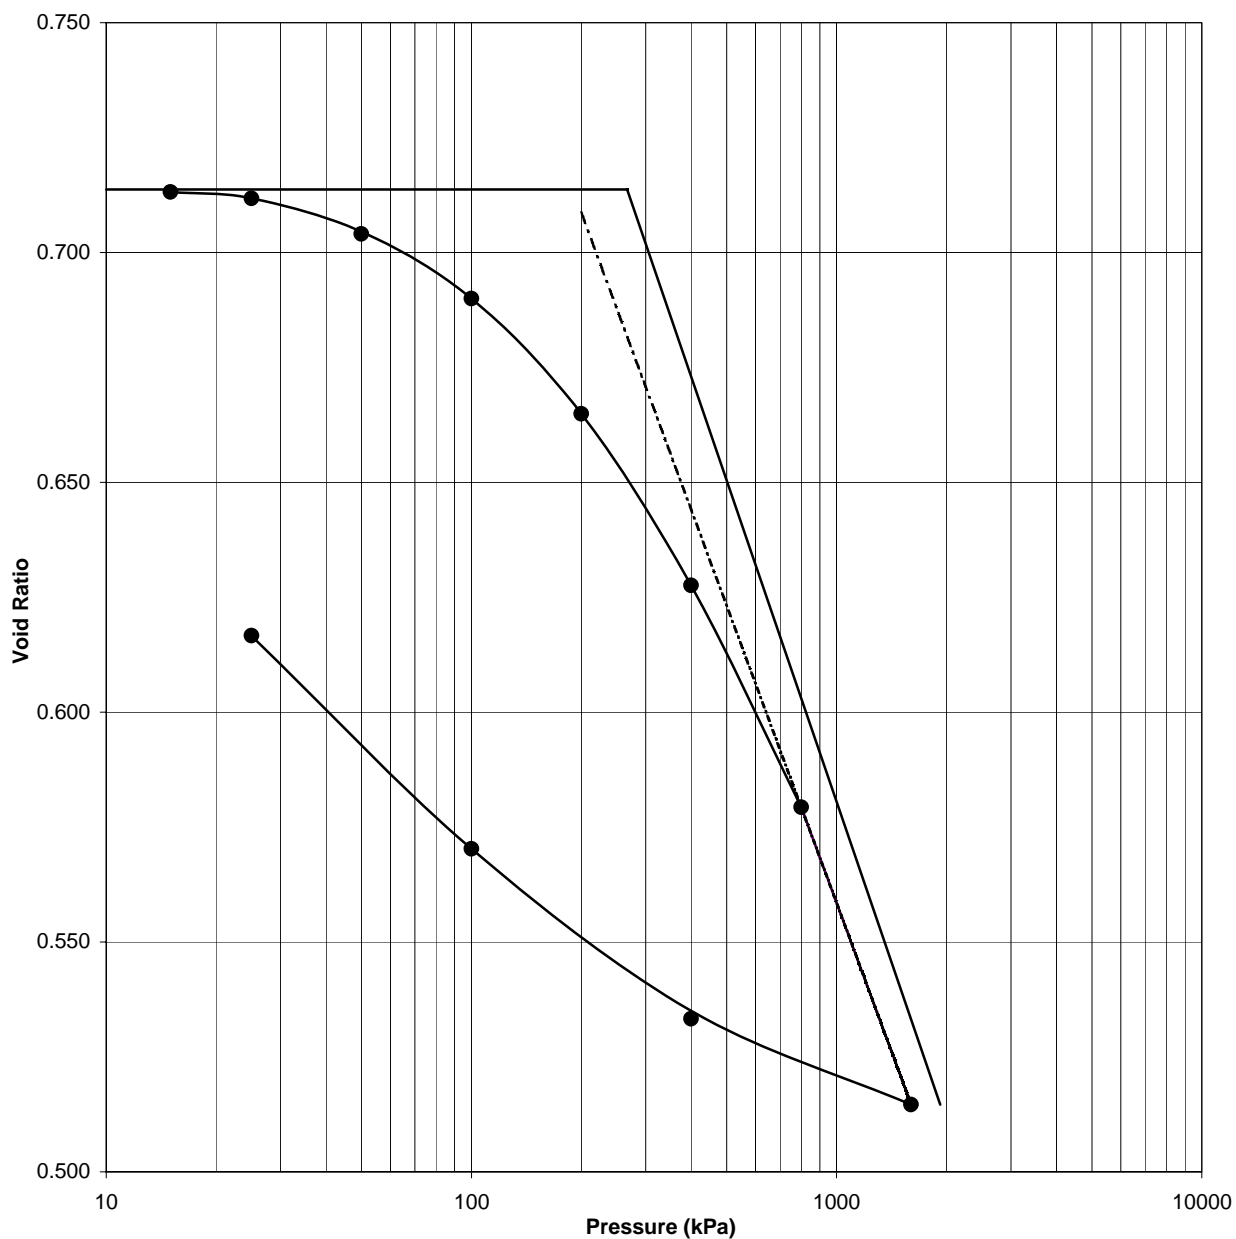


Bore hole No.: BH-6		Depth : 30.00m	
Initial Void Ratio, $e_0$	= 0.7137	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 267 kPa		
Compression Index $C_c$	= 0.2322	25 - 50	0.000181
$C_c/(1+e_0)$	= 0.1355	50 - 100	0.000164
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000146
Swelling Index, $C_s$	= 0.0565	200 - 400	0.000109
Recompression Index, $C_r$	$\approx$ 0.0565	400 - 800	0.000070
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/58

**e-logp curve**

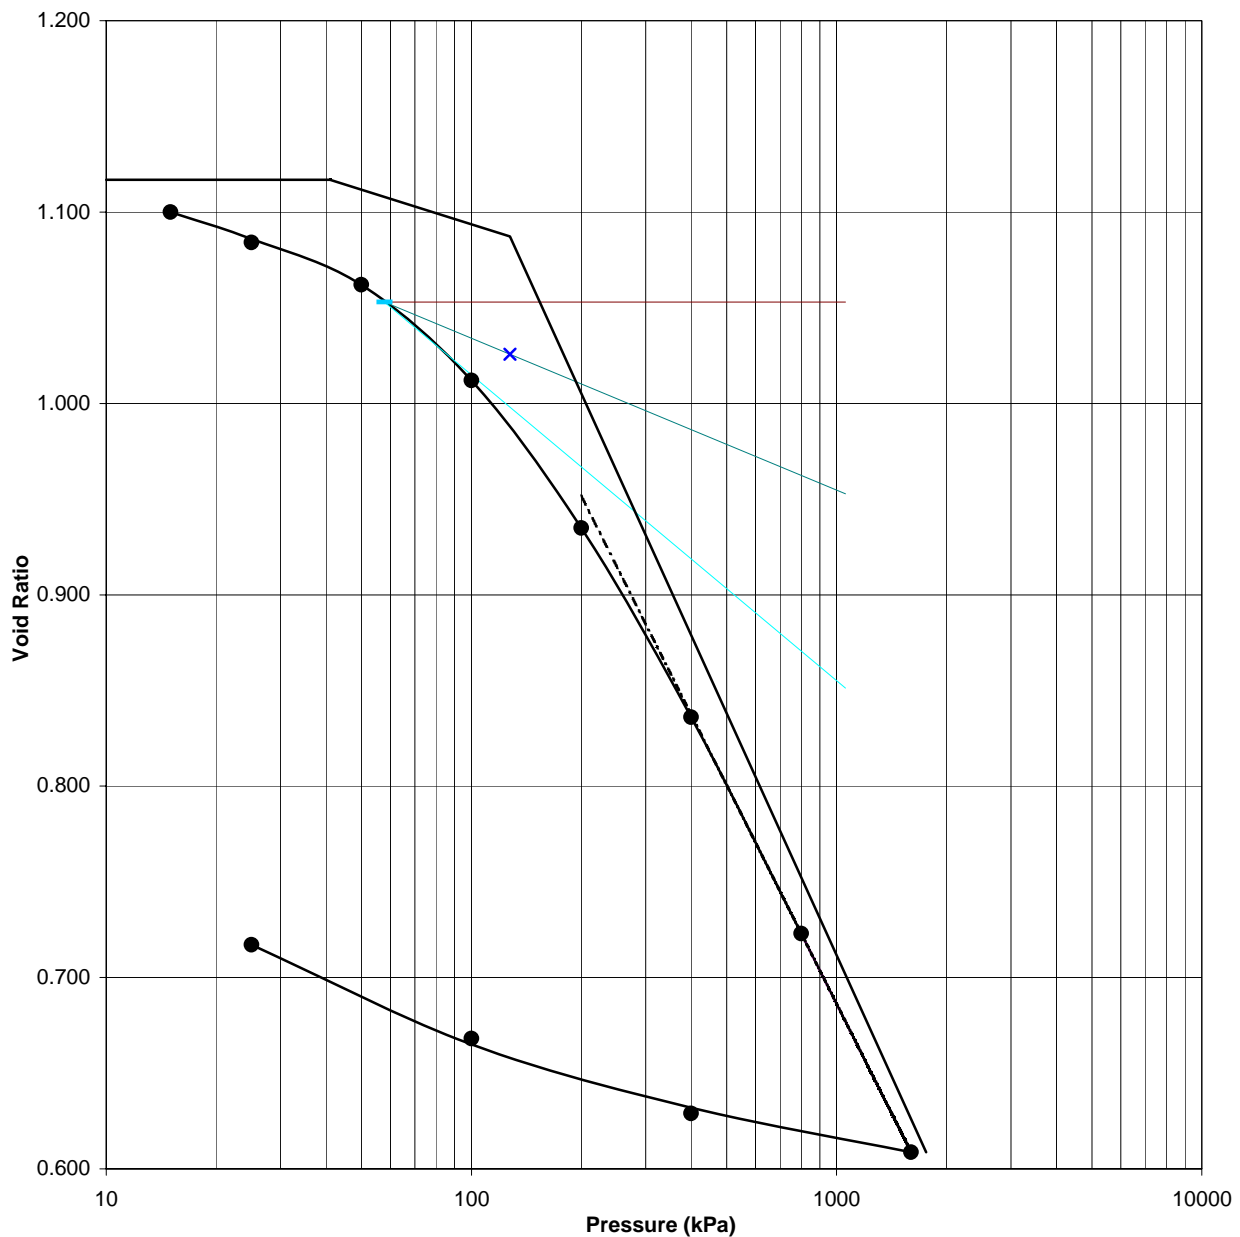


Bore hole No.: BH-7		Depth : 2.50m	
Initial Void Ratio, $e_0$	= 1.1168	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 41 kPa		
Compression Index $C_c$	= 0.4199	25 - 50	0.000415
$C_c/(1+e_0)$	= 0.1984	50 - 100	0.000473
Pre-consolidation Pressure, $p_c$	= 127 kPa	100 - 200	0.000364
Swelling Index, $C_s$	= 0.0600	200 - 400	0.000233
Recompression Index, $C_r$	$\approx$ 0.0600	400 - 800	0.000134
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/59

**e-logp curve**

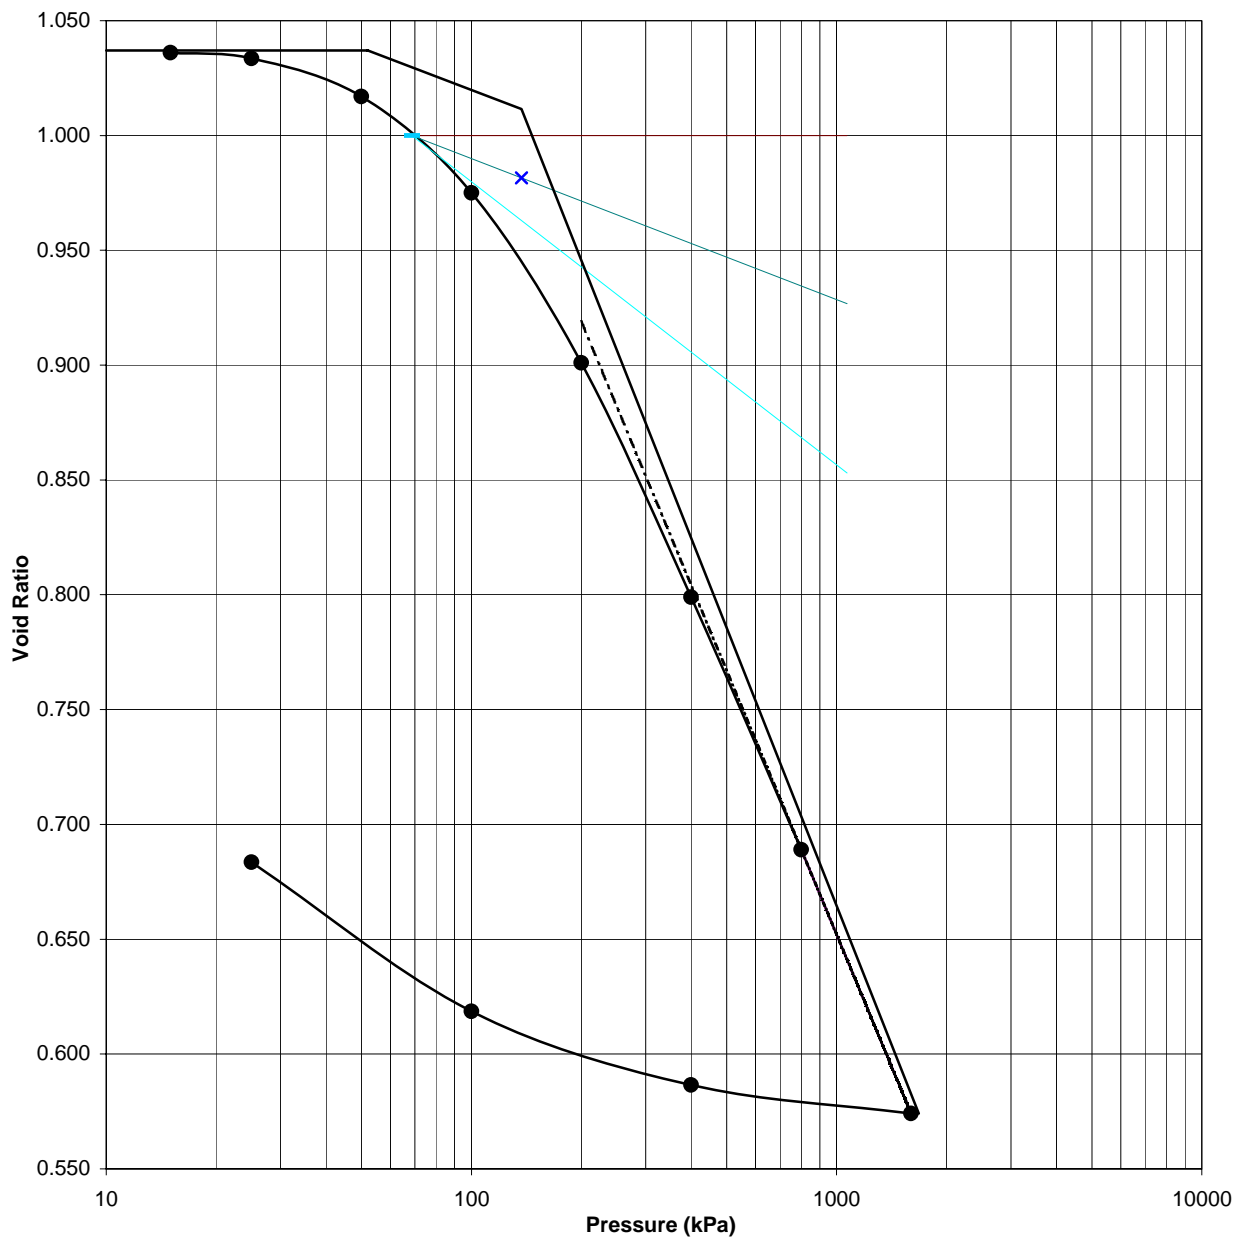

Bore hole No.: BH-7		Depth : 4.00m	
Initial Void Ratio, $e_0$	=	1.0371	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	52 kPa	
Compression Index $C_c$	=	0.4022	0.000325
$C_c/(1+e_0)$	=	0.1974	0.000412
Pre-consolidation Pressure, $p_c$	=	137 kPa	0.000363
Swelling Index, $C_s$	=	0.0606	0.000250
Recompression Index, $C_r$	$\approx$	0.0606	0.000135
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/60


**e-logp curve**

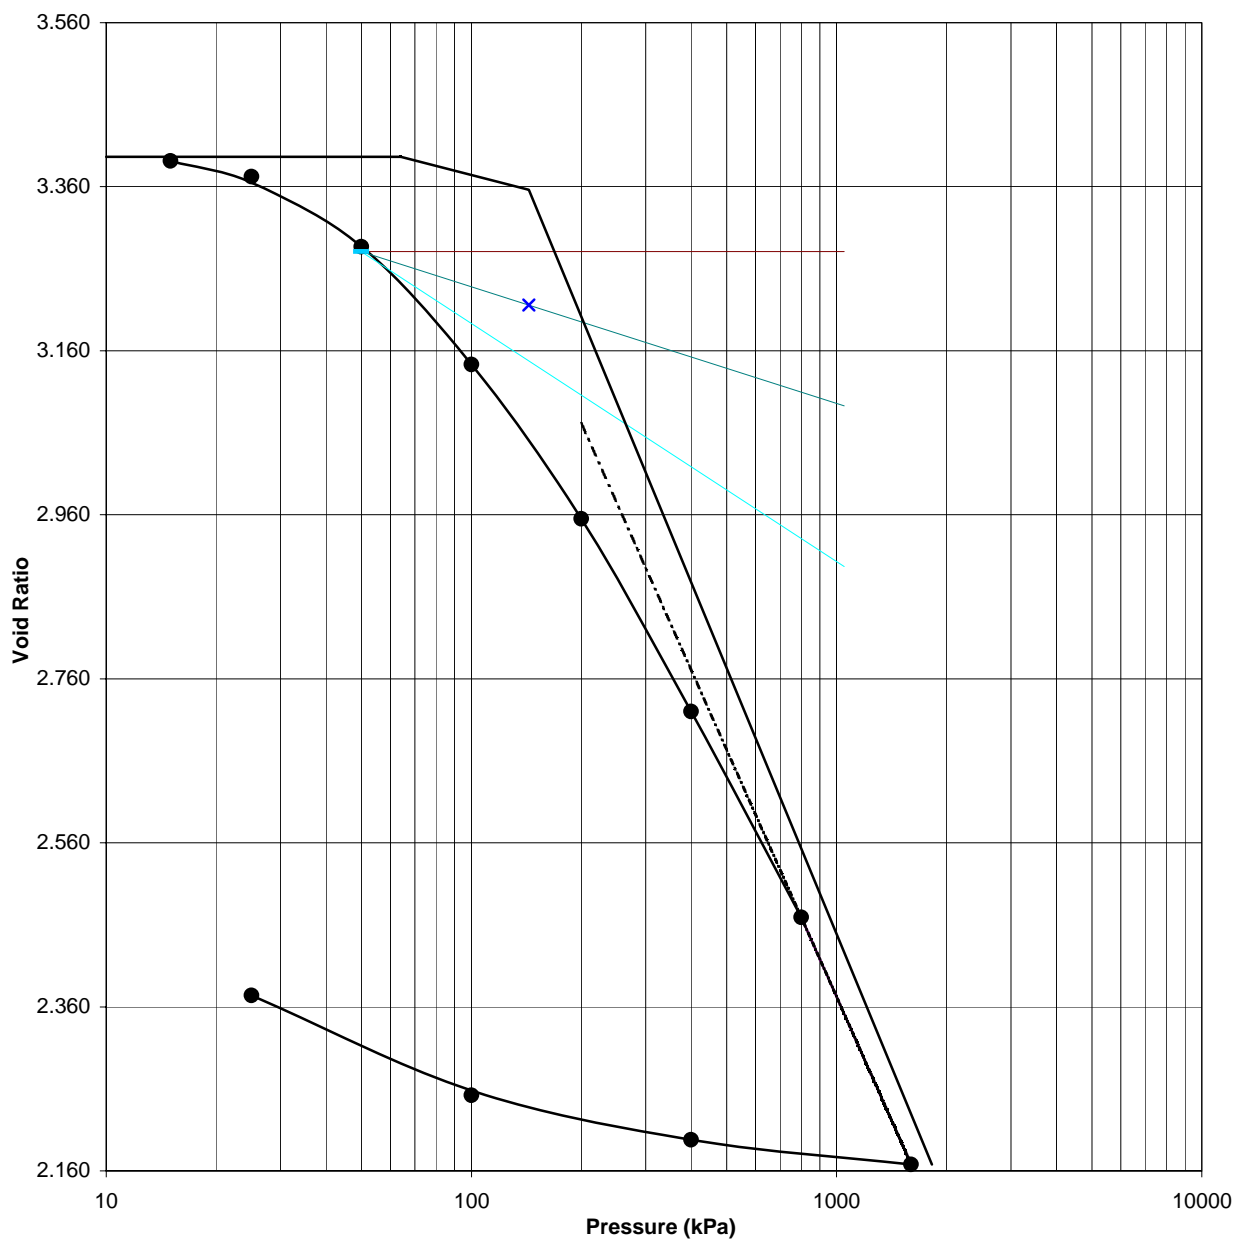

Bore hole No.: BH-7		Depth : 5.50m	
Initial Void Ratio, $e_0$	=	3.3963	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	64 kPa	
Compression Index $C_c$	=	1.0763	25 - 50
$C_c/(1+e_0)$	=	0.2448	50 - 100
Pre-consolidation Pressure, $p_c$	=	144 kPa	100 - 200
Swelling Index, $C_s$	=	0.1141	200 - 400
Recompression Index, $C_r$	≈	0.1141	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/61




**e-logp curve**

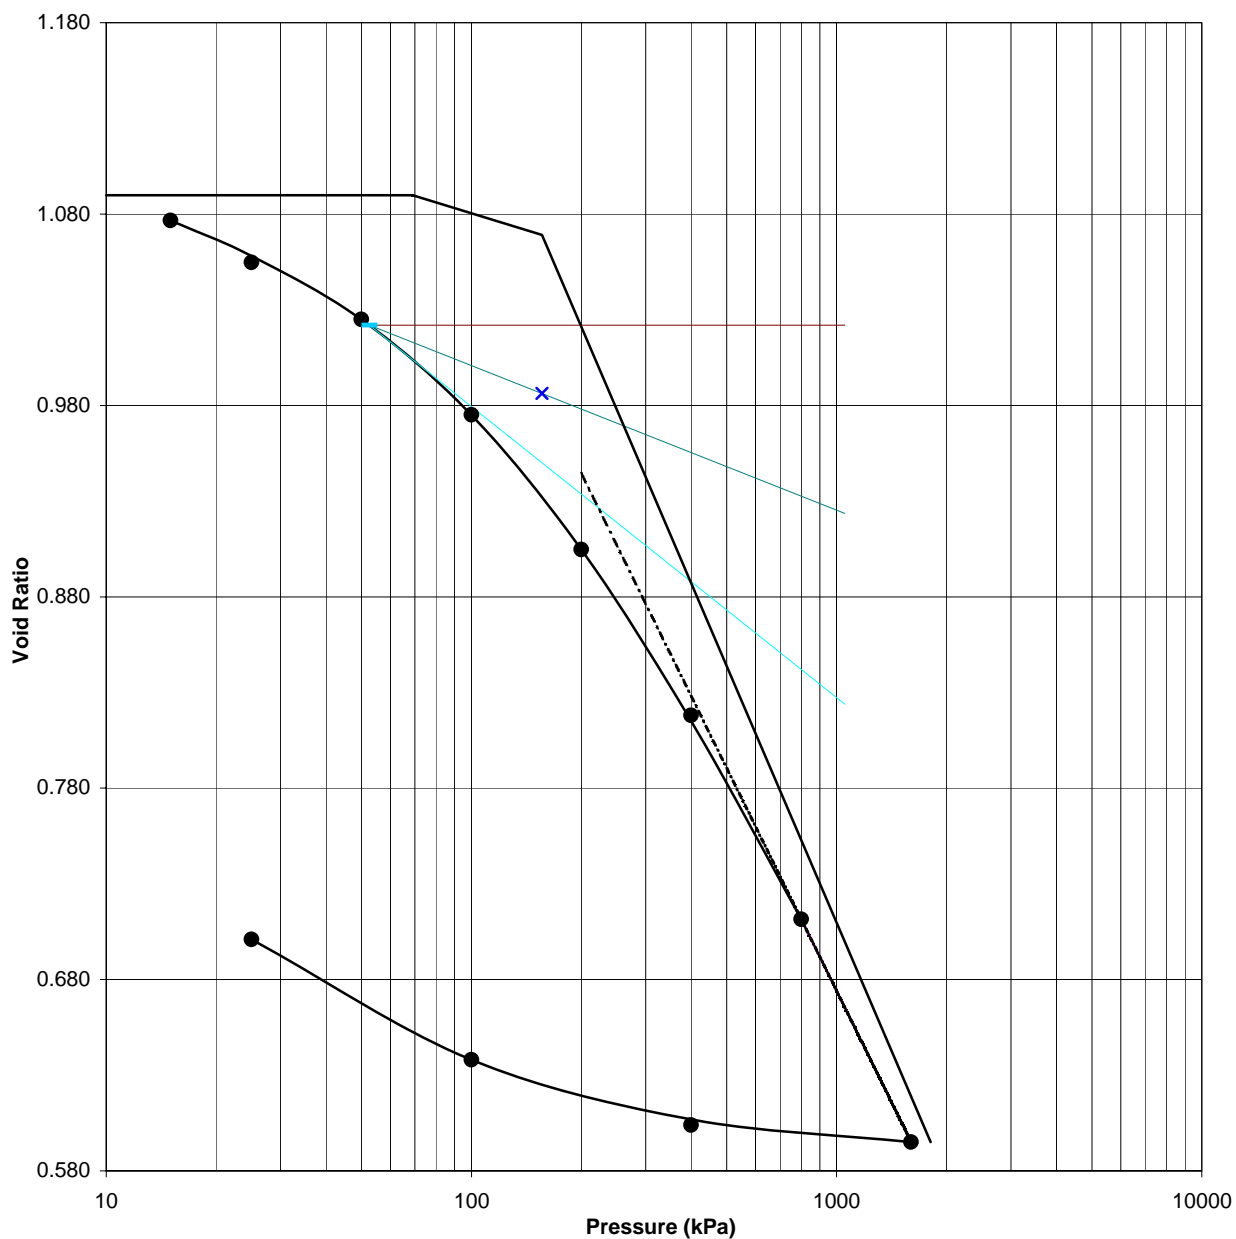


Bore hole No.: BH-7		Depth : 7.00m	
Initial Void Ratio, $e_0$	= 1.0898	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 69 kPa		
Compression Index $C_c$	= 0.4450	25 - 50	0.000568
$C_c/(1+e_0)$	= 0.2129	50 - 100	0.000478
Pre-consolidation Pressure, $p_c$	= 156 kPa	100 - 200	0.000336
Swelling Index, $C_s$	= 0.0587	200 - 400	0.000208
Recompression Index, $C_r$	$\approx$ 0.0587	400 - 800	0.000127
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/62

**e-logp curve**

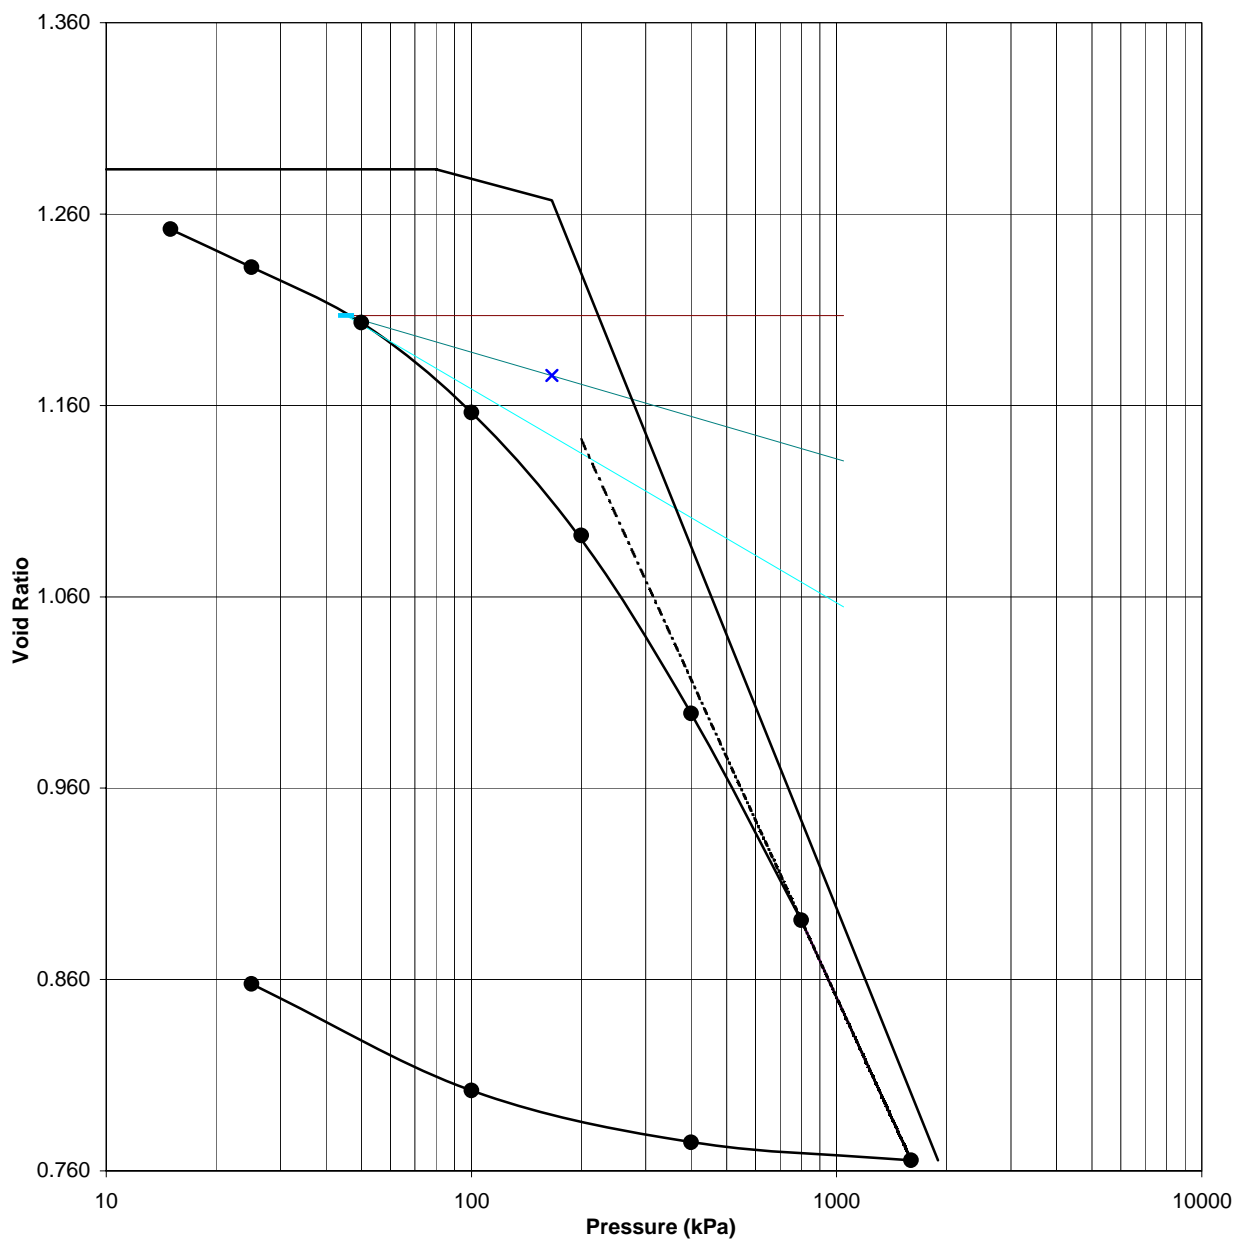


Bore hole No.: BH-7		Depth : 8.50m	
Initial Void Ratio, $e_0$	=	1.2834	Pressure Range (kPa)
Effective Overburden Pressure, $p_0$	=	80 kPa	
Compression Index $C_c$	=	0.4746	25 - 50
$C_c/(1+e_0)$	=	0.2079	50 - 100
Pre-consolidation Pressure, $p_c$	=	166 kPa	100 - 200
Swelling Index, $C_s$	=	0.0511	200 - 400
Recompression Index, $C_r$	≈	0.0511	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/63

**e-logp curve**

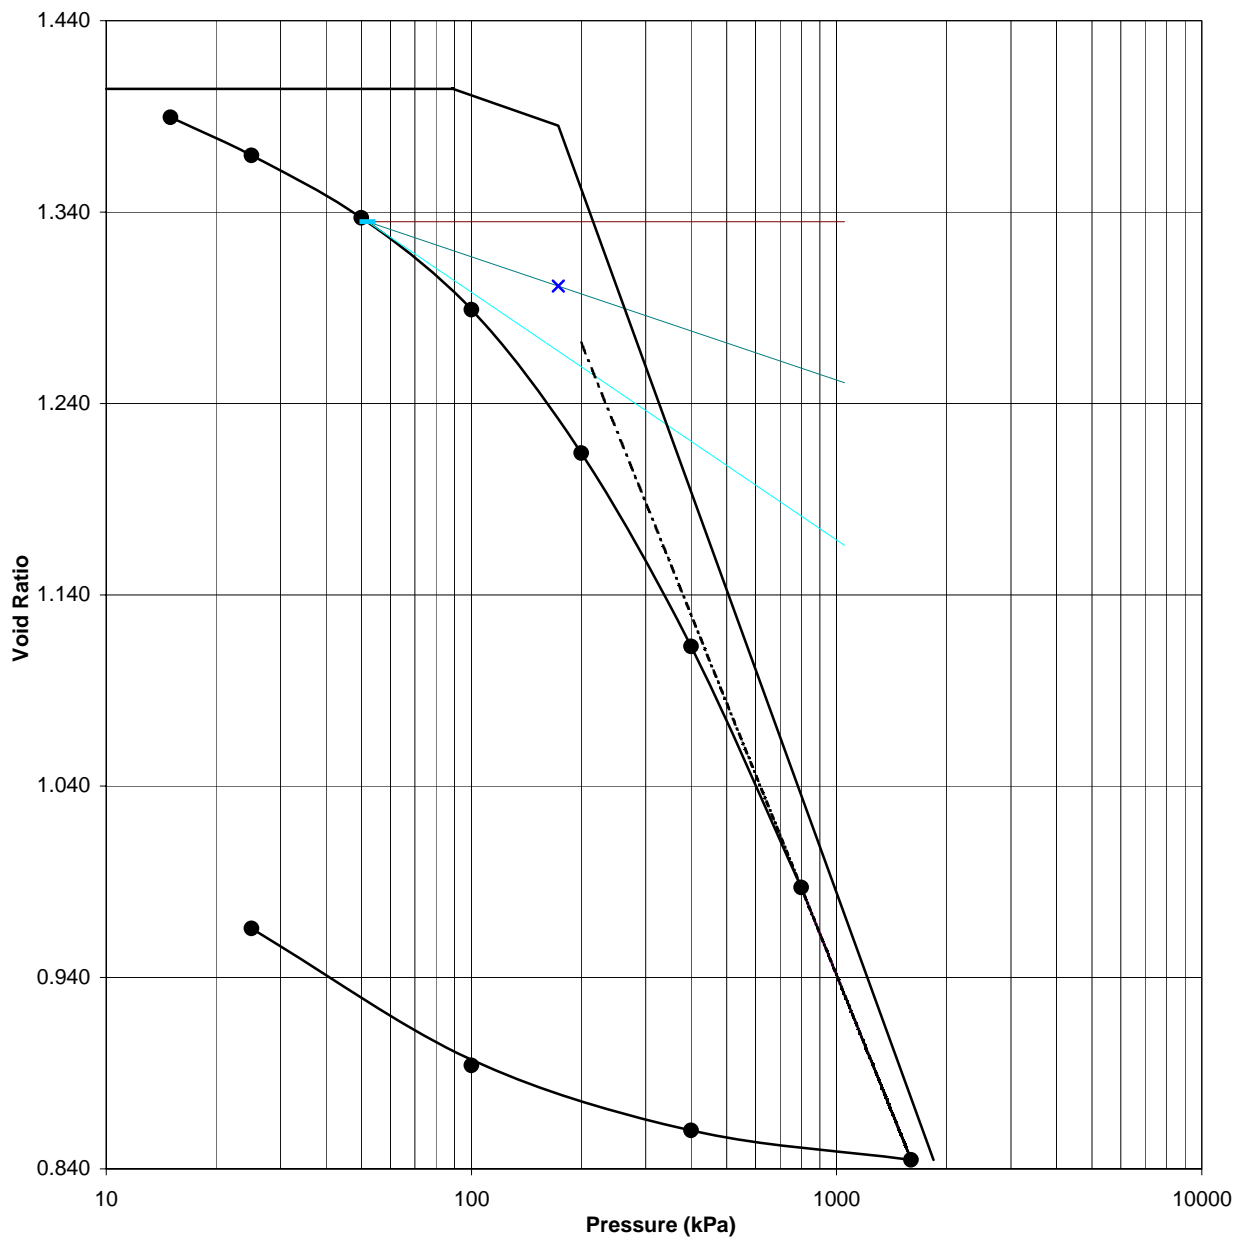


Bore hole No.: BH-7		Depth : 10.00m	
Initial Void Ratio, $e_0$	= 1.4044	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 89 kPa		
Compression Index $C_c$	= 0.5261	25 - 50	0.000541
$C_c/(1+e_0)$	= 0.2188	50 - 100	0.000400
Pre-consolidation Pressure, $p_c$	= 173 kPa	100 - 200	0.000312
Swelling Index, $C_s$	= 0.0670	200 - 400	0.000210
Recompression Index, $C_r$	$\approx$ 0.0670	400 - 800	0.000131
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/64

**e-logp curve**

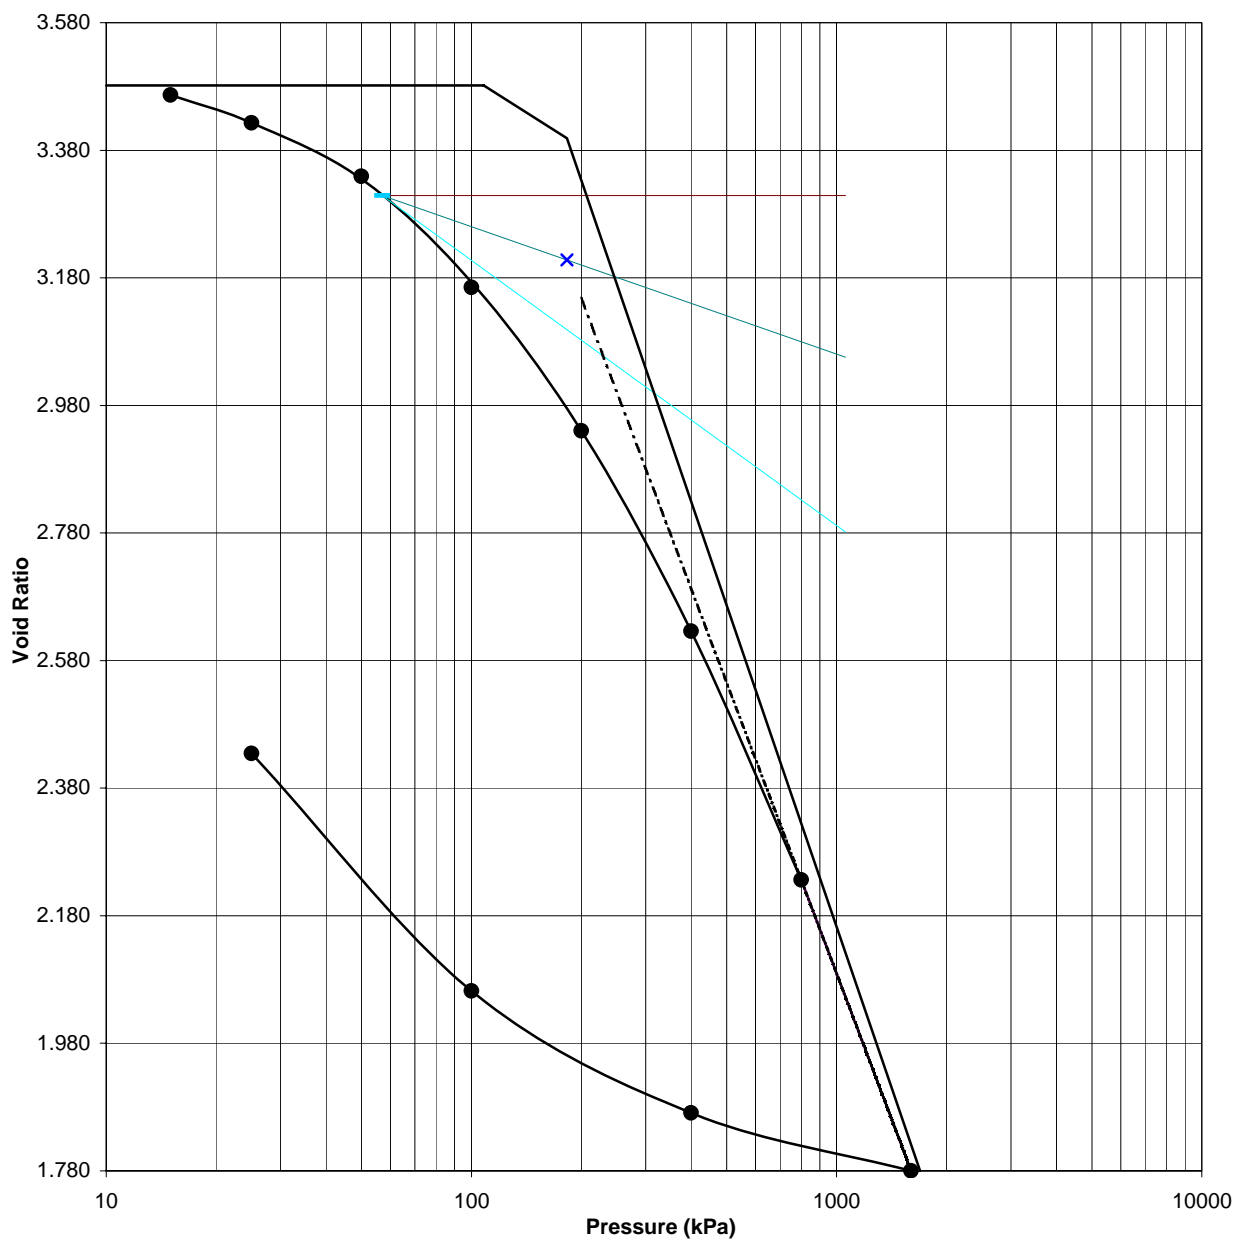


Bore hole No.: BH-7		Depth : 13.00m	
Initial Void Ratio, $e_0$	= 3.4814	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 108 kPa		
Compression Index $C_c$	= 1.6736	25 - 50	0.000749
$C_c/(1+e_0)$	= 0.3734	50 - 100	0.000777
Pre-consolidation Pressure, $p_c$	= 182 kPa	100 - 200	0.000502
Swelling Index, $C_s$	= 0.3624	200 - 400	0.000350
Recompression Index, $C_r$	$\approx$ 0.3624	400 - 800	0.000218
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/65

**e-logp curve**

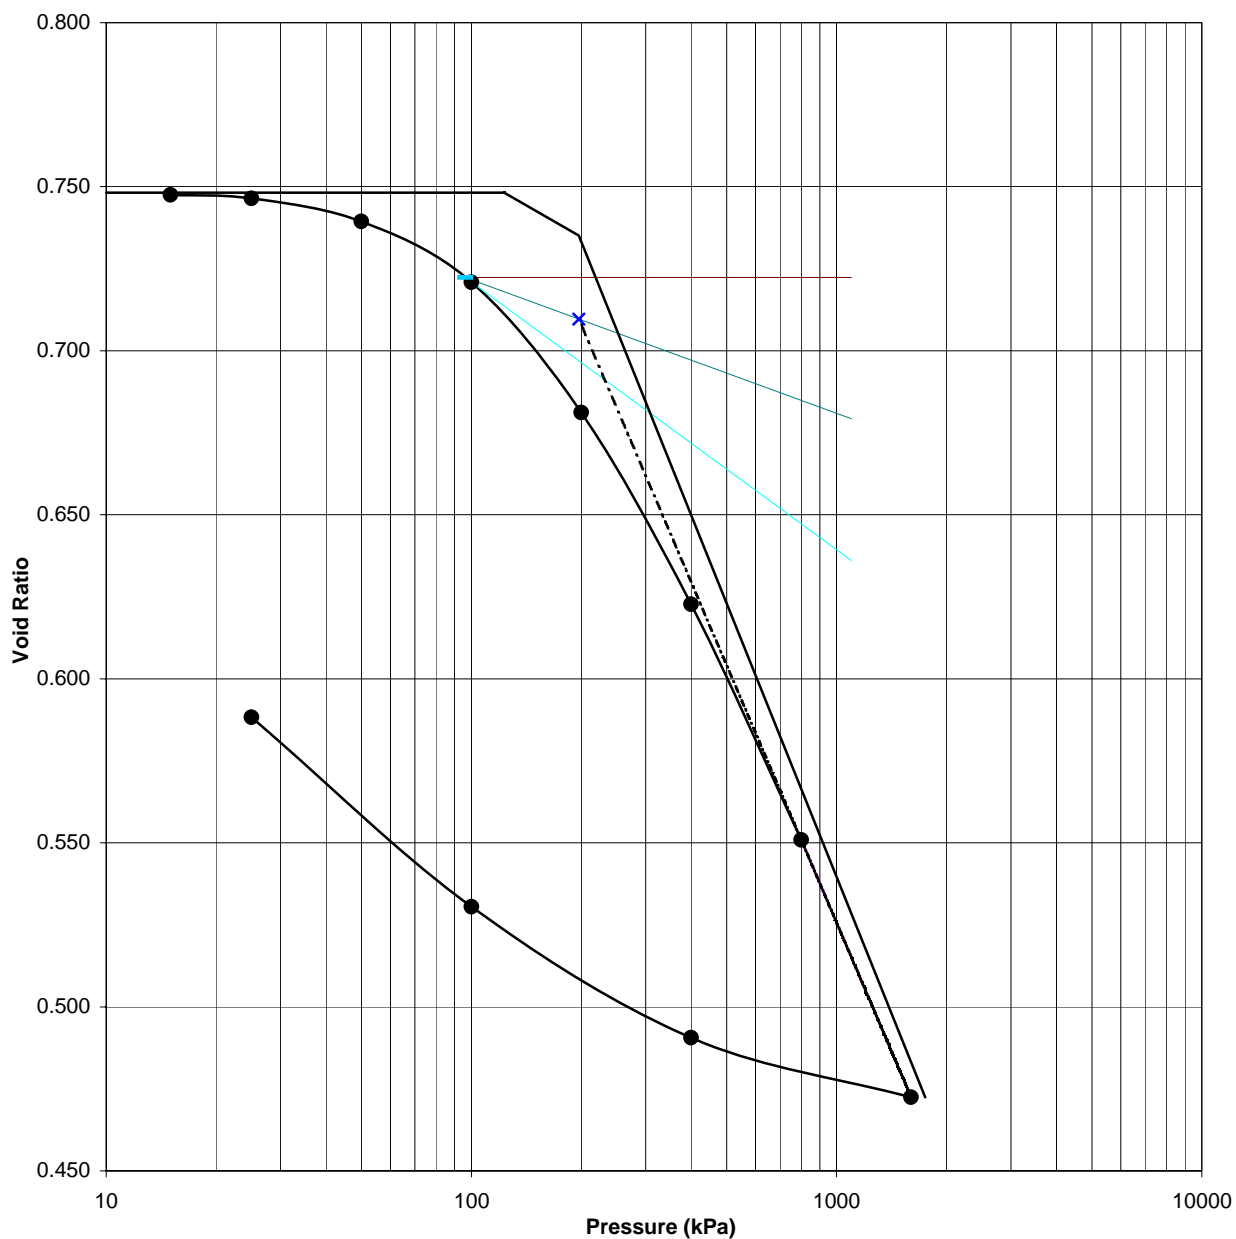


Bore hole No.: BH-7		Depth : 16.00m	
Initial Void Ratio, $e_0$	= 0.7482	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 123 kPa		
Compression Index $C_c$	= 0.2769	25 - 50	0.000162
$C_c/(1+e_0)$	= 0.1584	50 - 100	0.000212
Pre-consolidation Pressure, $p_c$	= 197 kPa	100 - 200	0.000227
Swelling Index, $C_s$	= 0.0641	200 - 400	0.000167
Recompression Index, $C_r$	$\approx$ 0.0641	400 - 800	0.000103
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/66

**e-logp curve**

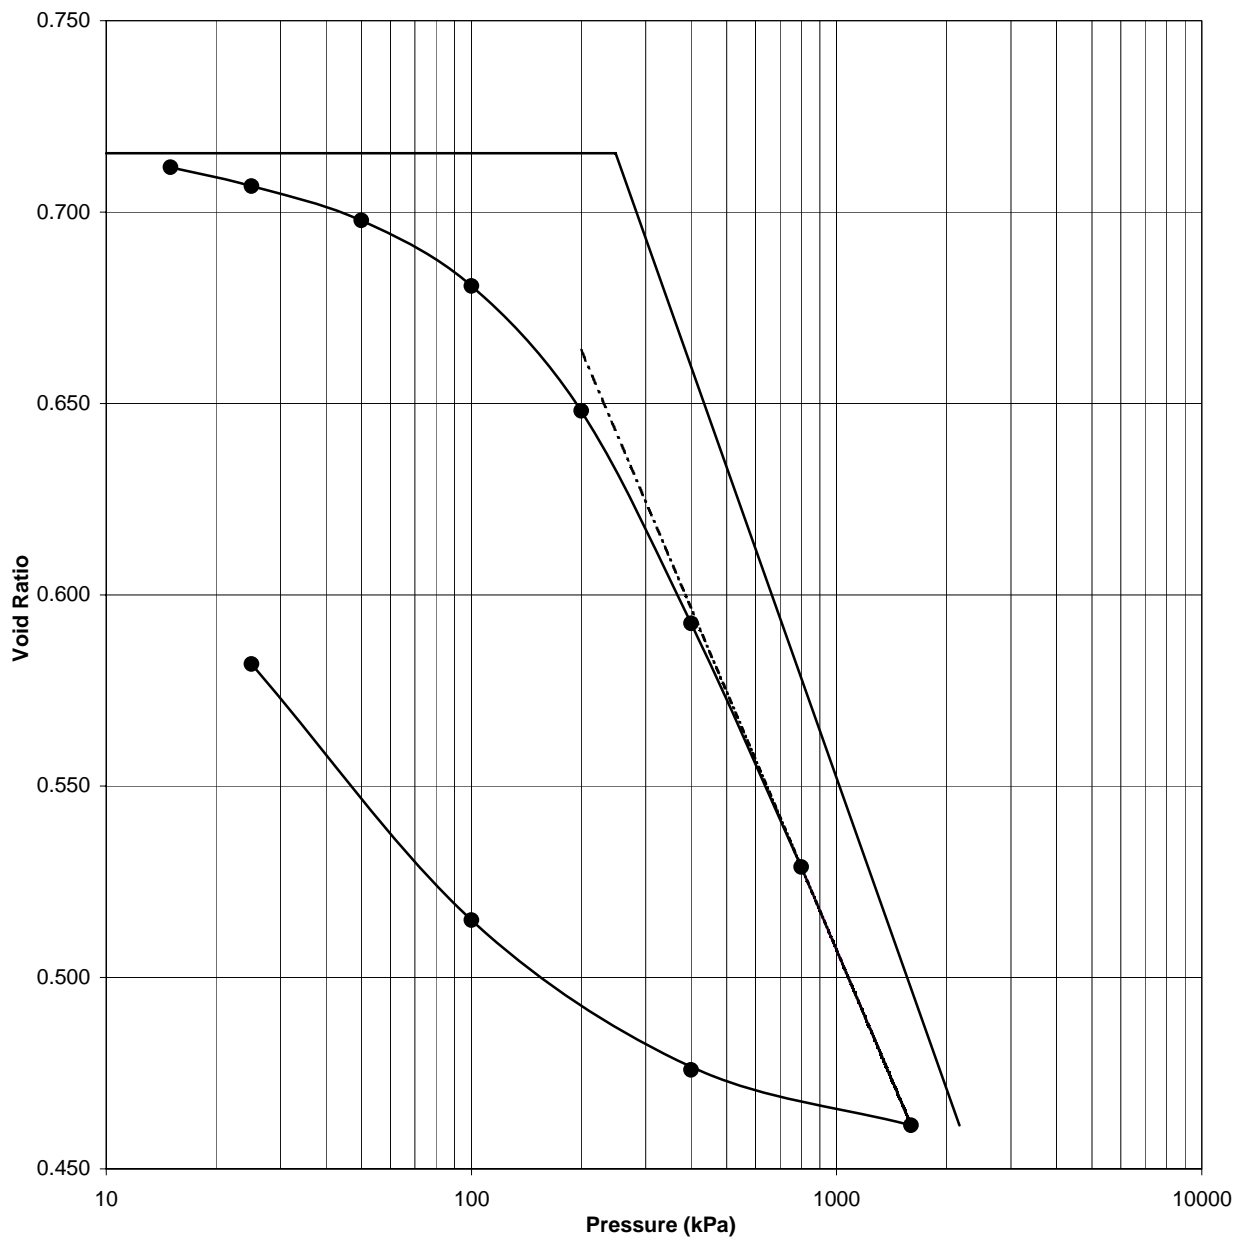


Bore hole No.: BH-7		Depth : 28.00m	
Initial Void Ratio, $e_0$	= 0.7154	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 248 kPa		
Compression Index $C_c$	= 0.2697	25 - 50	0.000210
$C_c/(1+e_0)$	= 0.1572	50 - 100	0.000199
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000190
Swelling Index, $C_s$	= 0.0667	200 - 400	0.000162
Recompression Index, $C_r$	$\approx$ 0.0667	400 - 800	0.000093
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/67

**e-logp curve**

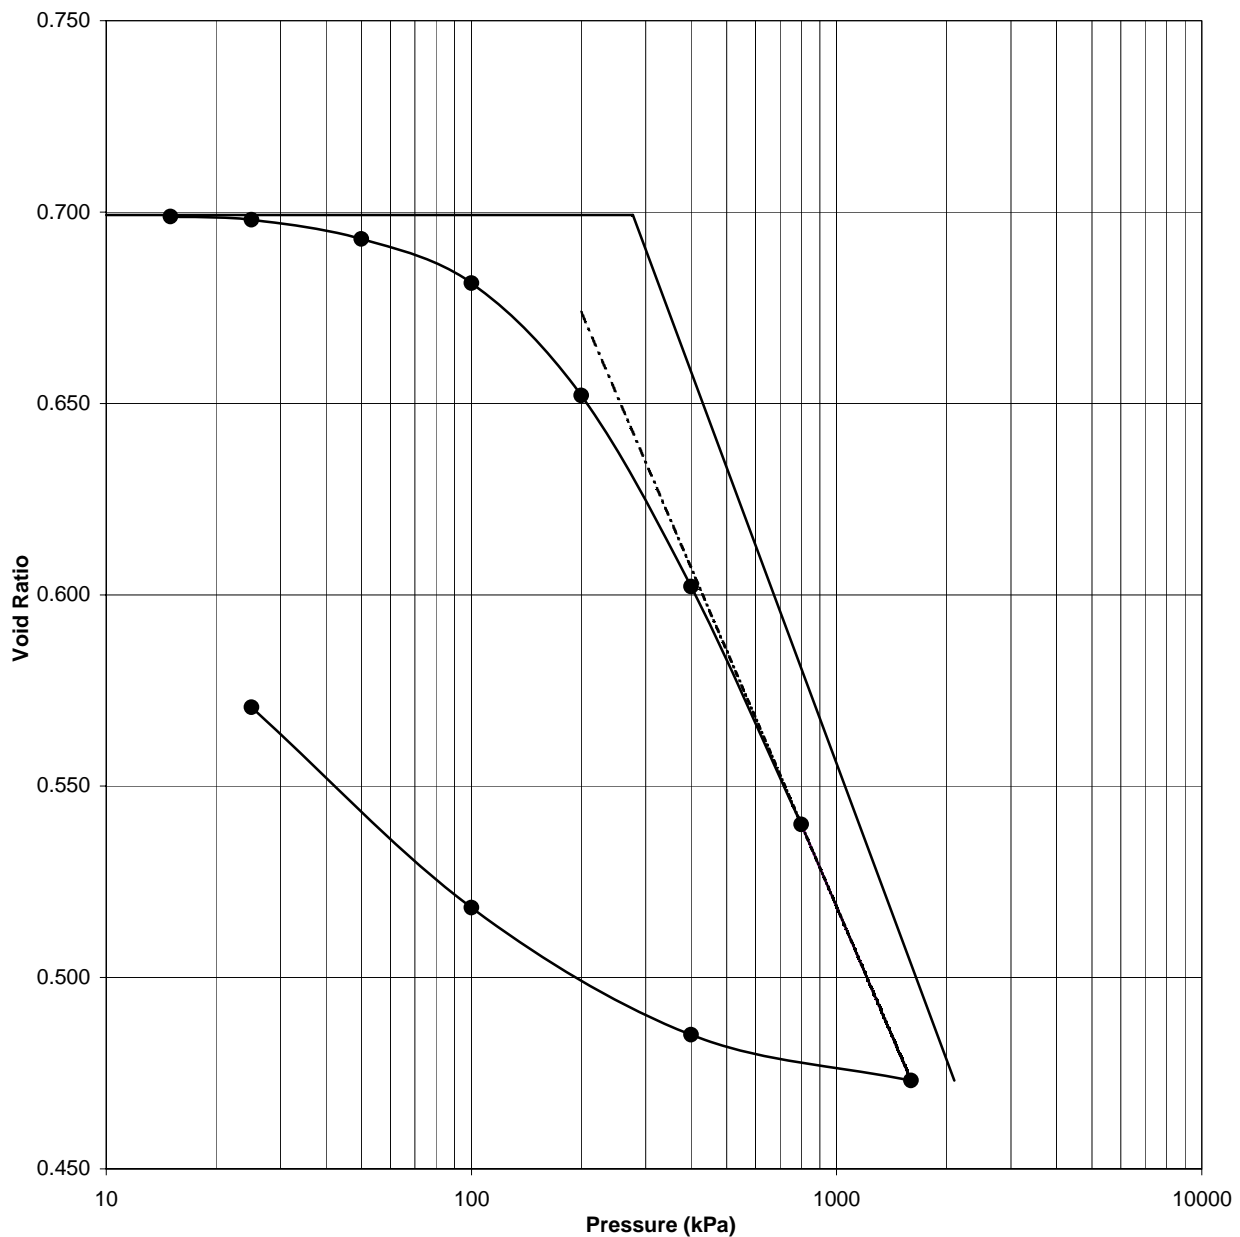

Bore hole No.: BH-7		Depth : 31.00m	
Initial Void Ratio, $e_0$	= 0.6992	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 277 kPa		
Compression Index $C_c$	= 0.2570	25 - 50	0.000117
$C_c/(1+e_0)$	= 0.1513	50 - 100	0.000136
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000173
Swelling Index, $C_s$	= 0.0540	200 - 400	0.000147
Recompression Index, $C_r$	$\approx$ 0.0540	400 - 800	0.000091
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/68


**e-logp curve**

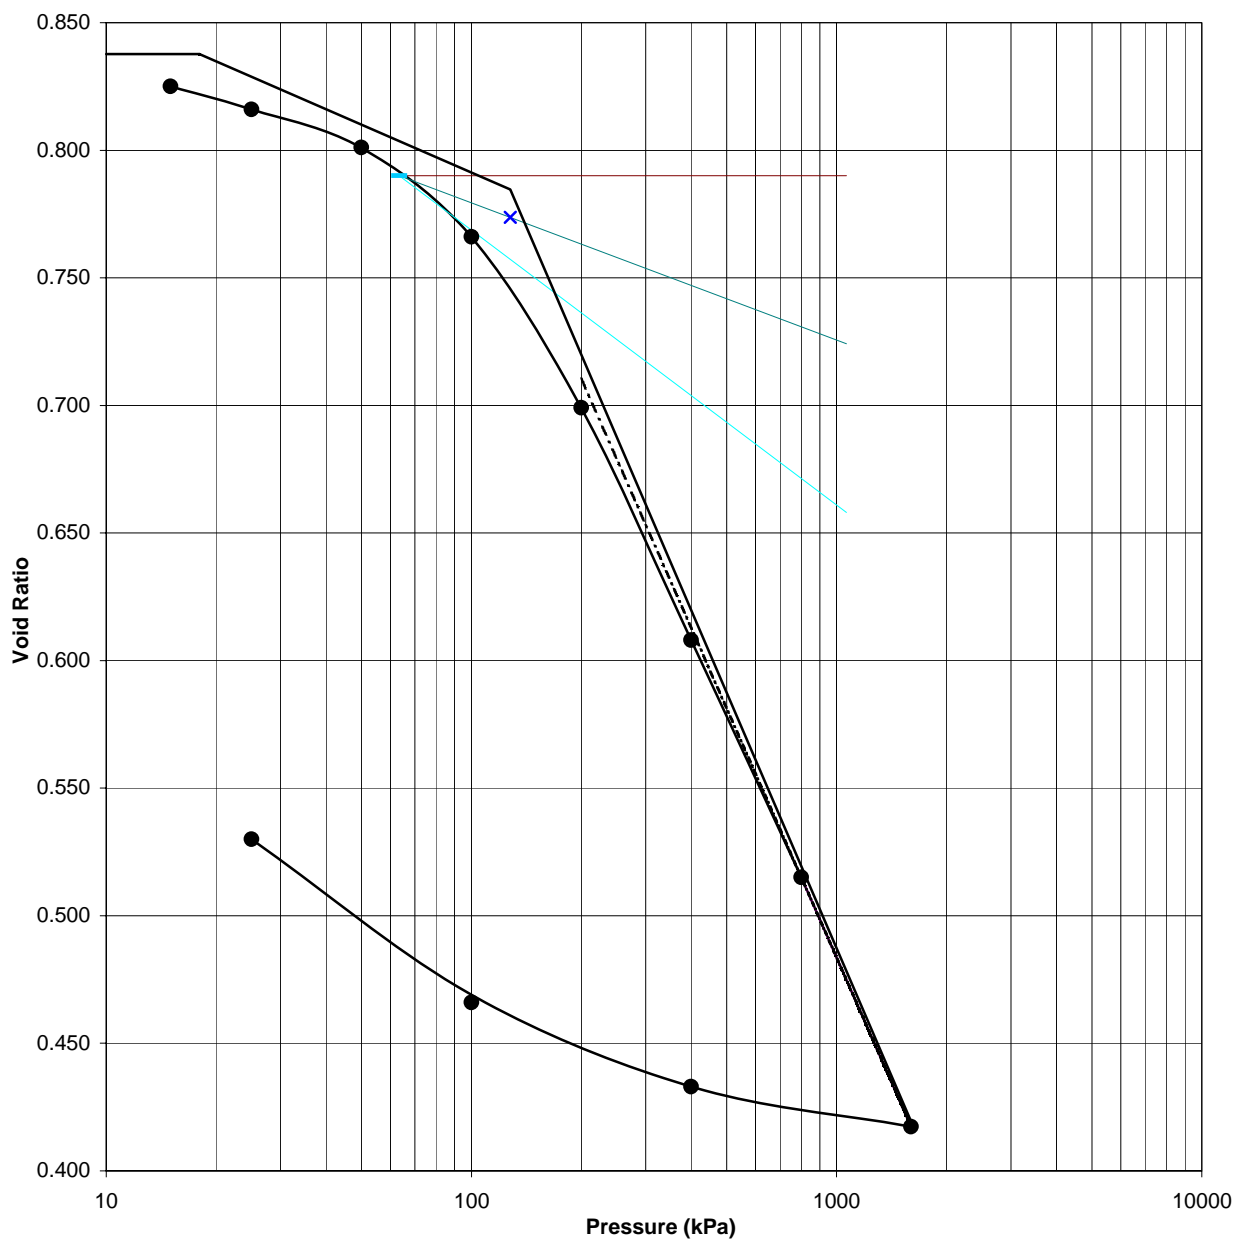

Bore hole No.: BH-8		Depth : 1.00m	
Initial Void Ratio, $e_0$	= 0.8377	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 18 kPa		
Compression Index $C_c$	= 0.3326	25 - 50	0.000326
$C_c/(1+e_0)$	= 0.1810	50 - 100	0.000381
Pre-consolidation Pressure, $p_c$	= 128 kPa	100 - 200	0.000365
Swelling Index, $C_s$	= 0.0624	200 - 400	0.000248
Recompression Index, $C_r$	$\approx$ 0.0624	400 - 800	0.000127
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/69




**e-logp curve**

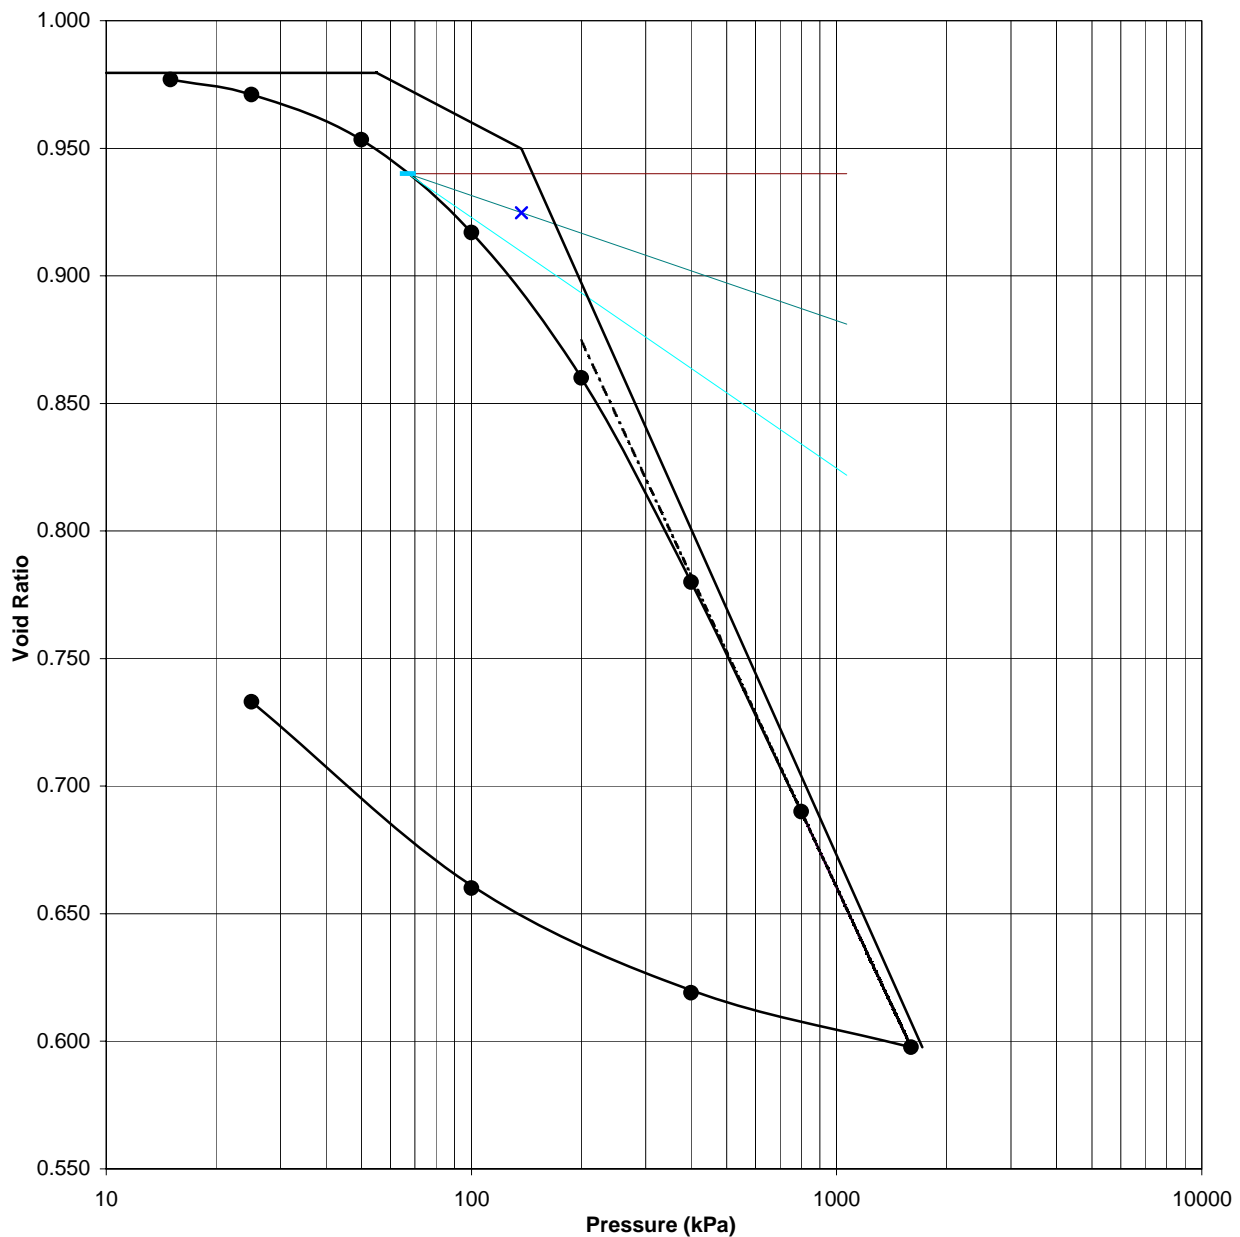


Bore hole No.: BH-8		Depth : 4.00m	
Initial Void Ratio, $e_0$	= 0.9795	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 55 kPa		
Compression Index $C_c$	= 0.3209	25 - 50	0.000358
$C_c/(1+e_0)$	= 0.1621	50 - 100	0.000367
Pre-consolidation Pressure, $p_c$	= 137 kPa	100 - 200	0.000288
Swelling Index, $C_s$	= 0.0749	200 - 400	0.000202
Recompression Index, $C_r$	≈ 0.0749	400 - 800	0.000114
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			<b>Job No. :</b> CCPL/20101211
			<b>Fig. No.</b> G/70

**e-logp curve**

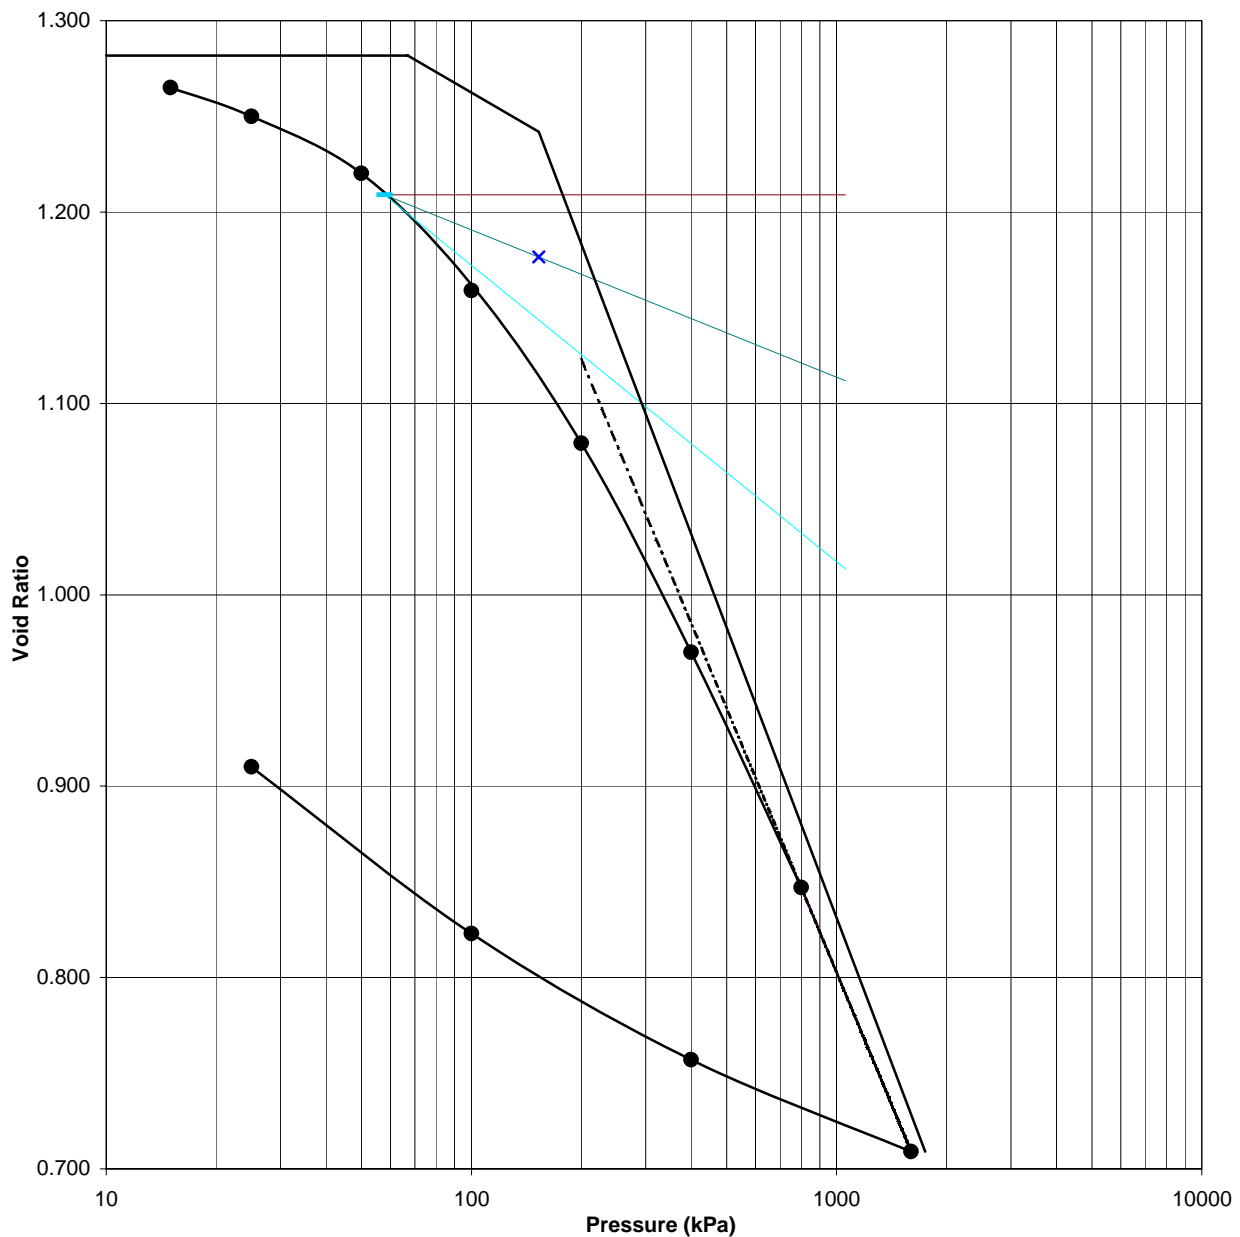


Bore hole No.: BH-8		Depth : 5.50m	
Initial Void Ratio, $e_0$	= 1.2818	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 67 kPa		
Compression Index $C_c$	= 0.5036	25 - 50	0.000524
$C_c/(1+e_0)$	= 0.2207	50 - 100	0.000535
Pre-consolidation Pressure, $p_c$	= 153 kPa	100 - 200	0.000350
Swelling Index, $C_s$	= 0.1113	200 - 400	0.000239
Recompression Index, $C_r$	$\approx$ 0.1113	400 - 800	0.000135
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/71

**e-logp curve**

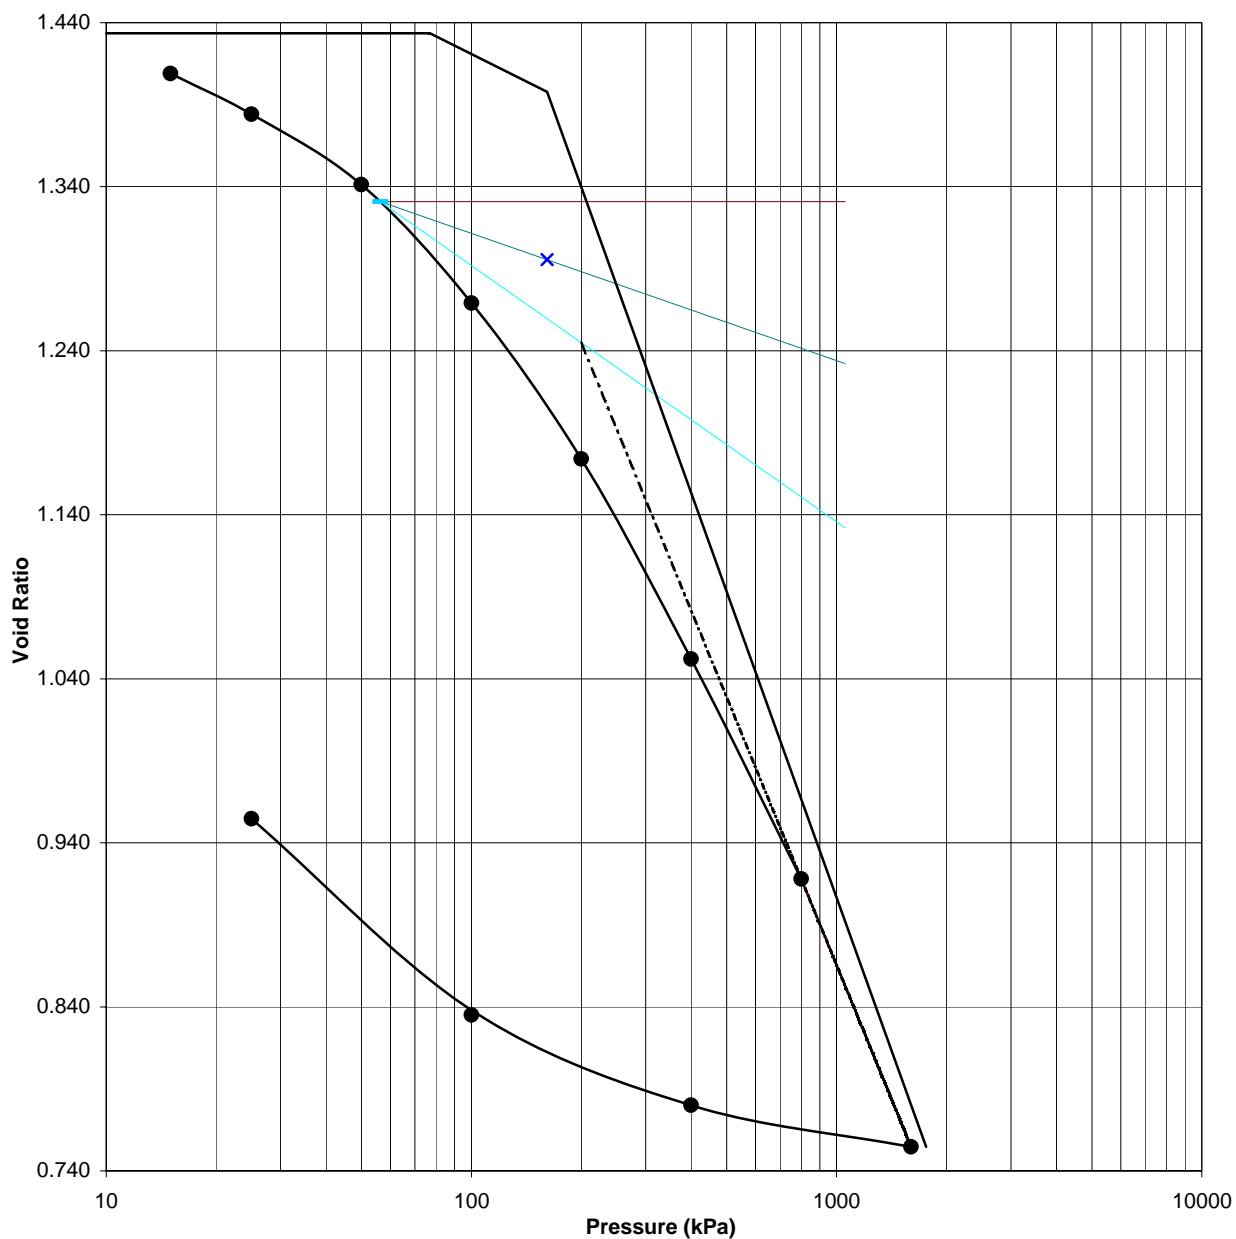


Bore hole No.: BH-8		Depth : 7.00m		
Initial Void Ratio, $e_0$	=	1.4335	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) (m <sup>2</sup> /kN)
Effective Overburden Pressure, $p_0$	=	77 kPa		
Compression Index $C_c$	=	0.6197	25 - 50	0.000705
$C_c/(1+e_0)$	=	0.2547	50 - 100	0.000594
Pre-consolidation Pressure, $p_c$	=	161 kPa	100 - 200	0.000390
Swelling Index, $C_s$	=	0.1108	200 - 400	0.000251
Recompression Index, $C_r$	≈	0.1108	400 - 800	0.000138
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock				Job No. : CCPL/20101211
				Fig. No. G/72

**e-logp curve**

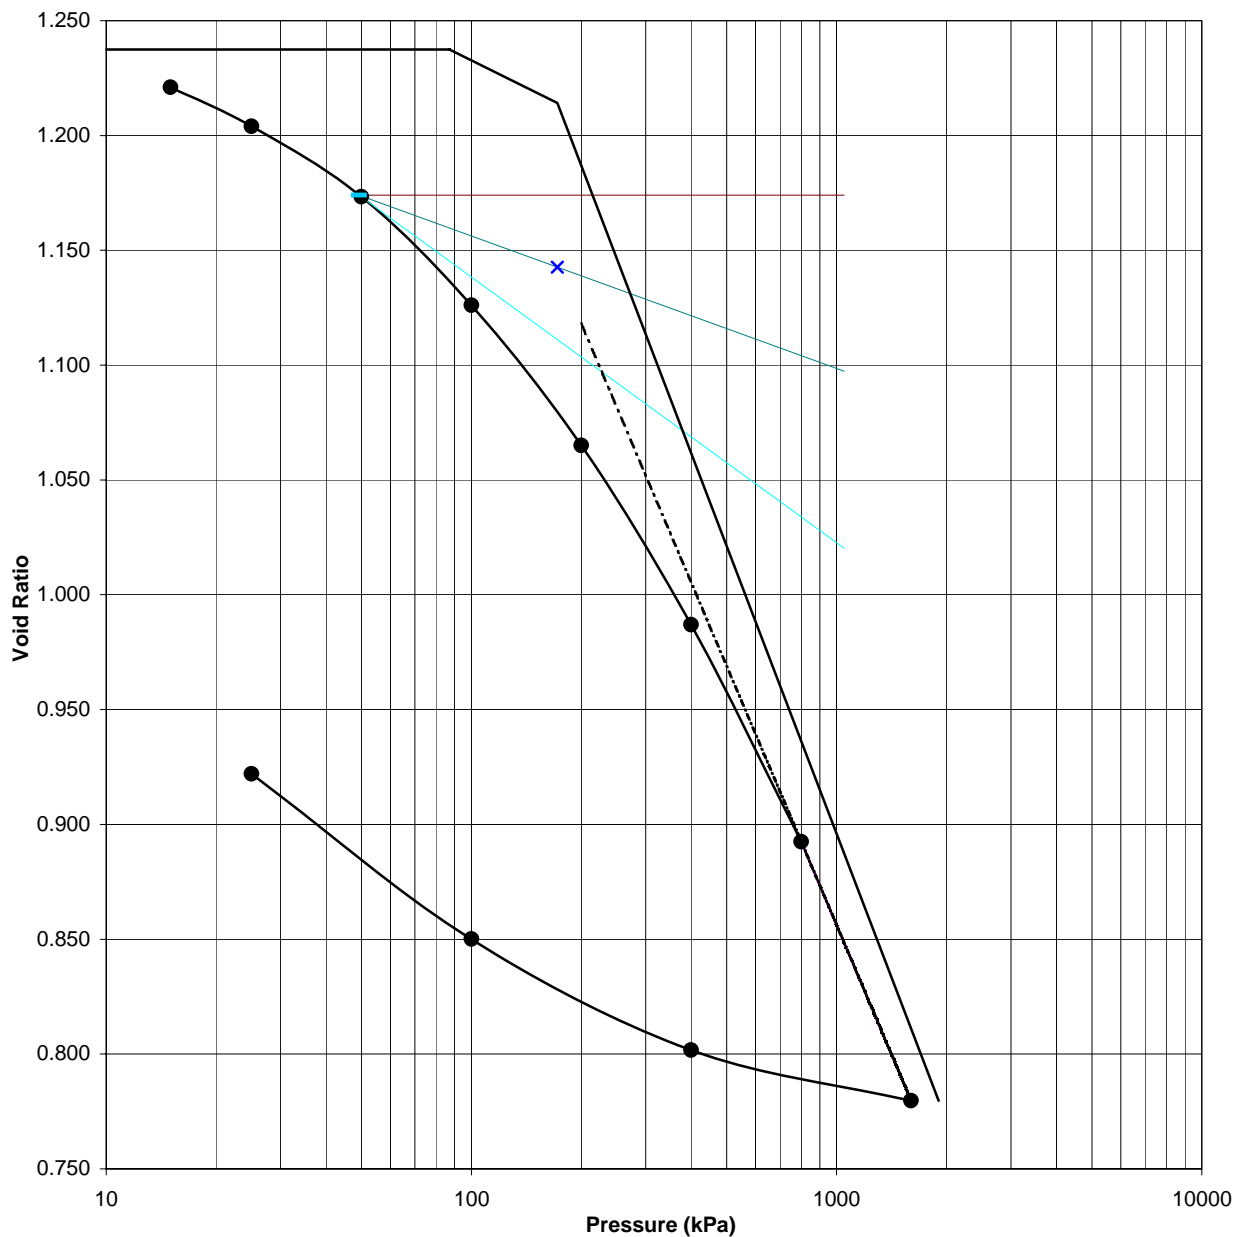


Bore hole No.: BH-8		Depth : 8.50m	
Initial Void Ratio, $e_0$	= 1.2375	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 87 kPa		
Compression Index $C_c$	= 0.4158	25 - 50	0.000547
$C_c/(1+e_0)$	= 0.1859	50 - 100	0.000423
Pre-consolidation Pressure, $p_c$	= 172 kPa	100 - 200	0.000273
Swelling Index, $C_s$	= 0.0788	200 - 400	0.000174
Recompression Index, $C_r$	$\approx$ 0.0788	400 - 800	0.000106
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/73

**e-logp curve**

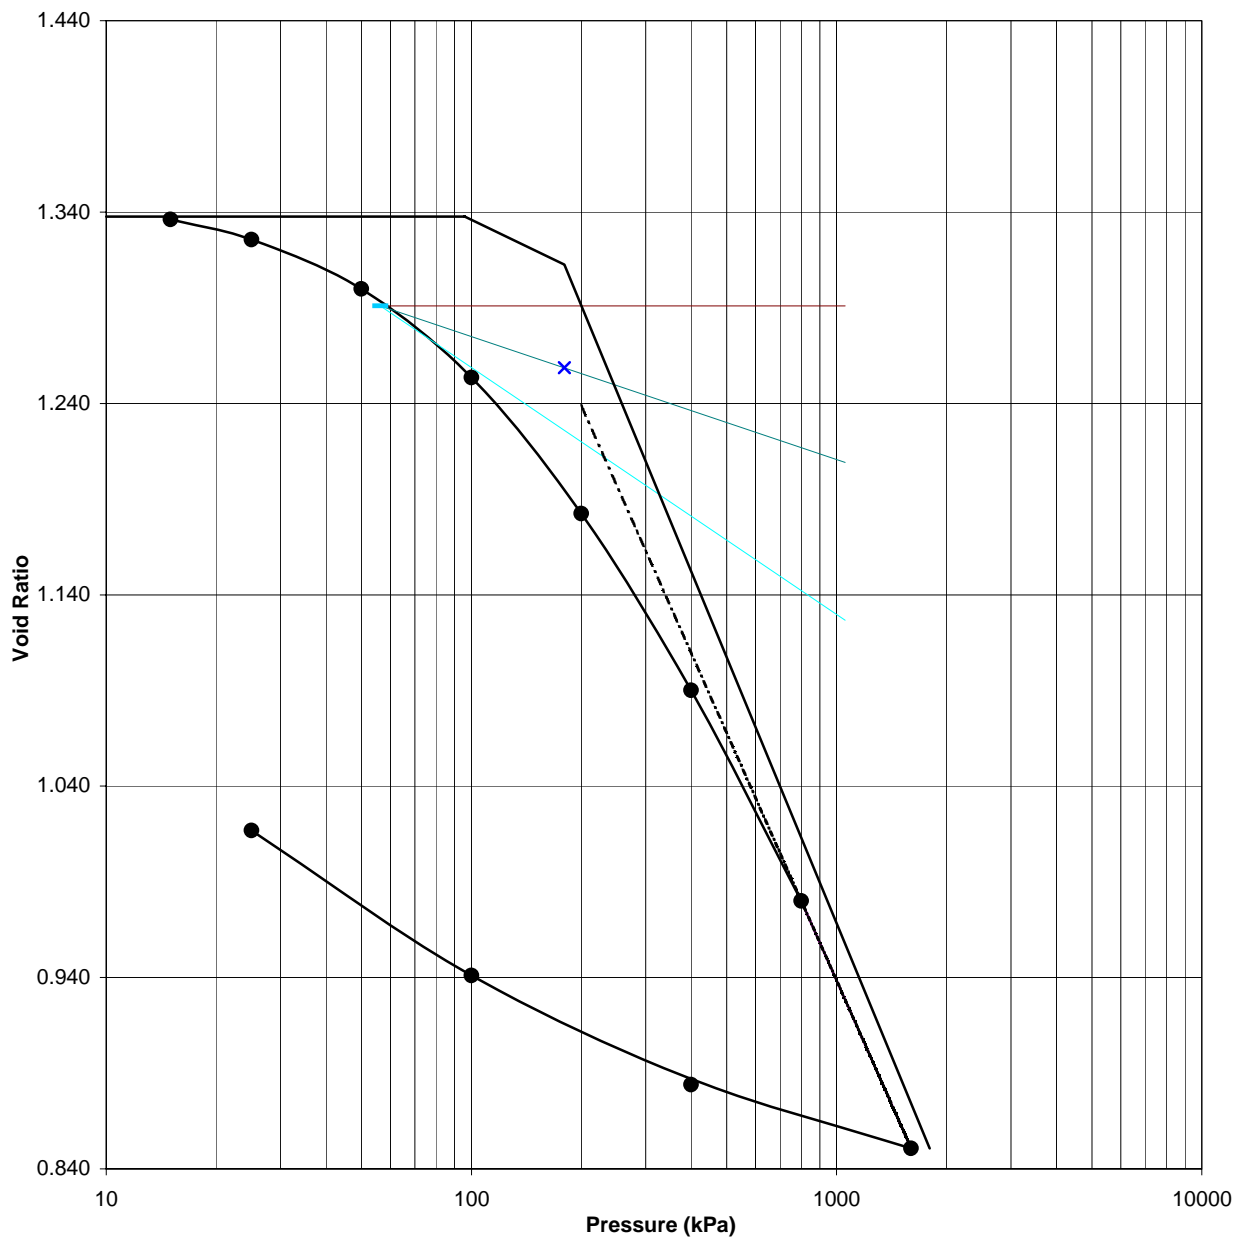


Bore hole No.: BH-8		Depth : 10.00m	
Initial Void Ratio, $e_0$	= 1.3376	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 96 kPa		
Compression Index $C_c$	= 0.4617	25 - 50	0.000439
$C_c/(1+e_0)$	= 0.1975	50 - 100	0.000396
Pre-consolidation Pressure, $p_c$	= 180 kPa	100 - 200	0.000305
Swelling Index, $C_s$	= 0.0919	200 - 400	0.000198
Recompression Index, $C_r$	$\approx$ 0.0919	400 - 800	0.000118
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/74

**e-logp curve**

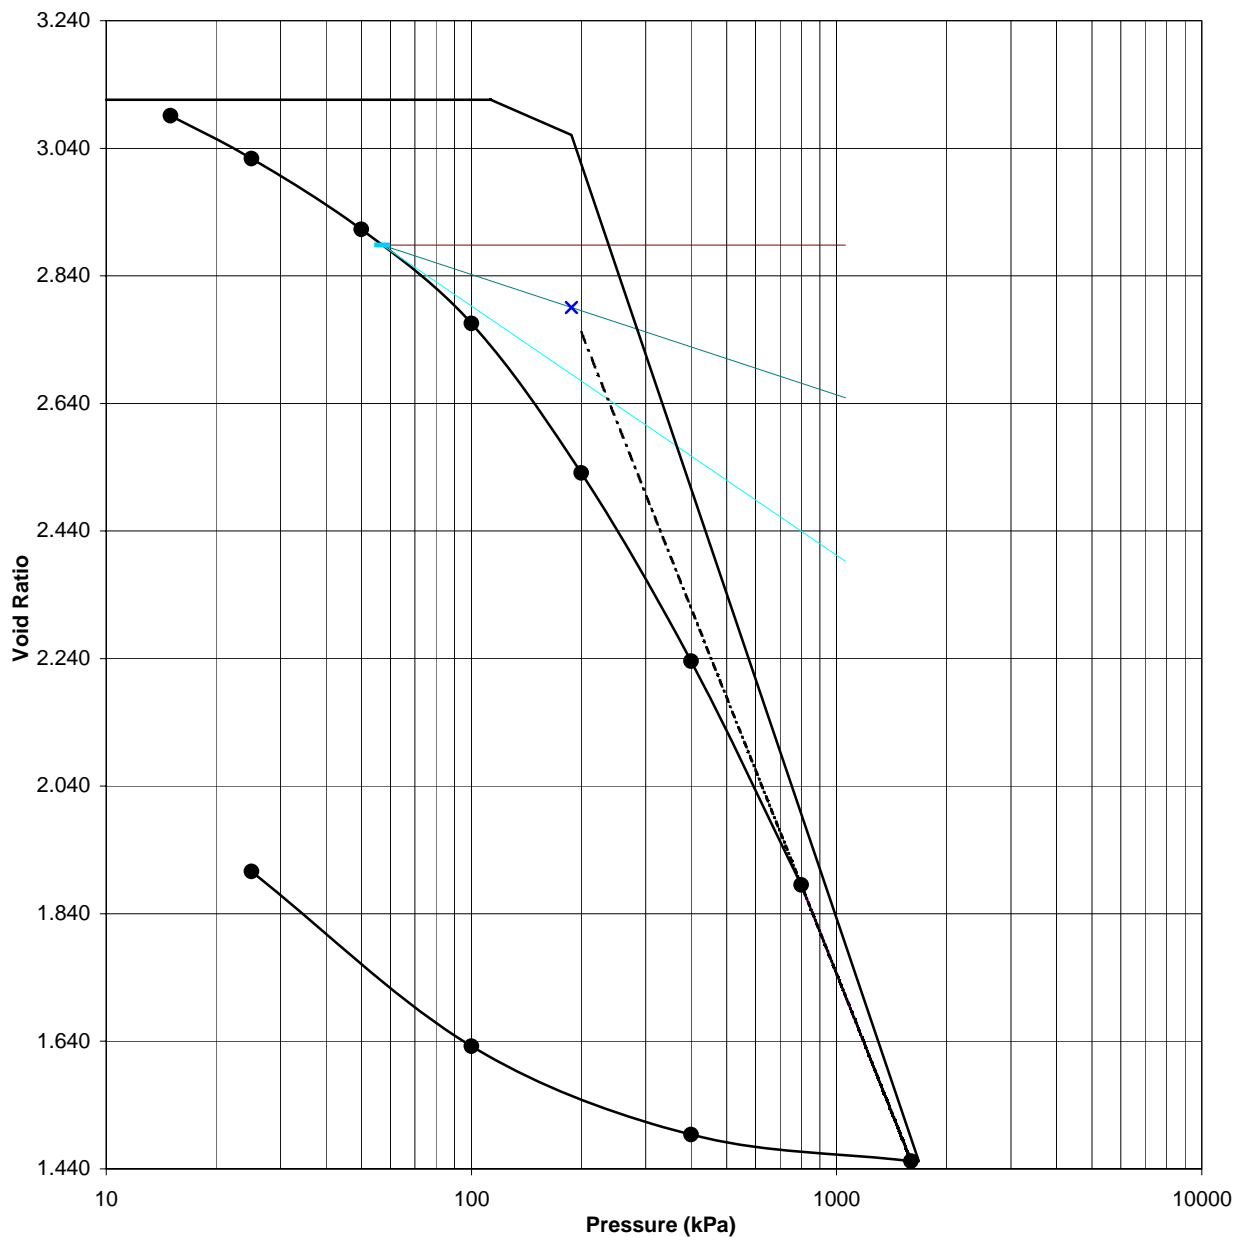


Bore hole No.: BH-8		Depth : 13.00m	
Initial Void Ratio, $e_0$	= 3.1163	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 113 kPa		
Compression Index $C_c$	= 1.6902	25 - 50	0.001073
$C_c/(1+e_0)$	= 0.4106	50 - 100	0.000719
Pre-consolidation Pressure, $p_c$	= 188 kPa	100 - 200	0.000569
Swelling Index, $C_s$	= 0.2513	200 - 400	0.000358
Recompression Index, $C_r$	$\approx$ 0.2513	400 - 800	0.000213
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/75

**e-logp curve**

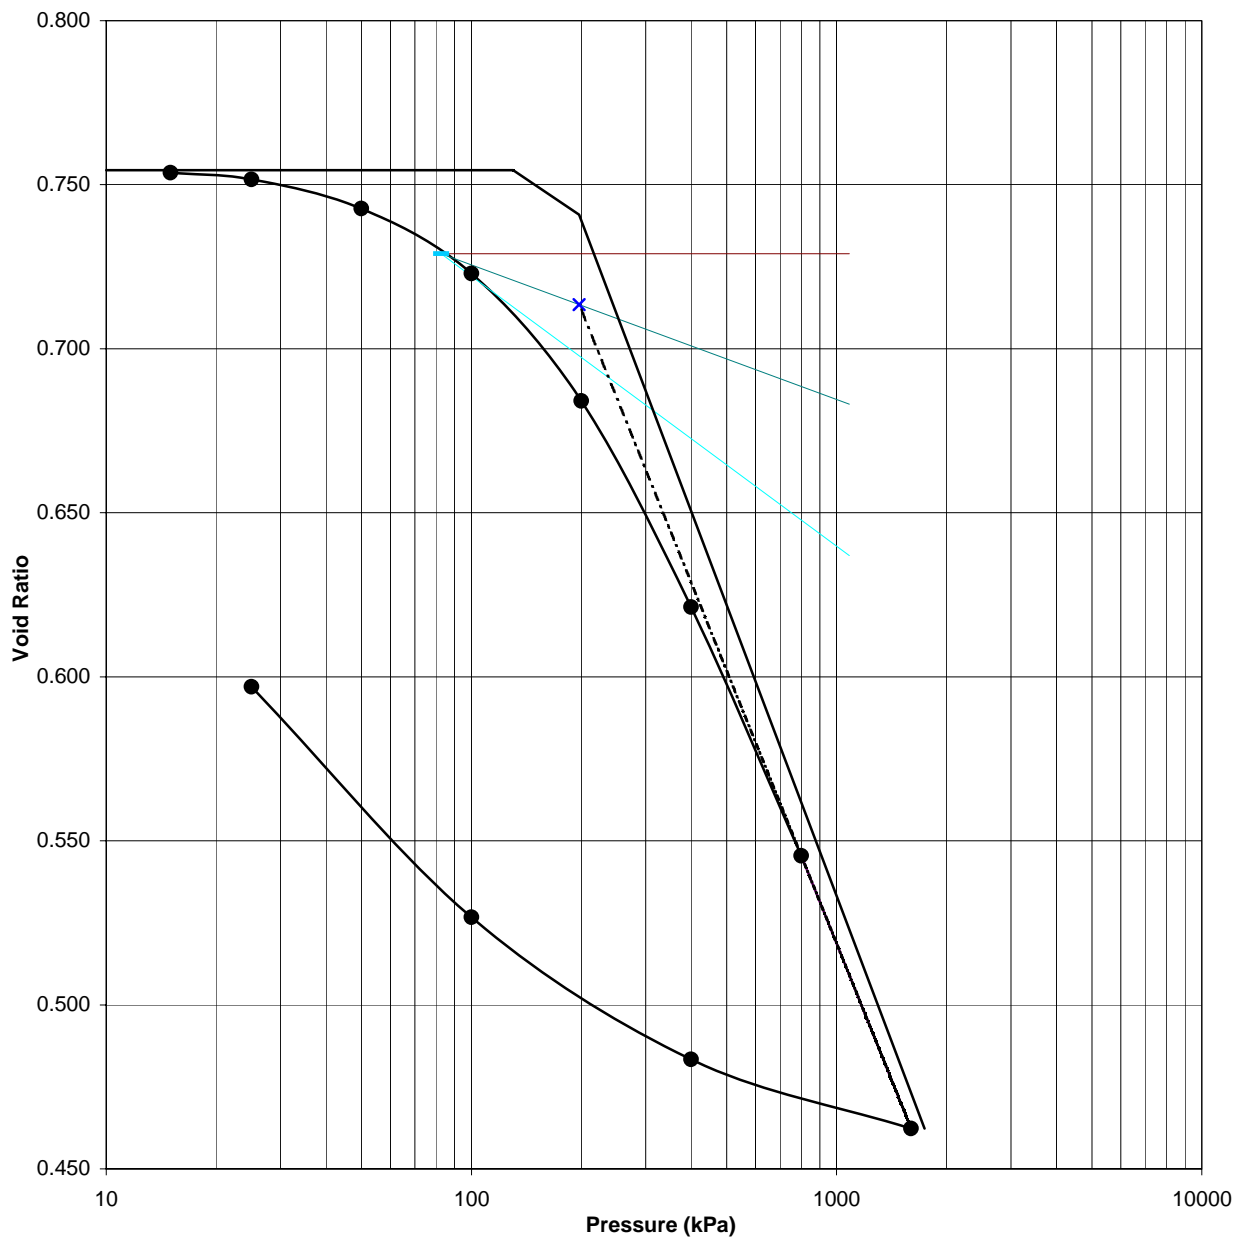

Bore hole No.: BH-8		Depth : 16.00m	
Initial Void Ratio, $e_0$	= 0.7544	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 130 kPa		
Compression Index $C_c$	= 0.2948	25 - 50	0.000202
$C_c/(1+e_0)$	= 0.1680	50 - 100	0.000226
Pre-consolidation Pressure, $p_c$	= 197 kPa	100 - 200	0.000221
Swelling Index, $C_s$	= 0.0745	200 - 400	0.000179
Recompression Index, $C_r$	$\approx$ 0.0745	400 - 800	0.000108
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/76


**e-logp curve**

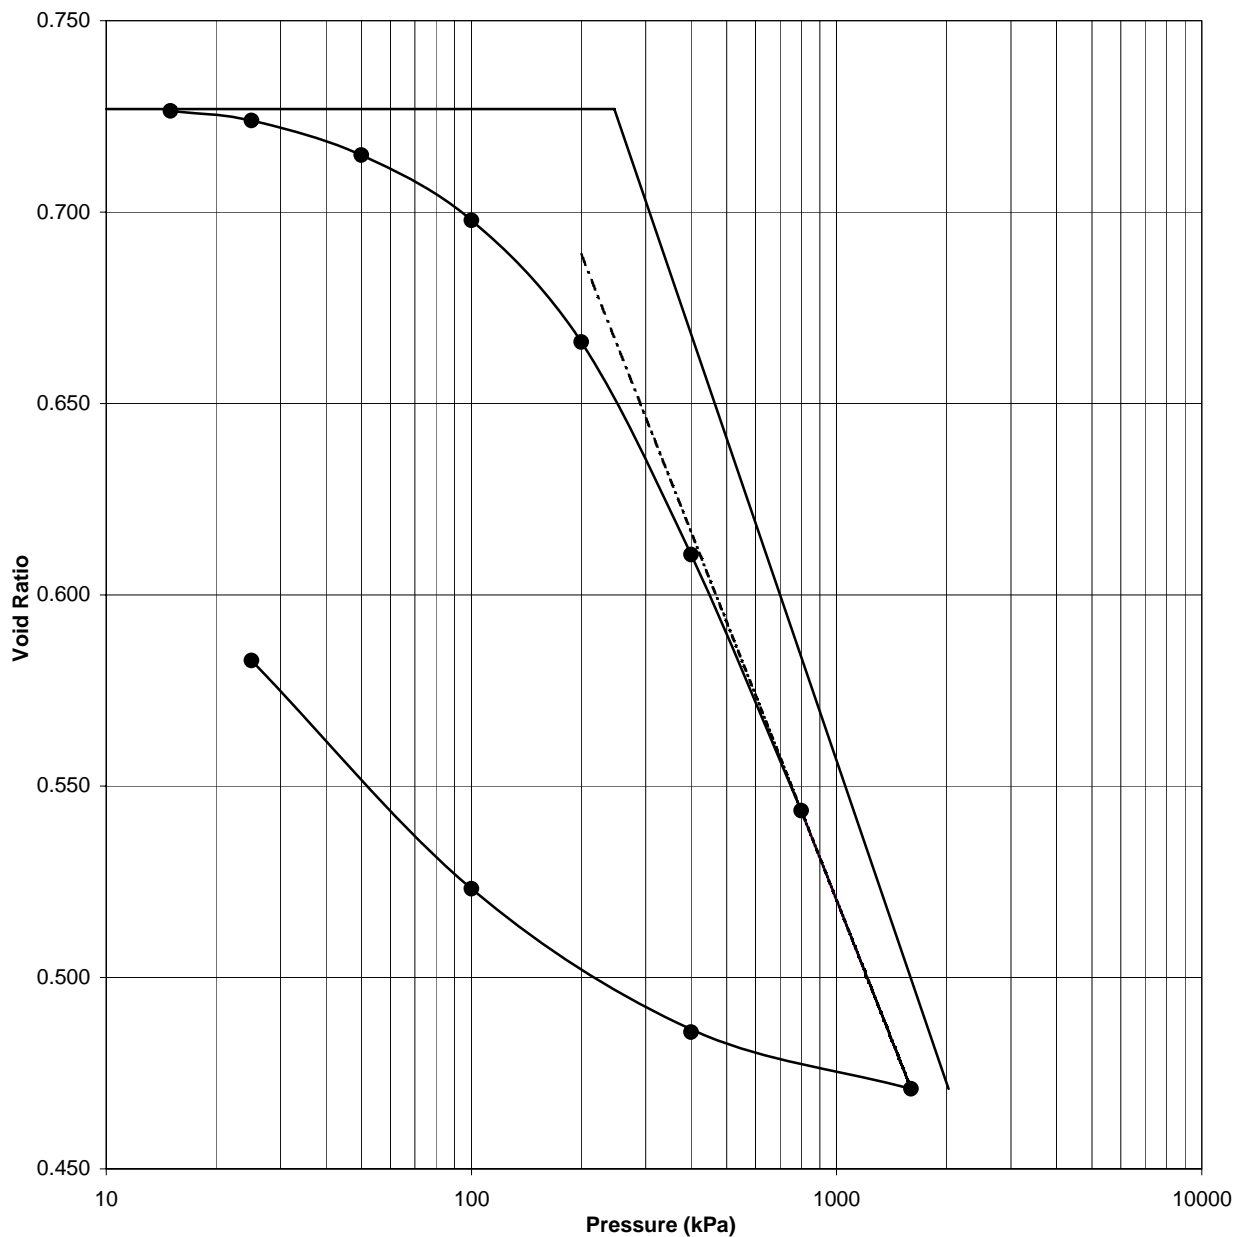

Bore hole No.: BH-8		Depth : 28.00m	
Initial Void Ratio, $e_0$	= 0.7269	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 246 kPa		
Compression Index $C_c$	= 0.2797	25 - 50	0.000209
$C_c/(1+e_0)$	= 0.1619	50 - 100	0.000197
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000184
Swelling Index, $C_s$	= 0.0619	200 - 400	0.000161
Recompression Index, $C_r$	$\approx$ 0.0619	400 - 800	0.000097
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/77




**e-logp curve**

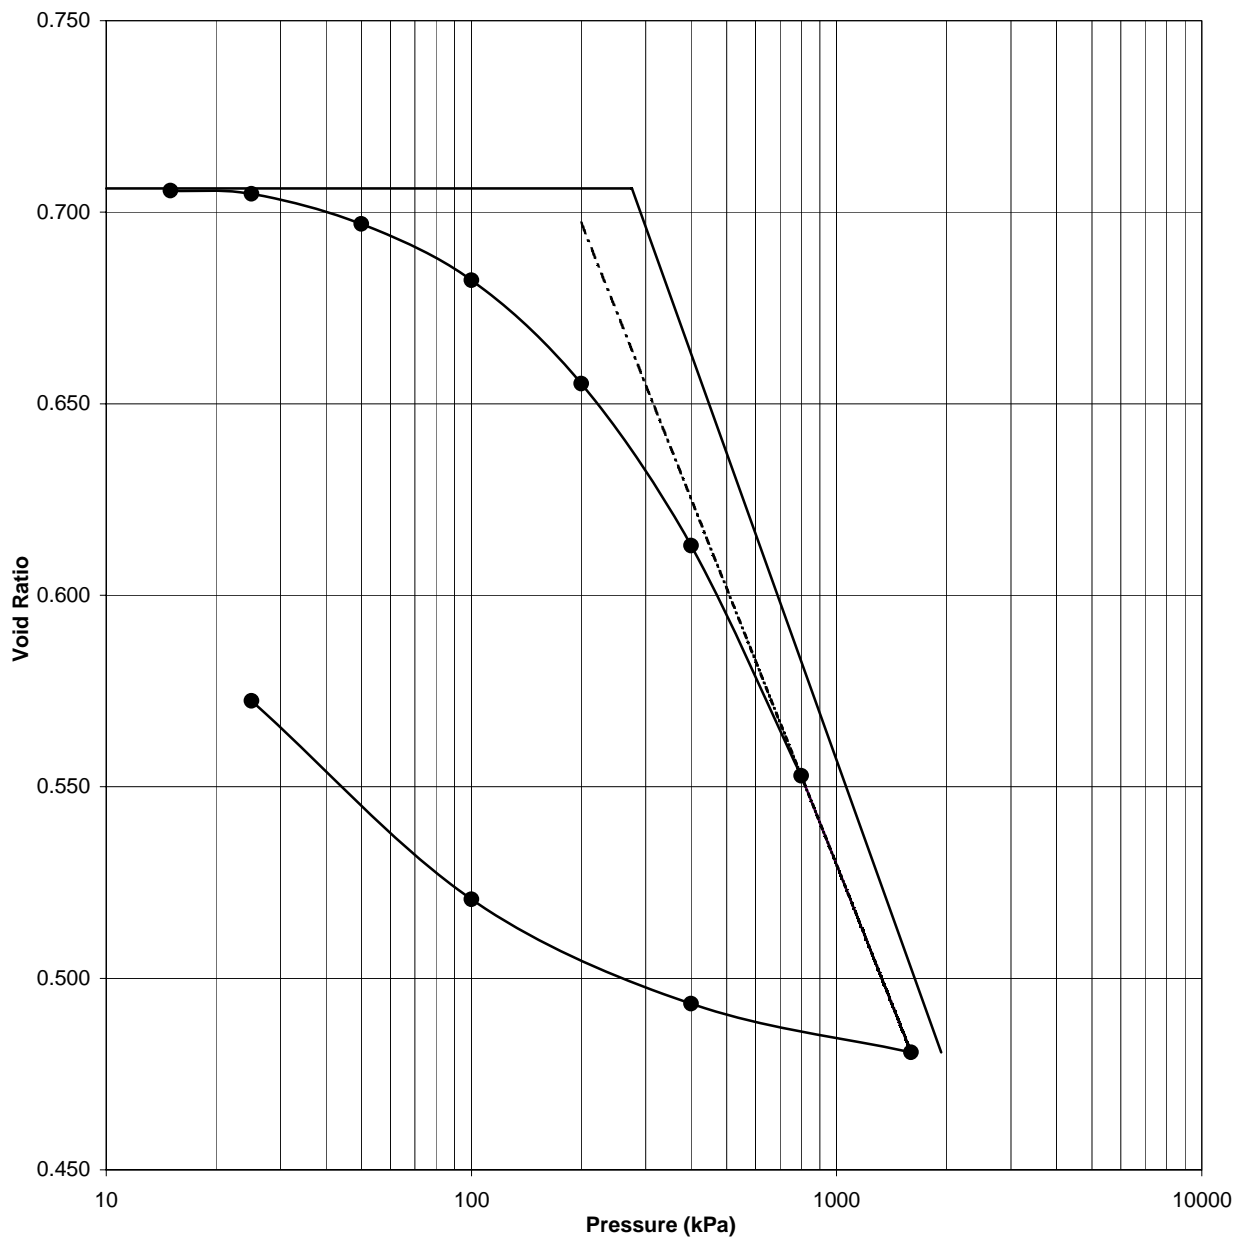


Bore hole No.: BH-8		Depth : 31.00m	
Initial Void Ratio, $e_0$	= 0.7062	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 275 kPa		
Compression Index $C_c$	= 0.2662	25 - 50	0.000184
$C_c/(1+e_0)$	= 0.1560	50 - 100	0.000172
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000158
Swelling Index, $C_s$	= 0.0508	200 - 400	0.000124
Recompression Index, $C_r$	$\approx$ 0.0508	400 - 800	0.000088
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/78

**e-logp curve**

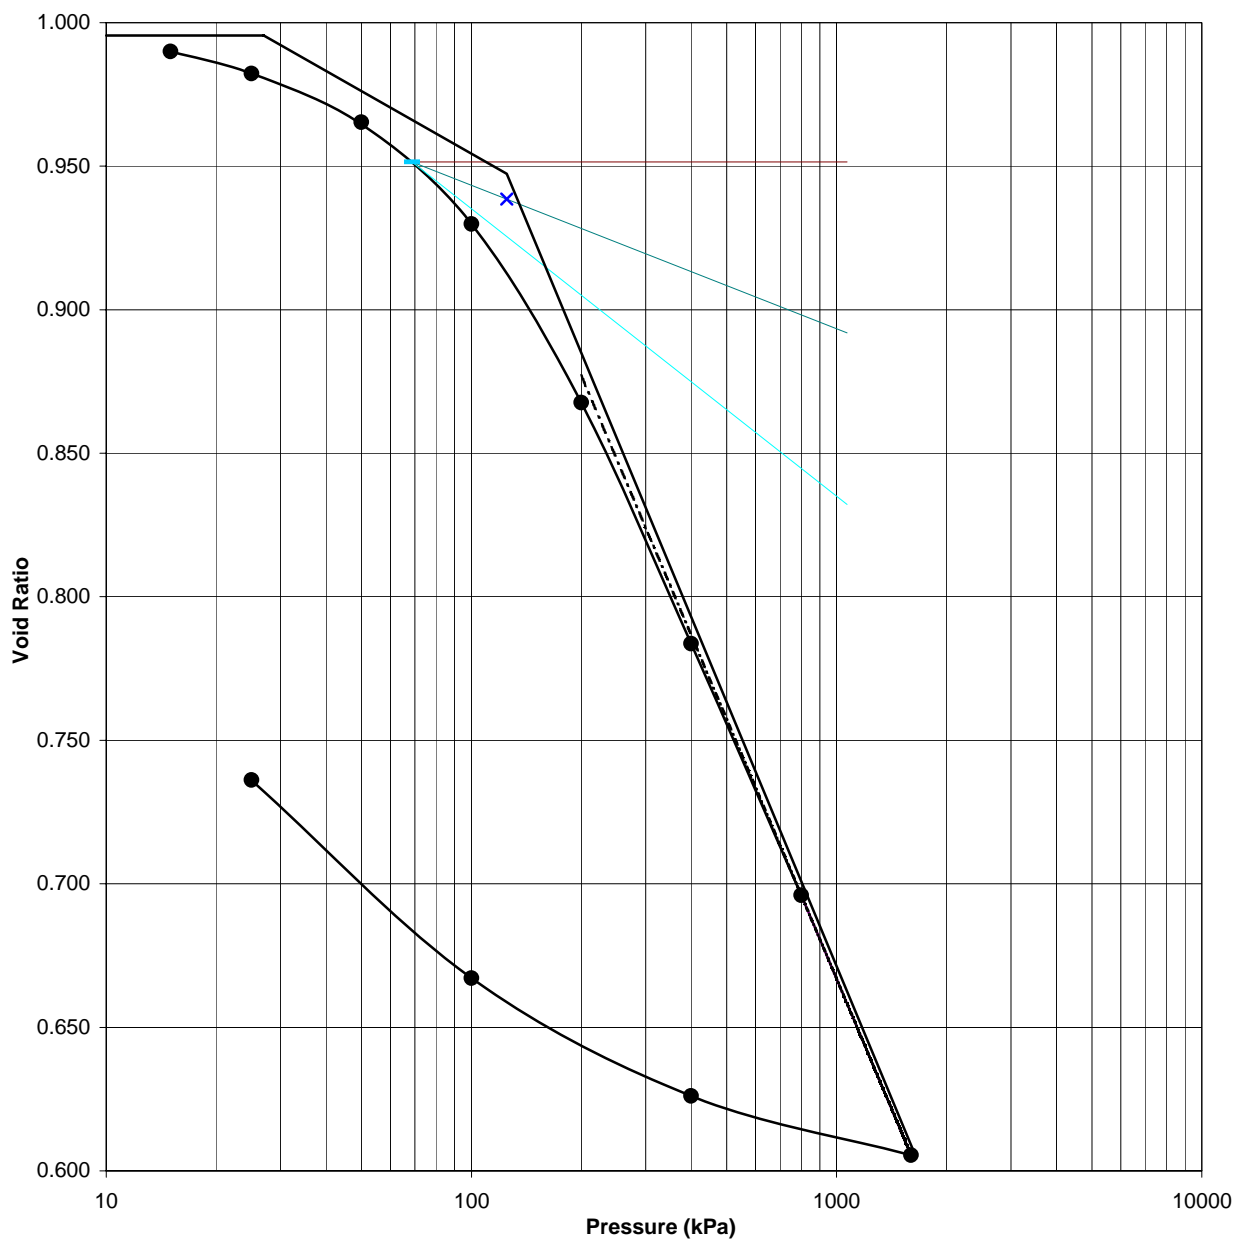


Bore hole No.: BH-10		Depth : 1.50m	
Initial Void Ratio, $e_0$	= 0.9955	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 27 kPa		
Compression Index $C_c$	= 0.3056	25 - 50	0.000341
$C_c/(1+e_0)$	= 0.1531	50 - 100	0.000356
Pre-consolidation Pressure, $p_c$	= 125 kPa	100 - 200	0.000312
Swelling Index, $C_s$	= 0.0723	200 - 400	0.000210
Recompression Index, $C_r$	$\approx$ 0.0723	400 - 800	0.000110
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/79

**e-logp curve**

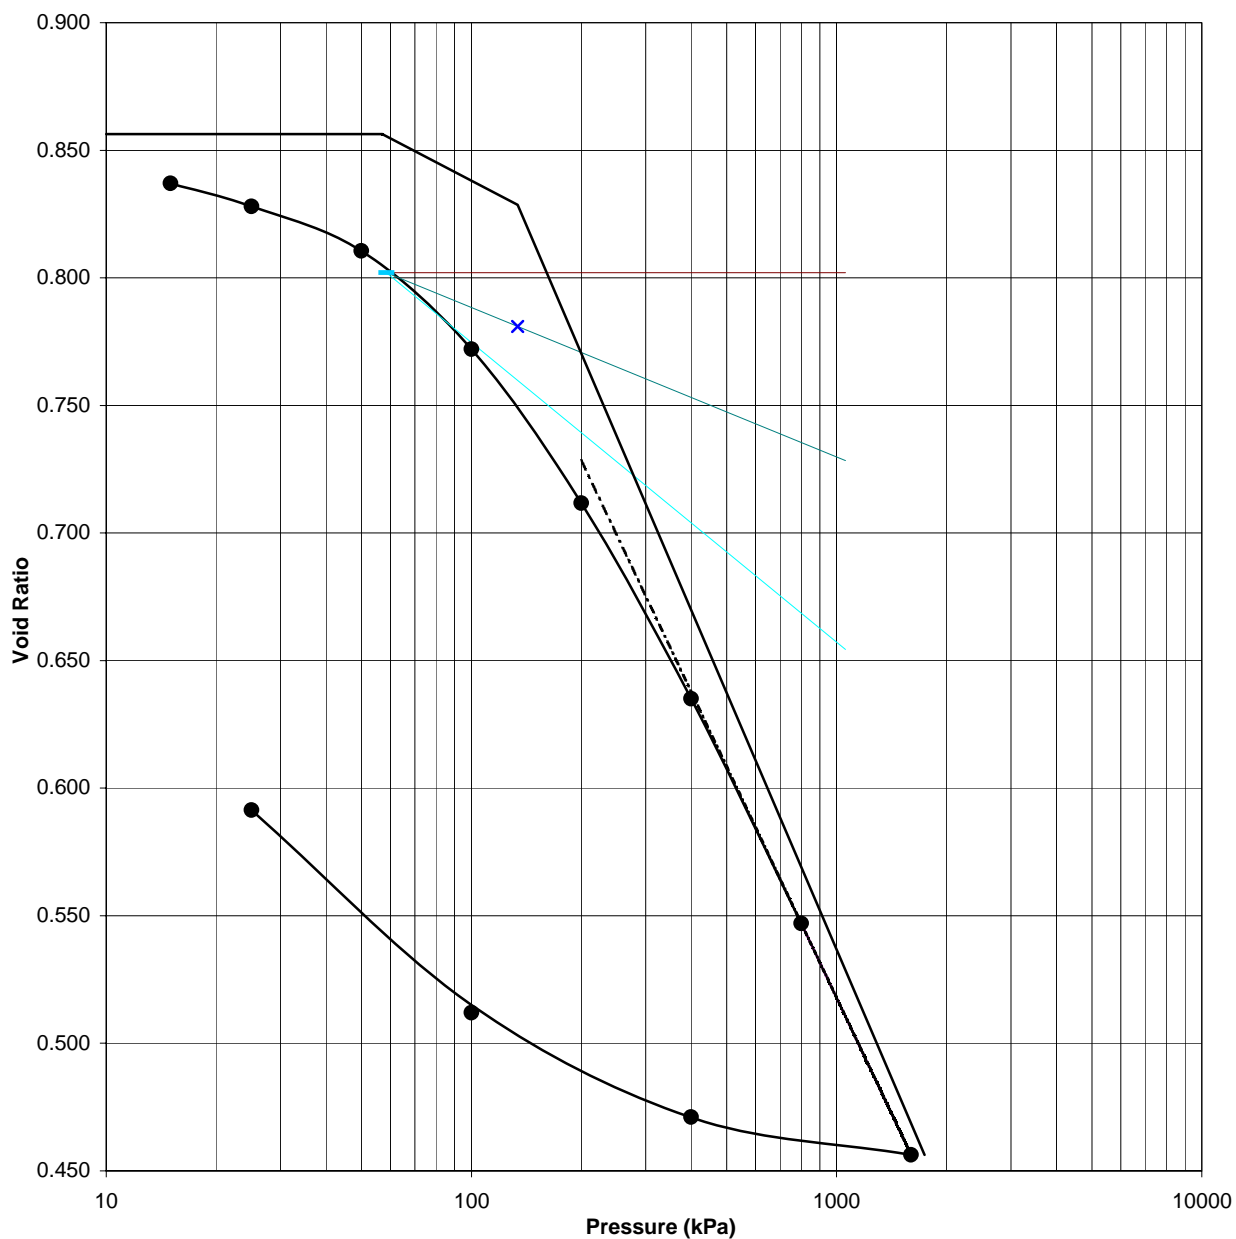


Bore hole No.: BH-10		Depth : 4.50m	
Initial Void Ratio, $e_0$	= 0.8563	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 57 kPa		
Compression Index $C_c$	= 0.3340	25 - 50	0.000375
$C_c/(1+e_0)$	= 0.1799	50 - 100	0.000416
Pre-consolidation Pressure, $p_c$	= 134 kPa	100 - 200	0.000325
Swelling Index, $C_s$	= 0.0748	200 - 400	0.000207
Recompression Index, $C_r$	$\approx$ 0.0748	400 - 800	0.000119
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/80

**e-logp curve**

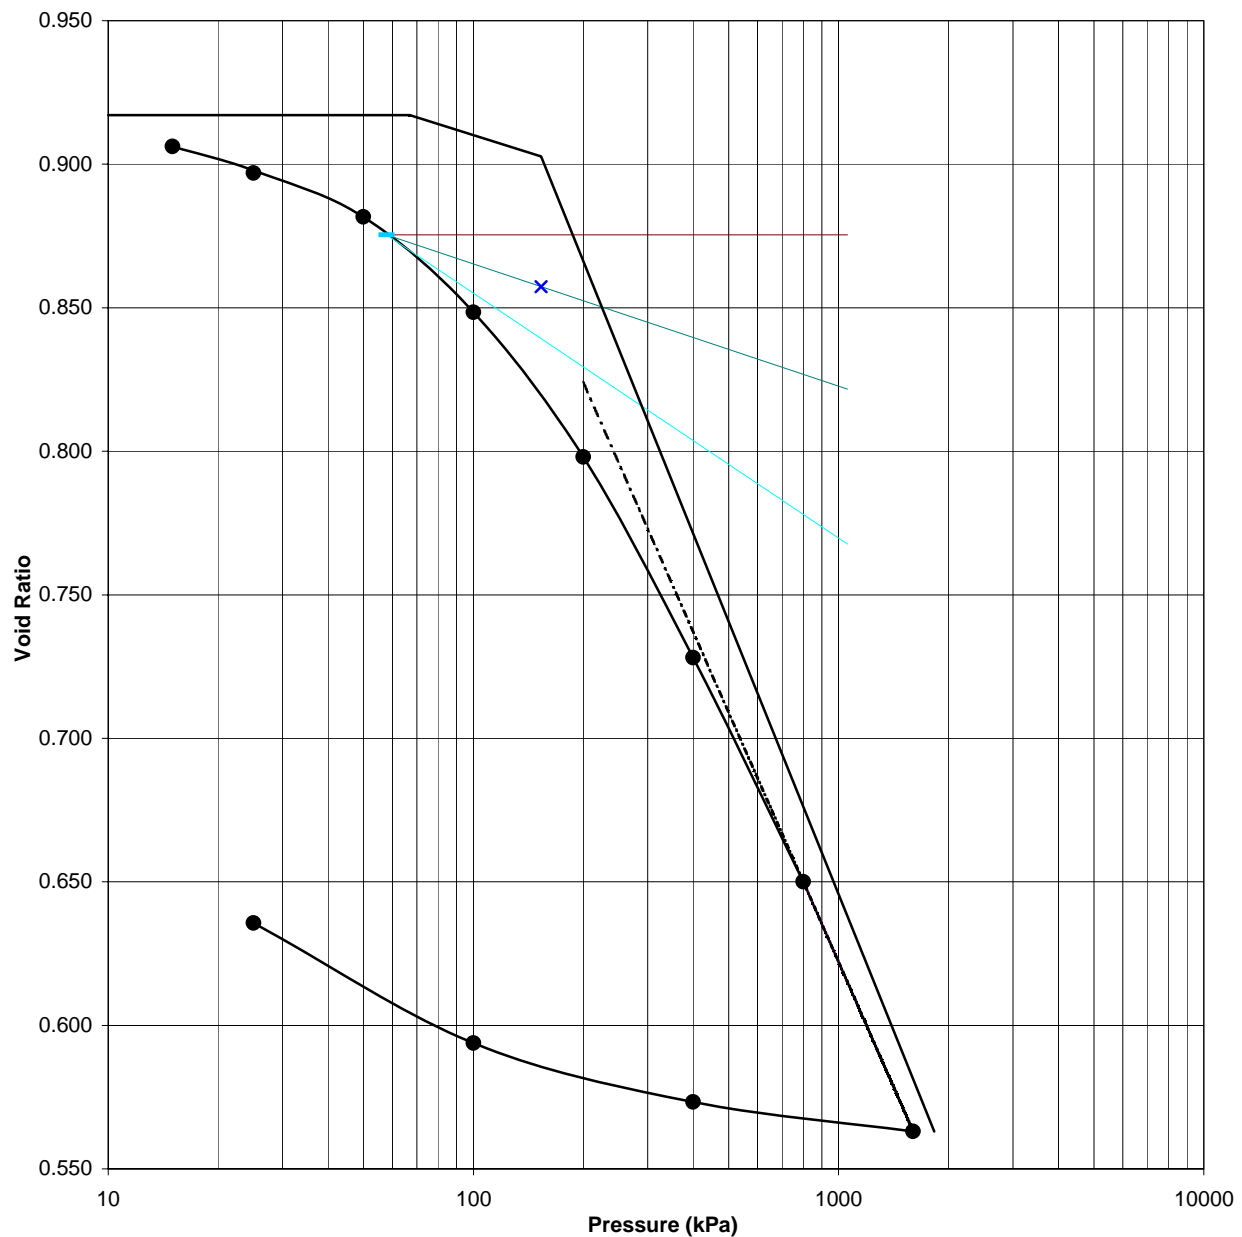


Bore hole No.: BH-10		Depth : 6.00m	
Initial Void Ratio, $e_0$	=	0.9171	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	67 kPa	
Compression Index $C_c$	=	0.3155	0.000319
$C_c/(1+e_0)$	=	0.1646	0.000347
Pre-consolidation Pressure, $p_c$	=	153 kPa	0.000263
Swelling Index, $C_s$	=	0.0402	0.000182
Recompression Index, $C_r$	≈	0.0402	0.000102
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/81

**e-logp curve**

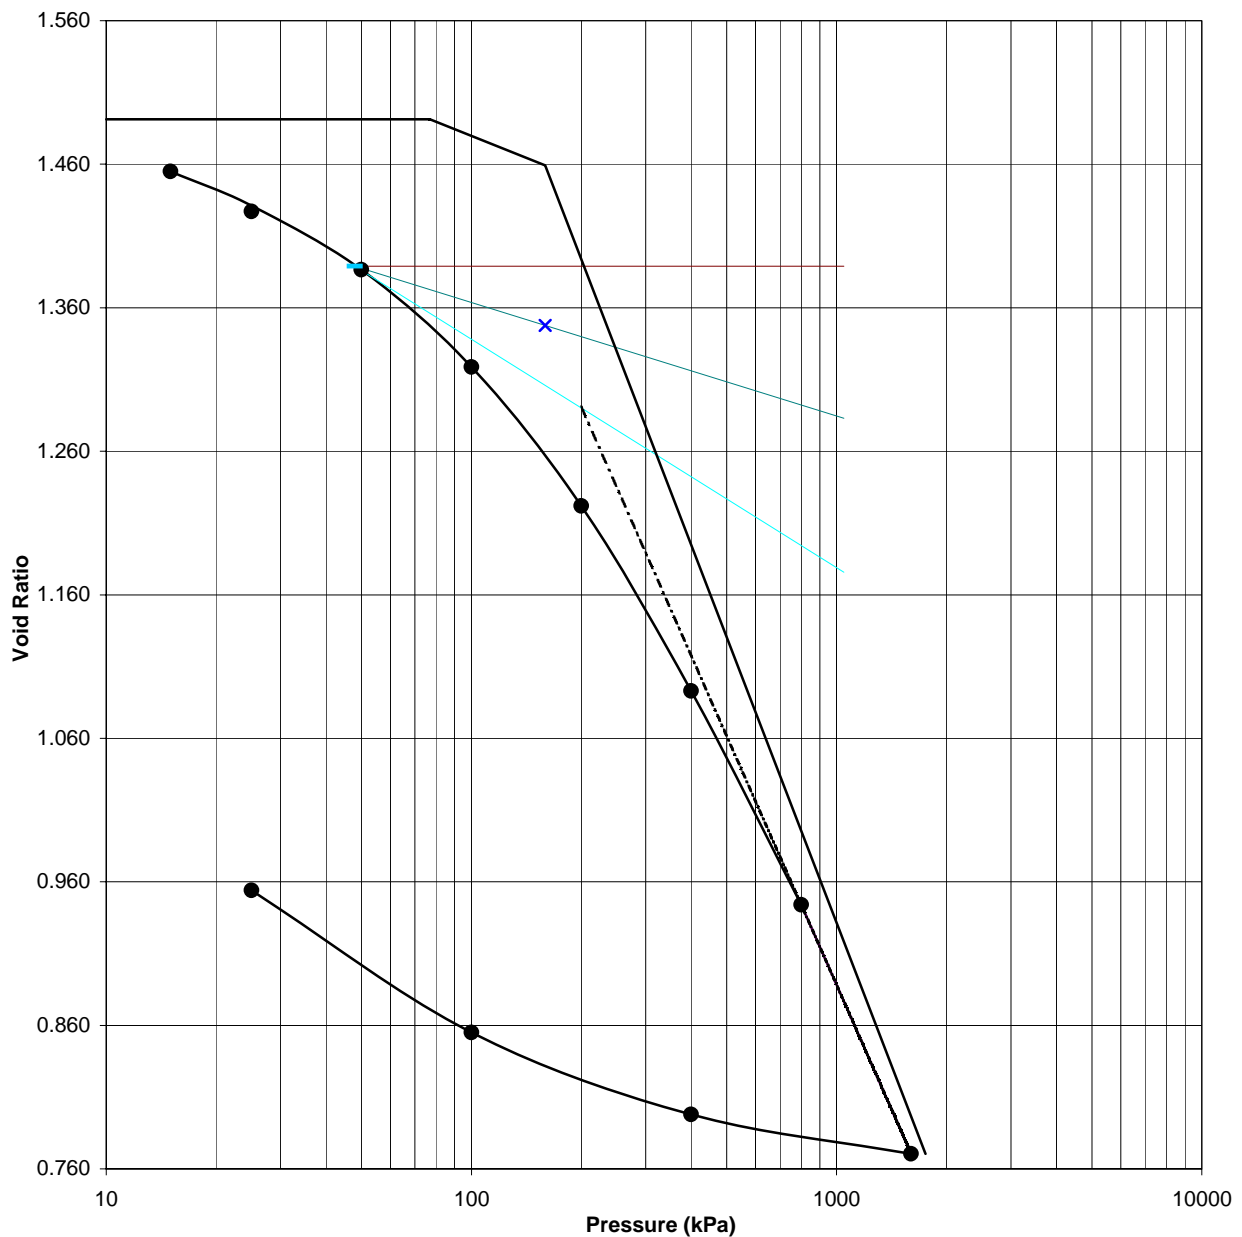


Bore hole No.: BH-10		Depth : 7.50m	
Initial Void Ratio, $e_0$	=	1.4912	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	=	77 kPa	
Compression Index $C_c$	=	0.6614	0.000648
$C_c/(1+e_0)$	=	0.2655	0.000545
Pre-consolidation Pressure, $p_c$	=	159 kPa	0.000388
Swelling Index, $C_s$	=	0.1016	0.000259
Recompression Index, $C_r$	≈	0.1016	0.000150
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/82

**e-logp curve**

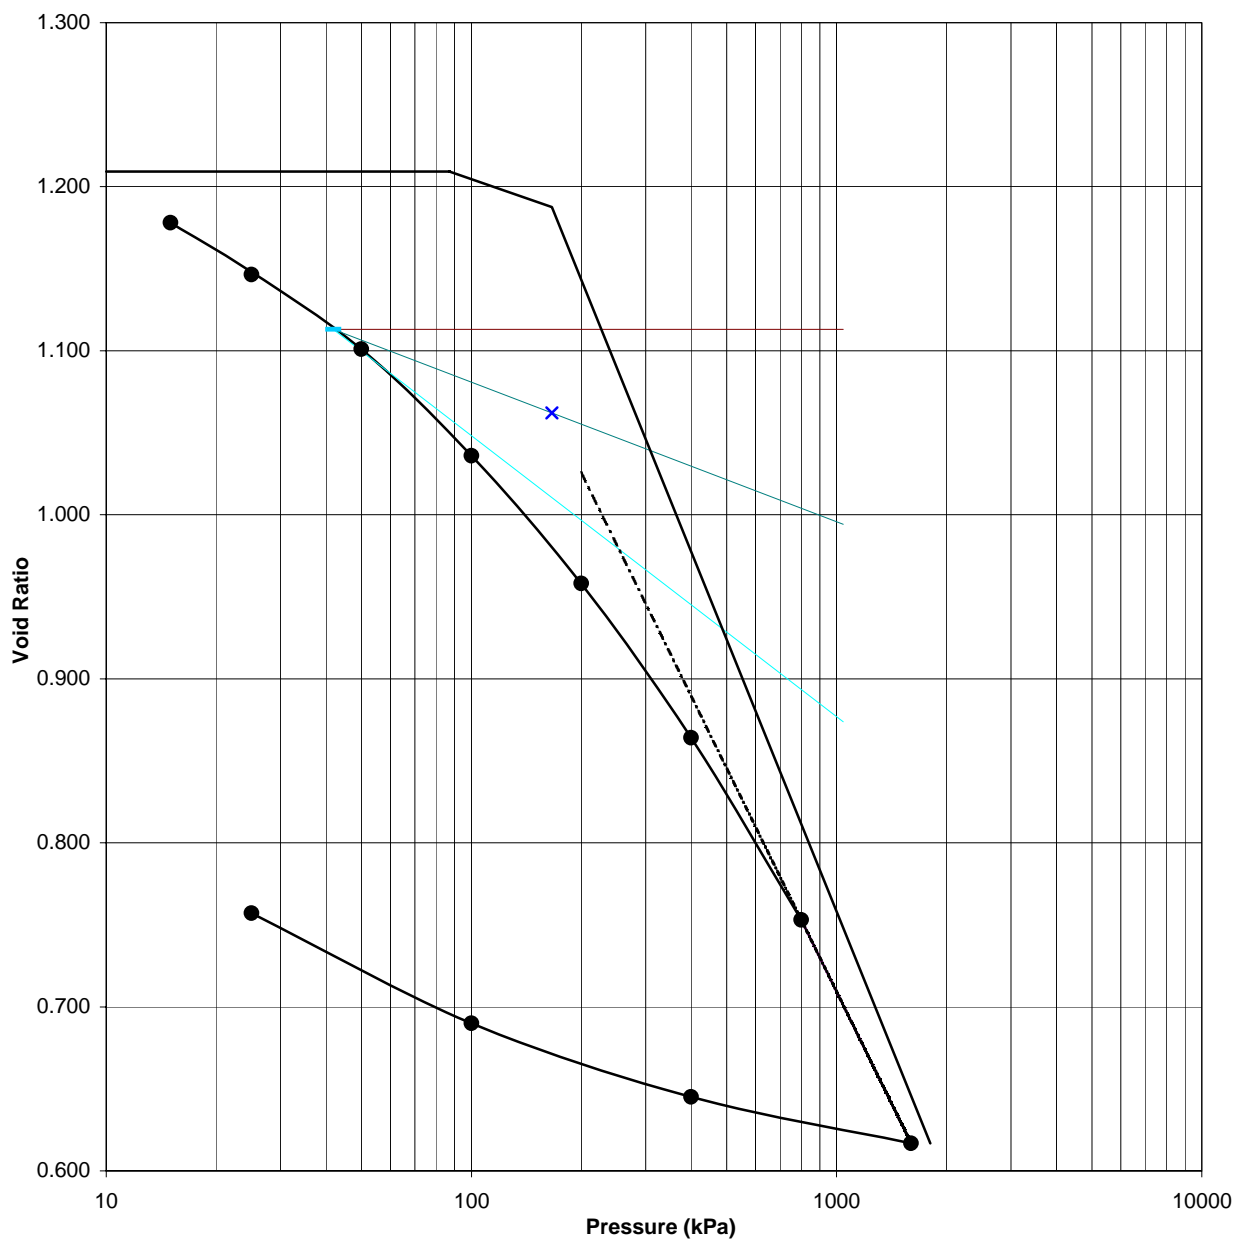


Bore hole No.: BH-10		Depth : 9.00m	
Initial Void Ratio, $e_0$	= 1.2093	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 87 kPa		
Compression Index $C_c$	= 0.5506	25 - 50	0.000823
$C_c/(1+e_0)$	= 0.2492	50 - 100	0.000588
Pre-consolidation Pressure, $p_c$	= 166 kPa	100 - 200	0.000353
Swelling Index, $C_s$	= 0.0777	200 - 400	0.000213
Recompression Index, $C_r$	$\approx$ 0.0777	400 - 800	0.000126
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/83

**e-logp curve**

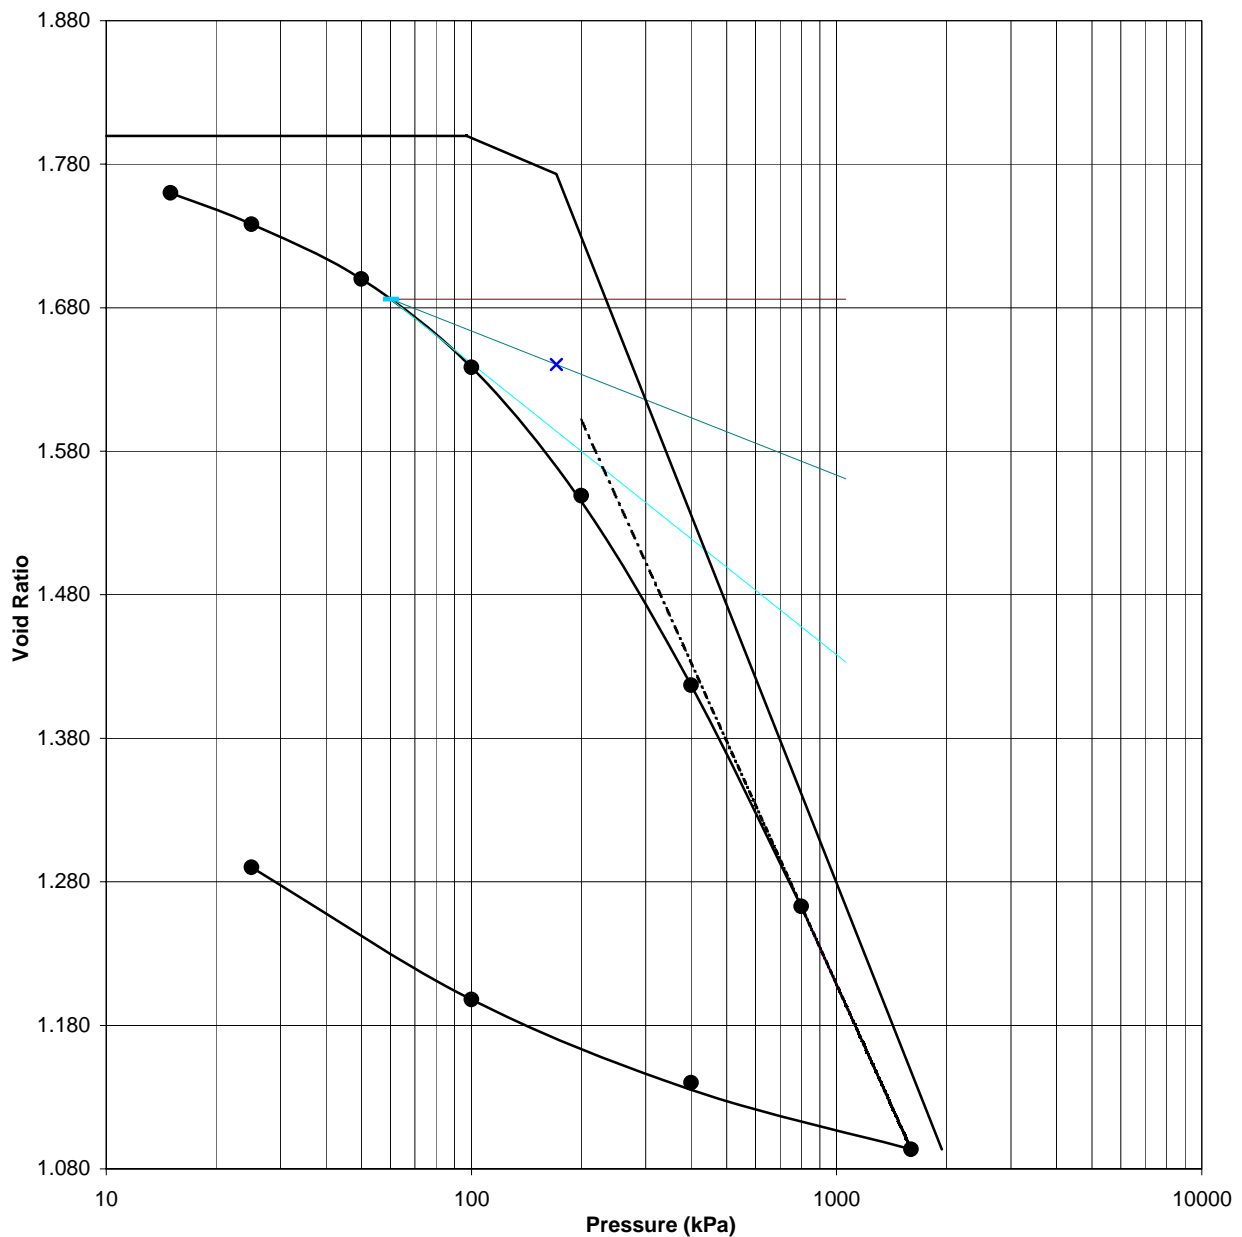

Bore hole No.: BH-10		Depth : 10.50m	
Initial Void Ratio, $e_0$	= 1.7998	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 97 kPa		
Compression Index $C_c$	= 0.6438	25 - 50	0.000546
$C_c/(1+e_0)$	= 0.2300	50 - 100	0.000439
Pre-consolidation Pressure, $p_c$	= 171 kPa	100 - 200	0.000320
Swelling Index, $C_s$	= 0.1088	200 - 400	0.000236
Recompression Index, $C_r$	$\approx$ 0.1088	400 - 800	0.000138
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/84


**e-logp curve**

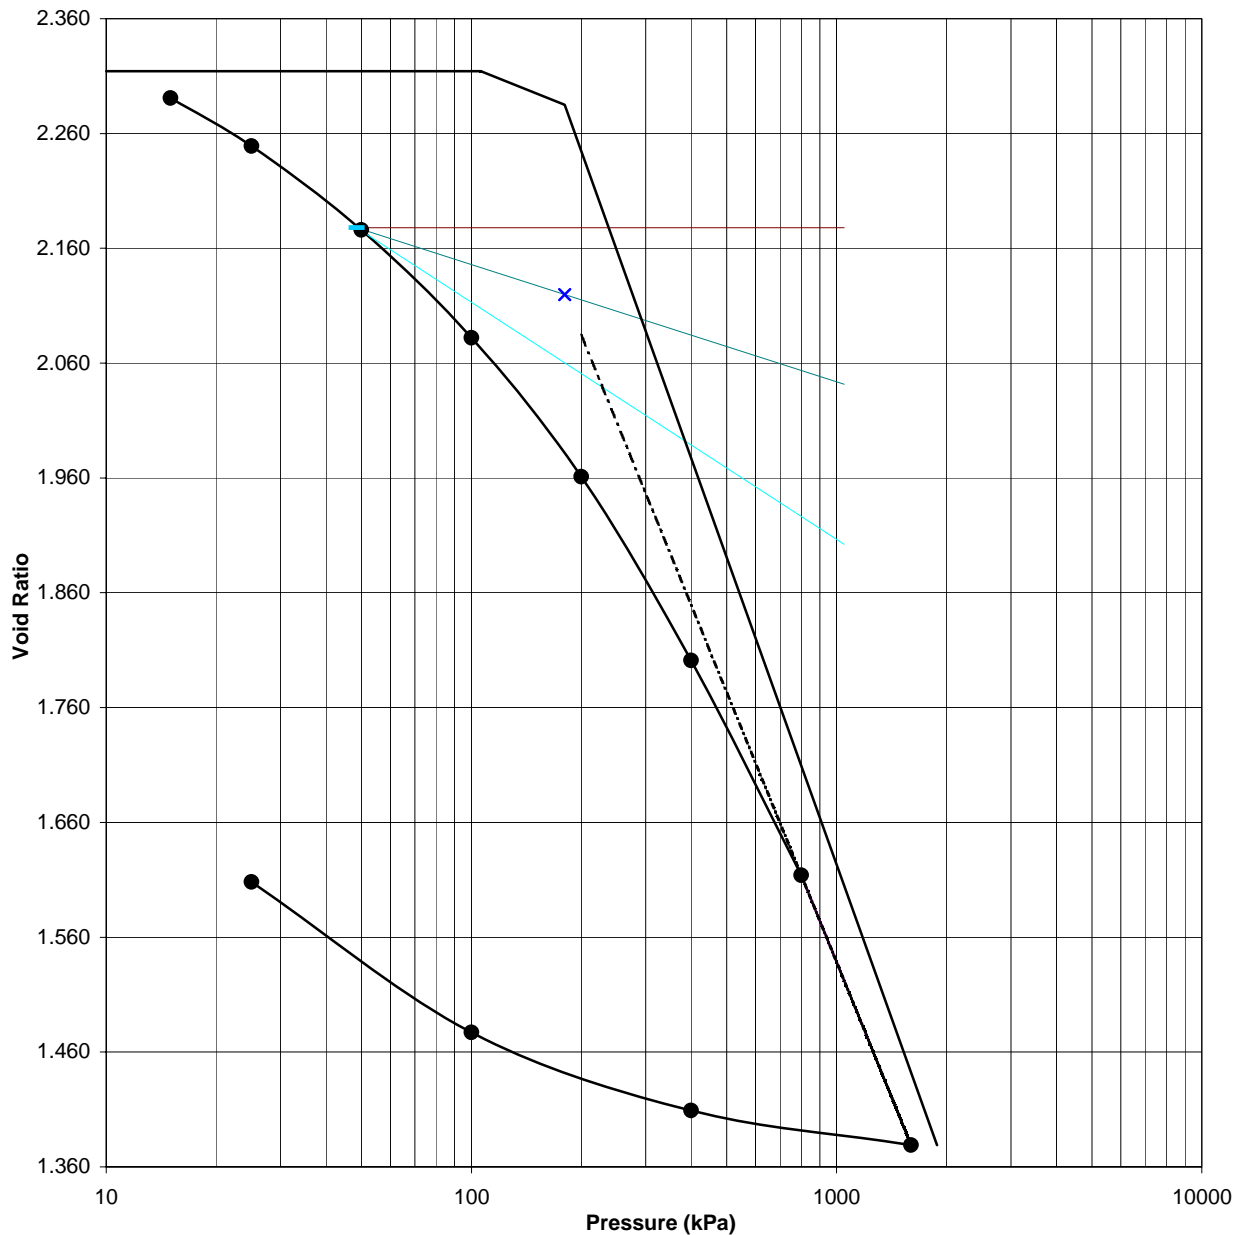

Bore hole No.: BH-10		Depth : 12.00m	
Initial Void Ratio, $e_0$	= 2.3142	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 106 kPa		
Compression Index $C_c$	= 0.8891	25 - 50	0.000882
$C_c/(1+e_0)$	= 0.2683	50 - 100	0.000567
Pre-consolidation Pressure, $p_c$	= 180 kPa	100 - 200	0.000365
Swelling Index, $C_s$	= 0.1269	200 - 400	0.000241
Recompression Index, $C_r$	$\approx$ 0.1269	400 - 800	0.000141
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/85




**e-logp curve**

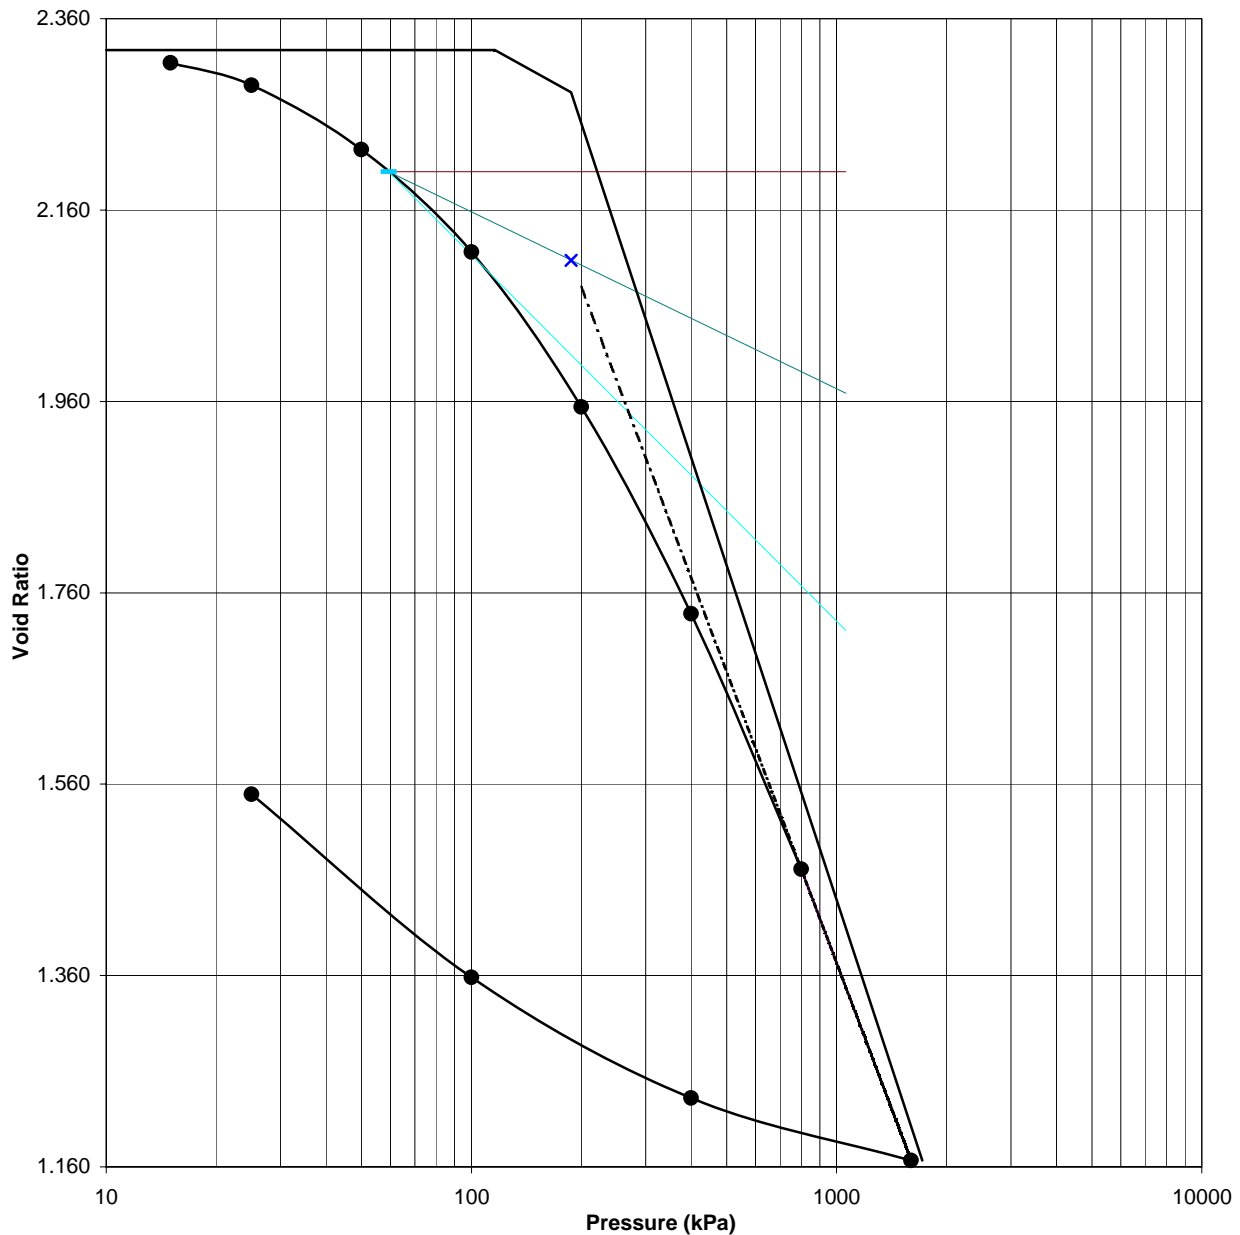


Bore hole No.: BH-10		Depth : 13.50m	
Initial Void Ratio, $e_0$	= 2.3272	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 116 kPa		
Compression Index $C_c$	= 1.1612	25 - 50	0.000810
$C_c/(1+e_0)$	= 0.3490	50 - 100	0.000644
Pre-consolidation Pressure, $p_c$	= 188 kPa	100 - 200	0.000486
Swelling Index, $C_s$	= 0.2118	200 - 400	0.000325
Recompression Index, $C_r$	$\approx$ 0.2118	400 - 800	0.000201
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/86

**e-logp curve**

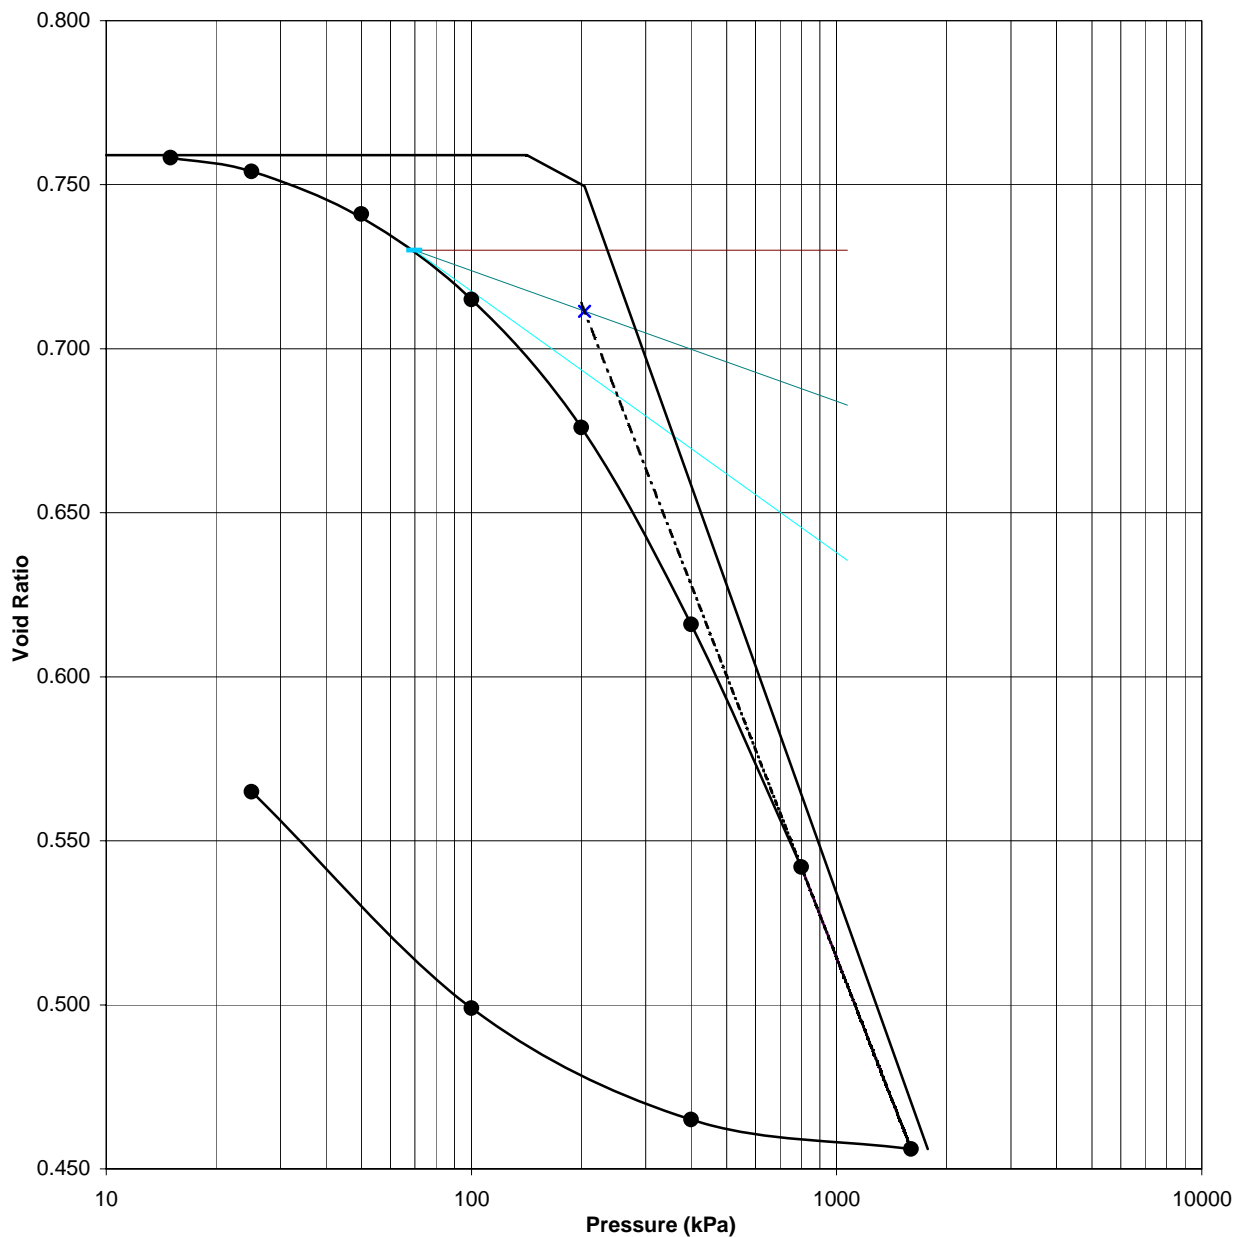


Bore hole No.: BH-10		Depth : 16.50m	
Initial Void Ratio, $e_0$	= 0.7590	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 142 kPa		
Compression Index $C_c$	= 0.3121	25 - 50	0.000295
$C_c/(1+e_0)$	= 0.1774	50 - 100	0.000296
Pre-consolidation Pressure, $p_c$	= 204 kPa	100 - 200	0.000222
Swelling Index, $C_s$	= 0.0603	200 - 400	0.000170
Recompression Index, $C_r$	≈ 0.0603	400 - 800	0.000105
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/87

**e-logp curve**

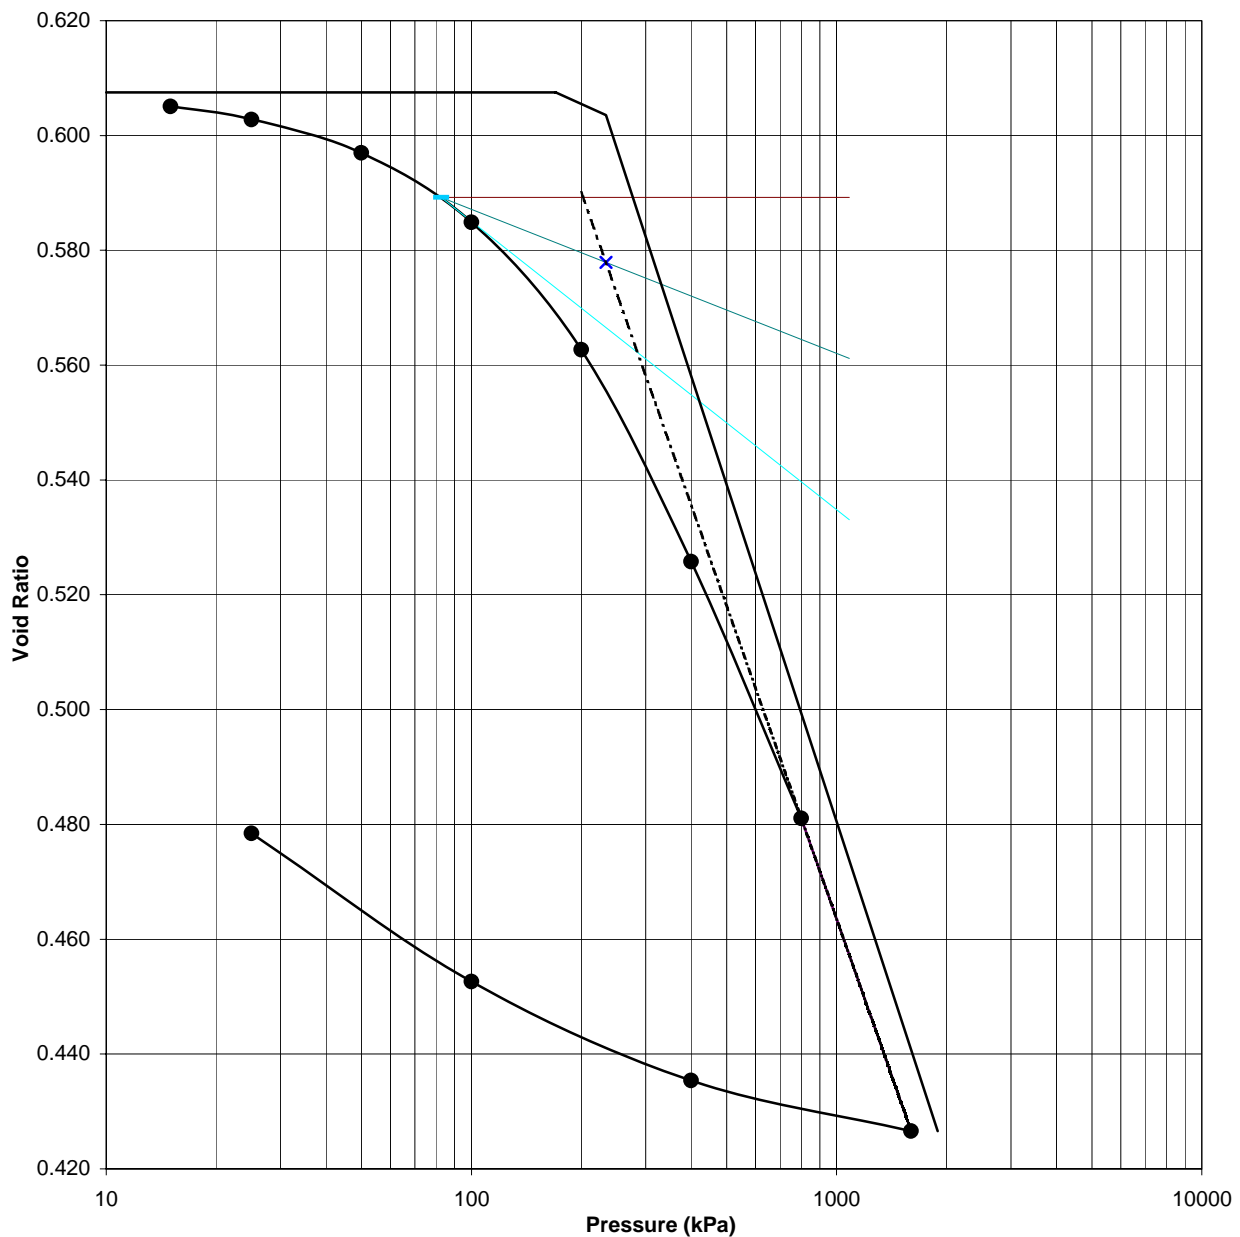


Bore hole No.: BH-10		Depth : 19.50m	
Initial Void Ratio, $e_0$	= 0.6075	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 170 kPa		
Compression Index $C_c$	= 0.1949	25 - 50	0.000145
$C_c/(1+e_0)$	= 0.1212	50 - 100	0.000150
Pre-consolidation Pressure, $p_c$	= 233 kPa	100 - 200	0.000138
Swelling Index, $C_s$	= 0.0287	200 - 400	0.000115
Recompression Index, $C_r$	$\approx$ 0.0287	400 - 800	0.000070
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/88

**e-logp curve**

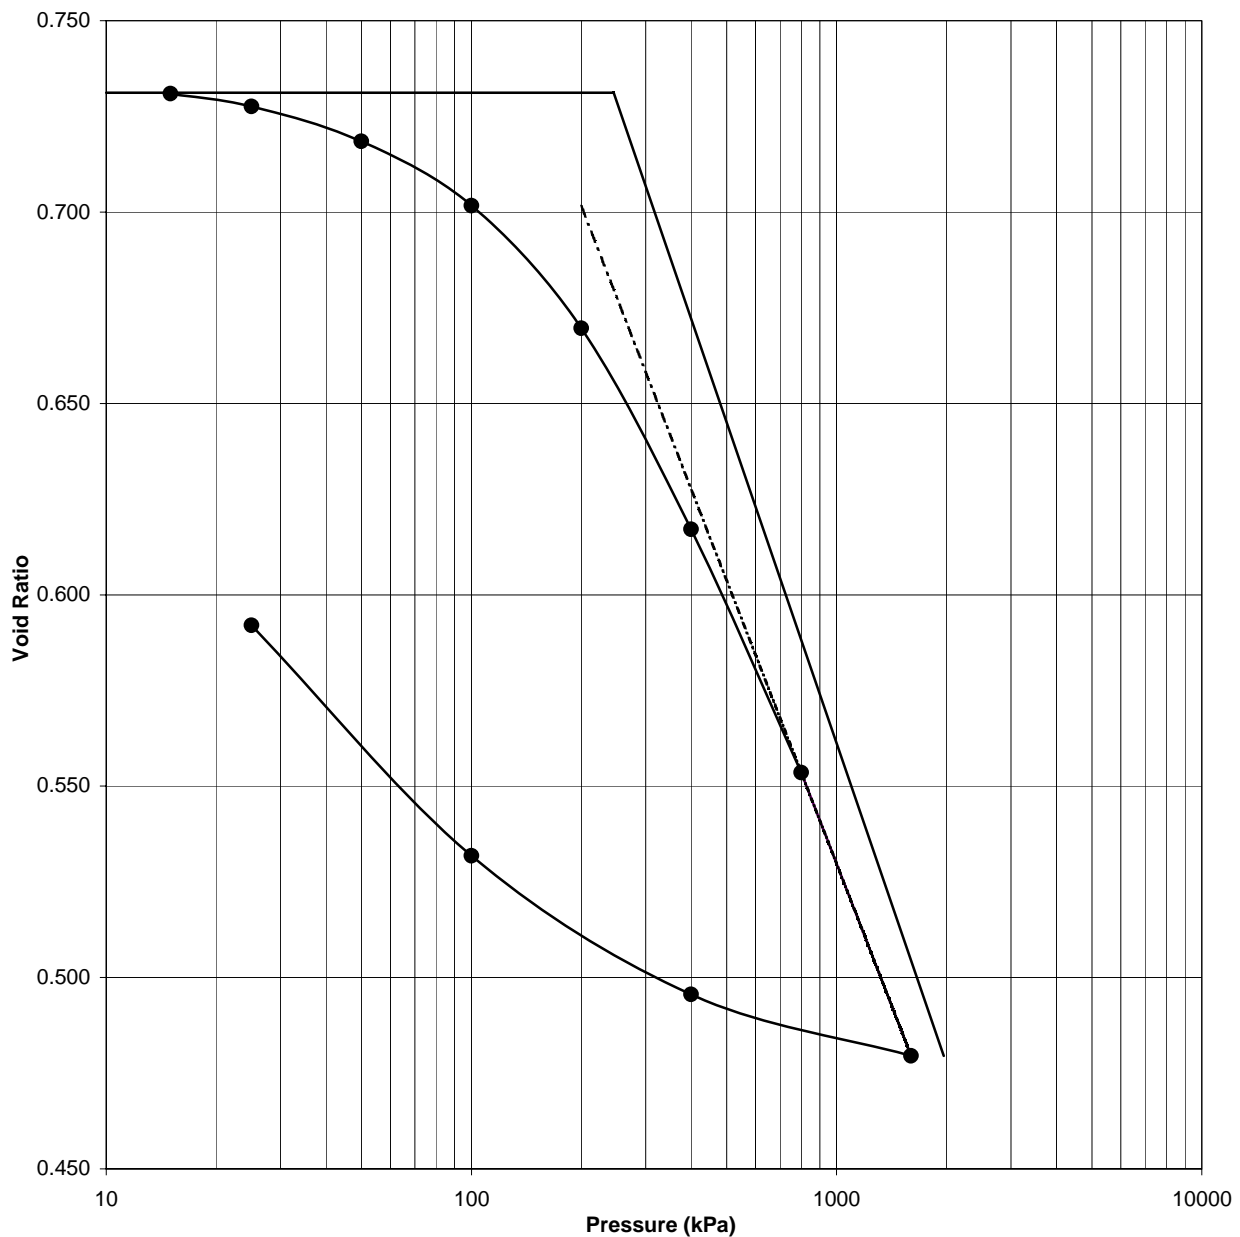


Bore hole No.: BH-10		Depth : 27.00m	
Initial Void Ratio, $e_0$	= 0.7312	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 245 kPa		
Compression Index $C_c$	= 0.2784	25 - 50	0.000211
$C_c/(1+e_0)$	= 0.1608	50 - 100	0.000194
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000185
Swelling Index, $C_s$	= 0.0623	200 - 400	0.000152
Recompression Index, $C_r$	$\approx$ 0.0623	400 - 800	0.000092
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/89

**e-logp curve**

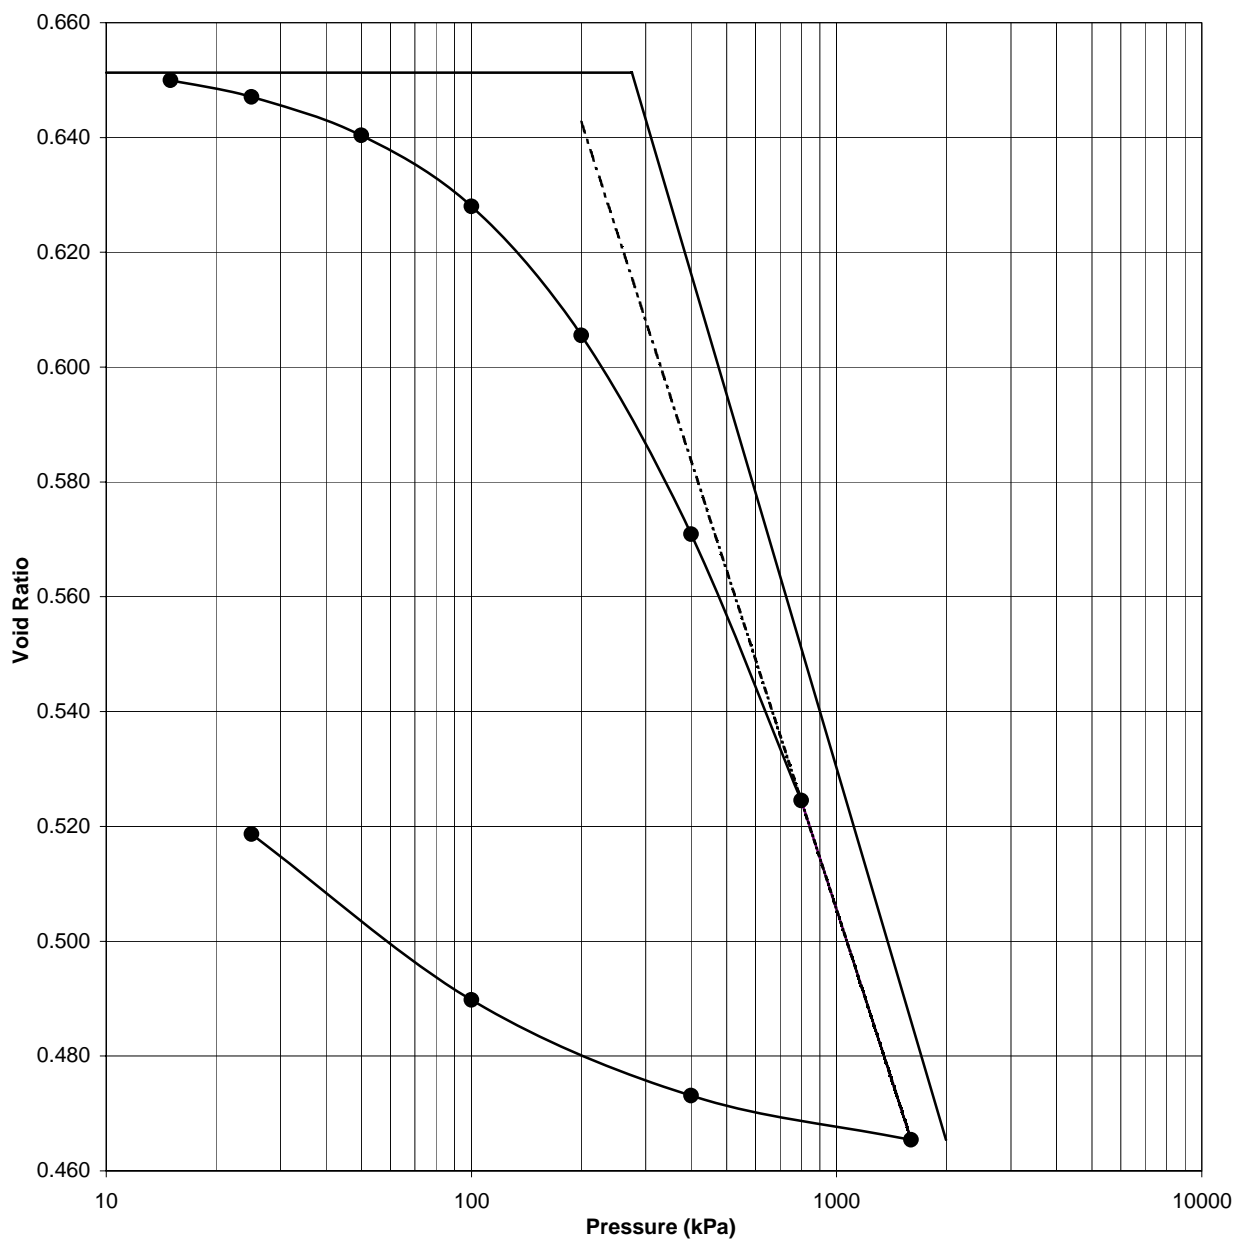


Bore hole No.: BH-10		Depth : 30.00m	
Initial Void Ratio, $e_0$	= 0.6513	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 275 kPa		
Compression Index $C_c$	= 0.2161	25 - 50	0.000162
$C_c/(1+e_0)$	= 0.1309	50 - 100	0.000150
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000136
Swelling Index, $C_s$	= 0.0295	200 - 400	0.000105
Recompression Index, $C_r$	$\approx$ 0.0295	400 - 800	0.000070
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/90

**e-logp curve**

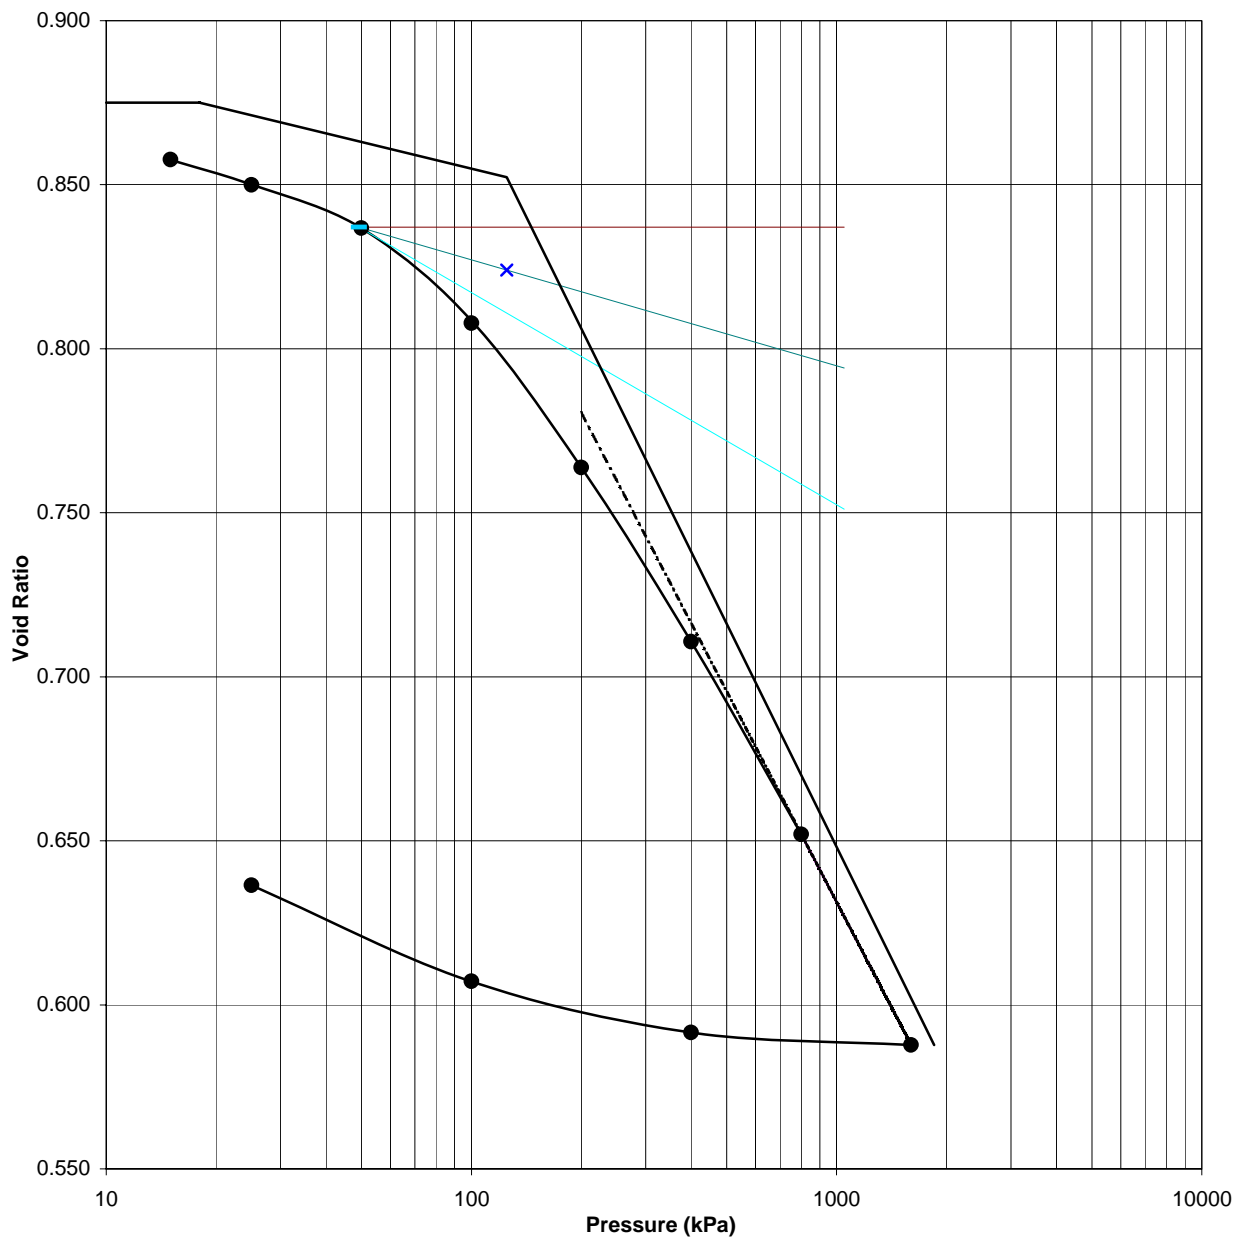


Bore hole No.: BH-11		Depth : 1.00m	
Initial Void Ratio, $e_0$	= 0.8750	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 18 kPa		
Compression Index $C_c$	= 0.2261	25 - 50	0.000281
$C_c/(1+e_0)$	= 0.1206	50 - 100	0.000309
Pre-consolidation Pressure, $p_c$	= 125 kPa	100 - 200	0.000235
Swelling Index, $C_s$	= 0.0269	200 - 400	0.000142
Recompression Index, $C_r$	$\approx$ 0.0269	400 - 800	0.000078
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. : CCPL/20101211
			Fig. No. G/91

**e-logp curve**

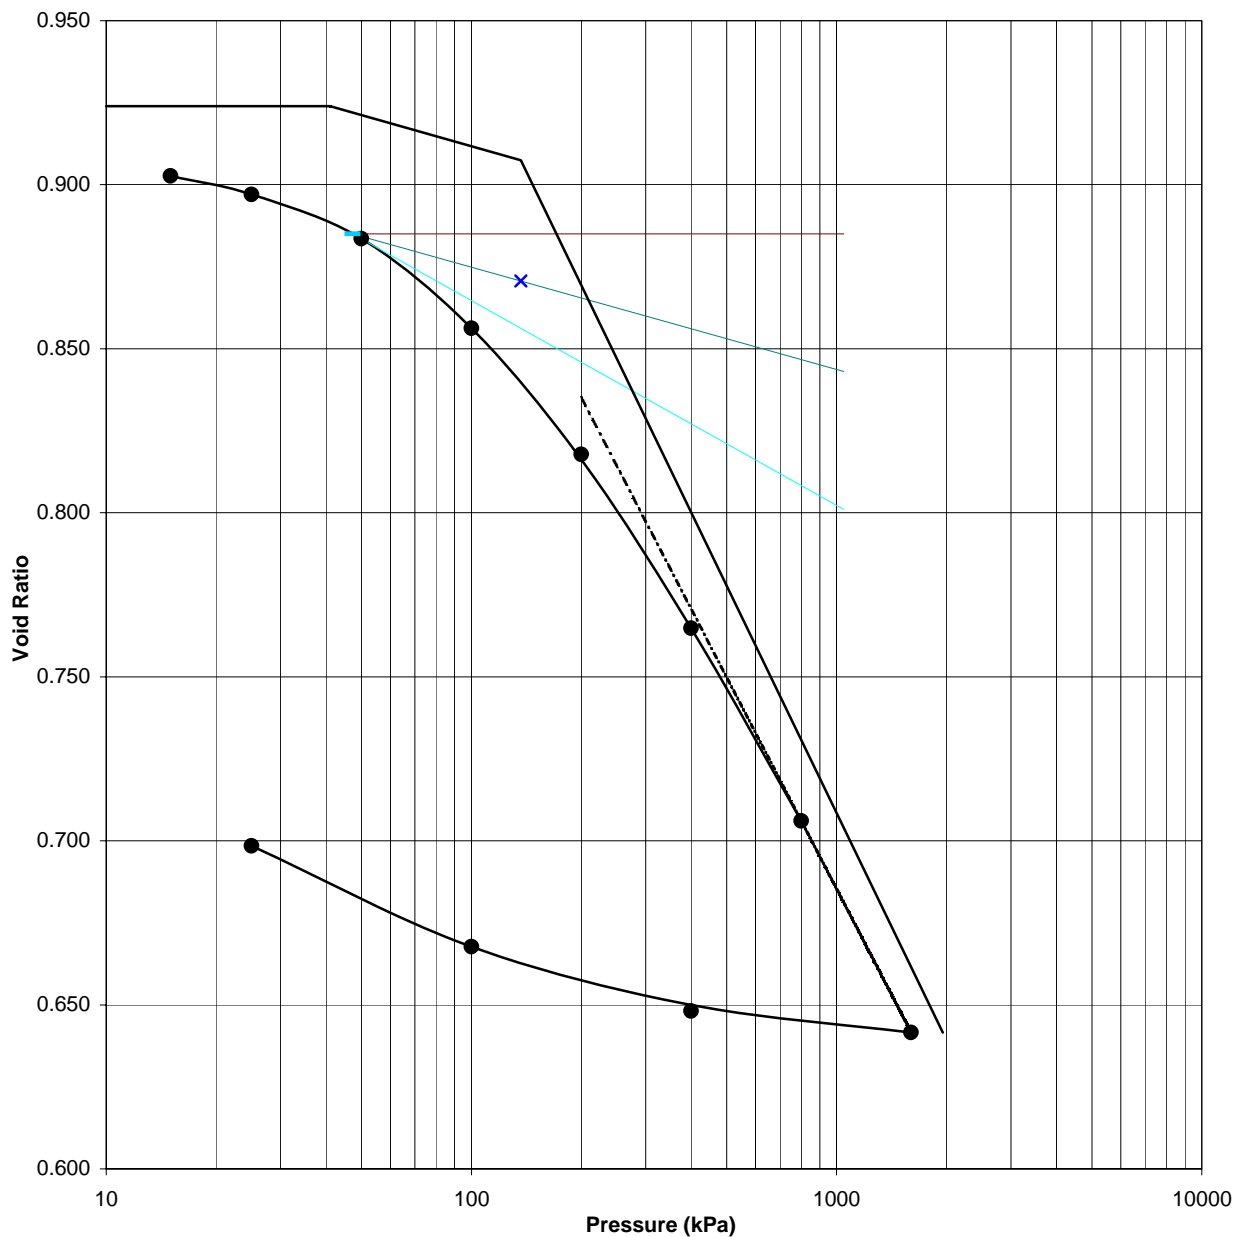


Bore hole No.: BH-11		Depth : 2.50m	
Initial Void Ratio, $e_0$	= 0.9239	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 41 kPa		
Compression Index $C_c$	= 0.2300	25 - 50	0.000279
$C_c/(1+e_0)$	= 0.1195	50 - 100	0.000285
Pre-consolidation Pressure, $p_c$	= 136 kPa	100 - 200	0.000199
Swelling Index, $C_s$	= 0.0315	200 - 400	0.000138
Recompression Index, $C_r$	≈ 0.0315	400 - 800	0.000076
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/92

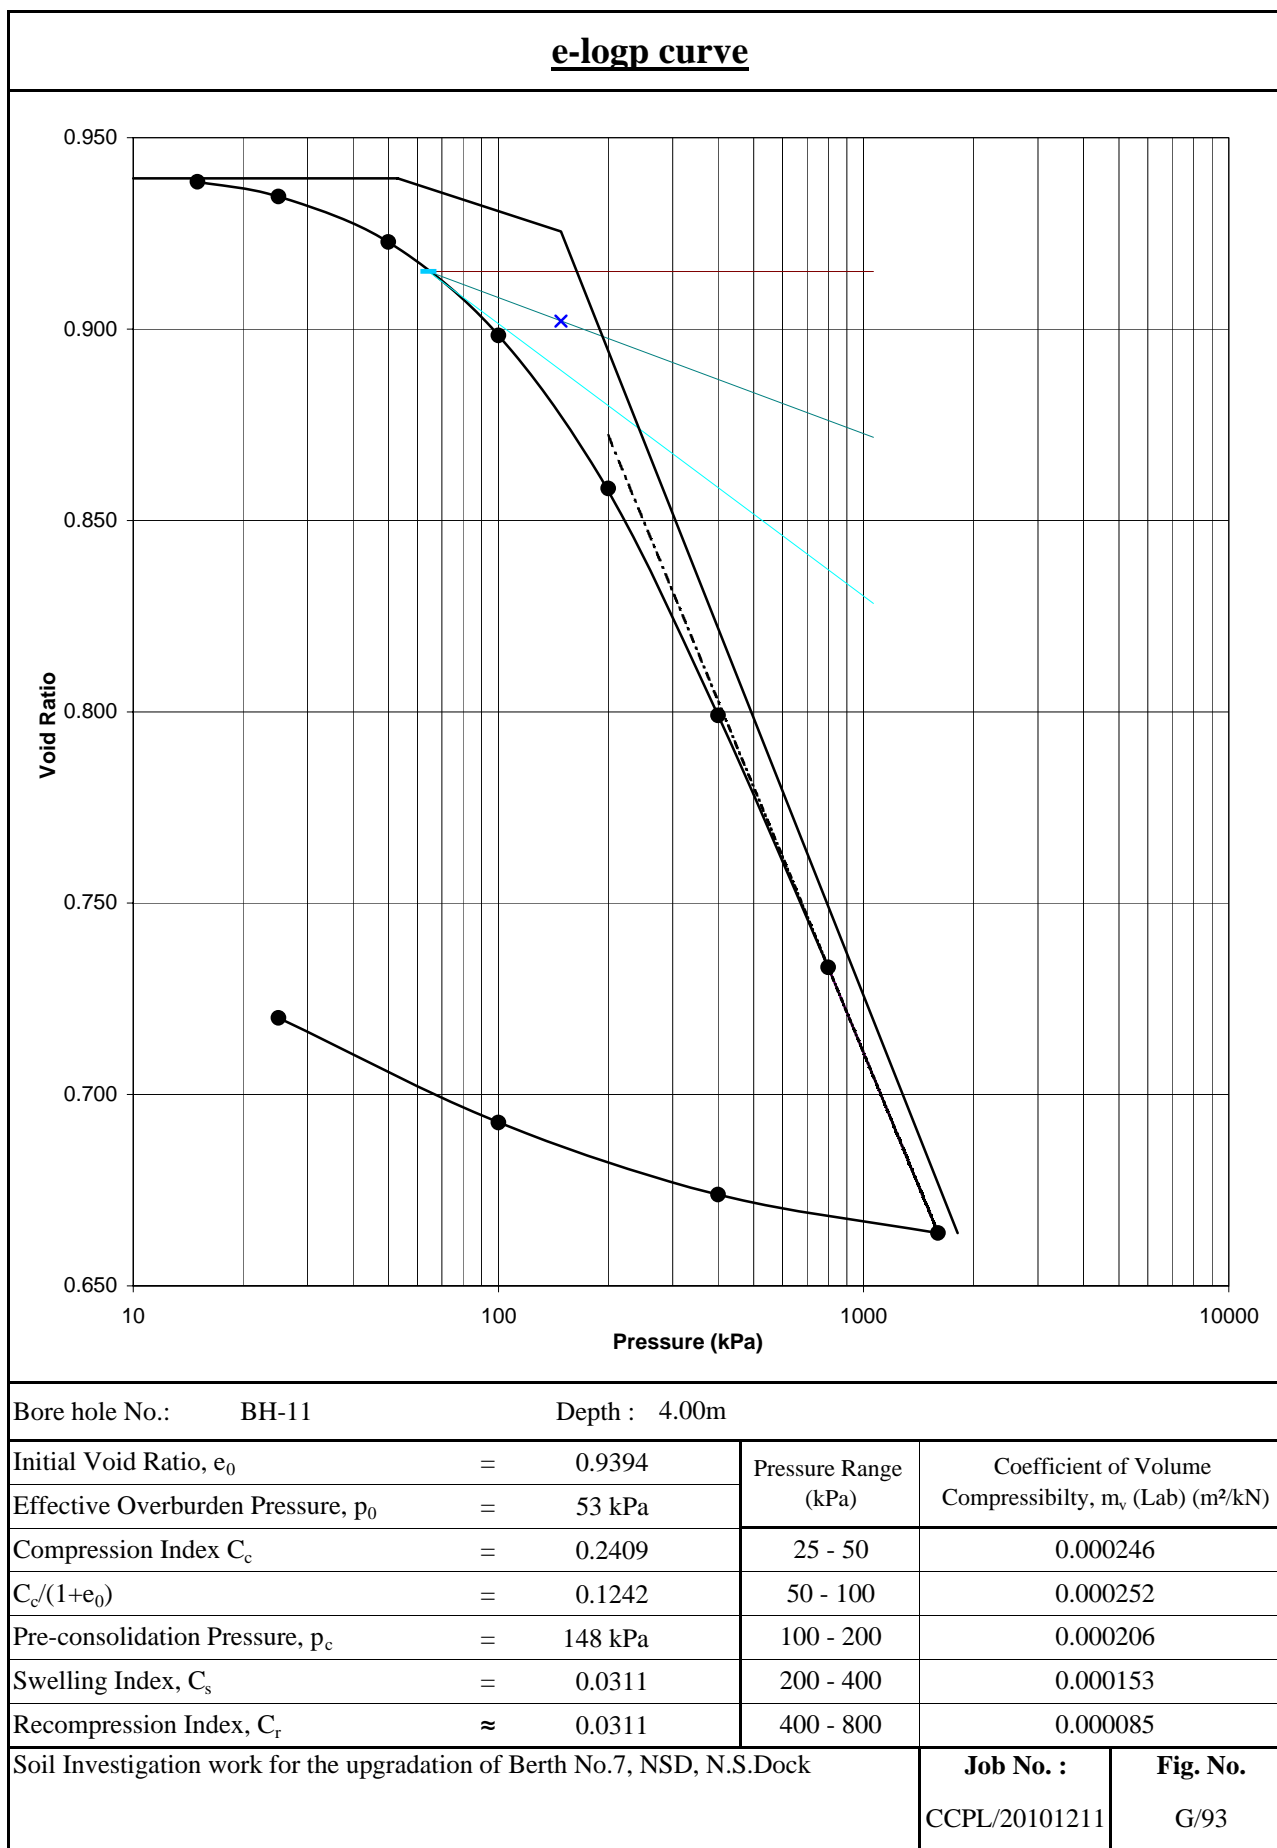




**e-logp curve**

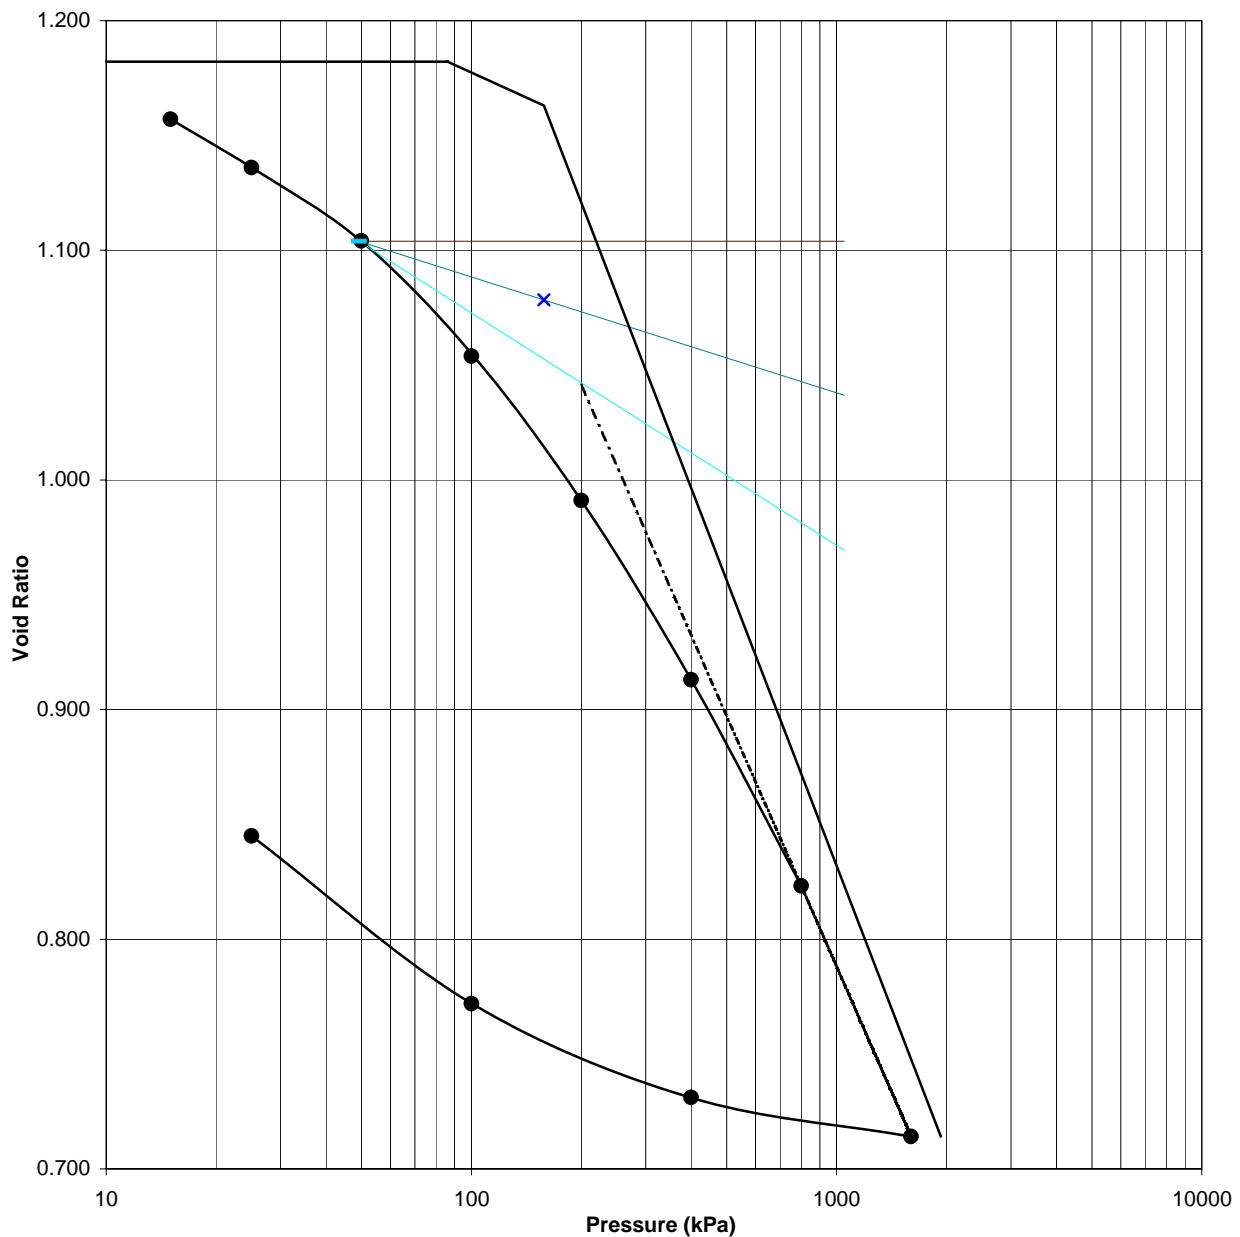


Bore hole No.: BH-11		Depth : 8.50m	
Initial Void Ratio, $e_0$	= 1.1822	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 86 kPa		
Compression Index $C_c$	= 0.4129	25 - 50	0.000585
$C_c/(1+e_0)$	= 0.1892	50 - 100	0.000459
Pre-consolidation Pressure, $p_c$	= 158 kPa	100 - 200	0.000289
Swelling Index, $C_s$	= 0.0725	200 - 400	0.000179
Recompression Index, $C_r$	$\approx$ 0.0725	400 - 800	0.000103
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/94

**e-logp curve**

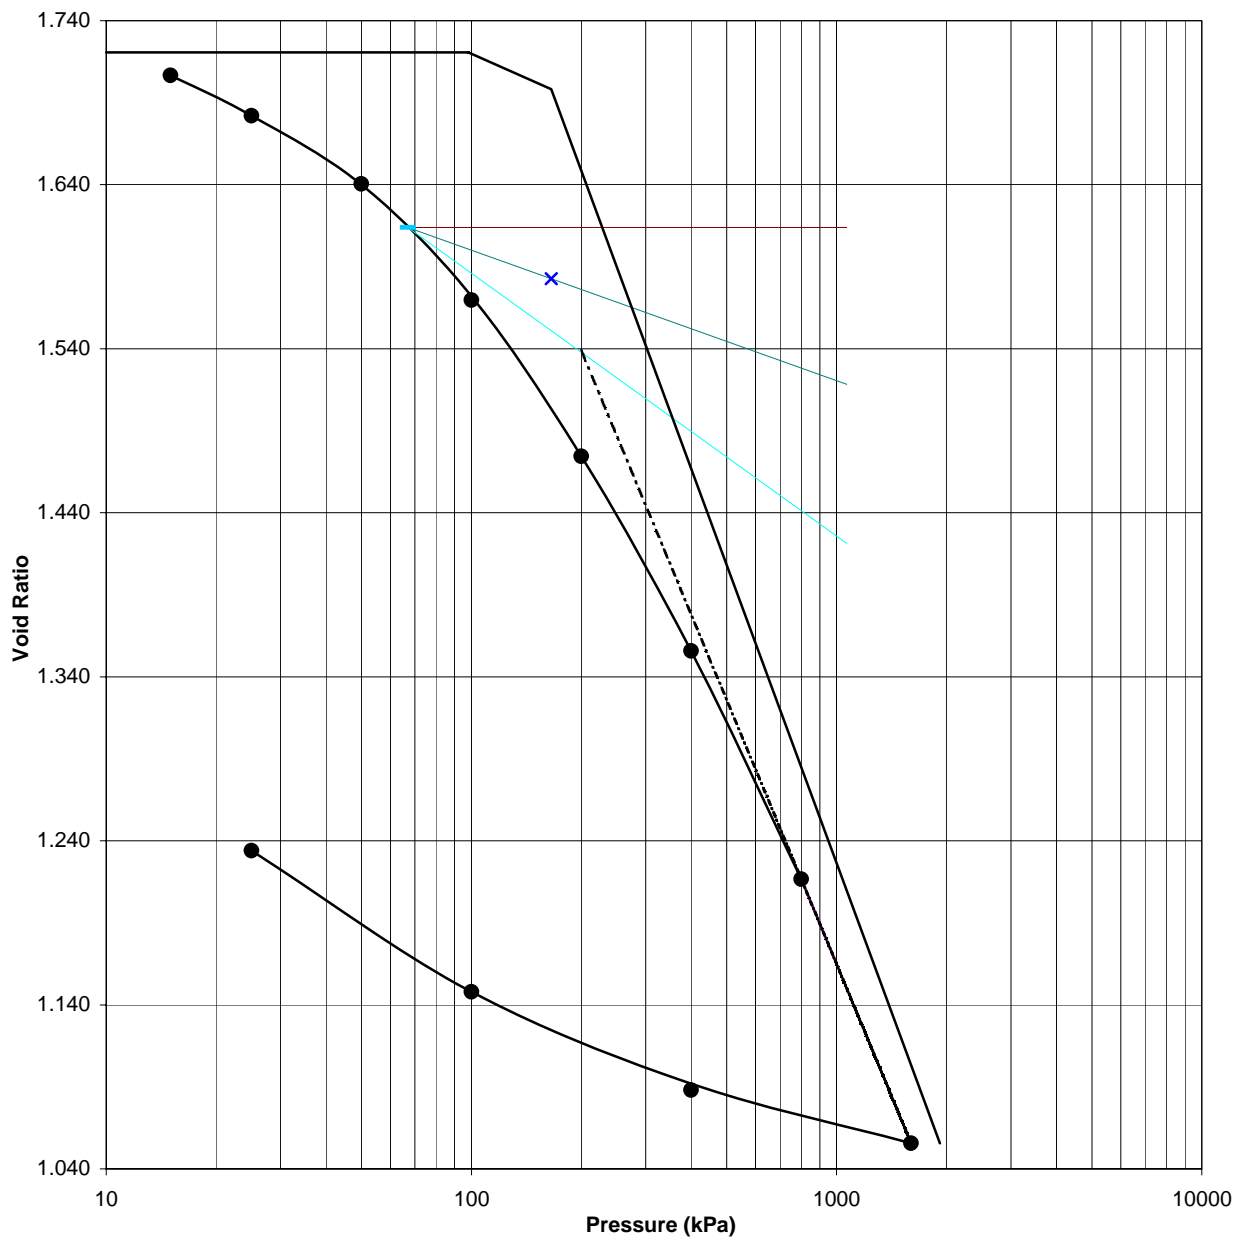


Bore hole No.: BH-11		Depth : 10.00m	
Initial Void Ratio, $e_0$	=	1.7207	Pressure Range (kPa)
Effective Overburden Pressure, $p_0$	=	98 kPa	
Compression Index $C_c$	=	0.6042	25 - 50
$C_c/(1+e_0)$	=	0.2221	50 - 100
Pre-consolidation Pressure, $p_c$	=	166 kPa	100 - 200
Swelling Index, $C_s$	=	0.0988	200 - 400
Recompression Index, $C_r$	≈	0.0988	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/95

**e-logp curve**

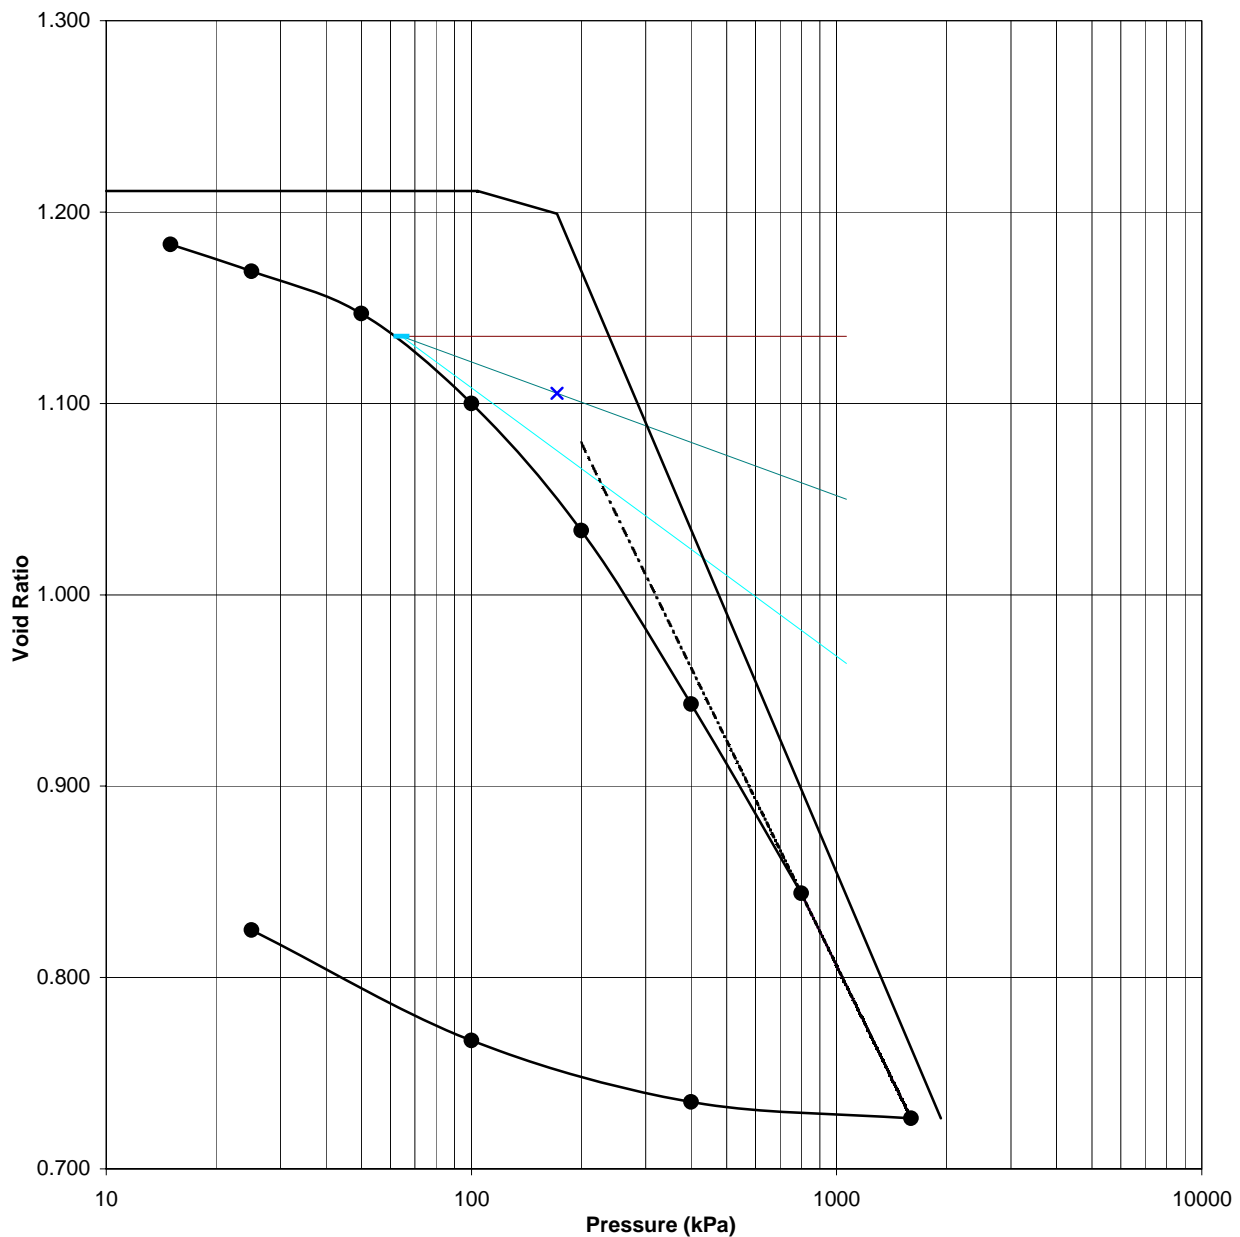


Bore hole No.: BH-11		Depth : 11.50m	
Initial Void Ratio, $e_0$	= 1.2110	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 104 kPa		
Compression Index $C_c$	= 0.4498	25 - 50	0.000397
$C_c/(1+e_0)$	= 0.2034	50 - 100	0.000425
Pre-consolidation Pressure, $p_c$	= 172 kPa	100 - 200	0.000300
Swelling Index, $C_s$	= 0.0545	200 - 400	0.000205
Recompression Index, $C_r$	$\approx$ 0.0545	400 - 800	0.000112
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/96

**e-logp curve**

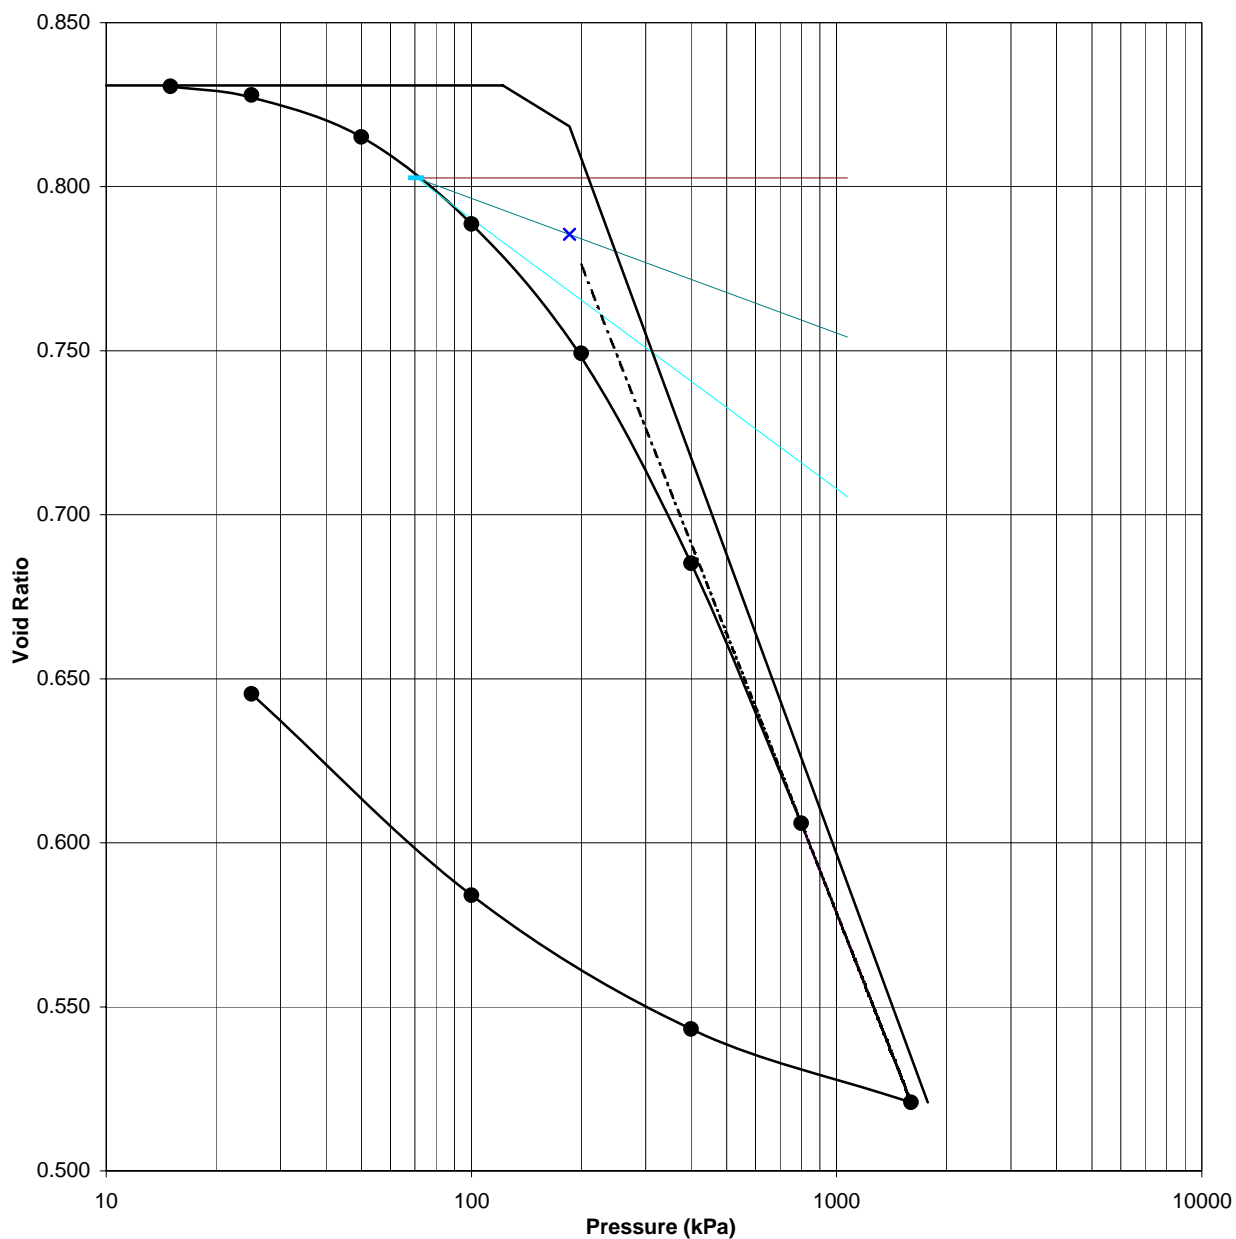


Bore hole No.: BH-11		Depth : 14.50m	
Initial Void Ratio, $e_0$	= 0.8309	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 122 kPa		
Compression Index $C_c$	= 0.3032	25 - 50	0.000280
$C_c/(1+e_0)$	= 0.1656	50 - 100	0.000289
Pre-consolidation Pressure, $p_c$	= 185 kPa	100 - 200	0.000215
Swelling Index, $C_s$	= 0.0689	200 - 400	0.000175
Recompression Index, $C_r$	$\approx$ 0.0689	400 - 800	0.000108
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			<div>Job No. :</div> <div>CCPL/20101211</div>
			<div>Fig. No.</div> <div>G/97</div>

**e-logp curve**

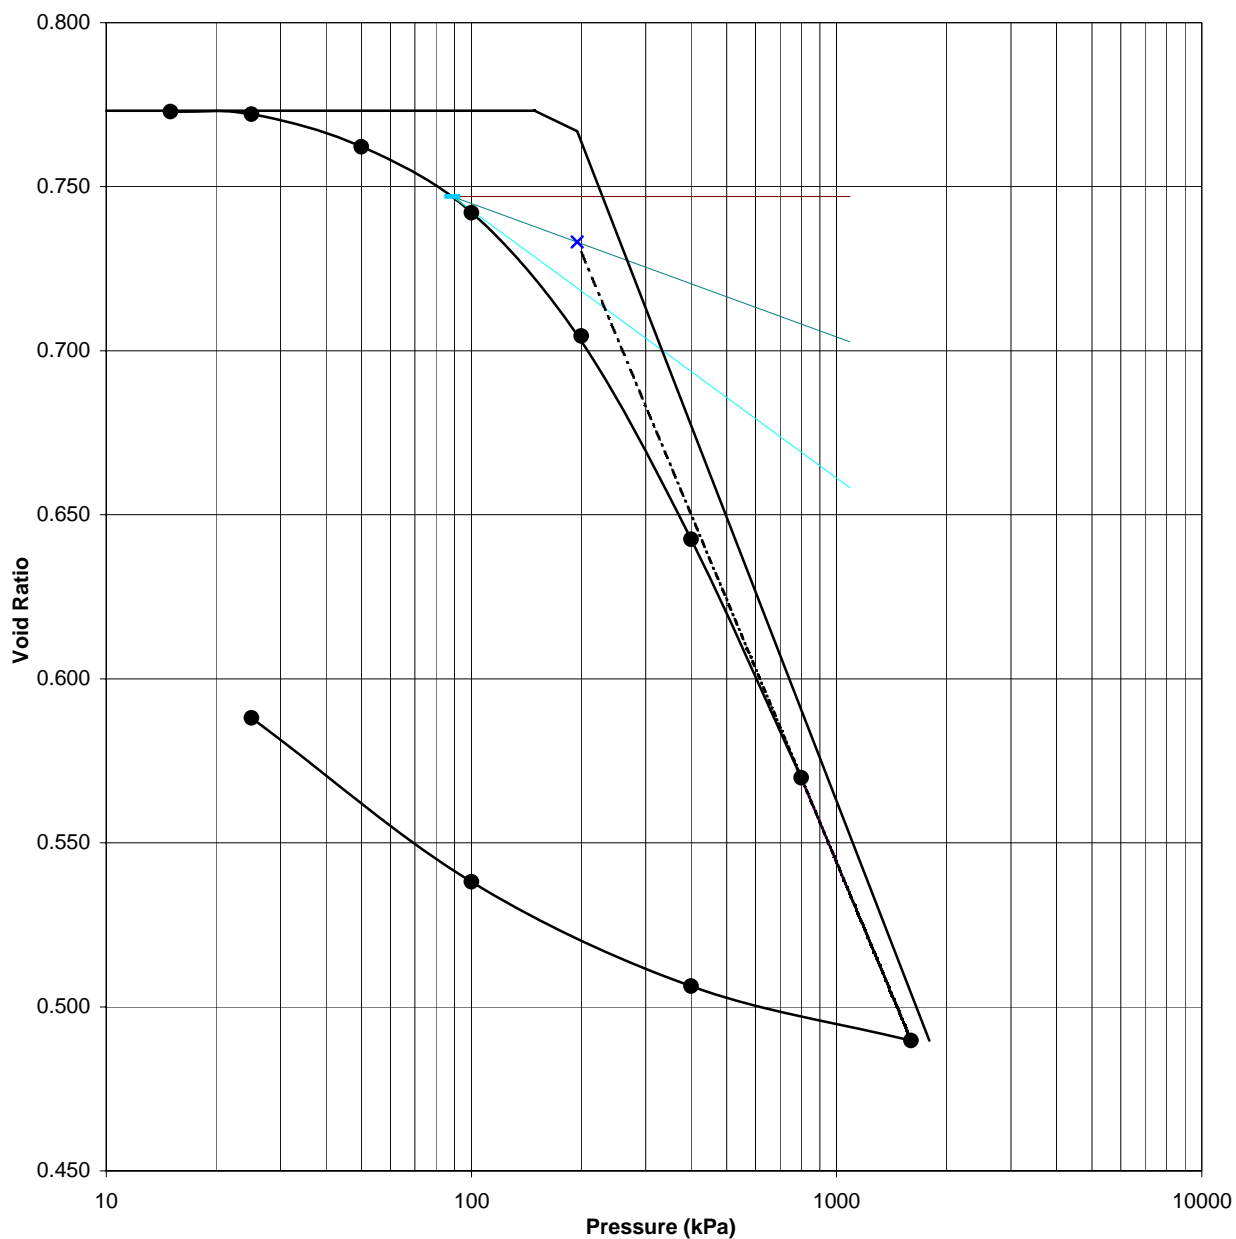


Bore hole No.: BH-11		Depth : 17.50m	
Initial Void Ratio, $e_0$	= 0.7732	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 149 kPa		
Compression Index $C_c$	= 0.2872	25 - 50	0.000223
$C_c/(1+e_0)$	= 0.1620	50 - 100	0.000227
Pre-consolidation Pressure, $p_c$	= 195 kPa	100 - 200	0.000212
Swelling Index, $C_s$	= 0.0544	200 - 400	0.000175
Recompression Index, $C_r$	$\approx$ 0.0544	400 - 800	0.000102
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/98

**e-logp curve**

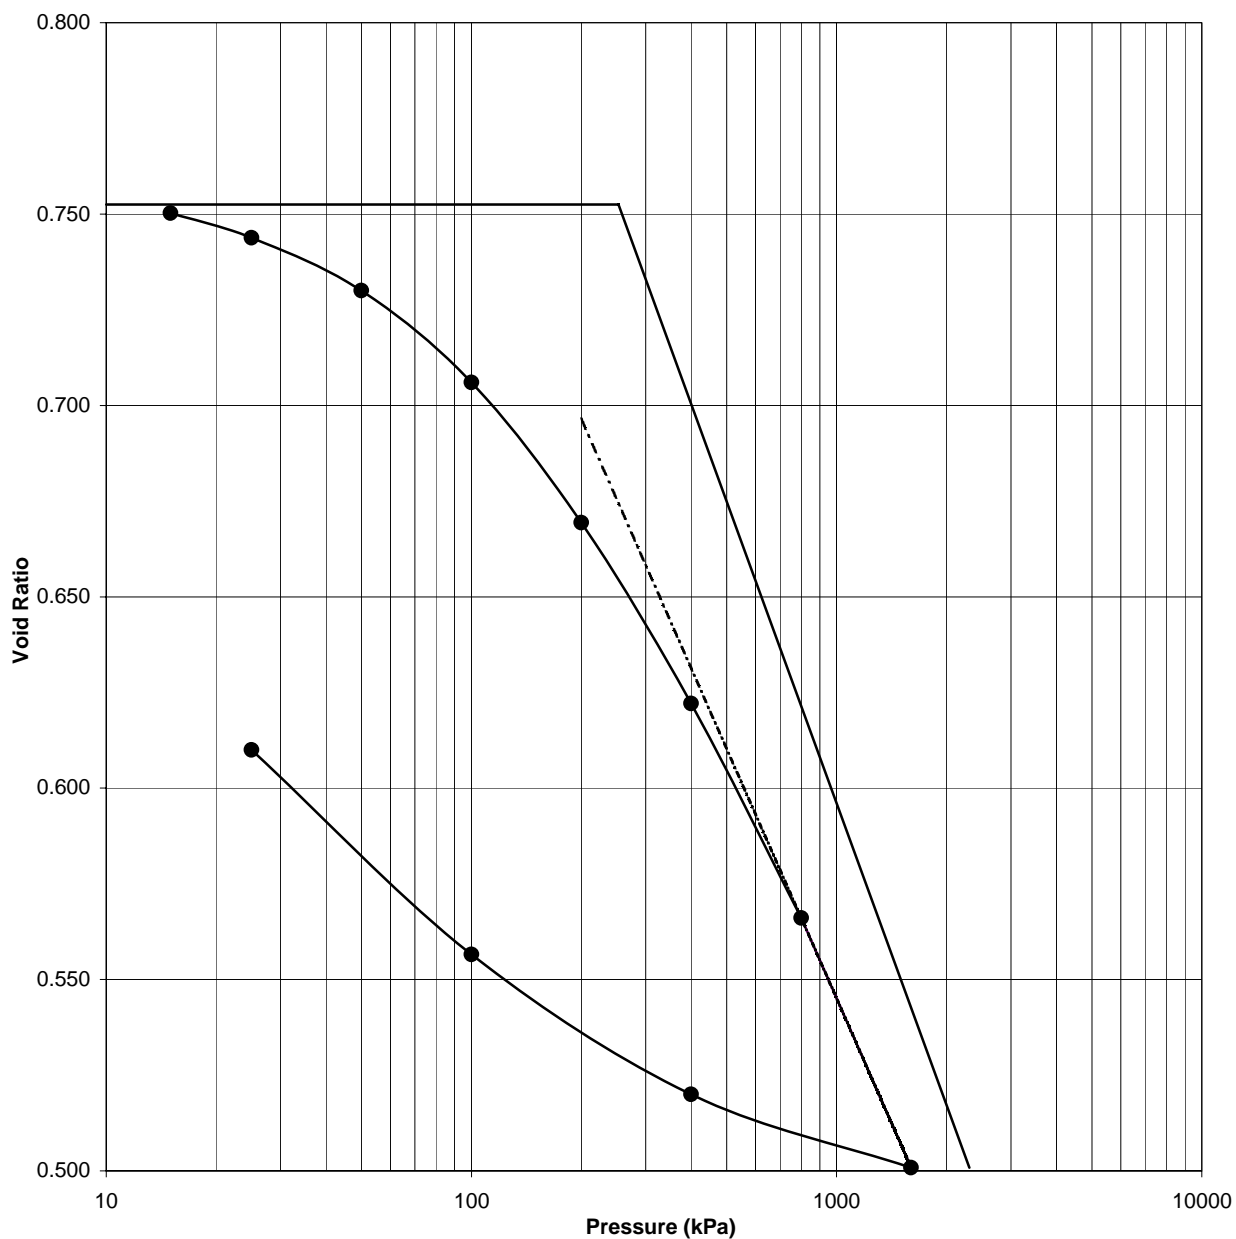

Bore hole No.: BH-11		Depth : 28.00m	
Initial Void Ratio, $e_0$	= 0.7525	Pressure Range (kPa)	Coefficient of Volume Compressibility, $m_v$ (Lab) ( $m^2/kN$ )
Effective Overburden Pressure, $p_0$	= 253 kPa		
Compression Index $C_c$	= 0.2619	25 - 50	0.000316
$C_c/(1+e_0)$	= 0.1495	50 - 100	0.000274
Pre-consolidation Pressure, $p_c$	= --	100 - 200	0.000209
Swelling Index, $C_s$	= 0.0604	200 - 400	0.000135
Recompression Index, $C_r$	$\approx$ 0.0604	400 - 800	0.000080
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/99

**e-logp curve**

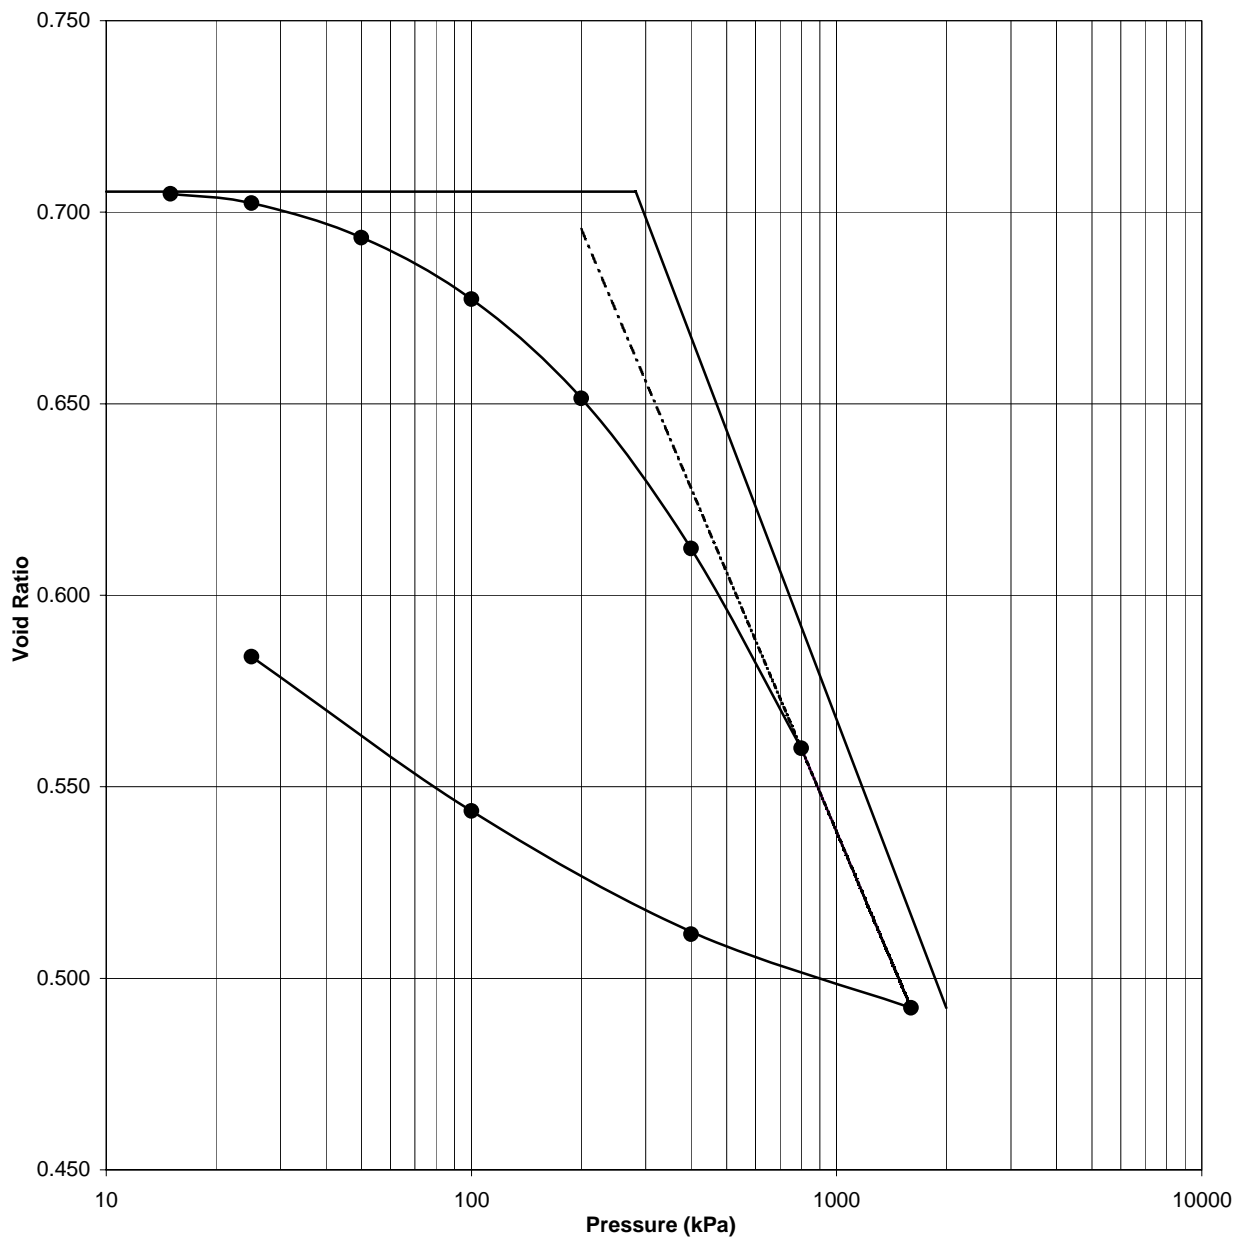


Bore hole No.: BH-11		Depth : 31.00m	
Initial Void Ratio, $e_0$	=	0.7054	Pressure Range (kPa)
Effective Overburden Pressure, $p_0$	=	282 kPa	
Compression Index $C_c$	=	0.2508	25 - 50
$C_c/(1+e_0)$	=	0.1471	50 - 100
Pre-consolidation Pressure, $p_c$	=	--	100 - 200
Swelling Index, $C_s$	=	0.0508	200 - 400
Recompression Index, $C_r$	$\approx$	0.0508	400 - 800
Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock			Job No. :
			CCPL/20101211
			Fig. No.
			G/100

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-5	Depth : 1.00m
---------------------	----------------------	---------------

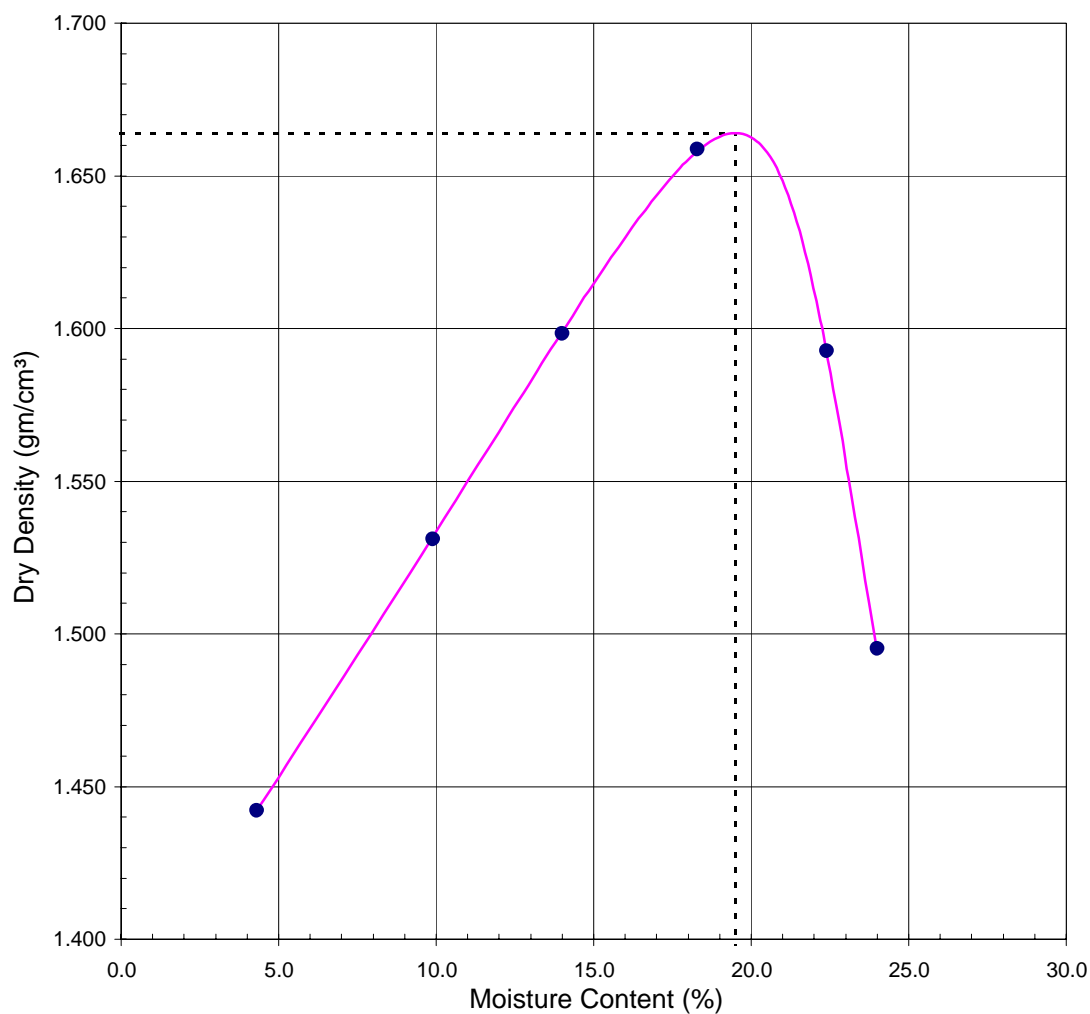

**Fig. H/1 : Moisture Content vs. Dry Density Plot**

**Optimum Moisture Content : 19.5 %**


**Maximum Dry Density,  $\gamma_{dmax}$  : 1.664 gm/cm³**



**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-5	Depth : 2.50m
---------------------	----------------------	---------------

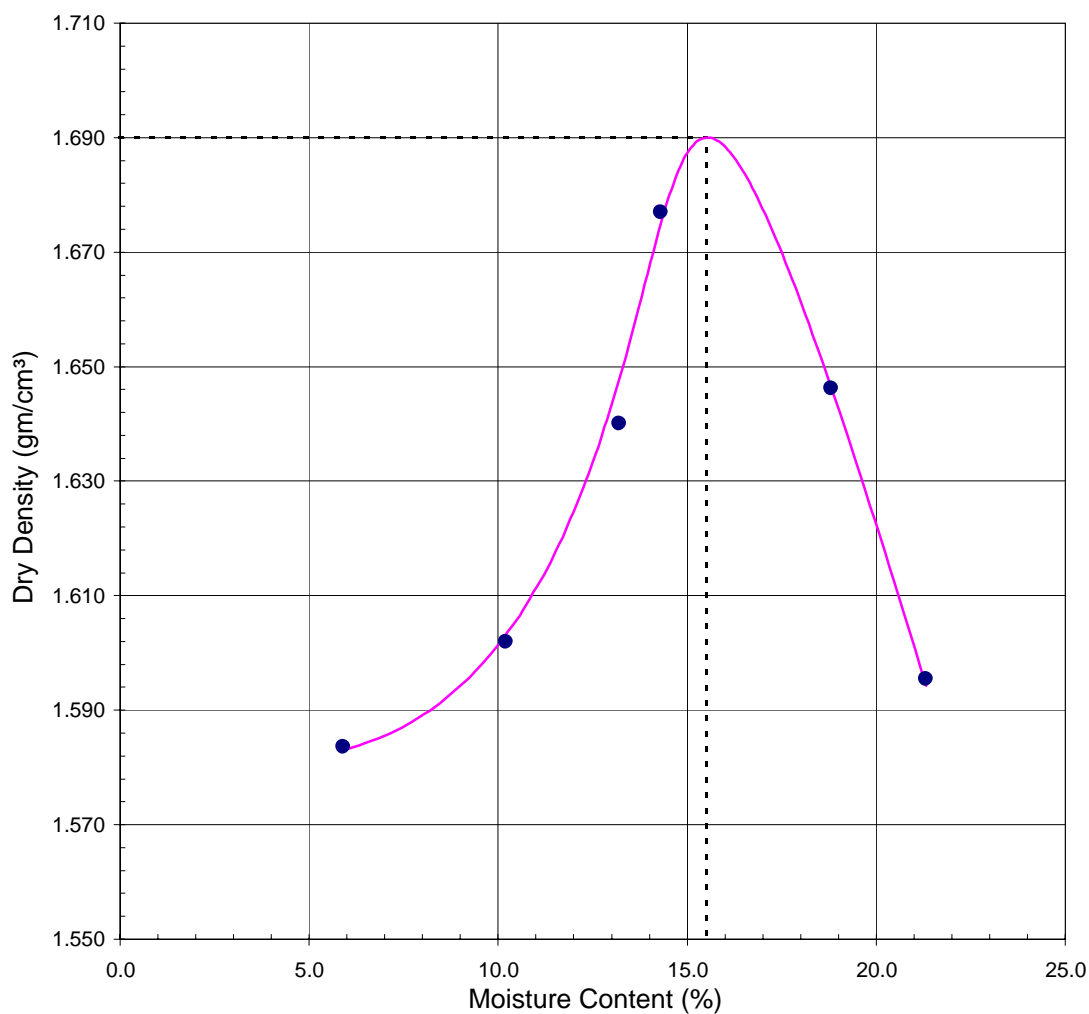

**Fig. H/2 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 15.5 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.690 gm/cm³**

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-6	Depth : 3.00m
---------------------	----------------------	---------------

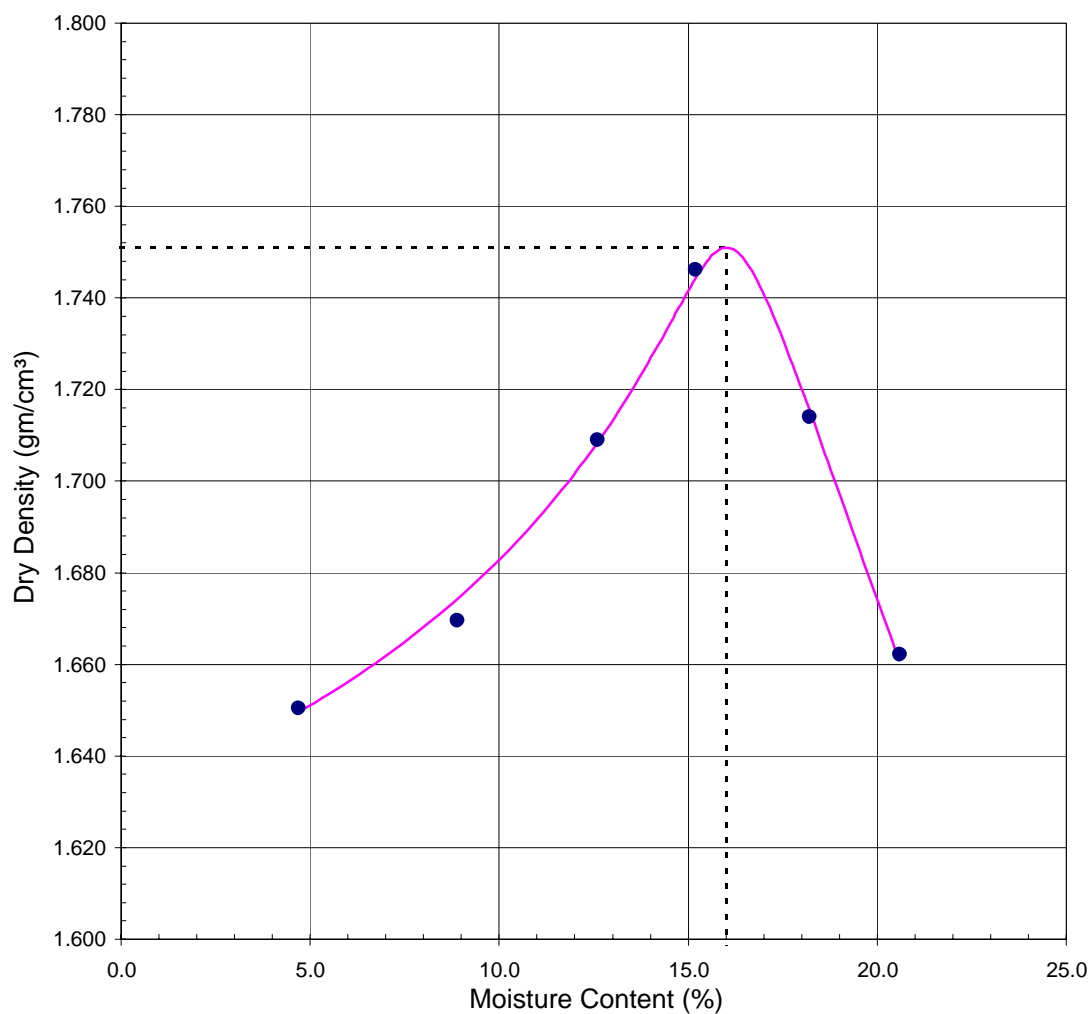

**Fig. H/3 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 16.0 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.751 gm/cm³**

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-7	Depth : 2.50m
---------------------	----------------------	---------------

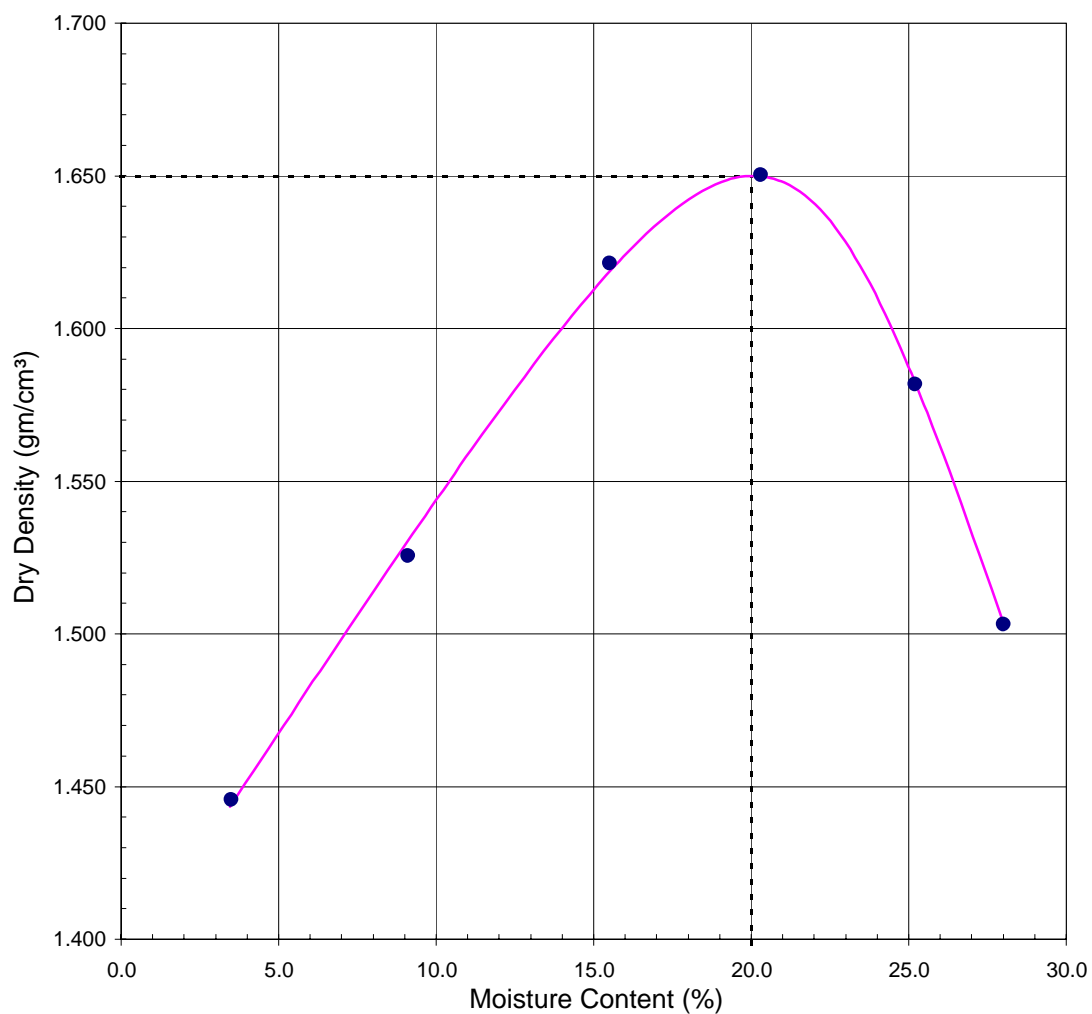

**Fig. H/4 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 20.0 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.650 gm/cm³**

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-8	Depth : 1.00m
---------------------	----------------------	---------------

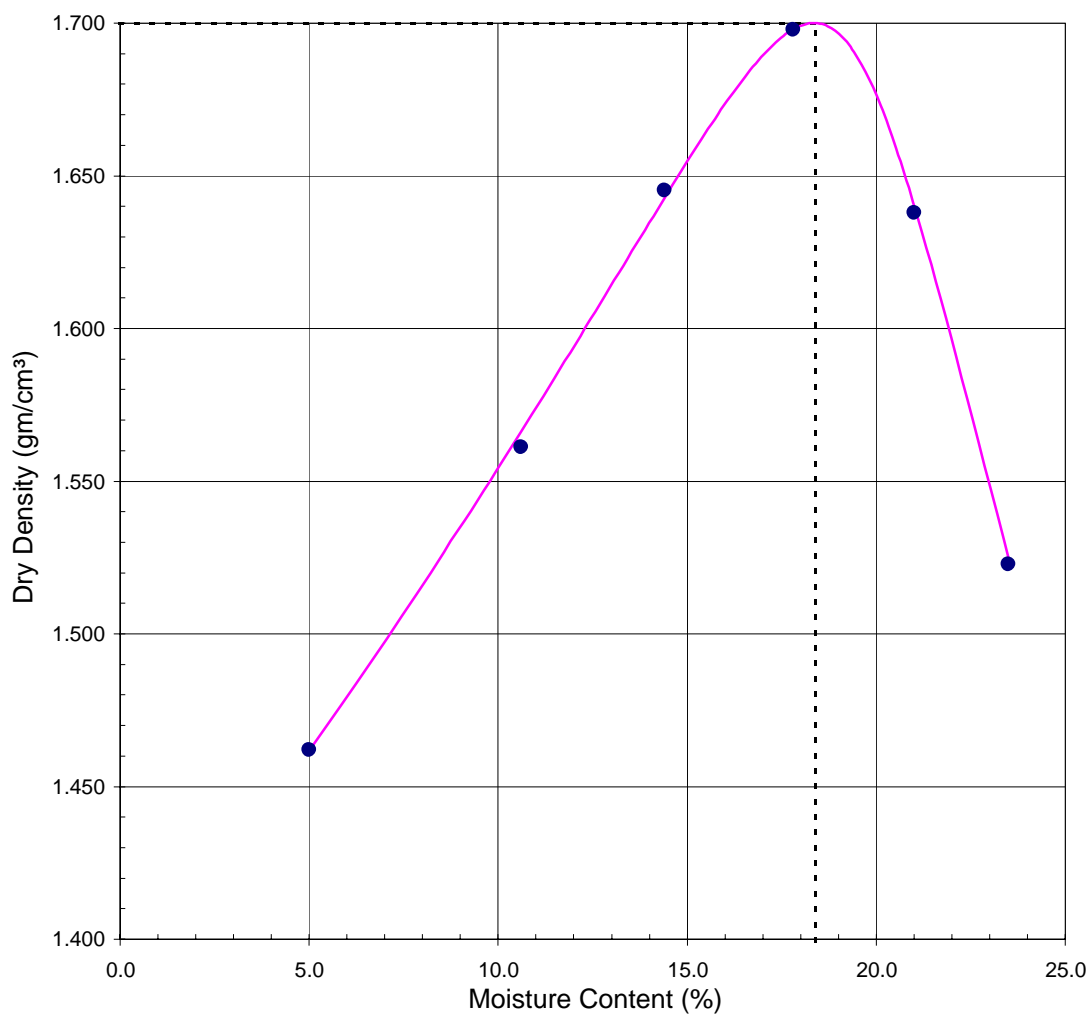

**Fig. H/5 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 18.4 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.700 gm/cm³**

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-8	Depth : 2.50m
---------------------	----------------------	---------------

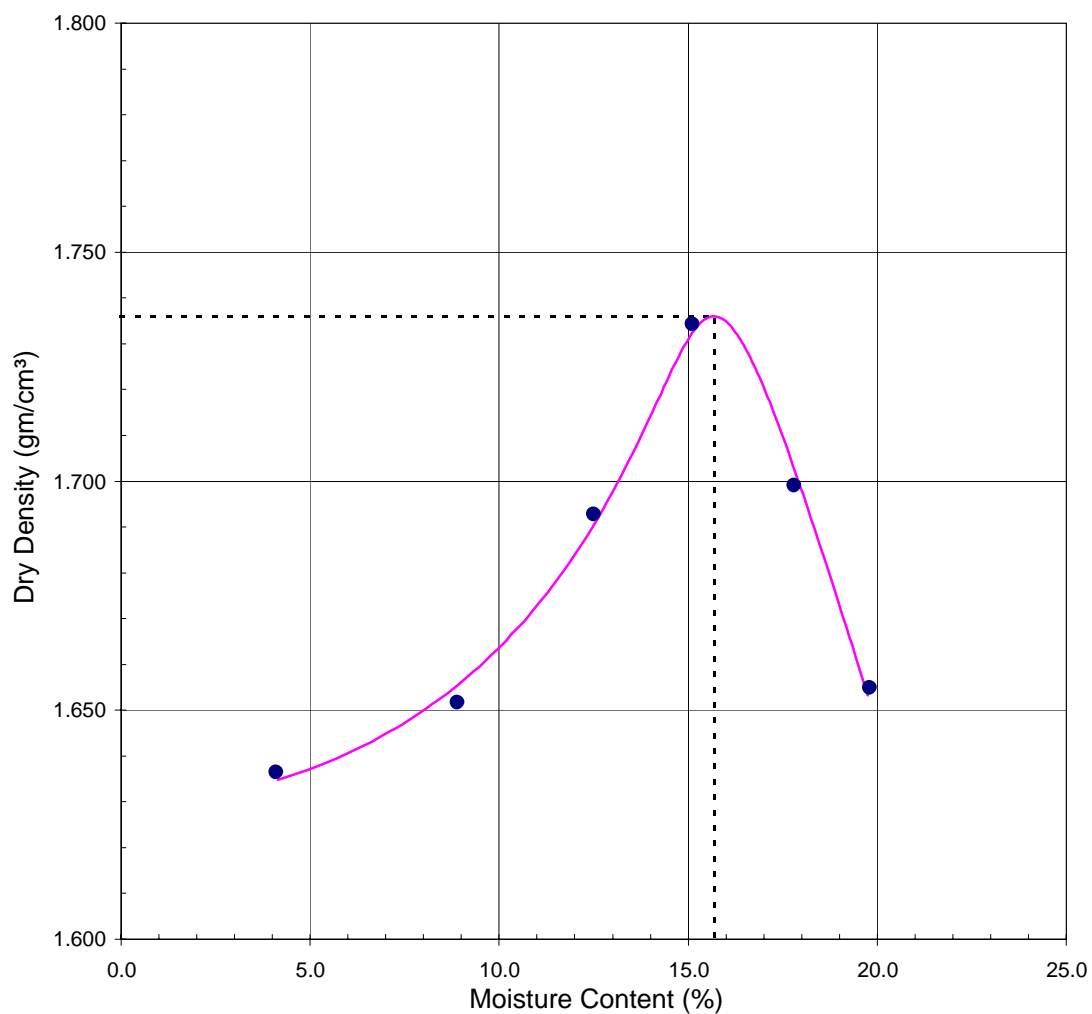

**Fig. H/6 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 15.7 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.736 gm/cm³**

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-10	Depth : 1.50m
---------------------	-----------------------	---------------

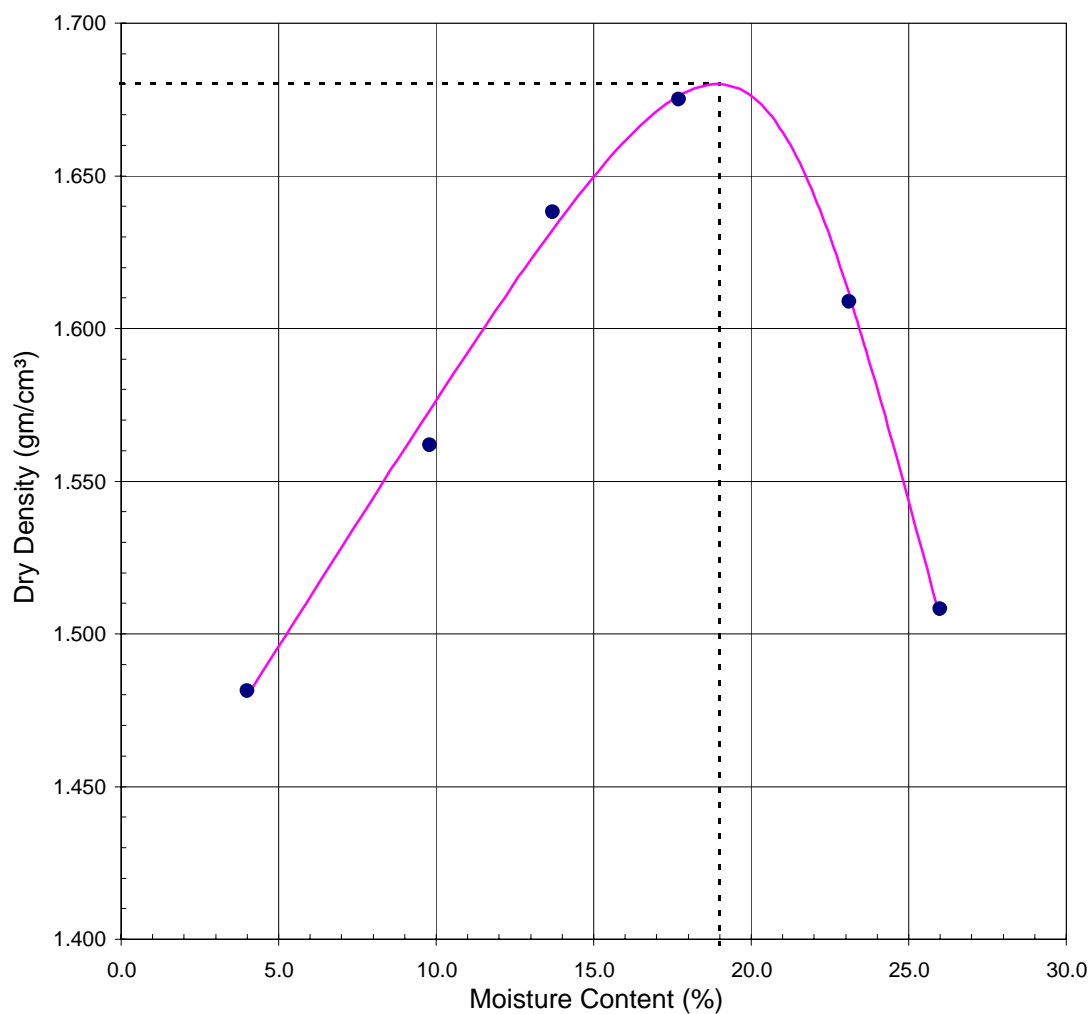

**Fig. H/7 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 19.0 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.680 gm/cm³**

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-10	Depth : 3.00m
---------------------	-----------------------	---------------

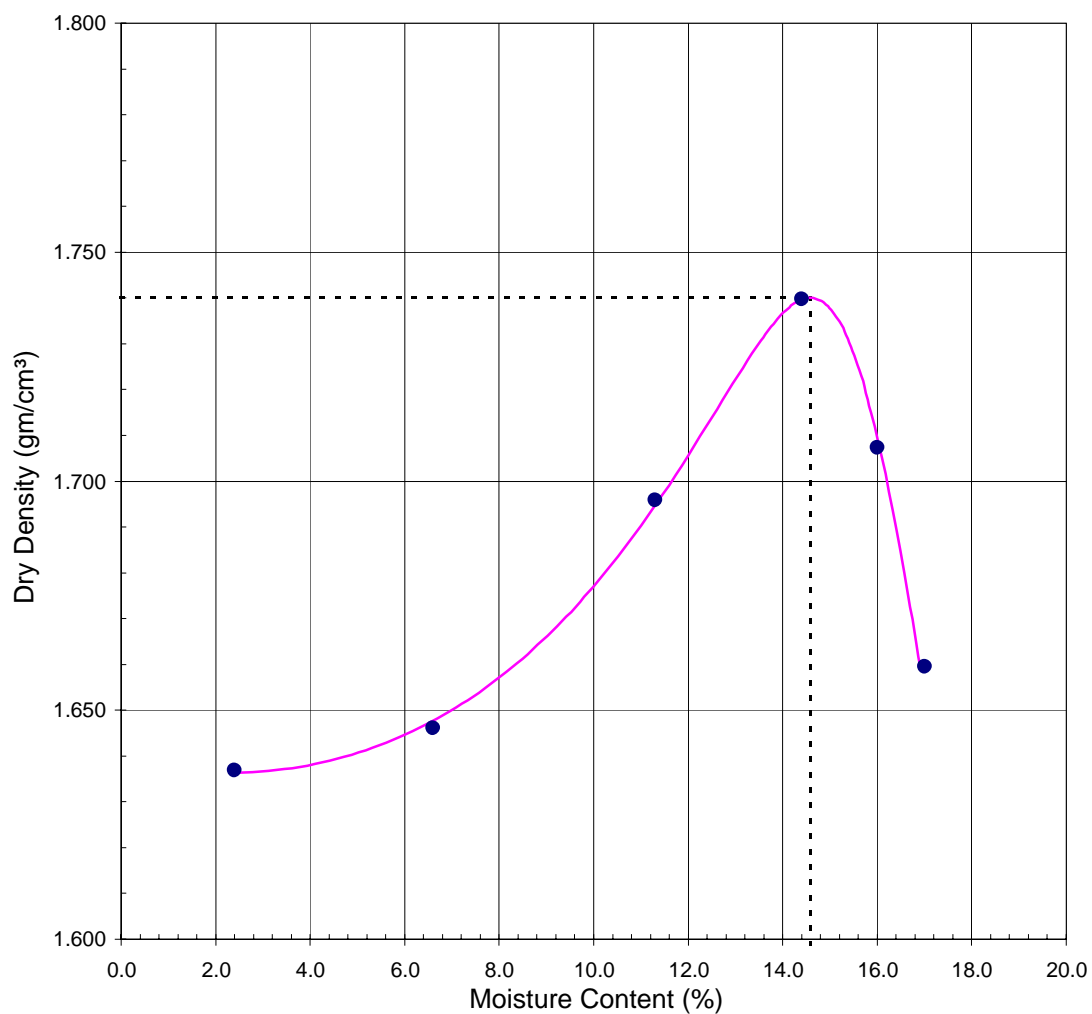

**Fig. H/8 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 14.6 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.740 gm/cm³**

**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-11	Depth : 1.00m
---------------------	-----------------------	---------------

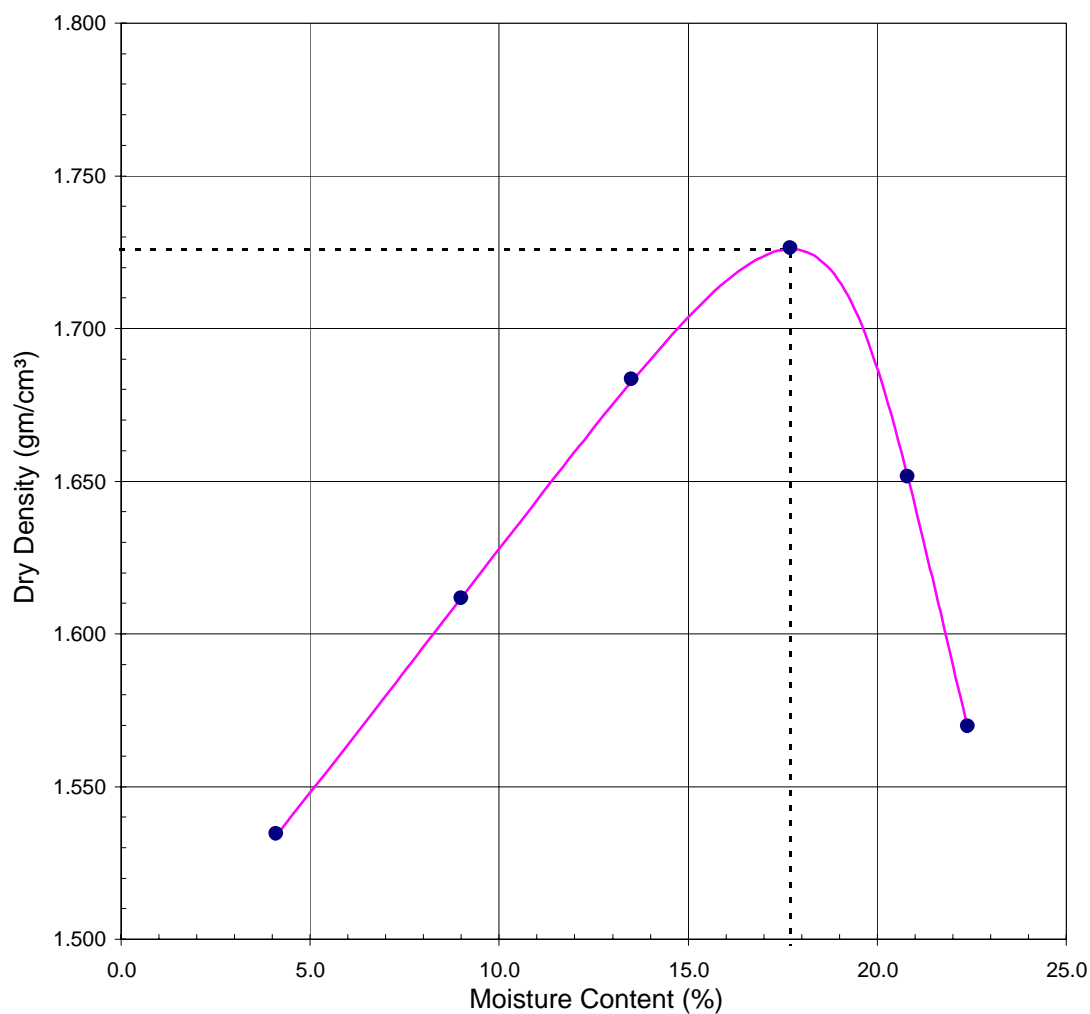

**Fig. H/9 : Moisture Content vs. Dry Density Plot**

**Optimum Moisture Content : 17.7 %**


**Maximum Dry Density,  $\gamma_{dmax}$  : 1.726 gm/cm³**



**Water Content - Dry Density Relation using Light Compaction**  
**(Standard Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-11	Depth : 2.50m
---------------------	-----------------------	---------------

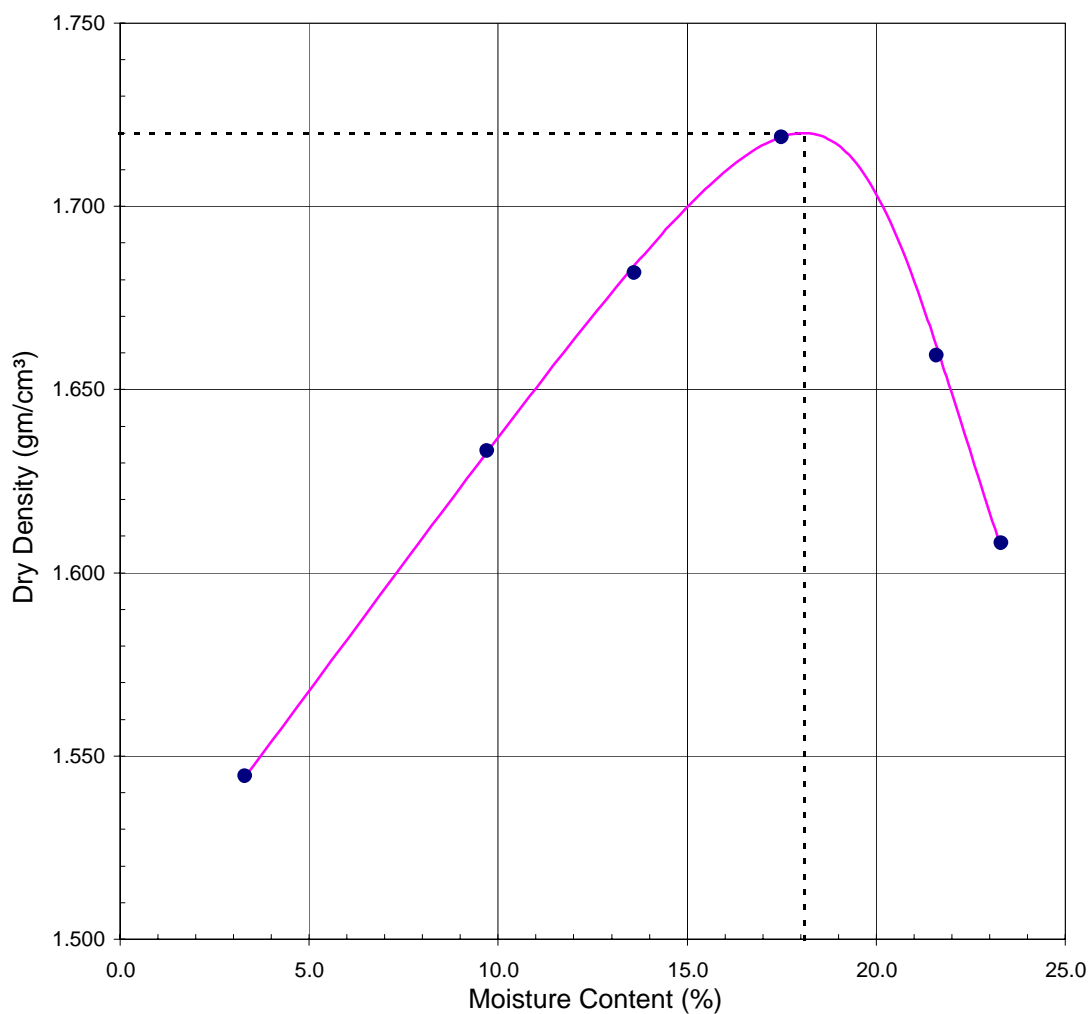

**Fig. H/10 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 18.1 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.720 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-5	Depth : 1.00m
---------------------	----------------------	---------------

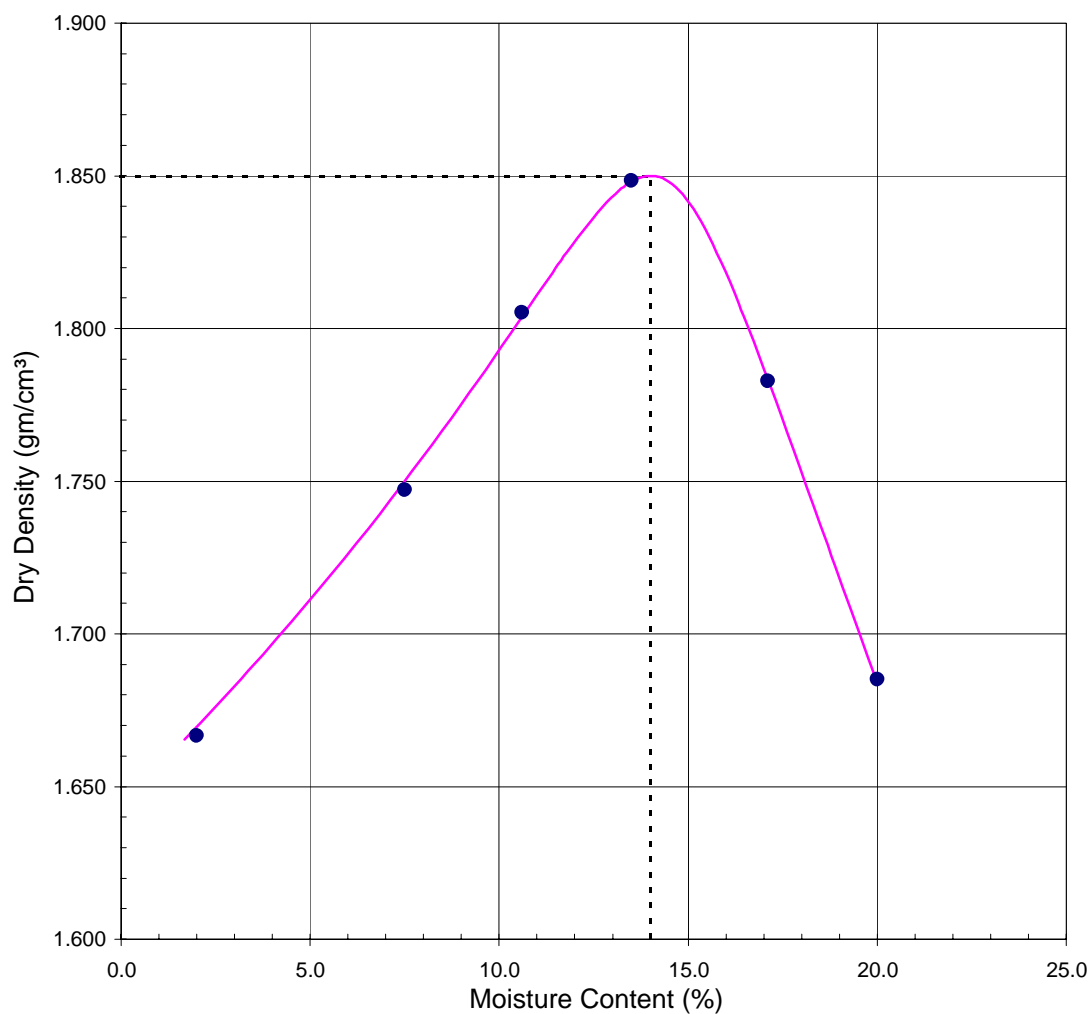

**Fig. H/11 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 14.0 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.850 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-5	Depth : 2.50m
---------------------	----------------------	---------------

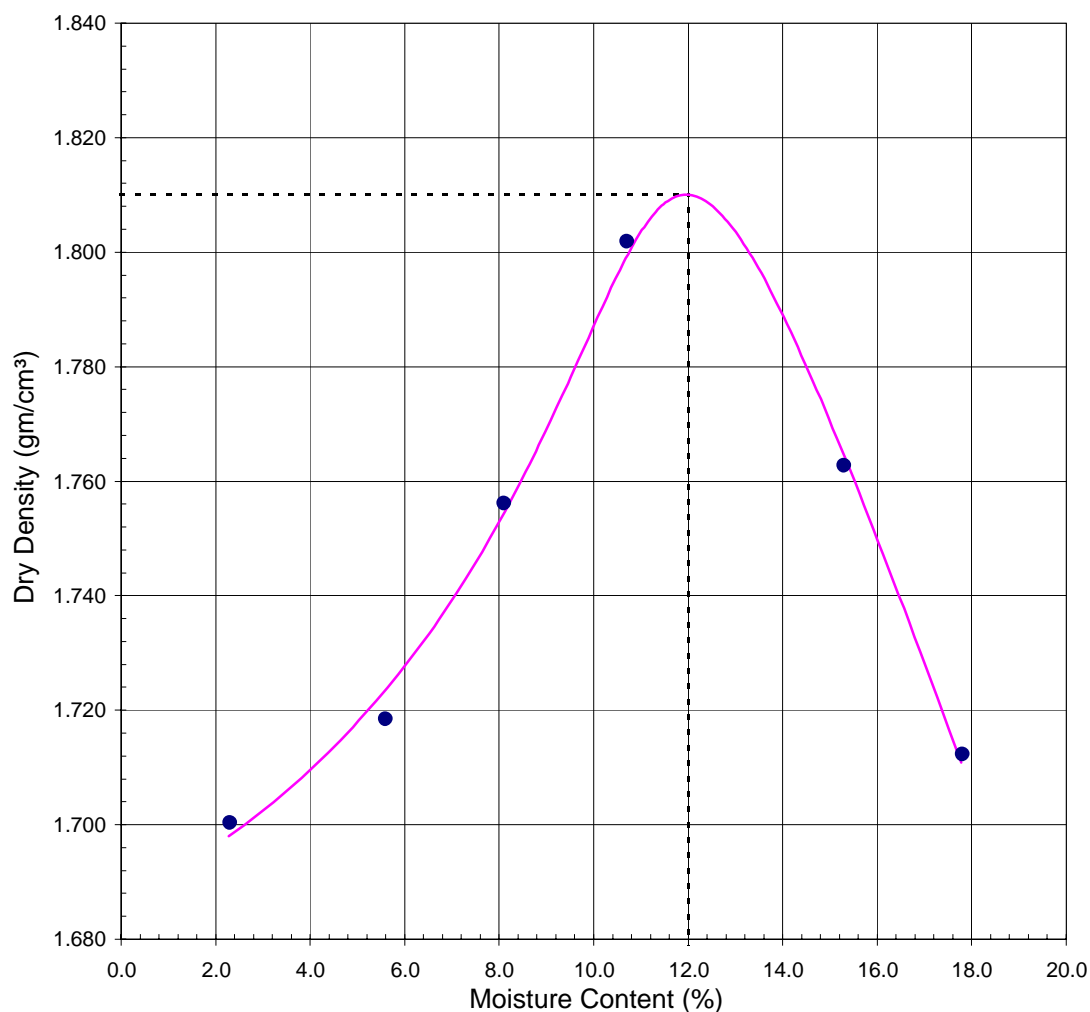

**Fig. H/12 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 12.0 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.810 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-6	Depth : 3.00m
---------------------	----------------------	---------------

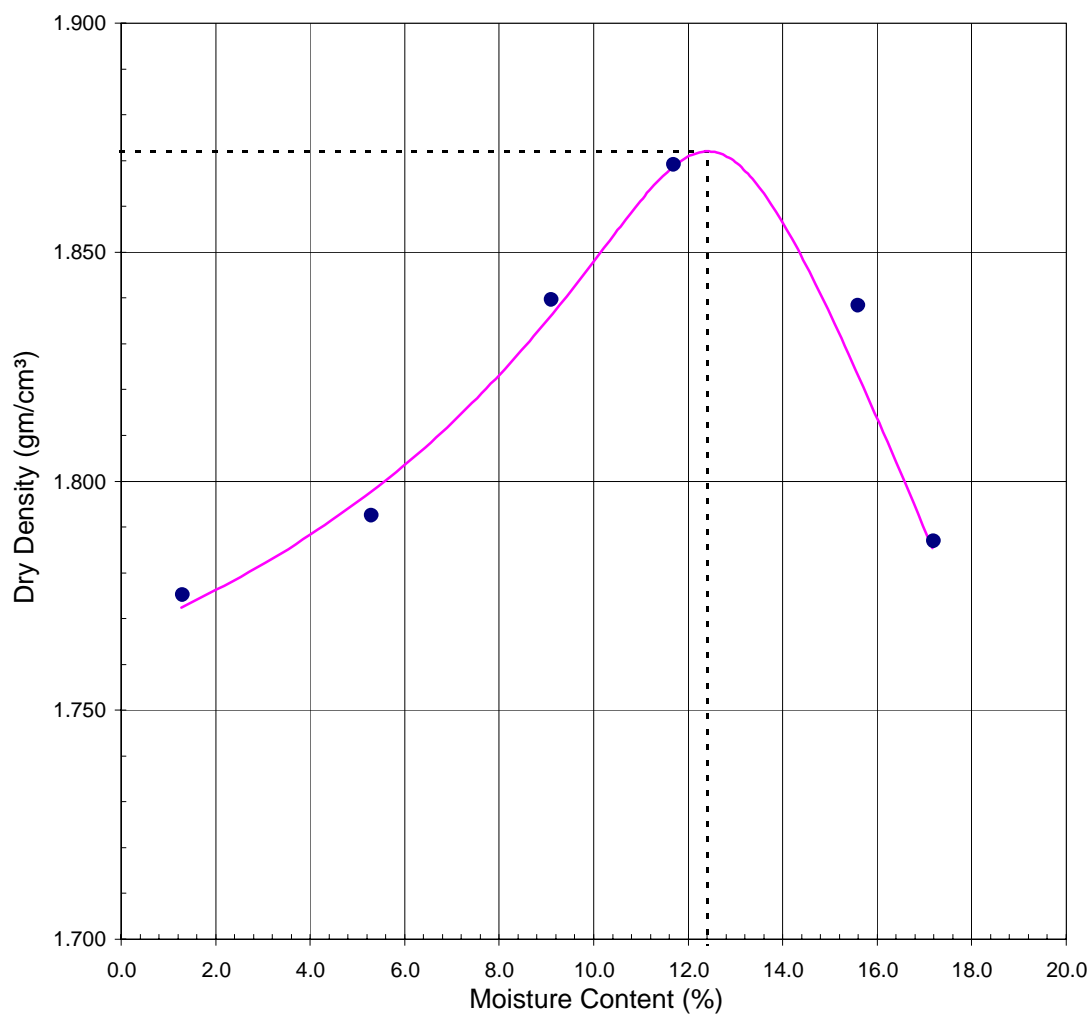

**Fig. H/13 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 12.4 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.872 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-7	Depth : 2.50m
---------------------	----------------------	---------------

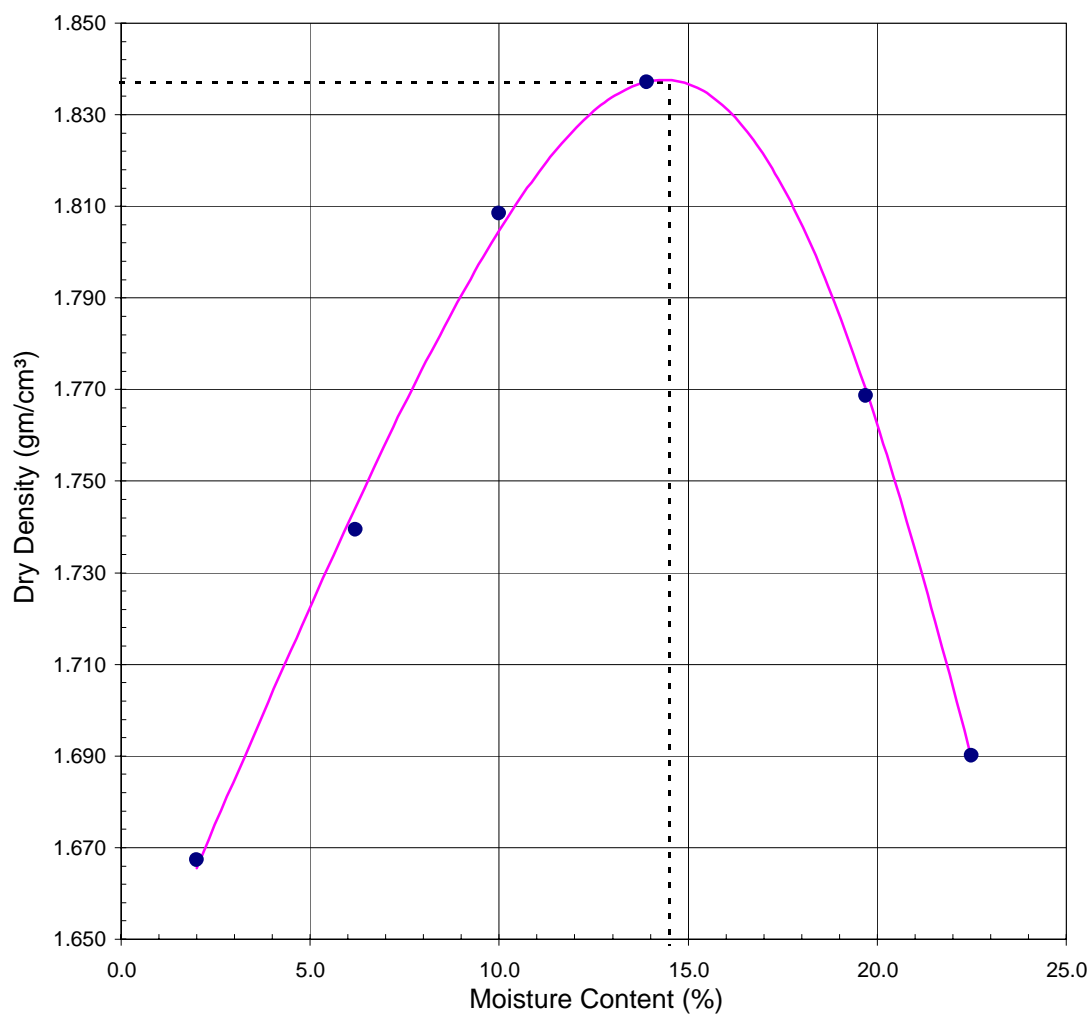

**Fig. H/14 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 14.4 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.838 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-8	Depth : 1.00m
---------------------	----------------------	---------------

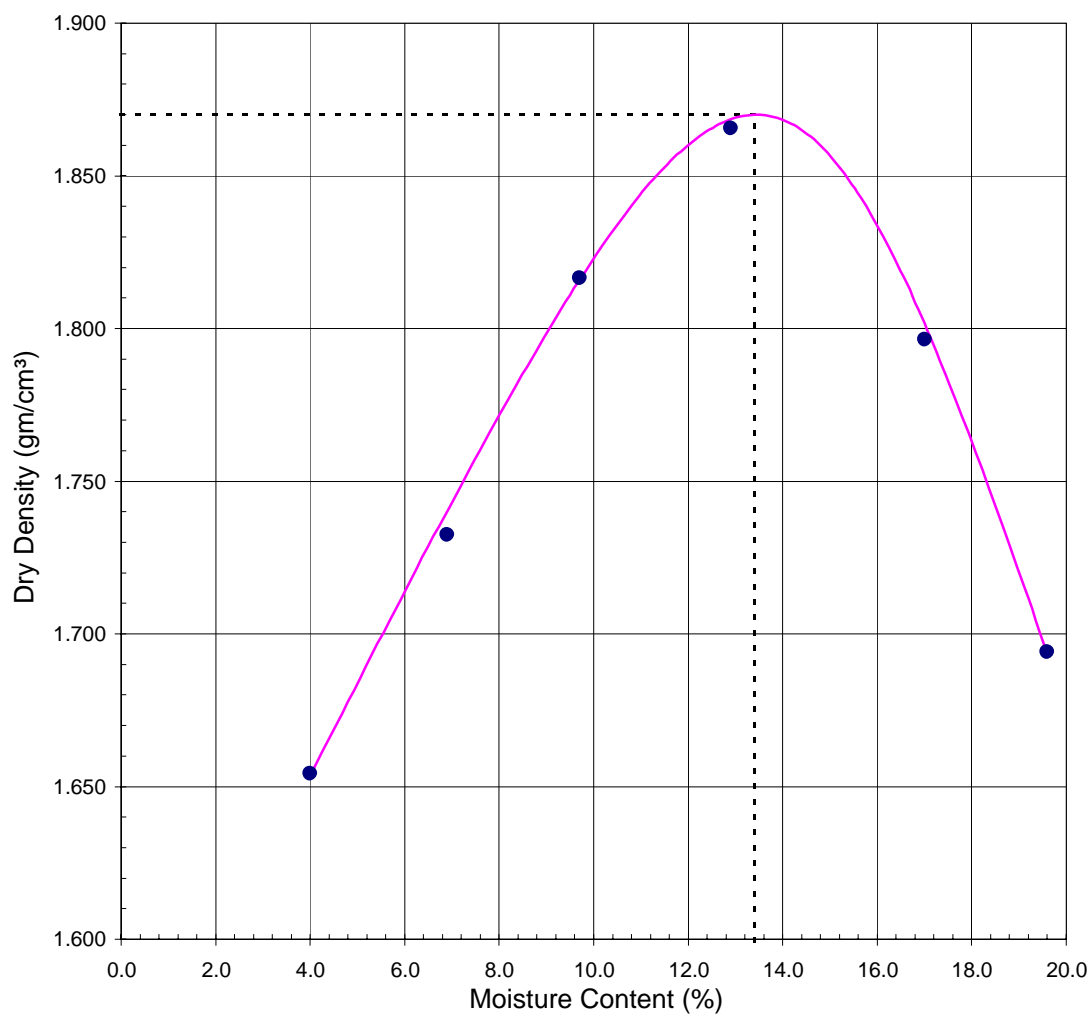

**Fig. H/15 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 13.4 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.870 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-8	Depth : 2.50m
---------------------	----------------------	---------------

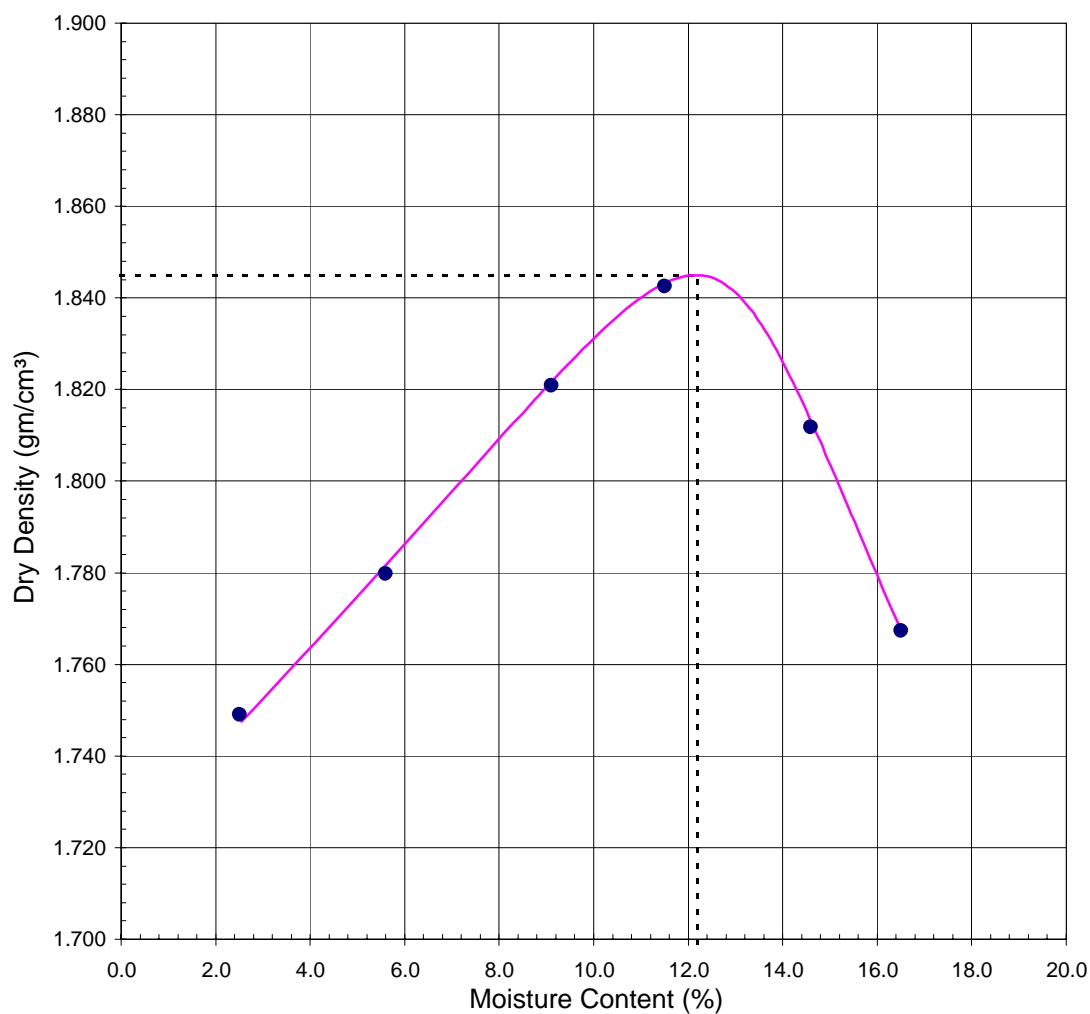

**Fig. H/16 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 12.2 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.845 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-10	Depth : 1.50m
---------------------	-----------------------	---------------

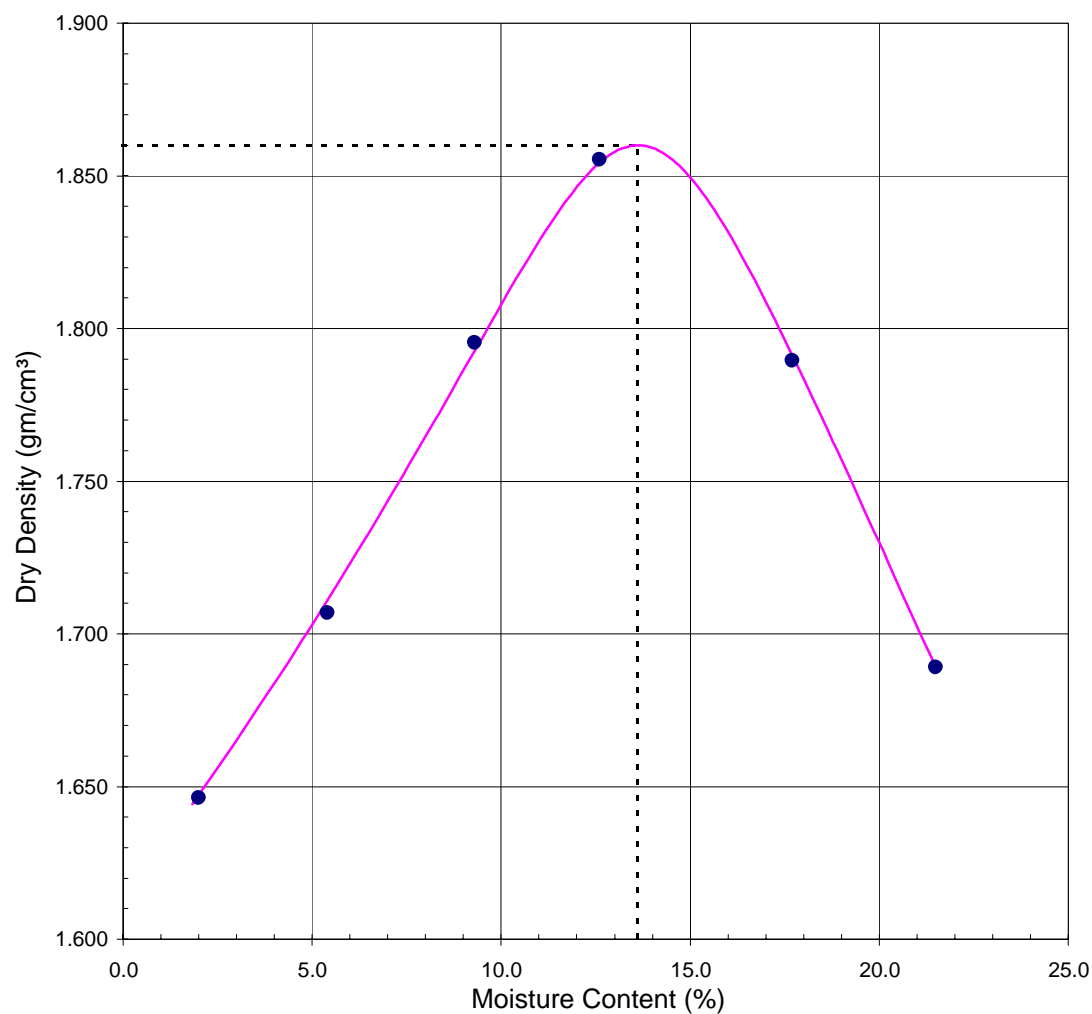

**Fig. H/17 : Moisture Content vs. Dry Density Plot**

**Optimum Moisture Content : 13.6 %**


**Maximum Dry Density,  $\gamma_{dmax}$  : 1.860 gm/cm³**



**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-10	Depth : 3.00m
---------------------	-----------------------	---------------

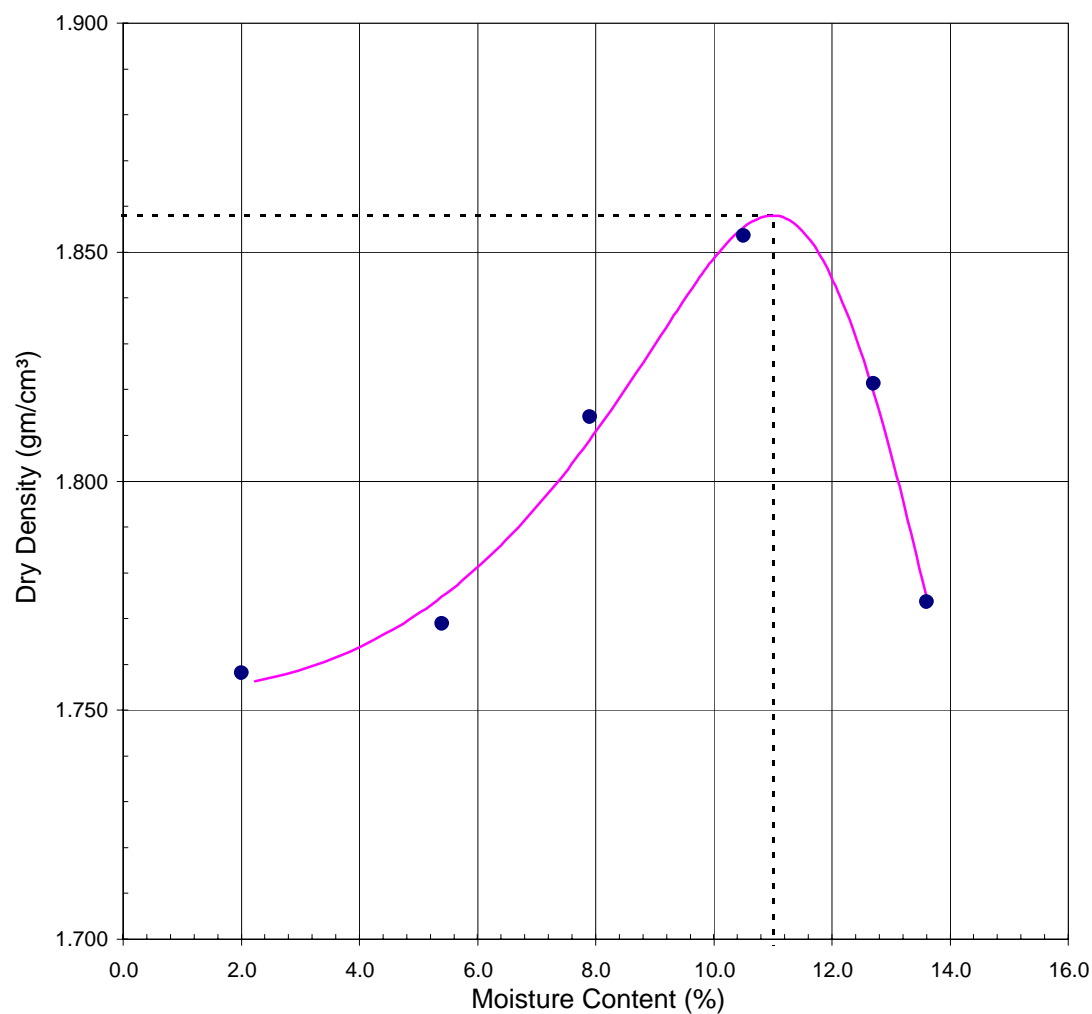

**Fig. H/18 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 11.0 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.858 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-11	Depth : 1.00m
---------------------	-----------------------	---------------

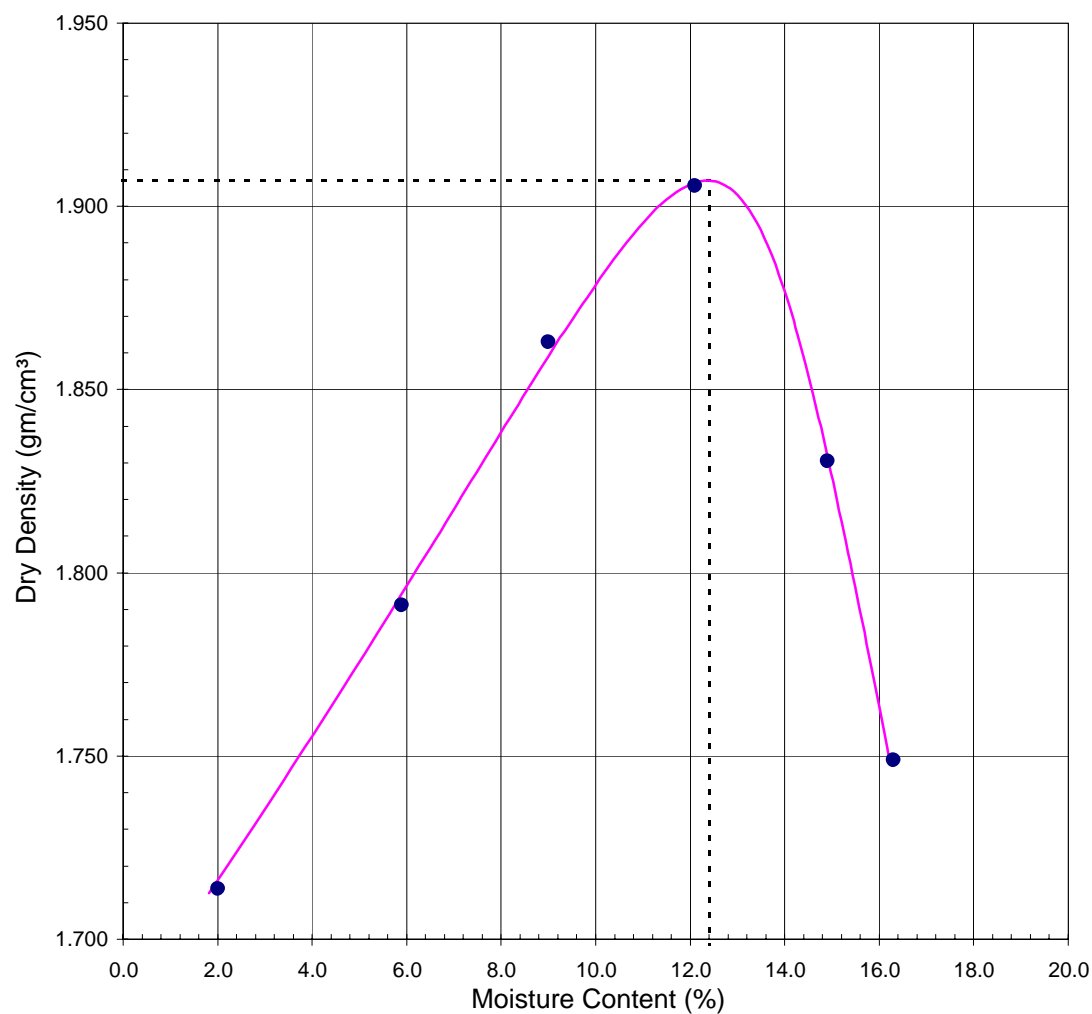

**Fig. H/19 : Moisture Content vs. Dry Density Plot**


**Optimum Moisture Content : 12.4 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.907 gm/cm³**

**Water Content - Dry Density Relation using Heavy Compaction**  
**(Modified Proctor Test)**

Project : Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock	Job No. : CCPL/20101211
---	-------------------------

Details of Sample :	Bore hole No. : BH-11	Depth : 2.50m
---------------------	-----------------------	---------------

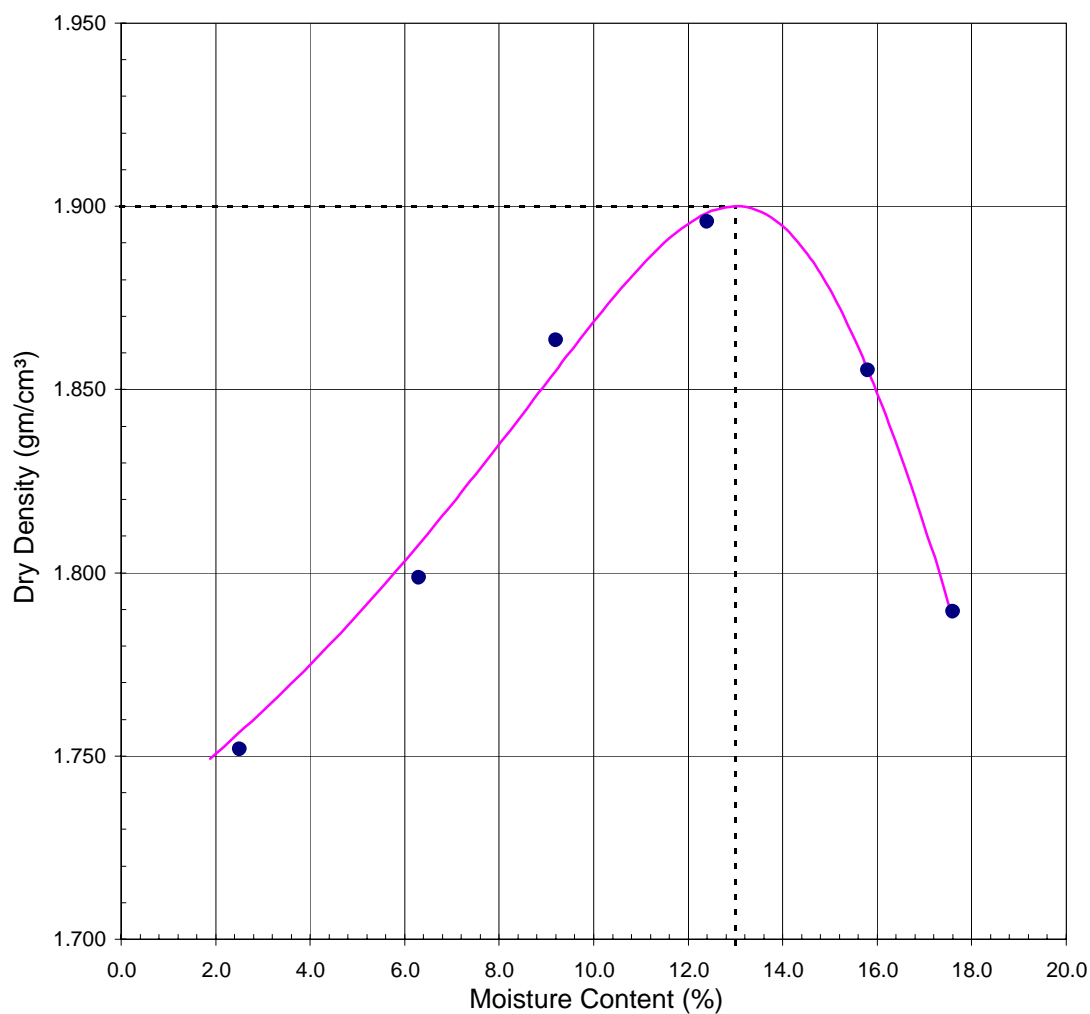

**Fig. H/20 : Moisture Content vs. Dry Density Plot**

**Optimum Moisture Content : 13.0 %**

**Maximum Dry Density,  $\gamma_{dmax}$  : 1.900 gm/cm³**

Job No. : CCPL/20101211

Ref. Location: BH-3

**DESIGN DATA:**

Pile diameter, D (m): 1.20  
Pile cut-off level (m): (+)6.0  
Pile founding level (m): (-)23.0  
Pile type: Bored Cast-in-situ

Existing bed level (m): (+)4.3  
Dredge level (m): (-)5.2  
Ground water table: At G.L.  
Factor of safety, FOS : 2.5

**SOIL DATA FOR CAPACITY CALCULATIONS**

Description of Layers					SPT value N	Bulk density $\gamma$ (t/m <sup>3</sup> )	Cohesion c (t/m <sup>2</sup> )	Angle of internal friction prior to installation of pile $\phi$ (°)	# For design of bored pile
Sl. No.	Layer ID	Starting RL (m)	Ending RL (m)	Thickness (m)					
1	-	(+)6.0	(-)5.2	11.2	-	-	-	-	-
2	II	(-)5.2	(-)8.7	3.5	3	1.626	1.6	-	-
3	IIIA	(-)8.7	(-)13.7	5.0	12	1.923	6.1	-	-
4	IIIB	(-)13.7	(-)15.2	1.5	27	2.000	12.0	-	-
5	IIIB	(-)15.2	(-)18.2	3.0	43	2.070	19.0	-	-
6	IV	(-)18.2	(-)20.7	2.5	37	2.028	-	35.5	32.5
7	V	(-)20.7	(-)33.2	12.5	27	2.001	12.2	-	-
8	VI	(-)33.2	(-)36.2	3.0	40	2.058	-	37.0	34.0
9	VI	(-)36.2	(-)37.7	1.5	27	2.028	-	35.0	32.0
10	VI	(-)37.7	(-)45.7	8.0	40	2.056	-	37.0	34.0

**Note:** # As per Pile foundation and Analysis by H.G.Poulos and E.H.Davis [Page 27]

## SAFE VERTICAL CAPACITY UNDER COMPRESSION

[Refer to IS: 2911(Part I/Sec 2)-2010]

### Shaft Resistance

$Q_s = \sum(\alpha_i c_i + K_i P_{di} \tan \delta_i) A_{si}$  where,  $\alpha_i$ : Adhesion factor;  $A_{si}$ : Area of shaft =  $\pi D L_i$ ;

$L_i$ : Length of pile in  $i^{th}$  layer;  $K_i$ : Earth pressure coefficient (varying between 1 to 1.5 for  $\phi$  30° to 40°);

$P_{di}$ : Effective overburden pressure;  $\delta_i$ : Angle of wall friction

Sl. No.	Layer ID	$L_i$ (m)	R.L.* (m)	$P_d^{*1}$ (t/m <sup>2</sup> )	$c$ (t/m <sup>2</sup> )	$\alpha$	$\phi$ (°)	$\delta$ (°)	K	$Q_s$ (t)	$\Sigma Q_s$ (t)
1	-	11.2	(+)0.4	0.0	-	-	-	-	-	-	271.5
2	II	3.5	(-)7.0	1.1	1.6	1.000	-	-	-	-21.1	
3	IIIA	5.0	(-)11.2	4.5	6.1	0.730	-	-	-	83.9	
4	IIIB	1.5	(-)14.5	7.6	12.0	0.368	-	-	-	25.0	
5	IIIB	3.0	(-)16.7	9.9	19.0	0.275	-	-	-	59.0	
6	IV	2.5	(-)19.5	12.8	-	-	32.5	32.5	1.13	86.5	
7	V	2.3	(-)21.9	15.2	12.2	0.361	-	-	-	38.2	

\*: R.L./Depth where effective overburden pressure ( $P_d$ ) is computed

\*1: Effective overburden pressure restricted to a depth of 15D for  $\phi \leq 30^\circ$  and increasing to 20D for  $\phi \geq 40^\circ$ , when relevant depth exceeds such limit

Weighted average of  $\phi = 0.0$  Overburden pressure restriction = 15.00D

### End Bearing Capacity

$Q_b = A_p (c N_c + 0.5 \gamma' D N_\gamma + P_d N_q)$

where,  $\alpha_i$ : Adhesion factor;  $\gamma'$ : Effective unit weight of soil;

$A_p$ : Cross-sectional area of pile toe =  $\pi D^2/4$

$N_c$ ,  $N_q$  and  $N_\gamma$ : Bearing capacity factors

Founding level (m)	$c$ (t/m <sup>2</sup> )	$\phi$ (degree)	$\gamma$ (t/m <sup>3</sup> )	$P_d$ (t/m <sup>2</sup> )	$N_c$	$N_q$	$N_\gamma$	$Q_b$ (t)
(-)23.0	12.2	-	2.001	16.4	9.0	-	-	124.2

Effective self weight of pile over existing soil surcharge

$$Q_{self} = \pi D^2/4 \times \sum [L_i \times (\gamma_c - \gamma_i)] = 30.7 \text{ t}$$

where,  $\gamma_c$  = unit weight of reinforced concrete = 2.5 t/m<sup>3</sup>

$$\text{Safe vertical pile capacity} = [\Sigma Q_s + Q_b] / \text{FOS} - Q_{self} =$$

127.6 t

**Suggested Vertical Capacity of Pile is 125t**

### UPLIFT CAPACITY

[Refer to IRC: 78: 2014]

$$\text{Safe uplift capacity} = \frac{R_s \cdot x r_d}{F \cdot S} + W = (271.5 \times 0.7) / 2.5 + 30.7 = 106.7t$$

Where  $R_s = \Sigma Q_s$  = Skin friction = 271.5t

$r_d$  = Reduction factor = 0.7

F.S. = Factor of safety = 2.5

W = Effective Self Weight of pile = 30.7 t

**Suggested Uplift Capacity of Pile is 100t**

### LATERAL LOAD CAPACITY

[Refer to IS: 2911(Part I/Sec 2)-2010]

Sl No.	Layer ID	R.L. (m)		Thick-ness (m)	$\eta_h$ (t/m <sup>3</sup> )	$k_1$ (t/m <sup>3</sup> )	K (t/m <sup>3</sup> )	Stiffness factor		Equivalent Stiffness factor
		From	To					T (m)	R (m)	T (m)
1	-	**(+6.0	(-)5.2		-	-	-	-	-	5.1
2	II	(-)5.2	(-)8.7	3.5	20	-	-	6.6	-	
3	IIIA	(-)8.7	(-)13.7	5.0	169	-	-	4.3	-	
4	IIIB	(-)13.7	(-)15.0	1.3	385	-	-	3.7	-	
			Total =	9.8			-	-	-	

\*\*Cut-off-level

Here, embedded length of pile  $L = [(-)5.2 - (-)23.0] = 17.8m$  4 x T

Therefore, pile is treated as intermediate pile

$$\text{where } T = \sqrt[5]{\frac{EI}{\eta_h}}, R = \sqrt[4]{\frac{EI}{KB}}, I = \frac{\pi d^4}{64}, K = \frac{k_1}{1.5} \times \frac{0.3}{B}$$

In which E = Young's modulus of pile material =  $5000 \times 25^{0.5} \text{ N/mm}^2 = 2.50 \times 10^6 \text{ t/m}^2$   
assuming grade of concrete M25

Assuming fixed-head pile, equivalent length of pile

$$L_f = 1.93 \times 5.1 = 9.8m \quad (\text{thickness of soil layer considered to assess T})$$

$$L_1 = \text{Cut-off level} - \text{Scour level} = 11.2m$$

Where  $L_1$  = Length of pile above Ground level / Scour level

Therefore, lateral load-carrying capacity of pile,  $Q = [12 \times 2500000 \times 0.1018 \times 0.0267] / 9261 = 8.8t$

$$\text{where } Q = \frac{12 \times E \times I \times \Delta}{(L_1 + L_f)^3} \text{ for fixed head pile}$$

$\Delta$  = maximum allowable lateral deflection at cut-off level of pile = 26.7mm  
i.e 12mm at Scour Level (1% of pile dia.)

[As per Article 709.3.5 of IRC:78, 2014]

**Suggested Lateral Capacity of Pile is 8.5t**

Job No. : CCPL/20101211

Ref. Location: BH-7

**DESIGN DATA:**

Pile diameter, D (m): 1.20  
Pile cut-off level (m): (+)6.0  
Pile founding level (m): (-)23.0  
Pile type: Bored Cast-in-situ

Existing ground level (m): (+)7.3  
Dredge level (m): -  
Ground water table: At G.L.  
Factor of safety, FOS : 2.5

**SOIL DATA FOR CAPACITY CALCULATIONS**

Sl. No.	Description of Layers				SPT value N	Bulk density $\gamma$ (t/m <sup>3</sup> )	Cohesion c (t/m <sup>2</sup> )	Angle of internal friction prior to installation of pile $\phi$ (°)	#For design of bored pile
	Layer ID	Starting RL (m)	Ending RL (m)	Thickness (m)					
1	—	(+)7.3	(+)5.8	1.5	-	1.855	-	-	-
2	I	(+)5.8	(+)1.8	4.0	3	1.764	1.7	-	-
3	II	(+)1.8	(-)7.7	9.5	4	1.670	2.1	-	-
4	IIIA	(-)7.7	(-)8.7	1.0	9	1.890	4.0	-	-
5	IIIA	(-)8.7	(-)13.7	5.0	15	1.948	7.2	-	-
6	IIIB	(-)13.7	(-)15.2	1.5	15	1.950	6.5	-	-
7	IIIB	(-)15.2	(-)18.2	3.0	28	2.010	12.5	-	-
8	IV	(-)18.2	(-)19.7	1.5	28	2.019	-	35.0	32.0
9	IV	(-)19.7	(-)20.7	1.0	40	2.070	-	37.0	34.0
10	V	(-)20.7	(-)27.2	6.5	21	1.964	9.0	-	-
11	V	(-)27.2	(-)31.7	4.5	39	2.050	17.0	-	-
12	V	(-)31.7	(-)33.2	1.5	24	1.980	11.0	-	-
13	VI	(-)33.2	(-)42.7	9.5	40	2.055	-	37.0	34.0

**Note:** #As per Pile foundation and Analysis by H.G.Poulos and E.H.Davis [Page 27]

# CONSTELL

CONSULTANTS PVT. LTD.

## SAFE VERTICAL CAPACITY UNDER COMPRESSION

[Refer to IS: 2911(Part I/Sec 2)-2010]

### Shaft Resistance

$Q_s = \sum (\alpha_i c_i + K_i P_{di} \tan \delta_i) A_{si}$  where,  $\alpha_i$ : Adhesion factor;  $A_{si}$ : Area of shaft  $= \pi D L_i$ ;

$L_i$ : Length of pile in  $i^{th}$  layer;  $K_i$ : Earth pressure coefficient (varying between 1 to 1.5 for  $\phi$  30° to 40°);

$P_{di}$ : Effective overburden pressure;  $\delta_i$ : Angle of wall friction

Sl. No.	Layer ID	$L_i$ (m)	R.L.* (m)	$P_d^{*1}$ (t/m <sup>2</sup> )	$c$ (t/m <sup>2</sup> )	$\alpha$	$\phi$ (°)	$\delta$ (°)	K	$Q_s$ (t)	$\Sigma Q_s$ (t)
1	—	0.2	(+)5.9	1.2	-	-	-	-	-	-	357.1
2	I	4.0	(+)3.8	2.8	1.7	1.000	-	-	-	-25.6	
3	II	9.5	(-)3.0	7.5	2.1	1.000	-	-	-	75.2	
4	IIIA	1.0	(-)8.2	11.1	4.0	1.000	-	-	-	15.1	
5	IIIA	5.0	(-)10.7	13.5	7.2	0.624	-	-	-	84.7	
6	IIIB	1.5	(-)10.7	13.5	6.5	0.690	-	-	-	25.4	
7	IIIB	3.0	(-)10.7	13.5	12.5	0.353	-	-	-	49.9	
8	IV	1.5	(-)10.7	13.5	-	-	32.0	32.0	1.10	52.4	
9	IV	1.0	(-)10.7	13.5	-	-	34.0	34.0	1.20	41.2	
10	V	2.3	(-)10.7	13.5	9.0	0.497	-	-	-	38.8	

\*: R.L./Depth where effective overburden pressure ( $P_d$ ) is computed

\*1: Effective overburden pressure restricted to a depth of 15D for  $\phi \leq 30^\circ$  and increasing to 20D for  $\phi \geq 40^\circ$ , when relevant depth exceeds such limit

Weighted average of  $\phi = 0.0$  Overburden pressure restriction = 15.00D

### End Bearing Capacity

$Q_b = A_p (c N_c + 0.5 \gamma' D N_\gamma + P_d N_q)$

where,  $\alpha_i$ : Adhesion factor;  $\gamma'$ : Effective unit weight of soil;

$A_p$ : Cross-sectional area of pile toe  $= \pi D^2/4$

$N_c$ ,  $N_q$  and  $N_\gamma$ : Bearing capacity factors

Founding level (m)	$c$ (t/m <sup>2</sup> )	$\phi$ (degree)	$\gamma$ (t/m <sup>3</sup> )	$P_d$ (t/m <sup>2</sup> )	$N_c$	$N_q$	$N_\gamma$	$Q_b$ (t)
(-)23.0	9.0	-	1.964	13.5	9.0	-	-	91.6

Effective self weight of pile over existing soil surcharge

$$Q_{\text{self}} = \pi D^2/4 \times \Sigma [L_i \times (\gamma_c - \gamma_i)] = 21.5 \text{ t}$$

where,  $\gamma_c$  = unit weight of reinforced concrete = 2.5 t/m<sup>3</sup>

$$\text{Safe vertical pile capacity} = [\Sigma Q_s + Q_b] / \text{FOS} - Q_{\text{self}} =$$

158.0 t

**Suggested Vertical Capacity of Pile is 150t**



# CONSTELL

CONSULTANTS PVT. LTD.

## UPLIFT CAPACITY

[Refer to IRC: 78: 2014]

$$\text{Safe uplift capacity} = \frac{R_s \times r_d}{F.S} + W = (357.1 \times 0.7) / 2.5 + 21.5 = 121.5t$$

Where  $R_s = \Sigma Q_s$  = Skin friction = 357.1t

$r_d$  = Reduction factor = 0.7

F.S. = Factor of safety = 2.5

W = Effective Self Weight of pile = 21.5 t

**Suggested Uplift Capacity of Pile is 120t**

## LATERAL LOAD CAPACITY

[Refer to IS: 2911(Part I/Sec 2)-2010]

Sl No.	Layer ID	R.L. (m)		Thick-ness (m)	$\eta_h$ (t/m <sup>3</sup> )	$k_1$ (t/m <sup>3</sup> )	K (t/m <sup>3</sup> )	Stiffness factor		Equivalent Stiffness factor
		From	To					T (m)	R (m)	T (m)
1	—	**(+6.0	(+)5.8	0.2	20	-	-	6.6	-	6.6
2	I	(+)5.8	(+)1.8	4.0	20	-	-	6.6	-	
3	II	(+)1.8	(-)7.7	9.5	20	-	-	6.6	-	
4	IIIA	(-)7.7	(-)8.2	0.5	120	-	-	4.6	-	
			Total =	14.2			-	-	-	

\*\*Cut-off-level

Here, embedded length of pile  $L = [(+)6.0 - (-)23.0] = 29.0m > 4 \times T$

Therefore, pile is treated as long pile

$$\text{where } T = \sqrt[5]{\frac{EI}{\eta_h}}, R = \sqrt[4]{\frac{EI}{KB}}, I = \frac{\pi d^4}{64}, K = \frac{k_1}{1.5} \times \frac{0.3}{B}$$

In which E = Young's modulus of pile material =  $5000 \times 25^{0.5} \text{ N/mm}^2 = 2.50 \times 10^6 \text{ t/m}^2$   
assuming grade of concrete M25

Assuming fixed-head pile, equivalent length of pile

$$L_f = 2.18 \times 6.6 = 14.4m \quad (\text{thickness of soil layer considered to assess } T)$$

$$L_1 = 0$$

Where  $L_1$  = Length of pile above Ground level / Scour level

Therefore, lateral load-carrying capacity of pile,  $Q = [12 \times 2500000 \times 0.1018 \times 0.012] / 2986 = 12.3t$

$$\text{where } Q = \frac{12 \times E \times I \times \Delta}{(L_1 + L_f)^3} = \text{for fixed head pile}$$

$\Delta$  = maximum allowable lateral deflection at cut-off level of pile = 12.0mm (1% of pile dia.)

[As per Article 709.3.5 of IRC:78, 2014]

**Suggested Lateral Capacity of Pile is 12t**

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock



**BH-1**



**BH-2**



**BH-3**

**FIELD WORK IN PROGRESS**

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock



**BH-4**



**BH-5**



**BH-6**

**FIELD WORK IN PROGRESS**

Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock



**BH-7**



**BH-8**

**FIELD WORK IN PROGRESS**



Soil Investigation work for the upgradation of Berth No.7, NSD, N.S.Dock



**BH-10**



**BH-11**

**FIELD WORK IN PROGRESS**

**CORRIGENDUM-I**

**Name of Work: DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP, KOLKATA"**

**NIT NO. SMPK/KDS/CIV/T/2622/60 Dt. 29.10.2021**

Reference to subject tender, please find the followings vide this **CORRIGENDUM-I** :

- I) Extension of Submission & Opening dates of tender
  - II) Authority's reply to queries of bidders.
  - III) Few additional information and inputs regarding said tender by SMPK.
  - IV) Four (4) Nos. drawings (PDF) & one sketch (PDF)
- All above are the part of the Tender document.

**I) Extension of submission & opening dates :**

Page Ref.	In place of	To be read as
4,10,11,48,49, Corrigendum-I & wherever applicable.	LAST DATE AND TIME FORRECEIPT OF BIDS:- 09.12.2021 upto15:00 Hrs	LAST DATE AND TIME FORRECEIPT OF BIDS:- <b>04.01.2022 upto15:00 Hrs</b>
---Do---	TIME AND DATE OF OPENING OF BIDS:- 10.12.2021 At 15:00 Hrs	TIME AND DATE OF OPENING OF BIDS:- <b>05.01.2022 at 15:00 Hrs</b>

All other terms & conditions and Clauses will remain same as per original.

**Superintending Engineer (Contract Cell)**  
**Forमुख्य अभियंता / Chief Engineer**

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA'

**II) Authority's reply in Response to Bidders' Queries:-**

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
1.	141	1.1 (2)	Maximum Vessel size 172 mtr. X 25 mtr with DWT 18,000 ton.	Clause 5.2.2 (iii), page 144, mentioned 25,500 DWT, Design ship Size is 18,000 DWT OR 25,500 DWT— Please <b>Confirm</b> .	The DWT of the ship is 18000MT with water displacement of 25500 MT . For design purpose considers displacement.
2.	141	1.1 (4)	Dredge bed level of dock basin is 5.18 m. KODS.	Is it 5.18 m KODS or (-) 5.18 m KODS.	It is (-) 5.18 m KODS. Incidentally KODS level is 2.36 m below MSL is to be read instead of 2.82 m below MSL.
				Please confirm whether work will be performed with KODS as reference OR MSL	Work to be carried out w.r.t. KODS.
3.	141	1.1 (5, 6 & 8)	Angle of berthing, Velocity of approach and Berthing Force.	<b>Mentioned here</b> as per IS 4651, Part III.	
				In clause 1.1" (16), page 142 mentioned "Providing and fixing marine fixtures such as SCN 1000H type rubber fender of reputed make like Bridge Stone".	Manufacturer of fenders will be Bridge Stone or other reputed manufacturer conforming to IS/International standard
				Please mention whether "SCN 1000H" is the Contract requirement OR shall be decided by the bidder as per 4651, Part III.	SCN 1000H rubber fender or equivalent is to be considered in design & installation.
				Please provide the list of accepted vendors instead of "like Bridge Stone" OR Delete "like Bridge Stone" and provide detailed specification <b>of Fender</b> .	Fenders of Bridgestone & similar reputed manufacturer will be accepted subject to satisfactory conformity to relevant IS/International Codal provision.

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA'

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
4.	141	1.1(9)	Dia. of Pile will be 1200 mm & Cut off length of Pile will be (-)35.00 m,KODS	Dia "1200 mm" & cut off "(-)35.00 m, KoDS" — Are they the contract requirement OR shall be decided by the bidders as per their design proposal satisfying 6.1 (ii) vis-à-vis codal provision.	Dia of Pile and Cut off level of piles are indicative only and should be considered as preliminary reference.
5.	141	1.1 (11)	PCC to be used will not be below M-20 grade	Our understanding, this is applicable for PCC structures and not for Levelling concrete and pavement — Please Confirm.	Yes
6.	142	1.1(13)	Construction of Service Trench ..... throughout the periphery both of berth and stacking yard duly provided with .....	Please mark the plan layout of the Service Trench in "SKETCH FOR BERTH NO. 7 & STACK YARD" included in Page 184 of the bid document.	G.A drawing is attached only for reference. However, it is to be provided by the successful bidder during making final layout of berth & yard which will be subsequently approved by EIC
7.	142	1.1 (16)	Providing and fixing marine fixtures..... D-shackles etc.	Please provide the drawing duly marking the location of each fixture OR Mention the numbers required against each fixture.	Successful bidder shall have to do it during 'Engineering' stage which will be subsequently approved by EIC.
8.	142	1.1 (17)	Providing crane track including ..... and foundation etc.	Please elucidate the Contract requirement. which one of the following is the Contract Requirement: 1. Only space to be created for fixing of rails infuture. No Rail Supply& Fixing. Such space to be filled with leaner concrete now for future use;	Clearly mentioned in clause 1.1(17) in page 142.
				2. Rail to be supplied and Fixed. In	Fixing detail of Crane Rail including check rail



Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA"

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
				suchcase, following shall be provided : <ul style="list-style-type: none"> <li>Rail detail covering check rail provision;</li> </ul> Wheel Load & Wheel configuration of theRMQC.	to be submitted by successful bidder during 'Engineering' stage which will be duly approved by EIC.
9.	142	1.1 (18)	Necessary foundation of high Mast..... of berth and stack yard	Please provide the following : <ul style="list-style-type: none"> <li>Specified location of High Masts in the Layout drawing OR state Number of High Masts; and</li> <li>Foot Print &amp; Load Data of the High Mast Tower at Top of Foundation.</li> </ul>	To be provided by successful bidder after detail survey of site & preparation of final G.A. layout during Engineering stage, which will be subsequently approved by EIC.
10.	142	1.1 (19)	Erection and drive of Z-section . . . . . area and stacking yard	Is It the Contract requirement OR shall be decided by the bidders as per their design proposal satisfying 6.1 (ii) vis-à-vis codal provision.	AZ 18 sheet pile is an indicative one and may be considered as design reference.
11.	143	1.2 (2)	Rich stacker and container trailer will operate on the yard	Please provide the Wheel configuration, Wheel Spacing, Axle Load, Tyre pressure etc. of each type of vehicles to be considered by the Contractor.	It will be as per Standard Reach Stacker & container trailer plying on container yard in Ports & Container Yard throughout India .
12.	143	2	Insure for Performance	Please elucidate the Contract requirement and provide the accepted terms of KDS, SMPTof suchinsurance.	The tenderer to insure the Project Value amount with an Insurance company in favour of SMPK and same should be done on year to year basis for 10 years from the date of completion of the work to take care of all risks for satisfactory operation on berth no.7,NSD

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA"

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
					and new container yard area and to be submitted within one month from the completion date of the project. The bidder shall submit a B.G for premium amount payable in the 1 <sup>st</sup> year multiplied by 10(Ten),which shall have to be submitted with SMPK within one month from the completion date of the project.
13	143	5	The berth & Stack Yard design shall be based on the detailed survey . . . . .	Please provide the "detailed survey" map of the existing facility.	Bidders, who are expected to carry out their own surveys, investigations and other detail examinations of the project before submitting their bids.
			Detail Design Report and Drawings ..... for review, comments and approval first. The work . . . . .	Please Define the number days for review, comments and approval by PMC / KDS, SMPK against each submission by the contractor.	(i)Submission of detail design report with detailed drawings of the project by successful bidder to EIC - 21(twenty- one)days. (ii)Comments of SMPK-14(fourteen) days. (iii)Incorporation by successful bidder and resubmission - 12(twelve )days. (iv)Final approval of design & drawings by SMPK – 14(fourteen)Days.
				Submission Type i.e. soft copy only OR Hard copy also for draft submission.	Both soft copy and 7 sets of hard copy to be submitted both for draft & final submission.
				Please specify the number of copies of final drawings / documents to be submitted by the Contractor	Do
14.	143	5.1	The bidder to .. . . . . .	Please provide the Layout proposed	Sketch already attached on page 184 of this

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA"

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
			.Stack Yard construction.	by the PMC and SMP, to be adopted for construction.	tender document. GA drawing & Cross section drawings are also attached now as reference.
15.	144	5.2.1 (II)	Rail Mounted Quay Crane (RMQC)	Please provide the Following : + Wheel Configuration; • Wheel Load; • Tie Down Location, Load & Arrangement; • Storm Anchor Location, Arrangement and Load; • Buffer Requirement and the Load Data.	Already mentioned in 5.2.1.(II), Page-144
16.	145	5.2.4 (III)e.	Expansion Joints .... as per relevant IS code	Please specify the code and clause.	It is already mentioned that relevant IS code provision to be considered in design during Engineering.
17.	146	6.2 (i)	The bidder shall submit the designs for the structural system proposed which is in the Tender..	Please provide the drawing showing the structural system proposed in the Tender — incase the same is mandatory to follow.	Only technical design datas are provided in the tender document. Bidders are require to submit their own structural system based on design.
18.	147	8.2.1.5	Notice for Inspections of Materials	Please specify the minimum number of days required to serve notice.	At least three days prior notice is required.
				Testing of Fender, Bollard at shop - whether to be witnessed by Owner & PMC. If so, expenses with respect to travel, accommodation, Fooding, etc Who will borne, please specify.	All tests will be witnessed by owner/PMC and all costs shall have to be borne by the contractor.

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA'

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
19.	177	8.3.8.2	Last Para This clause shall be read in conjunction with the section relating to painting	Please provide the "section relating to painting"	It is deleted.
20.	180	8.3.9.3	Expansion Joints	Para 2 is contradicting with 5.2.4 (iii)e, page 145 and Also, last para contradicting with 1.1 (15), page 142. Please provide details of the	It is not contradicting. The contractor should design the expansion joints & prepare drawings as per relevant I.S. code & submit design & drawings for approval during 'Engineering' stage which will be subsequently approved by EIC .
21.	183	Drawings EXISTING DRAWING OF OLD 7,NSD BERTH		Provide drawing is not legible and with sufficient information. Please provide the legible drawing with as built dimensions sufficient to assess the dismantling quantity	Soft copy (PDF) of old 7 NSD berth and GA drawing(PDF) & cross section(PDF) drawings are uploaded. Bidders should visit the site and take details of the structure to assess the dismantling quantity.
22.	188	14. Water and drainage . . . . . .Engineer-in-Charge/ PMC at no extracost to the department.		Please provide the as built drawings of the "Water and drainage pipe lines electrical, telephone, I.T. and server cables etc" which are within the area to be provided to the contractor	Bidders should visit the site and take details of the existing layout of all service lines. However, a tentative drawing of existing service lines within the vicinity of working zone is uploaded.
23.	192	Drains, pipes, ITcables, overhead wires and similar services encountered in the course of the works shall be guarded from damage by the Contractor at his own cost, so that they may continue in full and uninterrupted use to the satisfaction of the owners		Please provide the as built drawings of the "Water and drainage pipe lines electrical, telephone, I.T. and server cables etc" which are within the area to be provided to the contractor and have to be guarded.	Already replied in Sl. No. 22.
24.	202	116...		Please elaborate the procedure,	All the dismantled materials with sale value like

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA"

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
			Reinforcement/Structural steel, Steel, pipes, cables, etc., at Port General Stores or as directed by the Engineer- in-Charge/ PMC.	have to be followed by the Contractor. Please define the location where such material to be delivered.	reinforcement, structural steel, Bollard, fenders etc. are to be deposited with designated place of MM (Materials Manager) of SMPK under direction of EIC which is within 5km from site.
25.			Provision of price variation is not included in tender documents.	It is our prayer to introduce price variation clauses for major constructional materials, steel, cement, labour, plant and machinery and POL.	Price variation will not be there in this contract.
26.	P-212		Table in Para 2.2 Column 4 state the RL at Borehole Top.	For Boreholes BH 1 & BH 3 boreholes top levels are +4.40 & +4.30 respectively. On 16/11/2021, during pre bid meeting, it was confirmed that all levels in the soil report are in mKODS. With the above and the Dock water level as +5.33/+5.18 m KODS, available water depth is only around 1.00m.  At the same time, this berth is under operation with loaded ships. The same cannot happen with 1.00 m water depth only. From the above, it is necessary to reconfirm the RL at Top of all the boreholes	Bidders are requested to follow level given in Scope of work at Page-141 Clause 1. 1.1 .4

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA"

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
27.	P- 183		Drawings Sketch for Berth number 7 and stack yard ....	Please provide the UTM coordinates of the boundary corners	A sketch showing UTM coordinates is uploaded
28.	183&185			You are requested to please provide Existing Berth & Stack Yard and bathymetry drawing as tender drawing on page no 183 to 185 are not readable.	GA drawing, Cross Section of 7,NSD berth including stack yard are uploaded as reference and Layout drawing of Existing old berth no.7 is also uploaded.
29.	141&144	1.1(2)- Maximum vessel size & 5.2.2 (iii)- Vessels of Size DWT		On Page No 141, point 1.1 (2) Maximum vessel size 172 mtr. X 25 mtr. With DWT 18000 ton. While on page no 144, point 5 [5.2.2 (iii)] Vessels of Size DWT 25000 MT. You are requested to please clarify.	The DWT of the ship is 18000MT with water displacement of 25500 MT . For design purpose consider displacement.
30.	141	1.1(9).- Pile Diameter		Vessels of Size DWT As per page no 141, point 1 [1.1(9)], the pile diameter and pile foundation level are fixed? You are requested to please clarify.	Dia of Pile and Cut off level of pile are indicative and should be considered as reference during design.
31.	141	1.1.4- Levels		Levels mentioned in para 1.1.4 are with reference to MSL or what?	KODS
32.				High Mast Tower location is not mentioned in Tender document. Please provide location in layout drawing.	To be provided by successful bidder after detail survey of site & preparation of final G.A. layout during Engineering stage, which will be subsequently approved by EIC.
33.				Please clarify that, is it mandatory to provide sheet pile to retain Stack Yard Area?	YES
34.				Please provide specification of RMQC.	Already mentioned in 5.2.1.(II), Page-144

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA'

Sr. No	Page no.	Clause no.	Clause Description as given in Tender document	Queries of Bidders	Response of Authority (SMPK)
35.				Please clarify that existing pile of the existing jetty are to be removed or not? If yes, then upto which level. Also, please clarify that is there anything is to be removed from Stack Yard Area?	Old piles are to be dismantled upto pile muff. Those piles are not considered for design of the new berth and only to be connected with the new berth structure.
36.				Please clarify that is there any port charges.	There is no Port Charges. Please see Clause 123, Page-202.
37.				Can we have the required land area at the location near the work site for the labour camp and facilities like precast yard, batching plant etc. & also, provide charges for the same.	Please see Clause no.8.1.2.4 in Page no.153.
38.				You are requested to please clarify that the labour can stay in dock area.	Already replied above.
39	36	Sl.No.5		Formula for Bid Capacity calculation is not provided. Request you to provide the same.	Information sought from the bidders mentioned in tender documents to be provided.
40				Please provide interest free mobilization advance	No mobilization advance will be provided.

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA"

III) Few additional information and inputs regarding said tender by SMPK.

Sl. No.	Description /Reference		SMPK'S Comments
1.			Bidders can carry out additional soil investigation if necessary for foundation design without any extra cost.
2.			The diameter of the pile is 1200mm and the founding level is ( -)35m K.O.D.S as per the General Arrangement drawings (DWG No: NSD/BERTH/01) & the typical Cross Section (DWG NO: NSD/BERTH/02). Design basis report is also attached. These are being provided as a preliminary reference document by way of assistance to bidders. Bidders, who are expected to carry out their own surveys, investigations and other detail examinations of the project and do the design before submission of their bid.
			The Bidder shall submit the following along with the technical bid as evidence of preliminary design.
			I. Conceptual Layout of the berth & stack yard.
			II. General arrangement drawing of piles and typical longitudinal and cross section along with design basis report
			III. STADD input file




Name of Work :- E-tendering for ‘**DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA**’


			IV. Structural Design of pile including crack width calculation.
			V. Foundation design of pile.
3.	<p>Section 8</p> <p>2. Insurance for Performance/ Pg. No: 143 The Tenderer to insure with an insurance company for the whole work order amount for a period of 10 years from the date of completion of the work to take care of all risks for satisfactory operations on the Berth No 7, NSD, Kolkata. The bidder shall submit a Bank Guarantee for the Premium Amount payable annually for the entire period of 10 years.</p>		<p>To be read as</p> <p>The tenderer to insure the Project Value amount with an Insurance company in favour of SMPK and same should be done on year to year basis for 10 years from the date of completion of the work to take care of all risks for satisfactory operation on berth no.7,NSD and new container yard area and to be submitted within one month from the completion date of the project.</p> <p>The bidder shall submit a B.G for premium amount payable in the 1<sup>st</sup> year multiplied by 10(Ten),which shall have to be submitted with SMPK within one month from the completion date of the project.</p>
4.	<p>Section 8</p> <p>8. Technical Specification – 8.3.3.15</p> <p>Pile Load Tests (ii)/Pg.No.163 Pile Integrity Test to be done 50%</p>		<p>To be read as</p> <p>Pile Integrity Test to be done 100% .</p>
5.	<p>Page 143/ Clause 5.5.2 The data already mentioned are strictly to be used in designing the berth and stack yard structure.</p>		<p>To be read as</p> <p>The data already mentioned are strictly to be used in designing the berth and stack yard structure except 1.1.9 &amp; 1.1.19, which are indicative and to be taken as reference in page no.141 &amp; 142 respectively.</p>

Name of Work :- E-tendering for 'DESIGN, ENGINEERING & CONSTRUCTION FOR REHABILITATION OF 7, NSD OLD BERTH INCLUDING DEVELOPMENT OF BACK YARD AT N.S. DOCK, KDS, SMP,KOLKATA'

6..			Existing franky piles are to be dismantled upto pile muff and they will not be considered for design of new berth structure. Layout of new piles is to be made as per design and in space between old piles.
7.			The new berth and yard structure is to be matched with the existing berth/yard along boundary of the new berth and stack yard..
8.	202/117 All the tenderers are requested to physically inspect the existing sub and super structure including ancillary works of the" Parallel Bridge"....		To be read as All the tenderers are requested to physically inspect the existing sub and super structure including ancillary works of the <b><u>Old 7-NSD berth and adjacent yard.....</u></b>
9.			In general , there is no extra item of work in this tender,however if extra items are required to be executed not related to this project but required at site on specific instruction of the EIC,same will be paid on SOR of PWD,West Bengal or through a mutually agreed special rate if not available in SOR of PWD based on actual expenditure (on that item)plus 16% for overhead & profit.

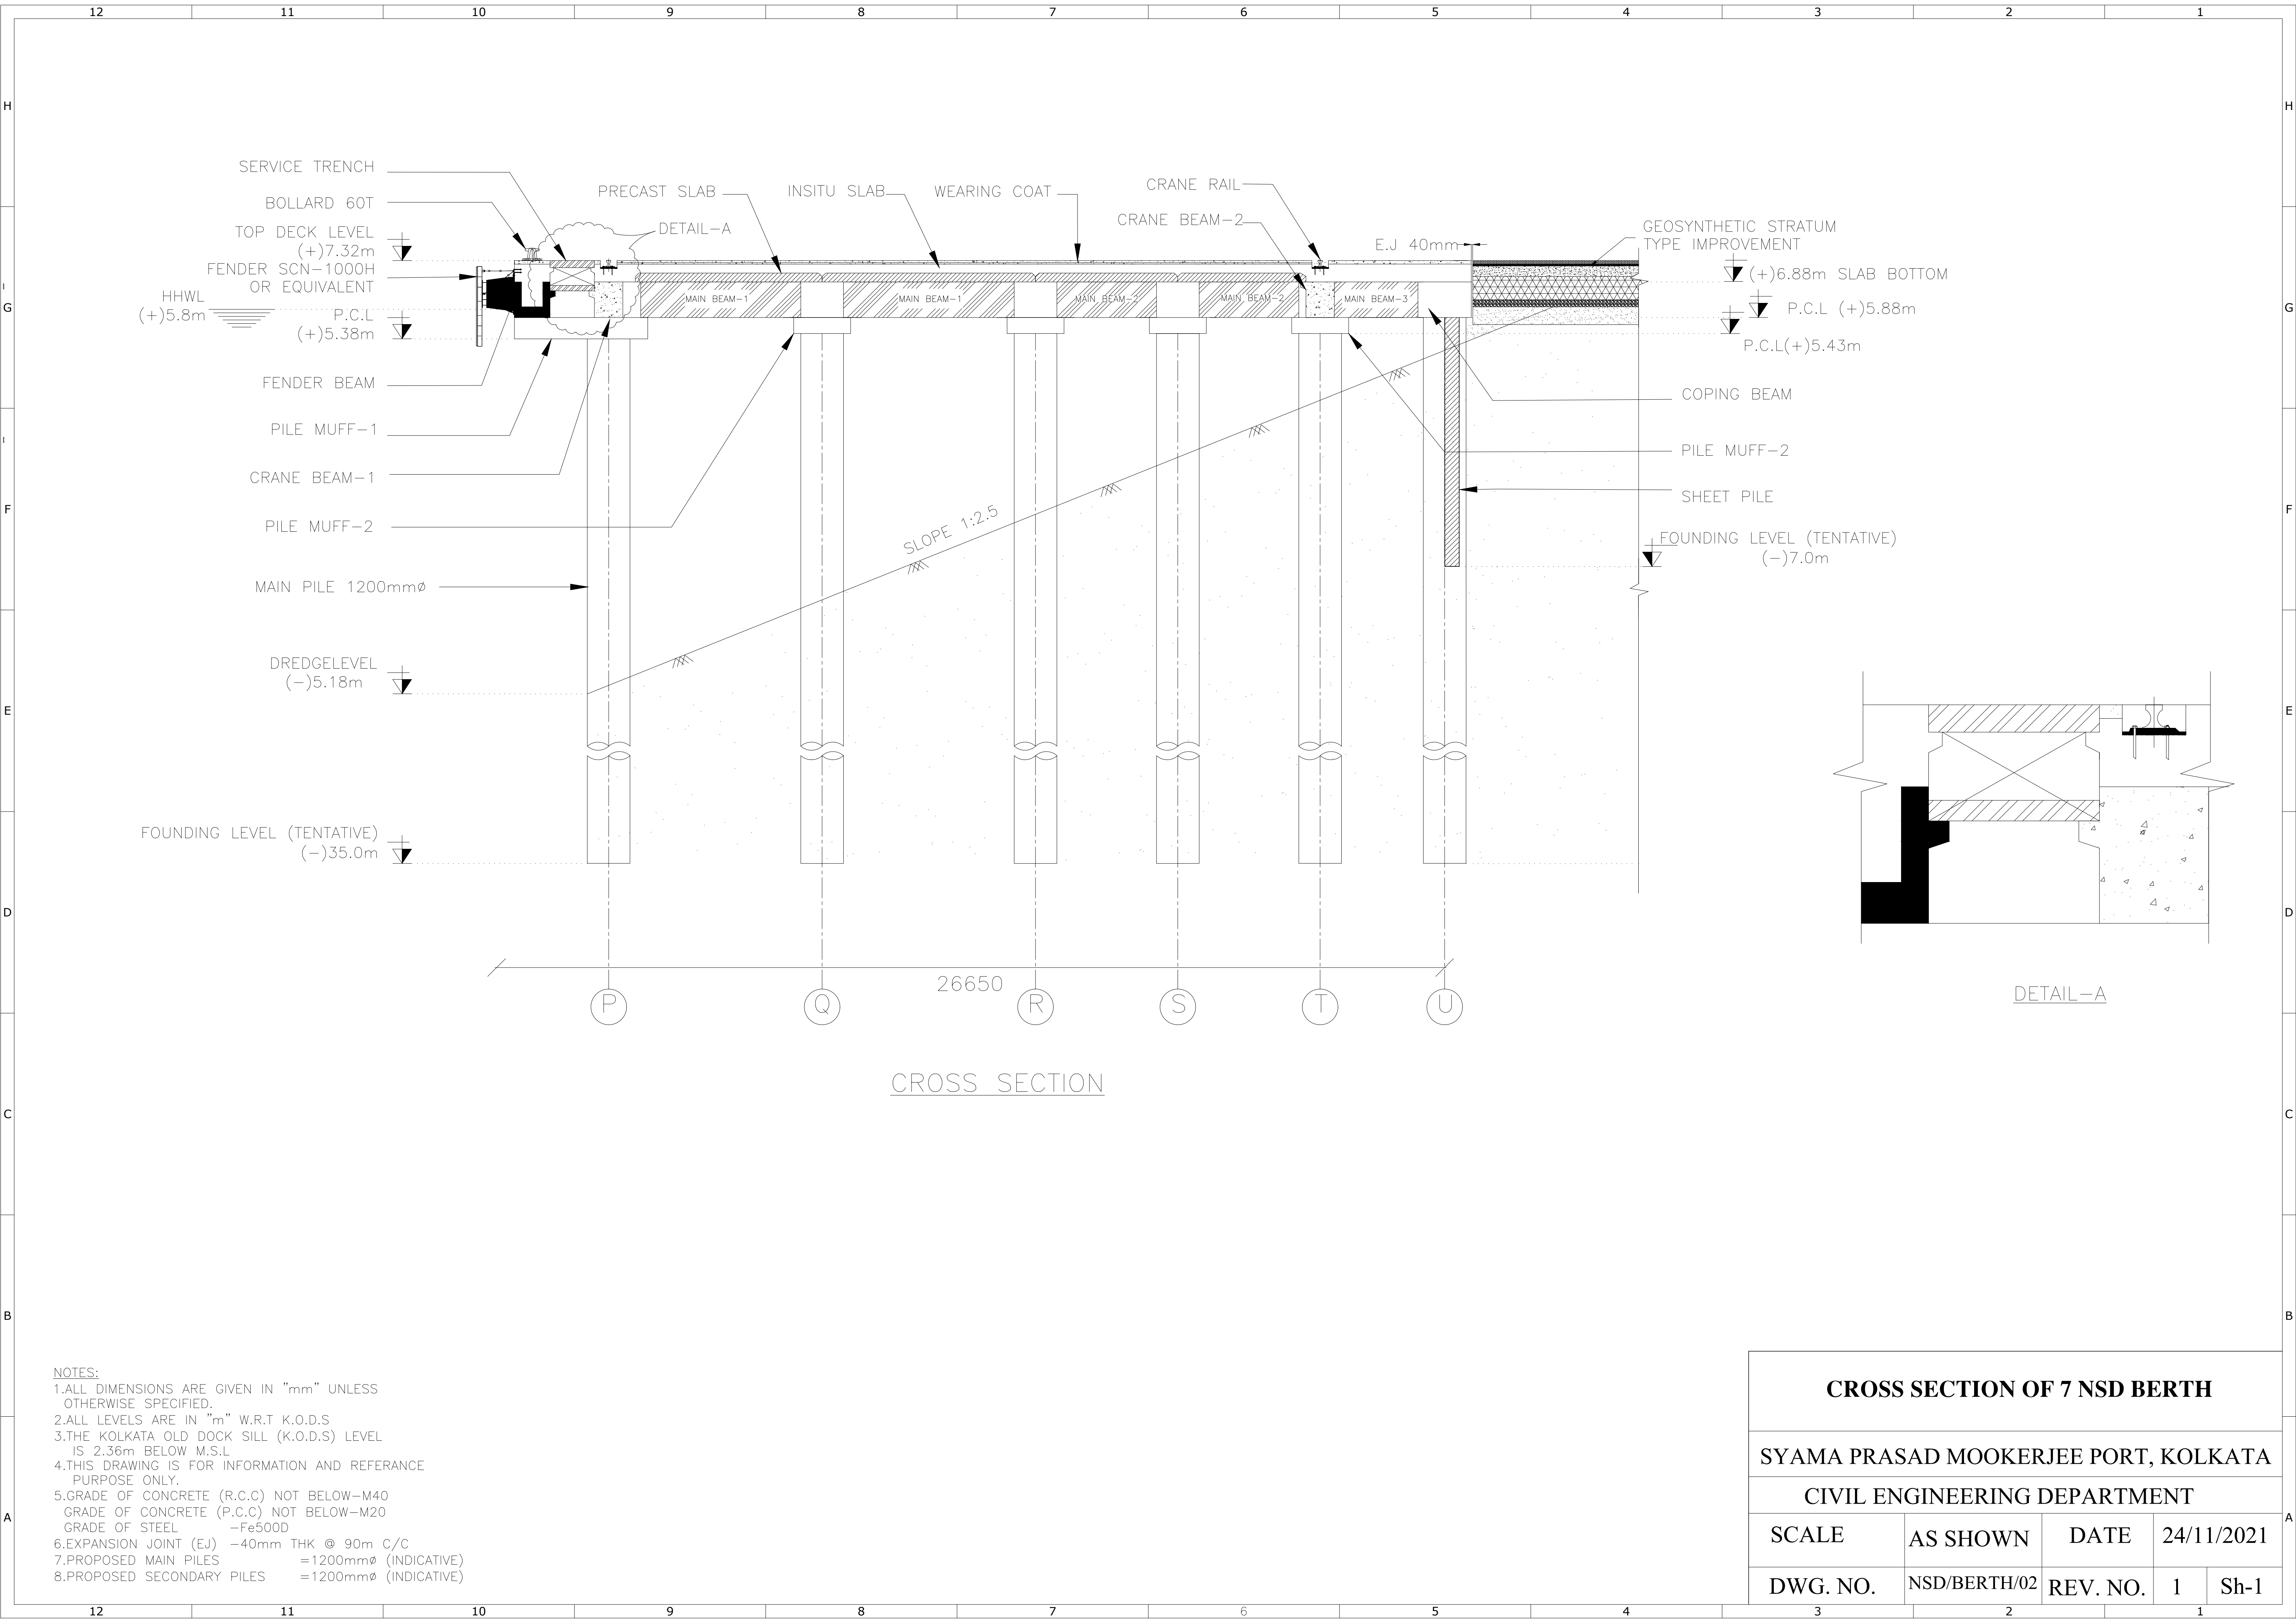


CROSS SECTION OF 7 NSD BERTH				
SYAMA PRASAD MOOKERJEE PORT, KOLKATA				
CIVIL ENGINEERING DEPARTMENT				
SCALE	AS SHOWN	DATE	24/11/2021	
DWG. NO.	NSD/BERTH/02	REV. NO.	1	Sh-1

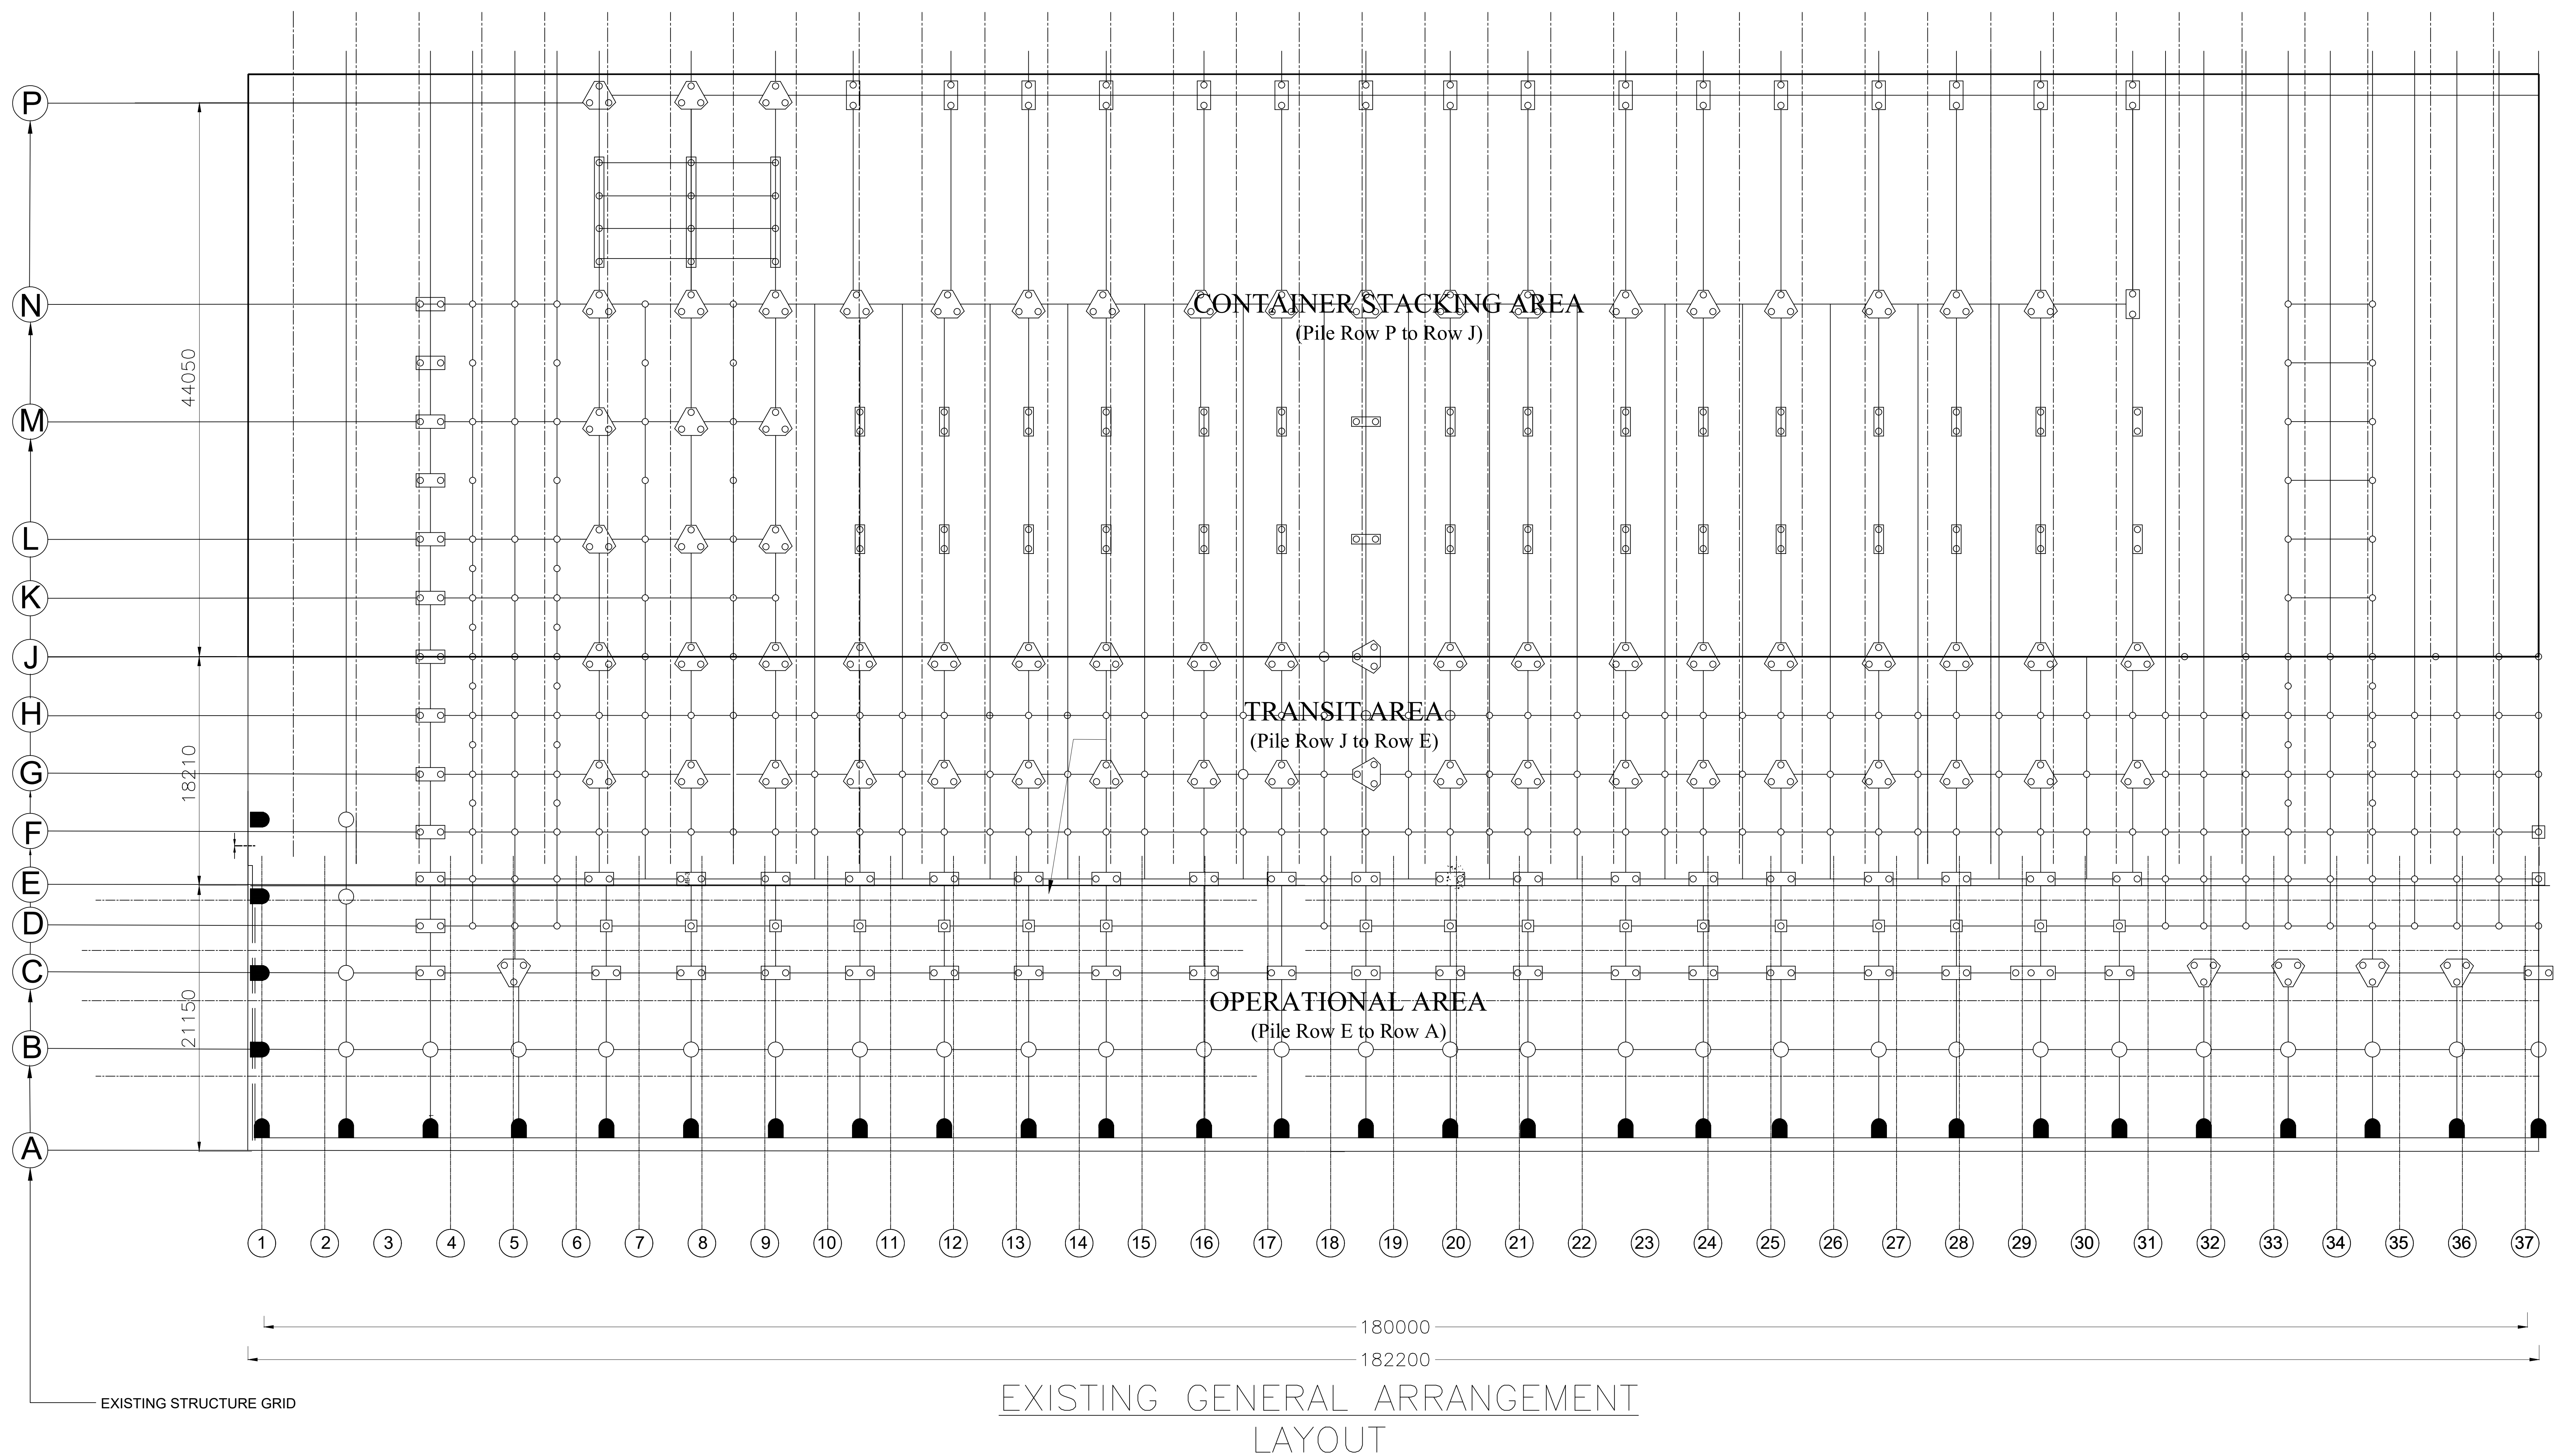

- NOTES:
- 1.ALL DIMENSIONS ARE GIVEN IN "mm" UNLESS OTHERWISE SPECIFIED.
  - 2.ALL LEVELS ARE IN "m" W.R.T K.O.D.S
  - 3.THE KOLKATA OLD DOCK SILL (K.O.D.S) LEVEL IS 2.36m BELOW M.S.L
  - 4. EXISTING PILES ARE OF 550MM FRANKI PILES.

EXISTING LAYOUT OF 7 NSD BERTH				
SYAMA PRASAD MOOKERJEE PORT, KOLKATA				
CIVIL ENGINEERING DEPARTMENT				
SCALE	AS SHOWN	DATE	24/11/2021	
DWG. NO.	NSD/BERTH/03	REV. NO.	0	Sh-1



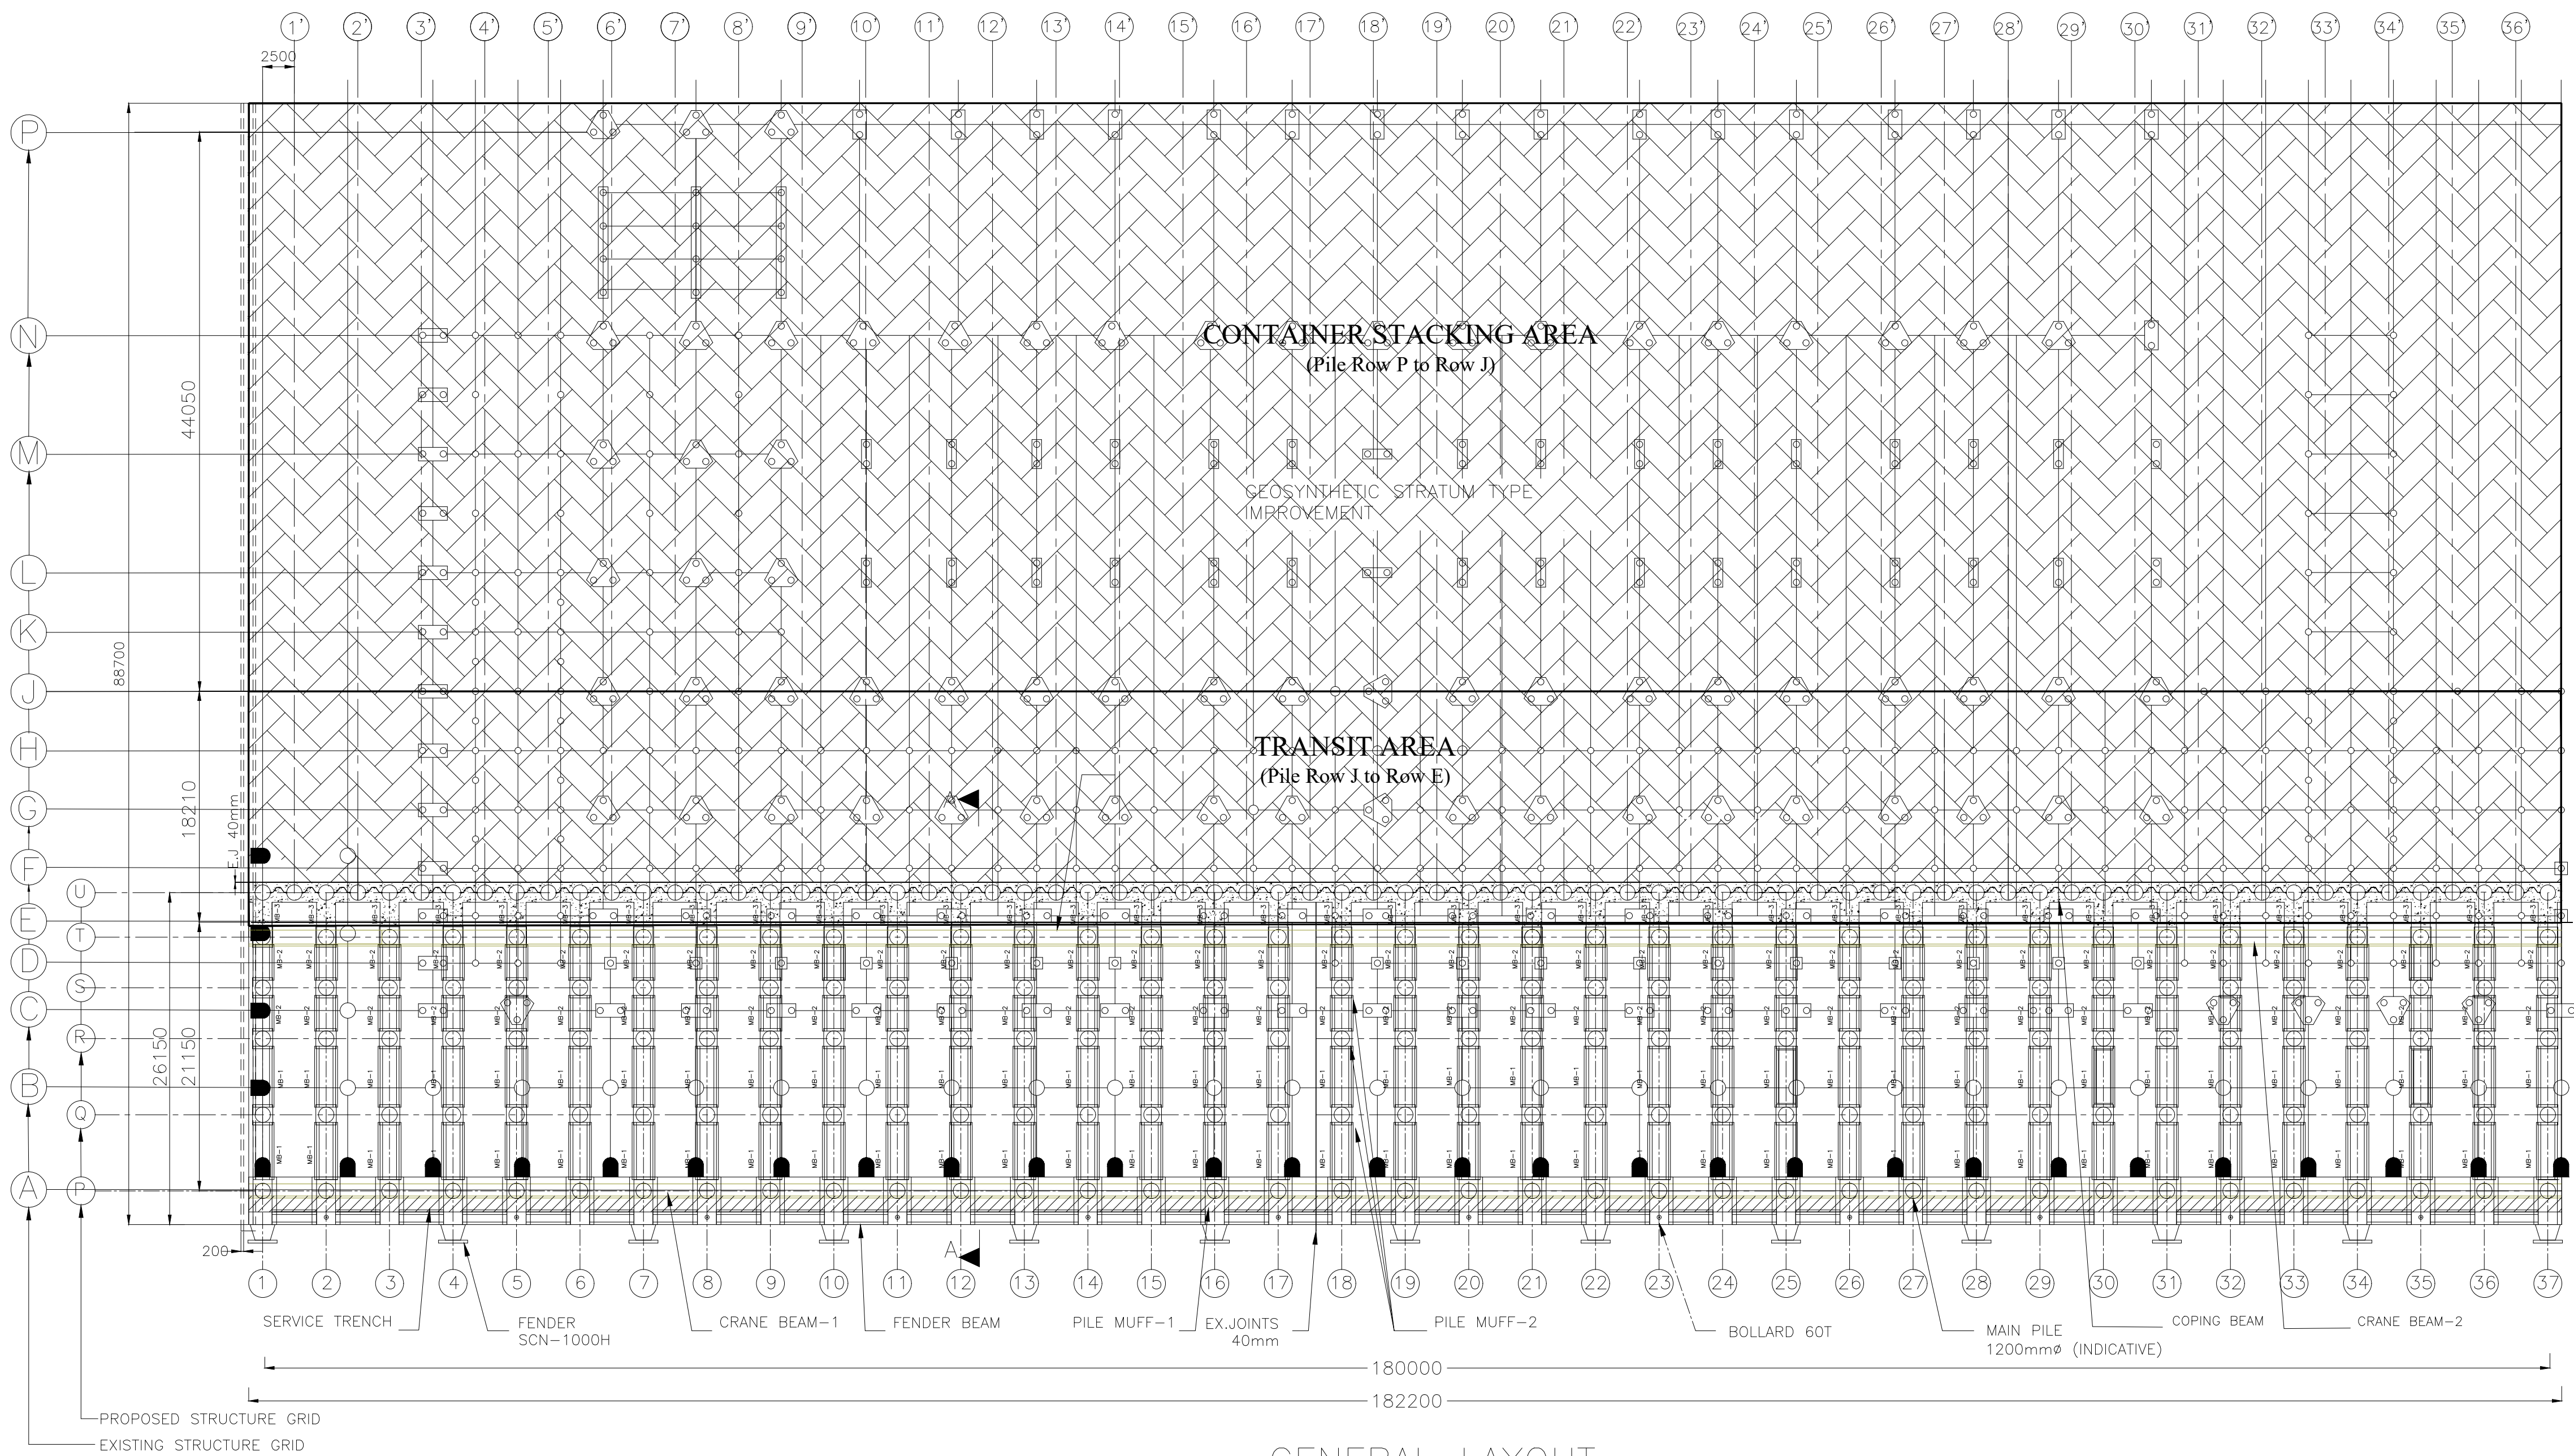

GENERAL LAYOUT

SPECIAL NOTES:  
1. THE MENTIONED DIMENSION/LEVEL ARE  
TENTATIVE AND INFORMATION ONLY.

- NOTES:
- 1.ALL DIMENSIONS ARE GIVEN IN "mm" UNLESS OTHERWISE SPECIFIED.
  - 2.ALL LEVELS ARE IN "m" W.R.T K.O.D.S
  - 3.THE KOLKATA OLD DOCK SILL (K.O.D.S) LEVEL IS 2.36m BELOW M.S.L
  - 4.THIS DRAWING IS FOR INFORMATION AND REFERENCE PURPOSE ONLY.
  - 5.GRADE OF CONCRETE (R.C.C) NOT BELOW-M40  
GRADE OF CONCRETE (P.C.C) NOT BELOW-M20  
GRADE OF STEEL -Fe500D
  - 6.EXPANSION JOINT (EJ) -40mm THK @ 90m C/C
  - 7.PROPOSED MAIN PILES =1200mmØ (INDICATIVE)
  - 8.PROPOSED SECONDARY PILES =1200mmØ (INDICATIVE)


GENERAL ARRANGEMENT OF 7 NSD BERTH

SYAMA PRASAD MOOKERJEE PORT, KOLKATA

CIVIL ENGINEERING DEPARTMENT

SCALE	AS SHOWN	DATE	24/11/2021	
DWG. NO.	NSD/BERTH/01	REV. NO.	0	Sh-1



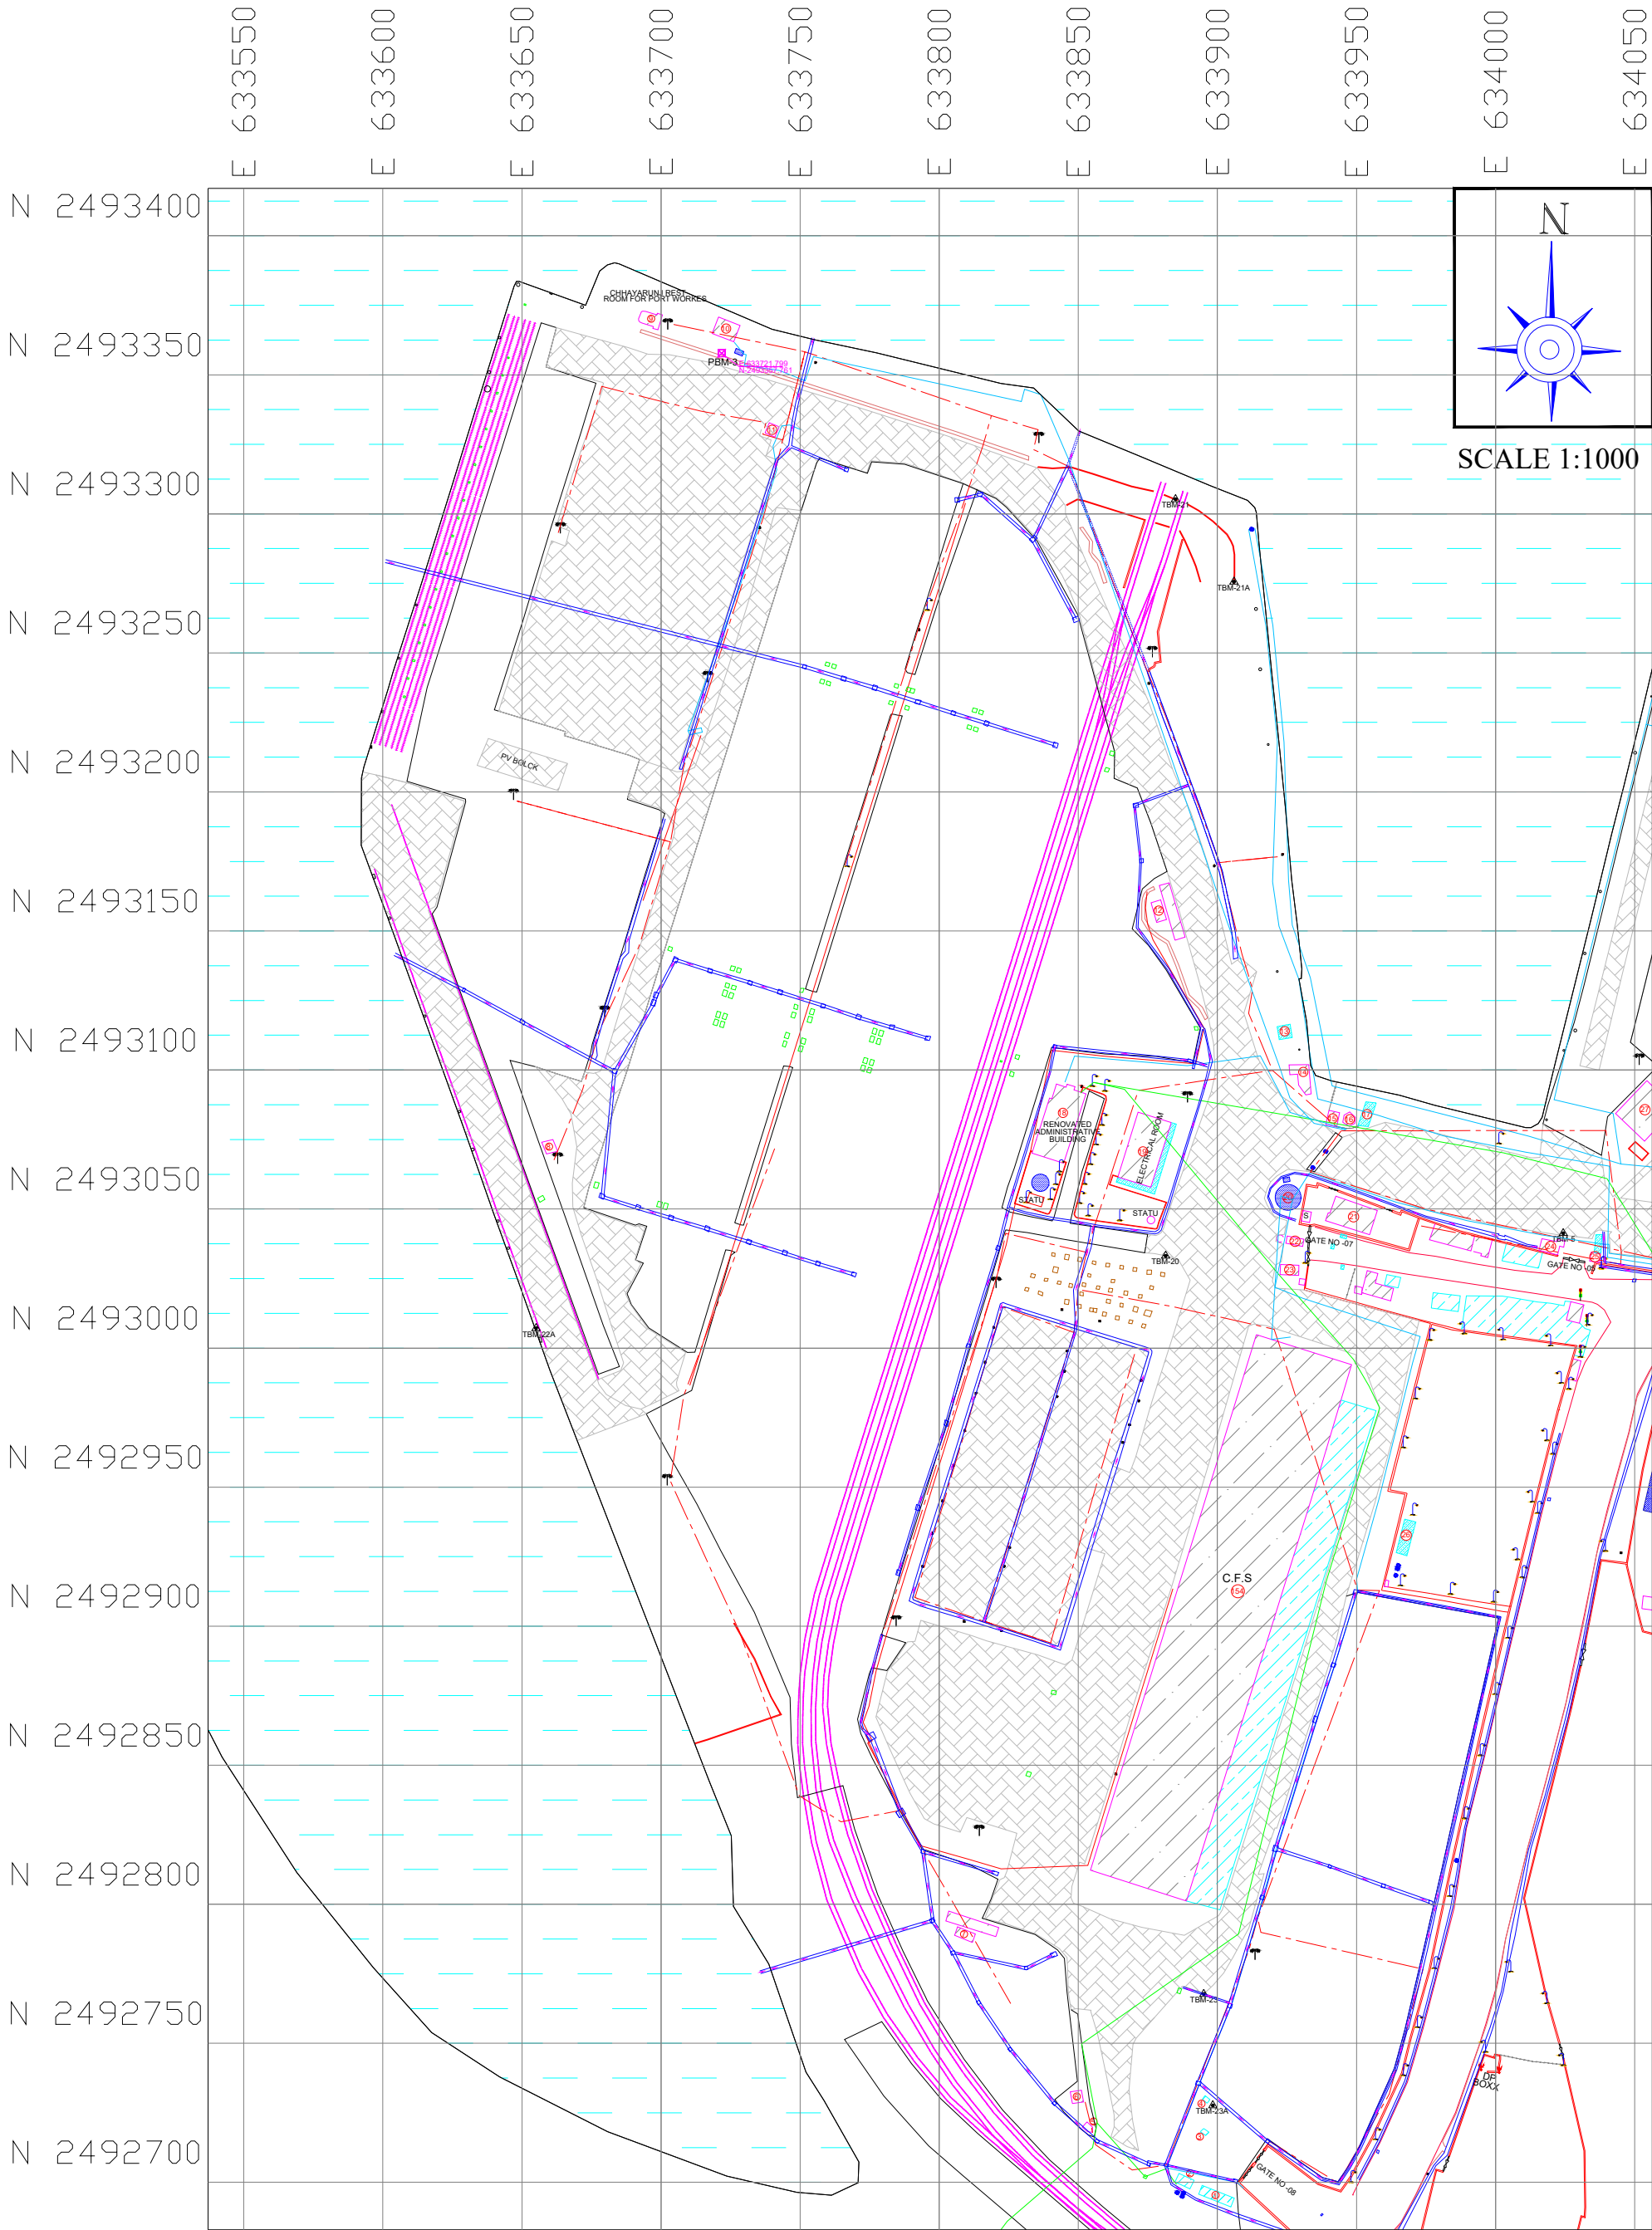

LEGEND			
STRUCTURE		DRAINAGE CHAMBER & LINE	
CONCRETE ROAD		WATER TANK	
BITUMANS ROAD EDGE		ELECTRICAL PANNAL BOARD	
PV BOLCK ROAD EDGE		ELECTRIC POLES	
FIBER OPTIC CHAMBER & LINE		WATER PIPE LINE	
IT FIBER OPTIC LINES CHAMBER		ELECTRIC CABLE	
RAILWAY LINE		STREET LIGHT POLE	
BOLLARD		PBM	
TREE		TBM	

SURVEY DRAWING OF 7 NSD BERTH WITH UTILITY LINES AT NSD			
SYAMA PRASAD MOOKERJEE PORT, KOLKATA			
CIVIL ENGINEERING DEPARTMENT			
SCALE	1:1	DATE	10/08/2021
DWG. NO.	NSD/BERTH/04	REV. NO.	0 Sh-1

